


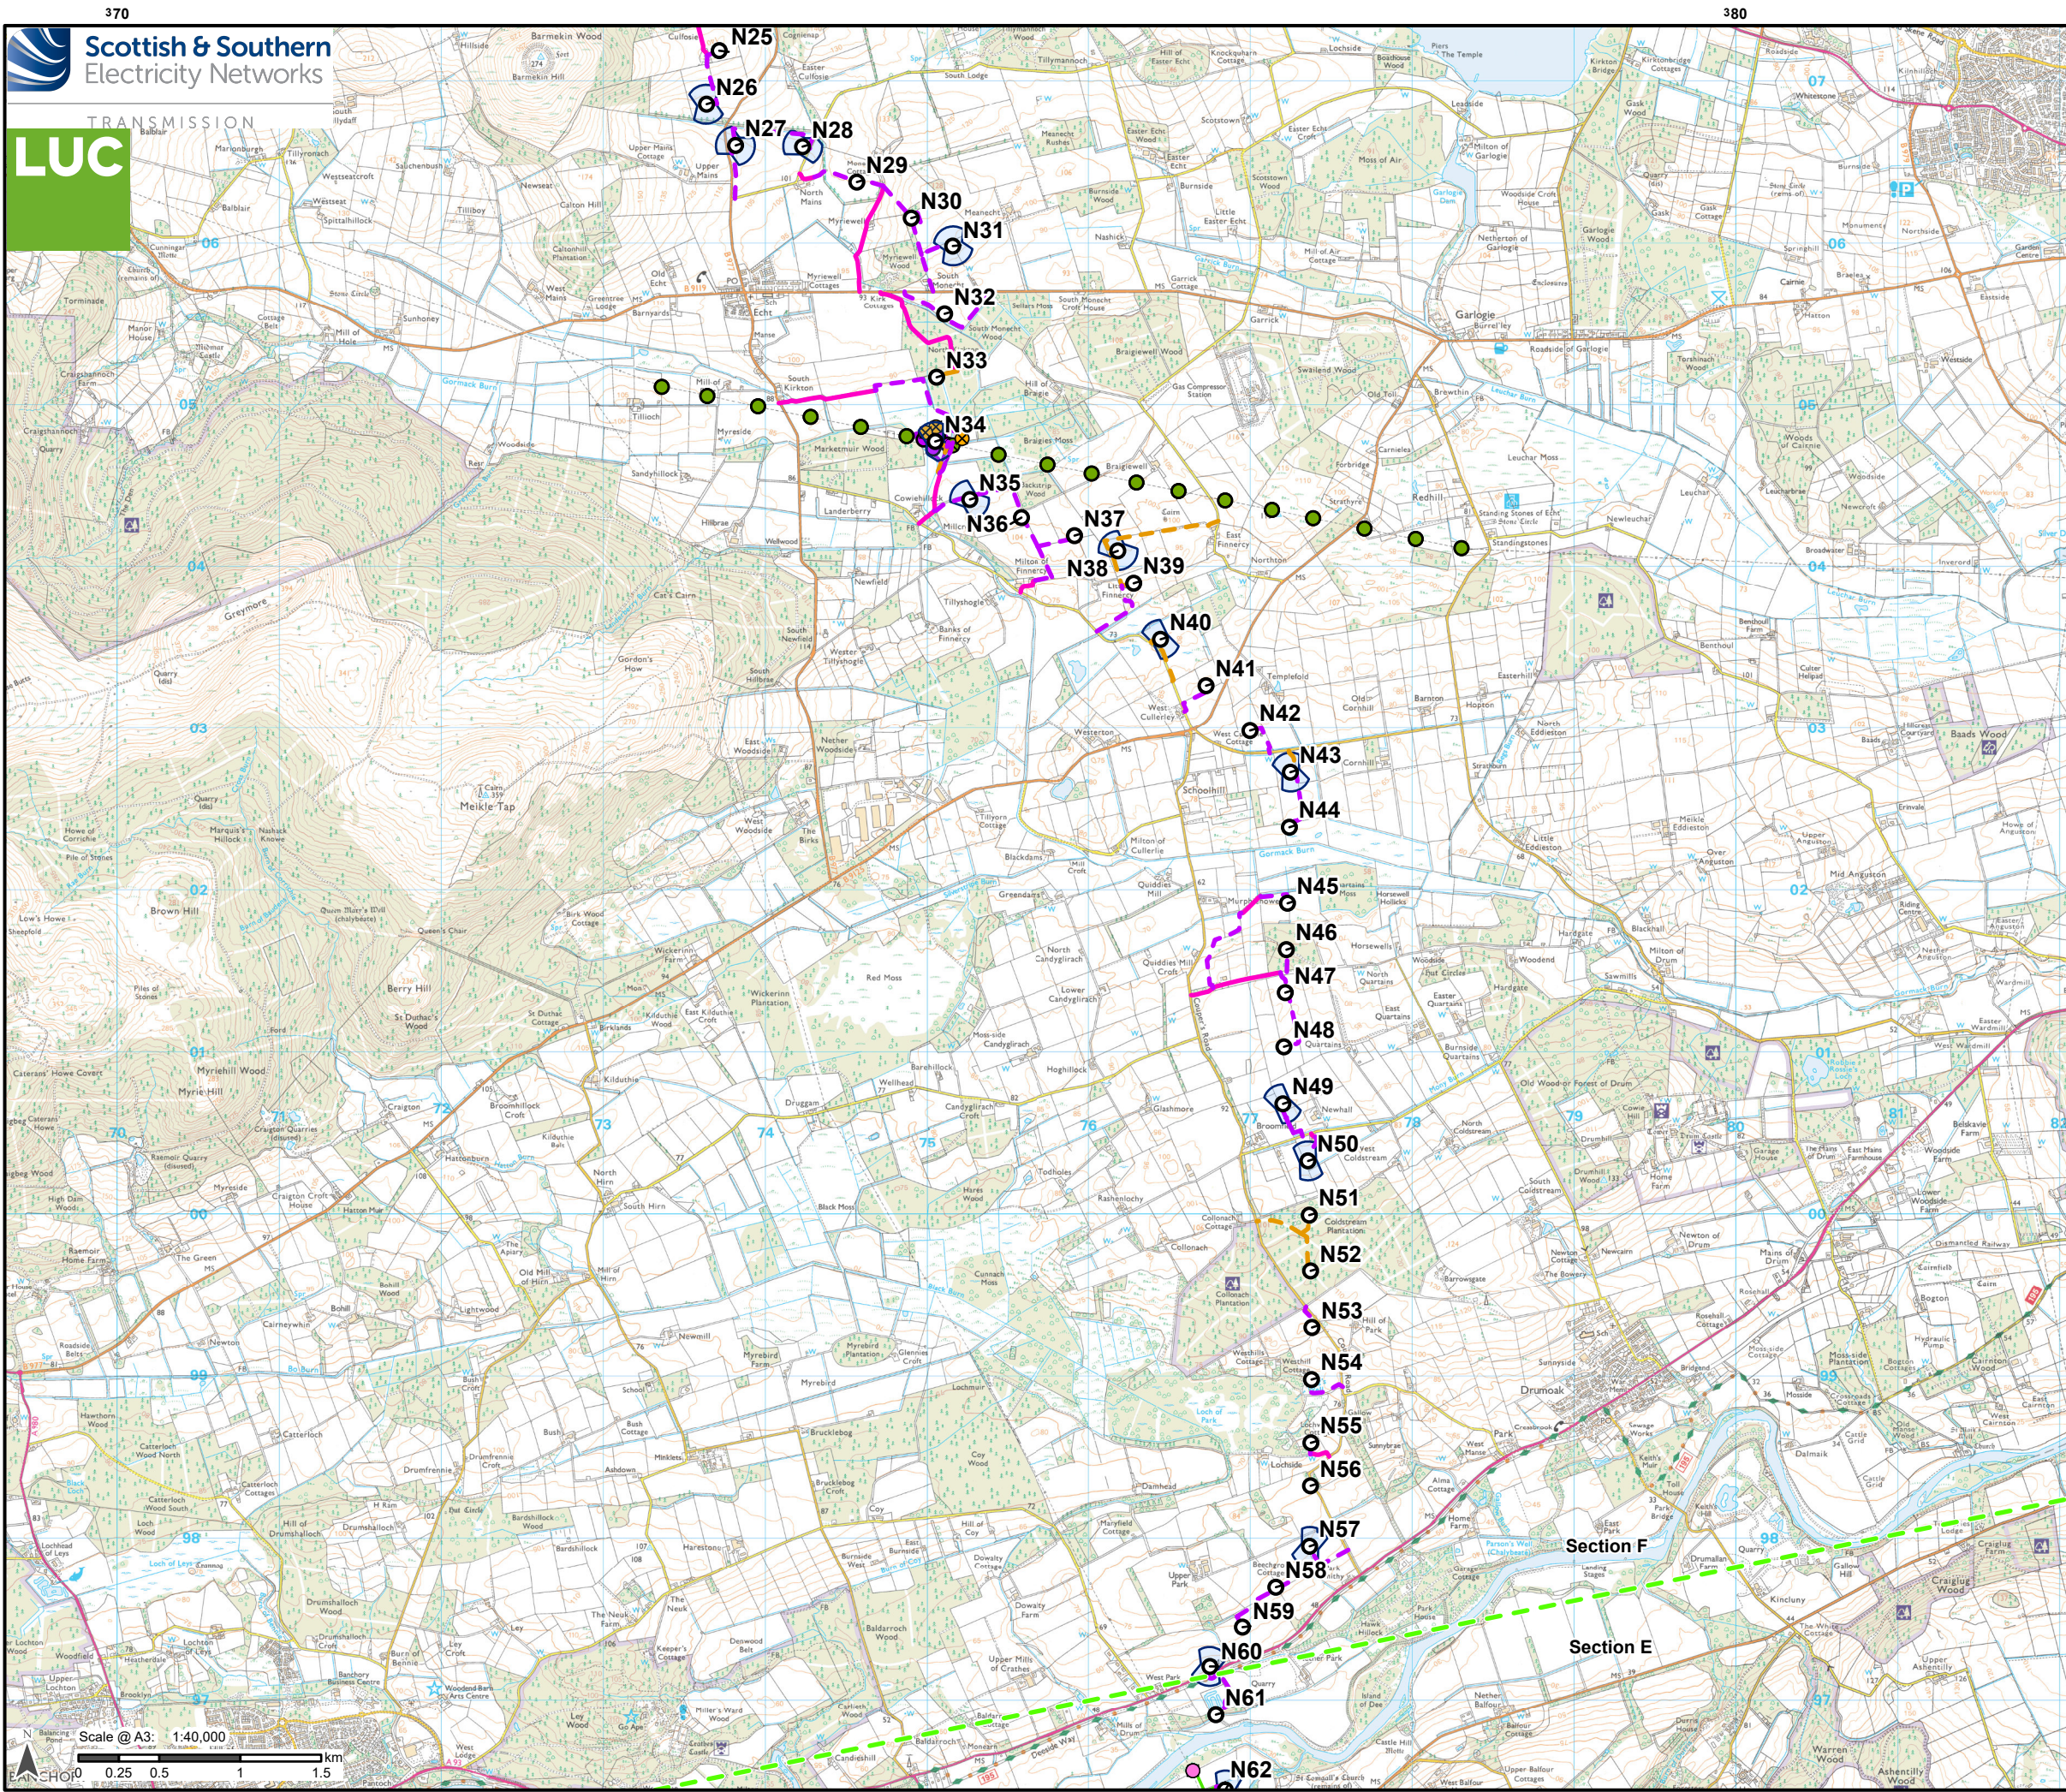

Alignment

- Proposed Tower
- Section boundary

Additional development to be included in Section 37 application

- Temporary 400kV Tower Position
- 400kV Diversion Tower Position
- Craigiebuckland -Tarland 132kV Temporary Tower Position
- Existing Craigiebuckland -Tarland 132kV Tower To Be Dismantled
- Existing Craigiebuckland -Tarland 132kV Tower Position
- Craigiebuckland -Tarland 132kV Diamond Diversion Tower Position

Access Track

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary
- 400kv Access Tracks
- CLN / CLS Access Tracks

Working area

- EPZ (Equipotential zones / Conductor pulling position)

*The conductor has been removed from this map. Please see the figure 1 'proposed alignment' section maps where the conductor is shown

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400kV Overhead Line

Title: Proposed Access Tracks and Working Areas - Section F - 1 of 2

Drawn by: CW Date: 14/02/2025

Drawing: 2.11