


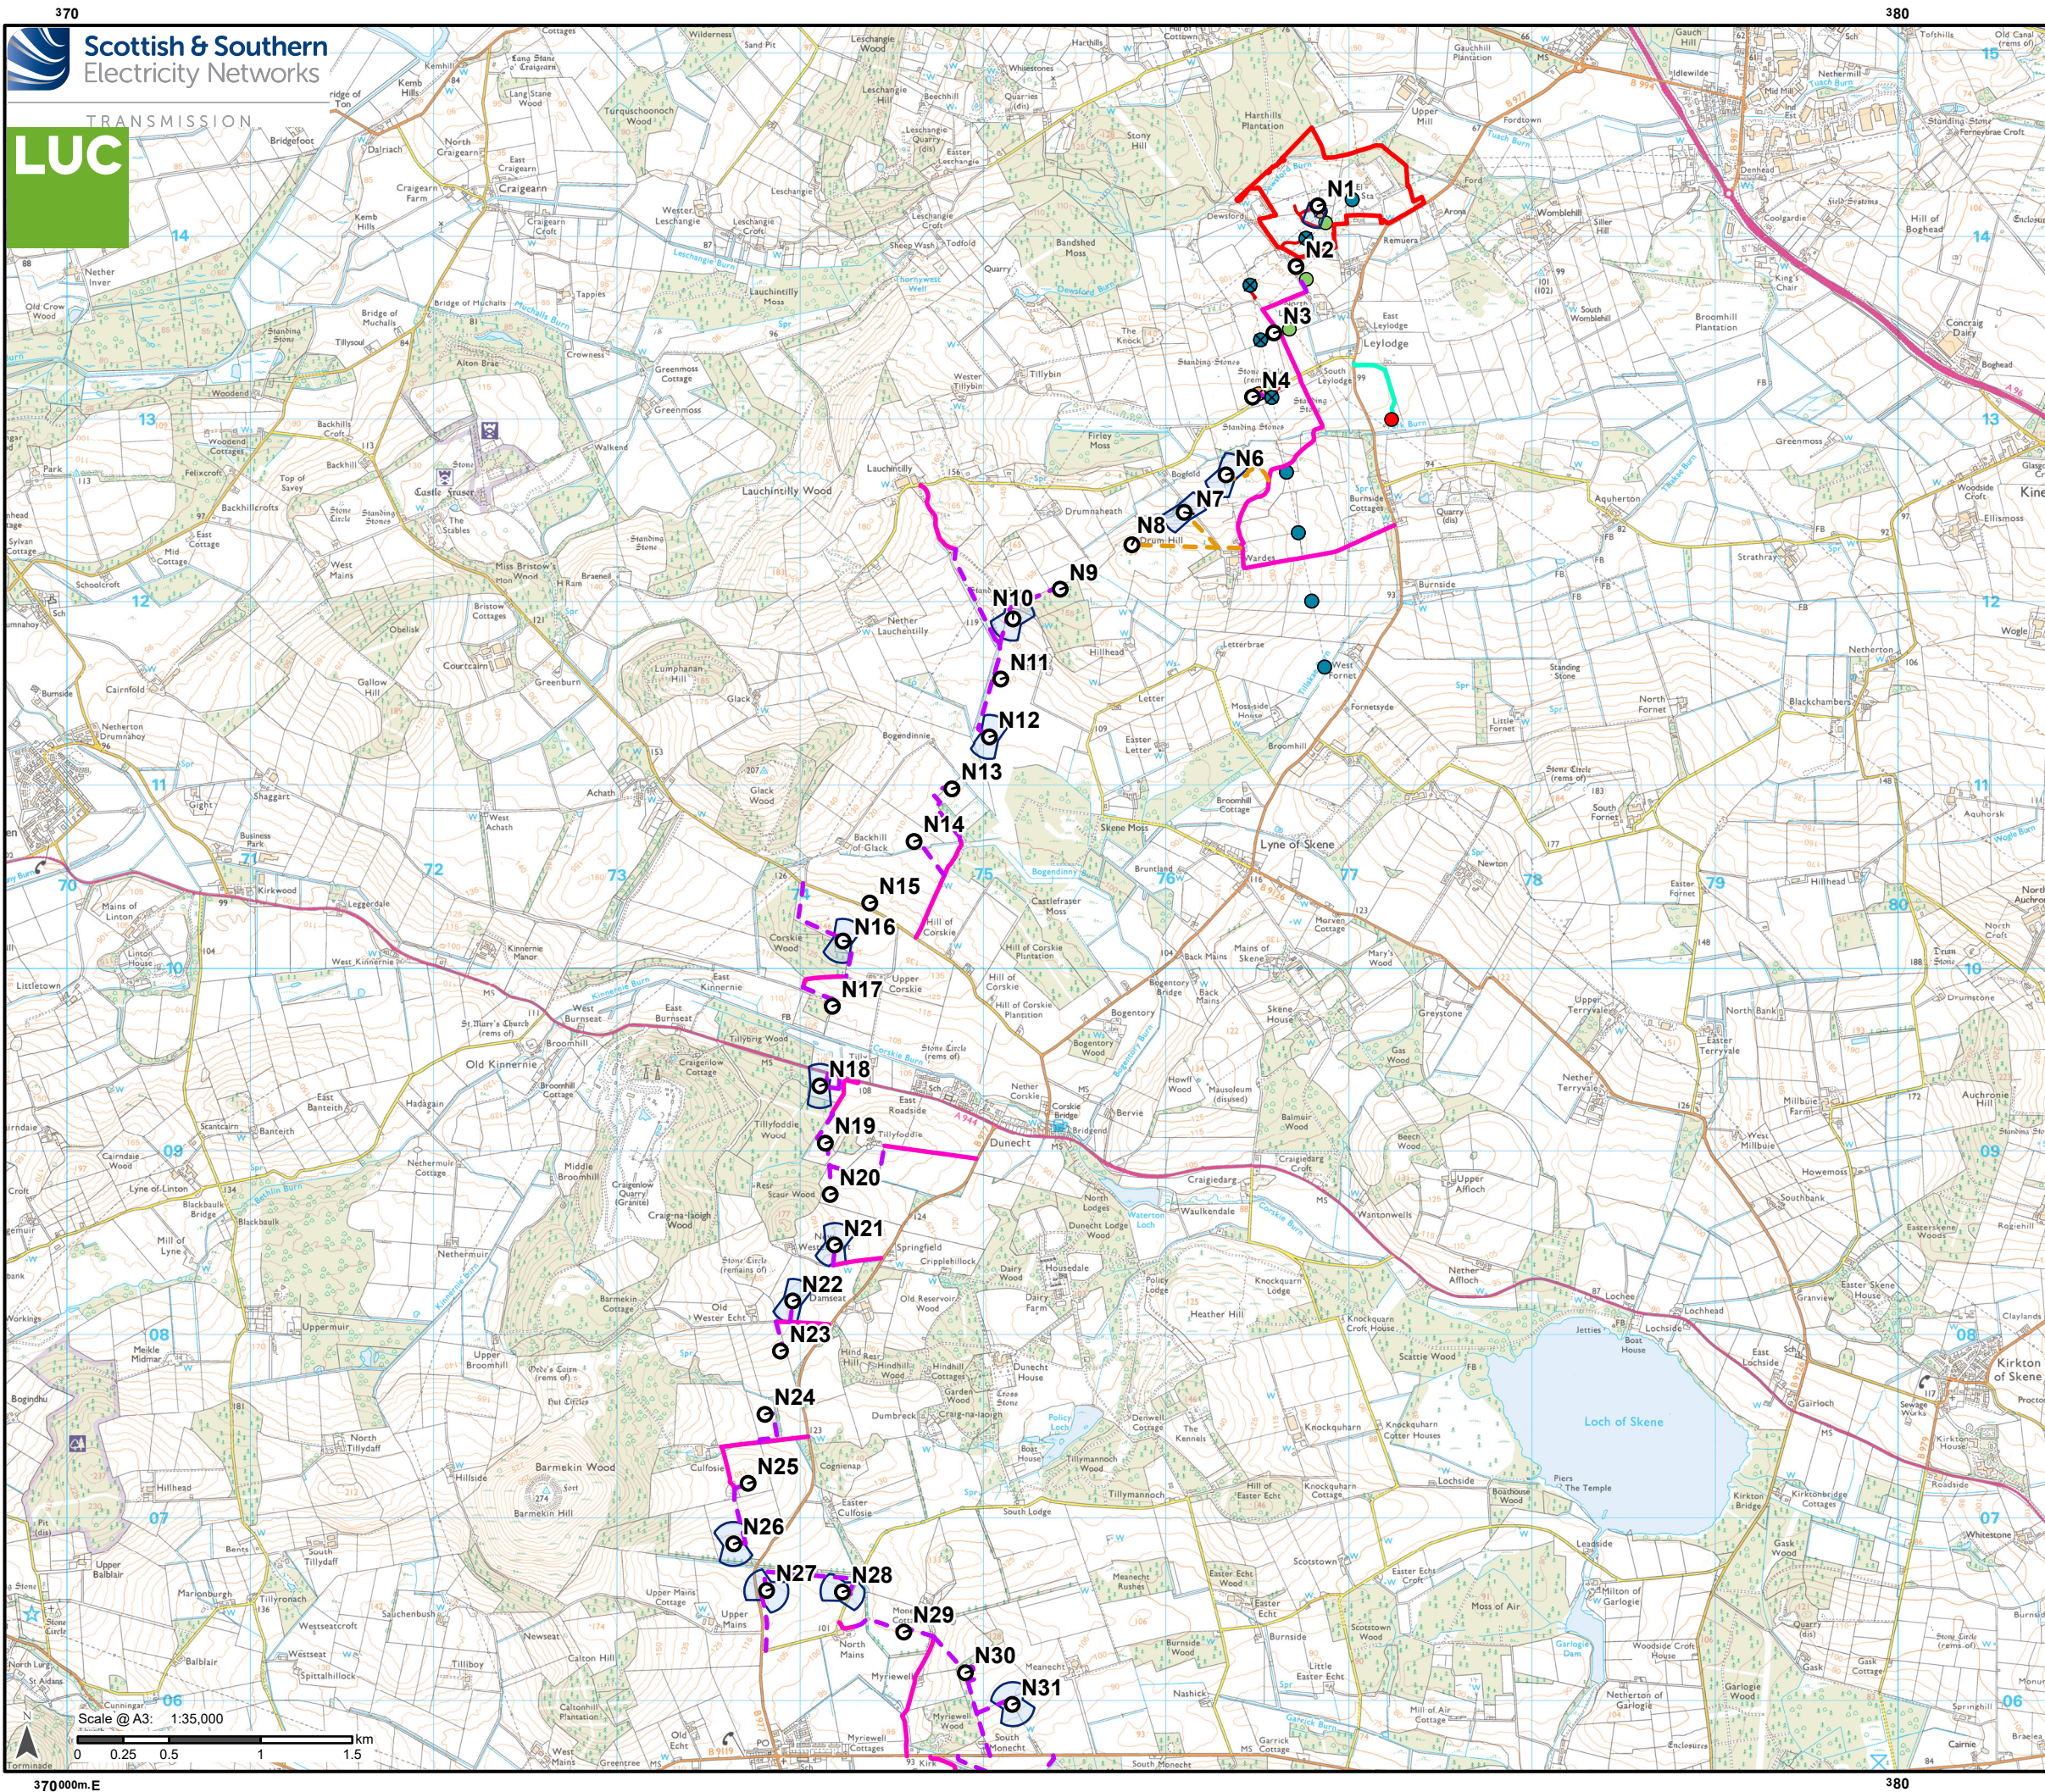

Alignment

- Proposed Tower

Substation

- Kintore Substation Ownership Boundary

Additional development to be included in Section 37 application

- ⊗ Temporary 275kV Tower Position
- ⊗ 275kV Tower To Be Dismantled
- Existing 275kV Tower Position
- 275kV Diversion Tower Position

Permitted Development

- Kintore - Craigiebuckler 132kV Tower Position

Access Track

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary
- Kintore - Craigiebuckler 132kV Access Tracks
- 275kV Access Tracks

Working area

- EPZ (Equipotential zones / Conductor pulling position)

*The conductor has been removed from this map. Please see the figure 1 'proposed alignment' section maps where the conductor is shown

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400kV Overhead Line

Title: Proposed Access Tracks and Working Areas - Section F - 2 of 2

Drawn by: CW

Date: 14/02/2025

Drawing: 2.12

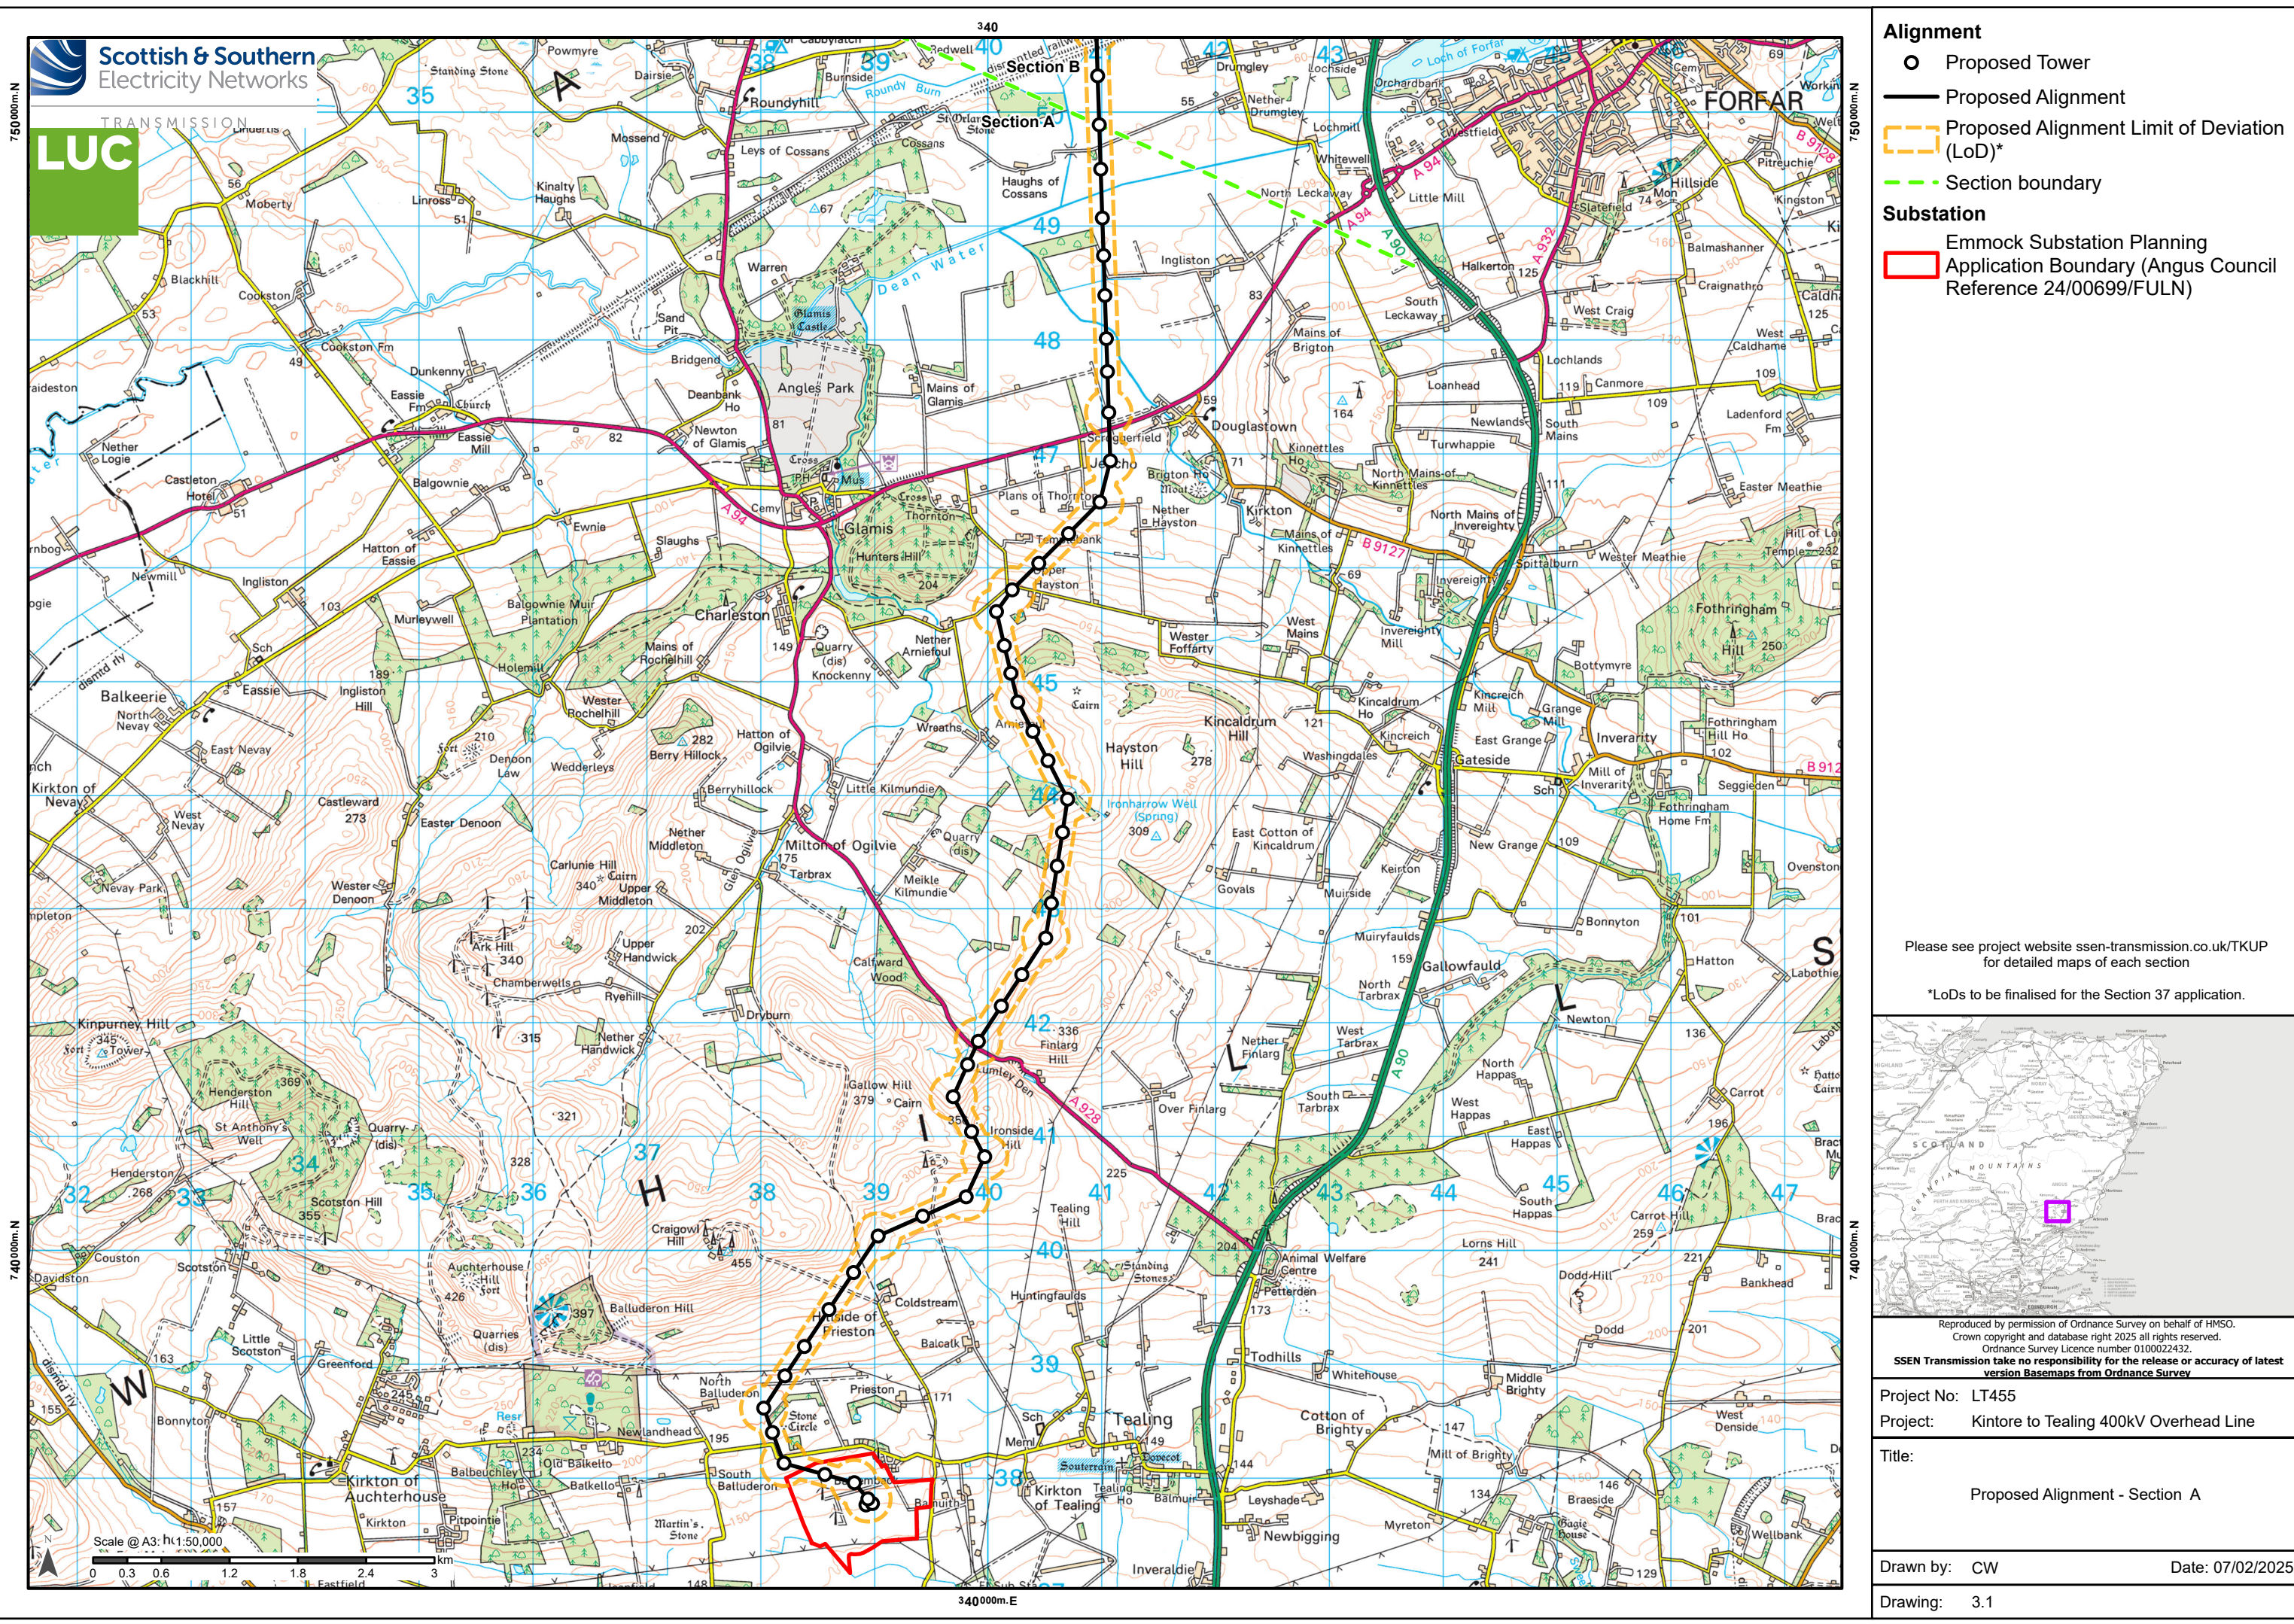

Alignment


- Proposed Tower
- Proposed Alignment
- Proposed Alignment Limit of Deviation (LoD)*
- Section boundary

Substation

- Emmock Substation Planning
- Application Boundary (Angus Council Reference 24/00699/FULN)

Please see project website ssen-transmission.co.uk/TKUP for detailed maps of each section

*LoDs to be finalised for the Section 37 application.

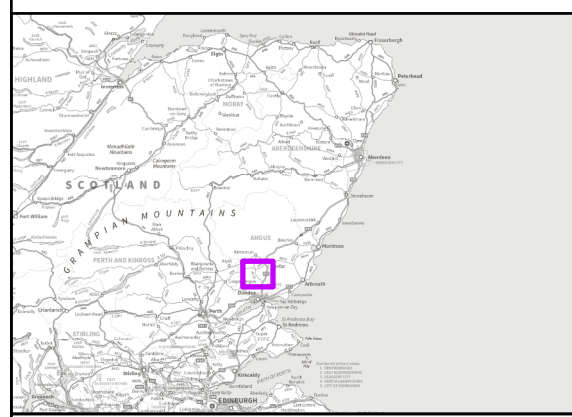

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400kV Overhead Line
Title:	Proposed Alignment - Section A
Drawn by:	CW
Date:	07/02/2025
Drawing:	3.1