

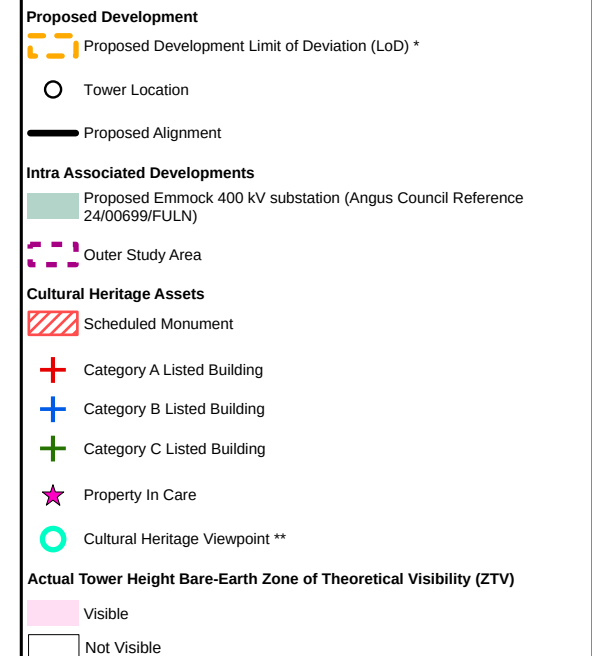


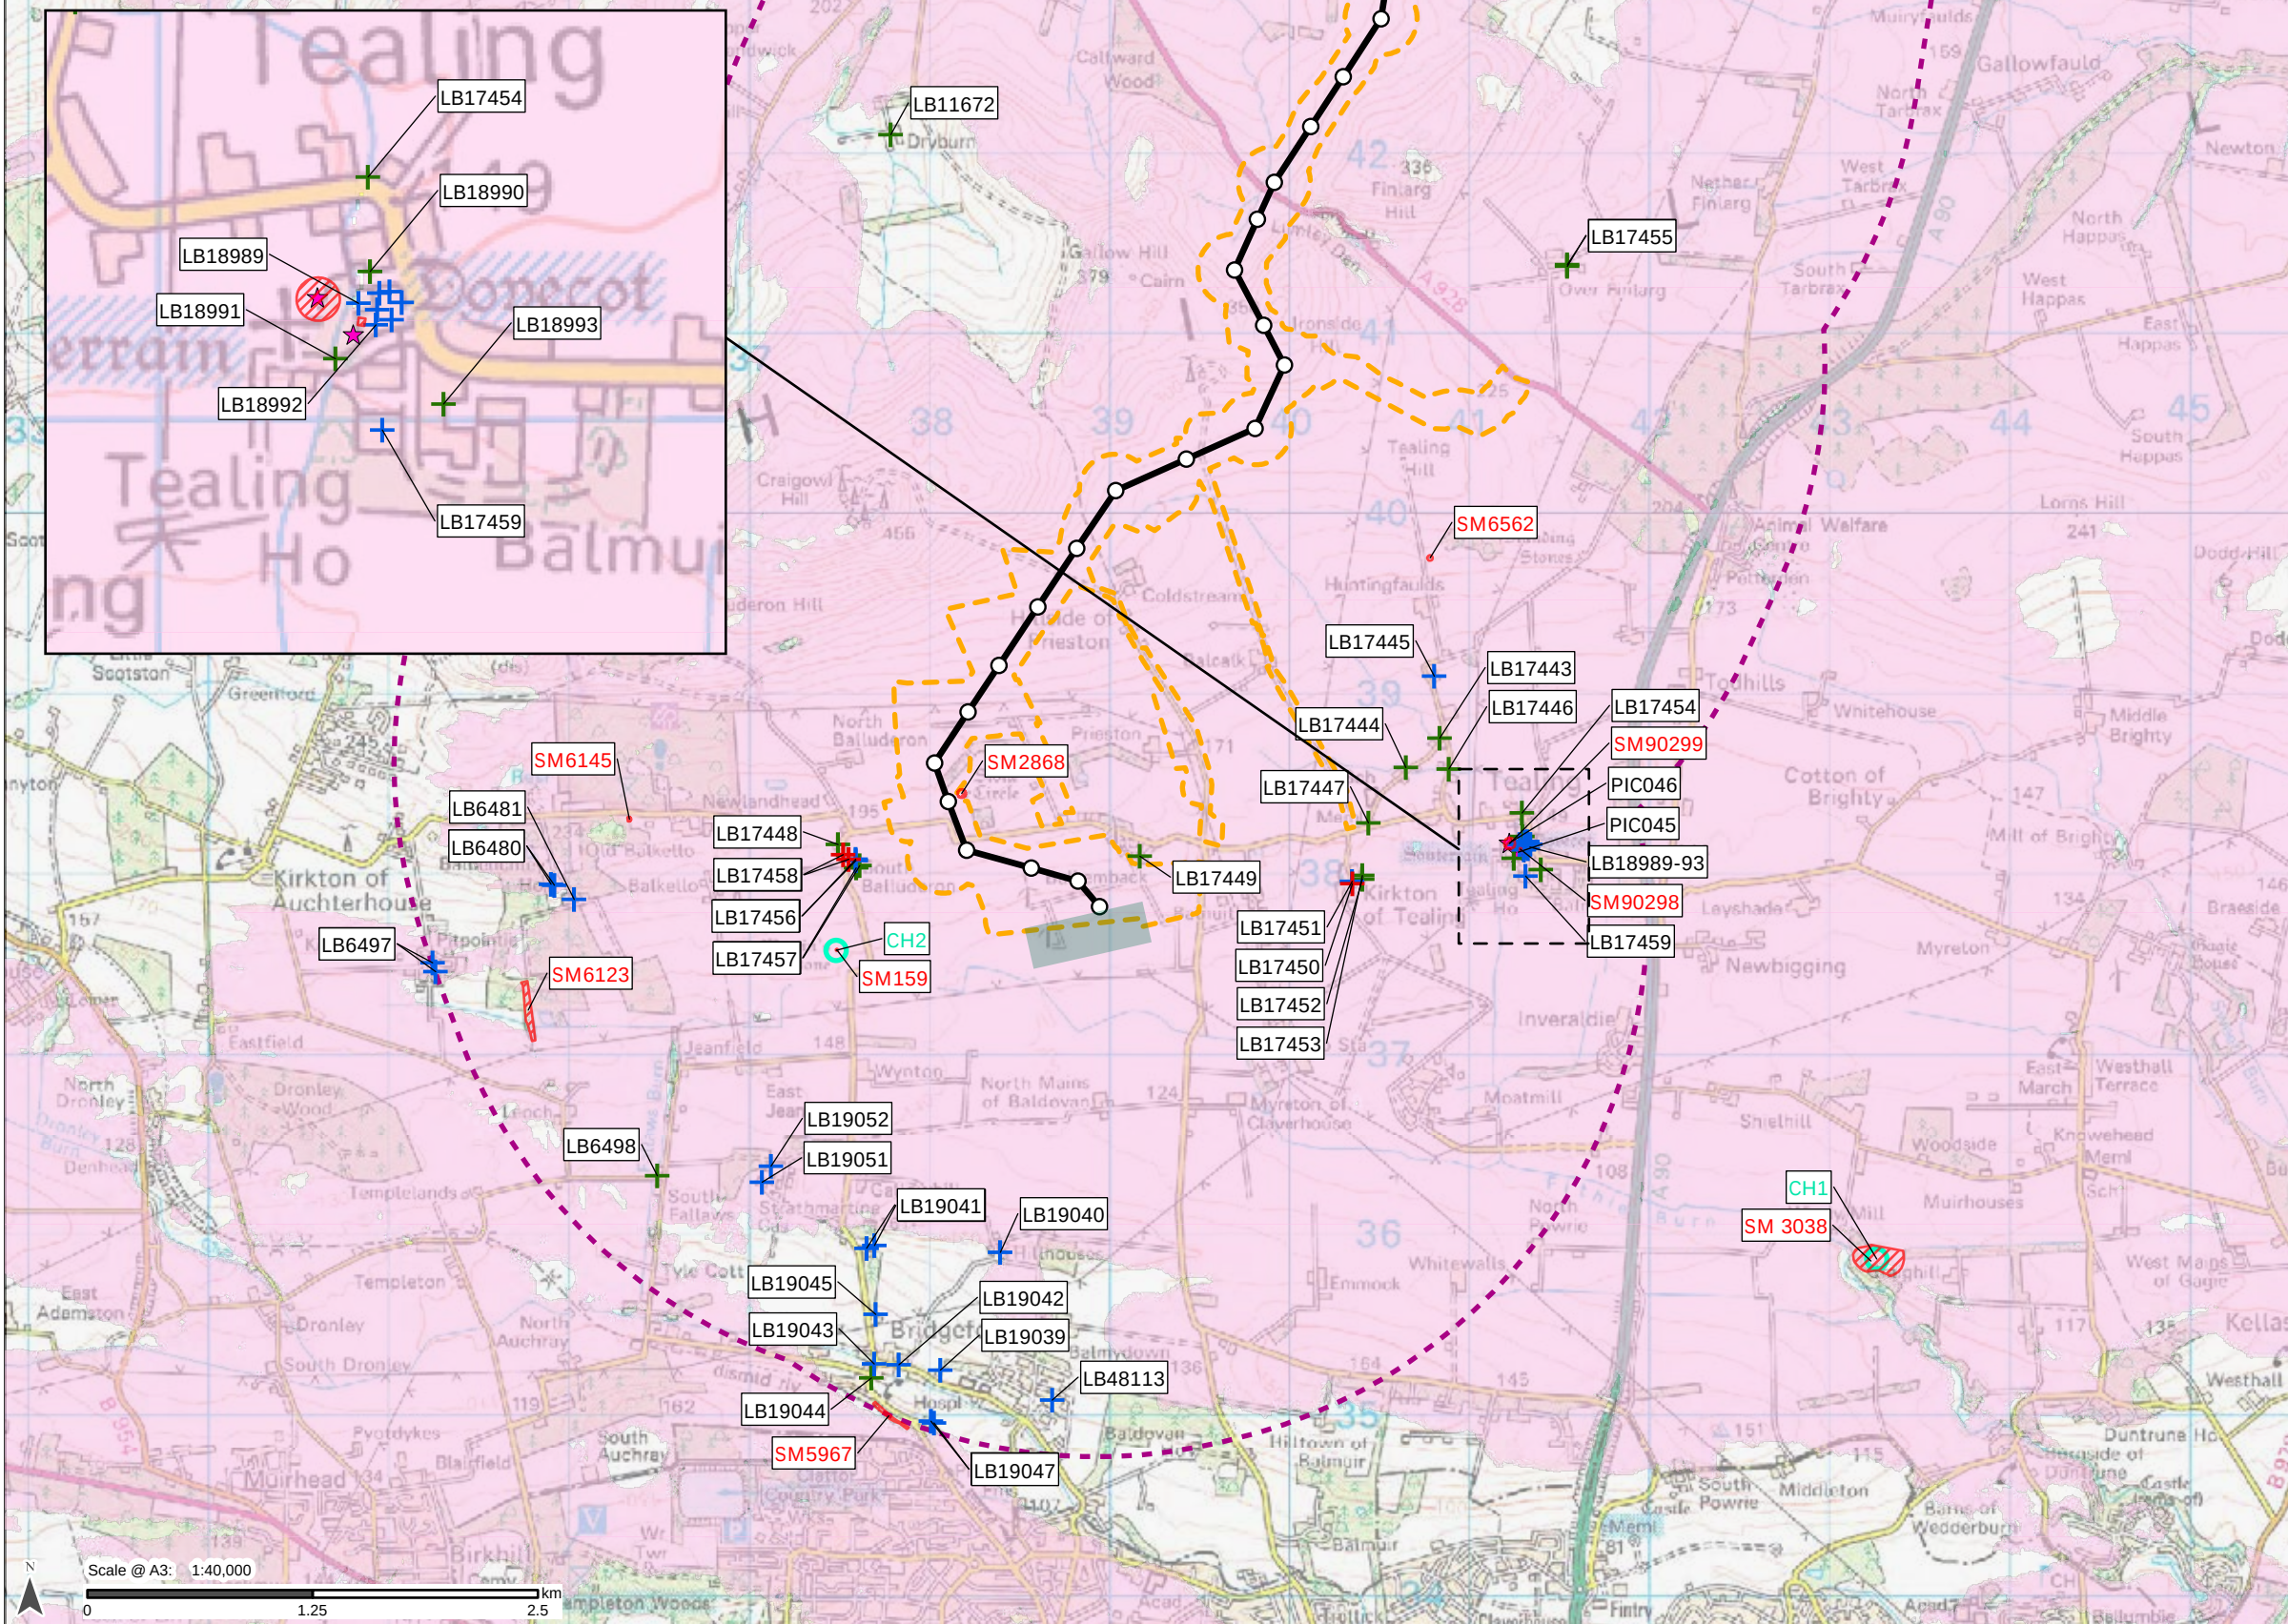

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

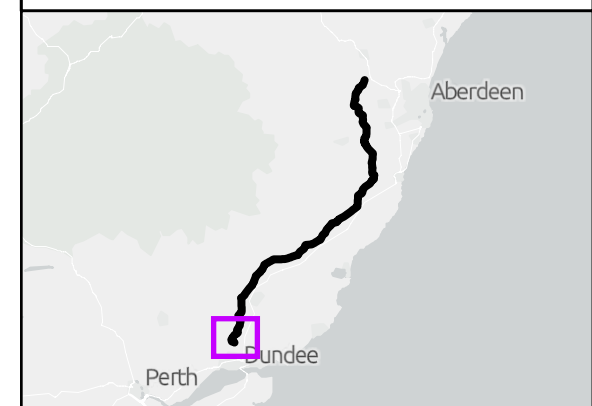


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Designated Heritage Assets: Outer Study Area
(and those outwith the Outer Study Area
included in the Assessment)

Drawn by: SB
Date: 15/08/2025

Drawing: 10.2.1

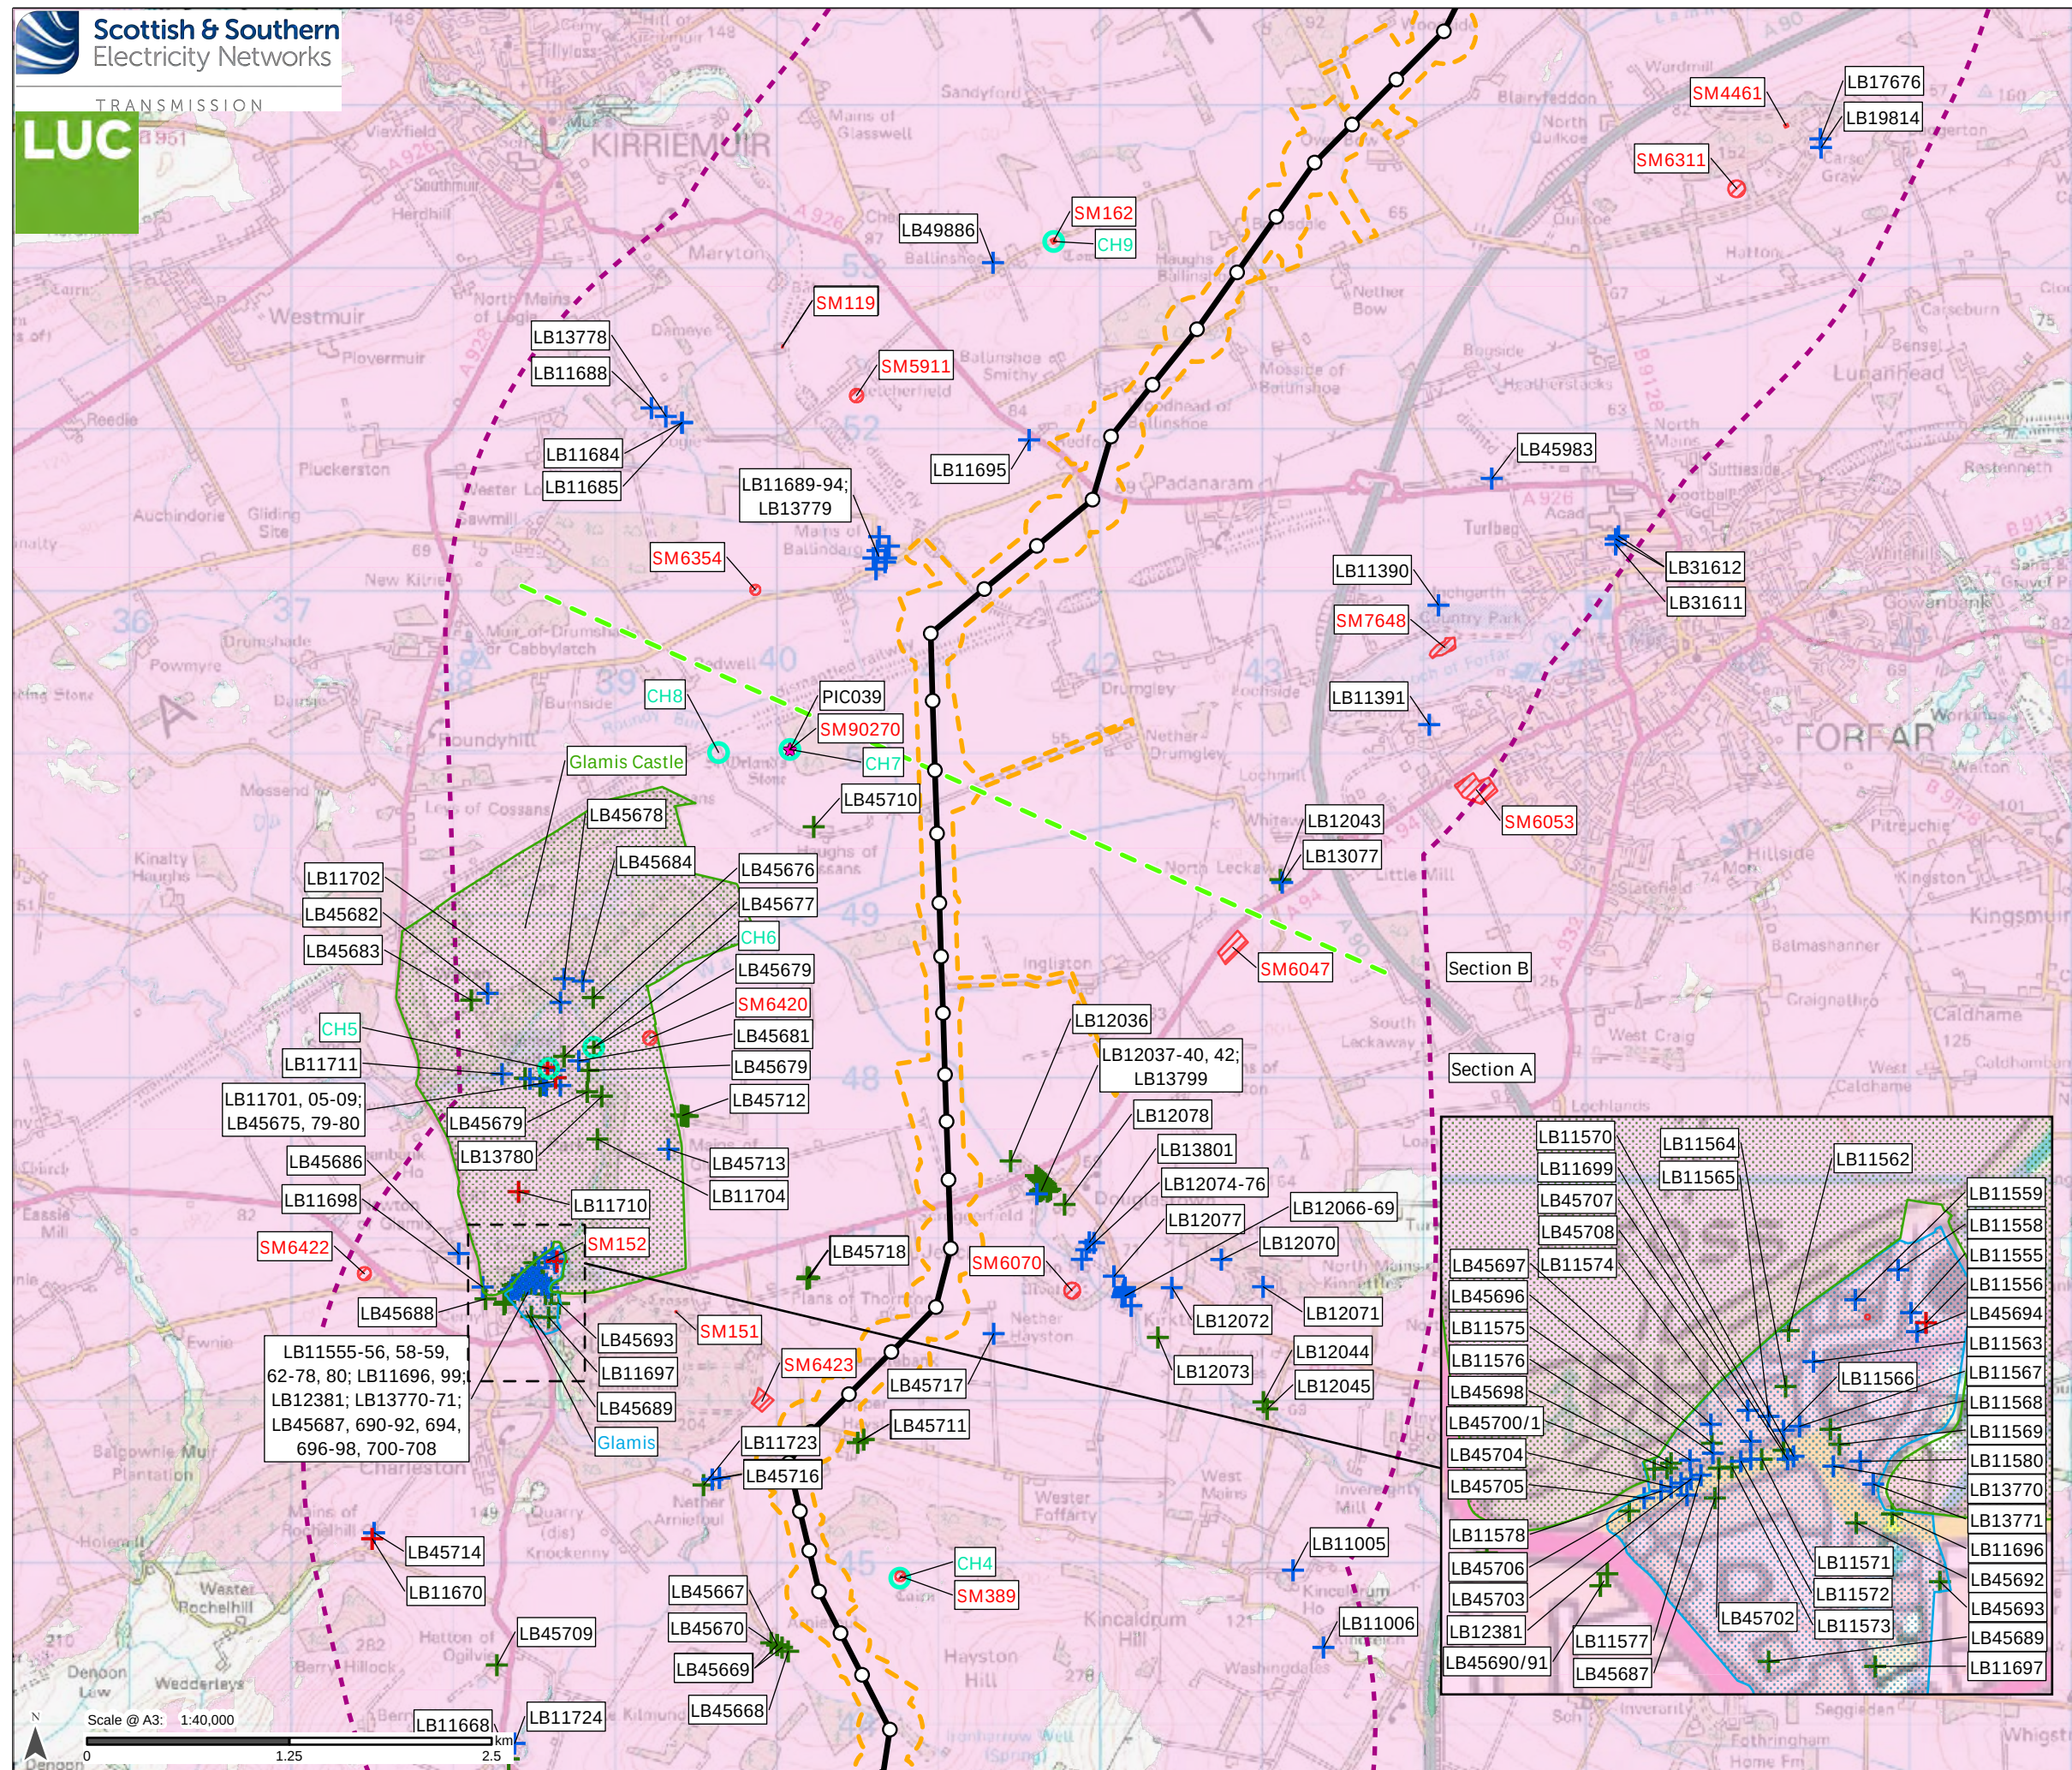

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey



Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)

Drawn by: SB Date: 15/08/2025


Drawing: 10.2.2

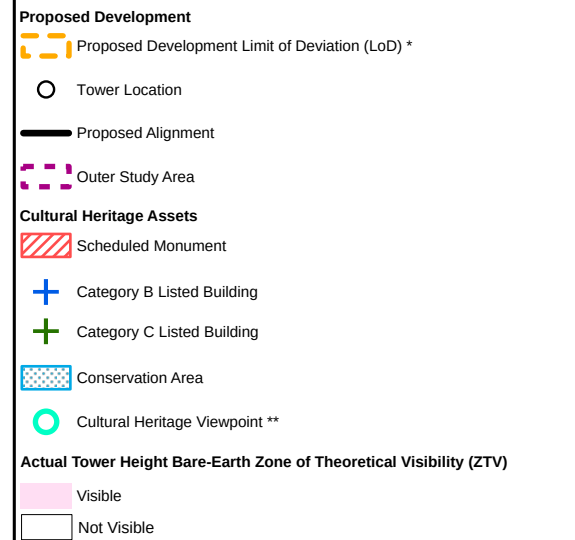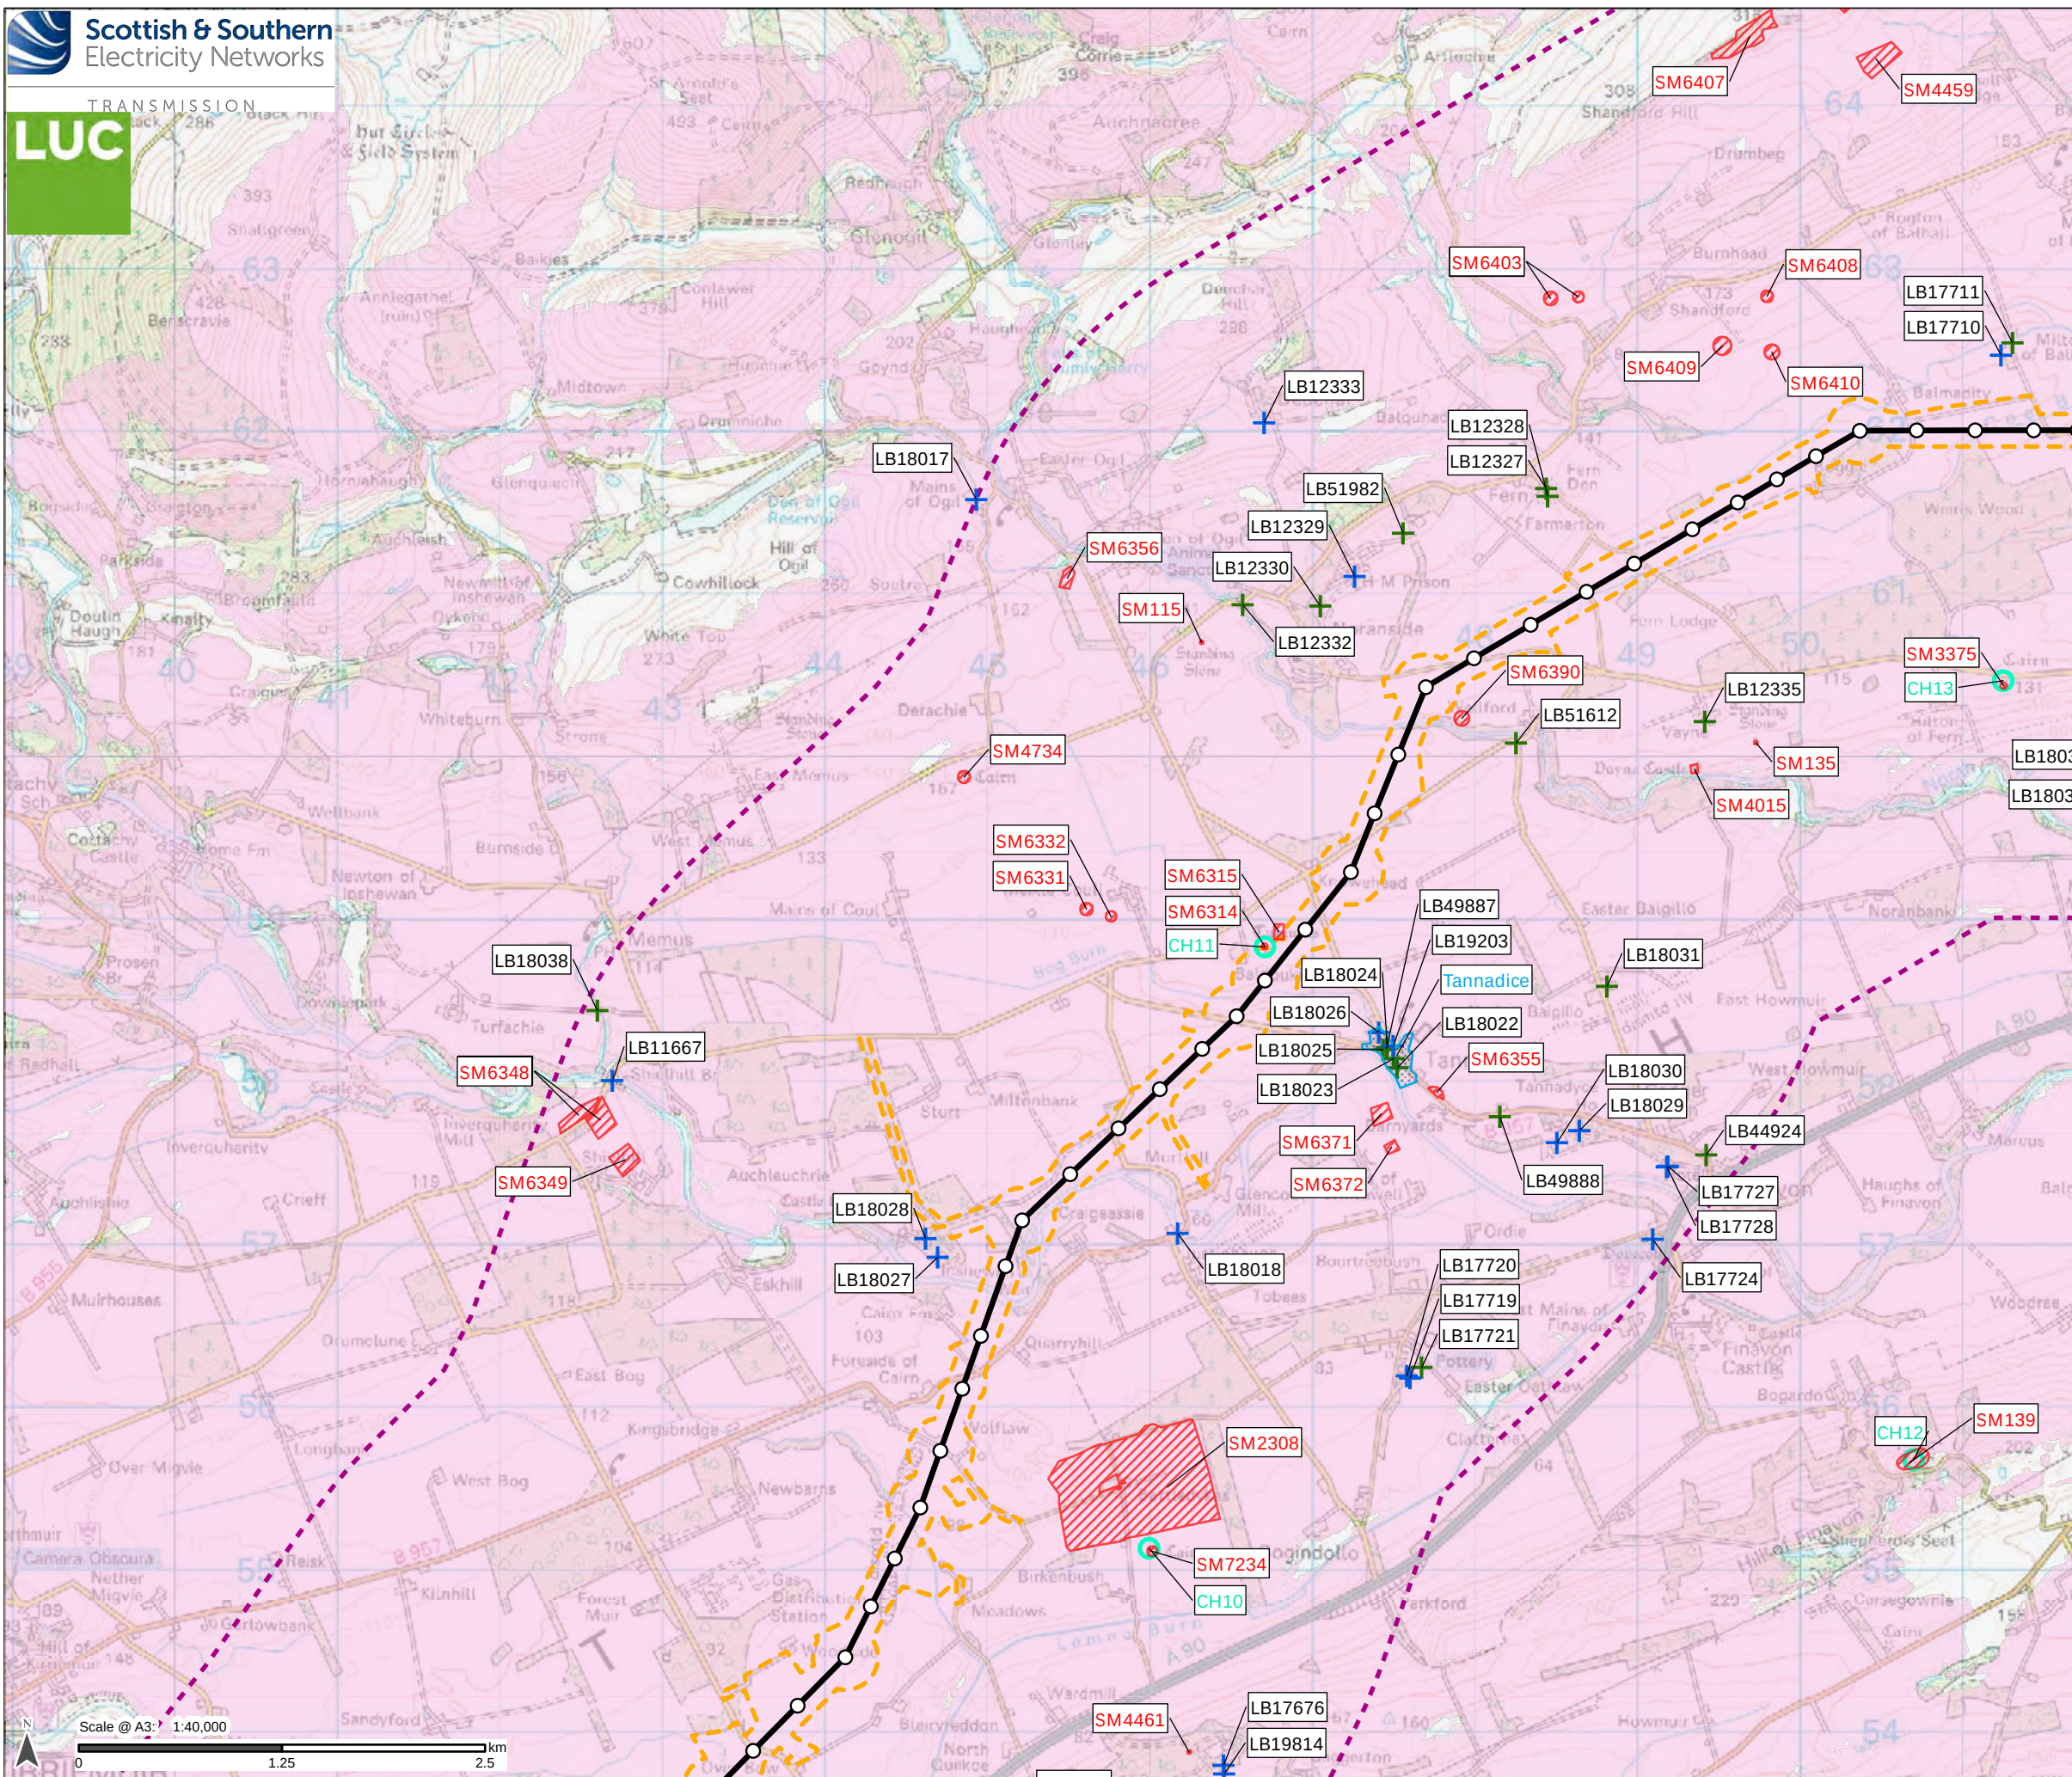

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

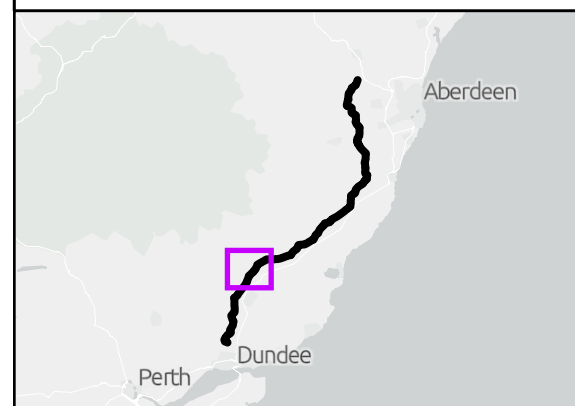


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Designated Heritage Assets: Outer Study Area
(and those outwith the Outer Study Area
included in the Assessment)

Drawn by: SB Date: 15/08/2025

Drawing: 10.2.3

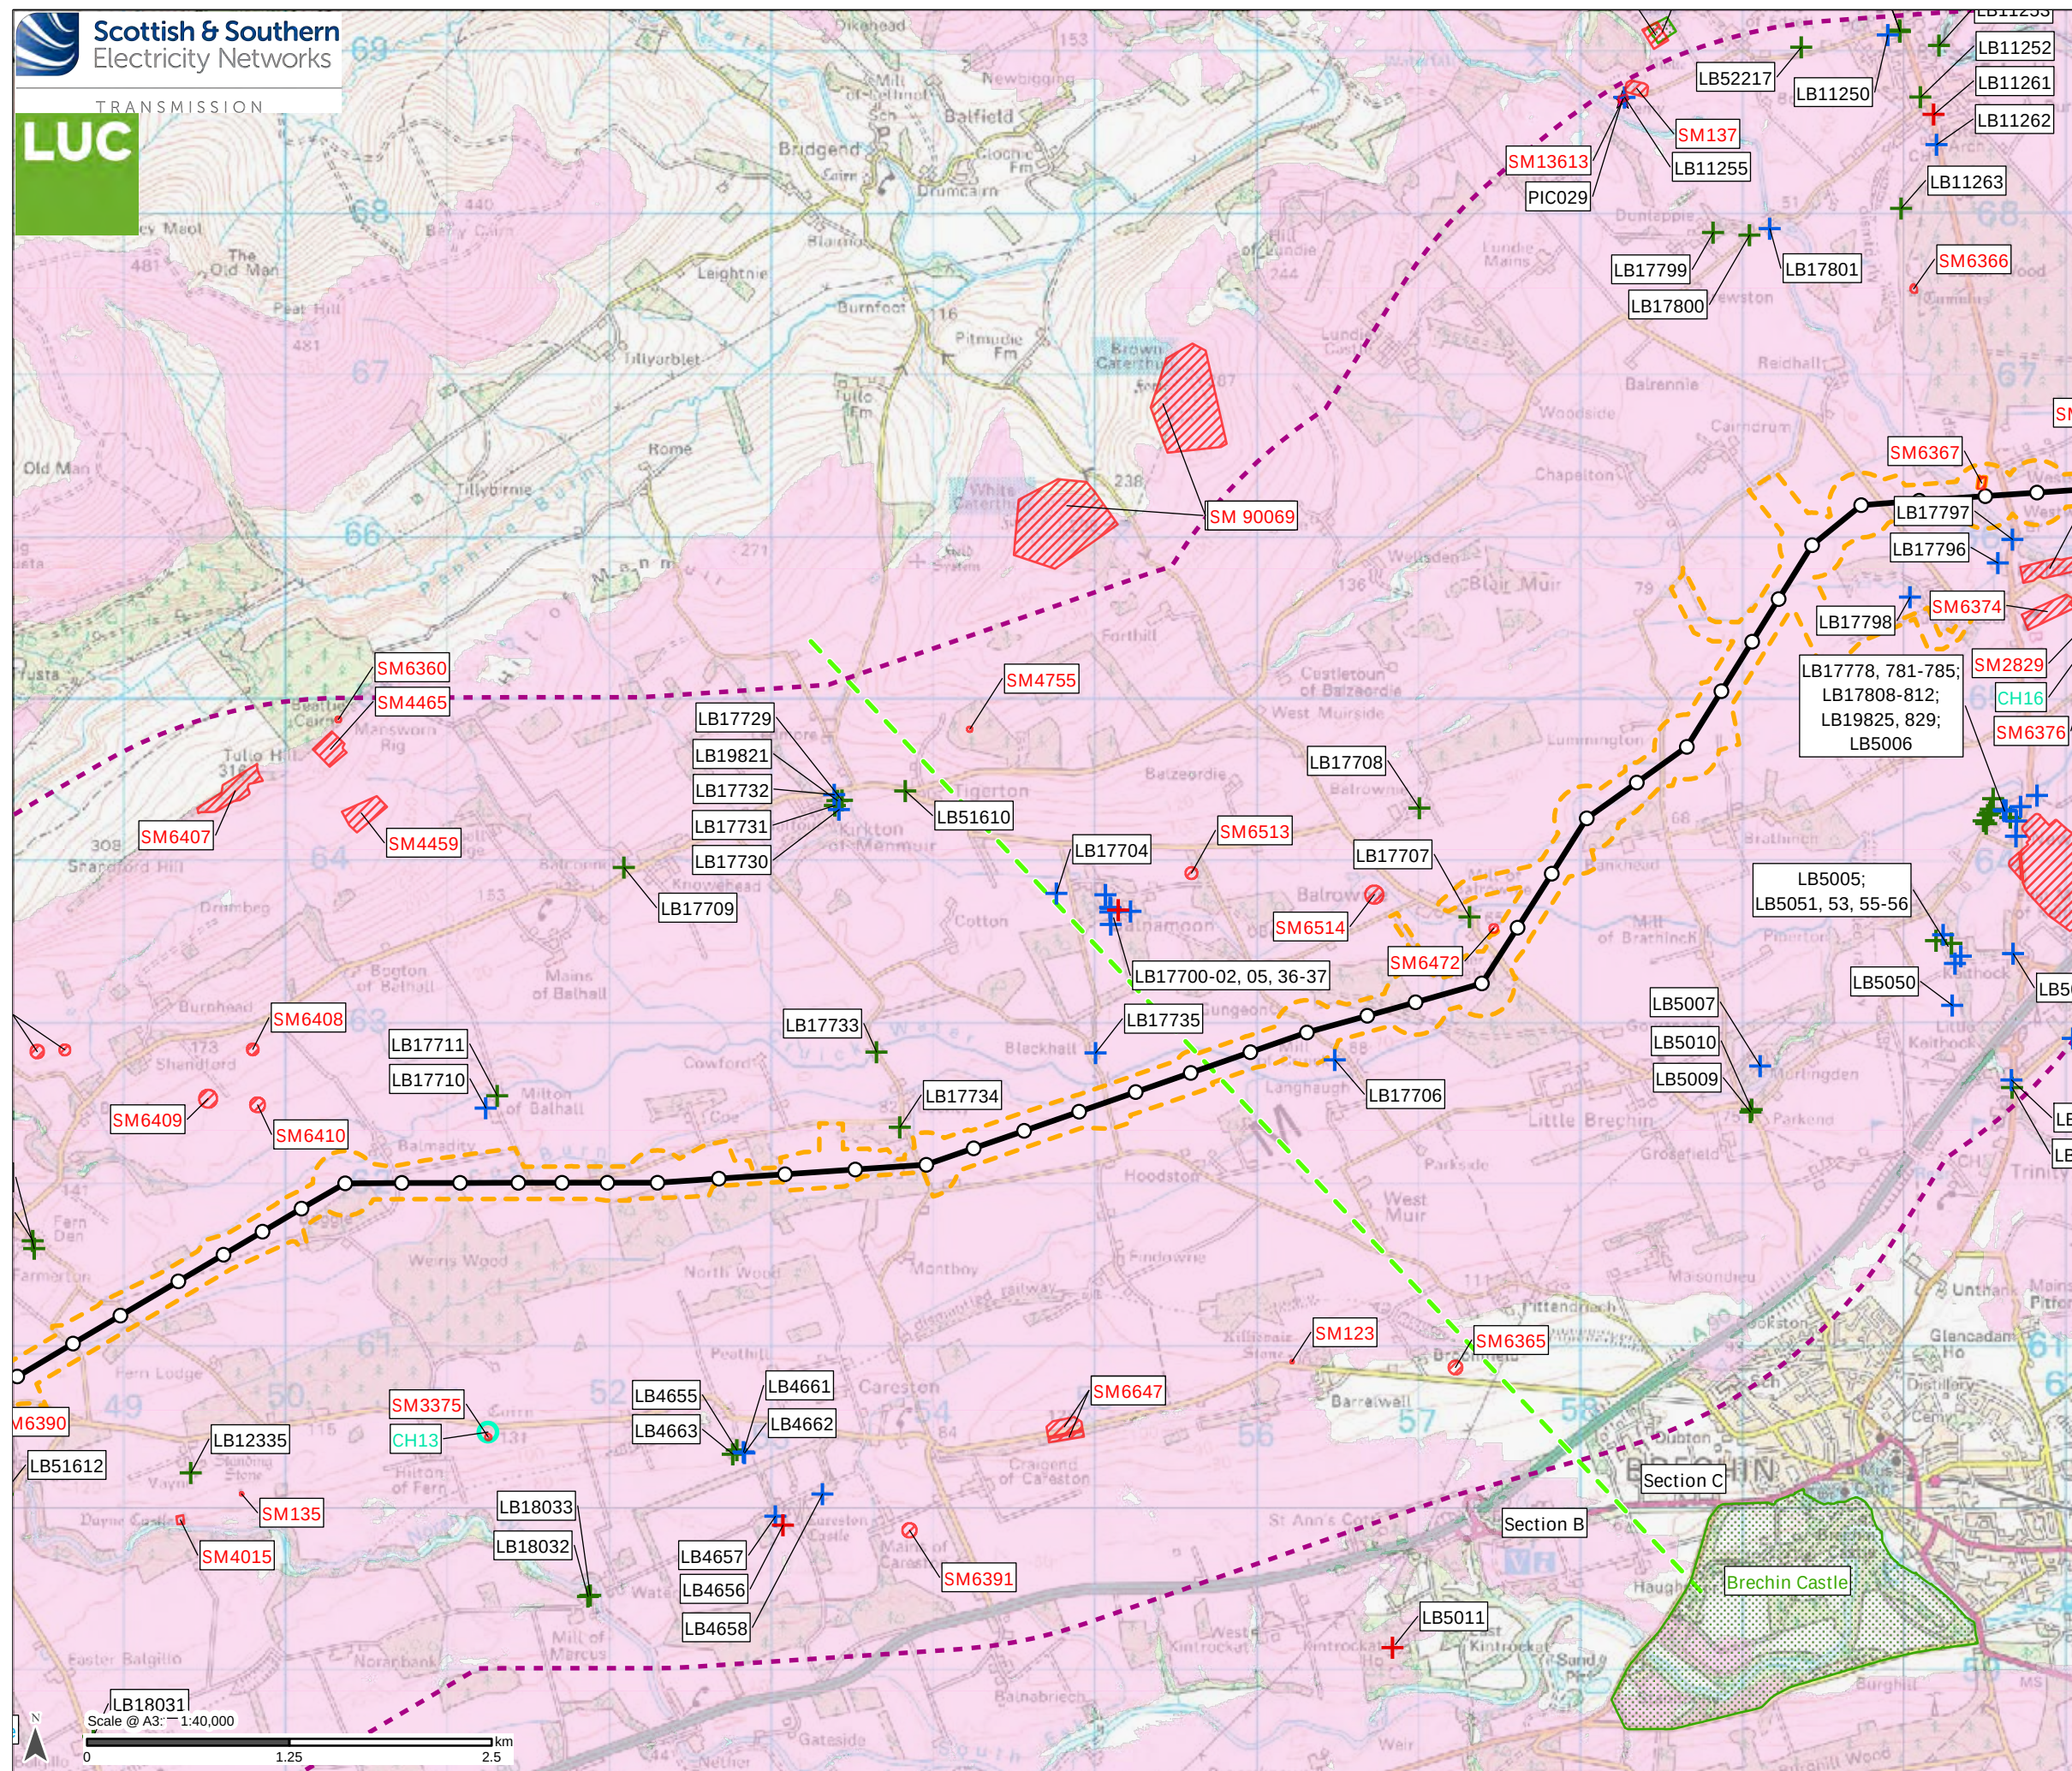

Proposed Development

- Proposed Development Limit of Deviation (LoD) *
- Tower Location
- Proposed Alignment
- Section boundary
- Outer Study Area

Cultural Heritage Assets

- Scheduled Monument
- Category A Listed Building
- Category B Listed Building
- Category C Listed Building
- Inventory Garden and Designed Landscape
- Property In Care
- Cultural Heritage Viewpoint **

Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)

- Visible
- Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Designated Heritage Assets: Outer Study Area
(and those outwith the Outer Study Area included in the Assessment)

Drawn by: SB Date: 15/08/2025

Drawing: 10.2.4

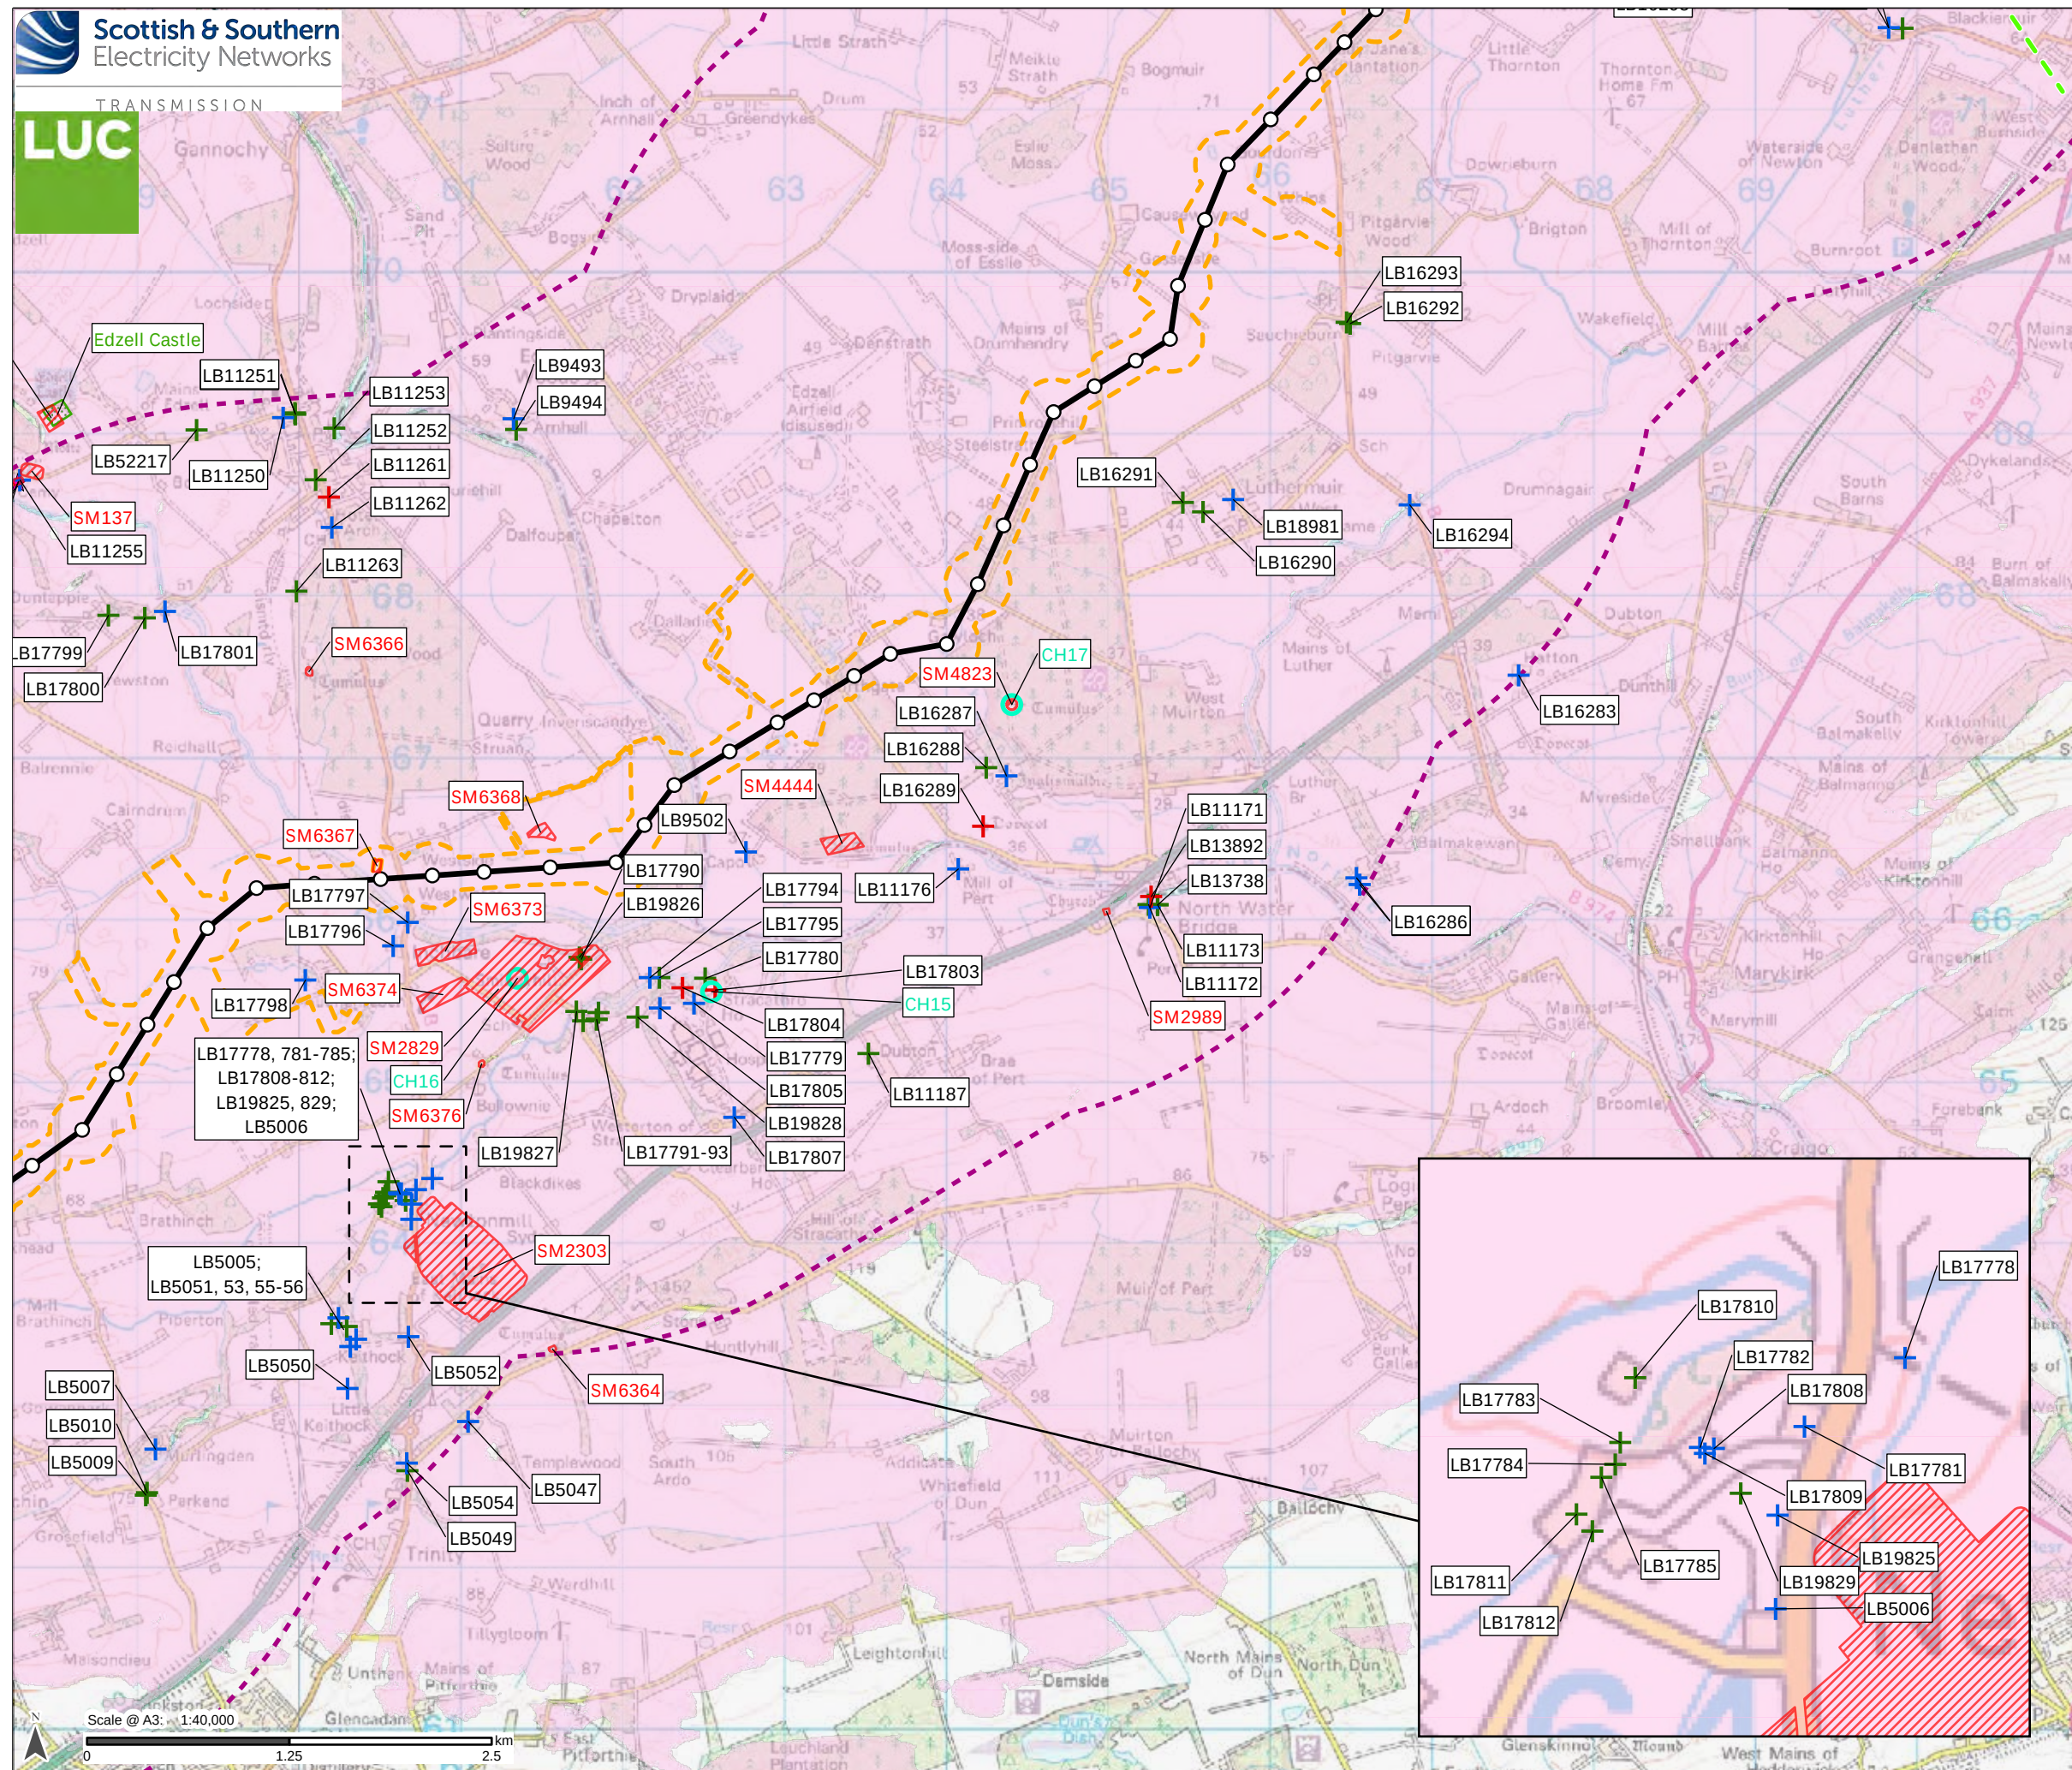

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)

Drawn by: SB Date: 15/08/2025

Drawing: 10.2.5

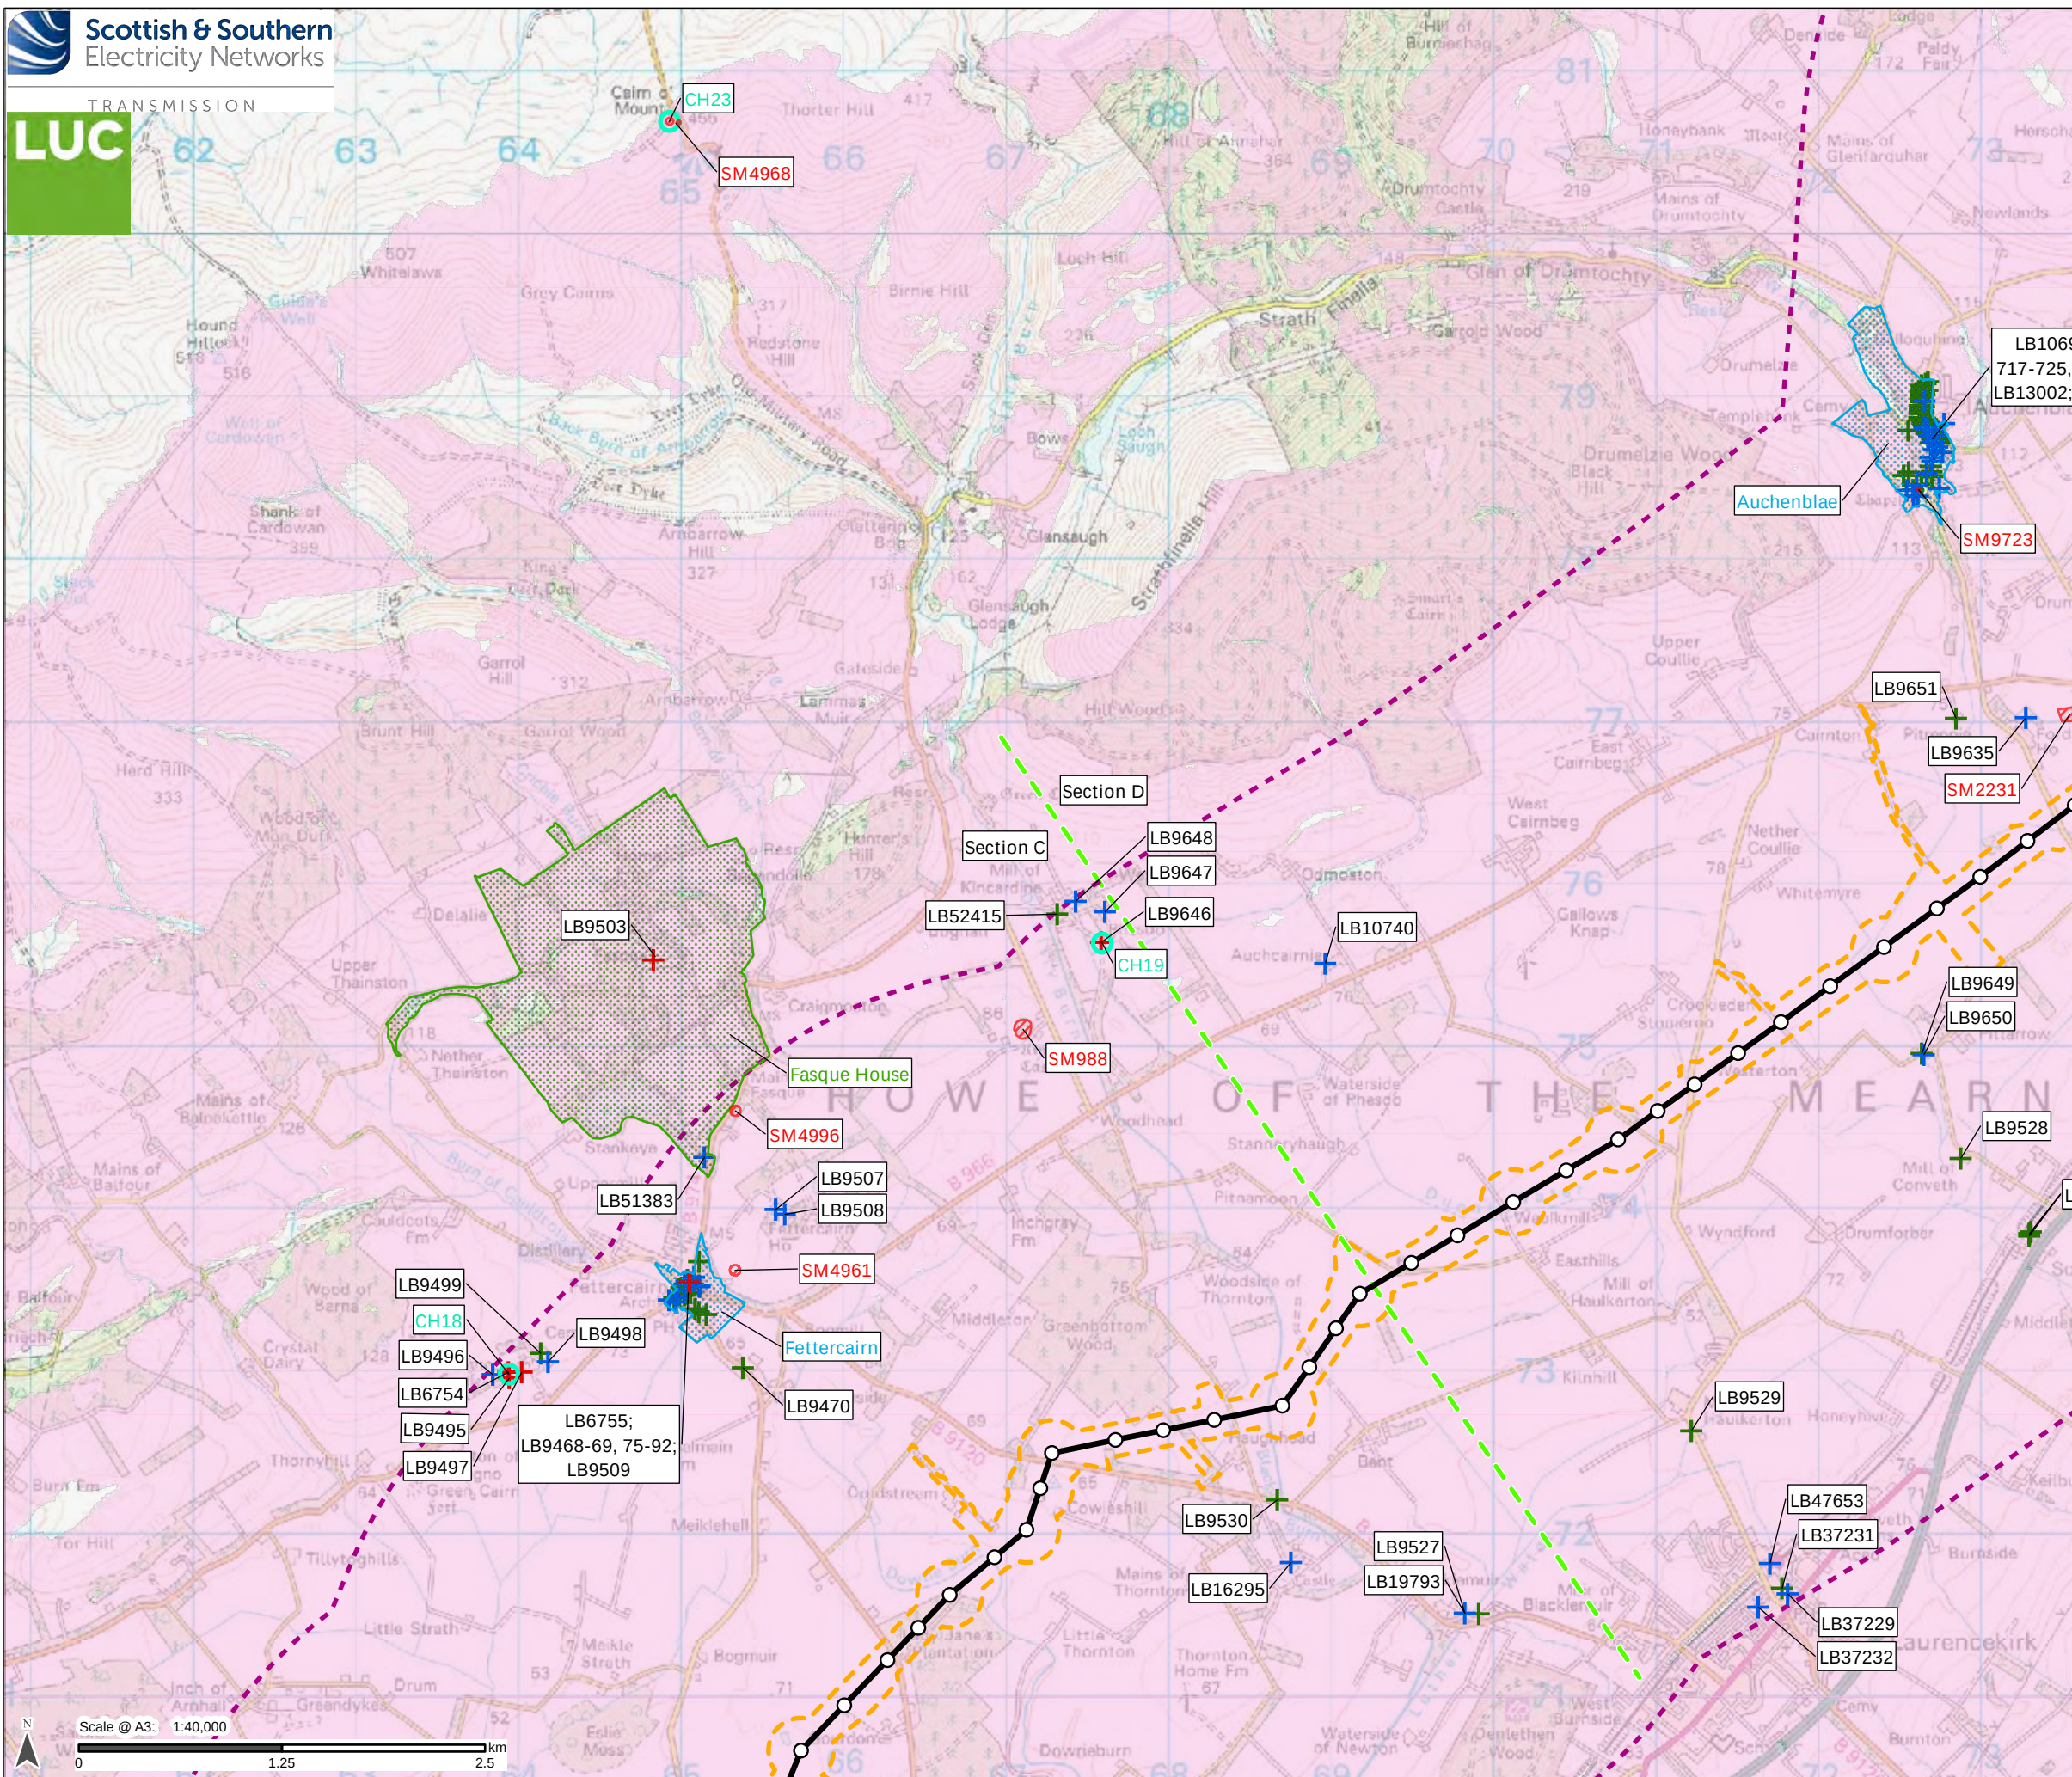


- Proposed Development**
- Proposed Development Limit of Deviation (LoD) *
 - Tower Location
 - Proposed Alignment
 - Section boundary
 - Outer Study Area
- Cultural Heritage Assets**
- Scheduled Monument
 - Category A Listed Building
 - Category B Listed Building
 - Category C Listed Building
 - Inventory Garden and Designed Landscape
 - Conservation Area
 - Cultural Heritage Viewpoint **
- Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)**
- Visible
 - Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.


*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

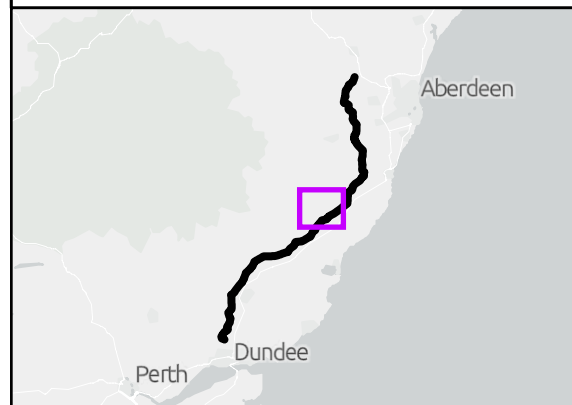

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)
Drawn by:	SB
Date:	15/08/2025
Drawing:	10.2.6

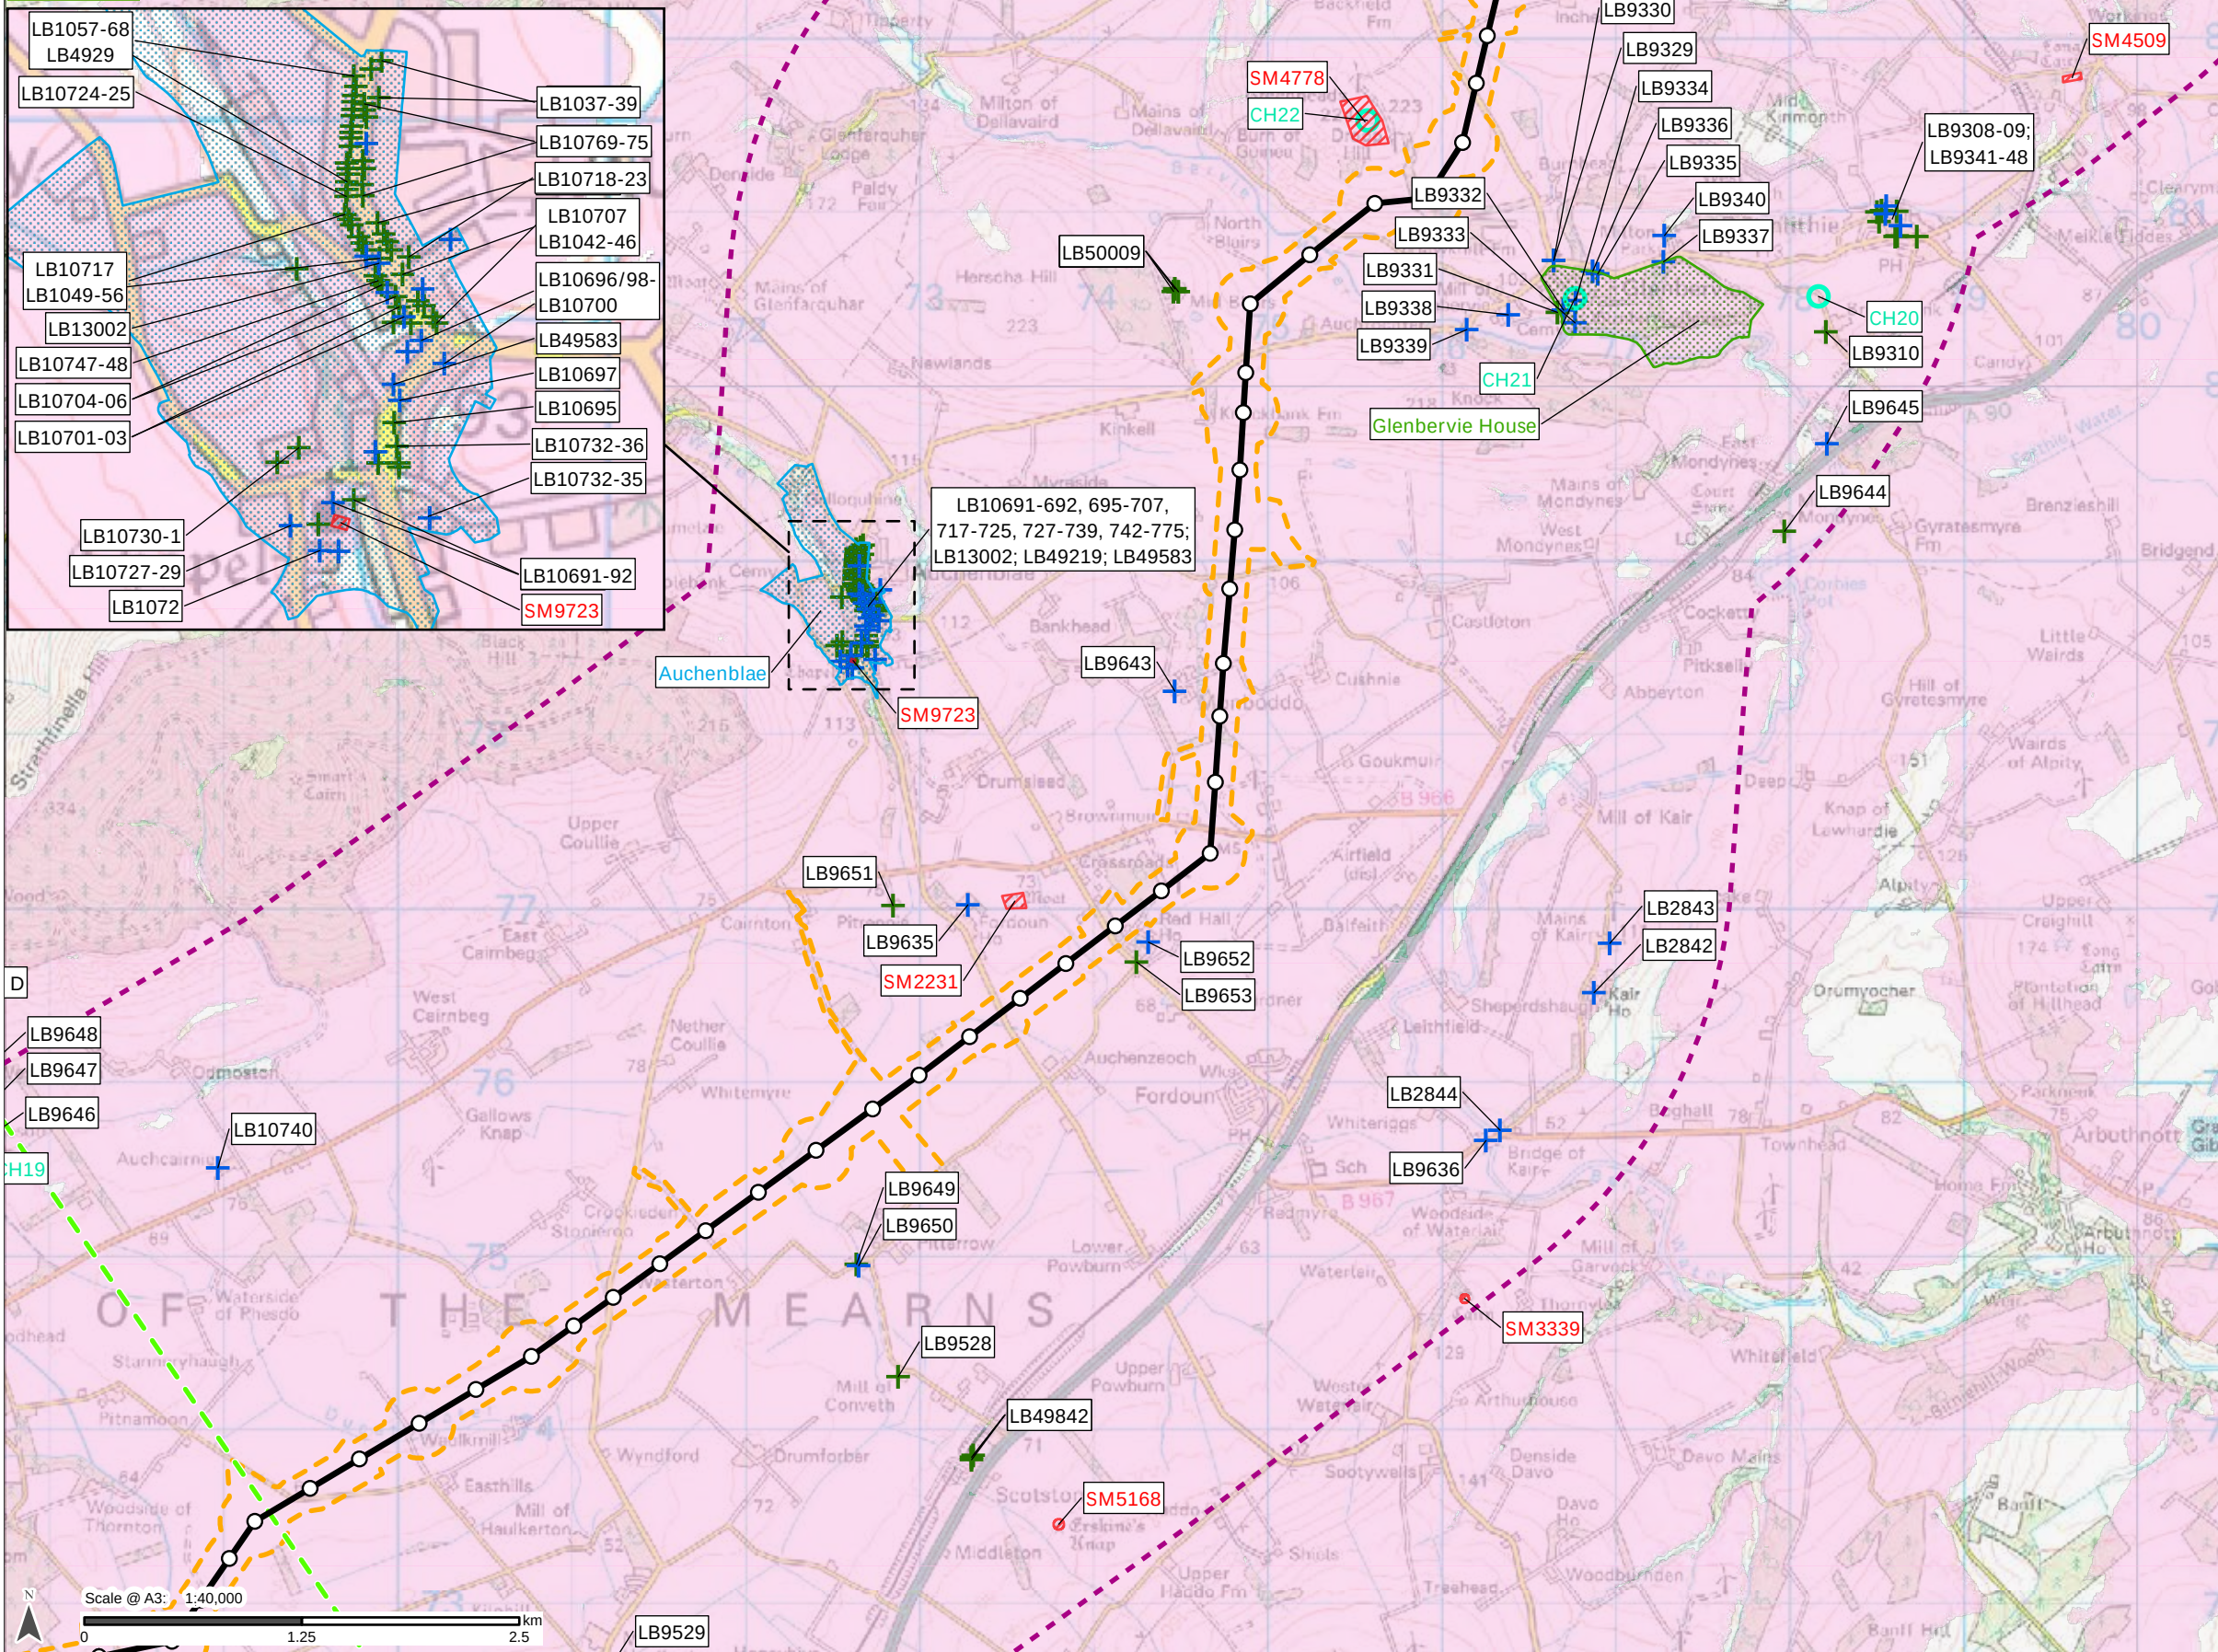

Proposed Development

- Proposed Development Limit of Deviation (LoD) *
- Tower Location
- Proposed Alignment
- Section boundary
- Outer Study Area

Cultural Heritage Assets

- Scheduled Monument
- Category B Listed Building
- Category C Listed Building
- Inventory Garden and Designed Landscape
- Conservation Area
- Cultural Heritage Viewpoint **


Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)

- Visible
- Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.


*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

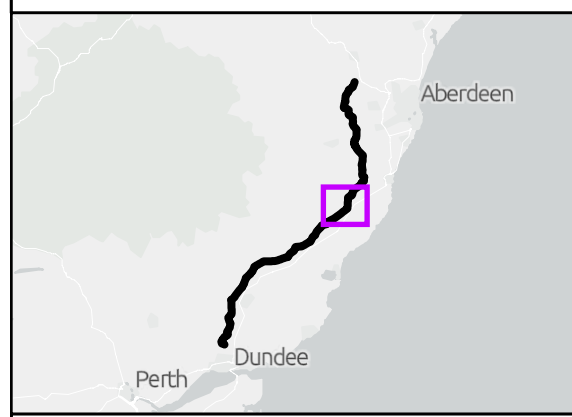

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)
Drawn by:	SB
Date:	15/08/2025
Drawing:	10.2.7

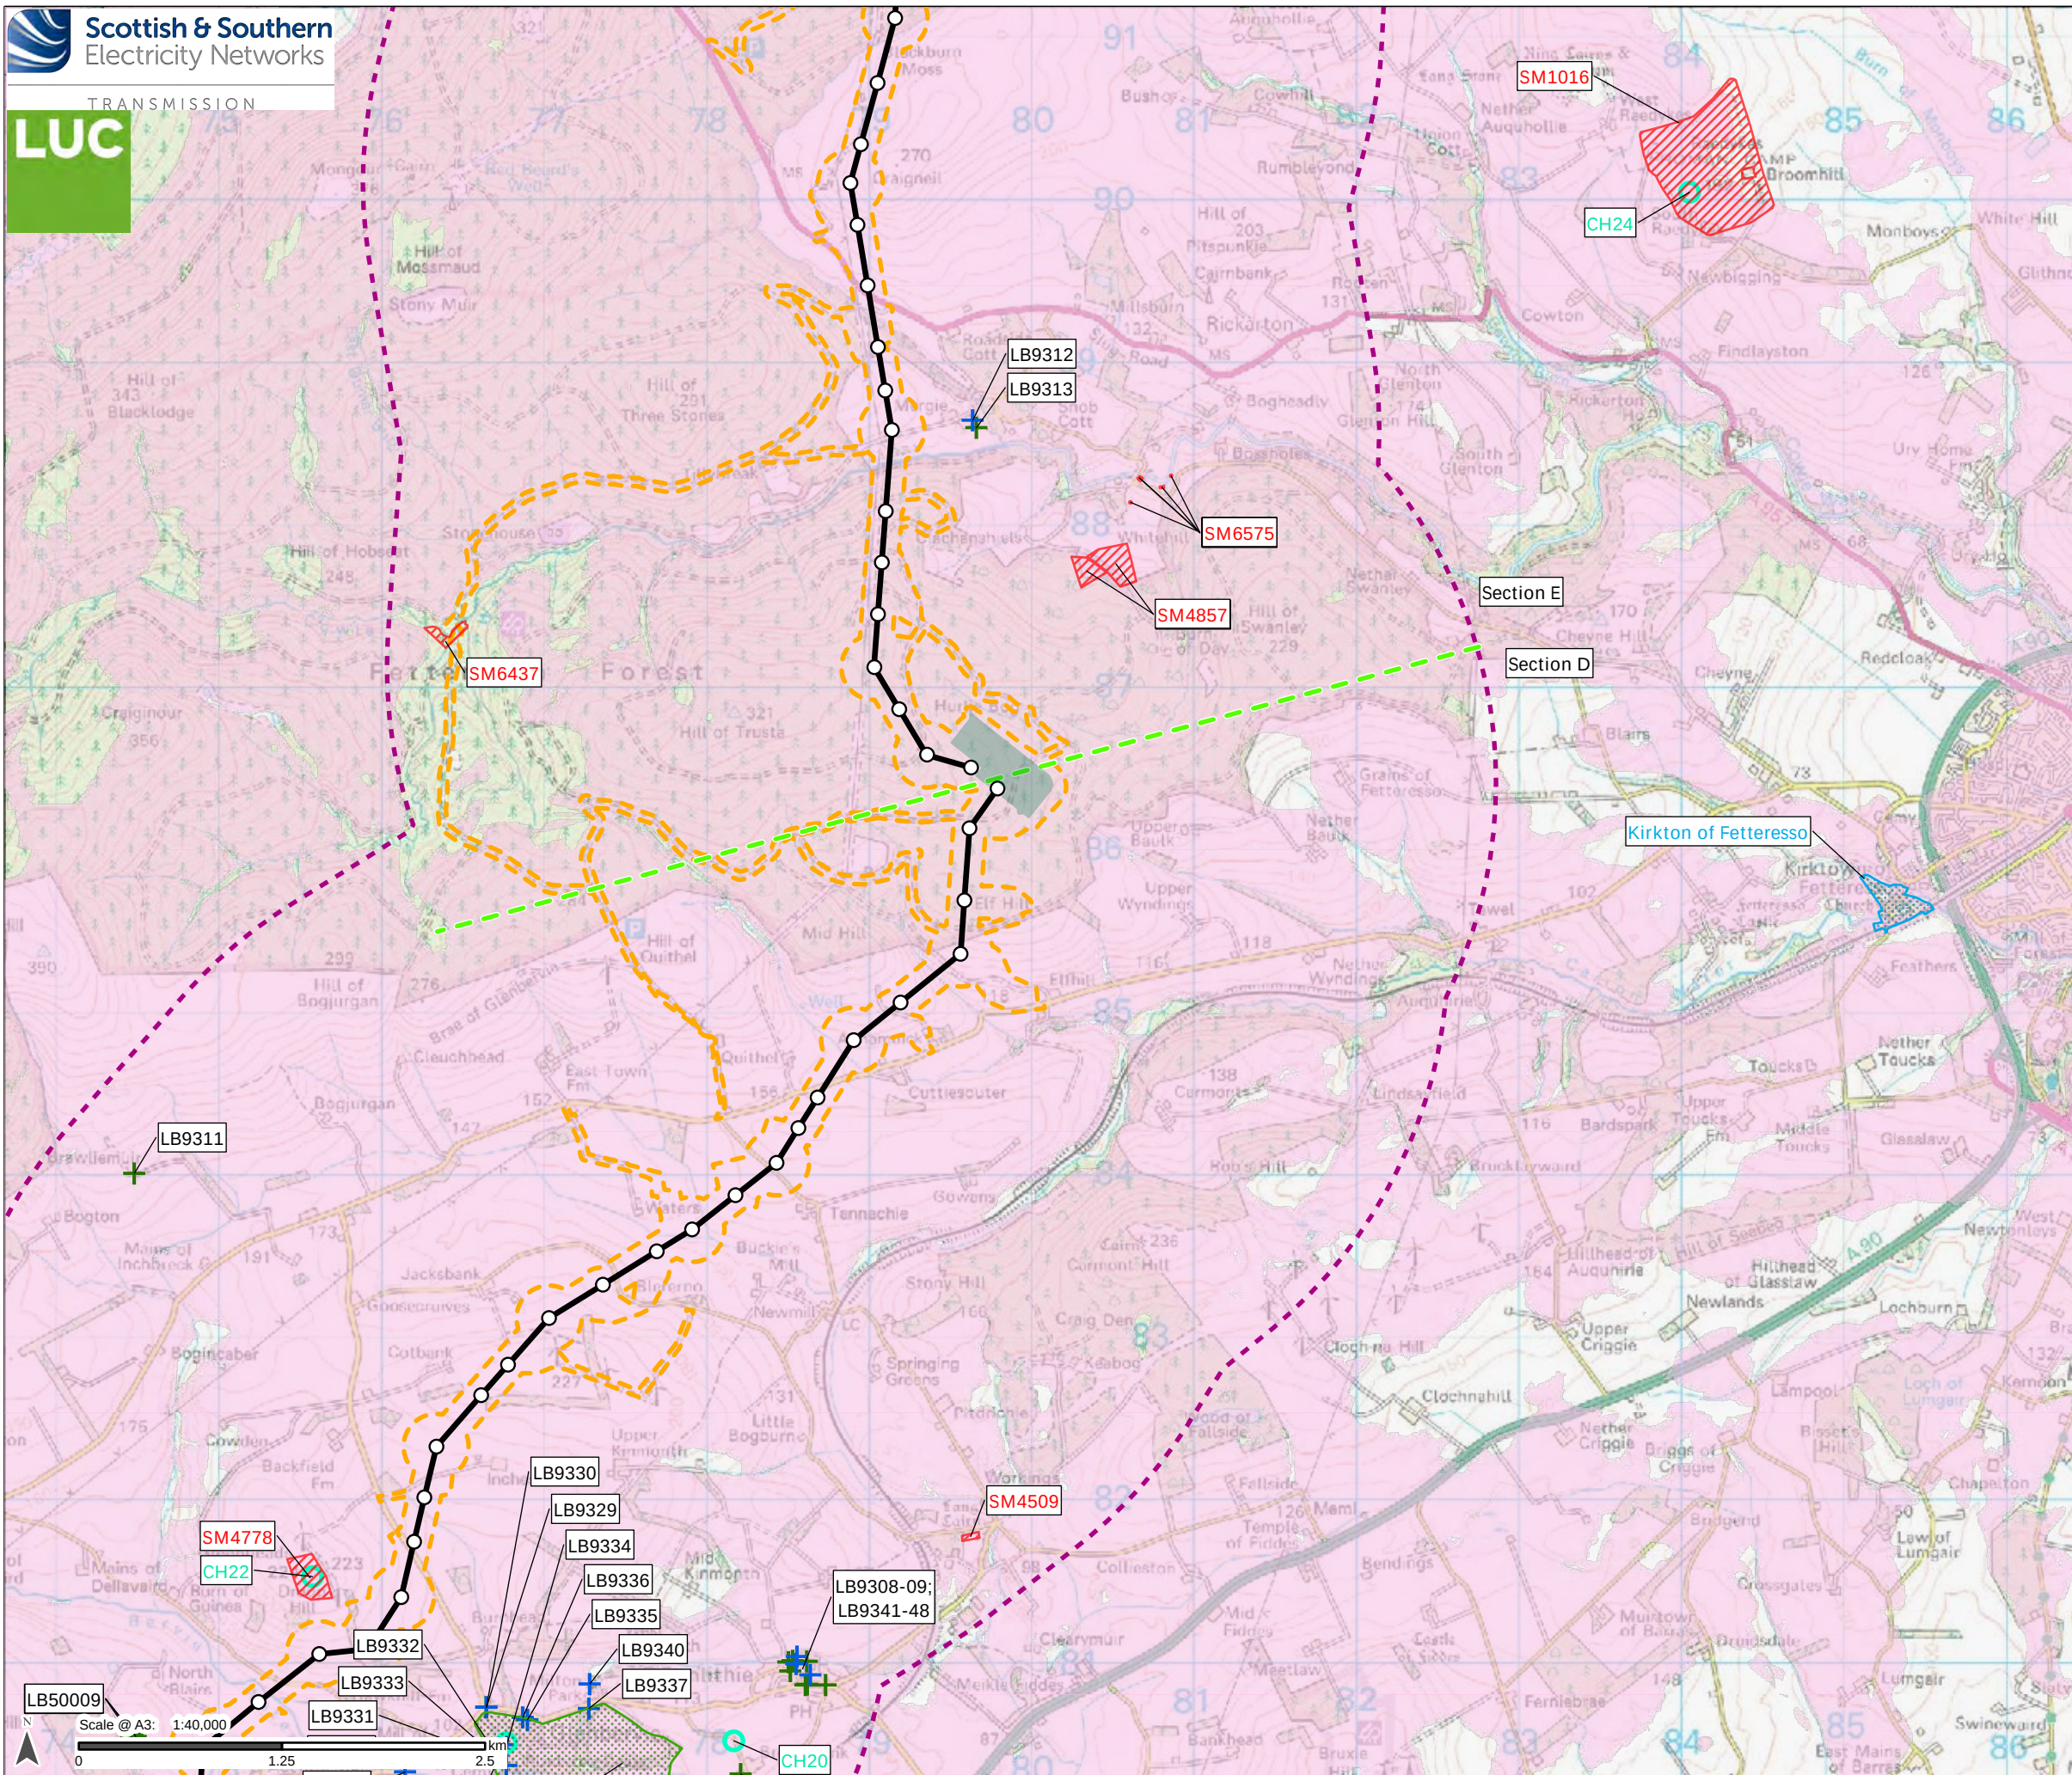

Proposed Development

- Proposed Development Limit of Deviation (LoD) *
- Tower Location
- Proposed Alignment

Intra Associated Developments

- Proposed Hurle 400 kV substation (Aberdeenshire Council Reference APP/2024/1951)
- Section boundary
- Outer Study Area

Cultural Heritage Assets

- Scheduled Monument
- Category B Listed Building
- Category C Listed Building
- Inventory Garden and Designed Landscape
- Conservation Area
- Cultural Heritage Viewpoint **

Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)

- Visible
- Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.


*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No: LT455	
Project: Kintore to Tealing 400 kV Overhead Line	
Title: Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)	
Drawn by: SB	Date: 18/08/2025
Drawing: 10.2.8	

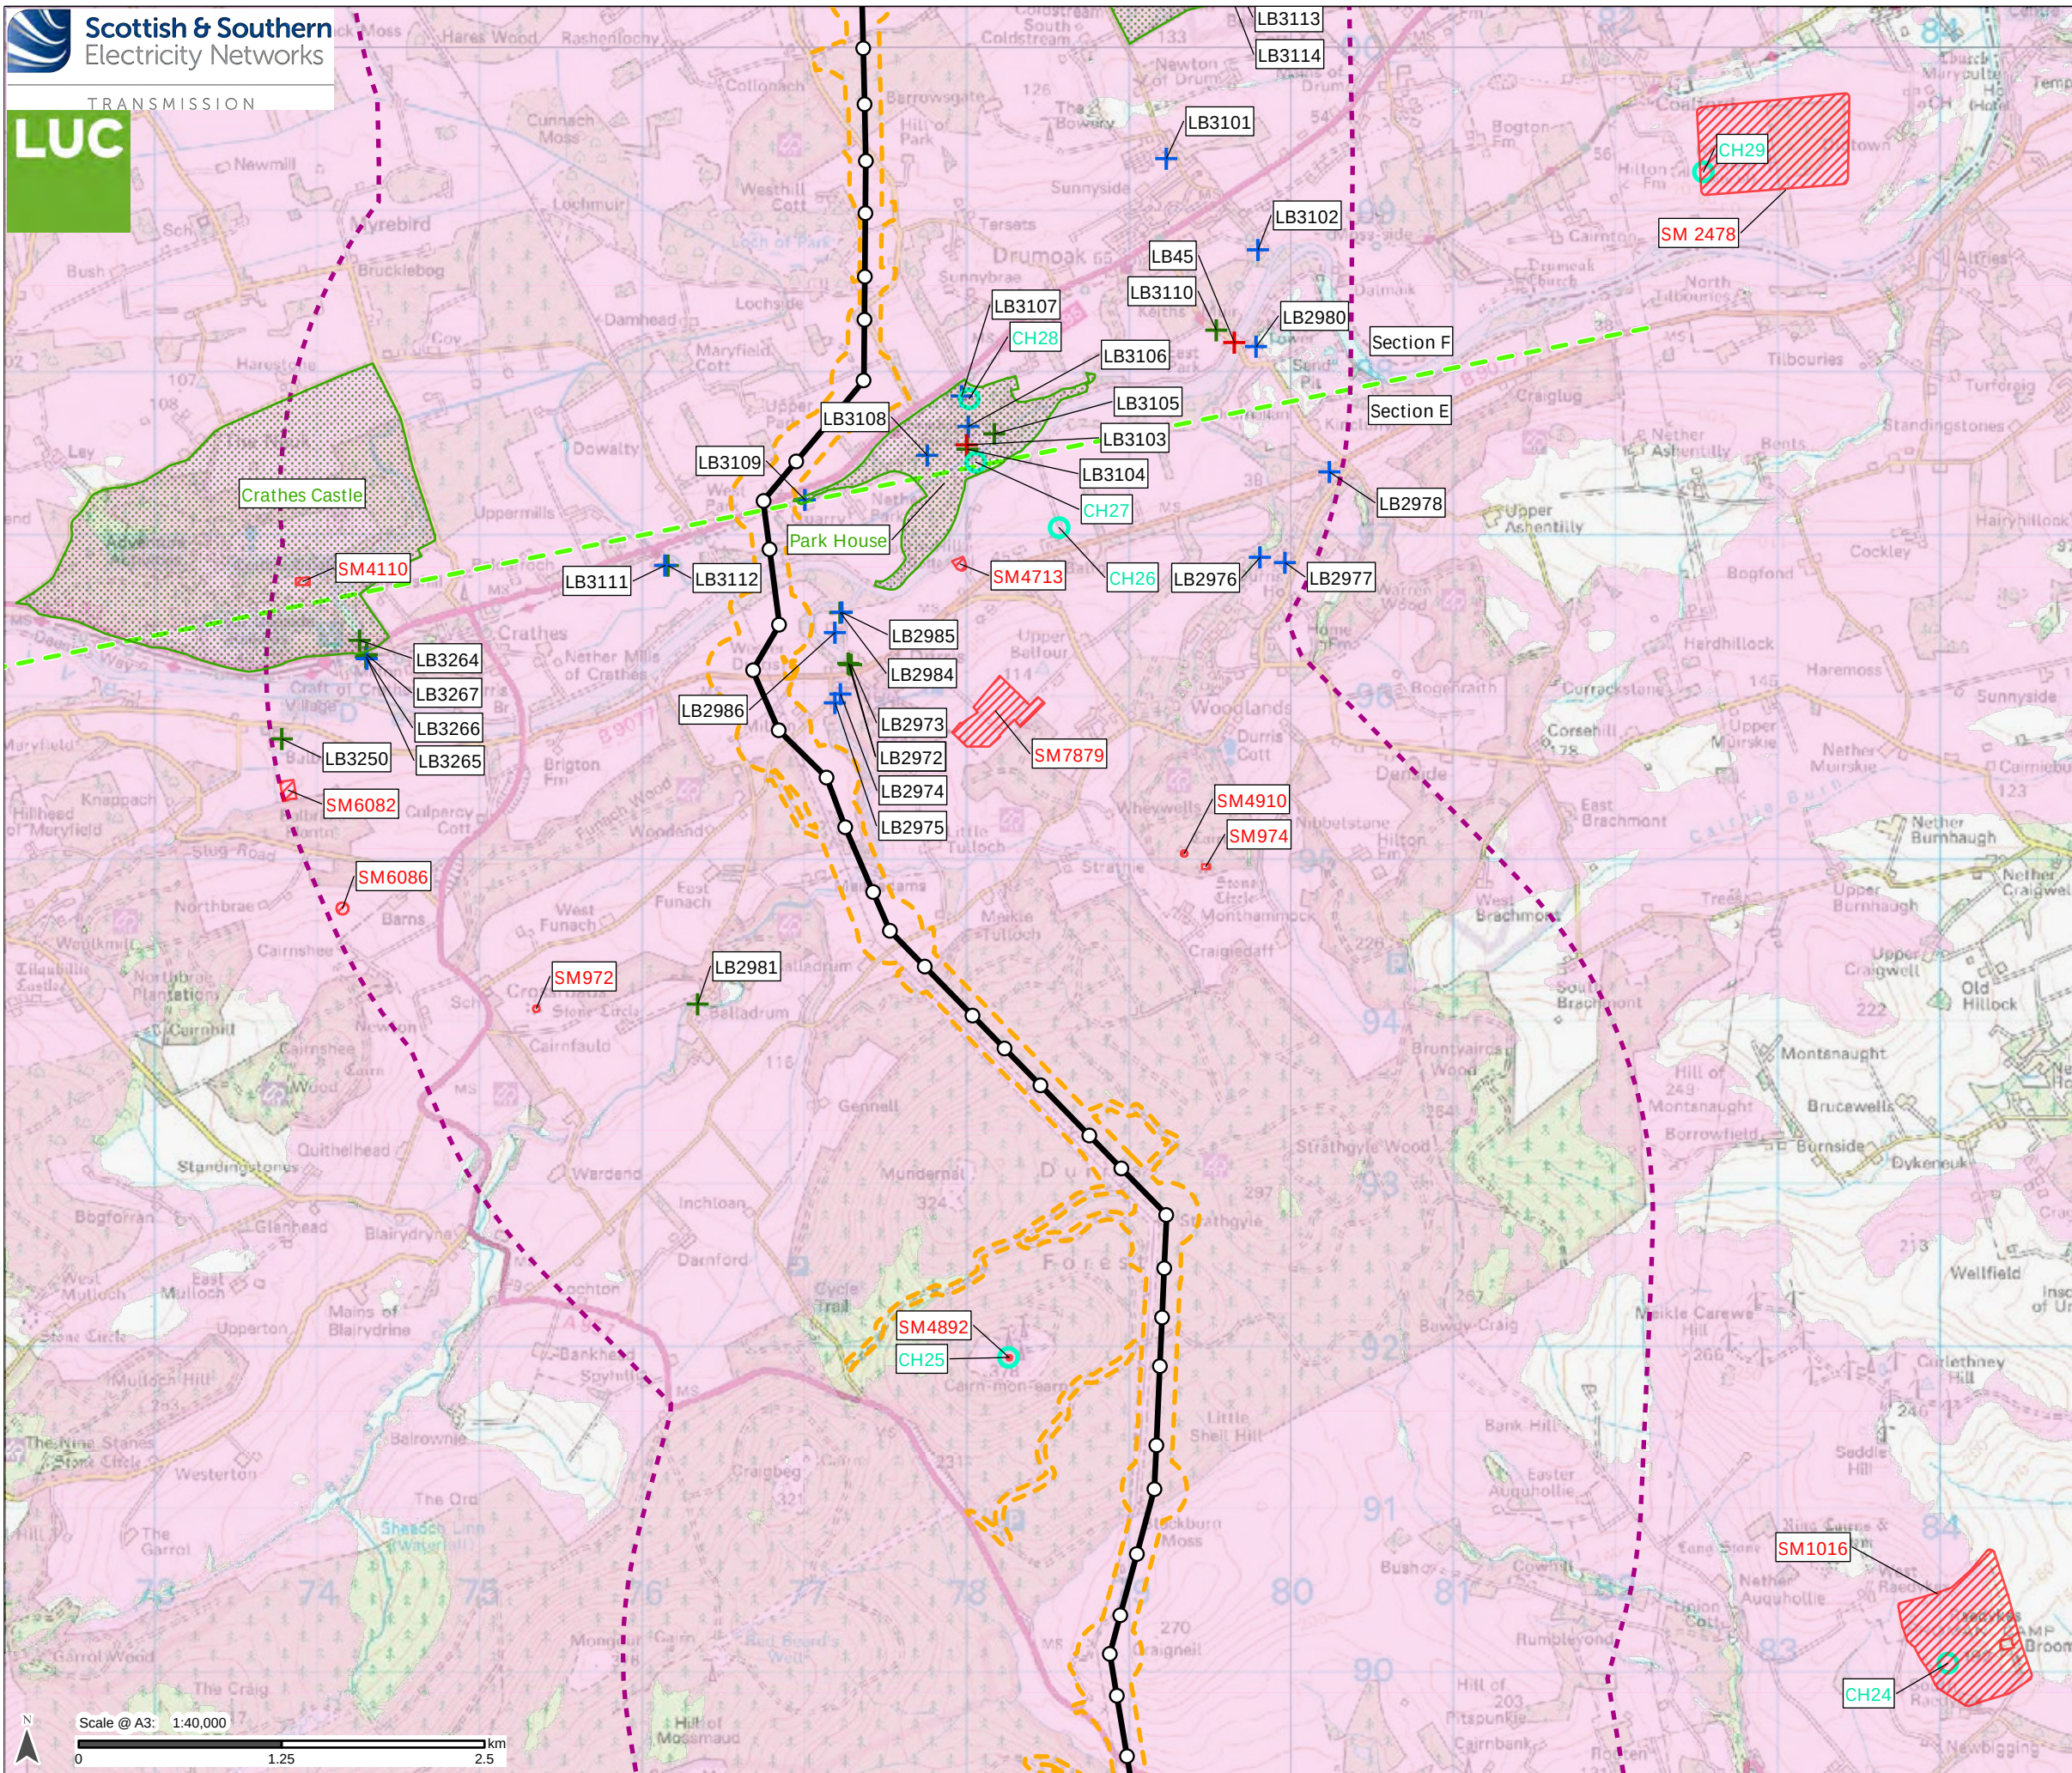

Proposed Development

Proposed Development Limit of Deviation (LoD) *

○ Tower Location

— Proposed Alignment

Section boundary

Outer Study Area

Cultural Heritage Assets

 Scheduled Monument

+ Category A Listed Building

+ Category B Listed Building

+ Category C Listed Building

 Inventory Garden and Designed Landscape

 Cultural Heritage Viewpoint **

Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)


Visible

☐ Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

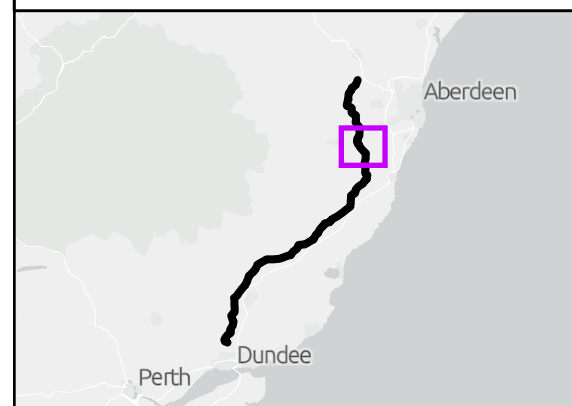

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
**SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey**

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Designated Heritage Assets: Outer Study Area
(and those outwith the Outer Study Area
included in the Assessment)

Drawn by: SB

Date: 15/08/2025

Drawing: 10.2.9

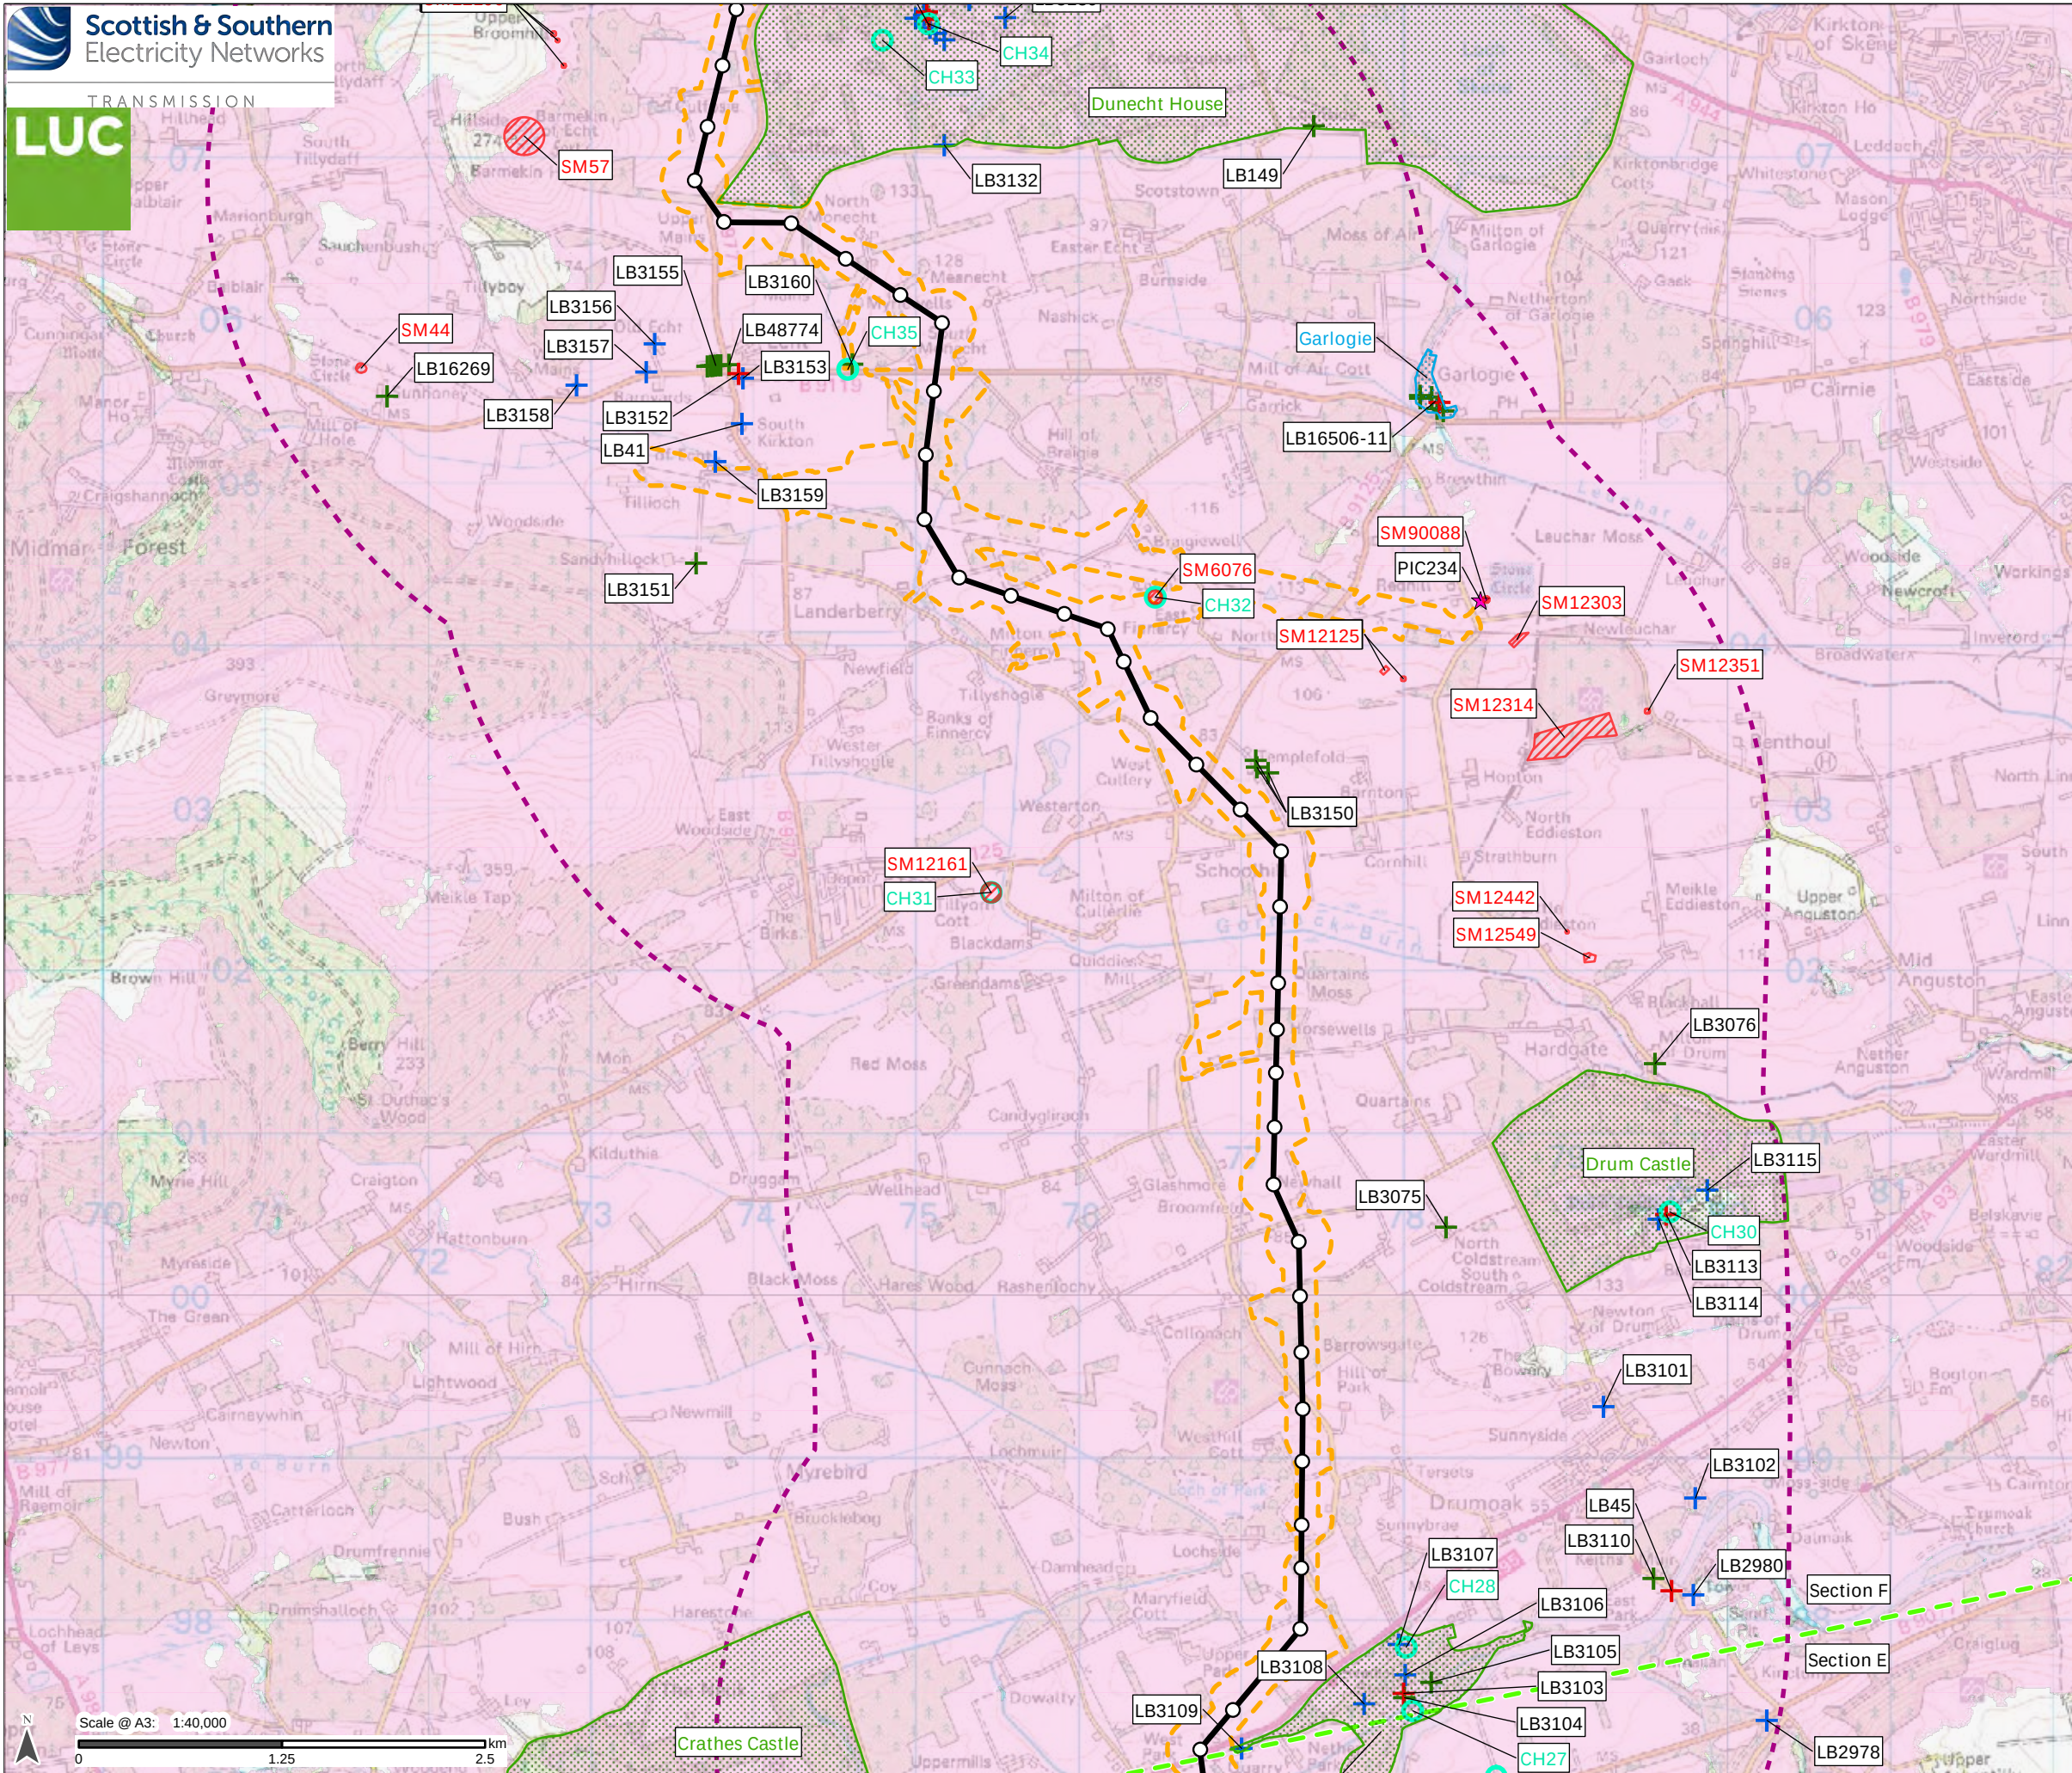

Proposed Development

- Proposed Development Limit of Deviation (LoD) *
- Tower Location
- Proposed Alignment
- Section boundary
- Outer Study Area

Cultural Heritage Assets

- Scheduled Monument
- Category A Listed Building
- Category B Listed Building
- Category C Listed Building
- Inventory Garden and Designed Landscape
- Property In Care
- Conservation Area
- Cultural Heritage Viewpoint **

Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)

- Visible
- Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)

Drawn by: SB

Date: 15/08/2025

Drawing: 10.2.10

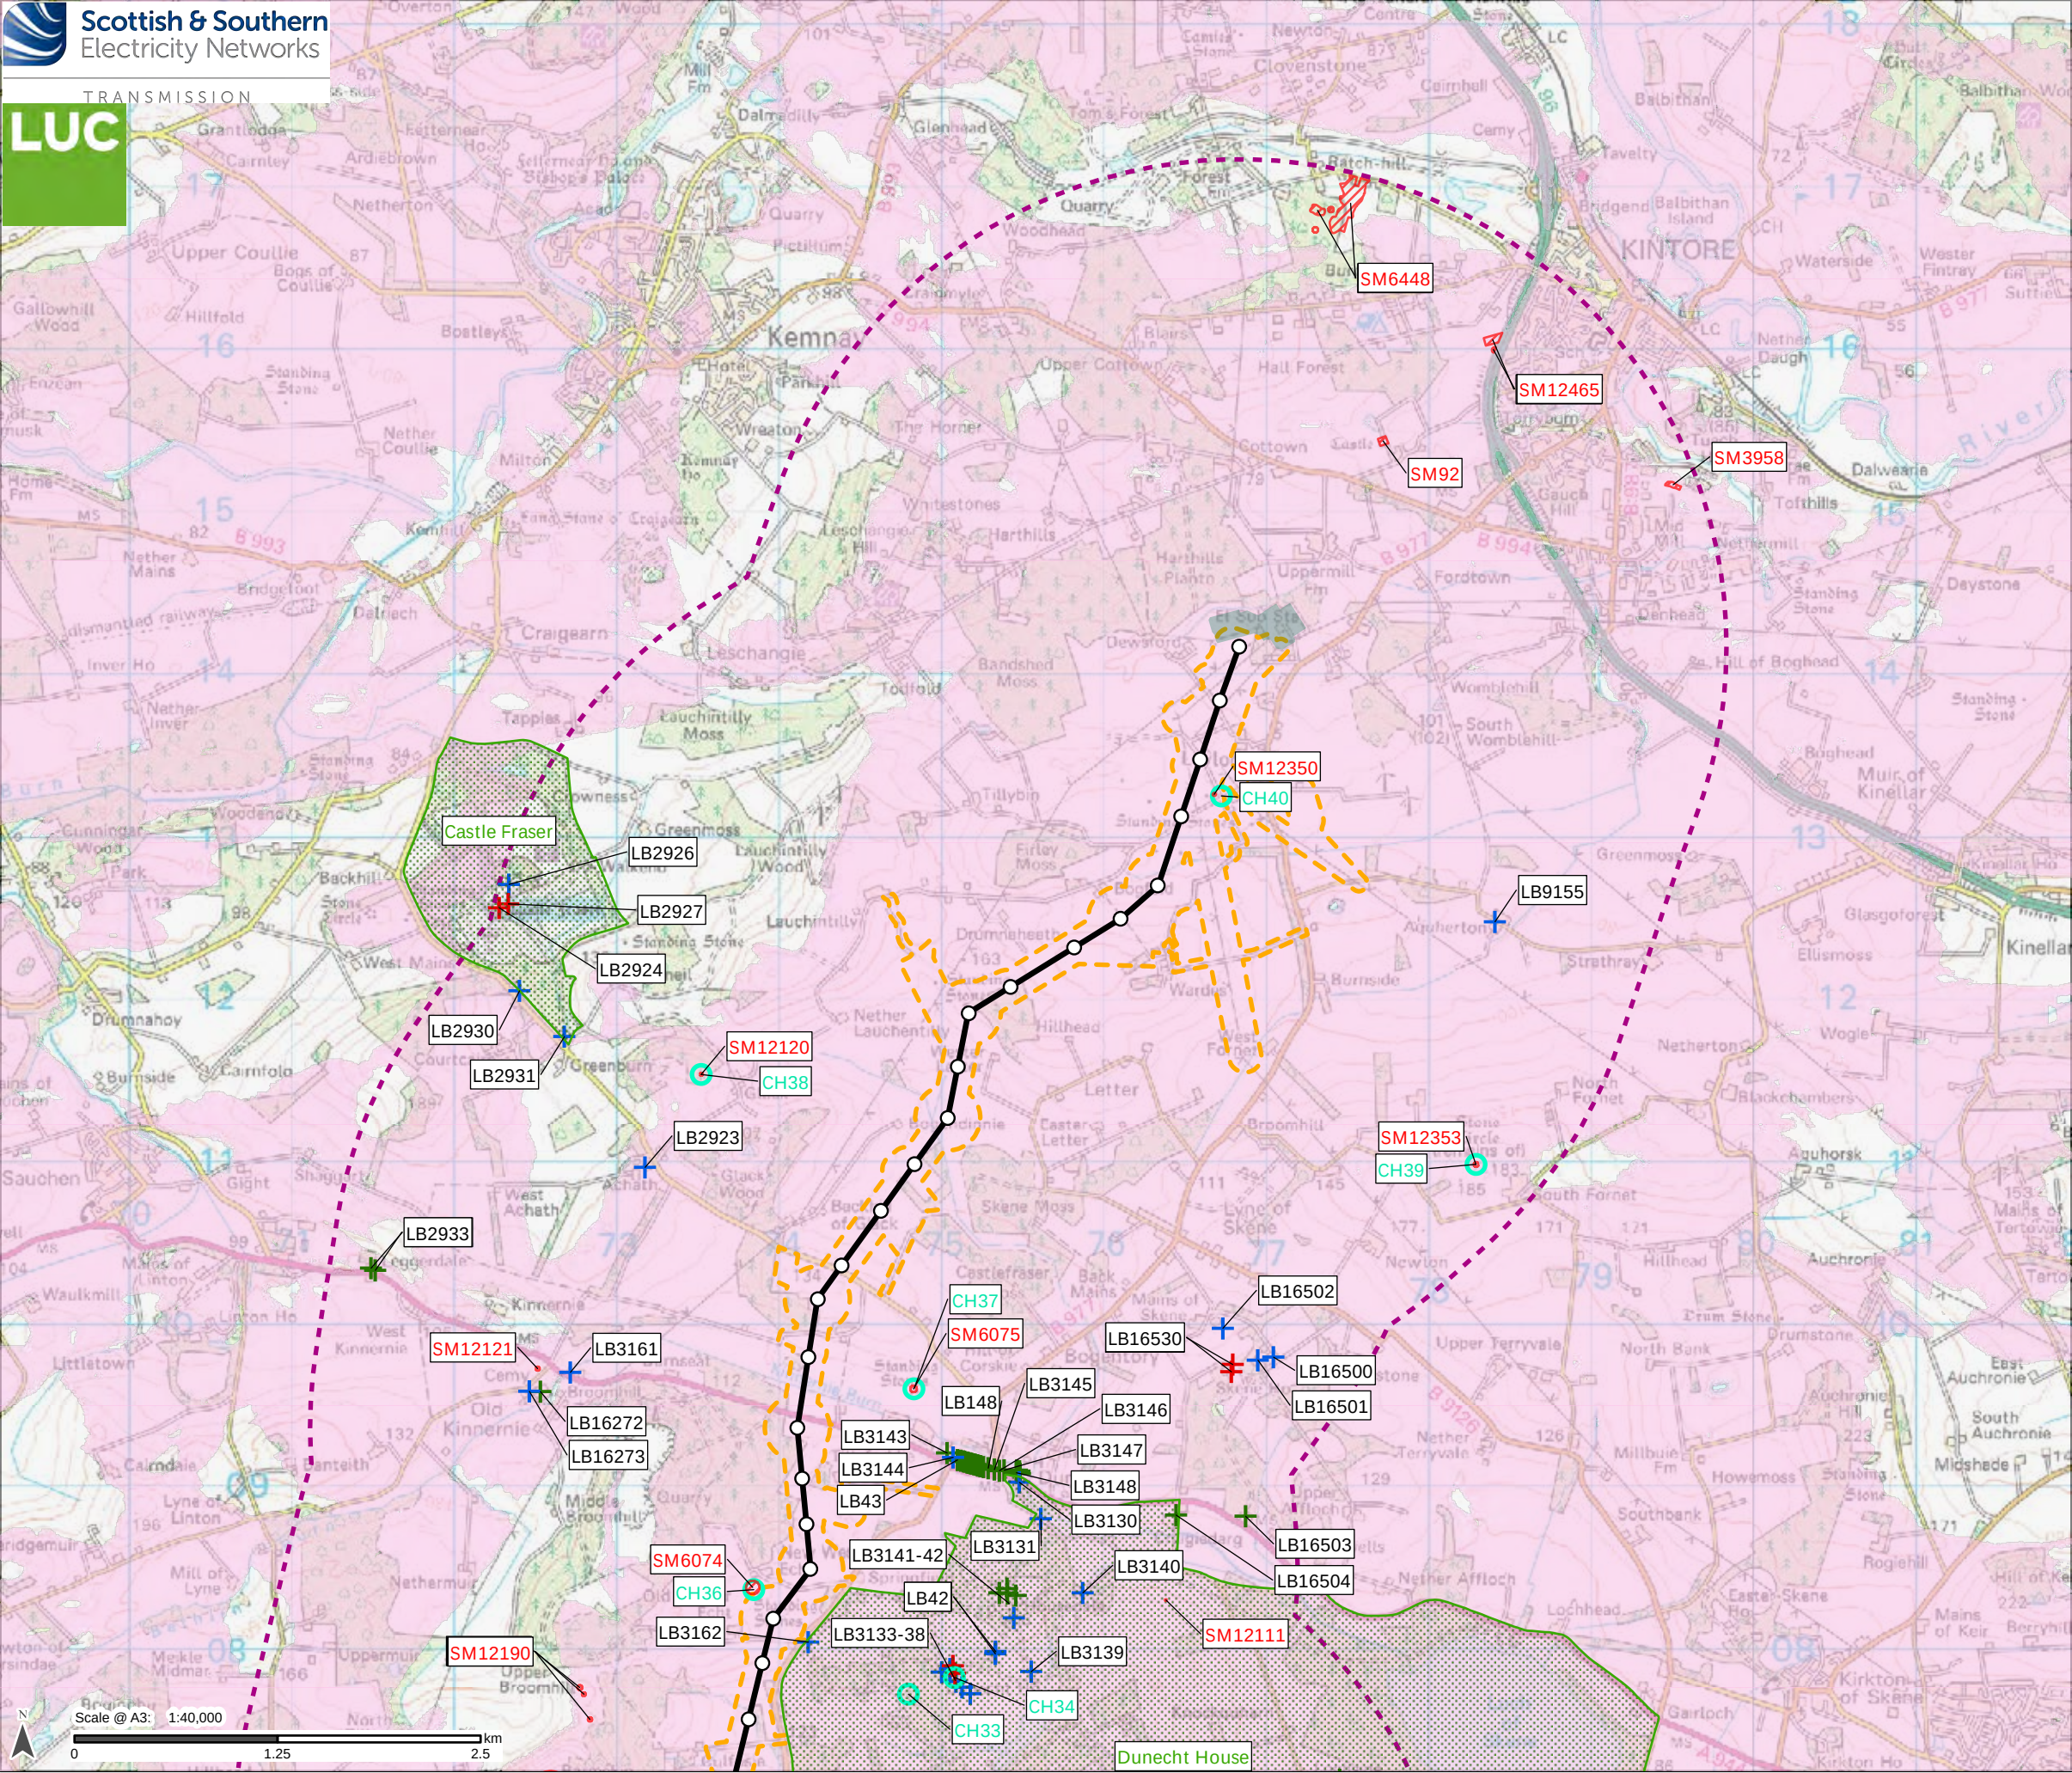

Proposed Development

- Proposed Development Limit of Deviation (LoD) *
- Tower Location
- Proposed Alignment

Existing Infrastructure

- Existing Kintore Substation
- Outer Study Area

Cultural Heritage Assets

- Scheduled Monument
- Category A Listed Building
- Category B Listed Building
- Category C Listed Building
- Inventory Garden and Designed Landscape
- Cultural Heritage Viewpoint **

Actual Tower Height Bare-Earth Zone of Theoretical Visibility (ZTV)

- Visible
- Not Visible

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

*Proposed Development Limit of Deviation (LOD) also defined as the Inner Study Area. See Chapter 10, Section 10.2.5 of the EIA report (Volume 2) for more detail.

**For full list of viewpoints, see Technical Appendix 10.3 (Volume 5).



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version
Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Designated Heritage Assets: Outer Study Area (and those outwith the Outer Study Area included in the Assessment)
Drawn by:	SB
Date:	18/08/2025
Drawing:	10.2.11