


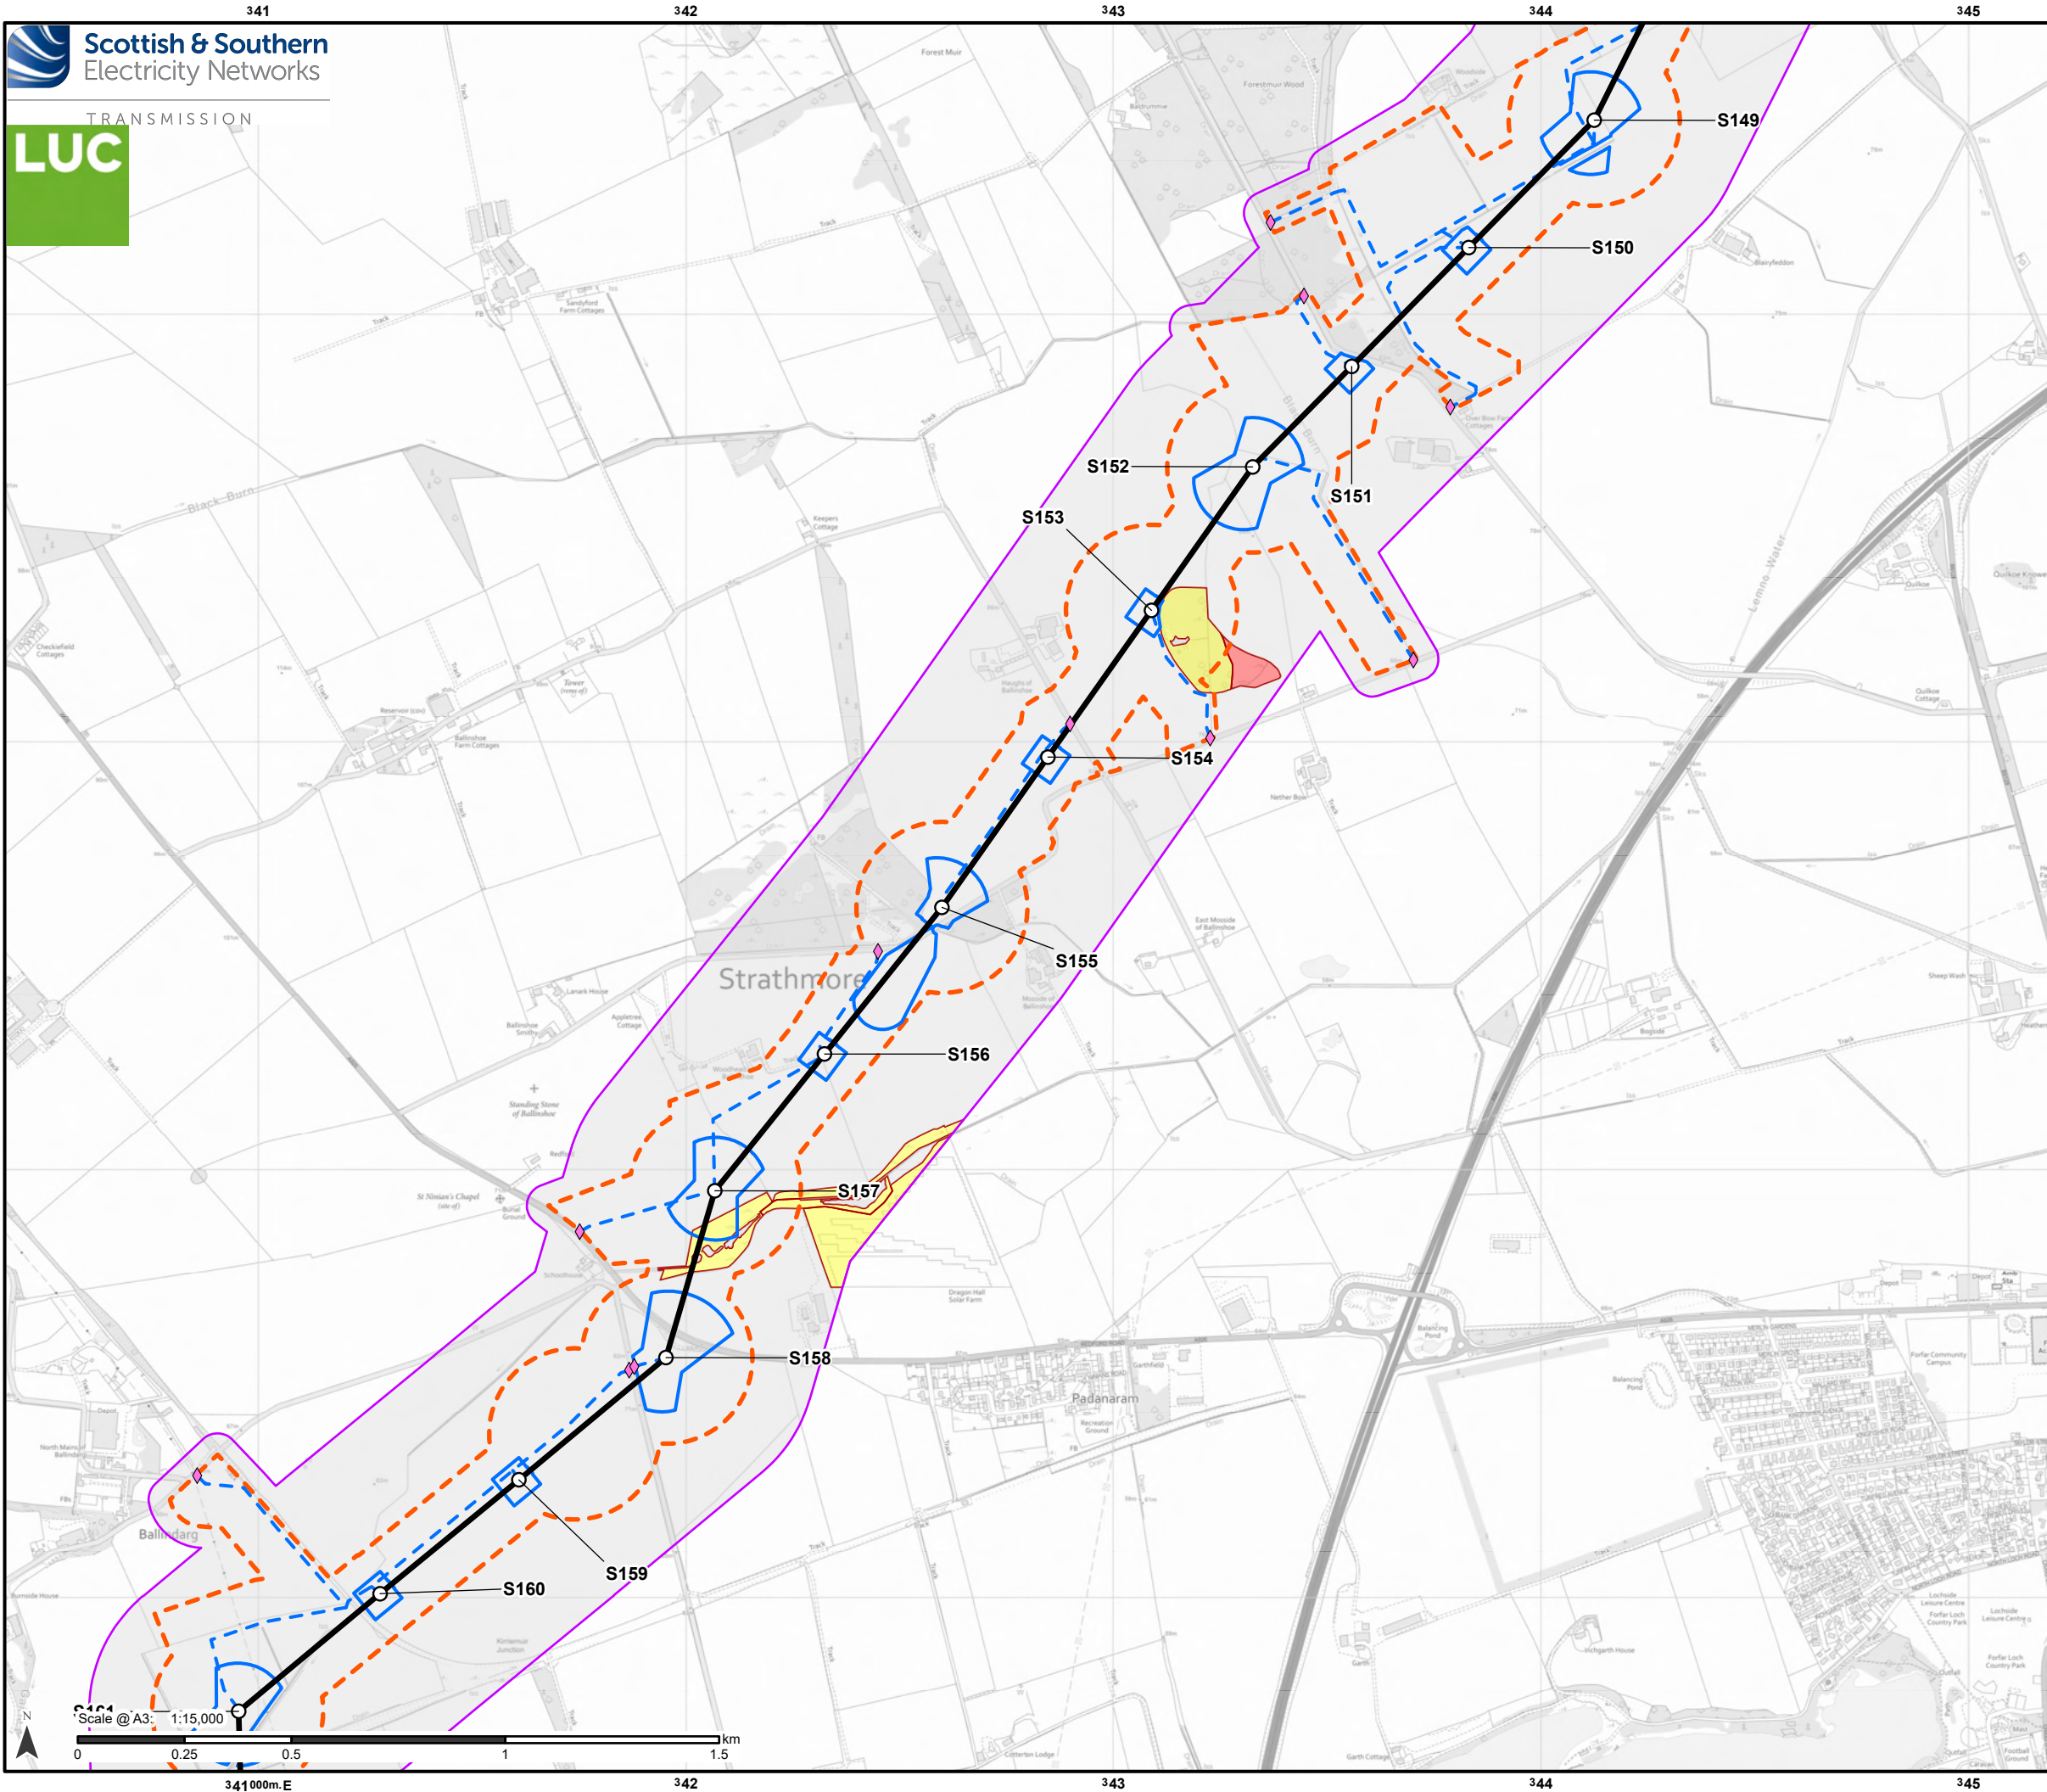

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)


- High potential
- Moderate potential
- Non-GWDTE habitat

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

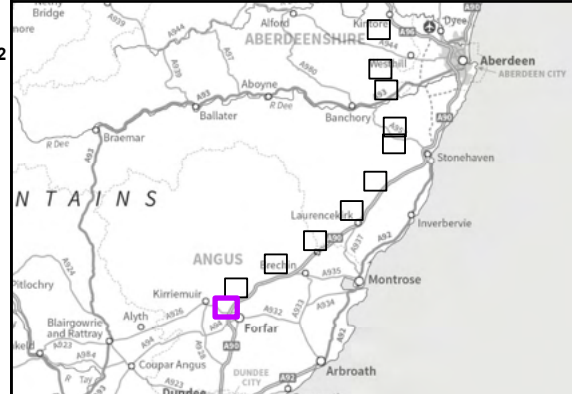


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS
Date: 14/08/2025

Drawing: 11.5.1

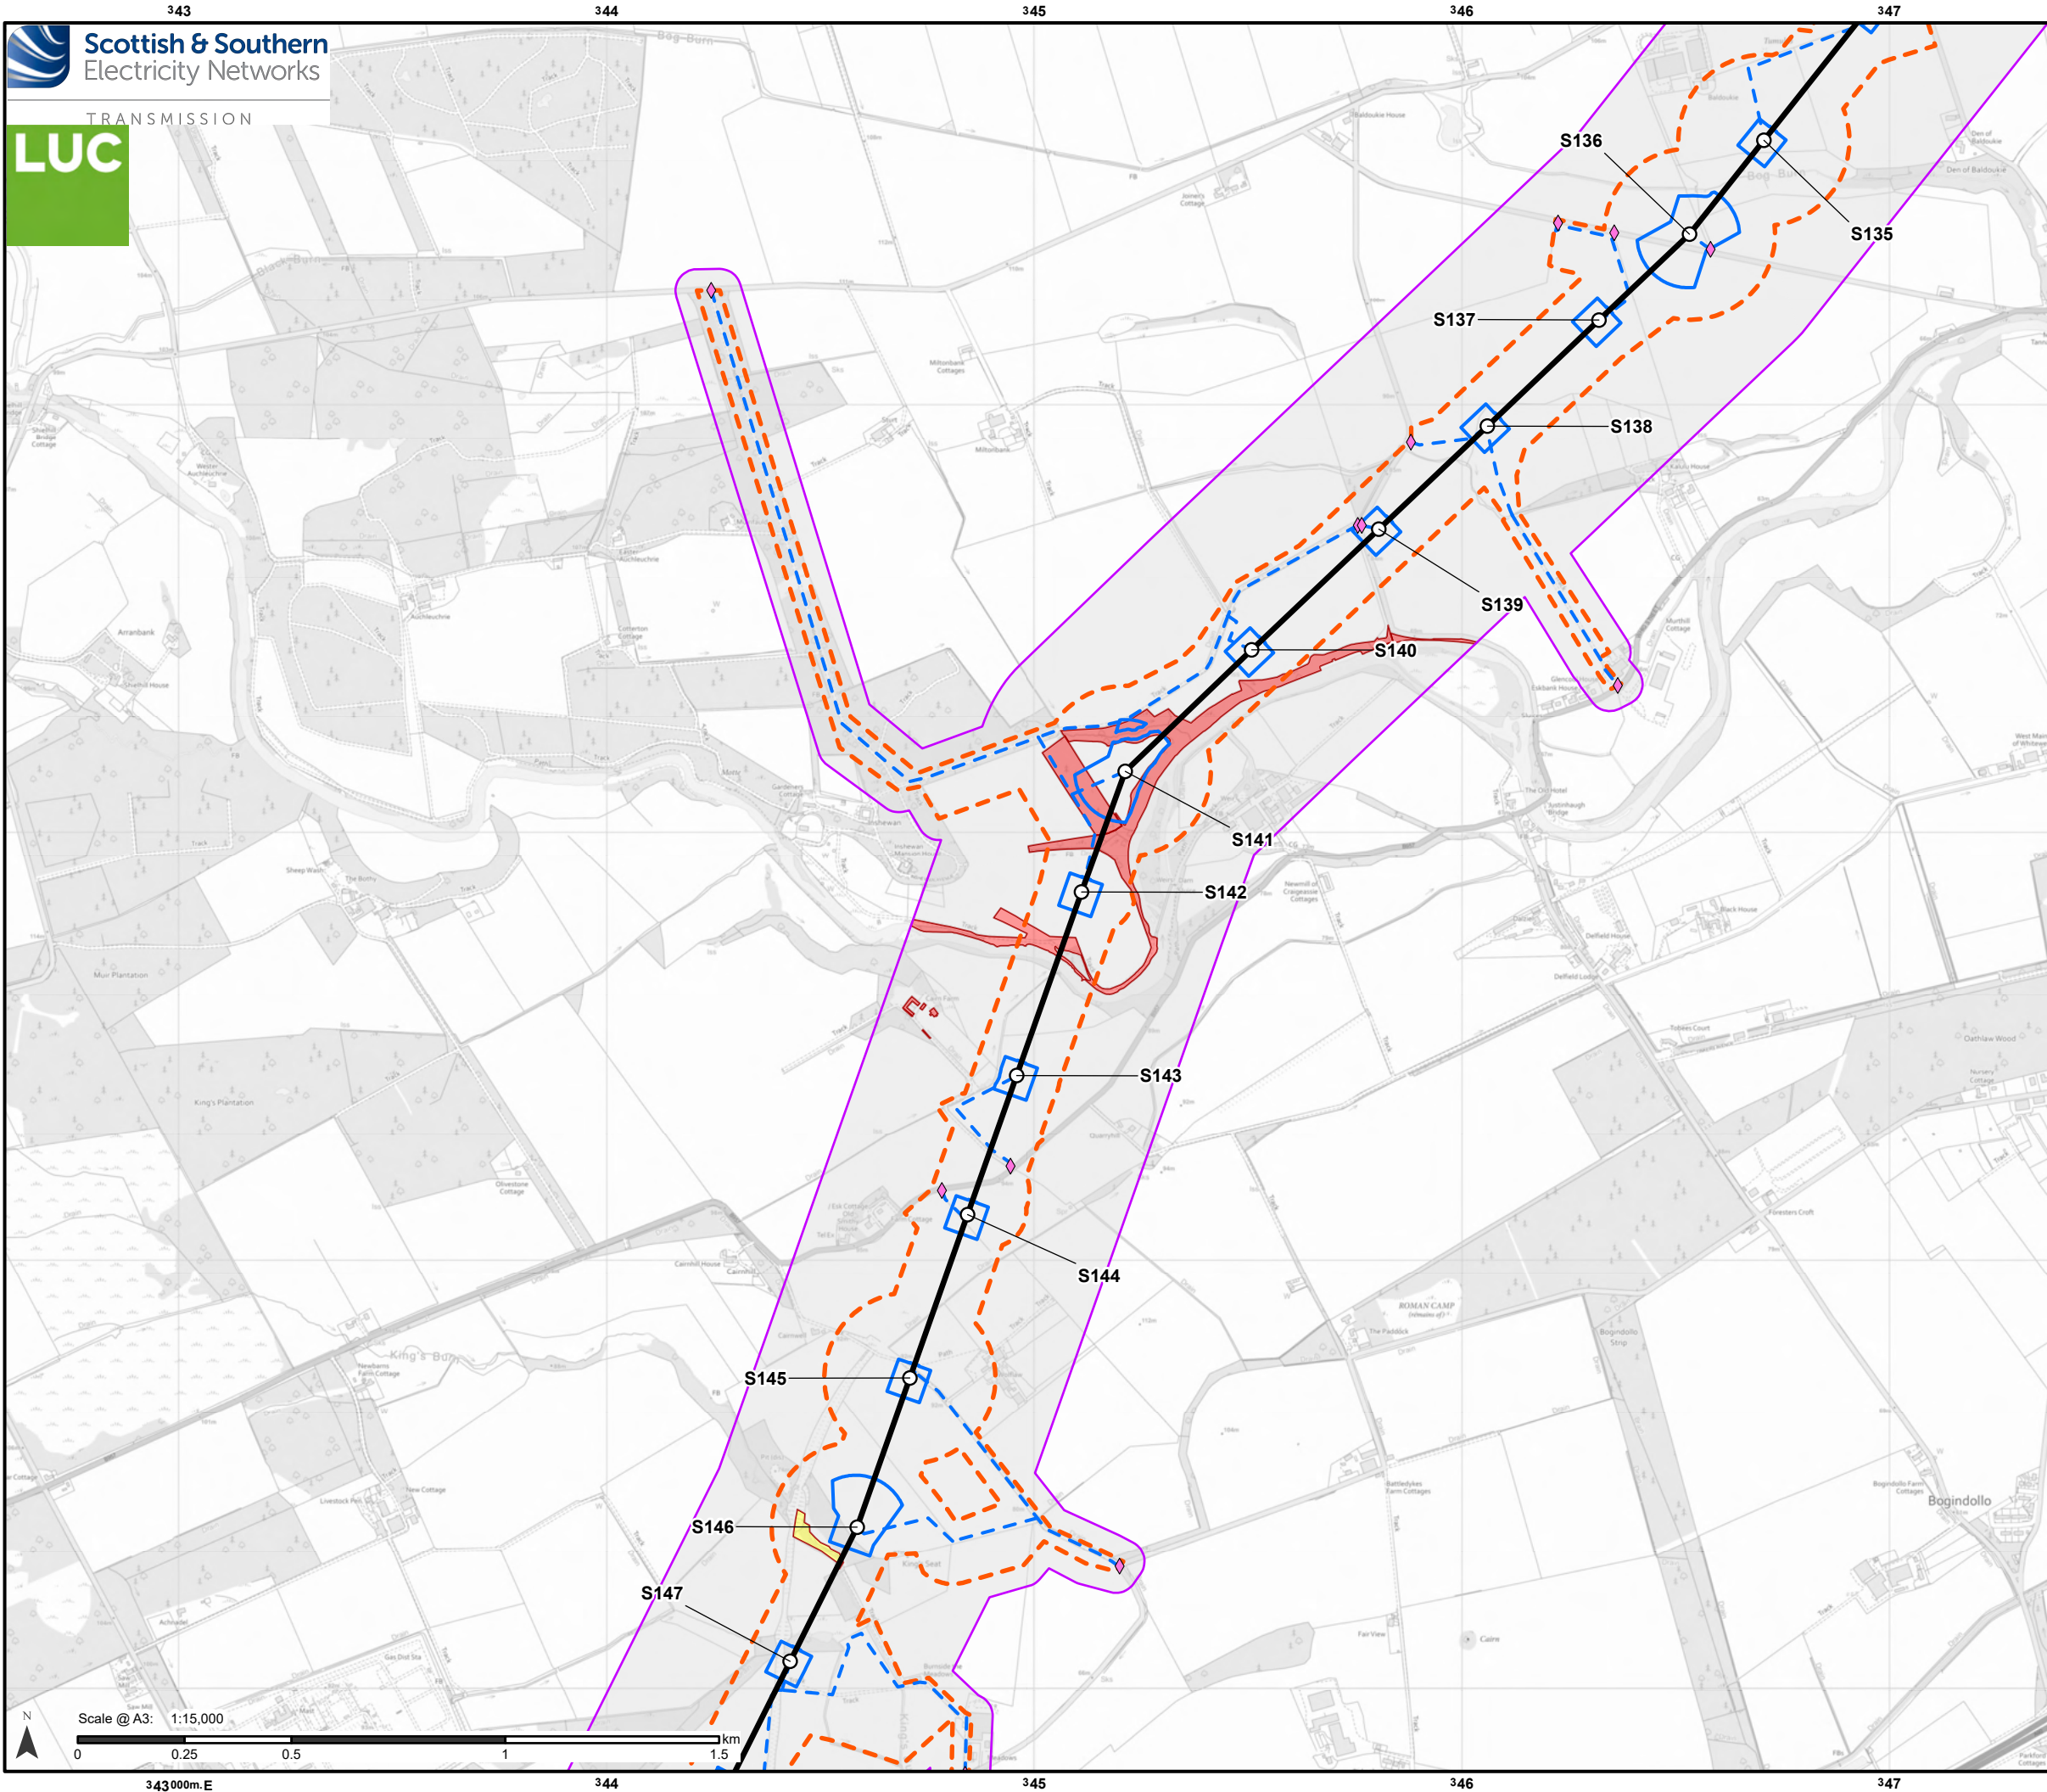

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- High potential
- Moderate potential
- Non-GWDTE habitat

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS Date: 14/08/2025

Drawing: 11.5.2

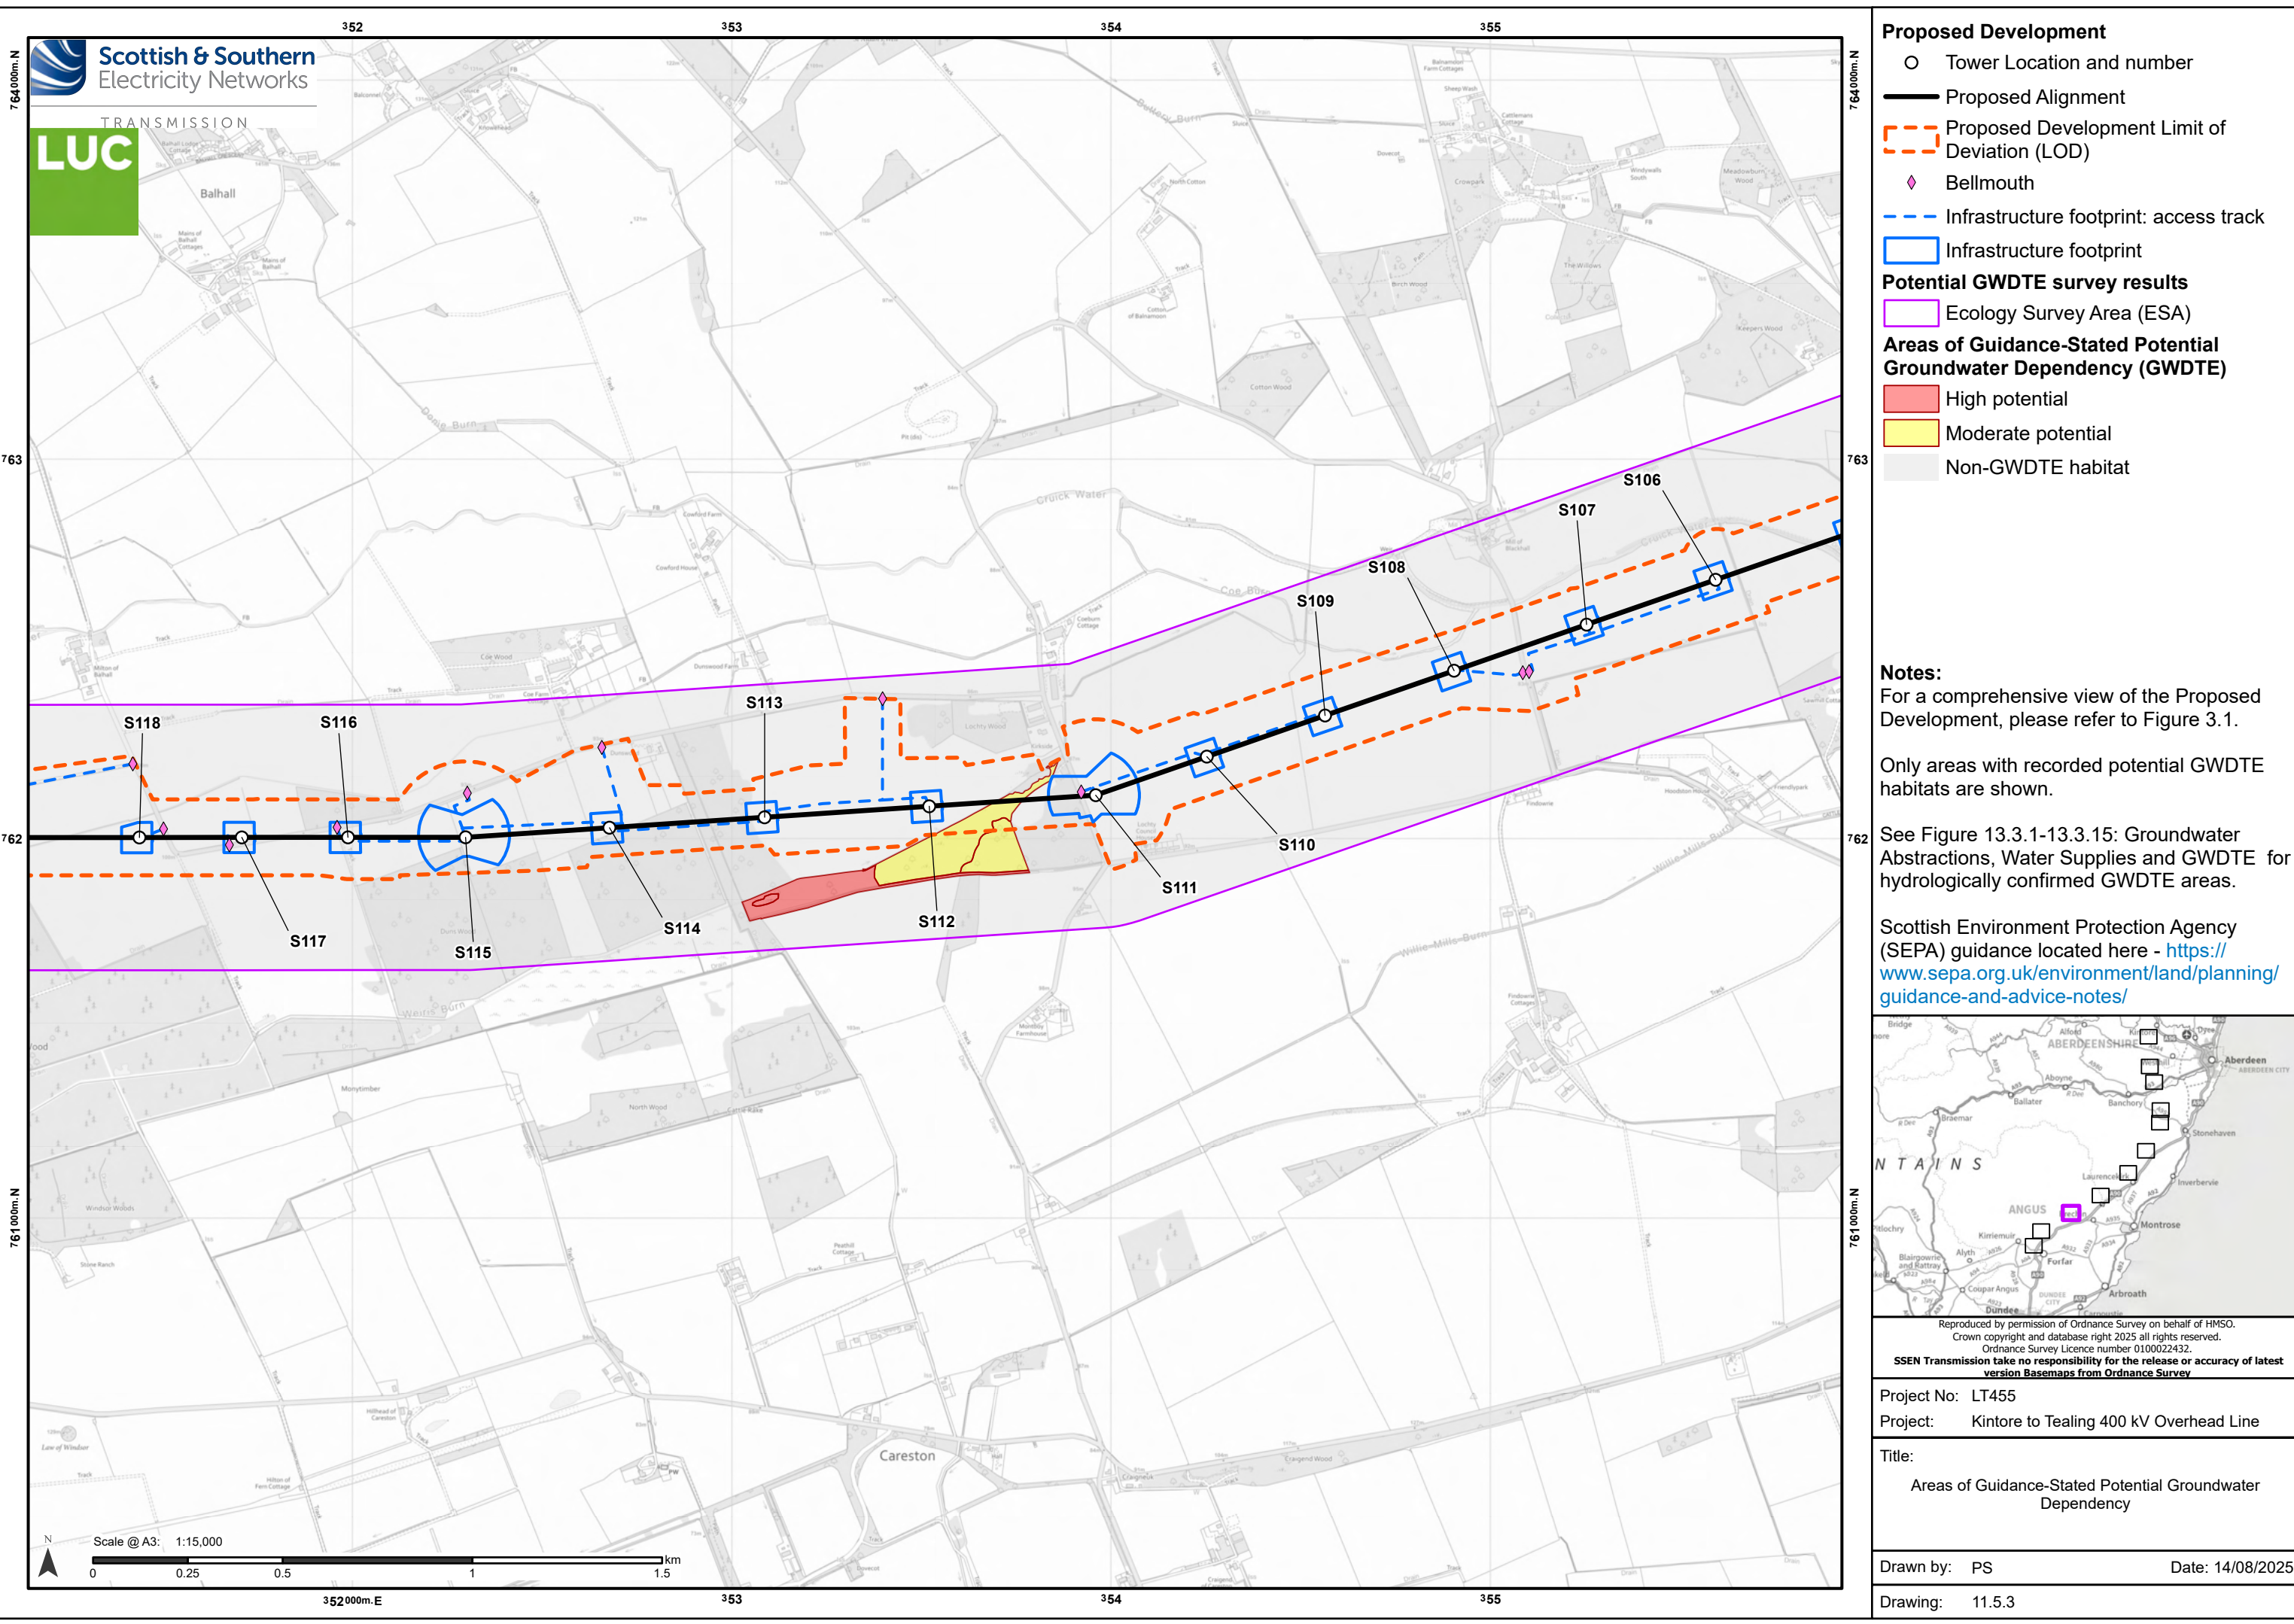


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - - - Proposed Development Limit of Deviation (LOD)
 - ◇ Bellmouth
 - - - Infrastructure footprint: access track
 - ▭ Infrastructure footprint
- Potential GWDTE survey results**
- ▭ Ecology Survey Area (ESA)
- Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)**
- ▭ High potential
 - ▭ Moderate potential
 - ▭ Non-GWDTE habitat

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.


See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

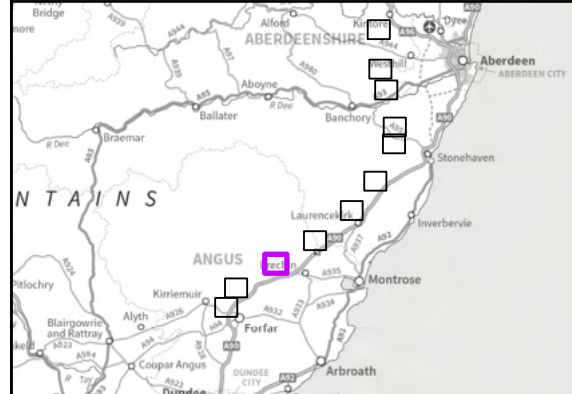

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Areas of Guidance-Stated Potential Groundwater Dependency
Drawn by:	PS
Date:	14/08/2025
Drawing:	11.5.3

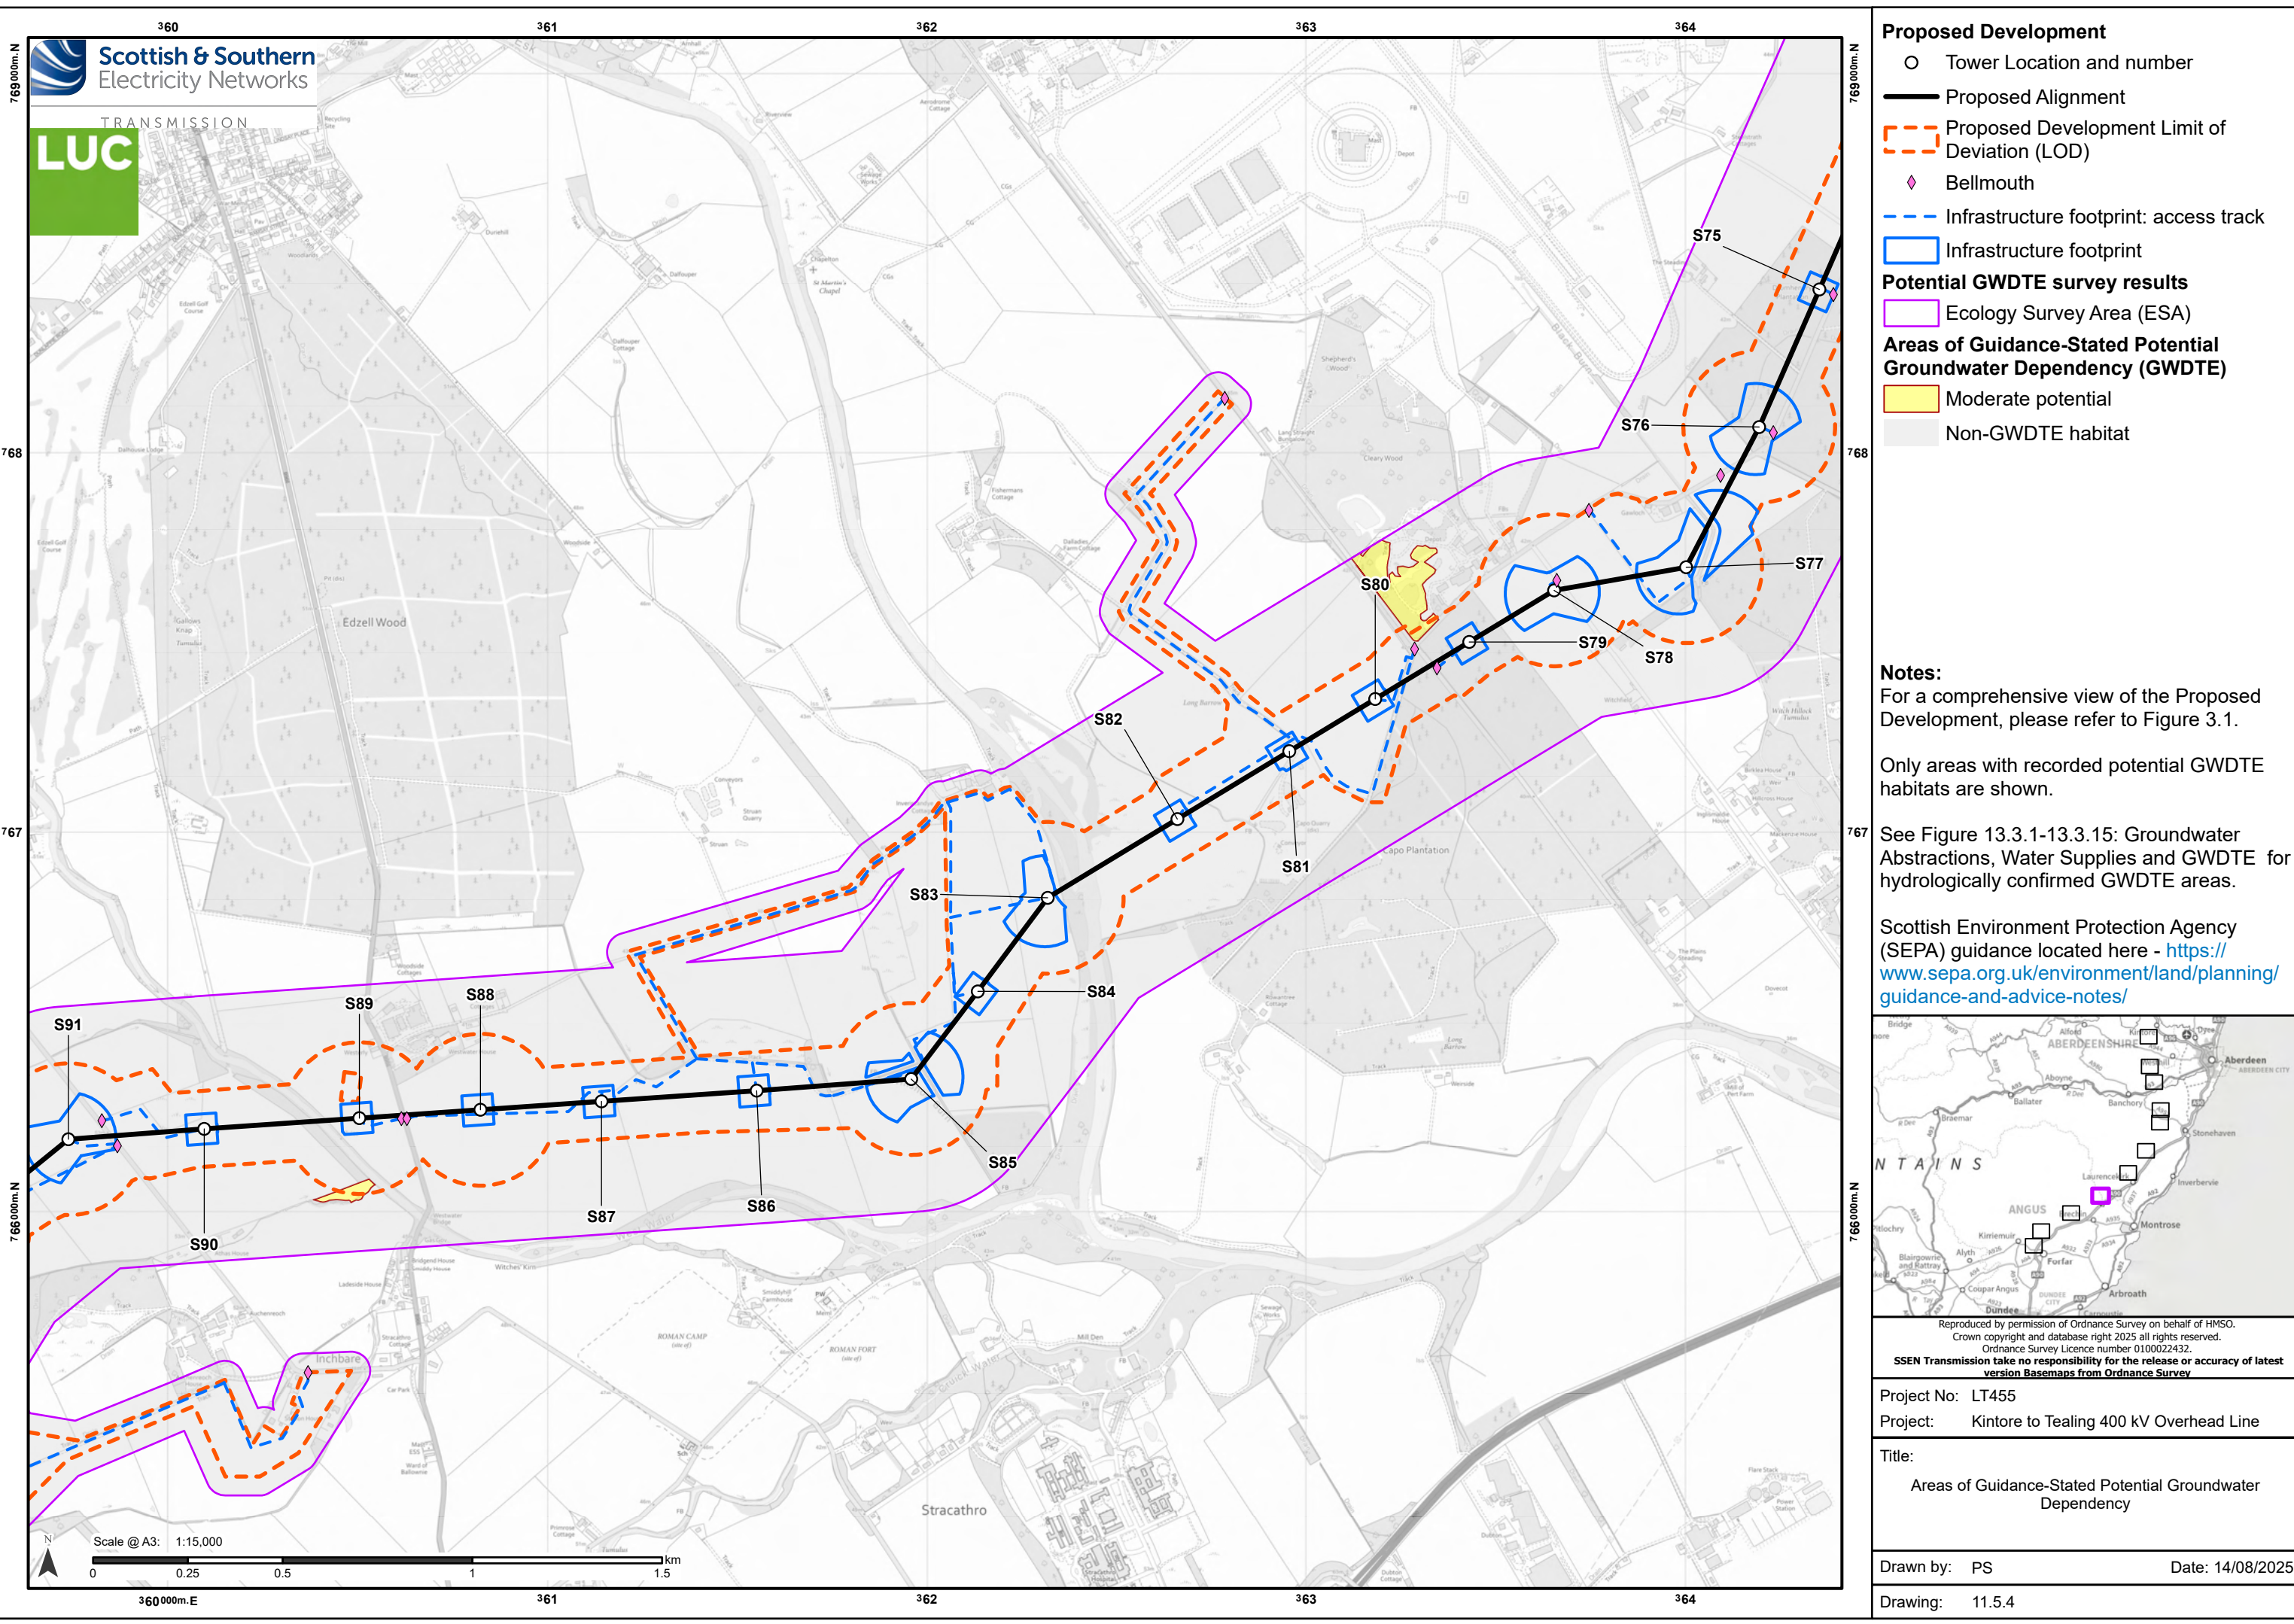

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- ▭ Infrastructure footprint

Potential GWDTE survey results

- ▭ Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- ▭ Moderate potential
- ▭ Non-GWDTE habitat

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS

Date: 14/08/2025

Drawing: 11.5.4

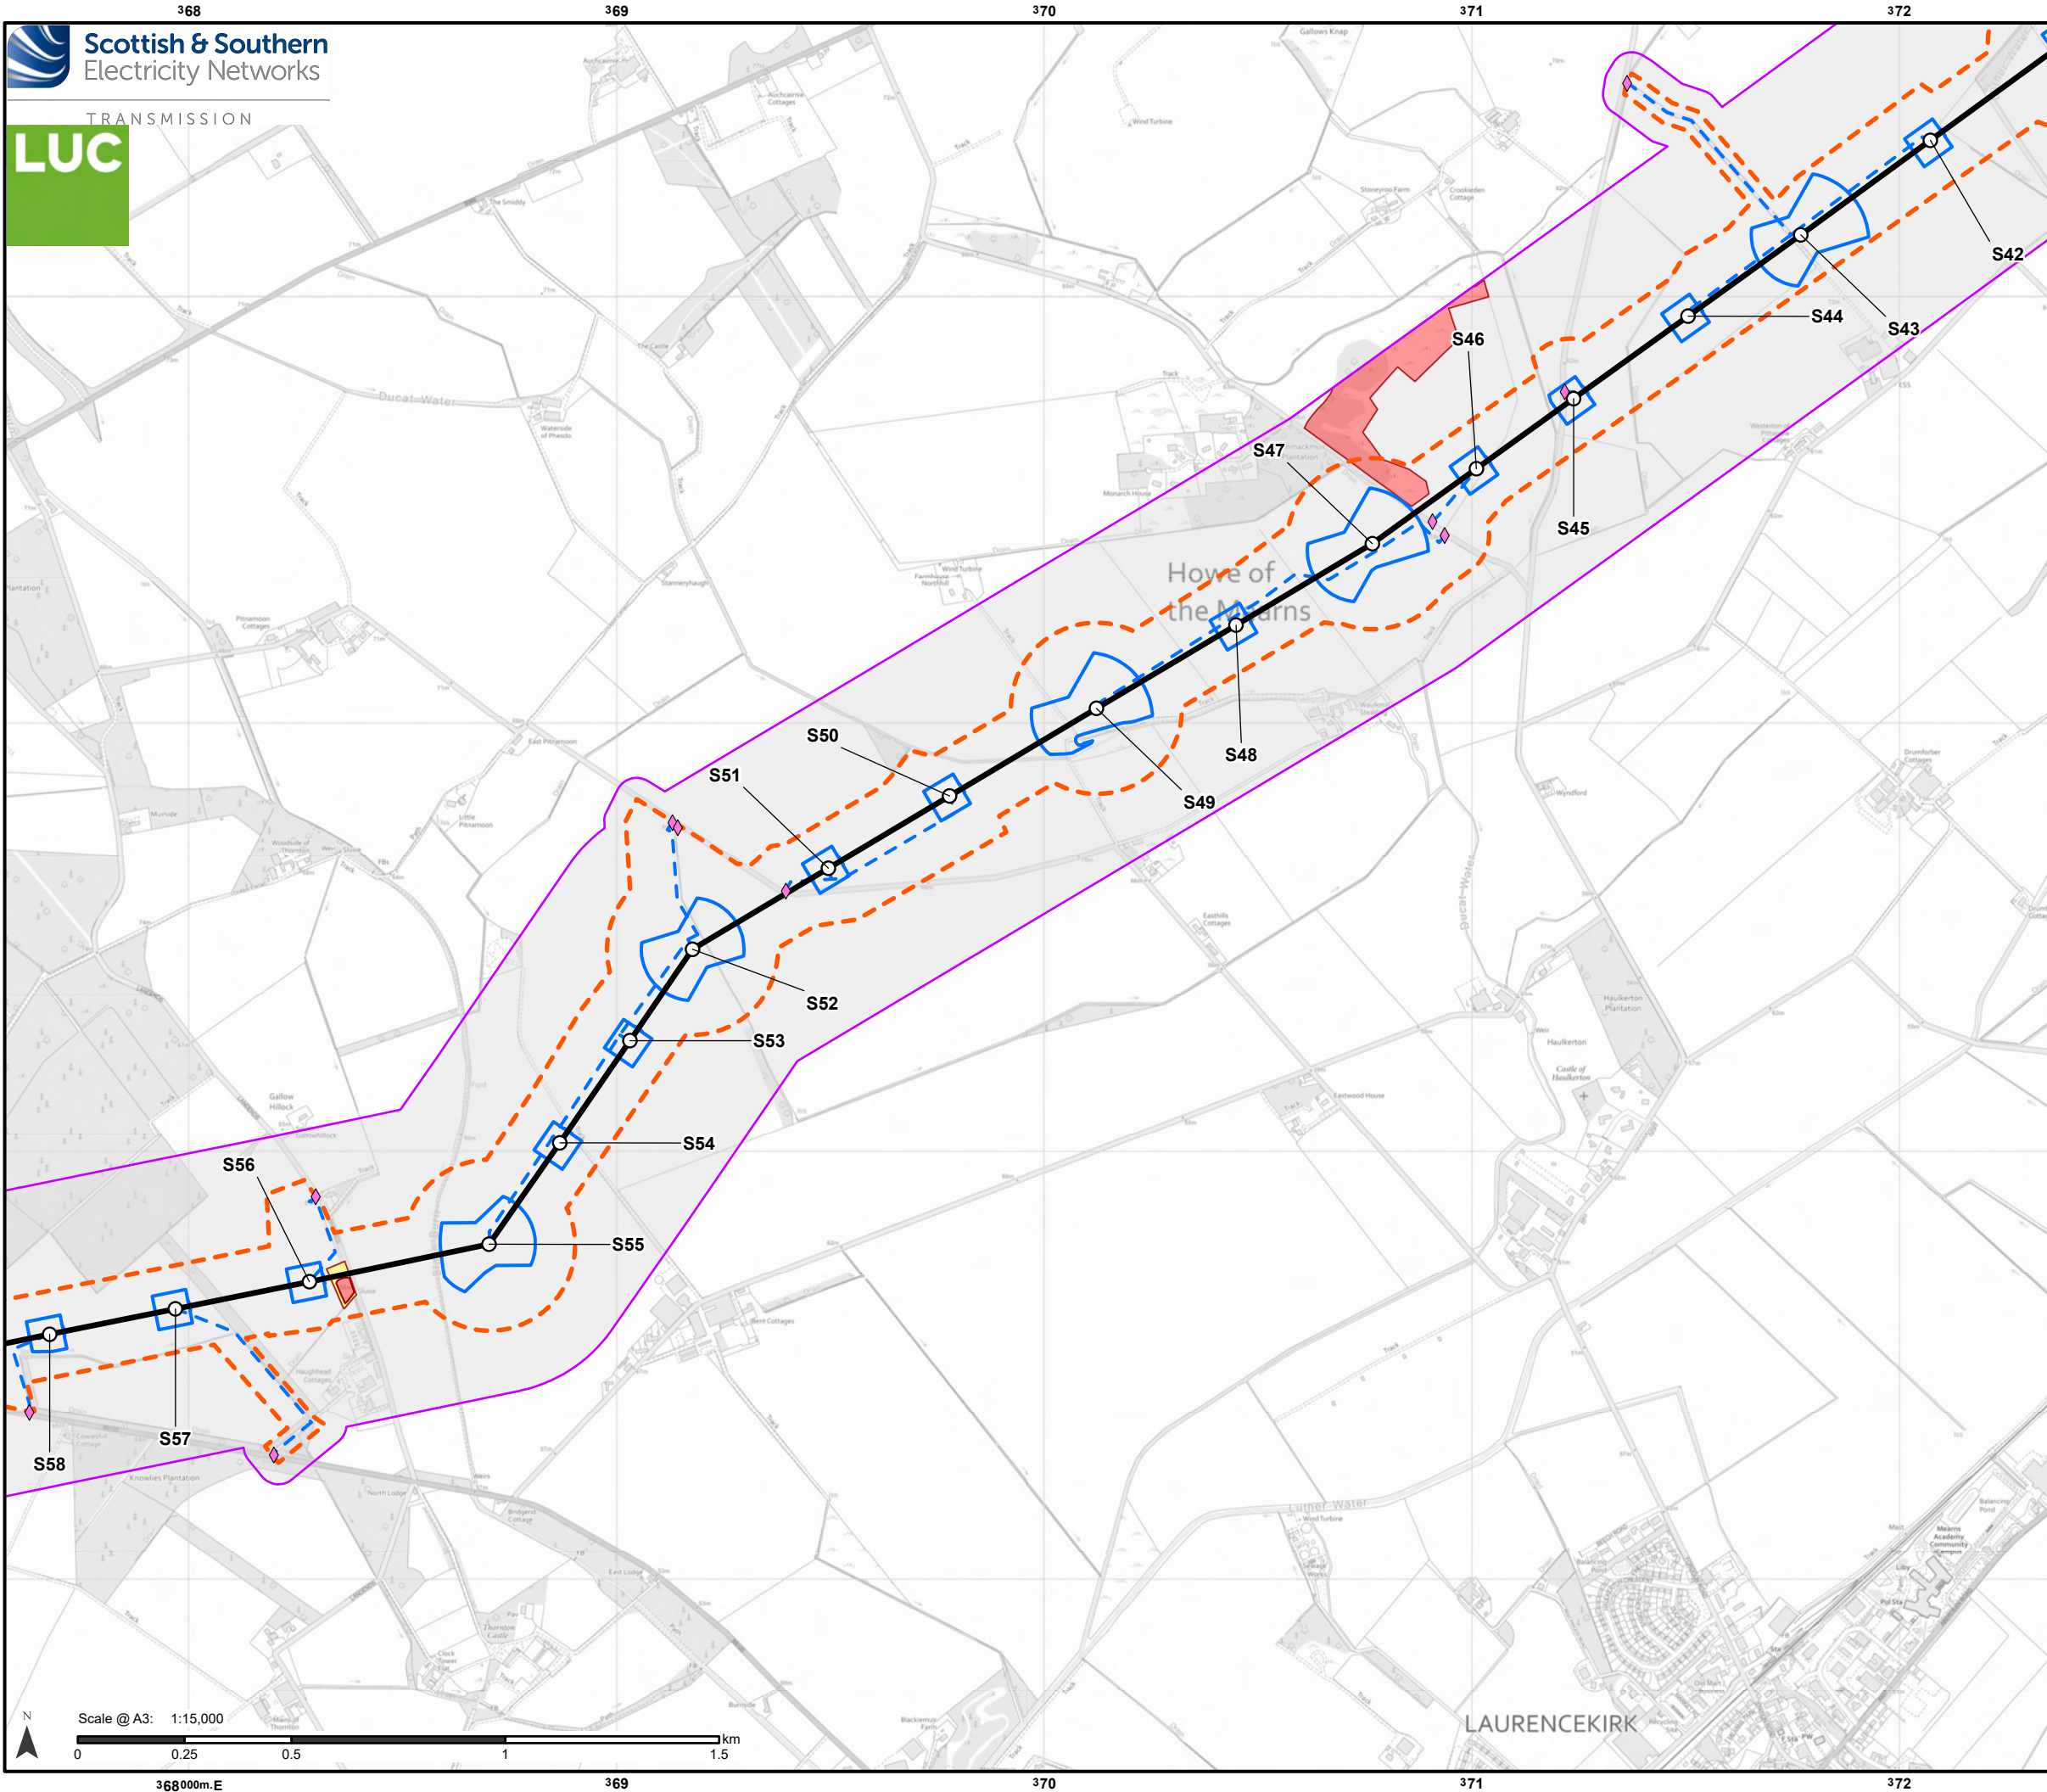

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)


- High potential
- Moderate potential
- Non-GWDTE habitat

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.


Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

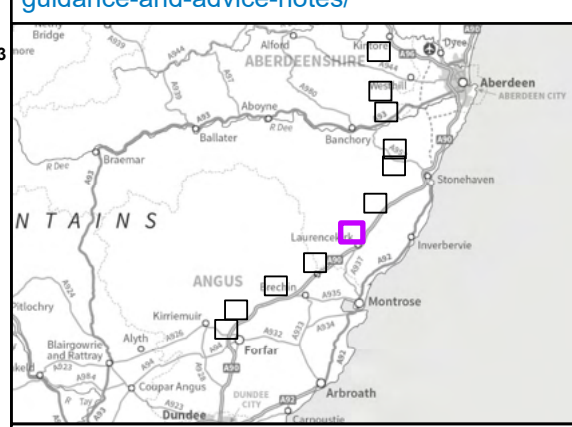

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Areas of Guidance-Stated Potential Groundwater Dependency
Drawn by:	PS
Date:	14/08/2025
Drawing:	11.5.5

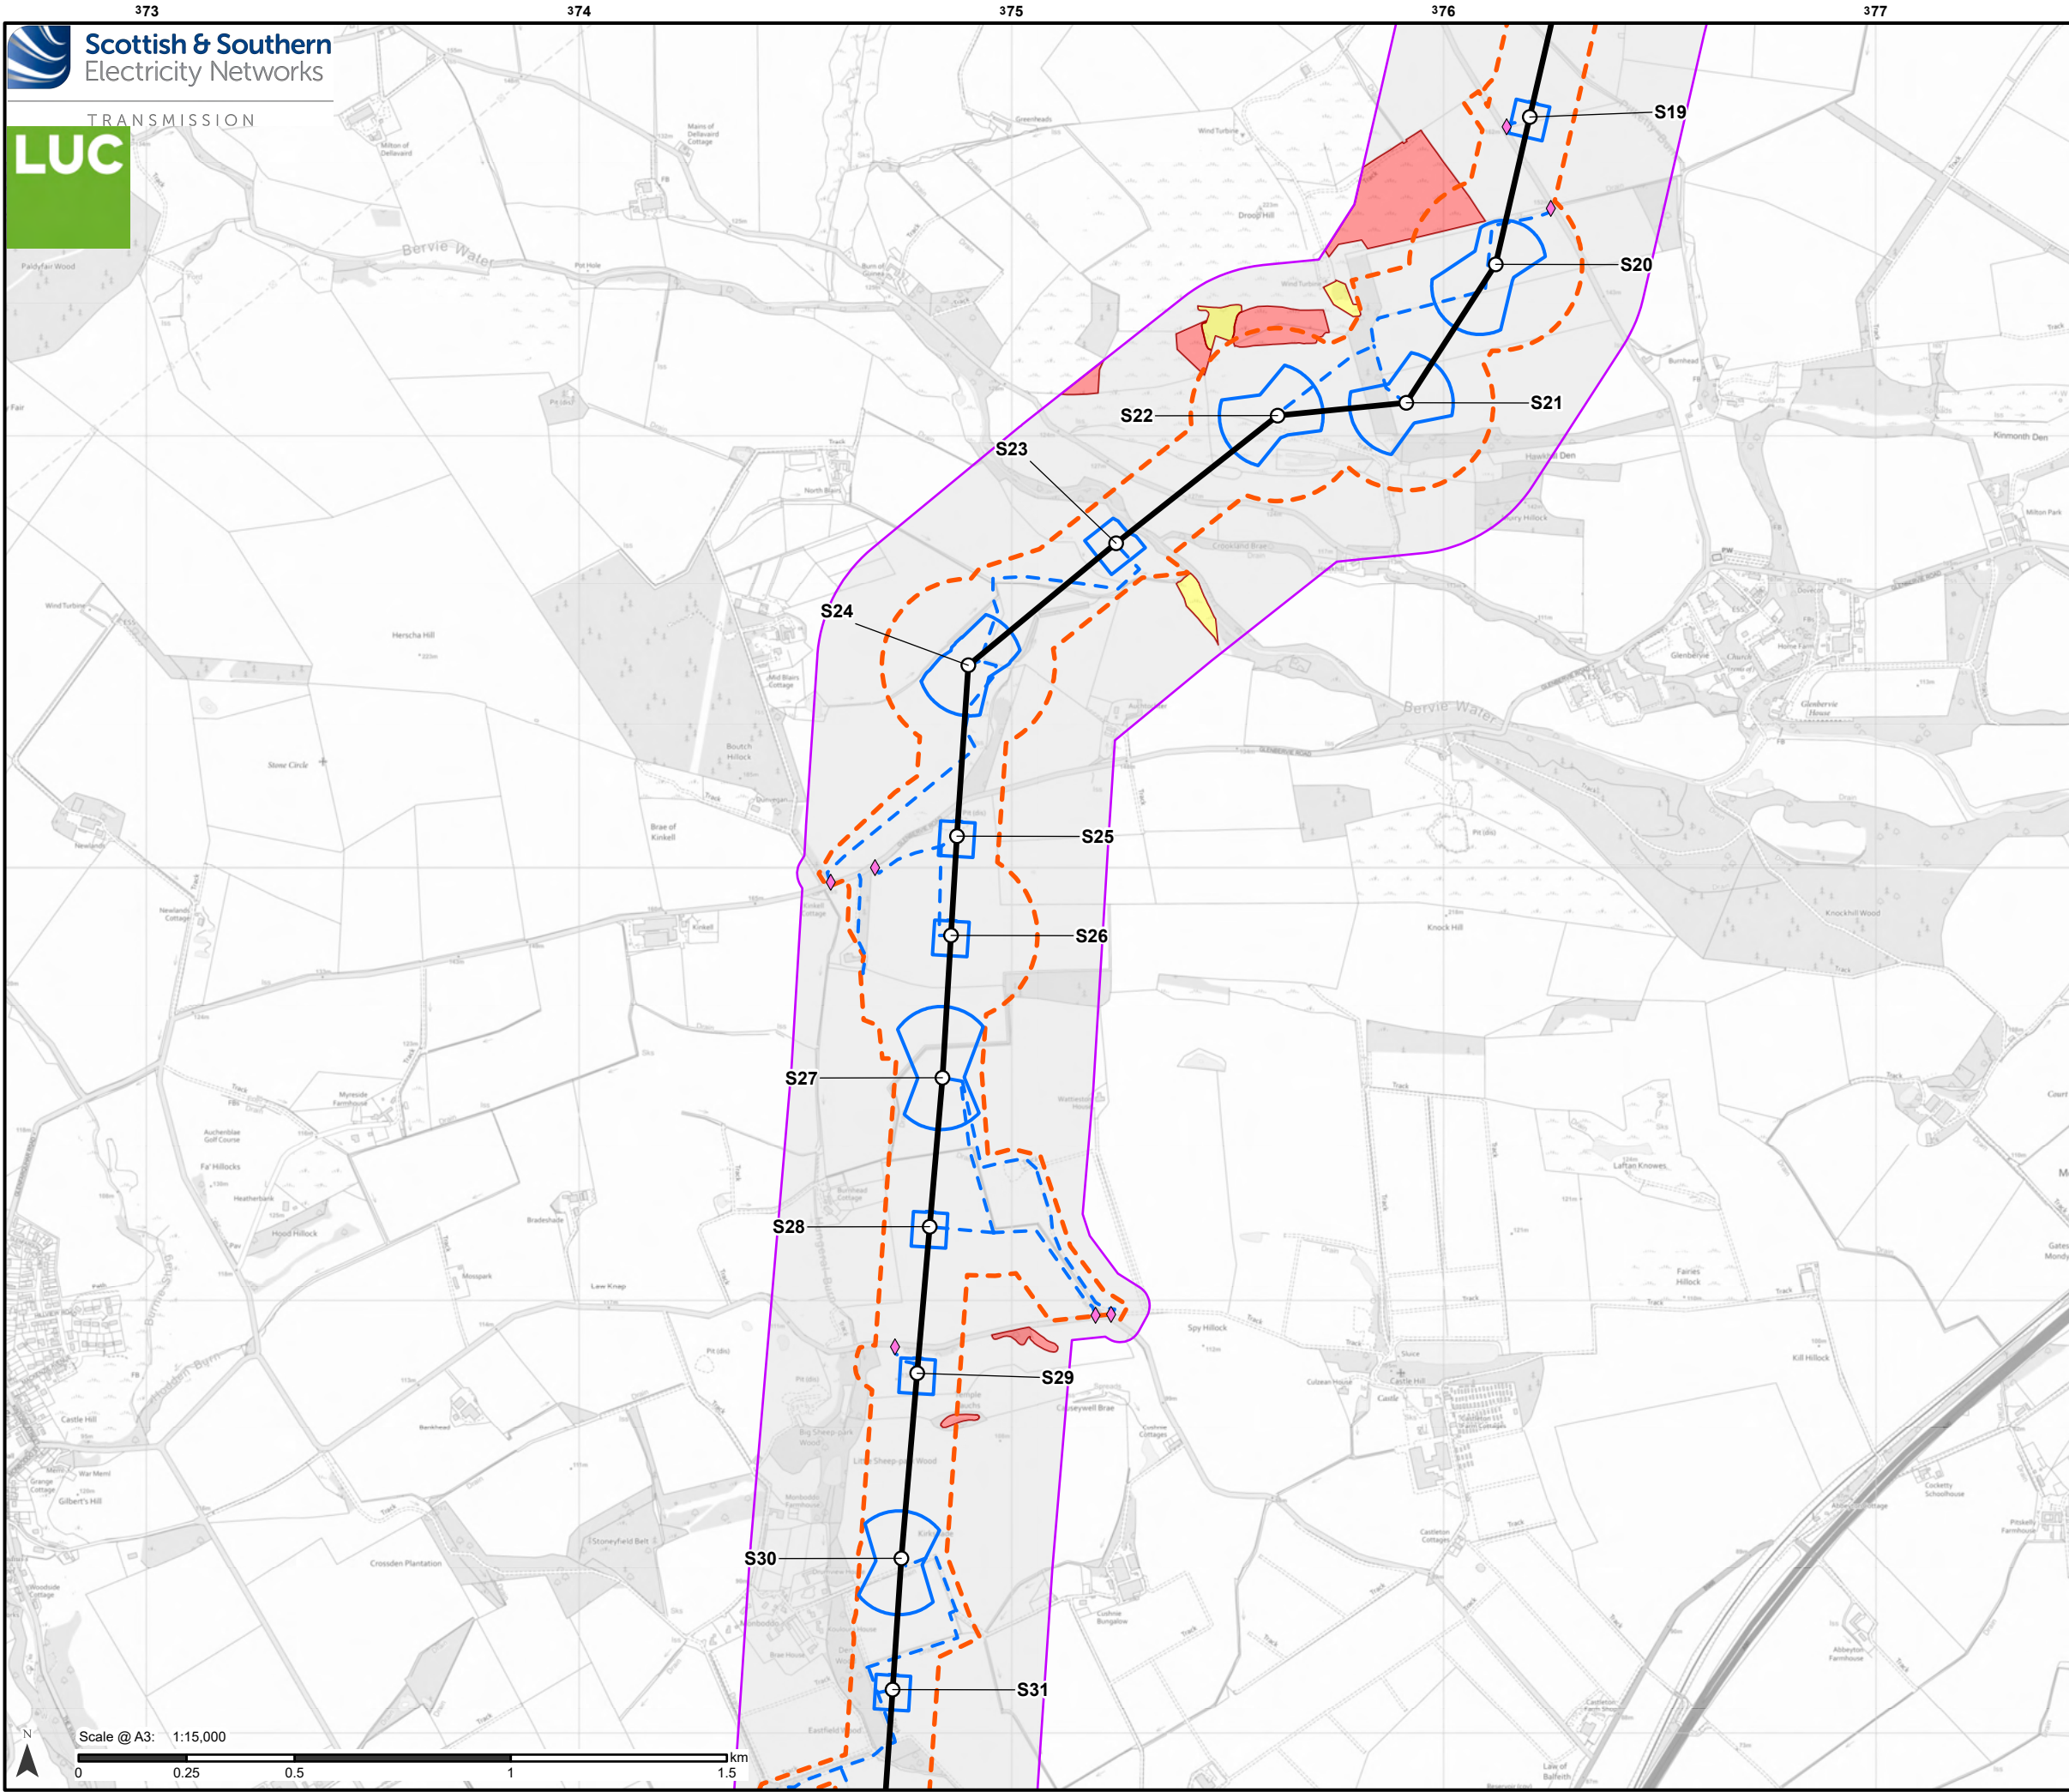

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- High potential
- Moderate potential
- Non-GWDTE habitat

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line


Title: Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS

Date: 14/08/2025

Drawing: 11.5.6

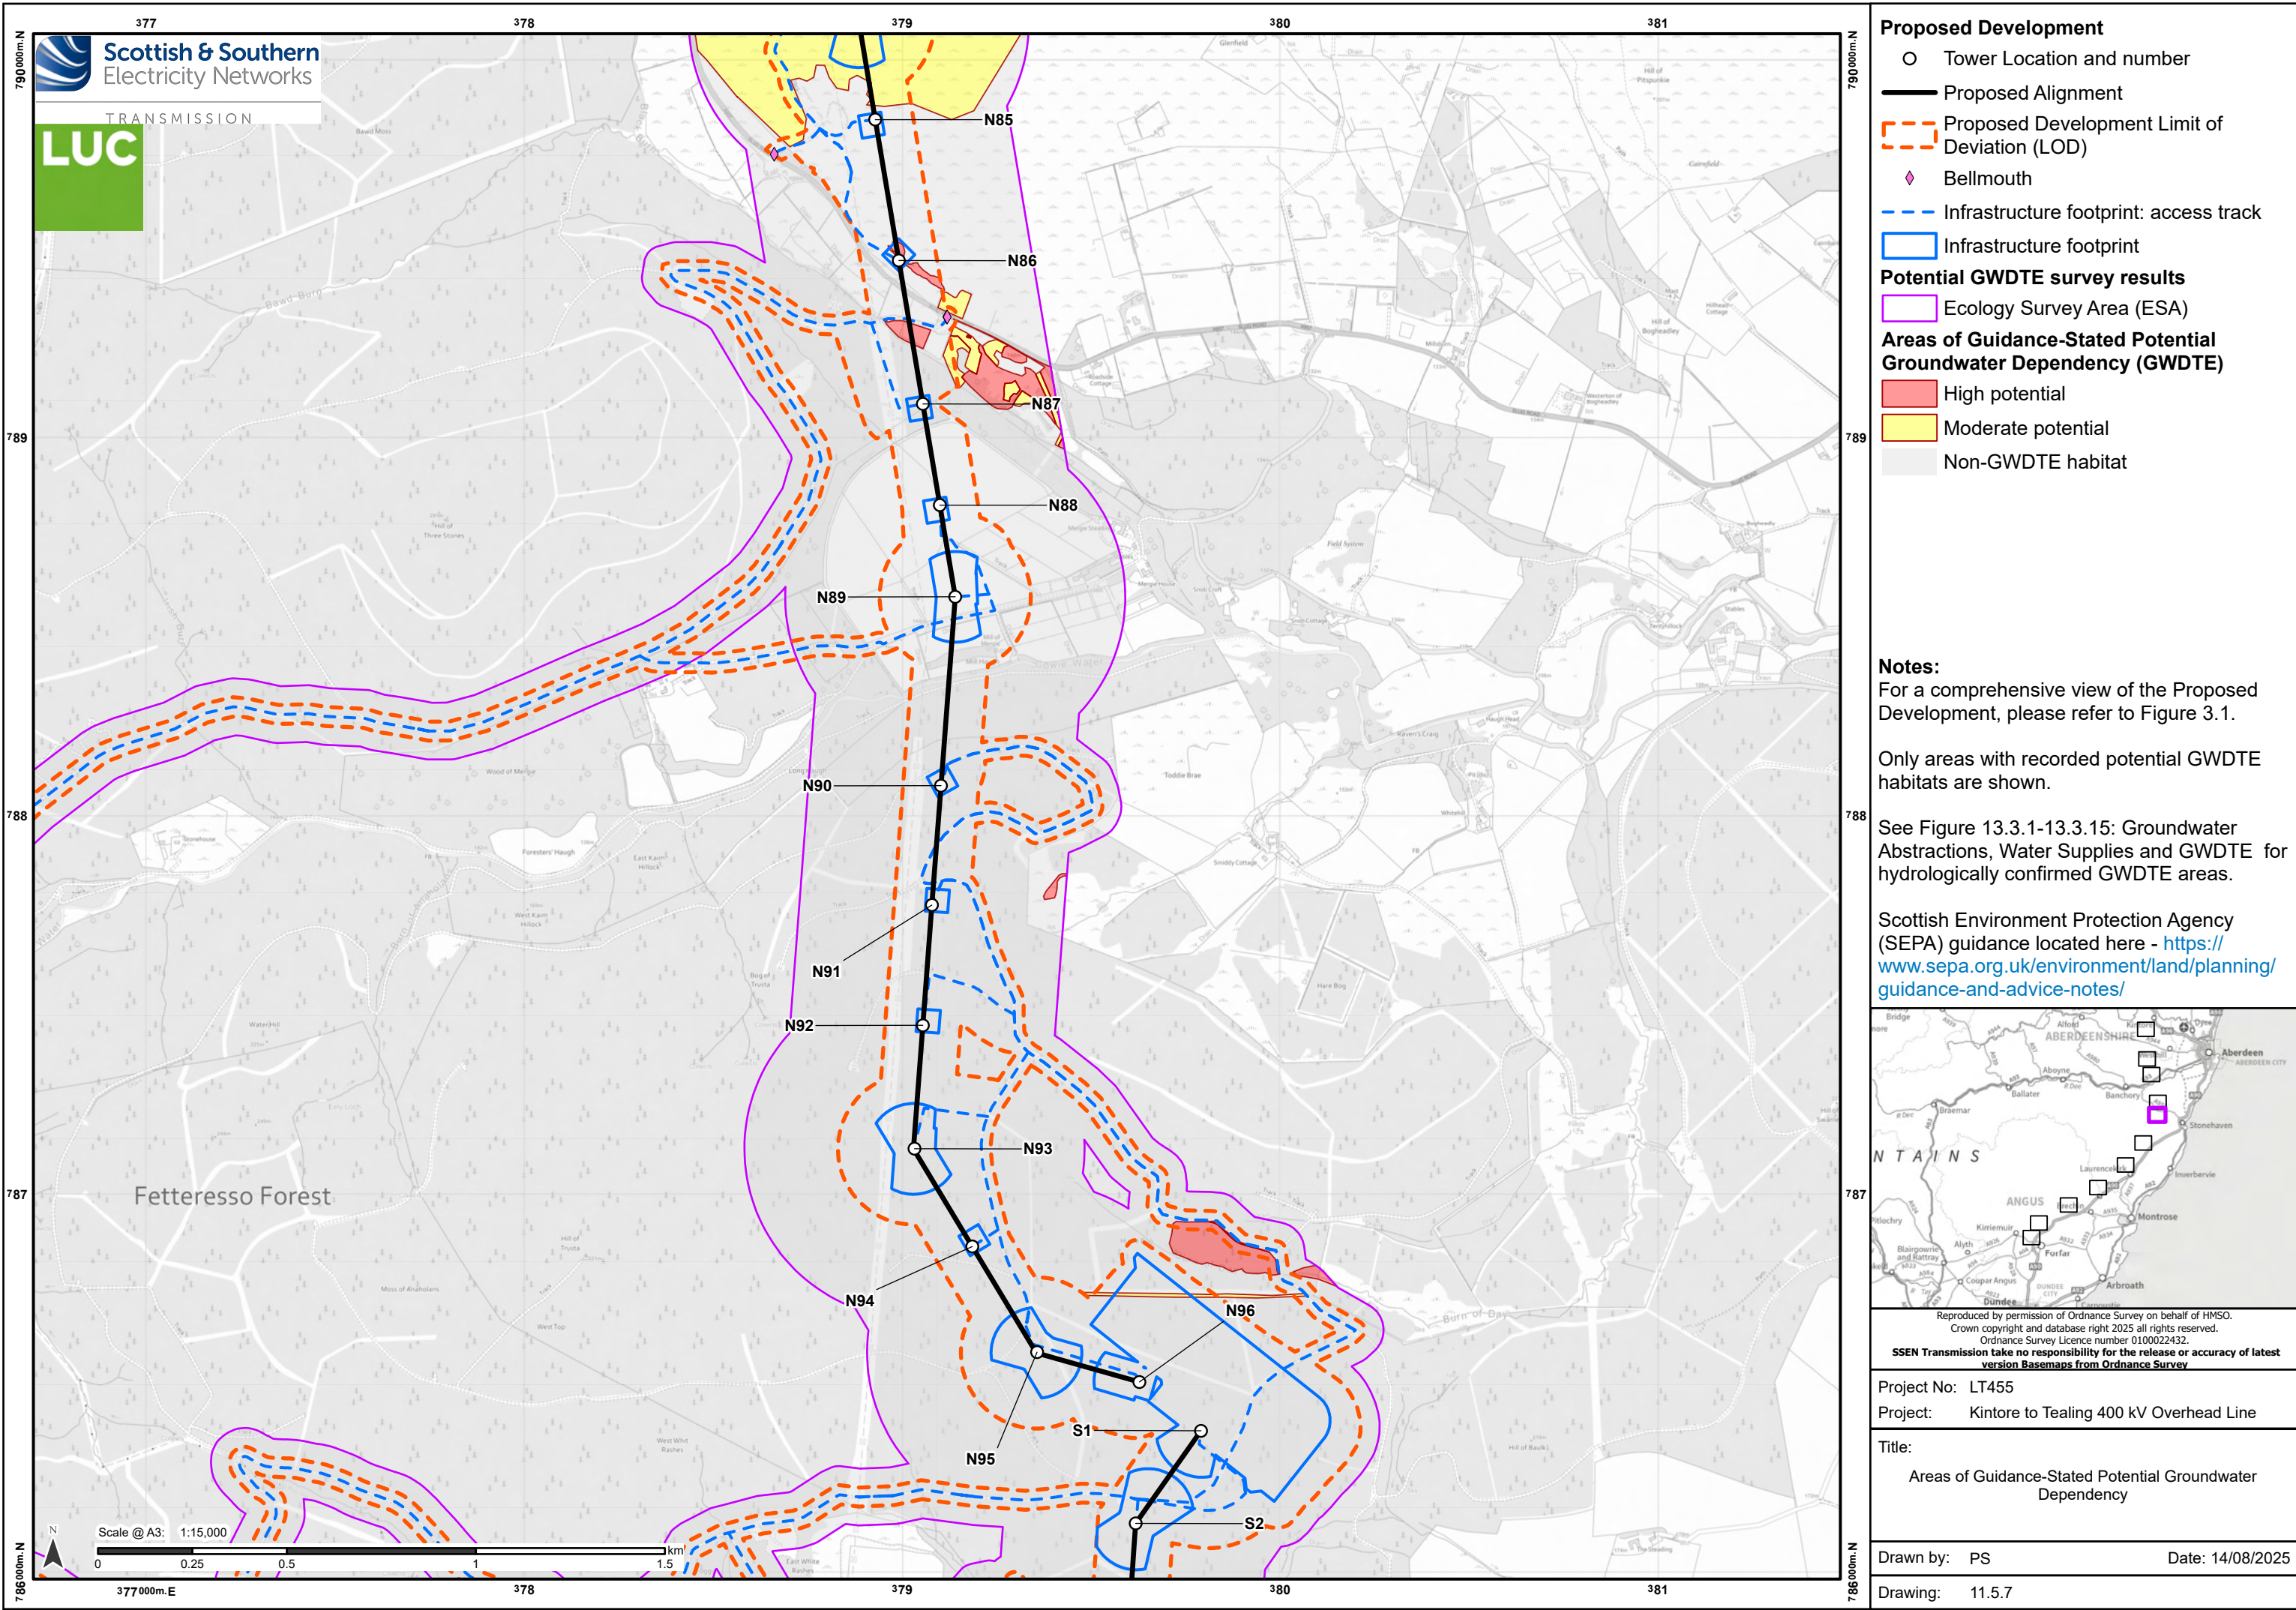

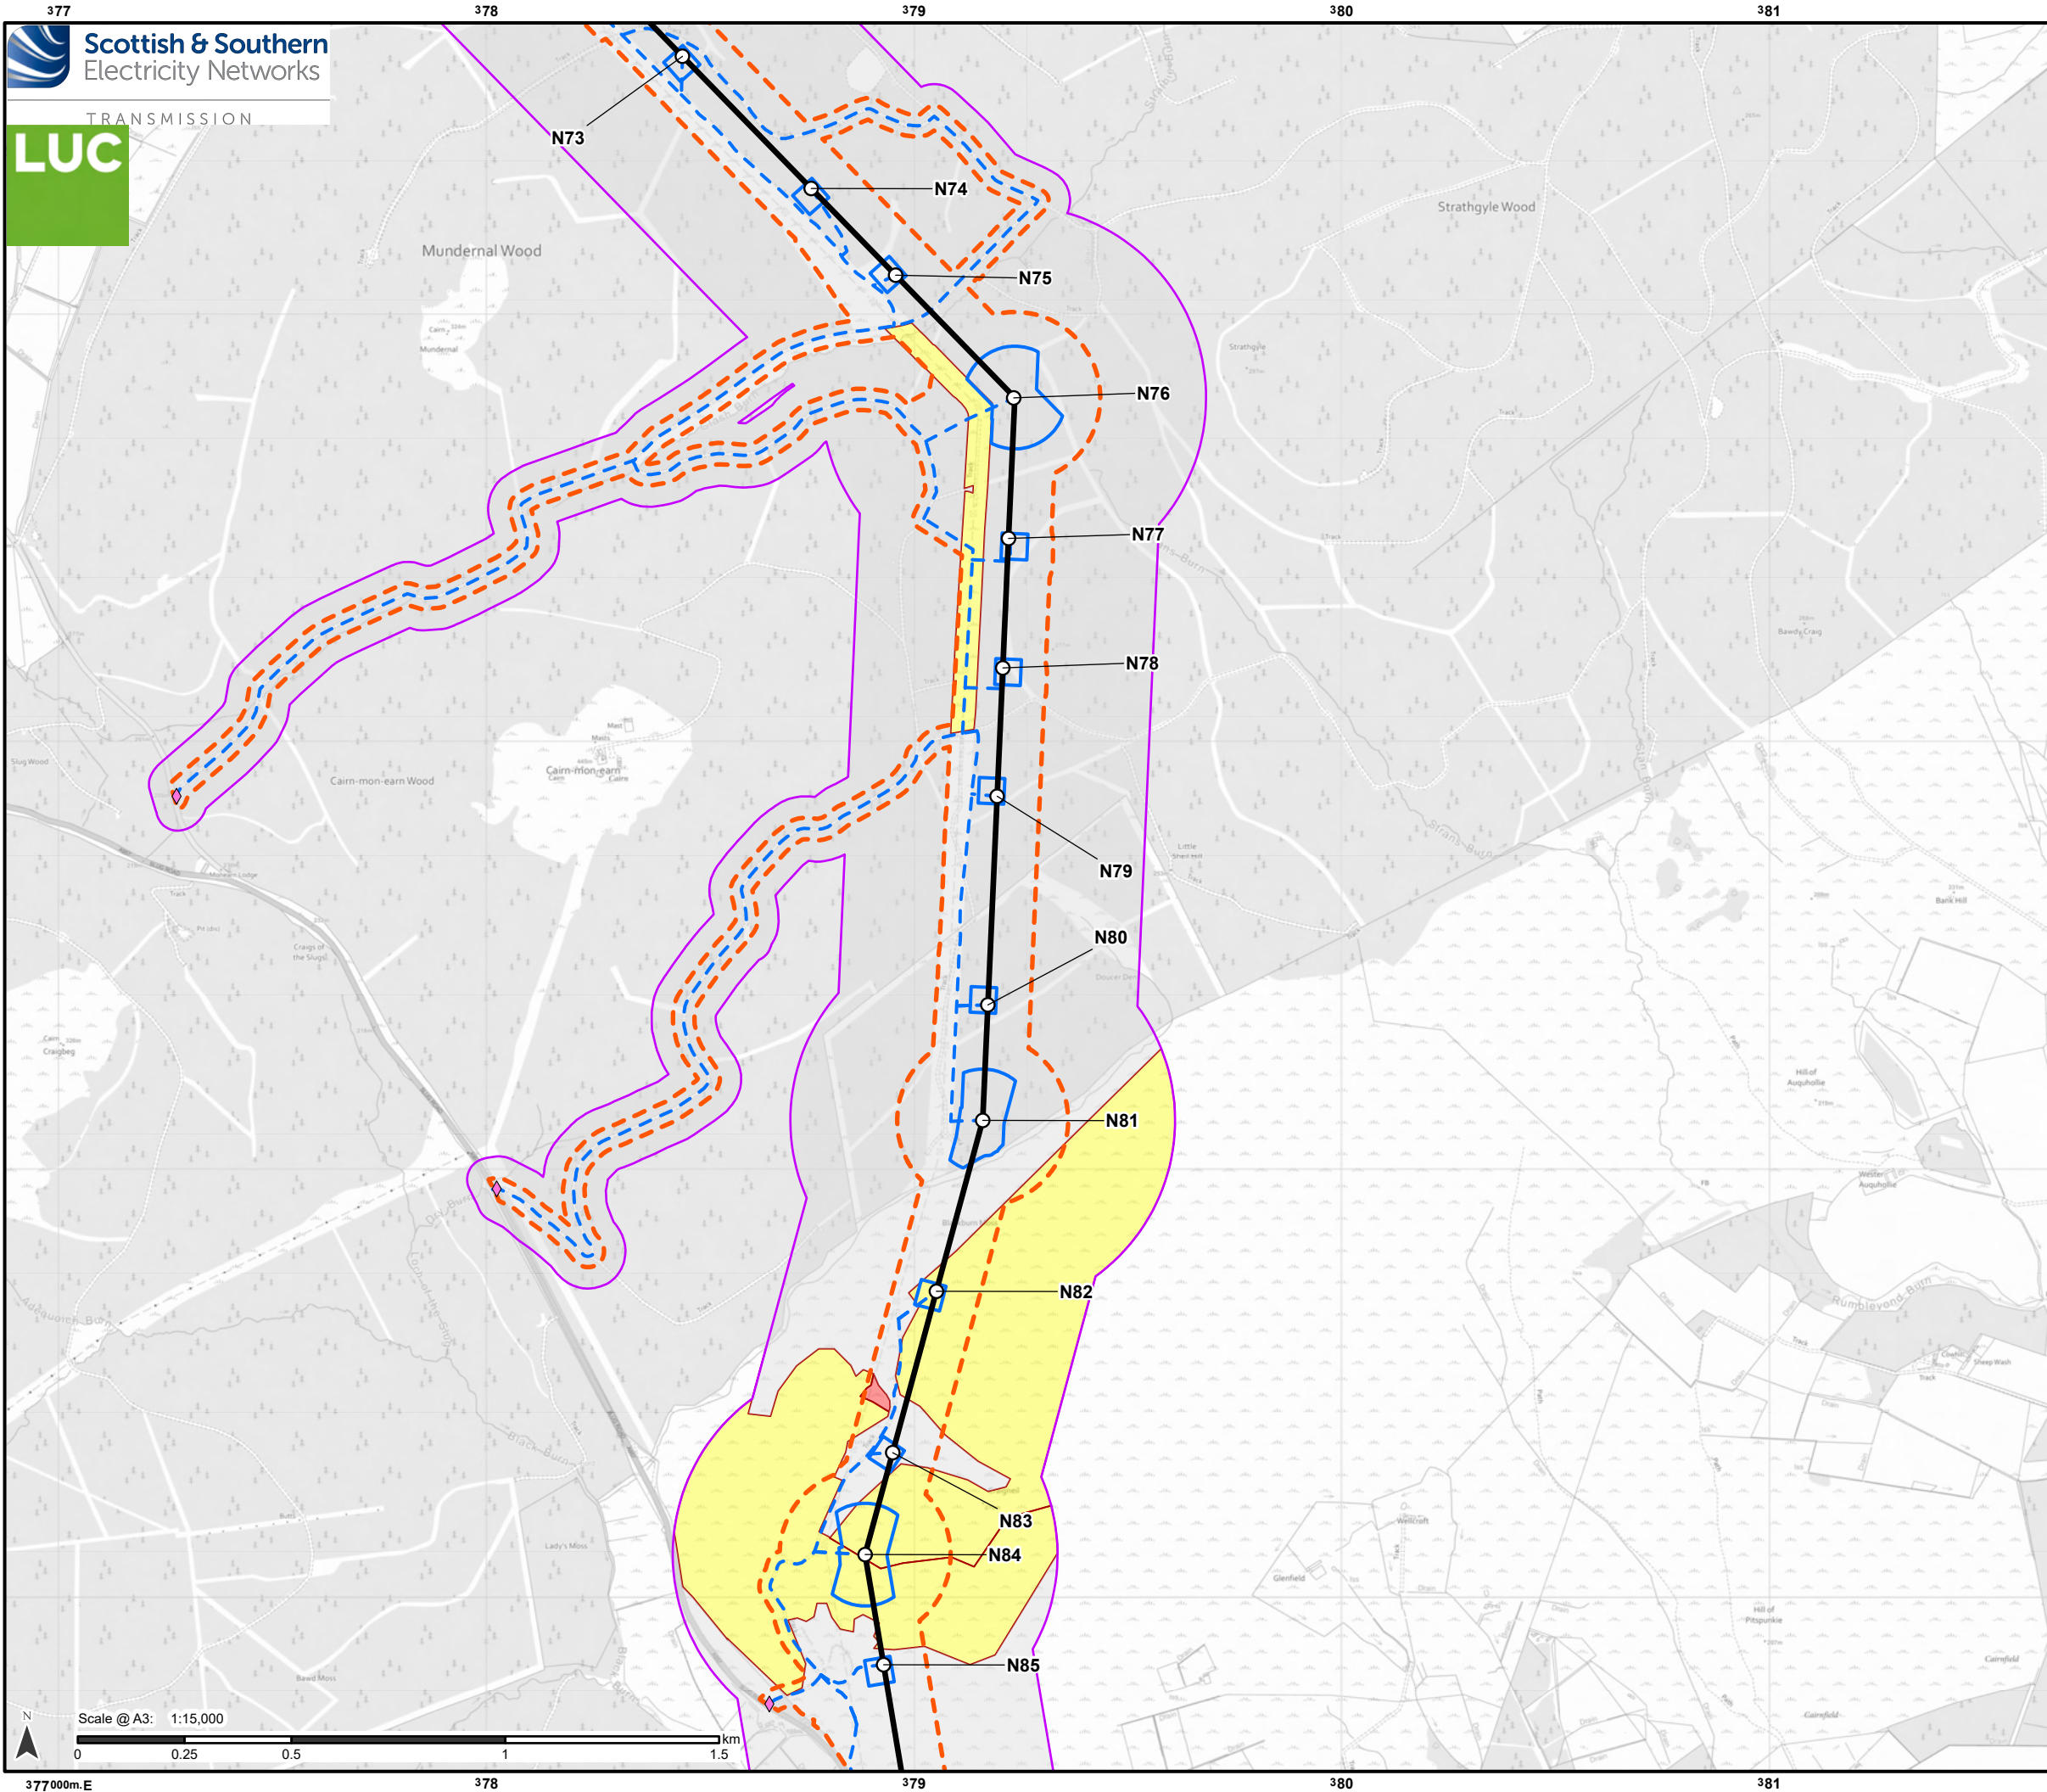

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- High potential
- Moderate potential
- Non-GWDTE habitat


Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

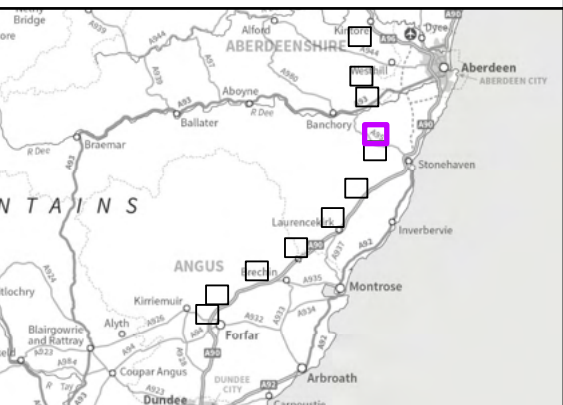


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS Date: 14/08/2025

Drawing: 11.5.8

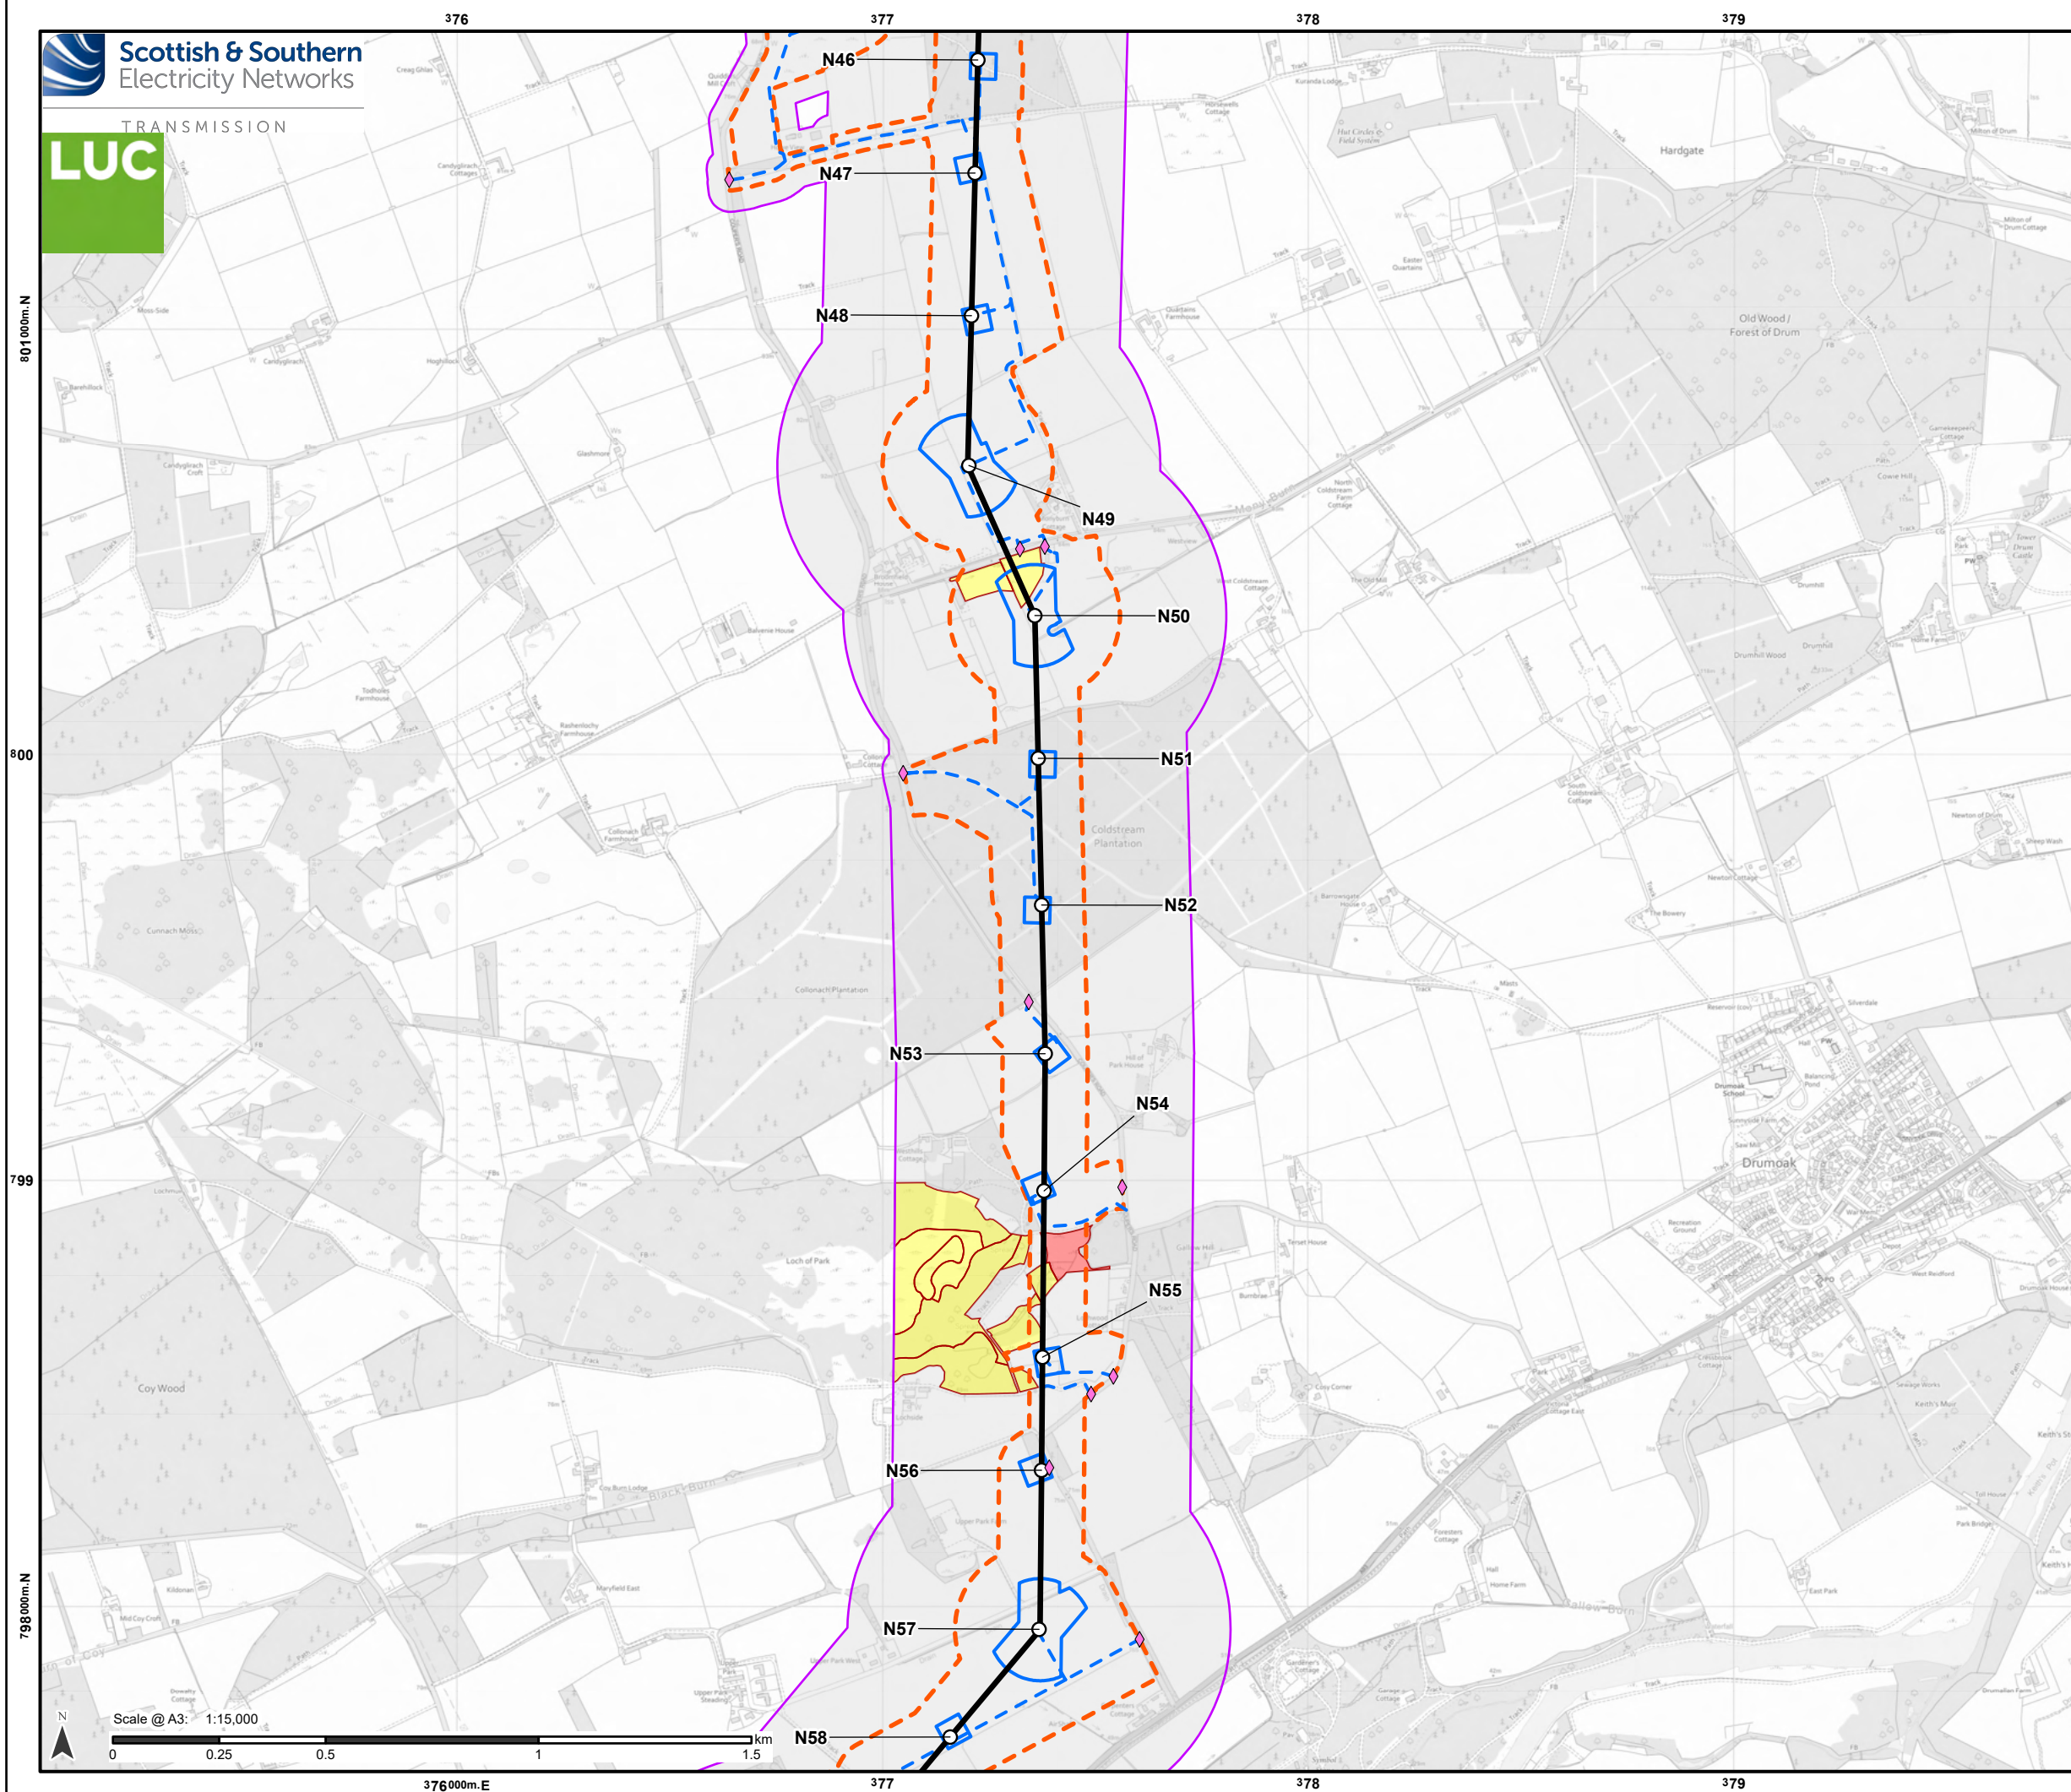

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◆ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- High potential
- Moderate potential
- Non-GWDTE habitat


Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

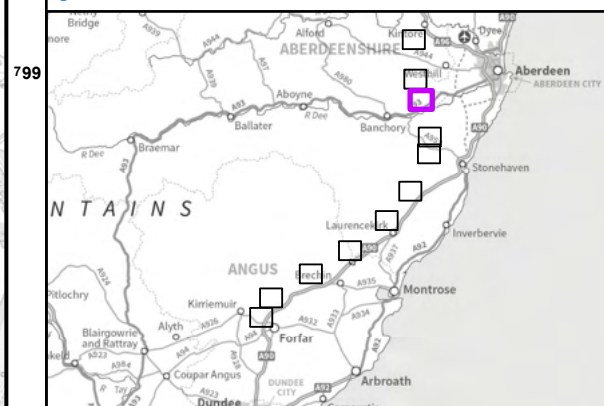

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:


Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS

Date: 14/08/2025

Drawing: 11.5.9

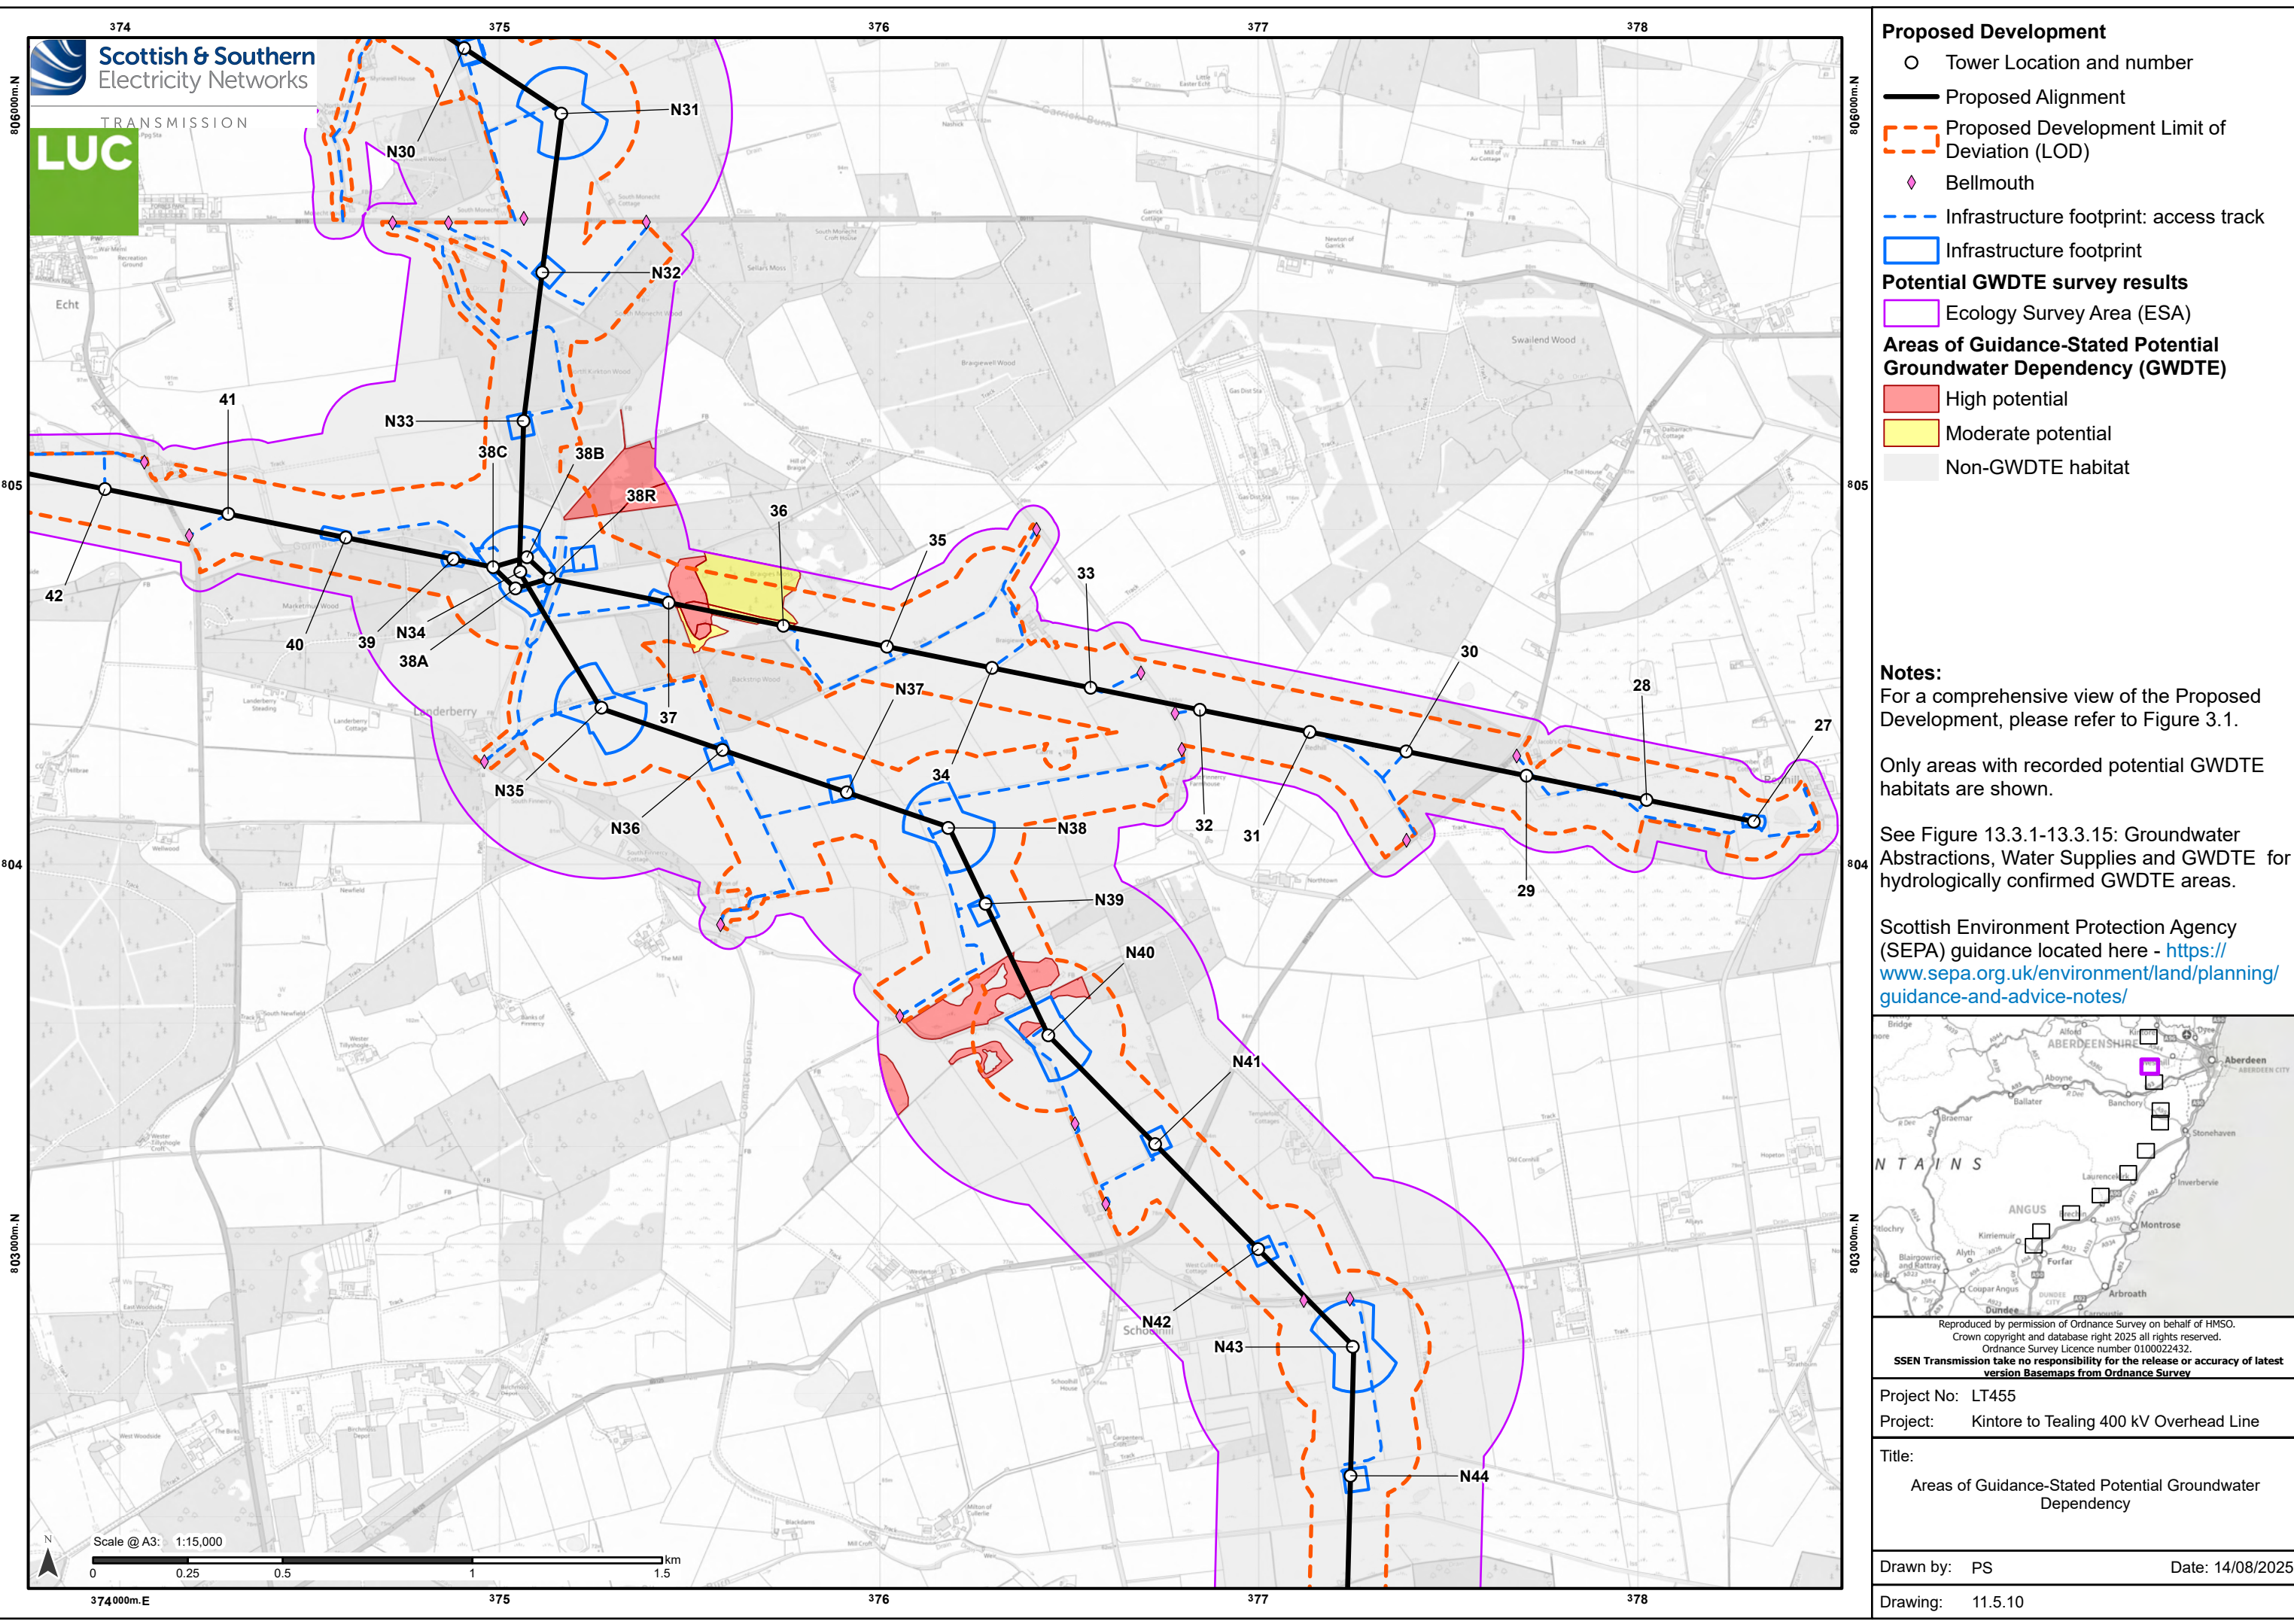

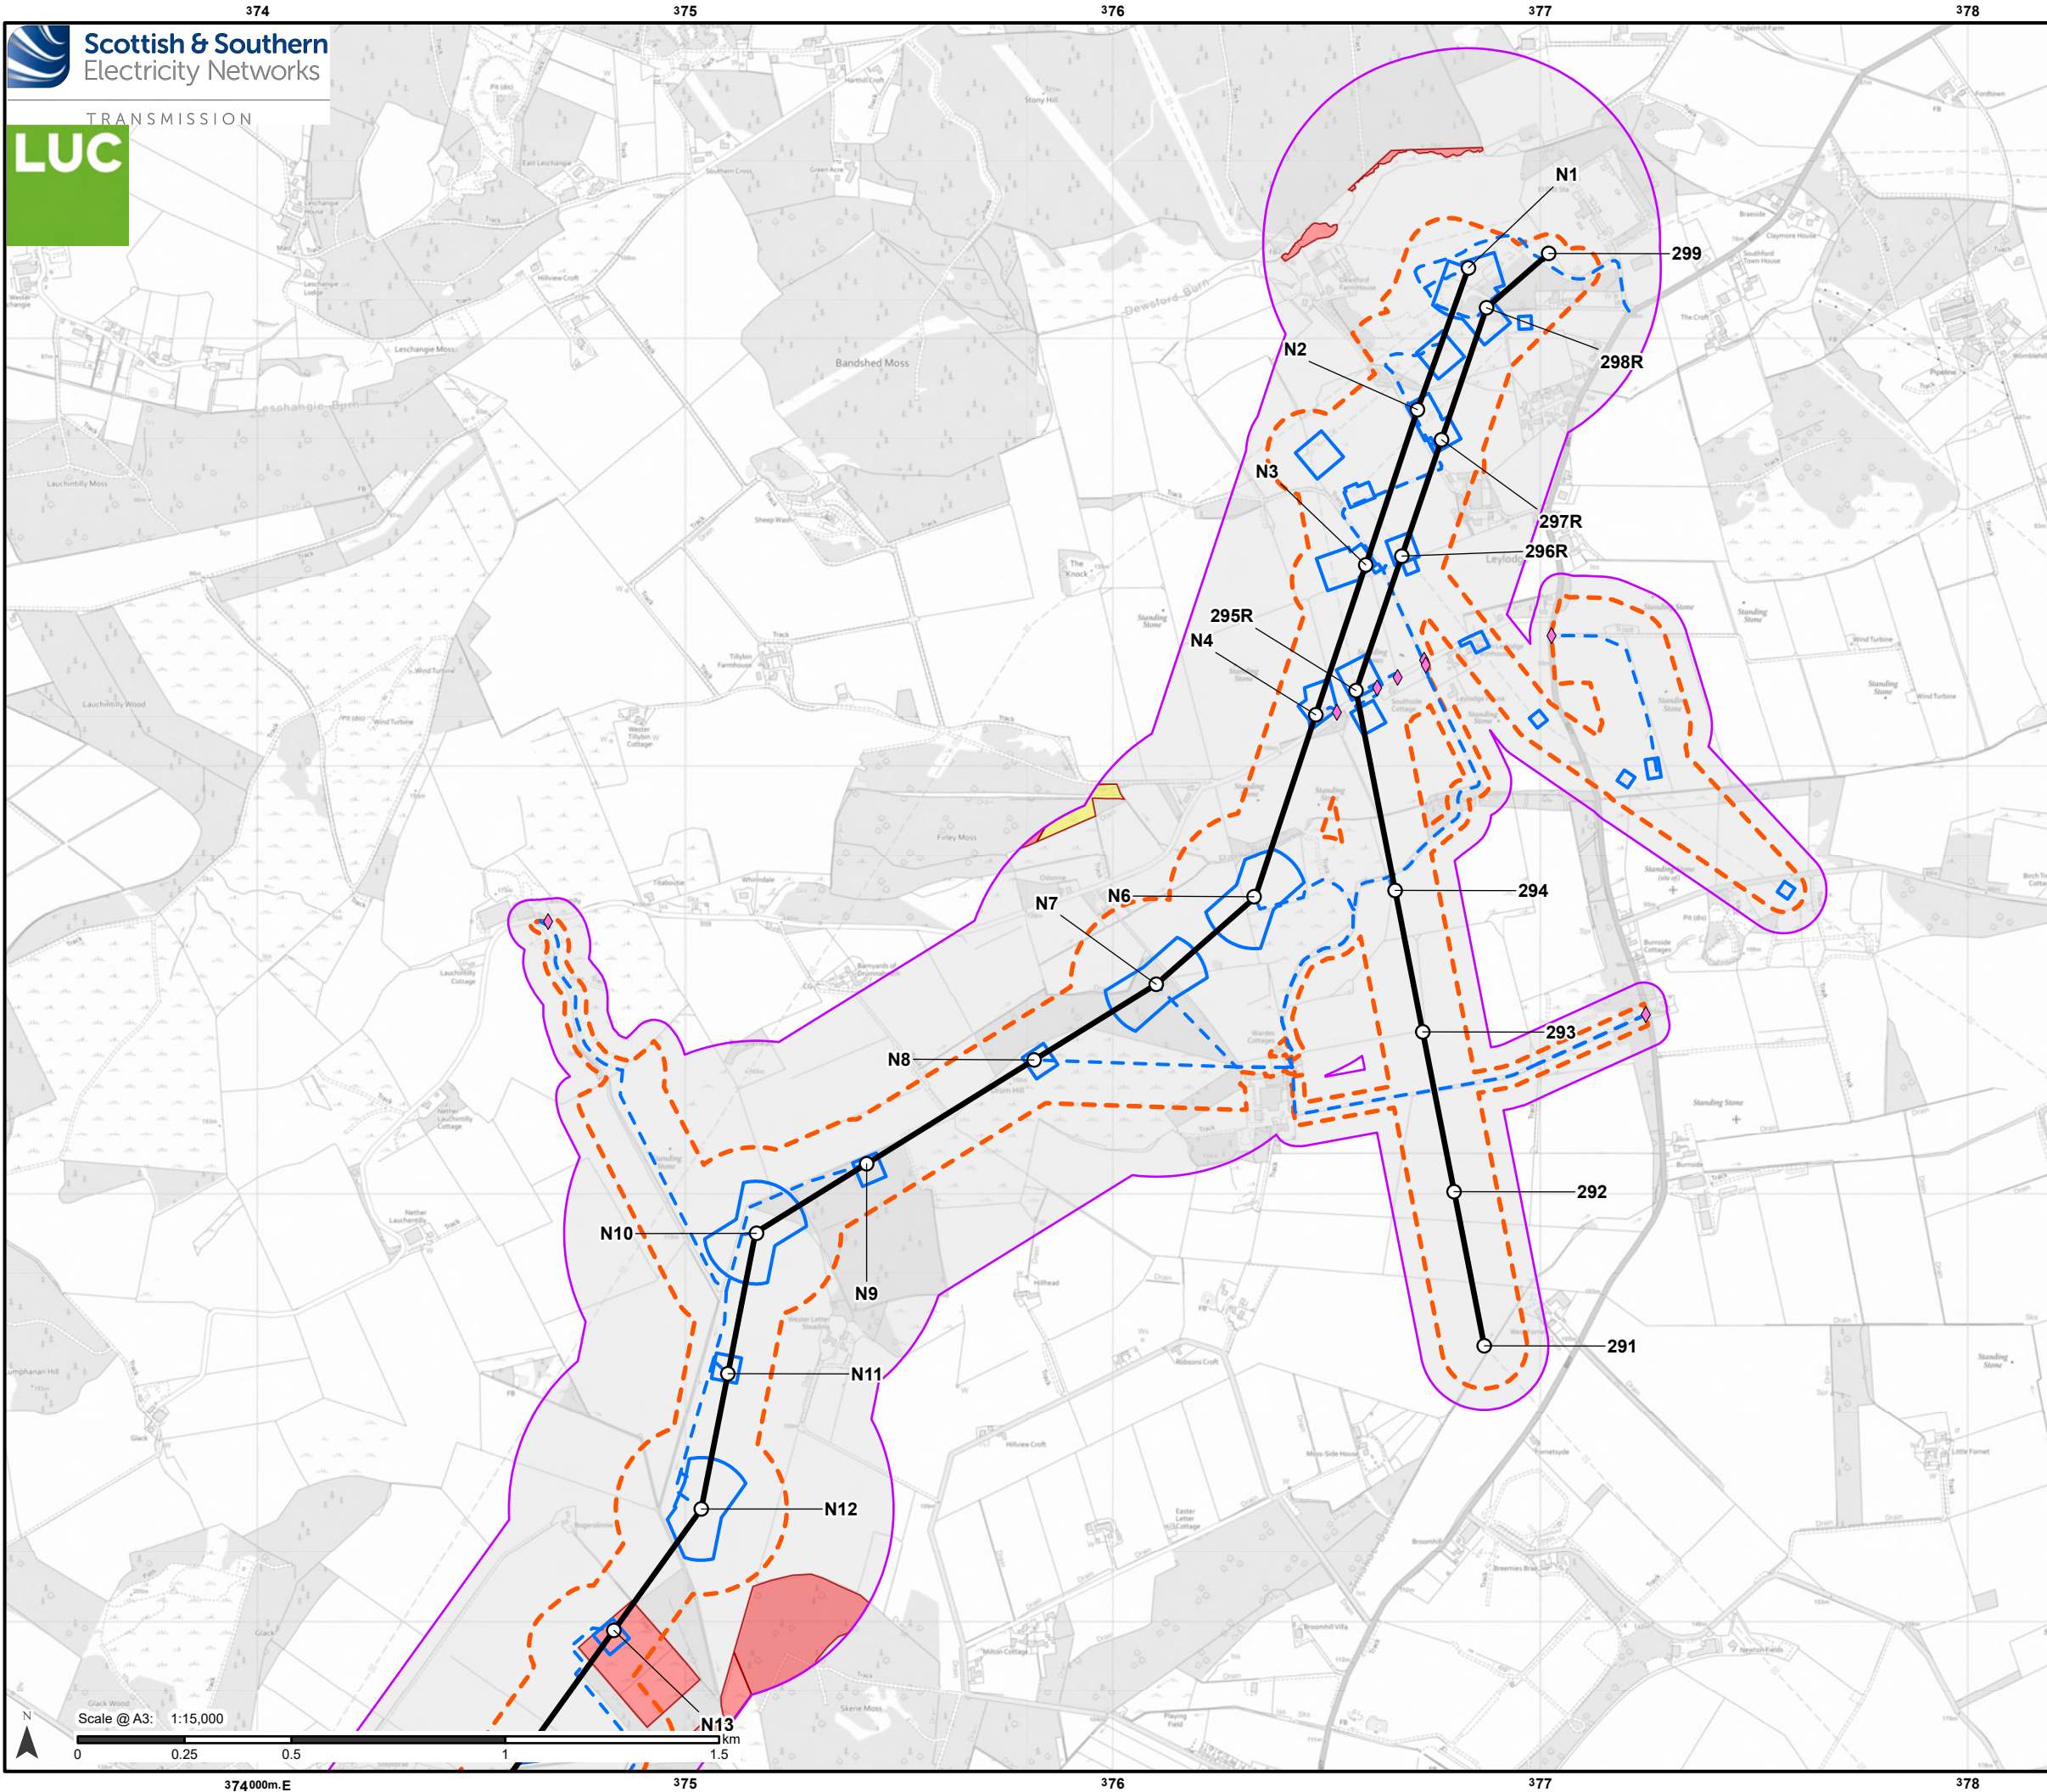

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ◇ Bellmouth
- - - Infrastructure footprint: access track
- Infrastructure footprint

Potential GWDTE survey results

- Ecology Survey Area (ESA)

Areas of Guidance-Stated Potential Groundwater Dependency (GWDTE)

- High potential
- Moderate potential
- Non-GWDTE habitat

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Only areas with recorded potential GWDTE habitats are shown.

See Figure 13.3.1-13.3.15: Groundwater Abstractions, Water Supplies and GWDTE for hydrologically confirmed GWDTE areas.

Scottish Environment Protection Agency (SEPA) guidance located here - <https://www.sepa.org.uk/environment/land/planning/guidance-and-advice-notes/>

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Areas of Guidance-Stated Potential Groundwater Dependency

Drawn by: PS Date: 14/08/2025

Drawing: 11.5.11