


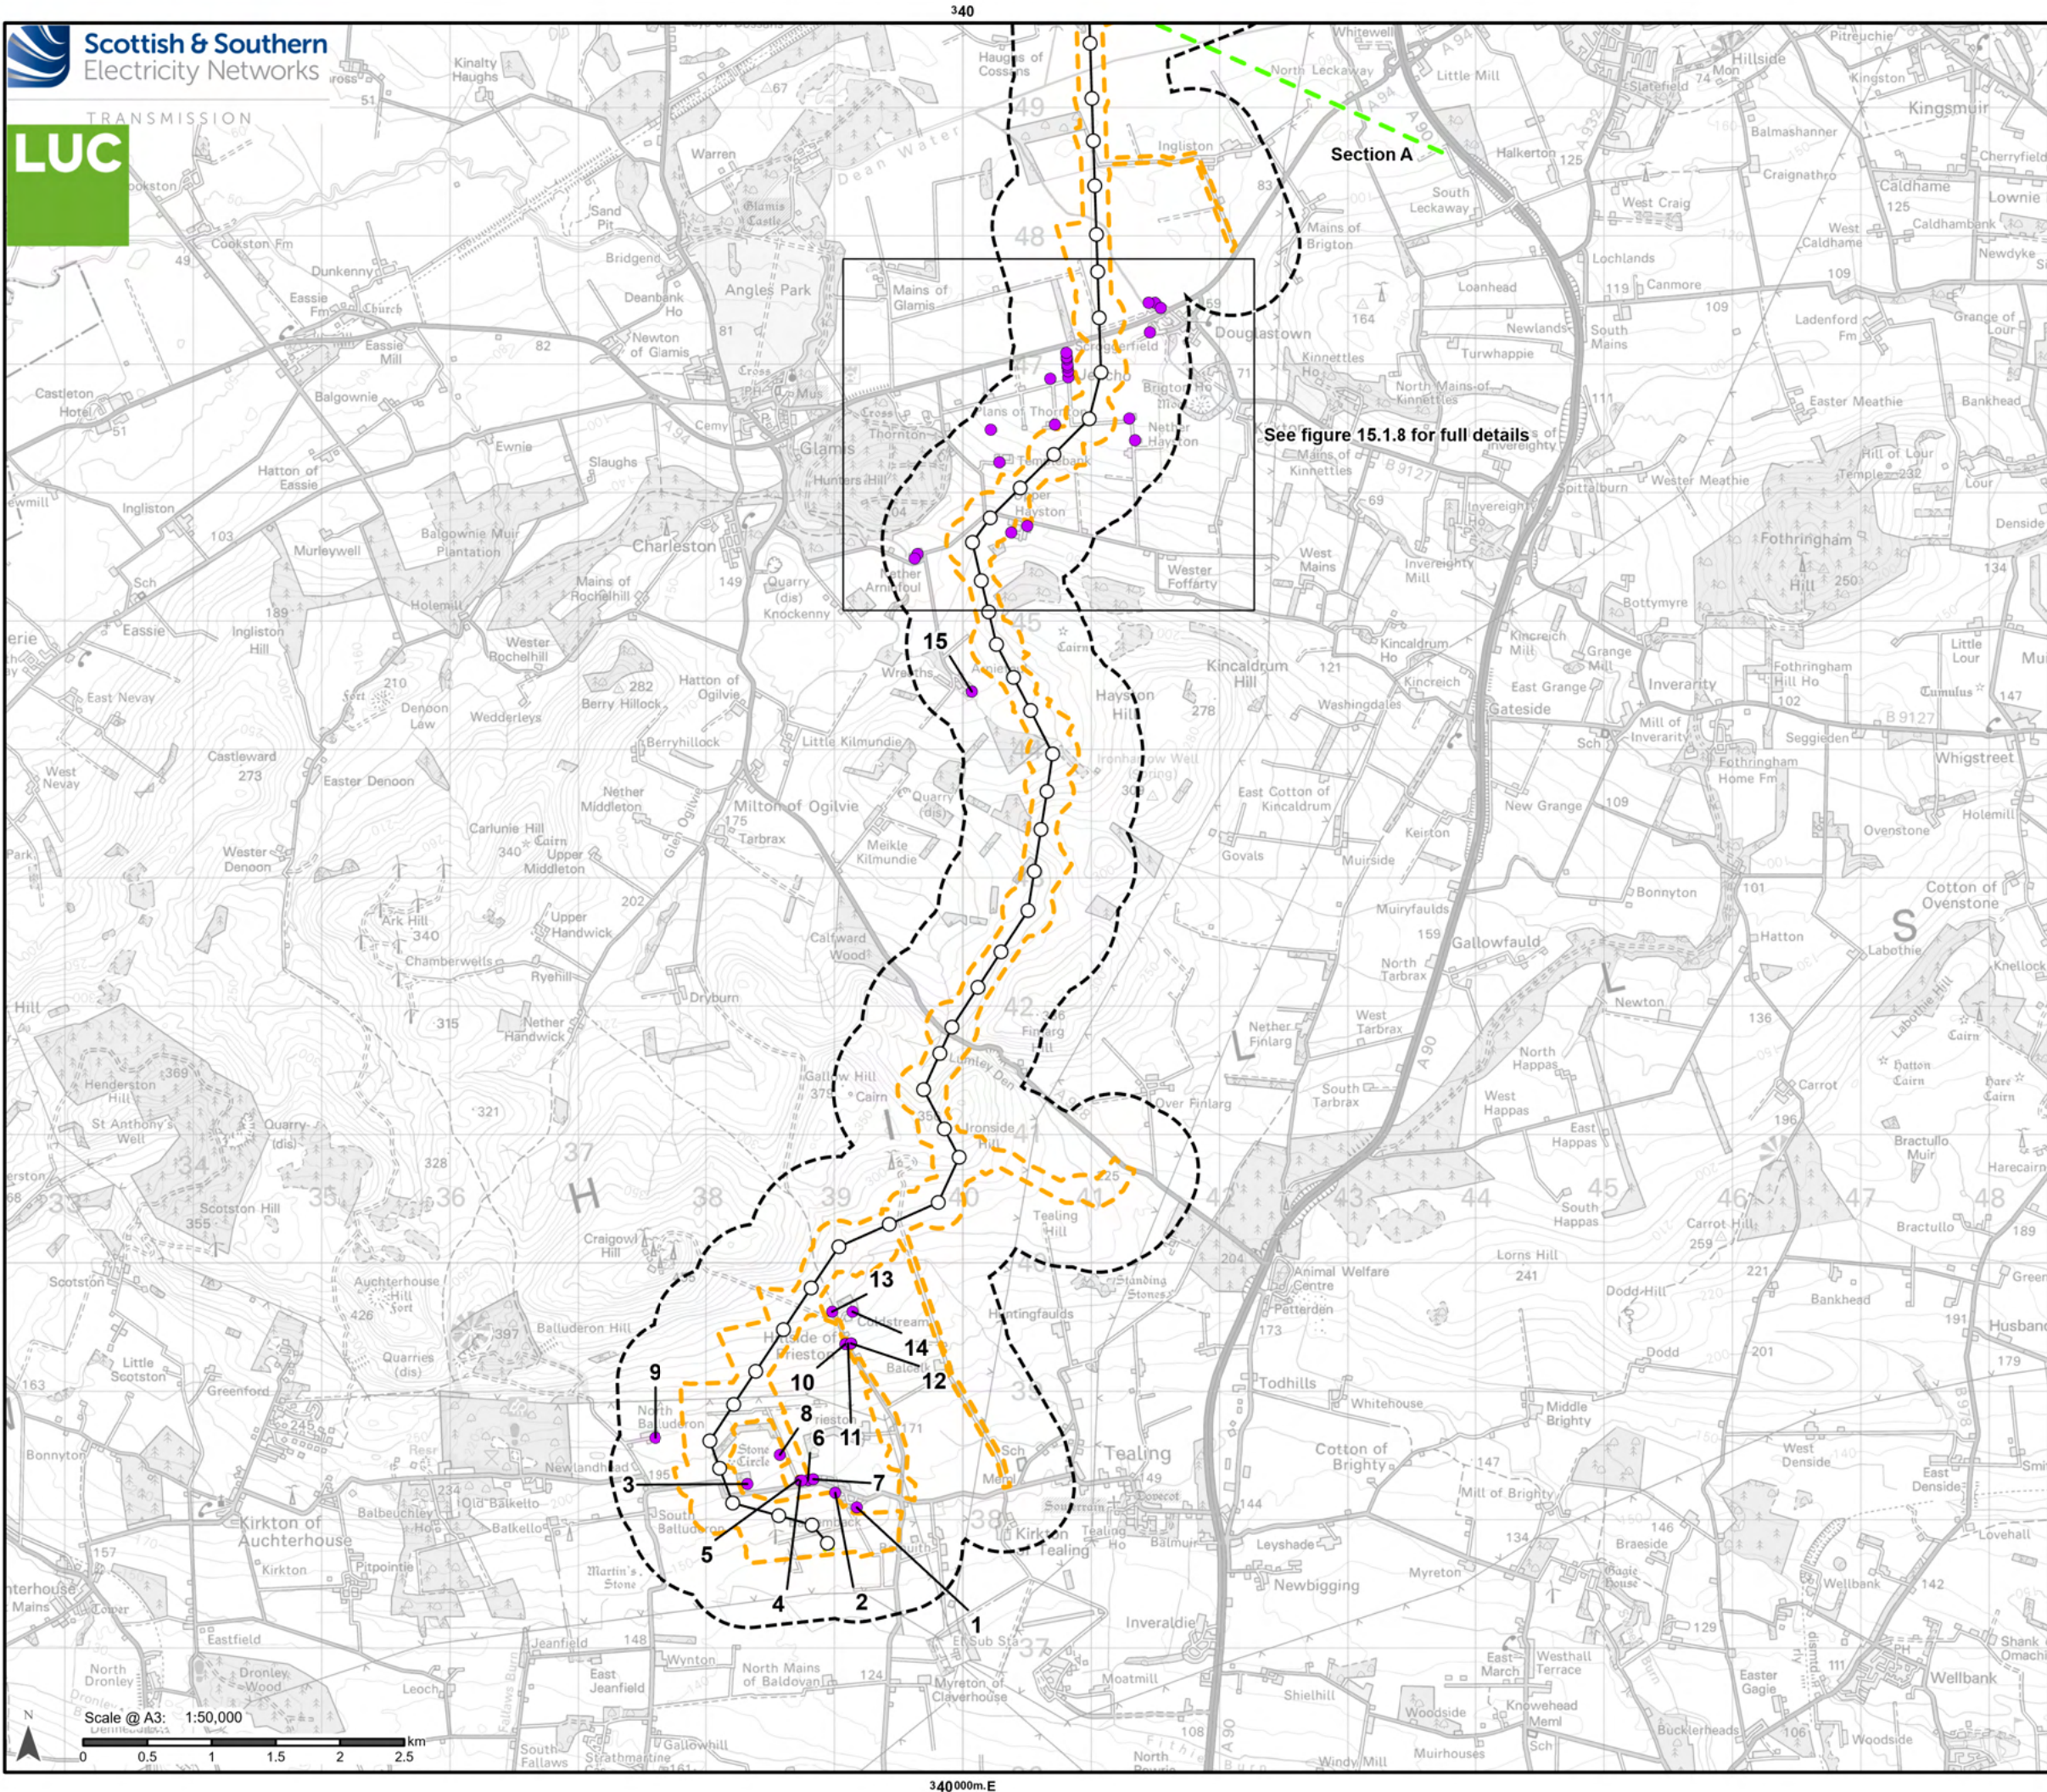

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)
- Section boundary

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS Date: 27/08/2025

Drawing: 15.1.1

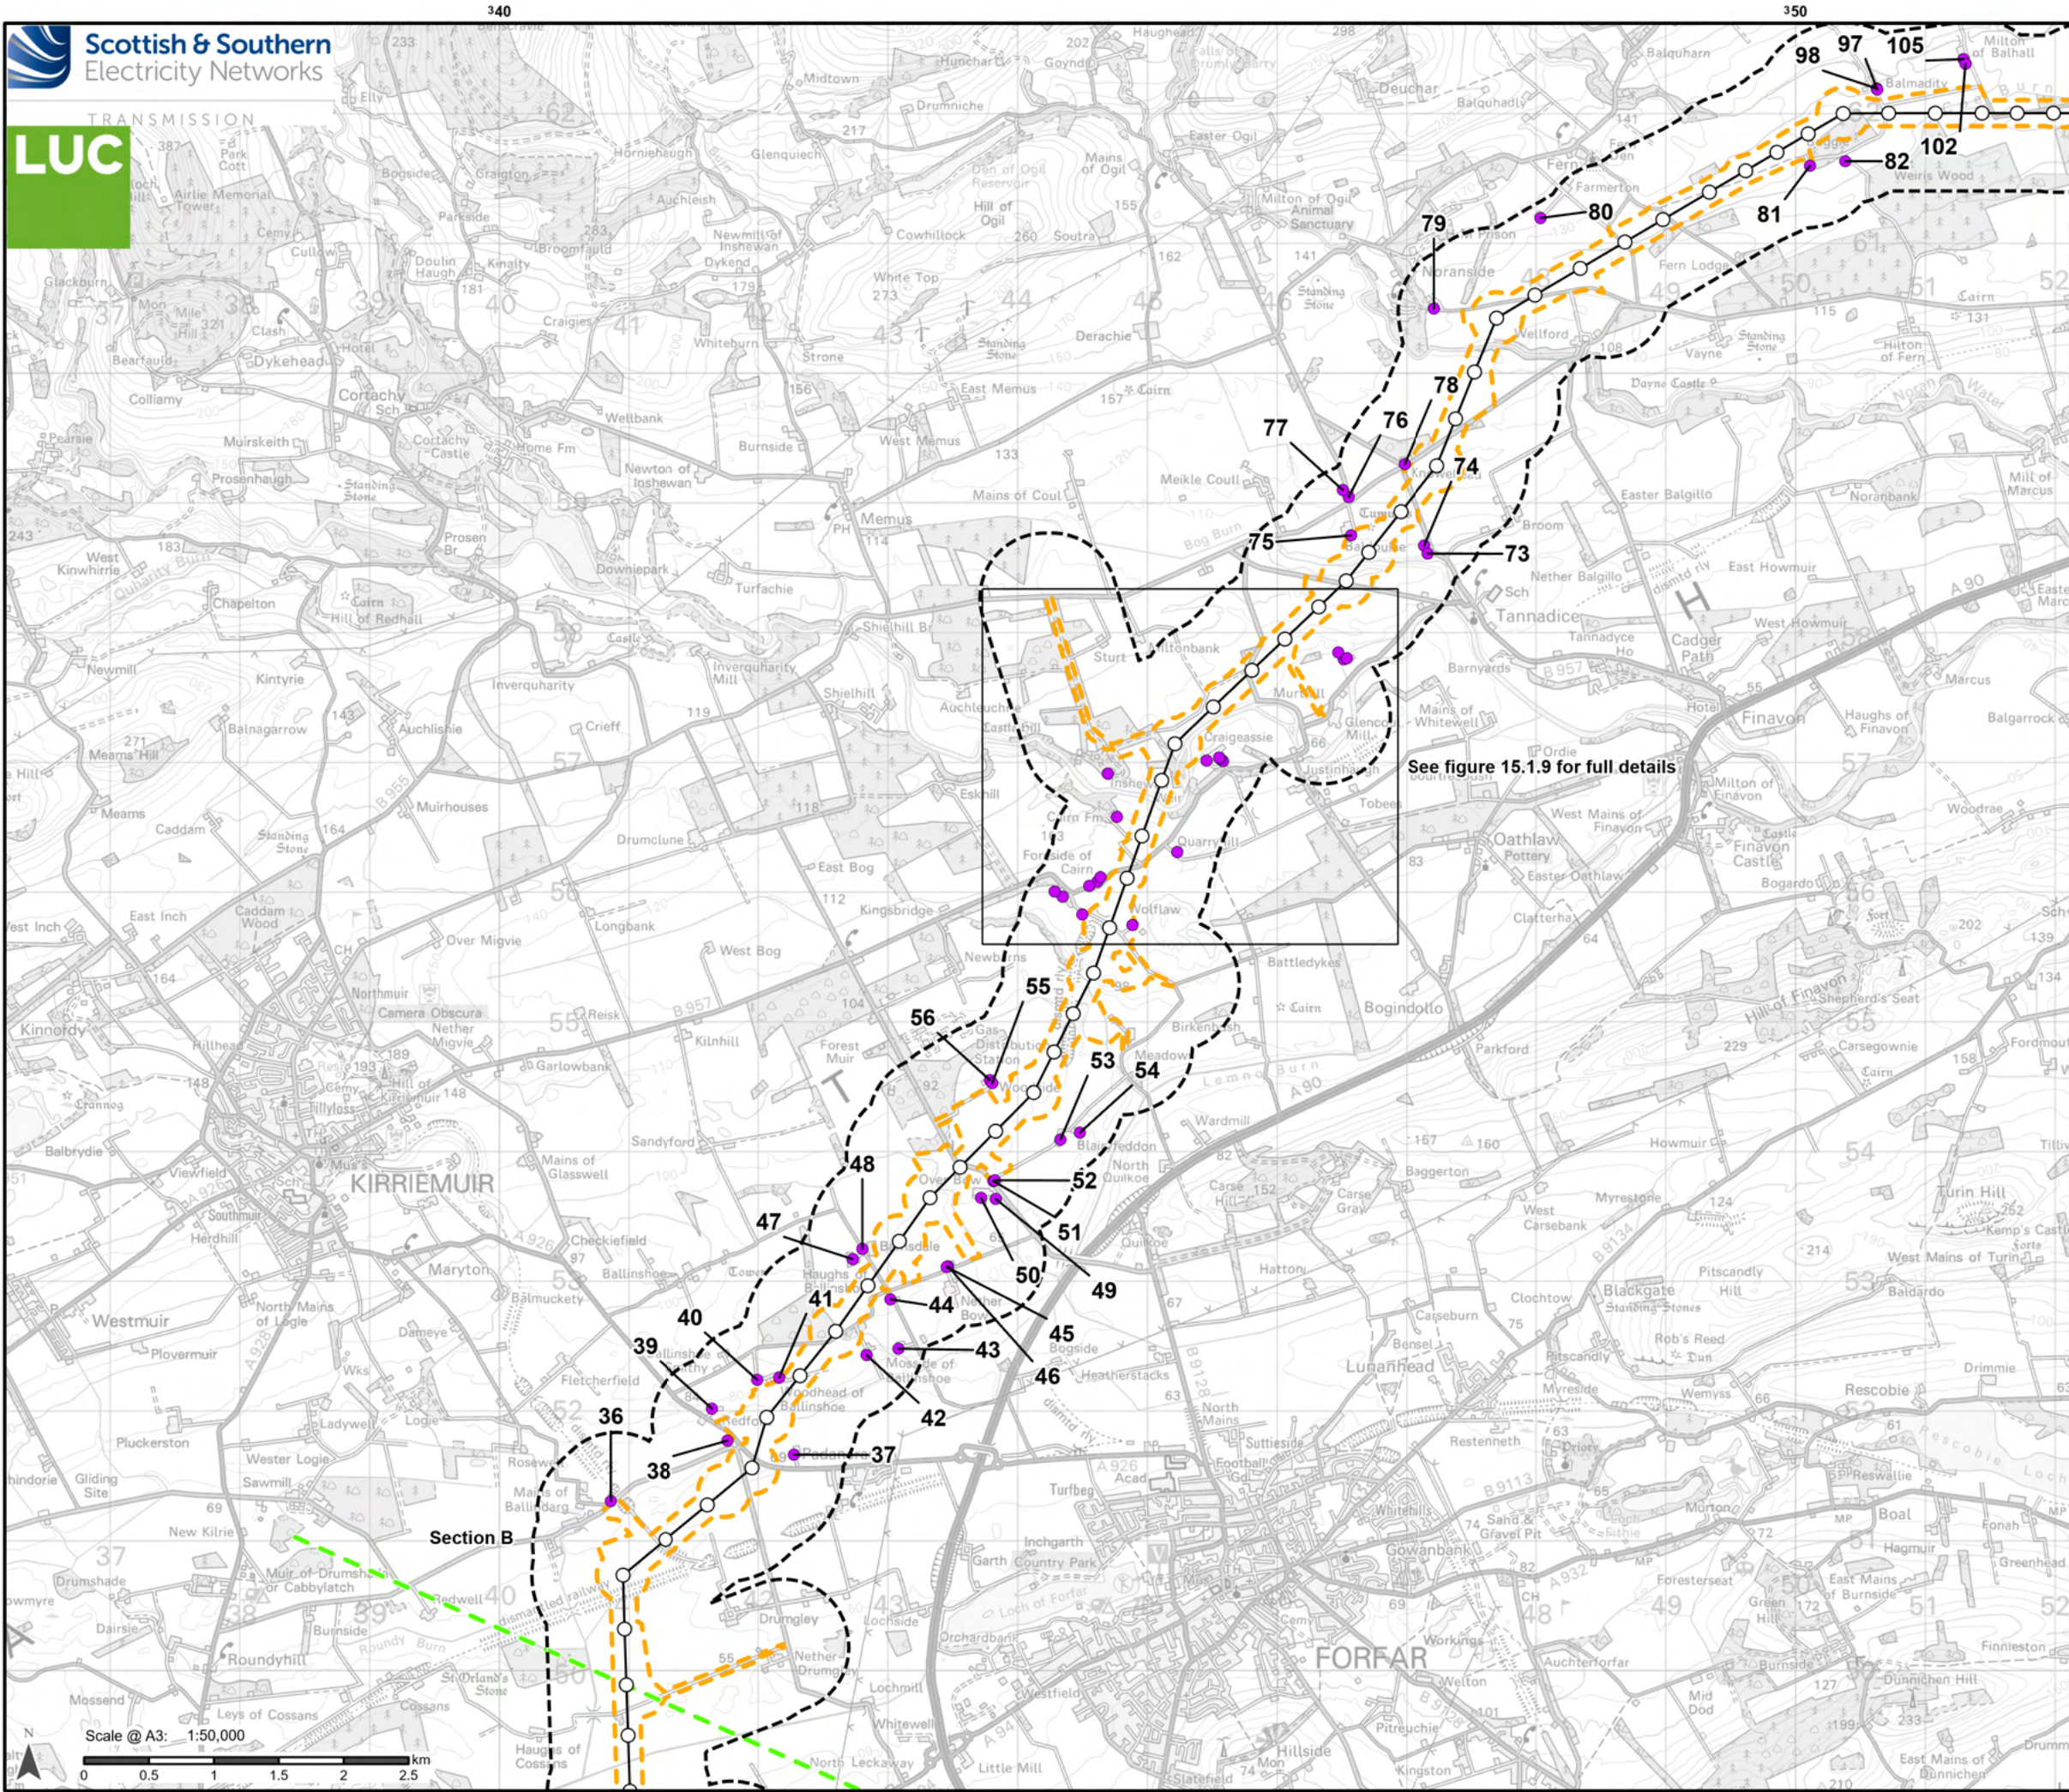

Proposed Development

- Tower Location
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- - - 500 m buffer from LOD (study area)
- - - Section boundary

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS

Date: 27/08/2025

Drawing: 15.1.2

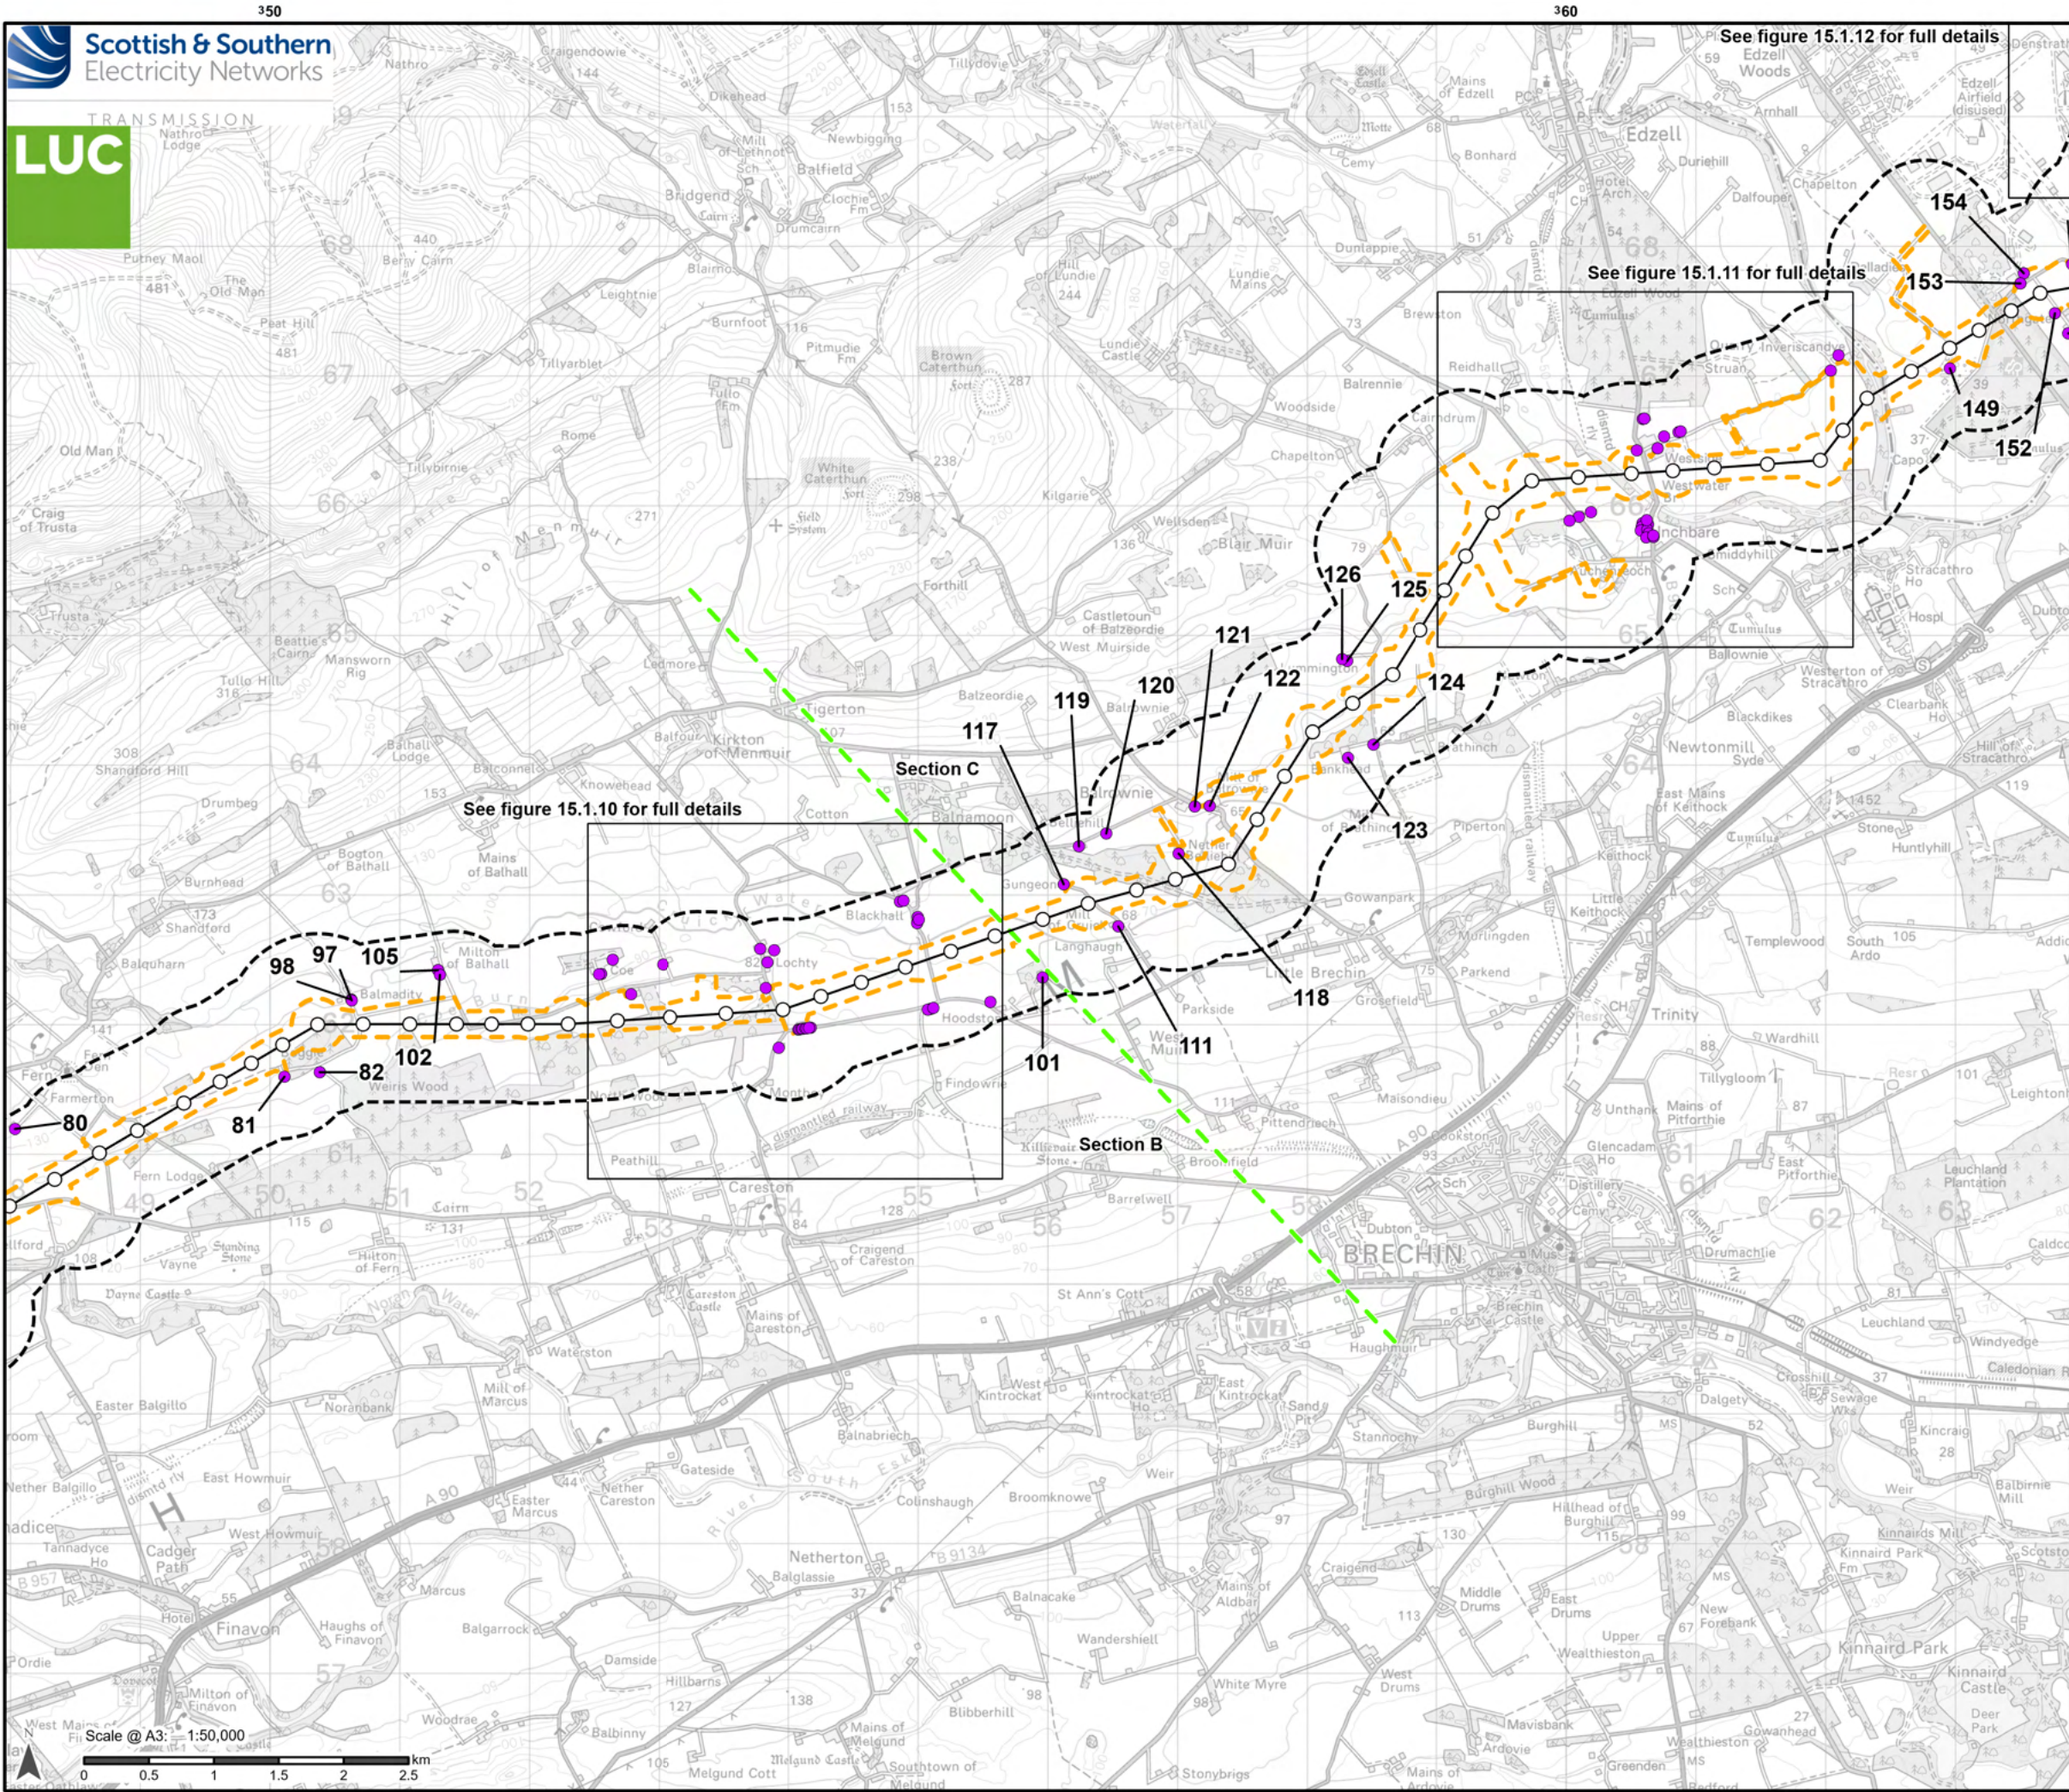

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)
- Section boundary

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS


Date: 27/08/2025

Drawing: 15.1.3

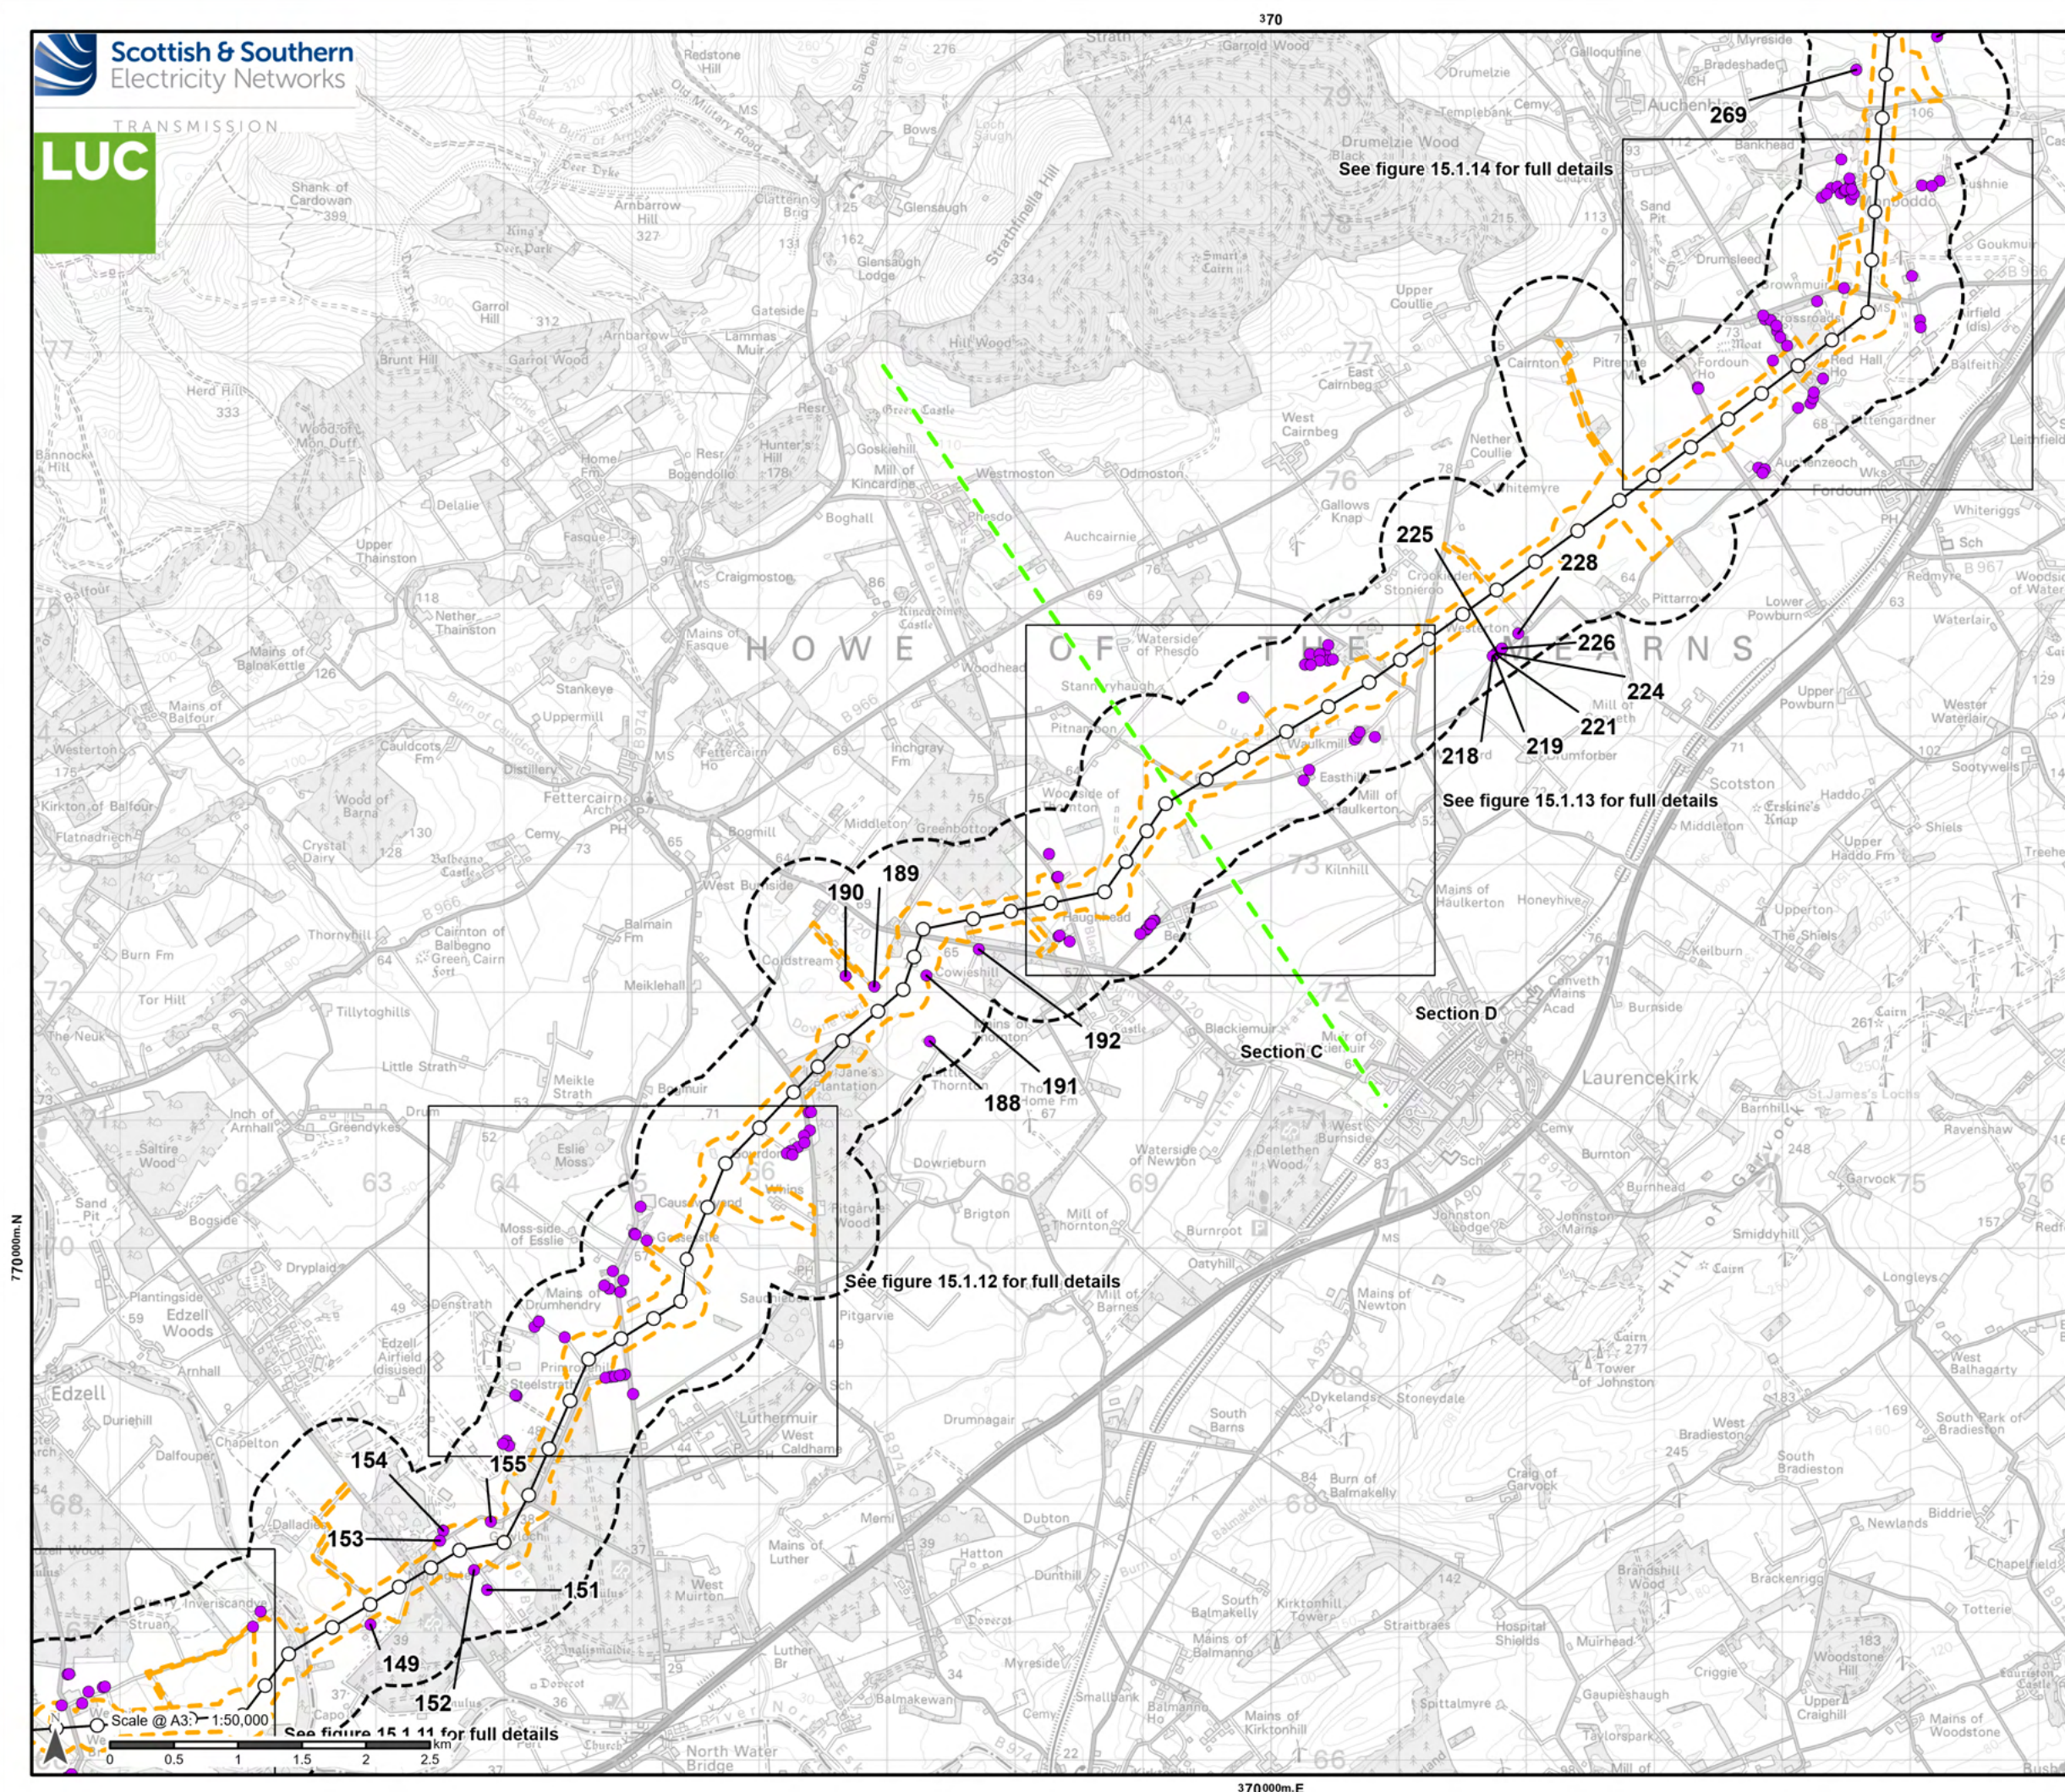

- Proposed Development**
- Tower Location
 - Proposed Alignment
 - - - Proposed Development Limit of Deviation (LOD)
 - - - 500 m buffer from LOD (study area)
 - - - Section boundary
- Noise**
- Noise Sensitive Receptor

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.
Data provided by Wood PLC.

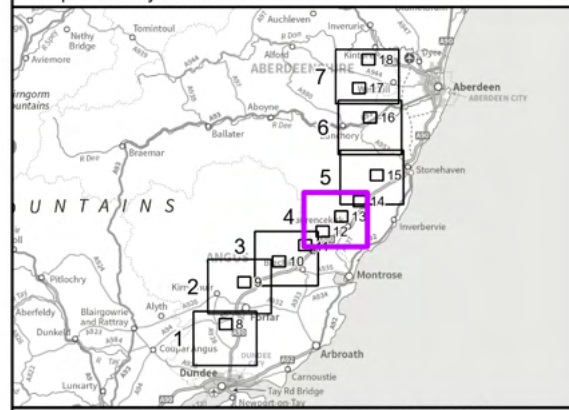


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Noise Sensitive Receptors (NSRs)

Drawn by: MS
Date: 27/08/2025
Drawing: 15.1.4

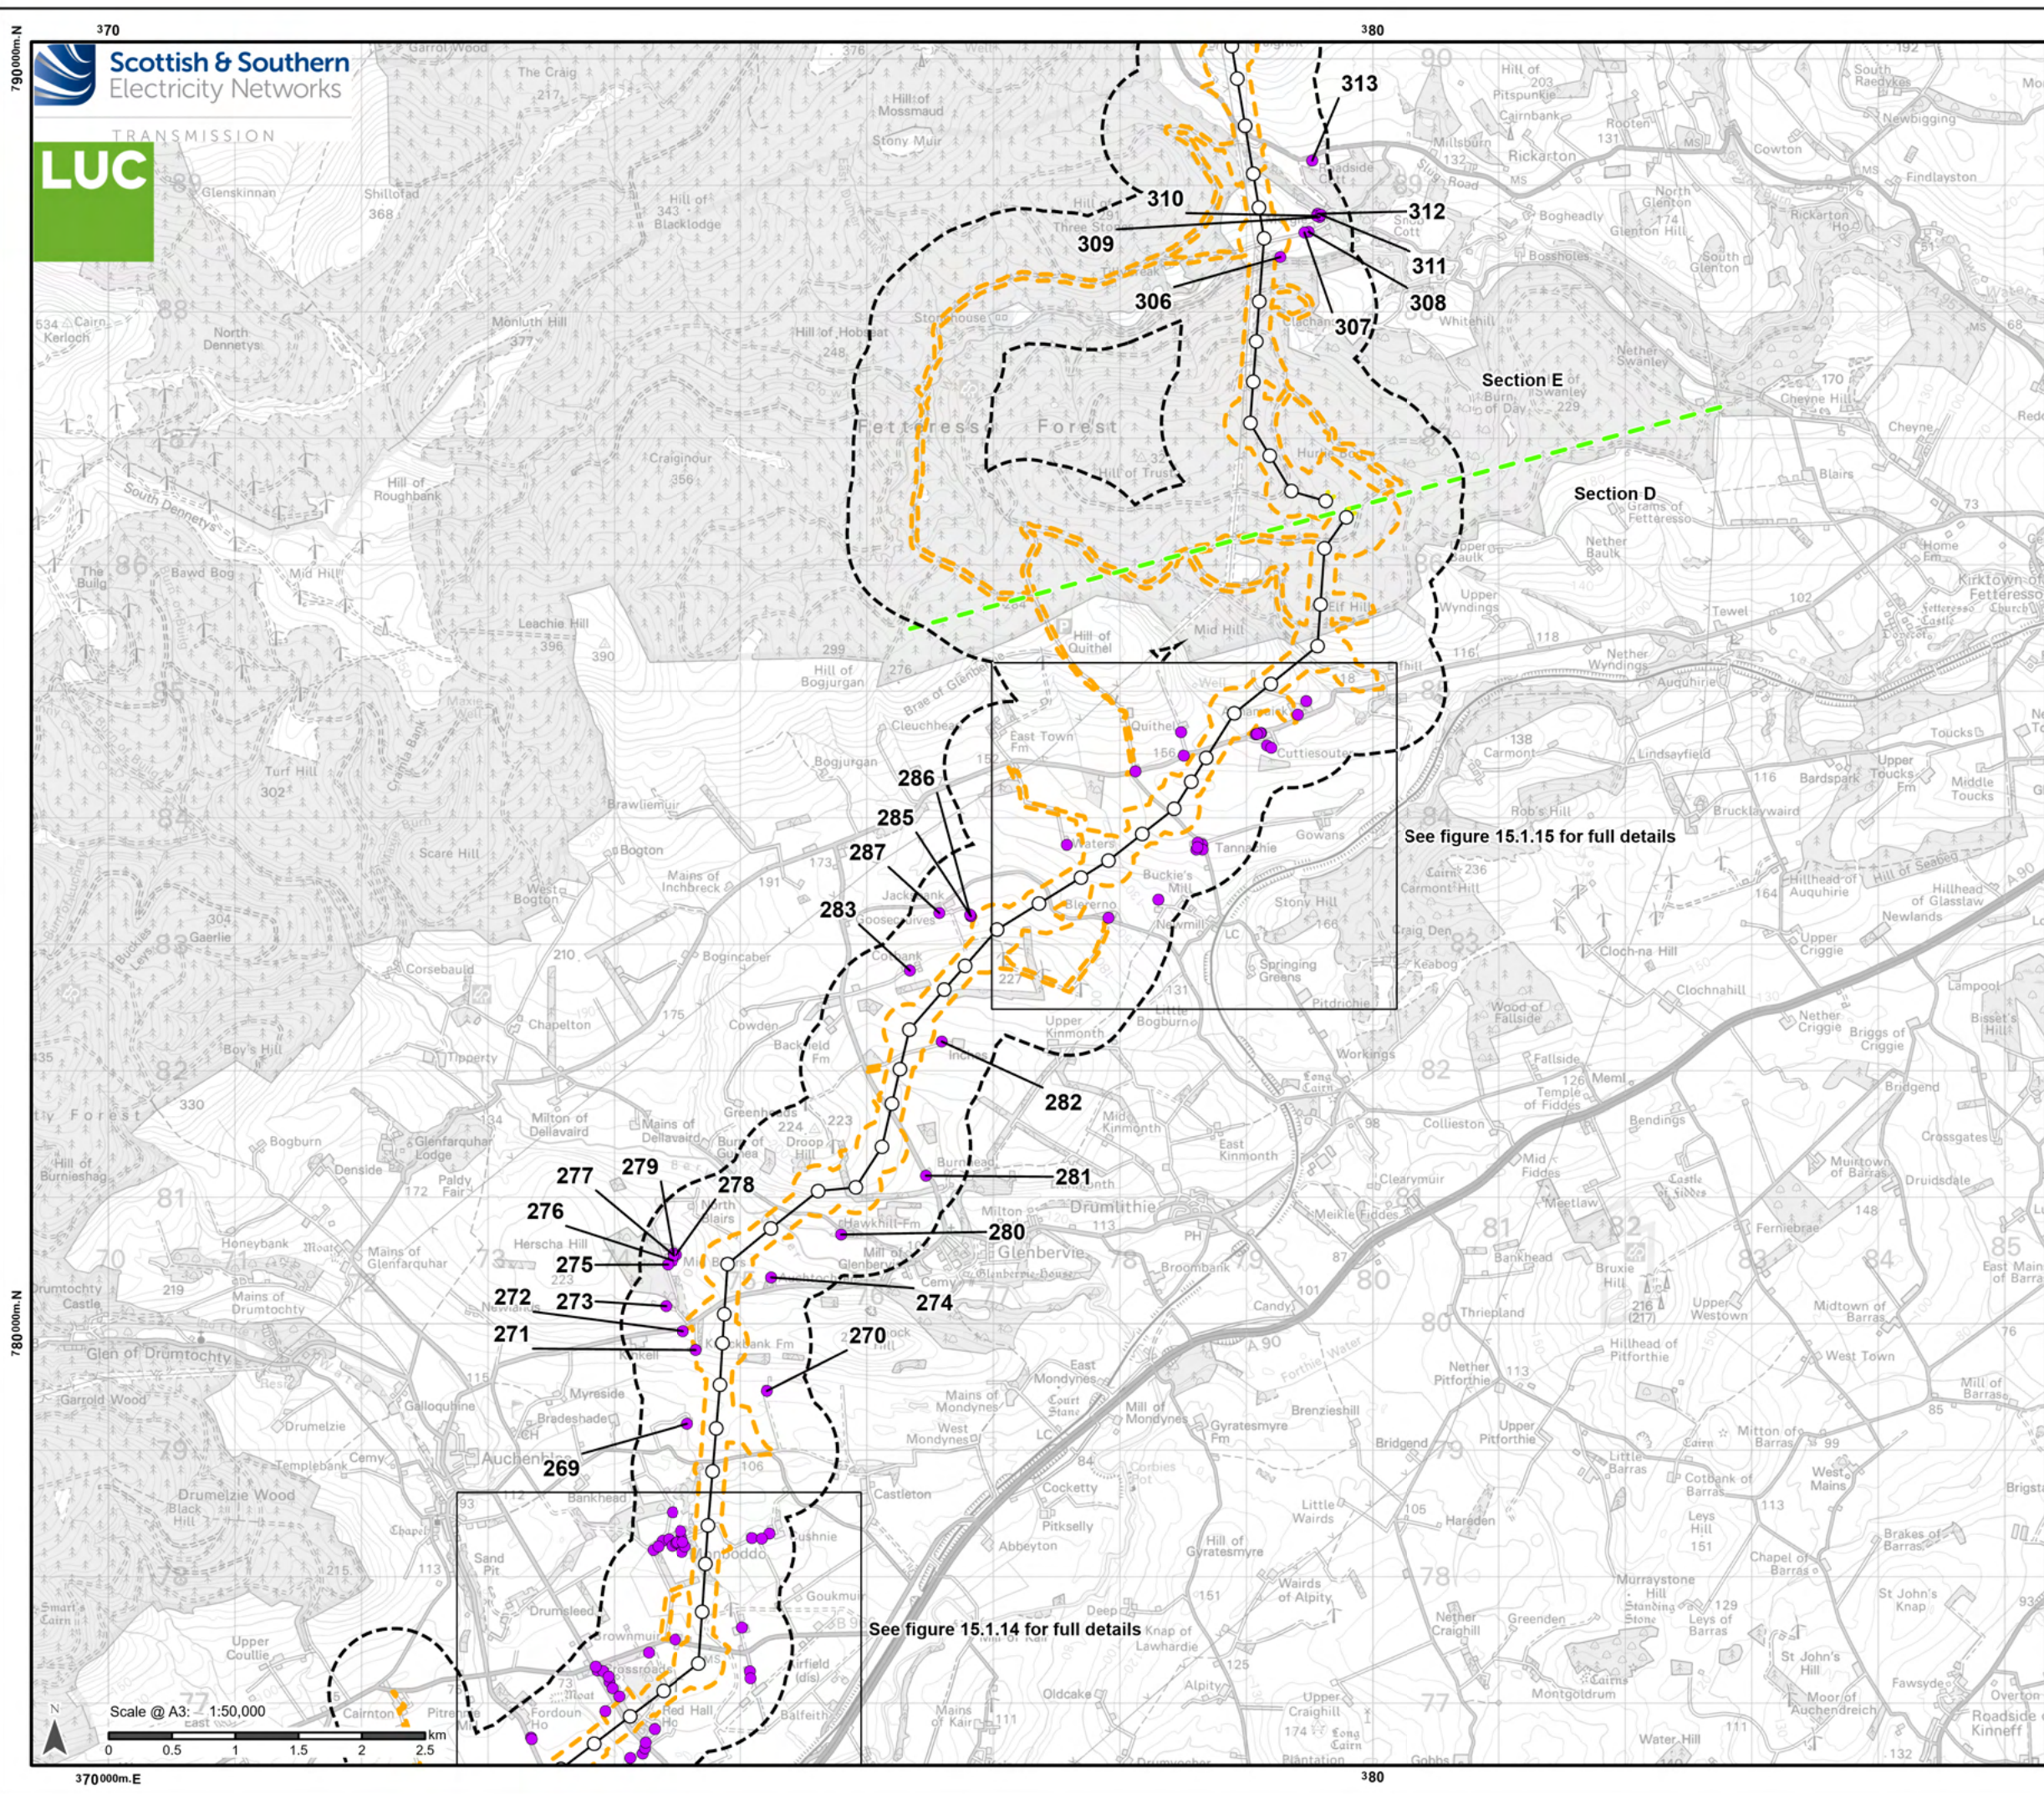

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)
- Section boundary

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS

Date: 27/08/2025

Drawing: 15.1.5

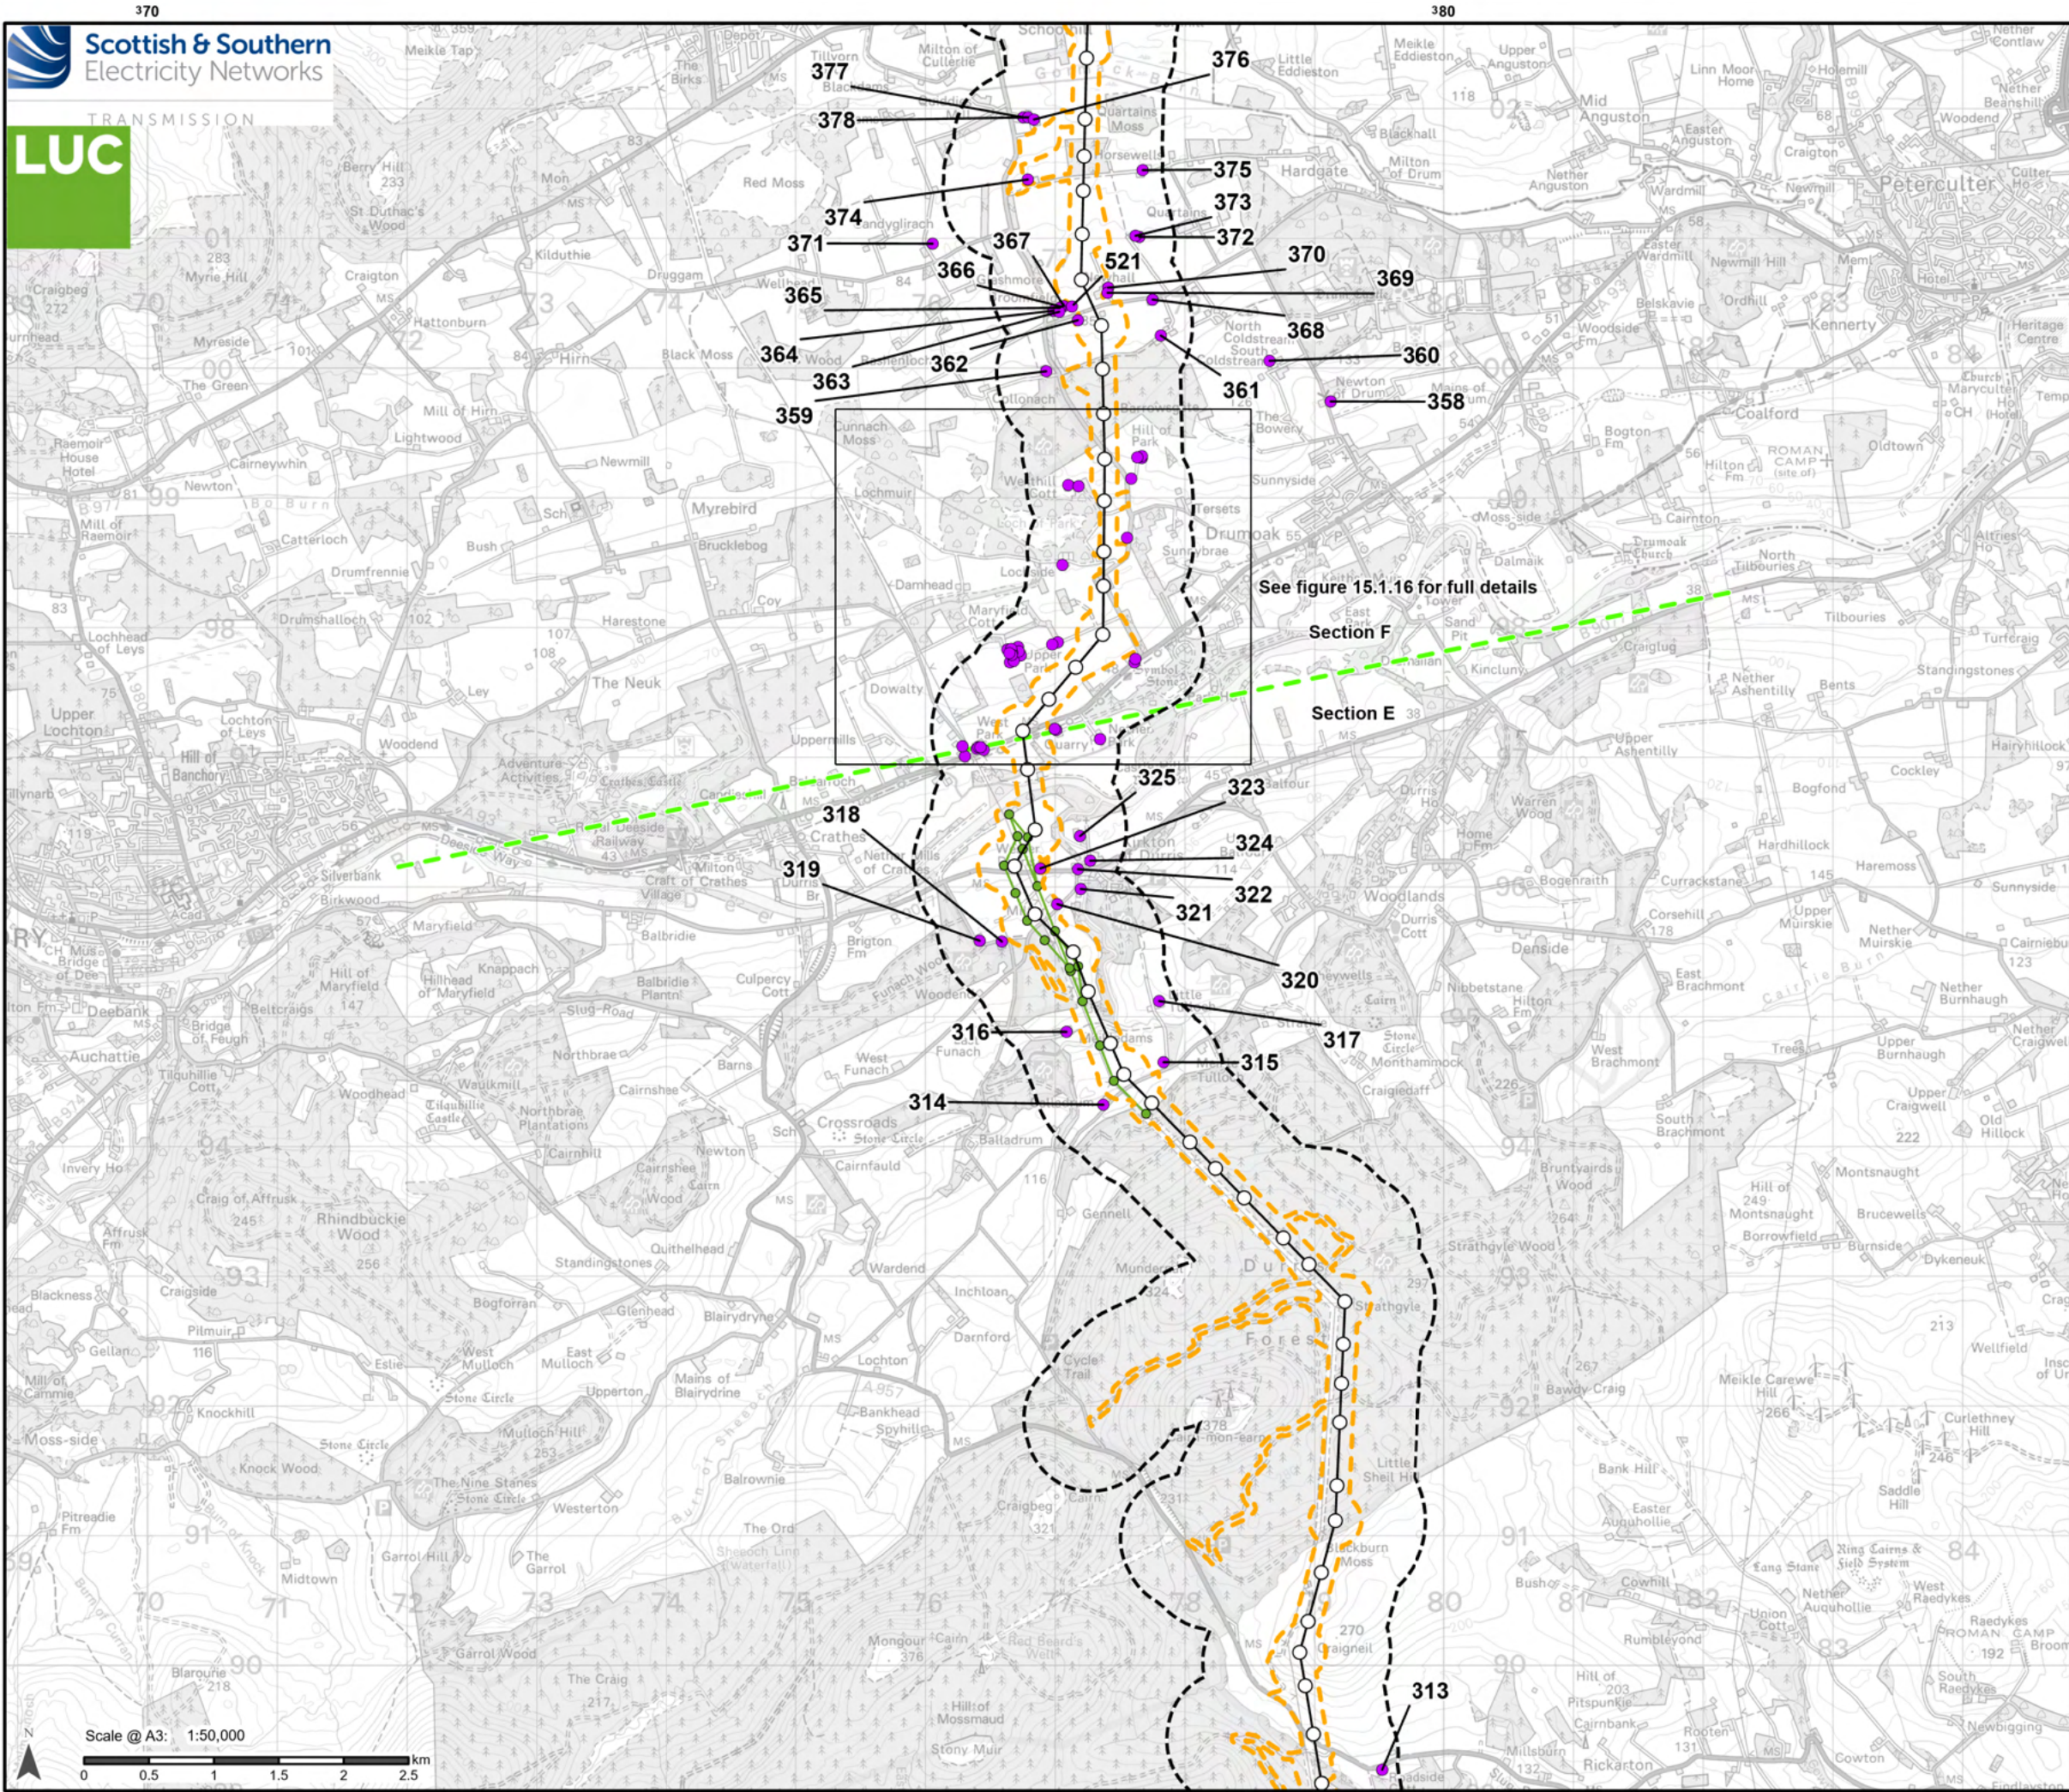

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)
- Section boundary

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS Date: 27/08/2025

Drawing: 15.1.6

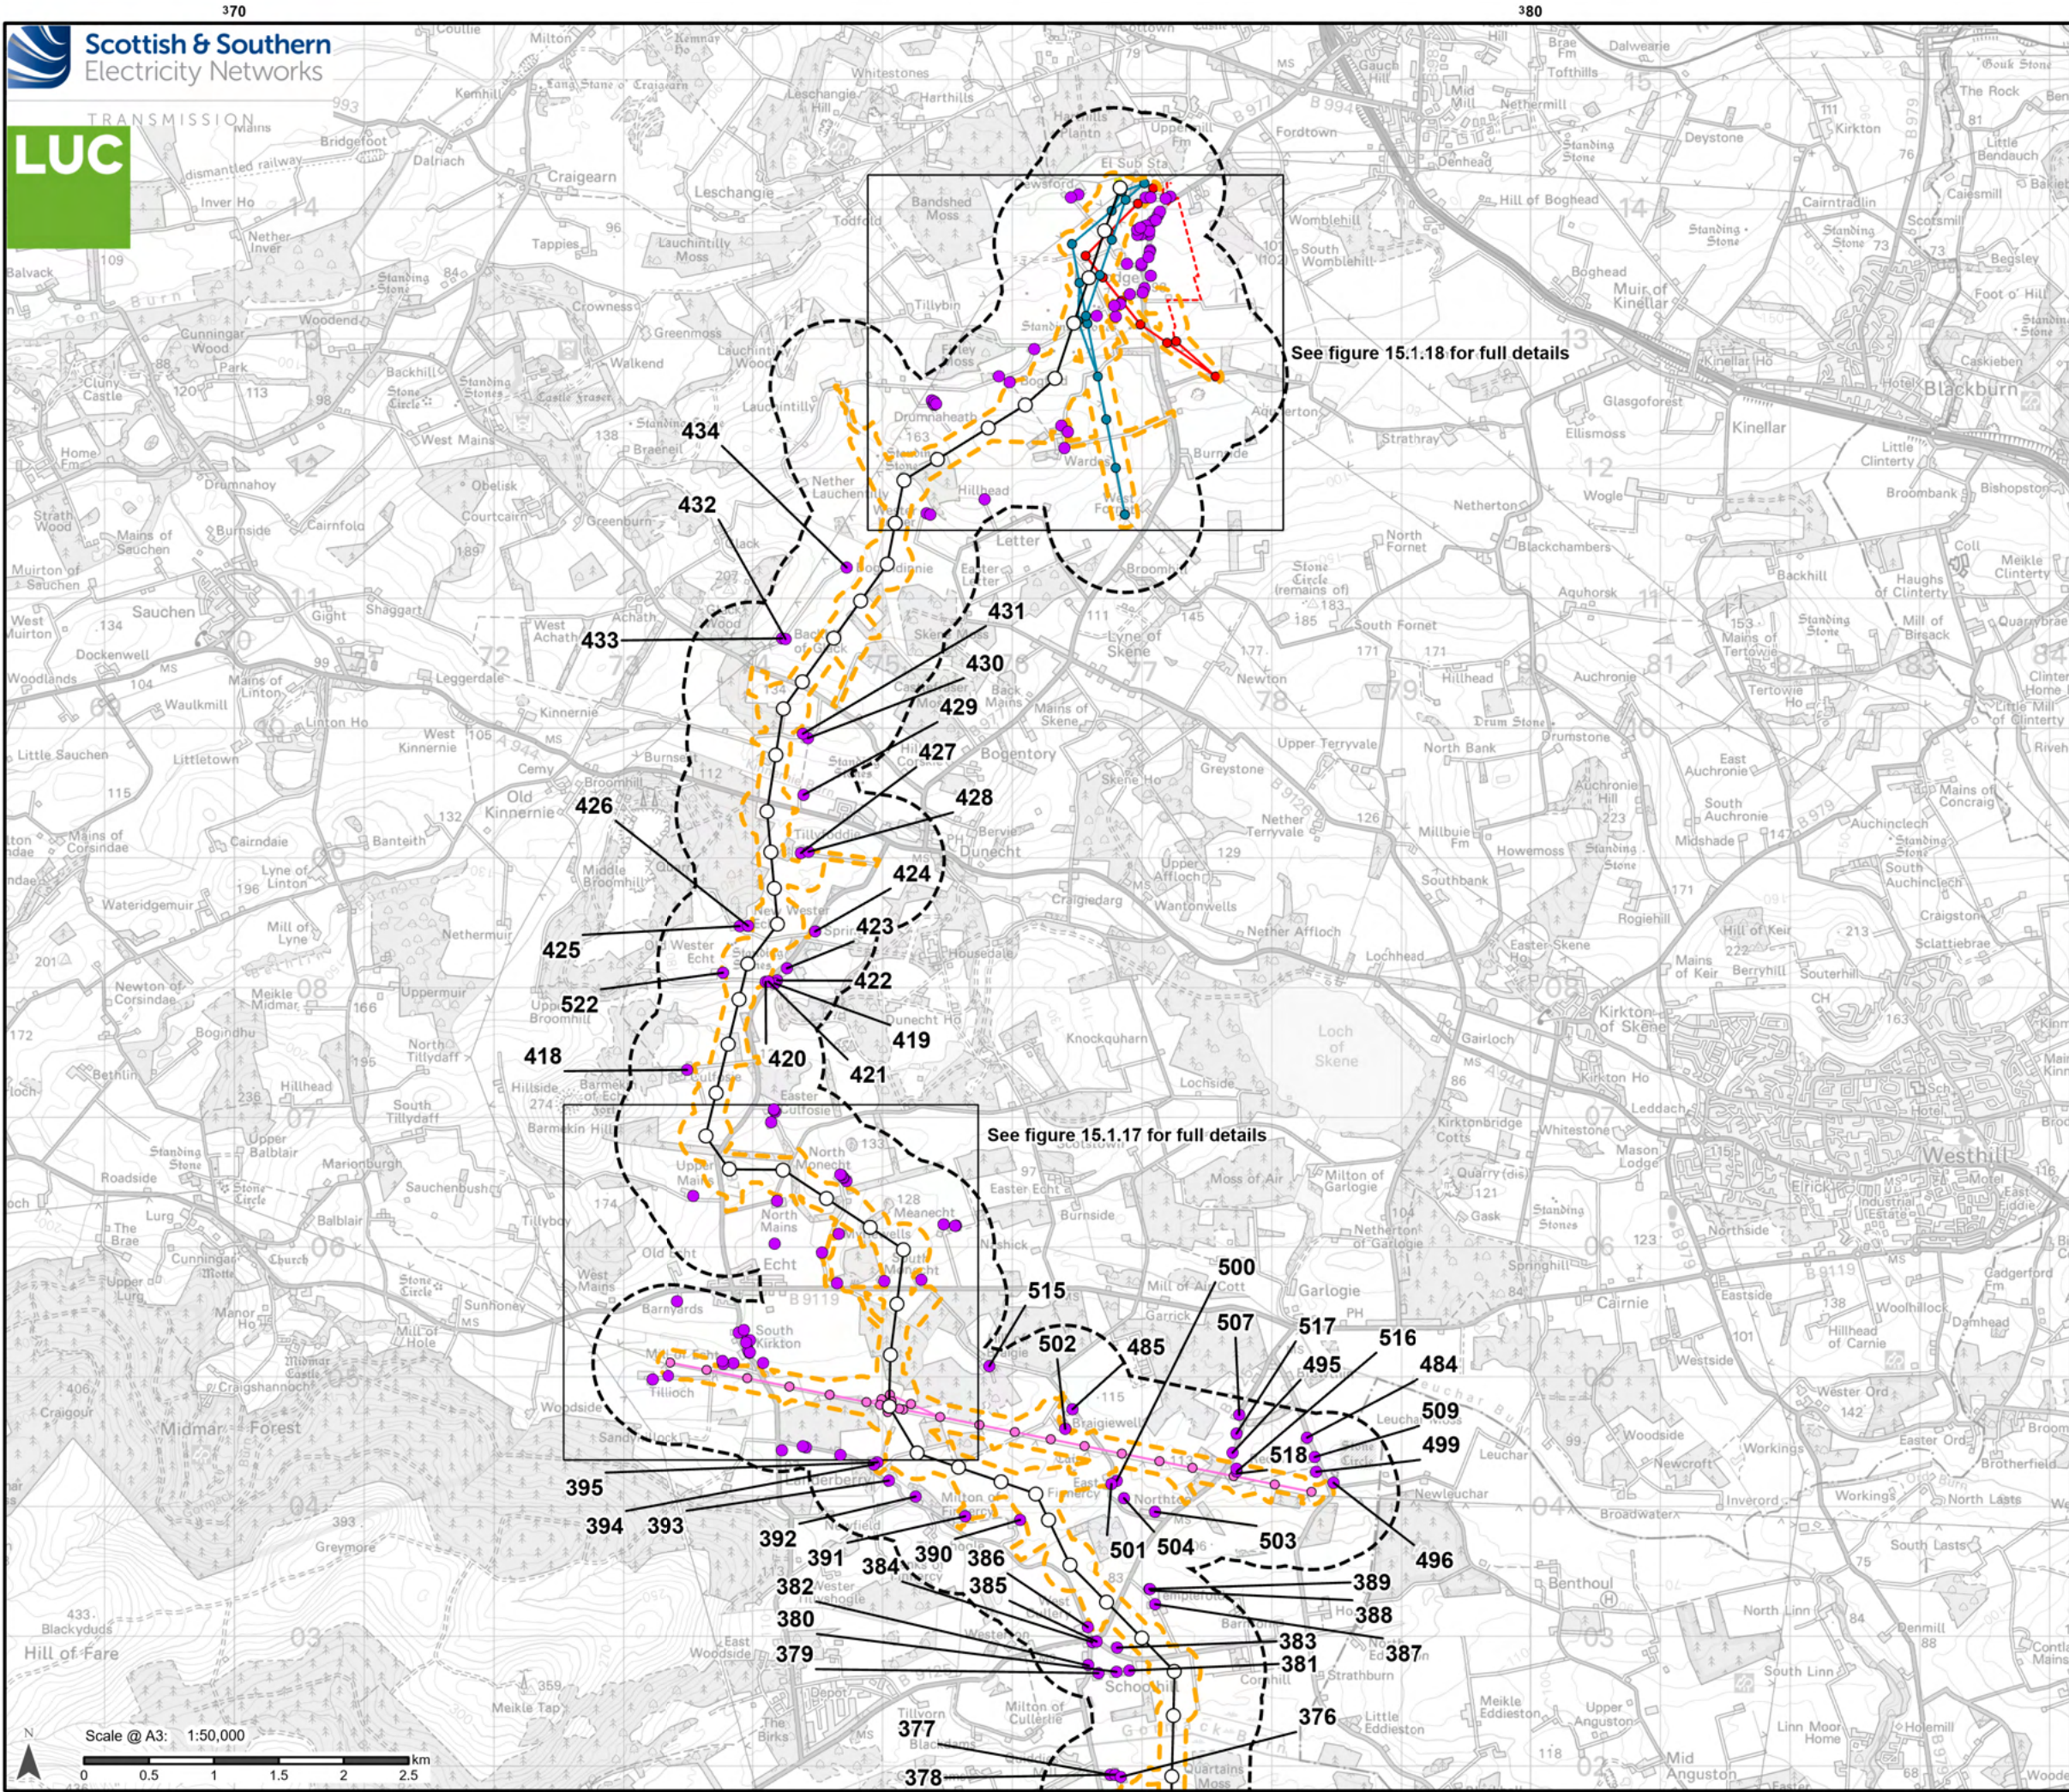

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Craigiebukler - Tarland 132 kV Overhead Line Crossing

- Tower Location
- OHL

Additional development included in Section 37 application: Kintore - Craigiebukler 132 kV

- Tower Location
- OHL

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Noise Sensitive Receptors (NSRs)

Drawn by: MS Date: 27/08/2025


Drawing: 15.1.7



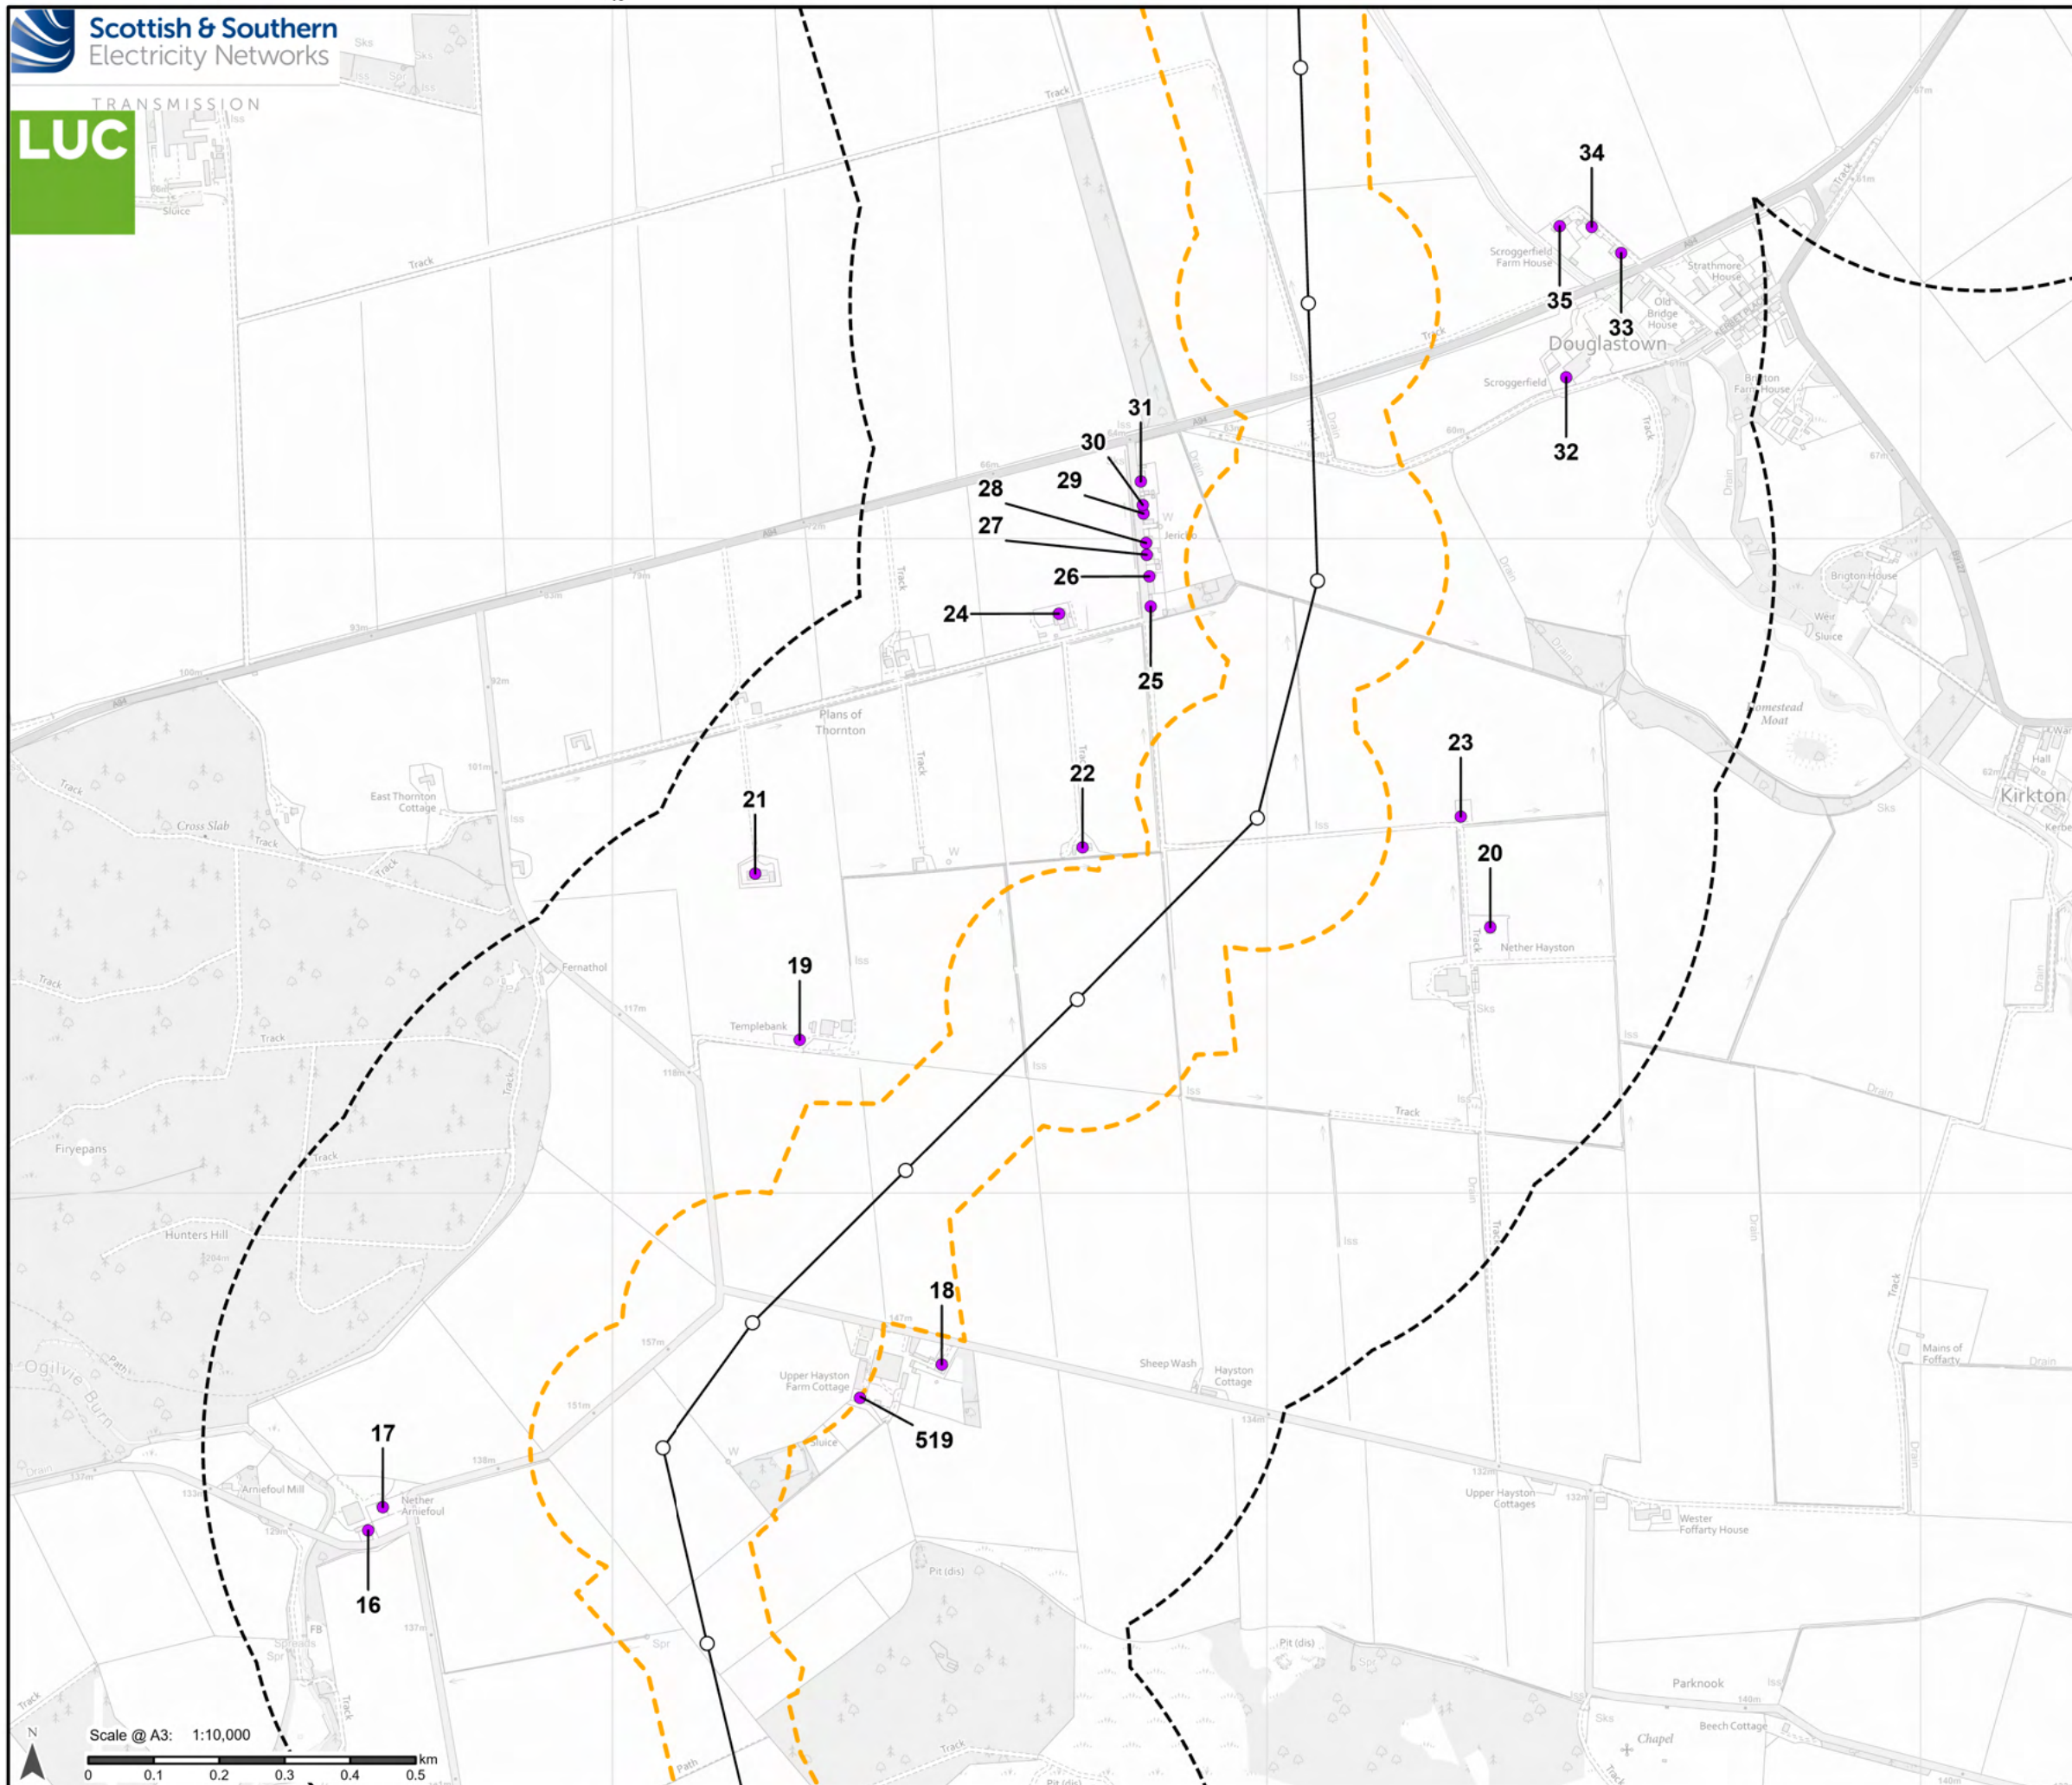


- Proposed Development**
- Tower Location
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - 500 m buffer from LOD (study area)
- Noise**
- Noise Sensitive Receptor

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.
Data provided by Wood PLC.

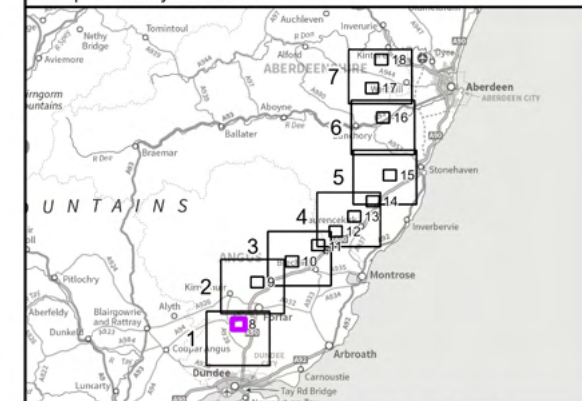

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Noise Sensitive Receptors (NSRs)
Drawn by:	MS
Date:	27/08/2025
Drawing:	15.1.8

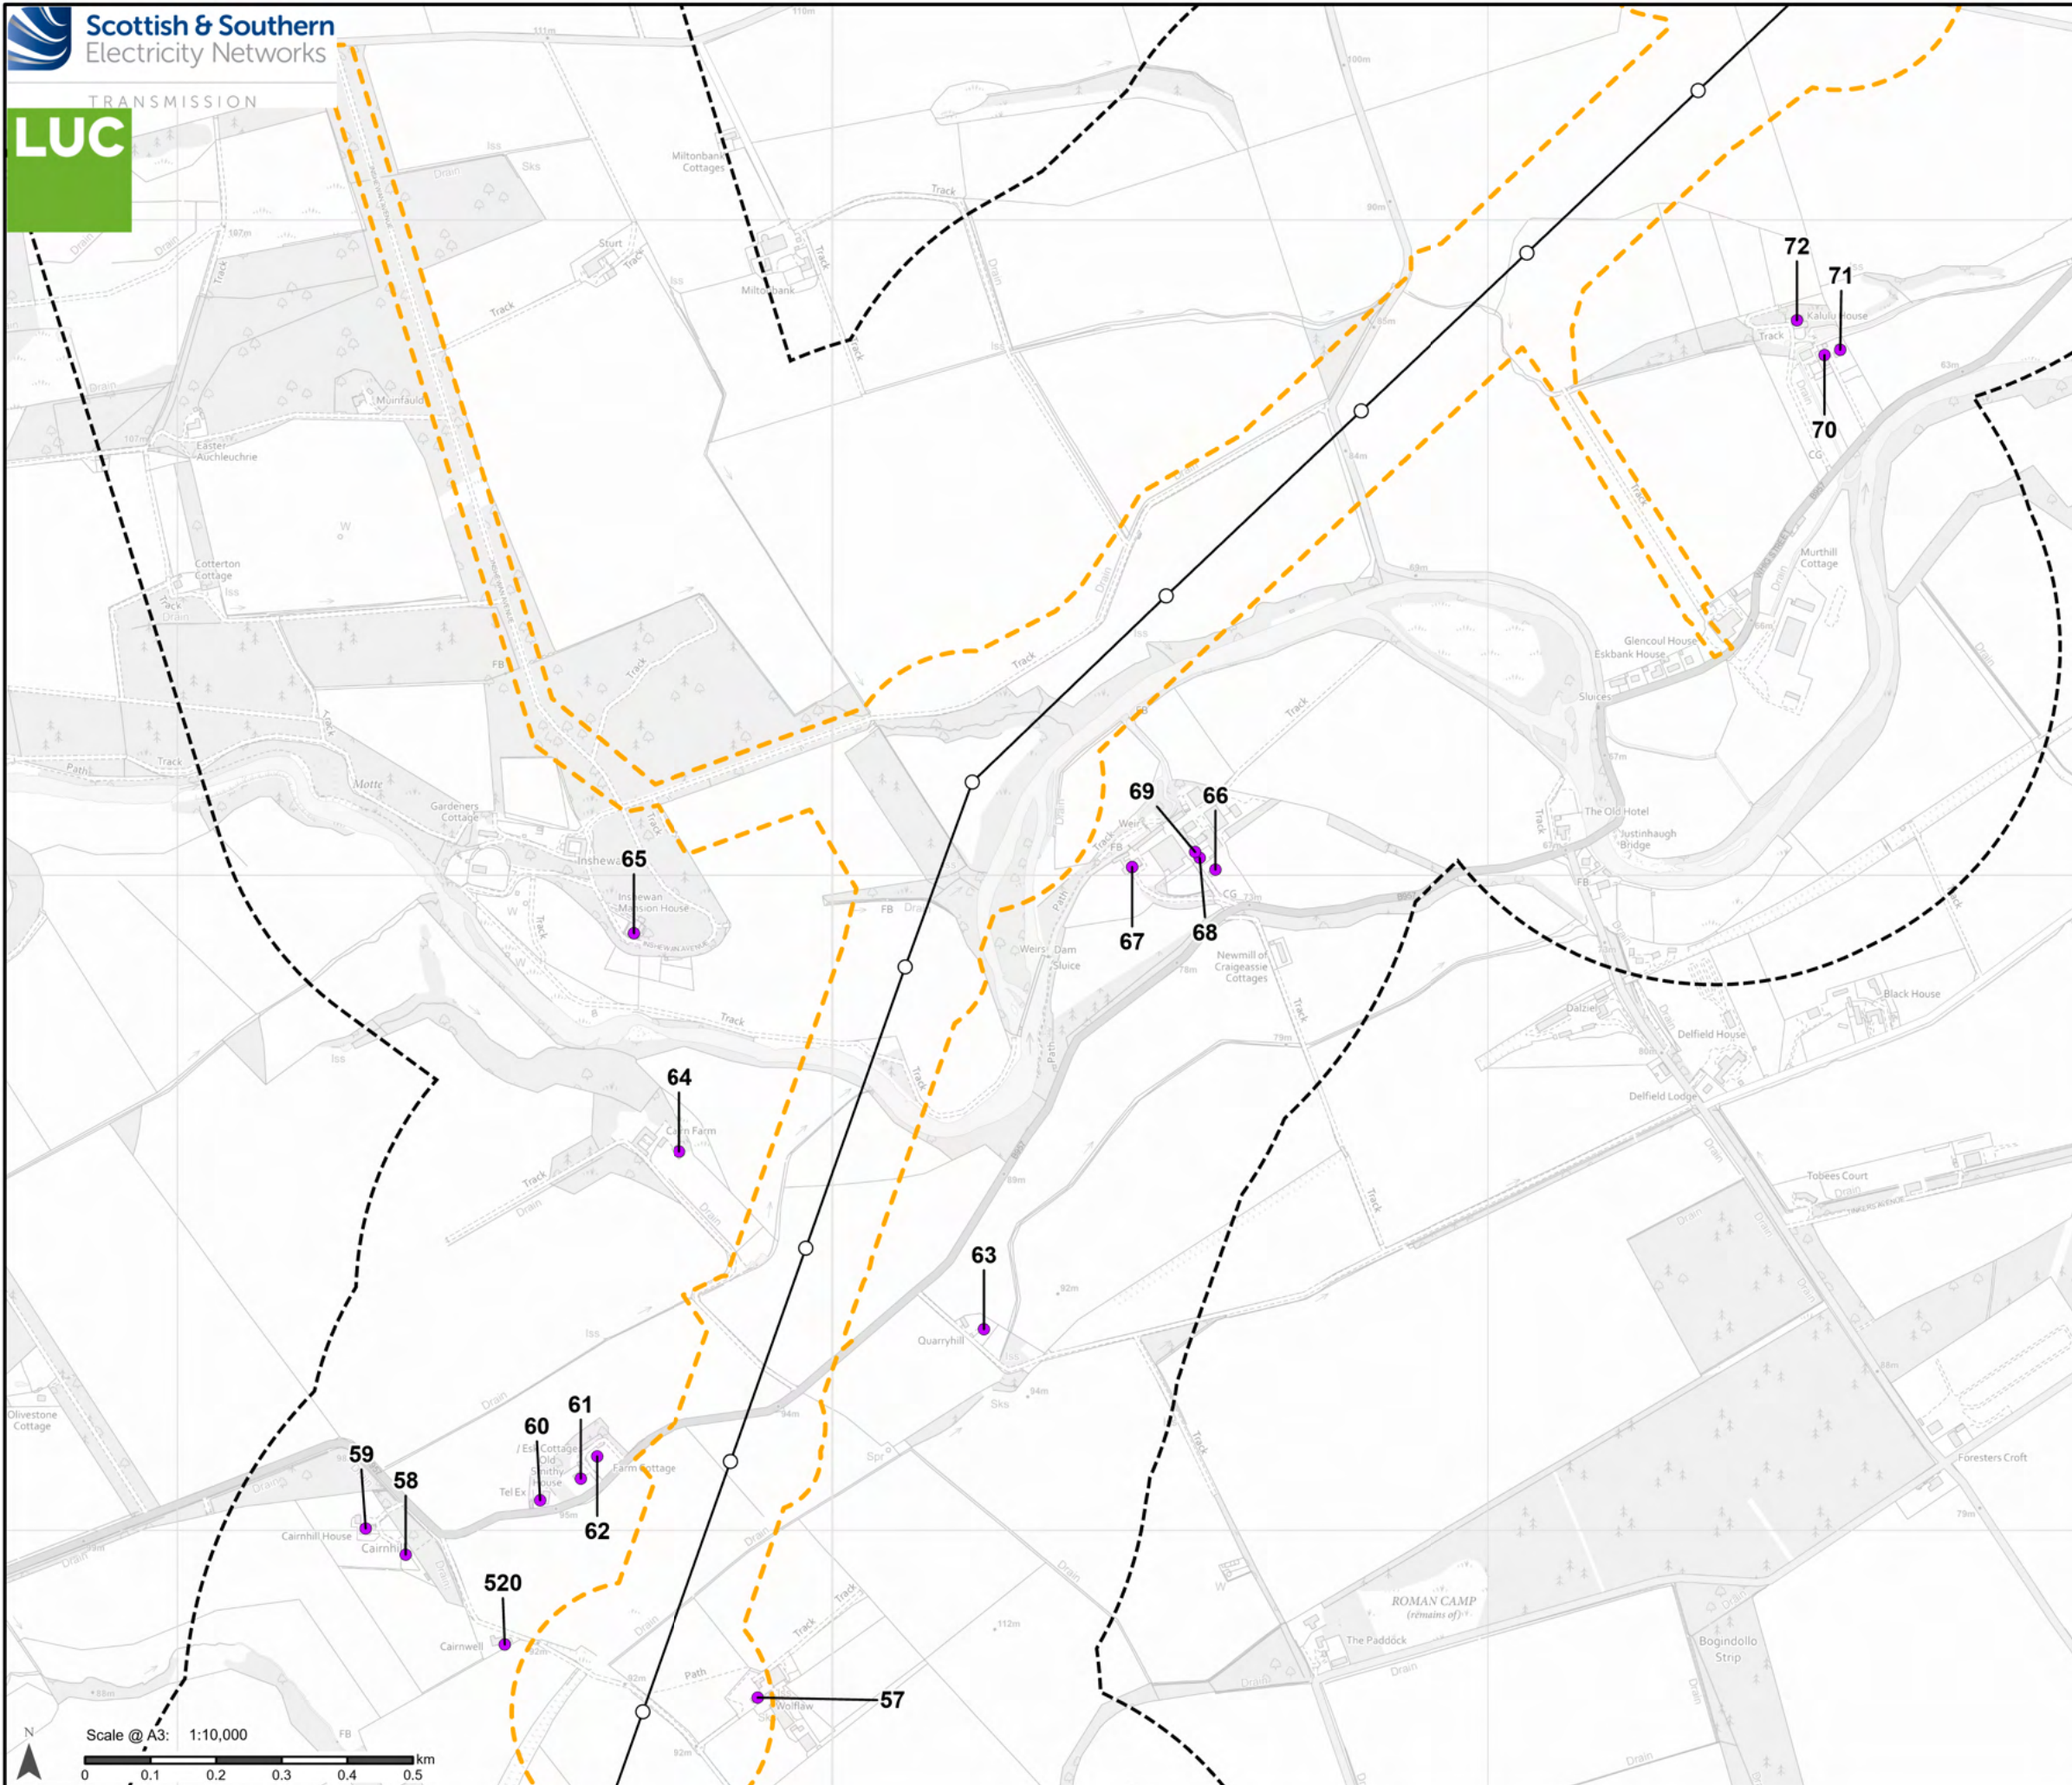

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- 500 m buffer from LOD (study area)


Noise

- Noise Sensitive Receptor

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by Wood PLC.

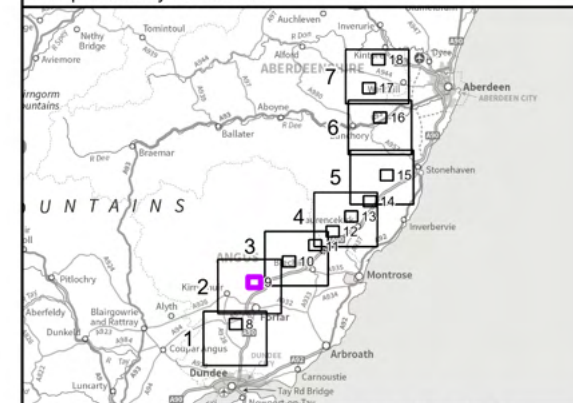

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title:

Noise Sensitive Receptors (NSRs)

Drawn by: MS

Date: 27/08/2025

Drawing: 15.1.9