


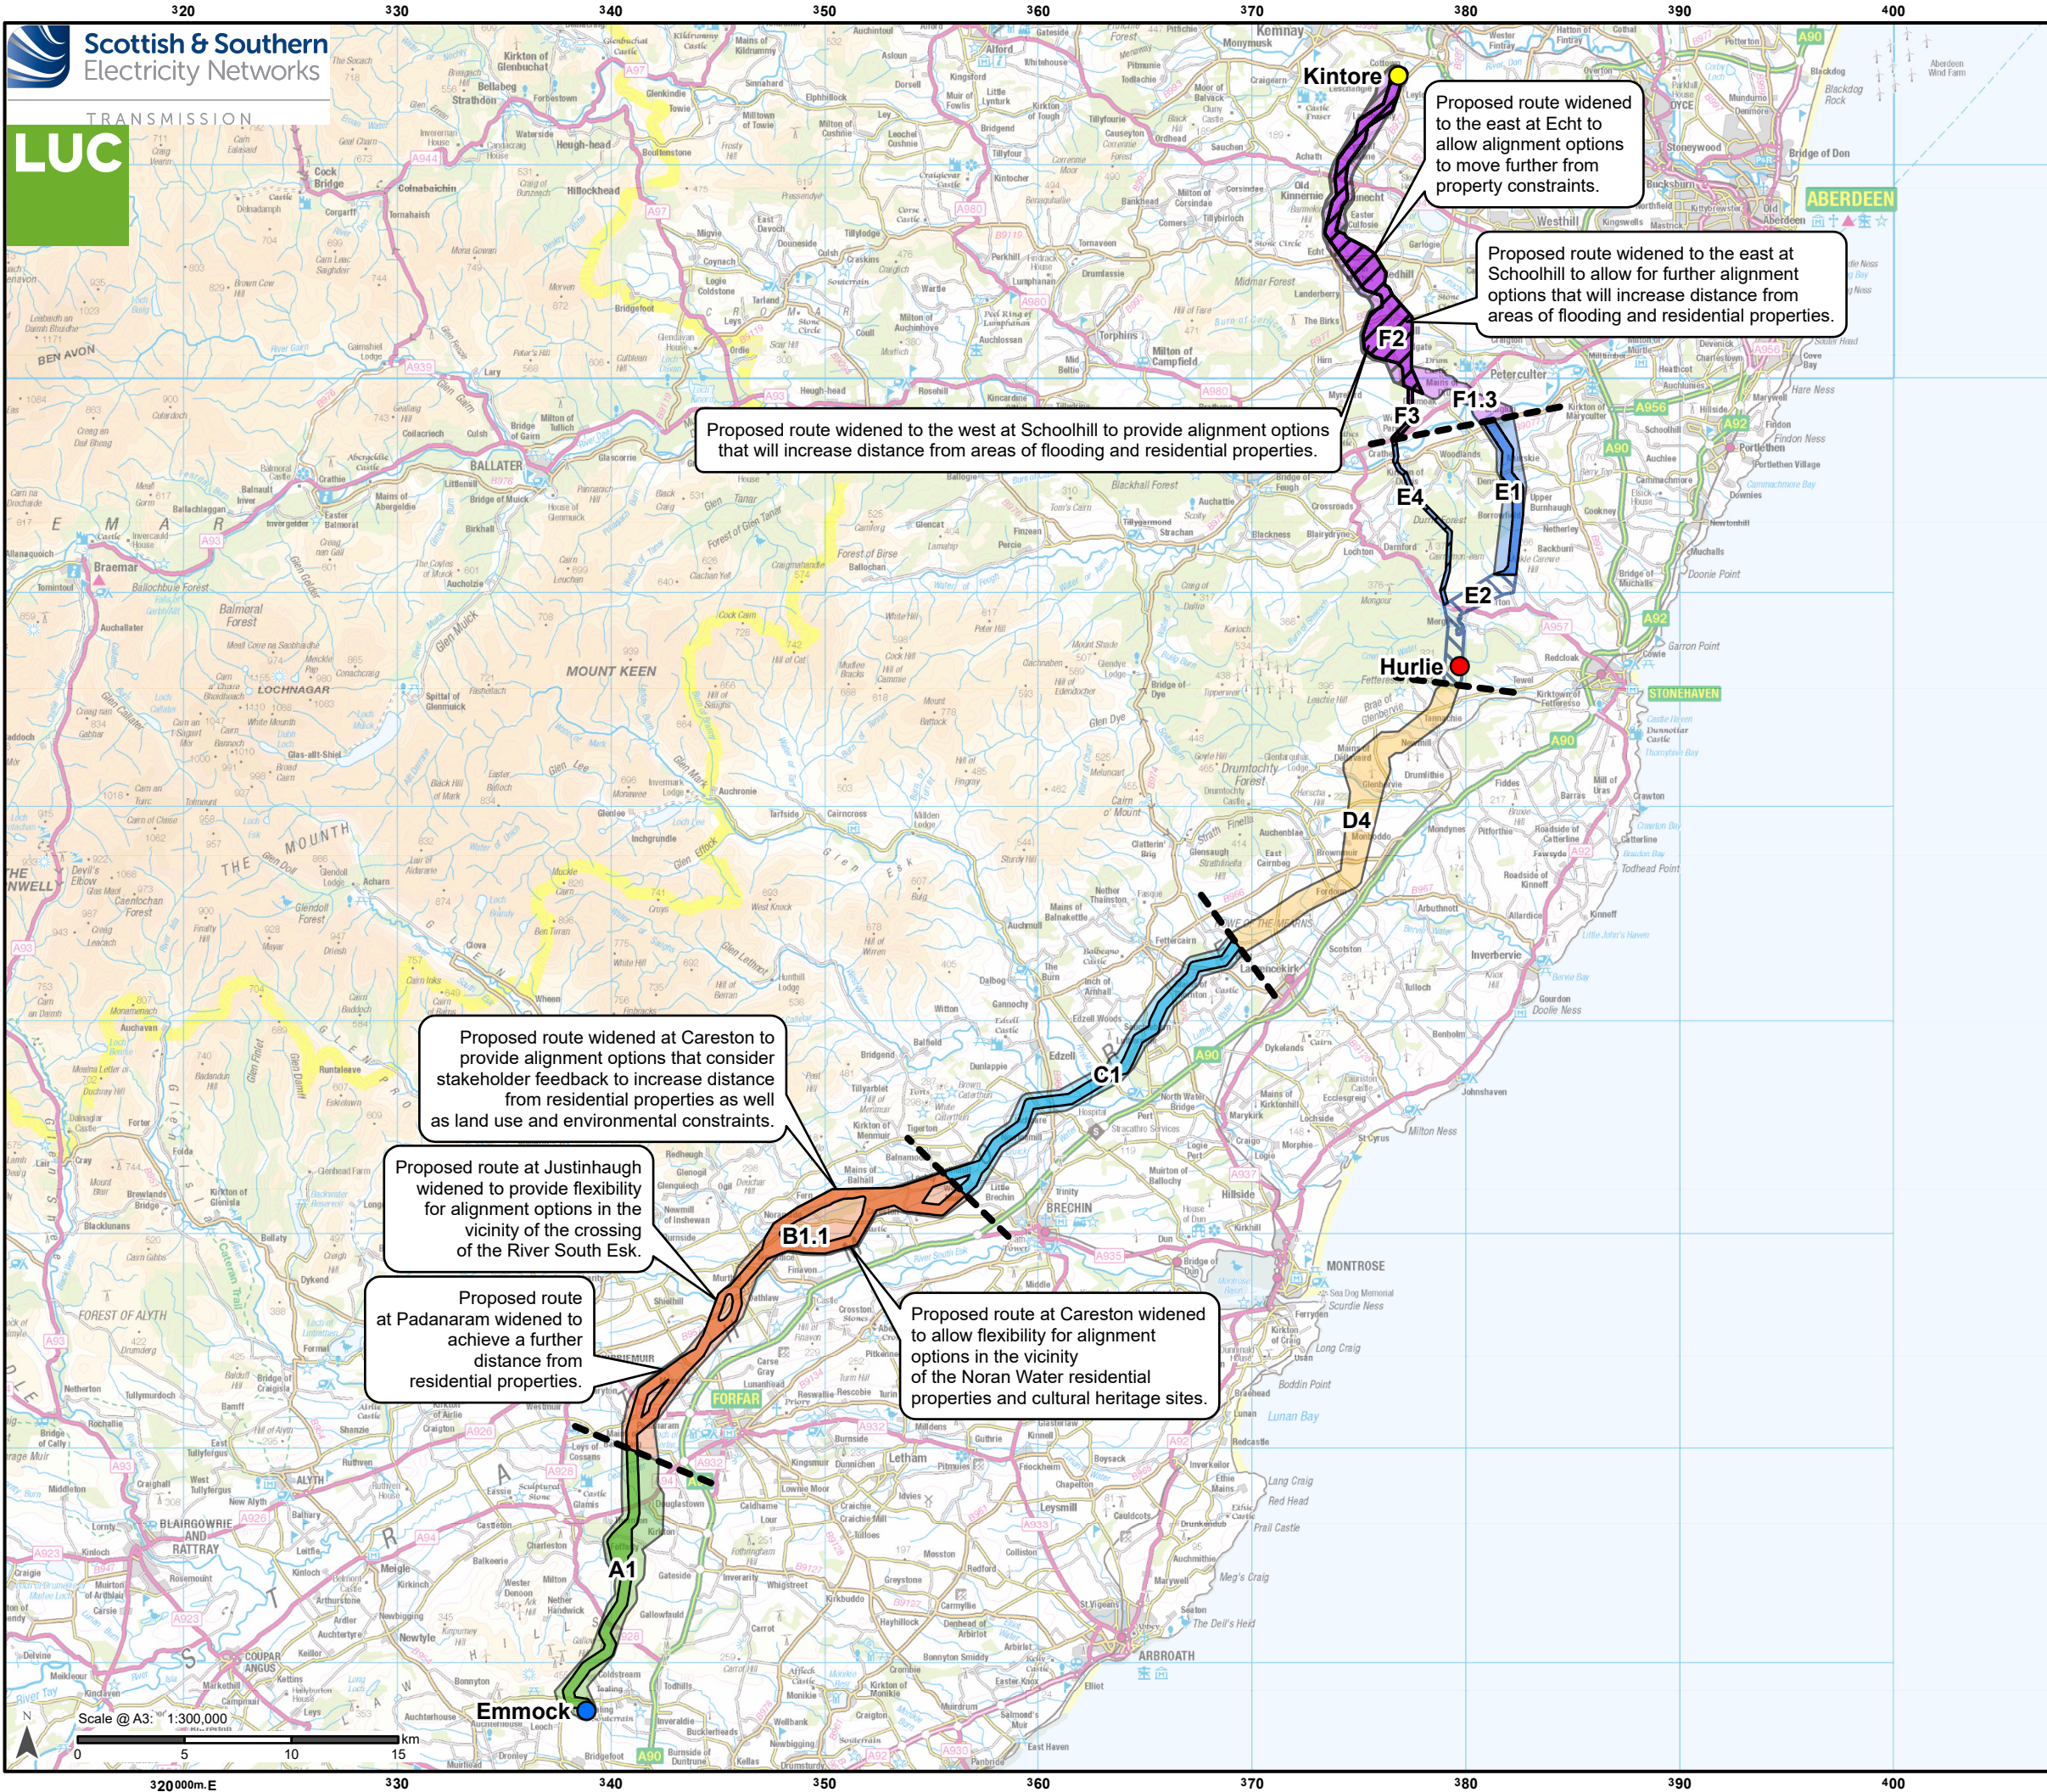

Sections
--- Route section divider

Substations

- Existing Kintore Substation
- Proposed Hurlie substation
- Proposed Emmock substation

Refined Route*

- A1
- B1.1
- C1
- E1
- F2

Proposed Route

- A1
- B1.1
- C1
- D4
- E1
- E2
- F1.3
- F2

Additional options (identified following March 2024 consultation)

- E4
- F3

*Refined routes are approximately 500 m wide, within which an optimal alignment for the OHL can be developed

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title:

Proposed Options Following March 2024 Consultation

Drawn by: JN

Date: 04/07/2025

Drawing: 4.3.5