


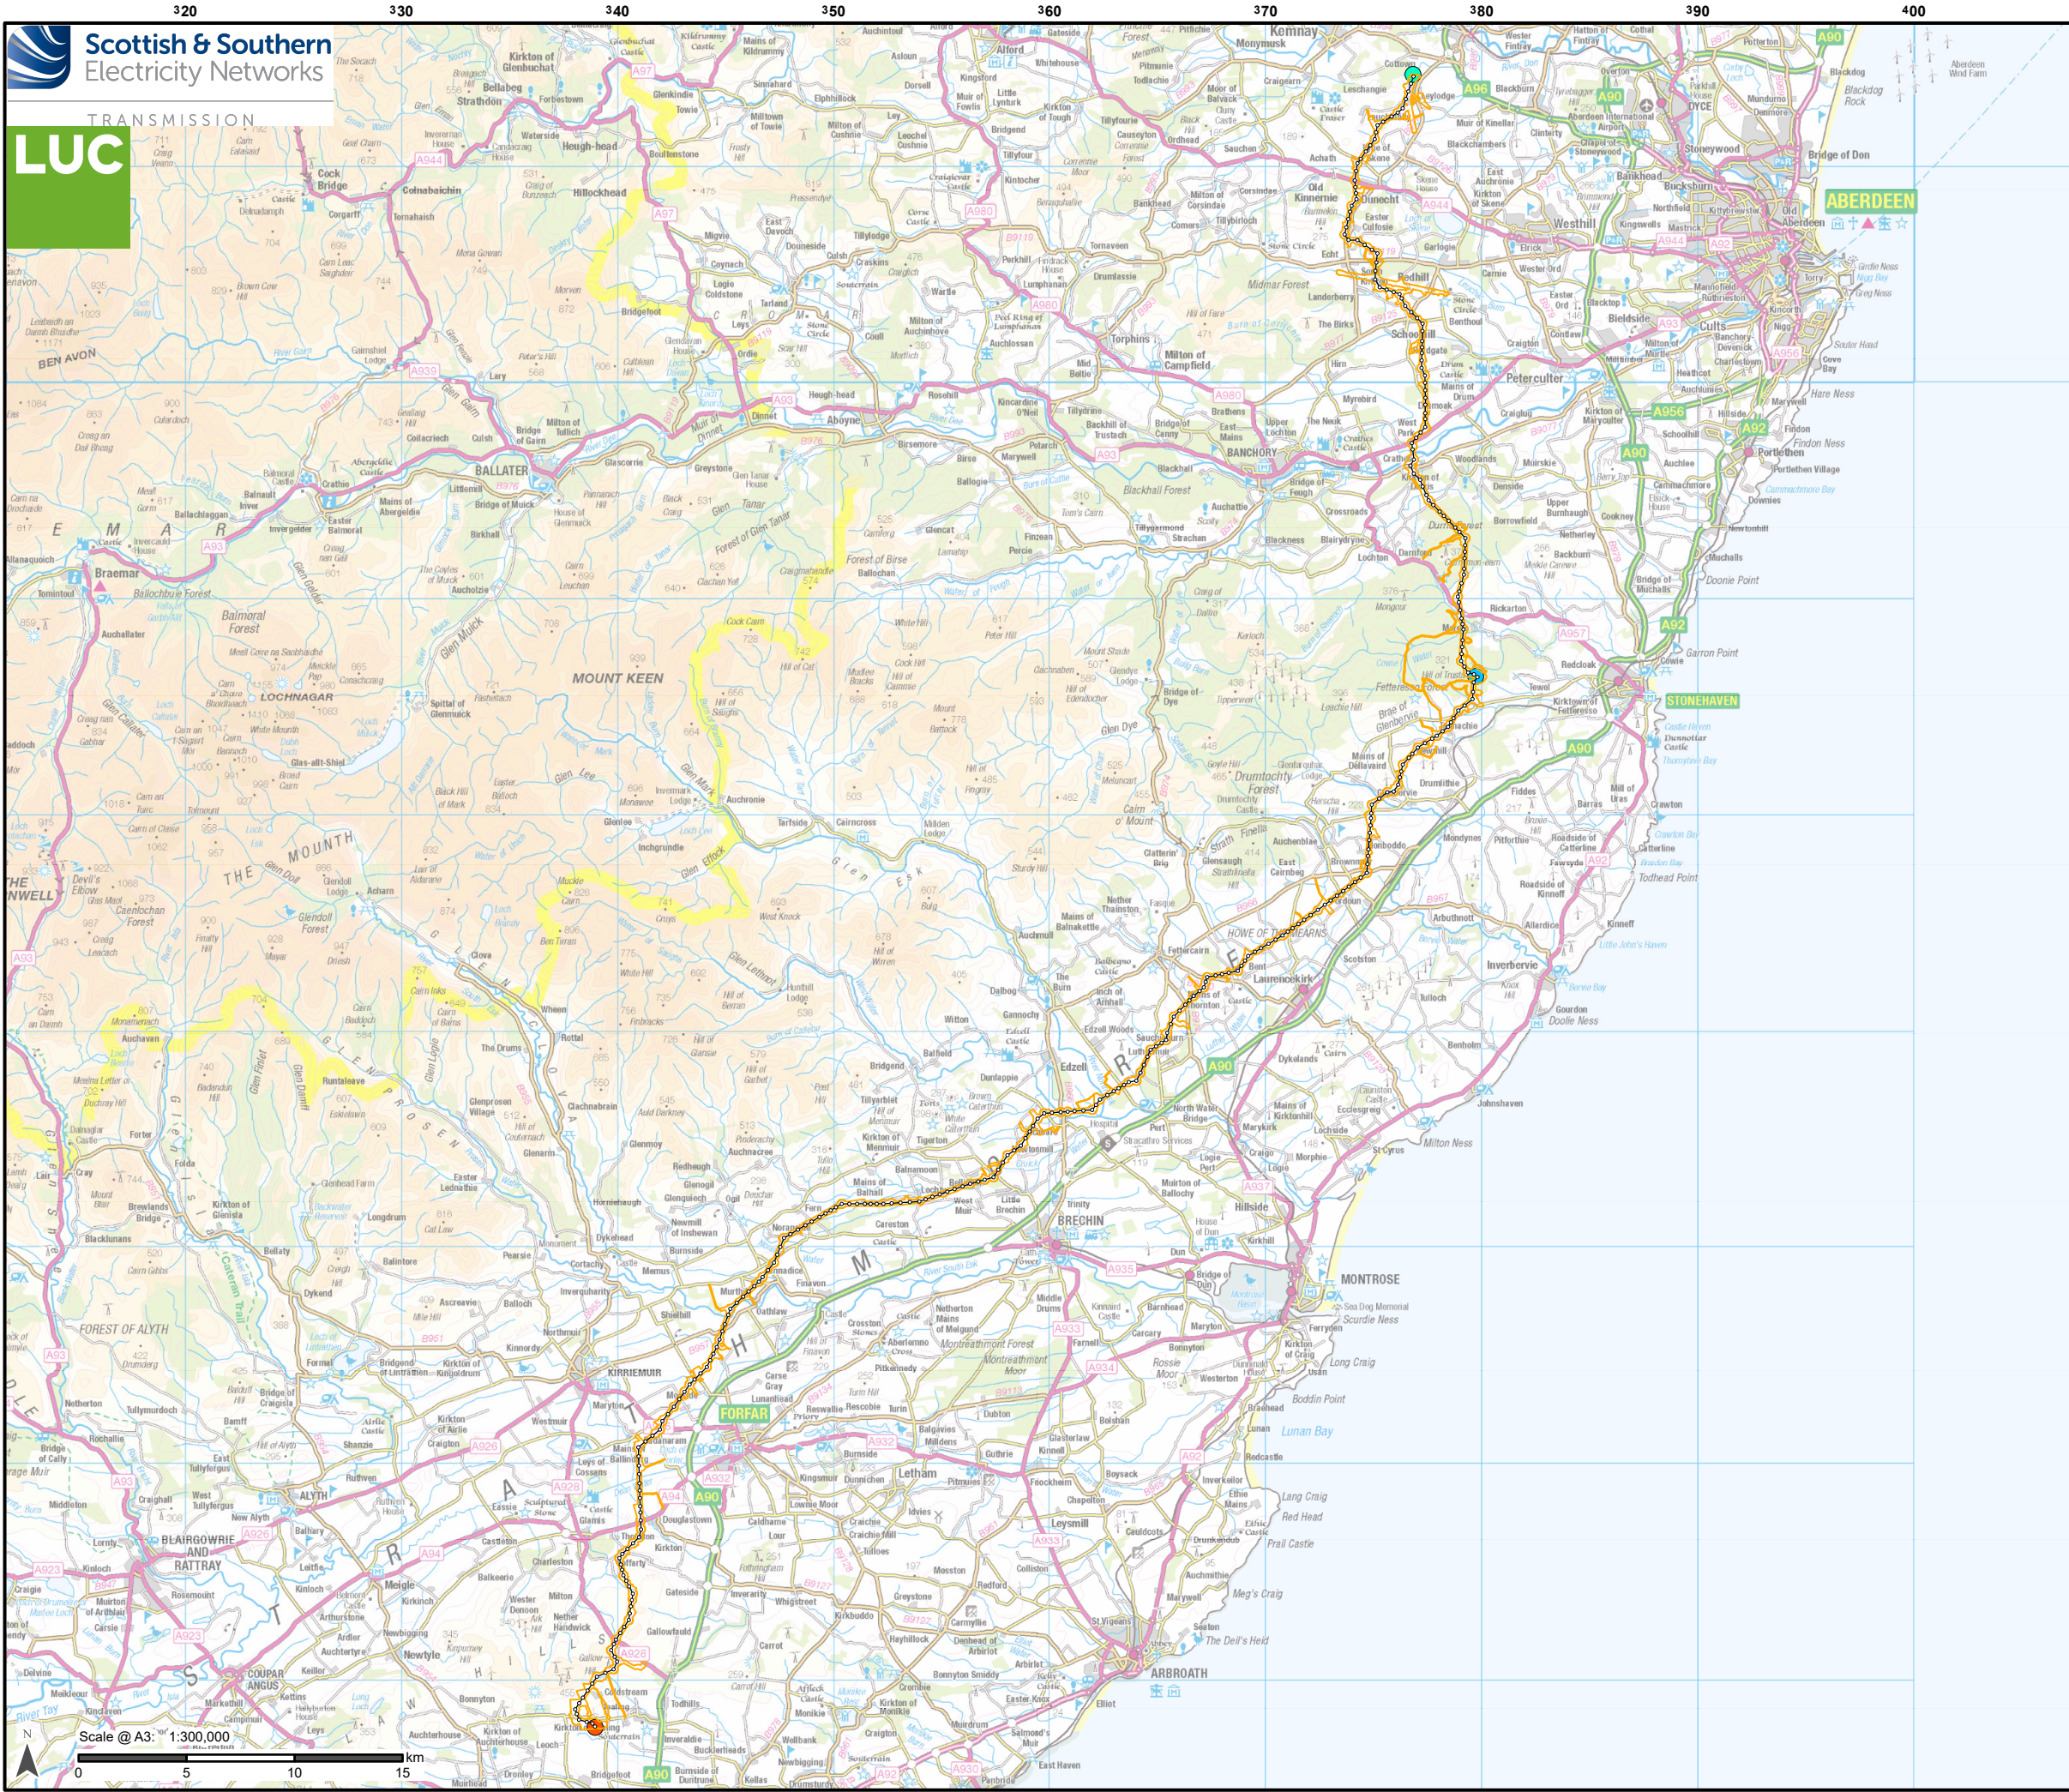

Alignment

- Tower location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Existing infrastructure

- Kintore Substation

SSEN Transmission Related Developments

- Proposed Emmock substation
- Proposed Hurlie substation

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title:

Proposed Alignment

Drawn by: JN

Date: 04/07/2025

Drawing: 4.4.9