


Areas

- Substation search area (5 km radius from existing Substation)
- Study area 10 km buffer


Corridor Options

- 1a
- 1b
- 1c
- 2a
- 2b
- 2c

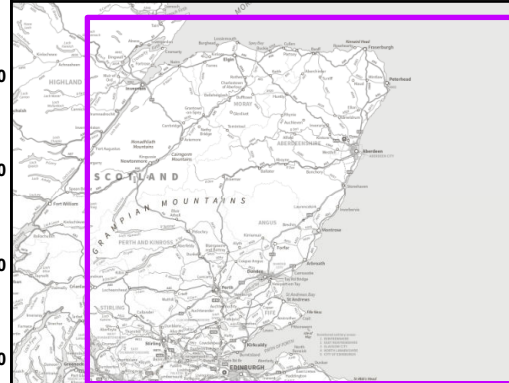

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Overview of Corridor Options
Drawn by:	JN
Date:	16/07/2025
Drawing:	4.1.1

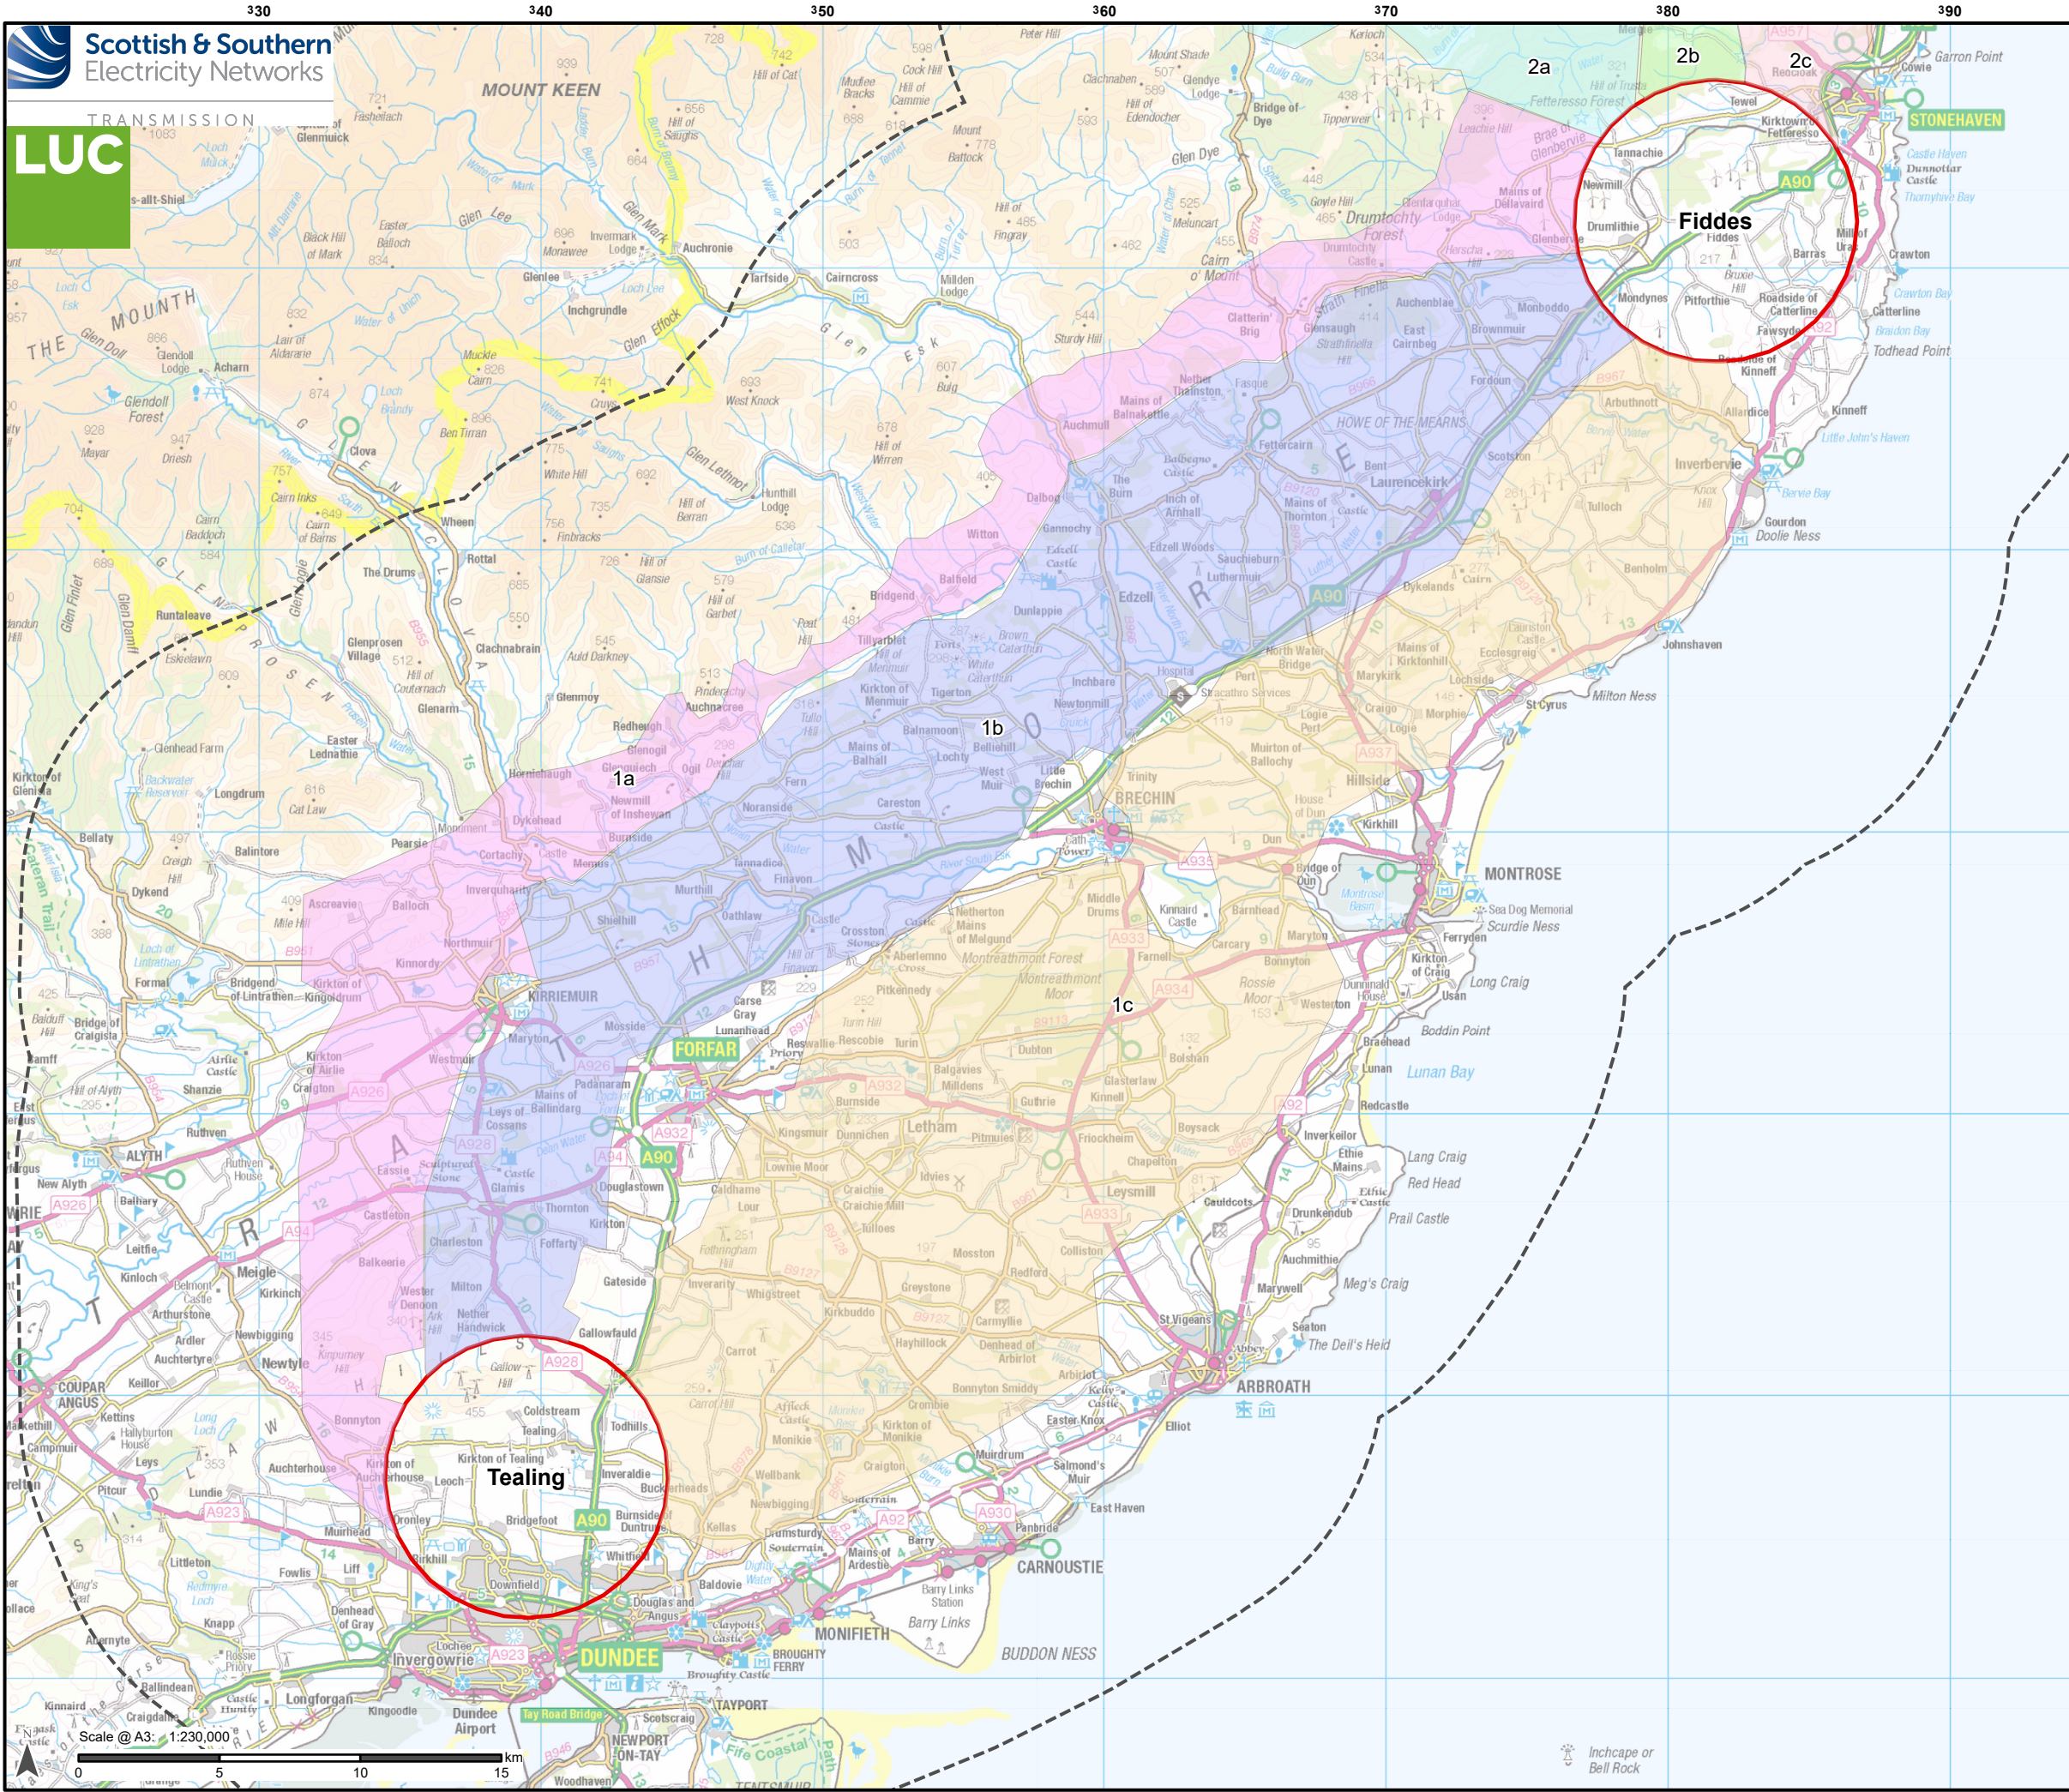


Areas

- Substation search area (5 km radius from existing Substation)
- Study area 10 km buffer

Corridor Options



- 1a
- 1b
- 1c
- 2a
- 2b
- 2c

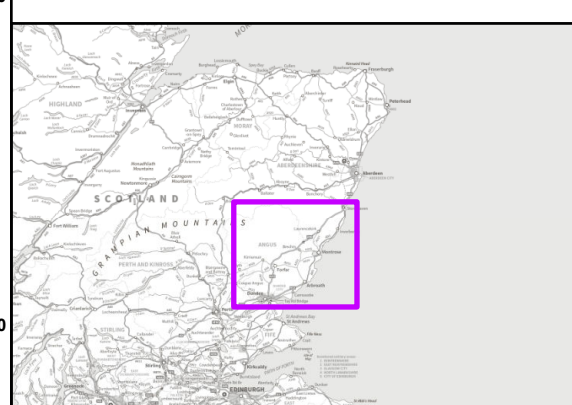


Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
 Project: Kintore to Tealing 400 kV Overhead Line
 Title:
 Corridor Options (Section 1)

Drawn by: JN
 Date: 16/07/2025
 Drawing: 4.1.2

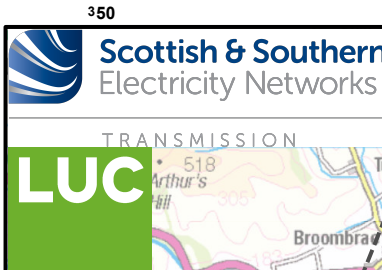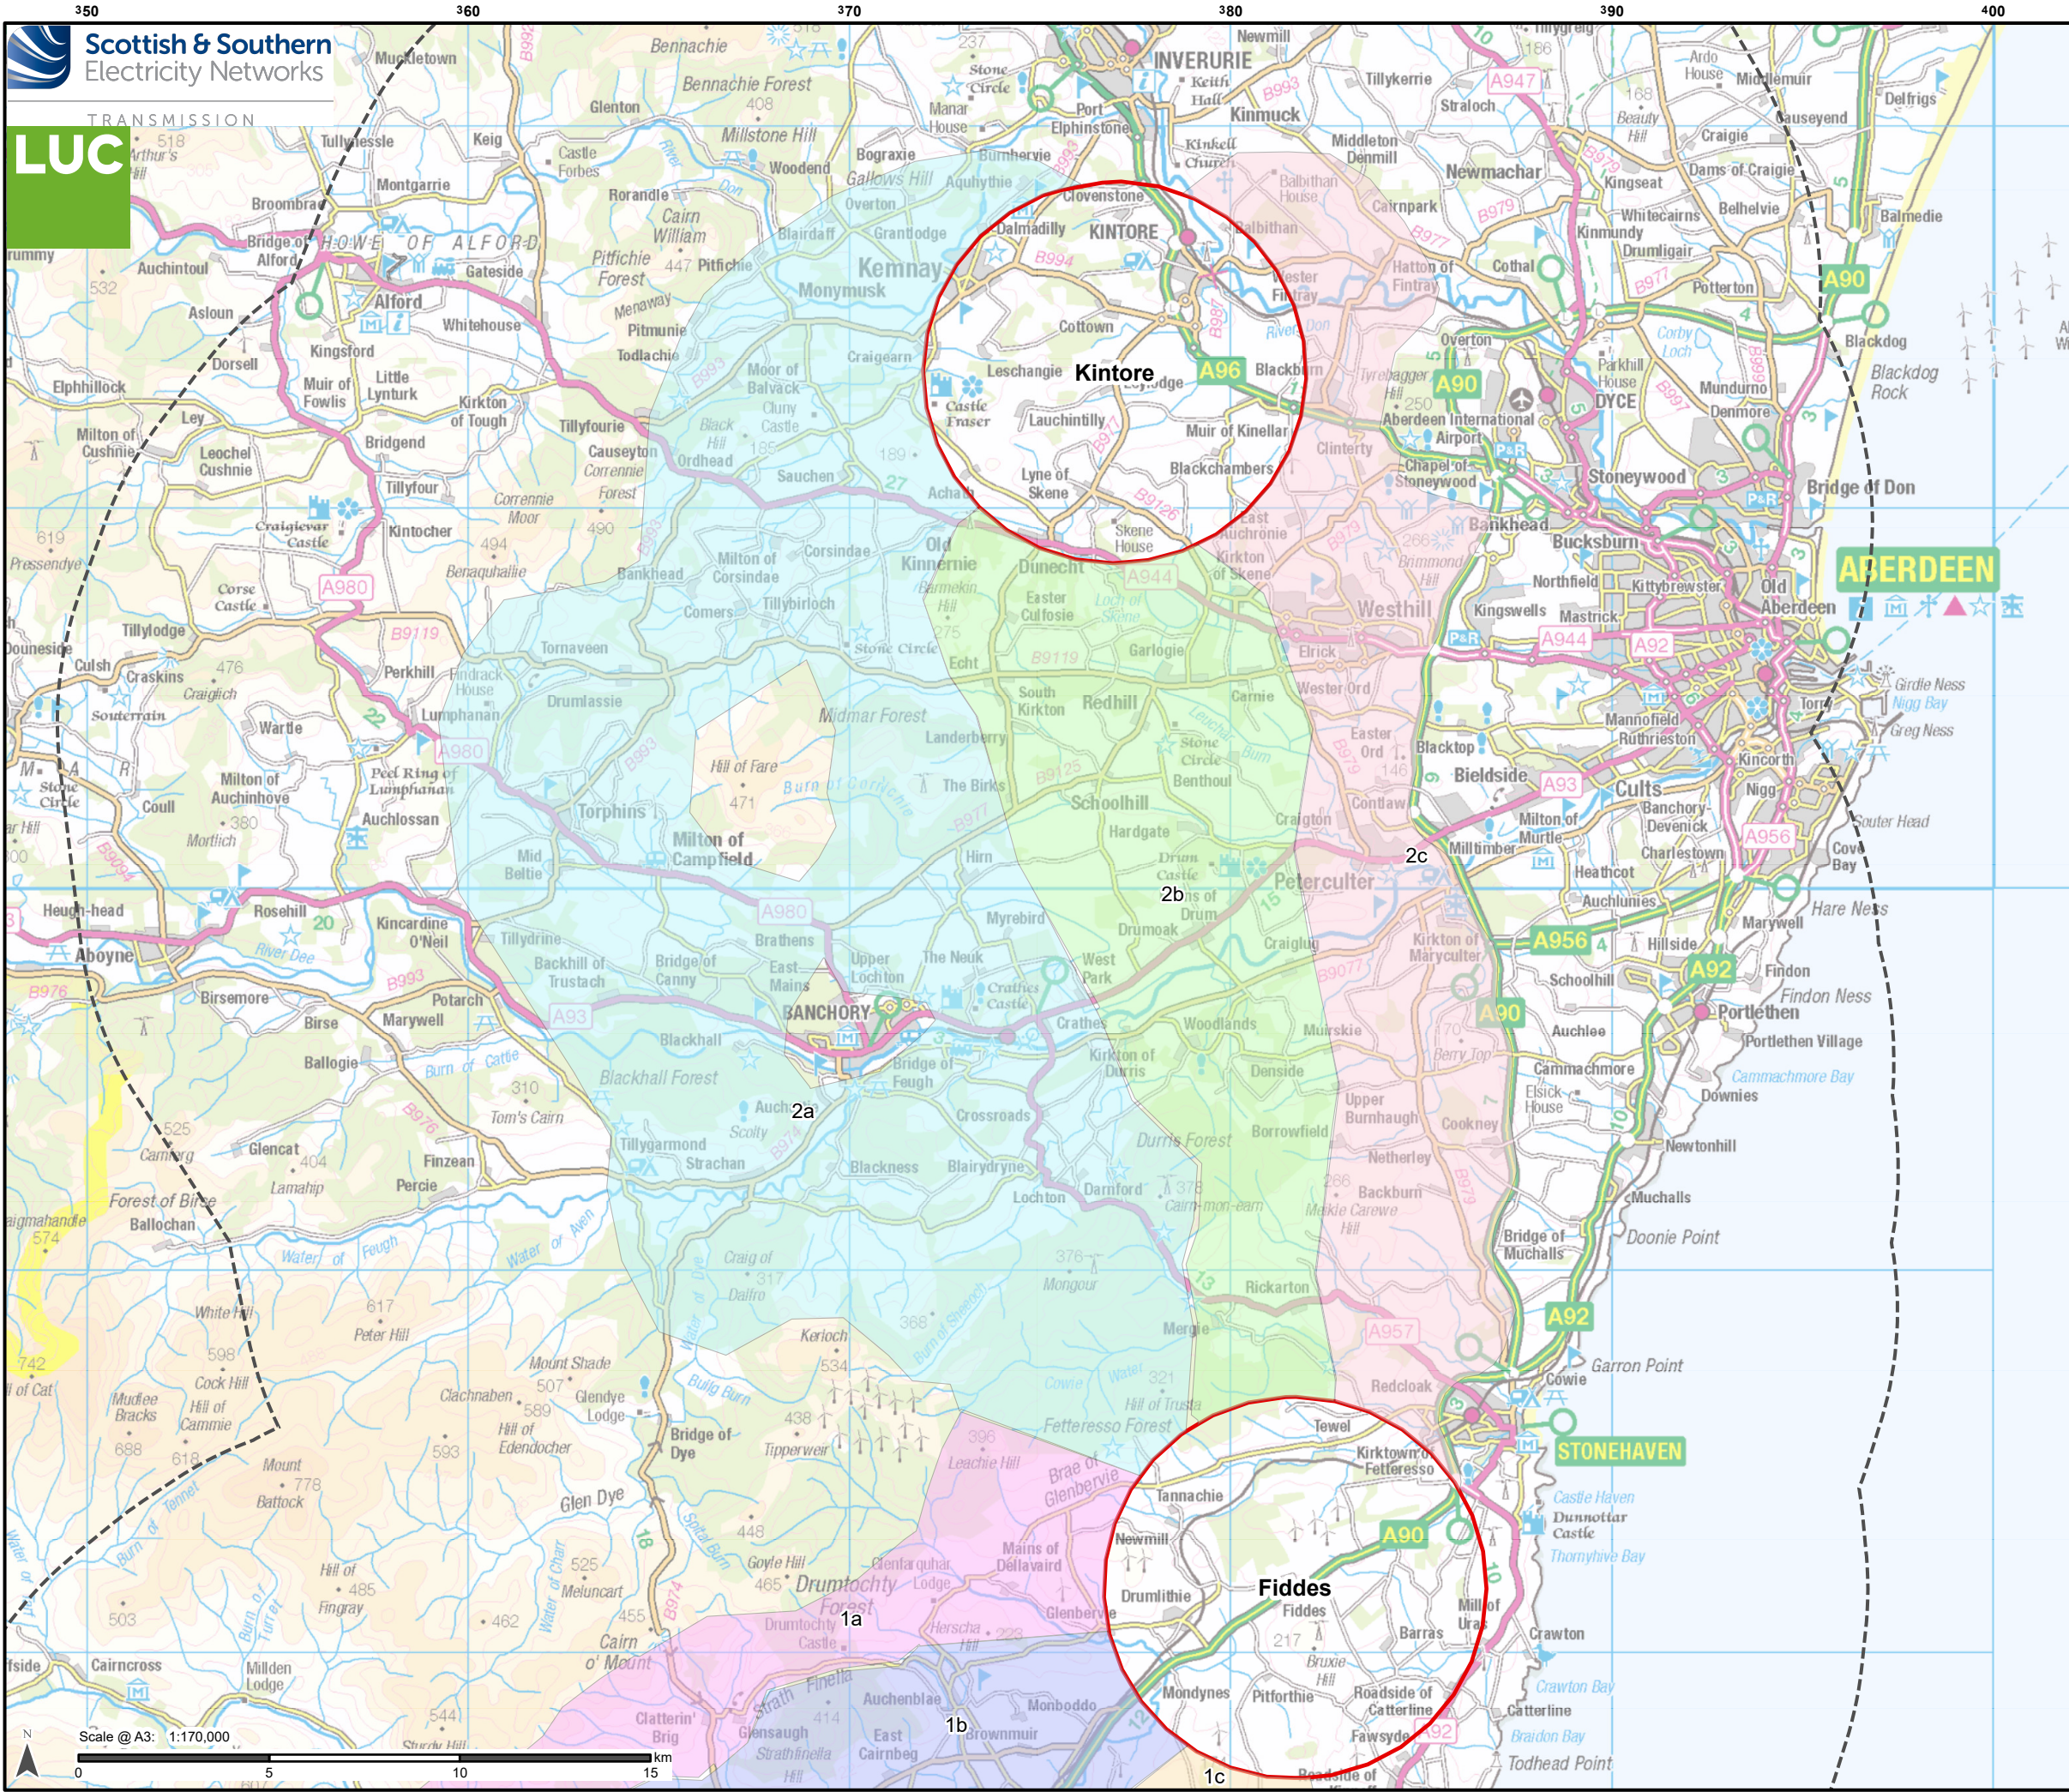

- Areas**
- Substation search area (5 km radius from existing Substation)
 - Study area 10 km buffer
- Corridor Options**
- 1a
 - 1b
 - 1c
 - 2a
 - 2b
 - 2c

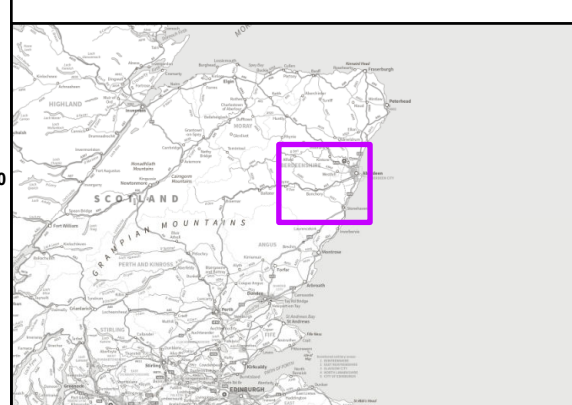

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Corridor Options (Section 2)
Drawn by:	JN
Date:	16/07/2025
Drawing:	4.1.3

