


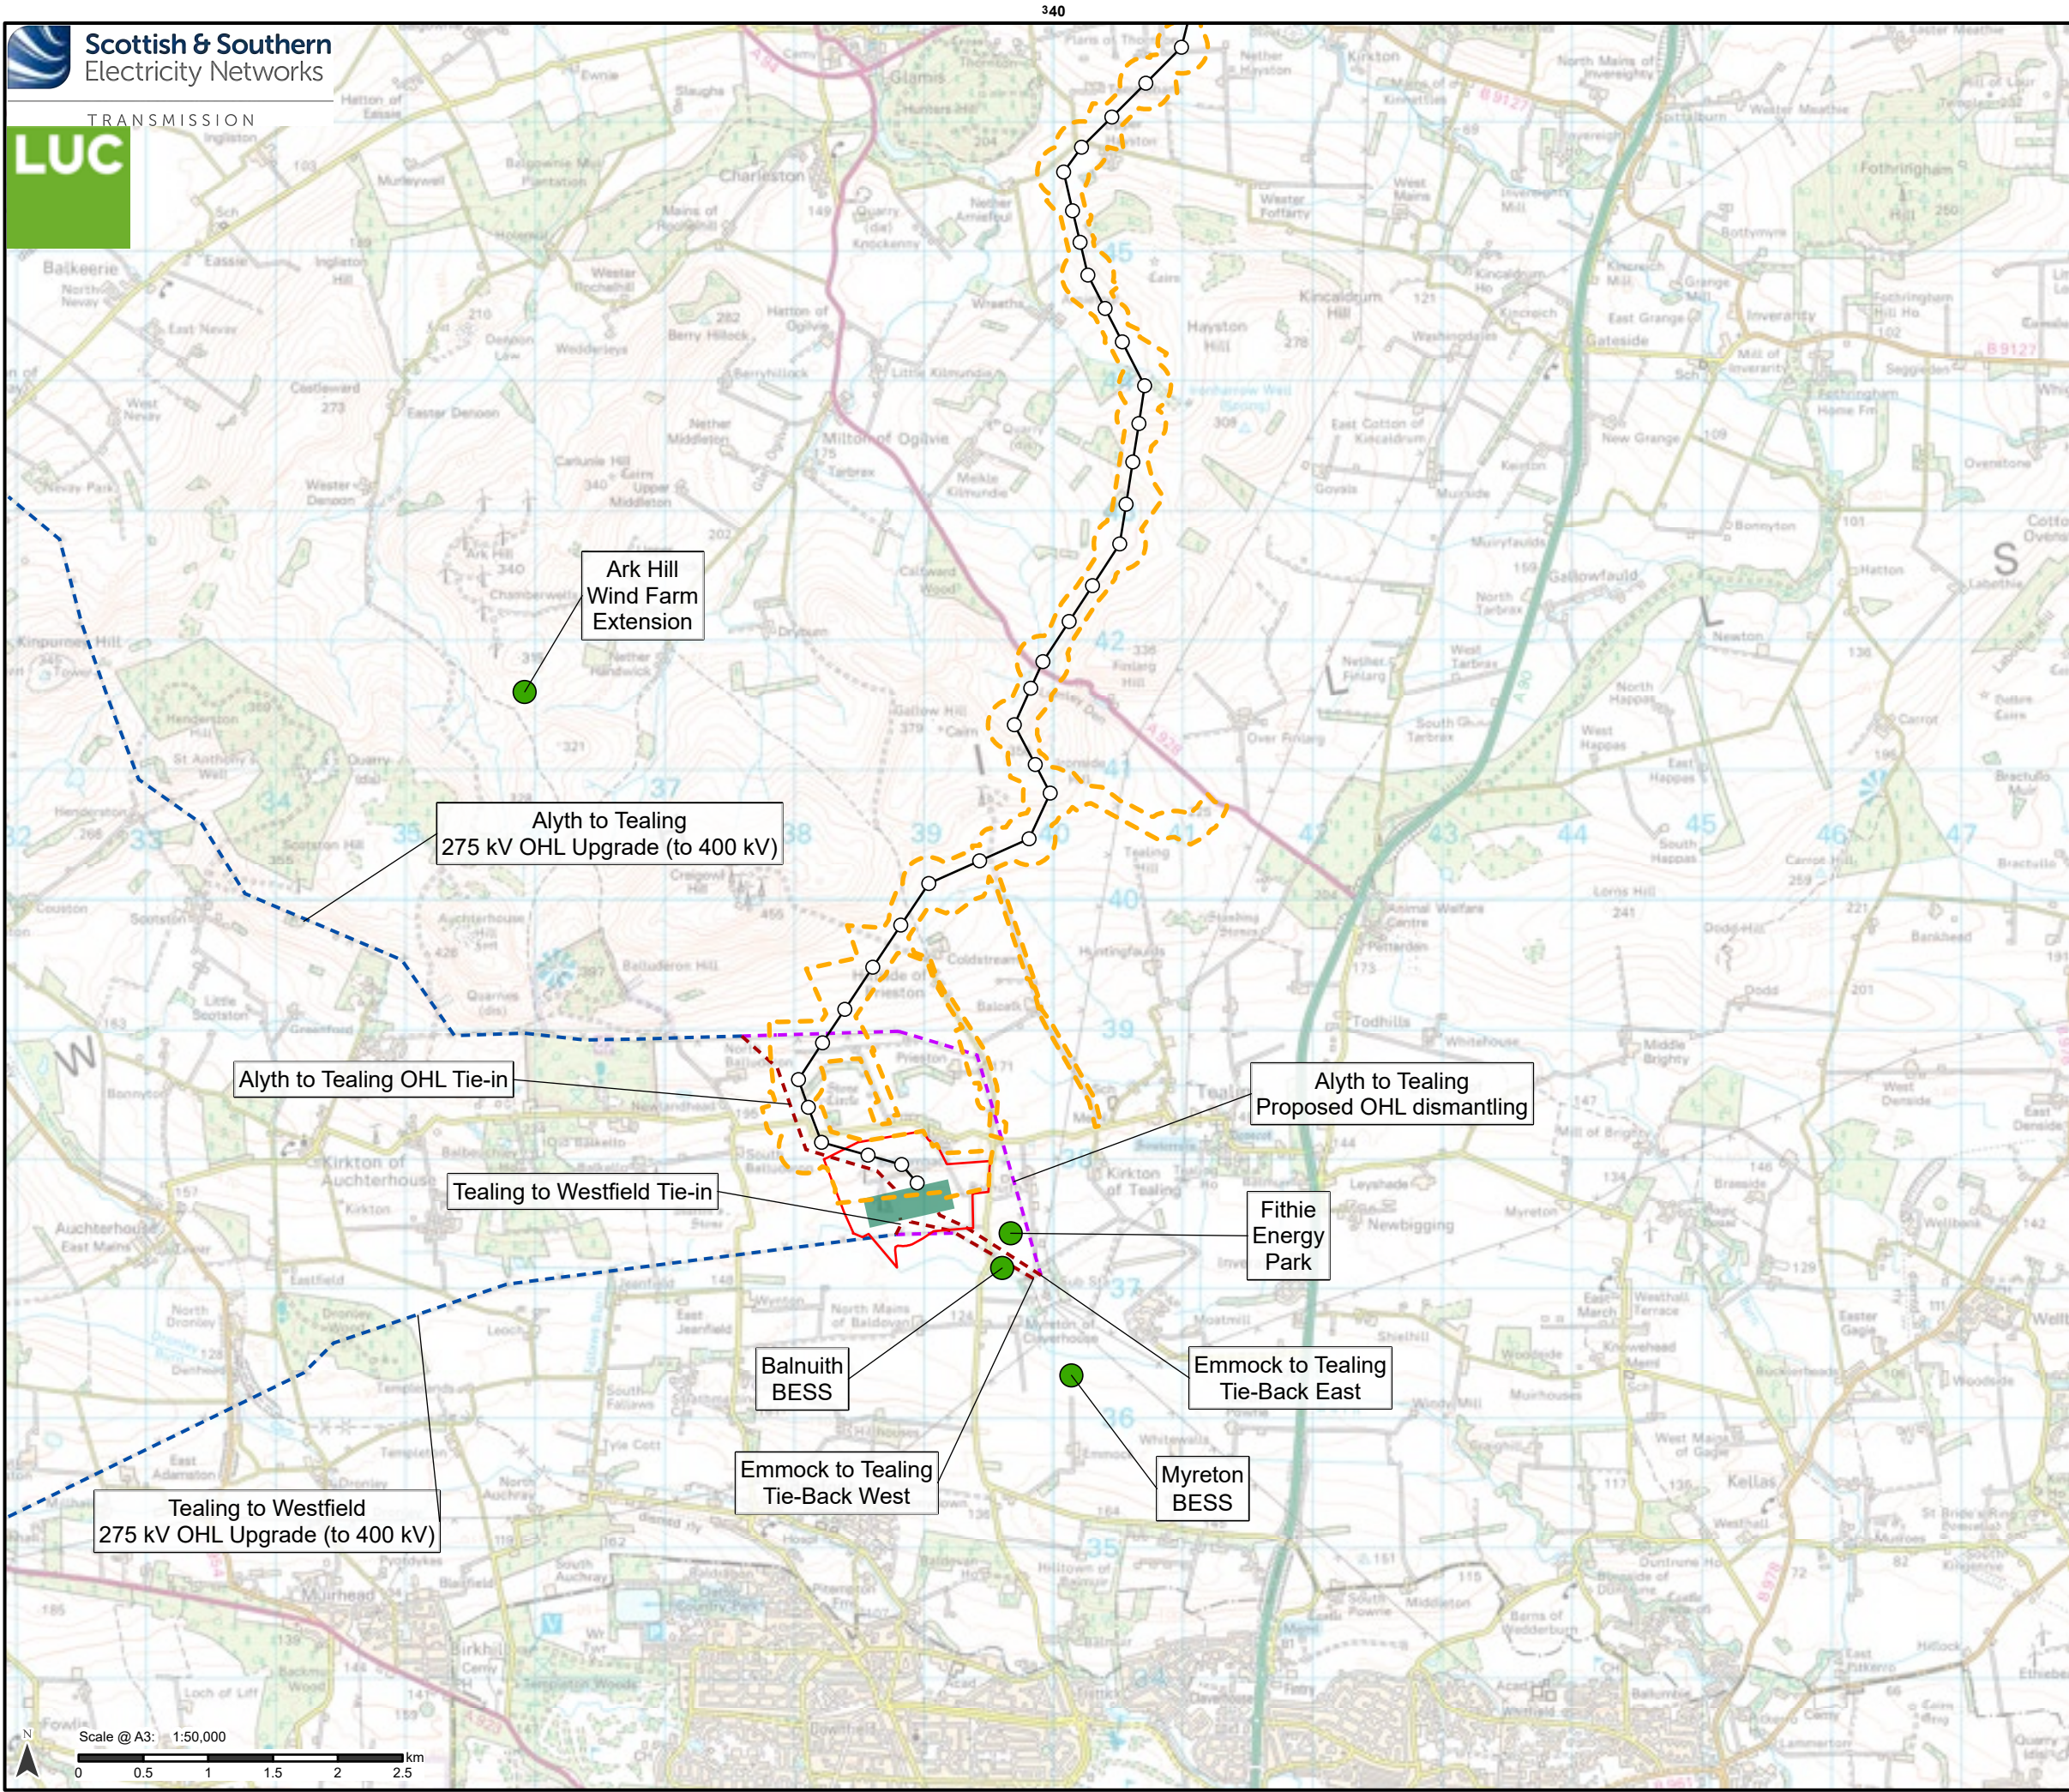

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Intra (Associated) Developments

- Emmock 400 kV substation planning boundary (24/00699/FULN)
- Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/FULN)

Inter Developments

- Other third party cumulative development indicative location
- Alyth to Tealing and Tealing to Westfield 275 kV OHL Upgrade (to 400 kV)


Emmock and Tealing OHL Tie-ins and Tie-backs ECU00005204

- Existing Alyth to Tealing and existing Tealing to Westfield OHL Dismantling
- Emmock and Tealing OHL Tie-ins and Tie-backs

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

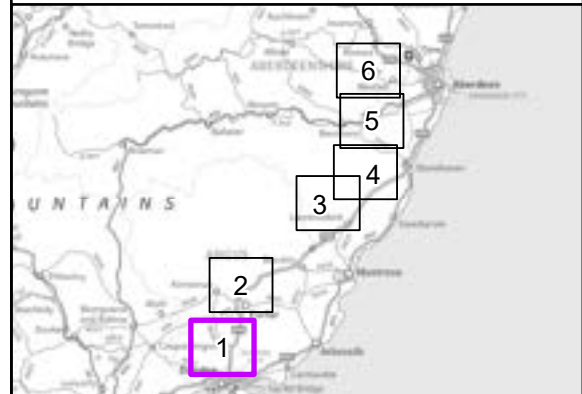


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Cumulative Developments
Drawn by:	MS
Date:	12/08/2025
Drawing:	5.1.1

760000m.N

750000m.N

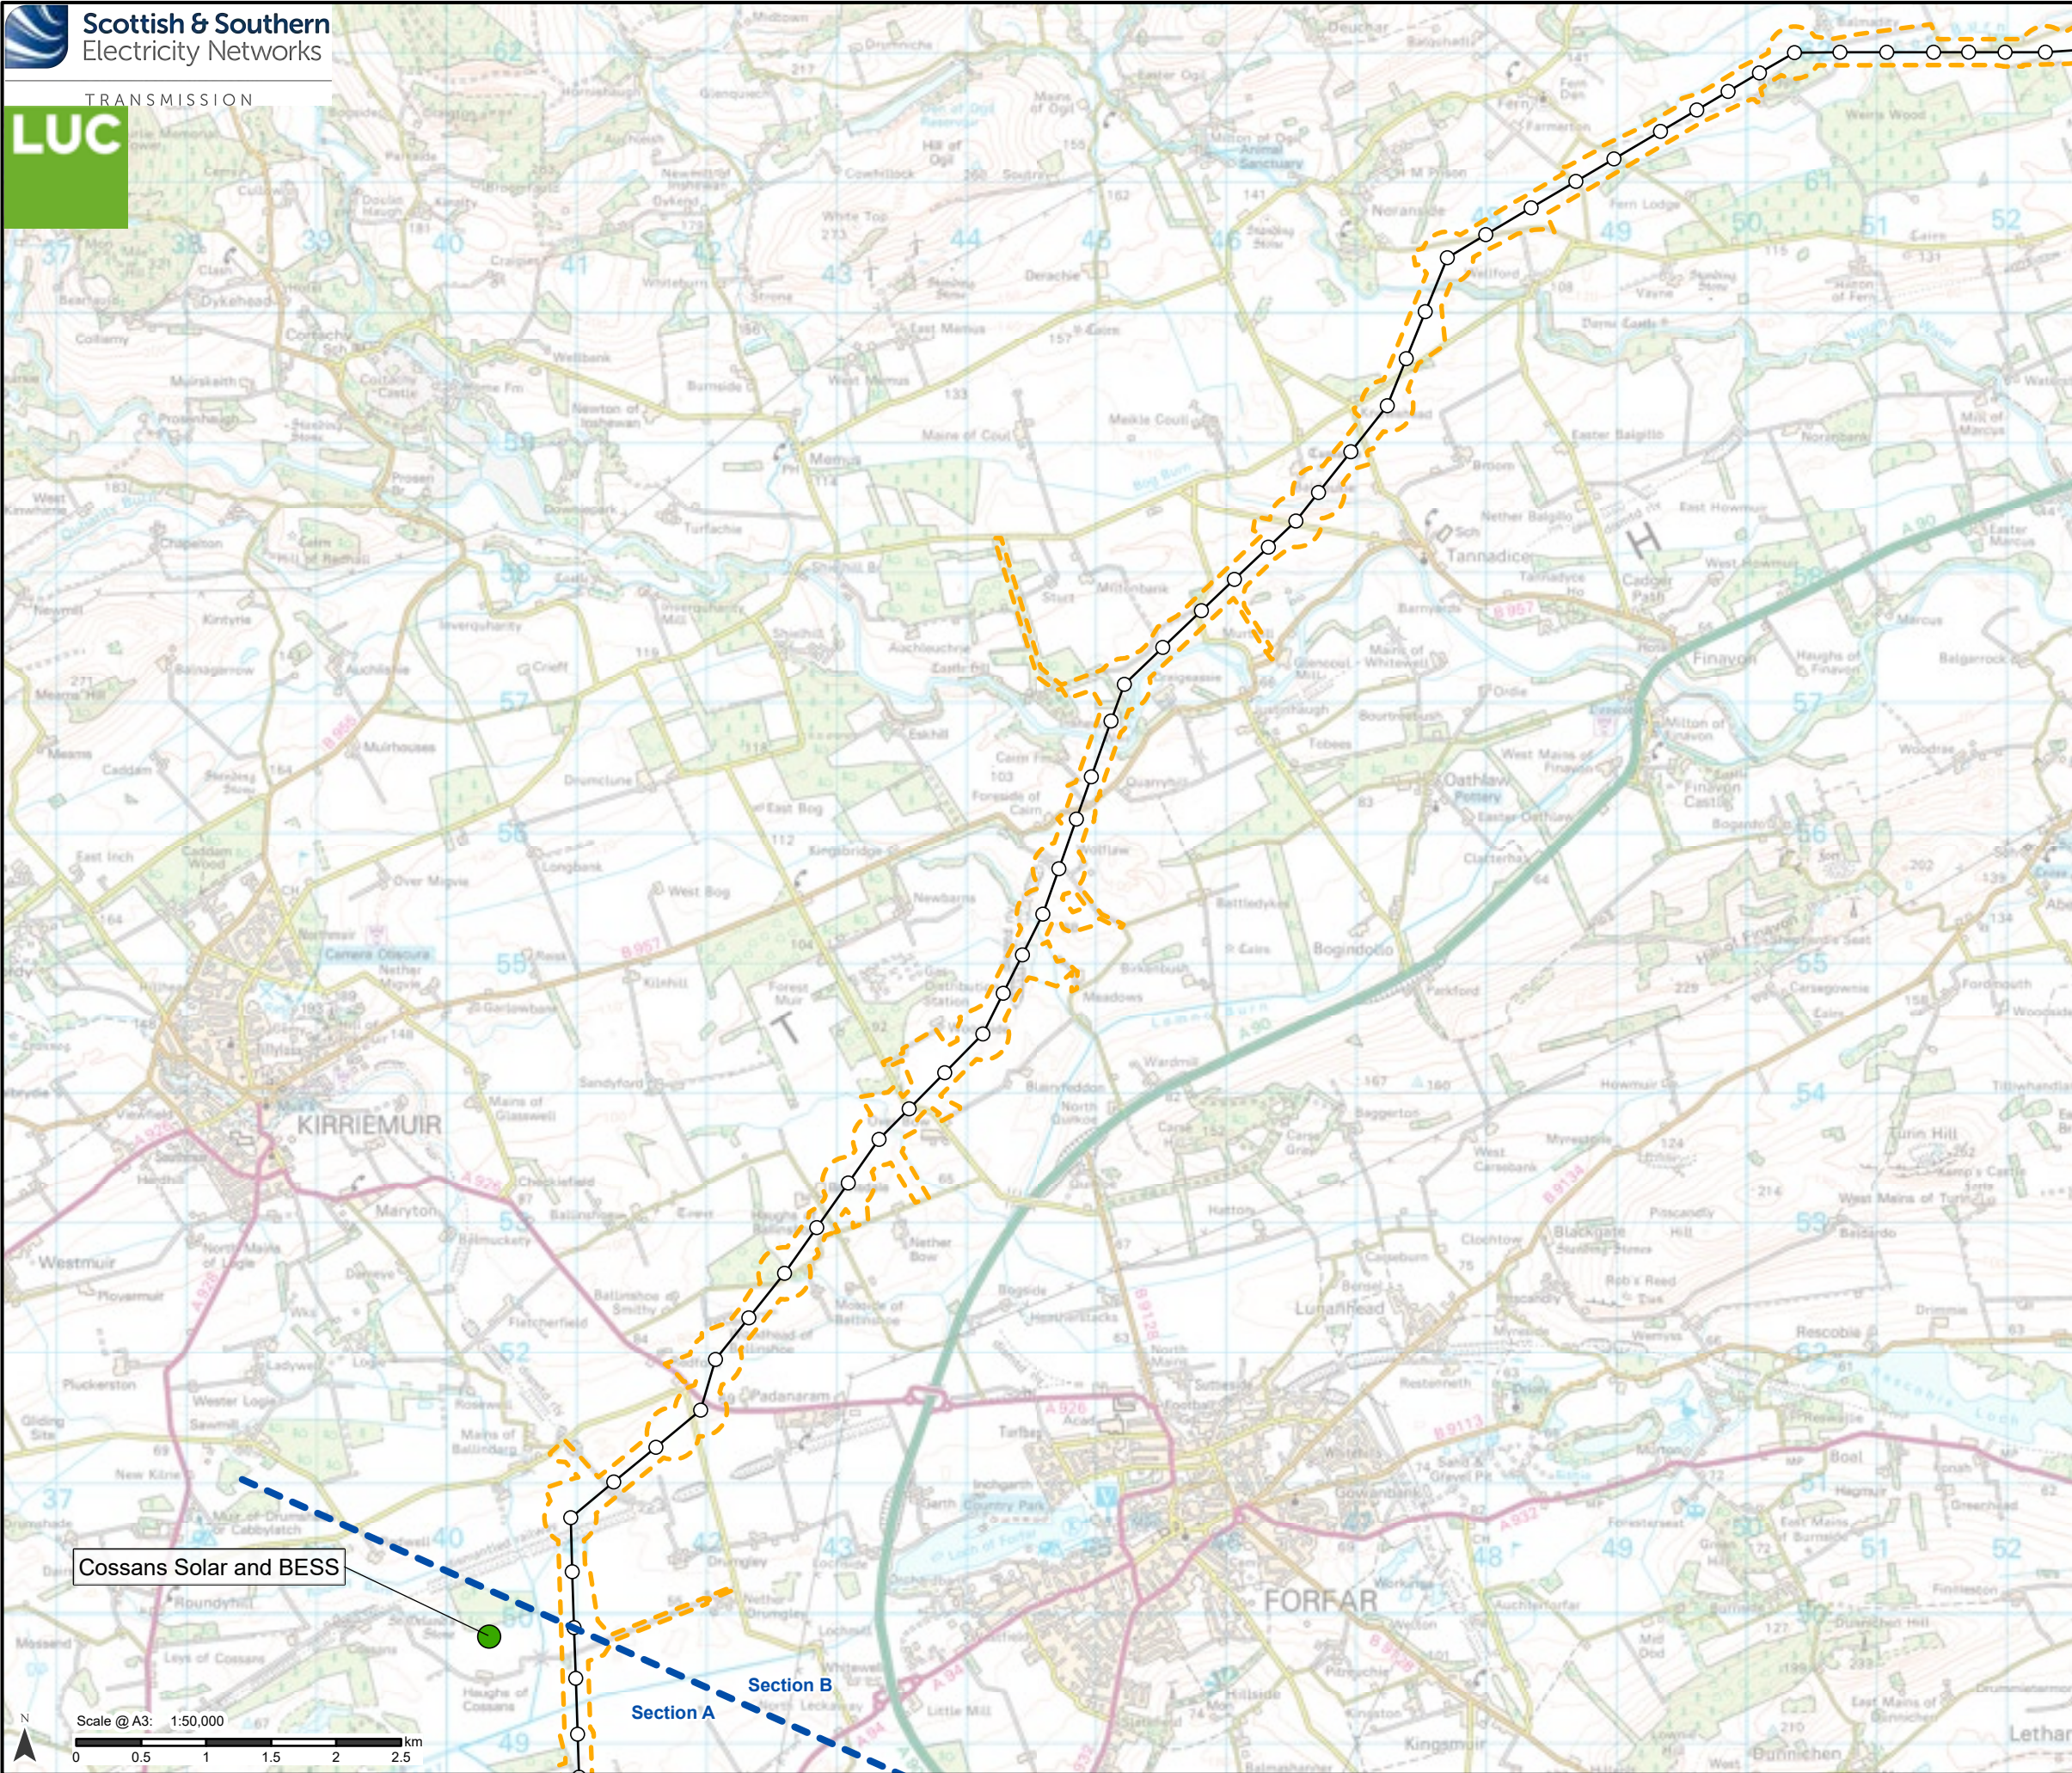

Proposed Development


- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Inter Developments

- Other third party cumulative development indicative location

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

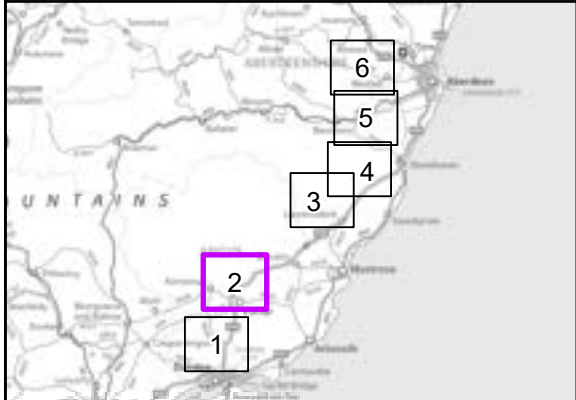


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Cumulative Developments

Drawn by: MS Date: 12/08/2025
Drawing: 5.1.2

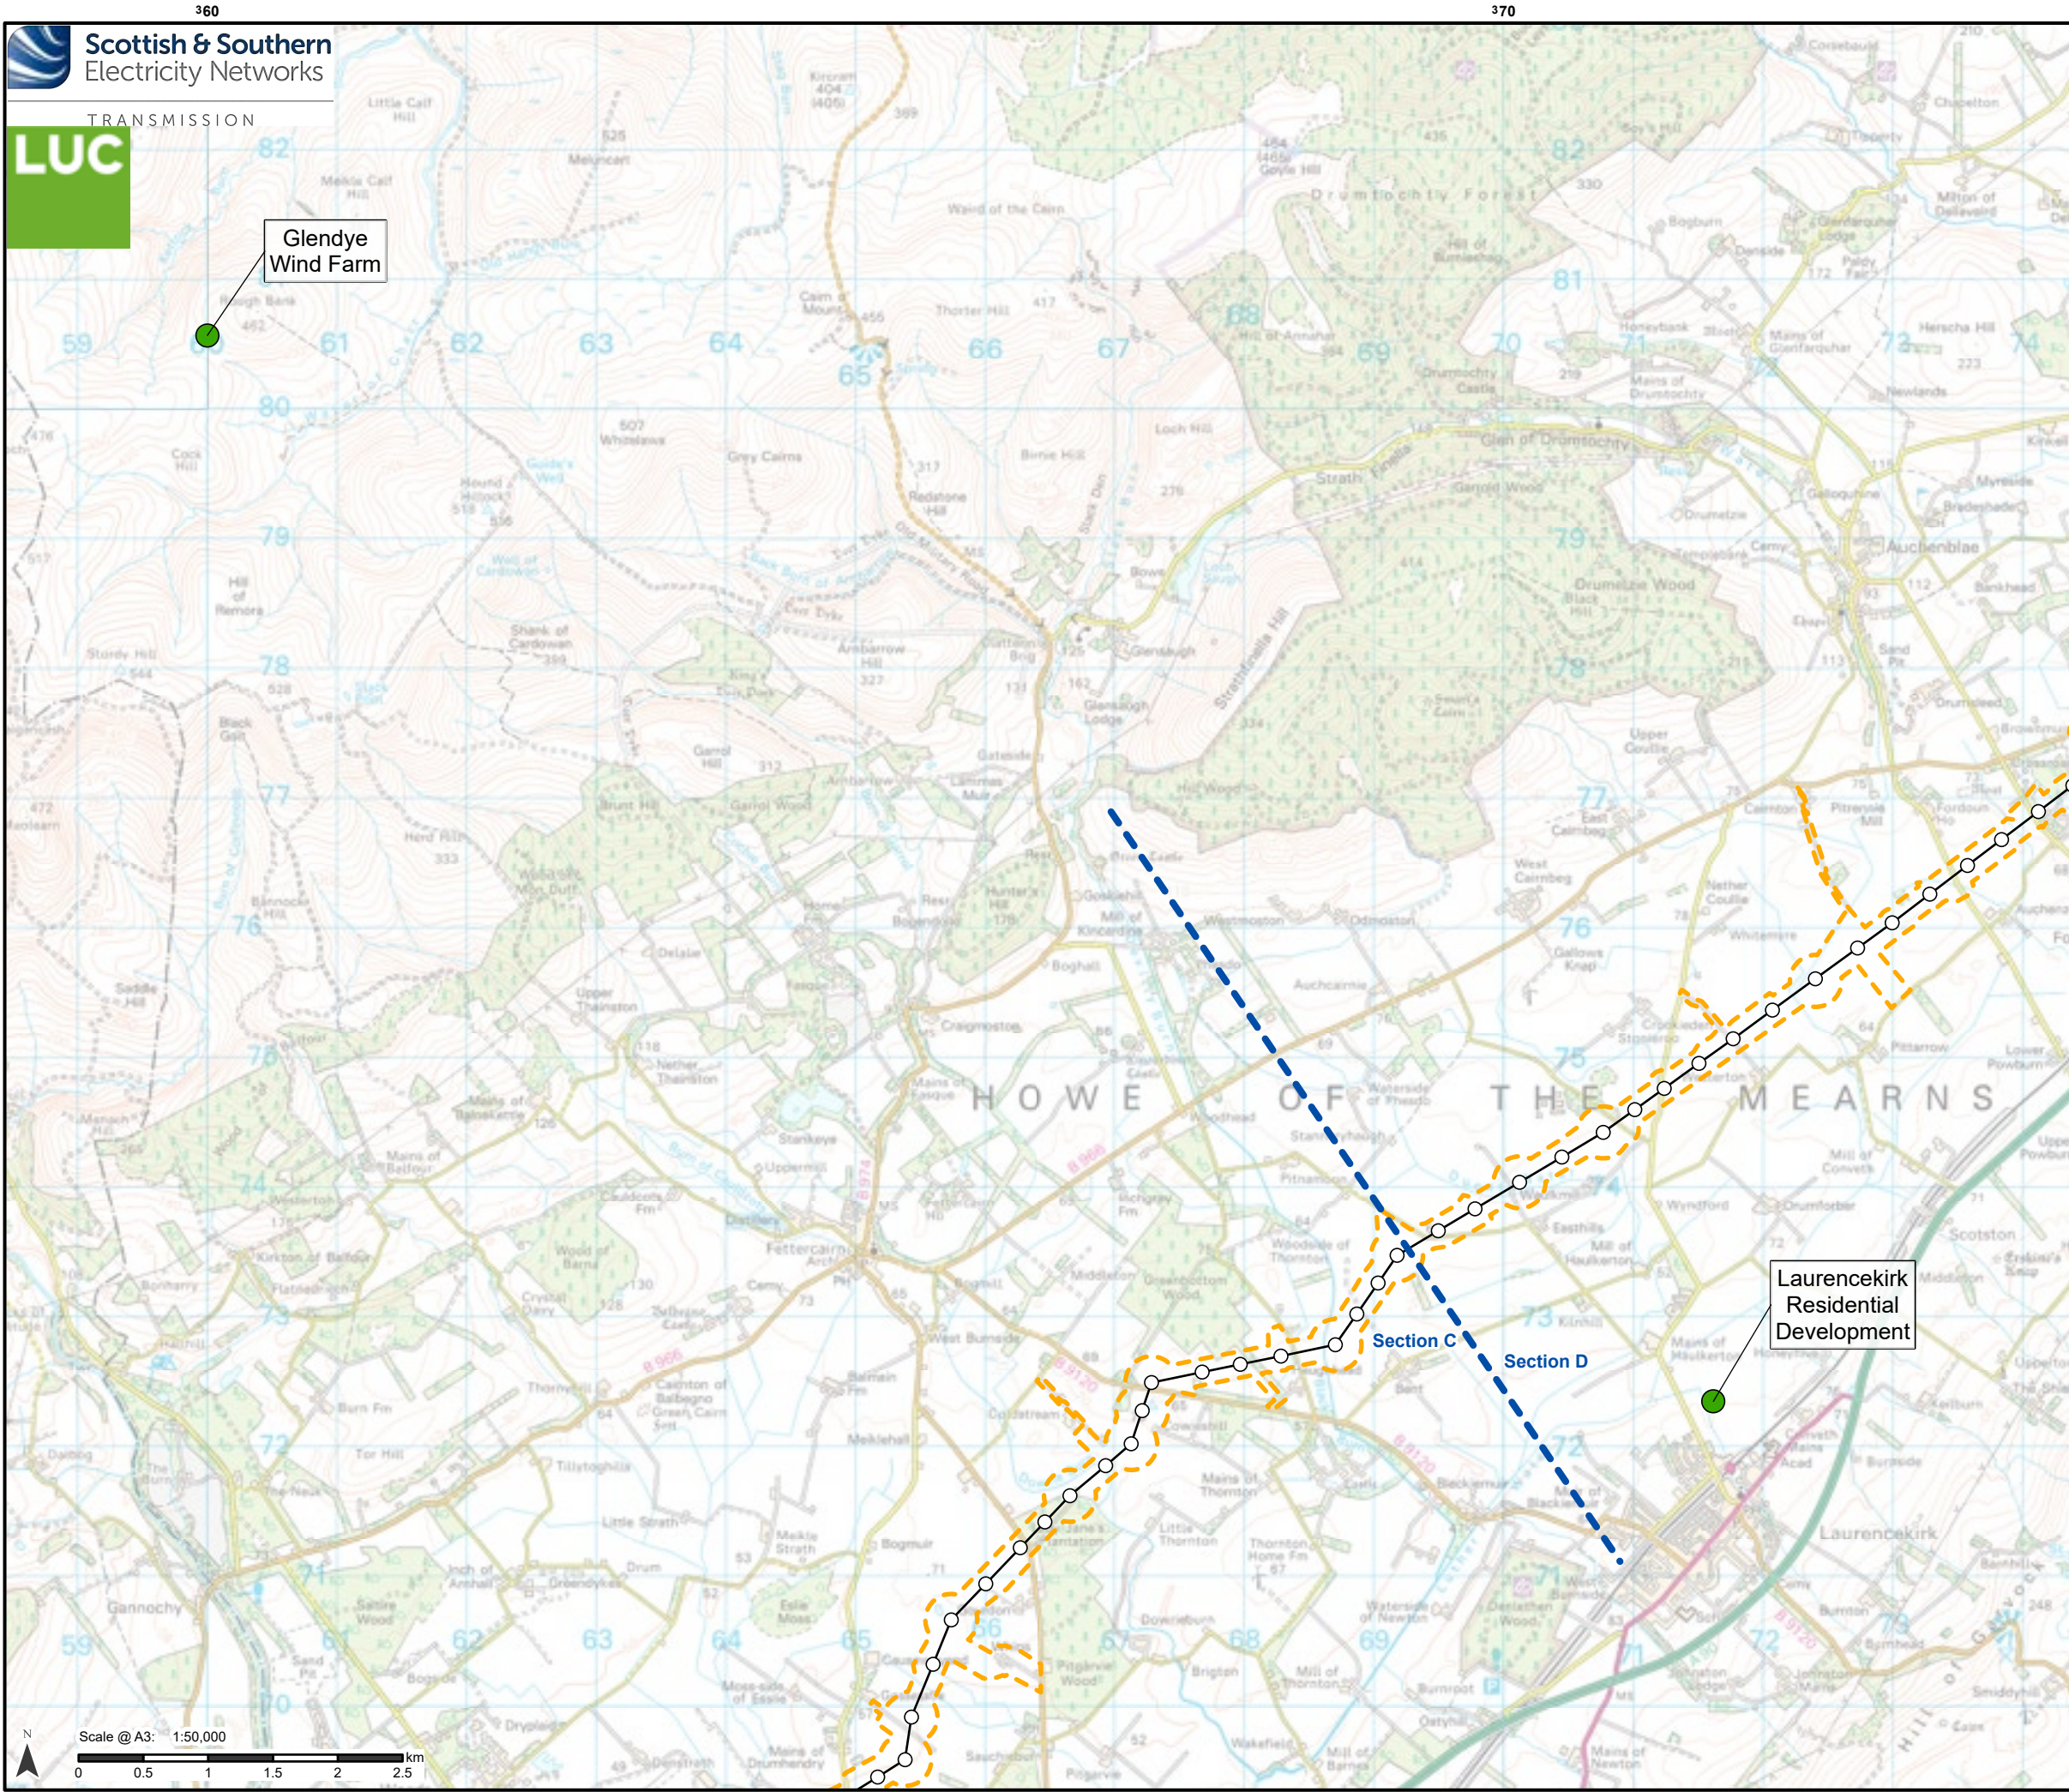

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Inter Developments

- Other third party cumulative development indicative location

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Cumulative Developments

Drawn by: MS Date: 12/08/2025

Drawing: 5.1.3

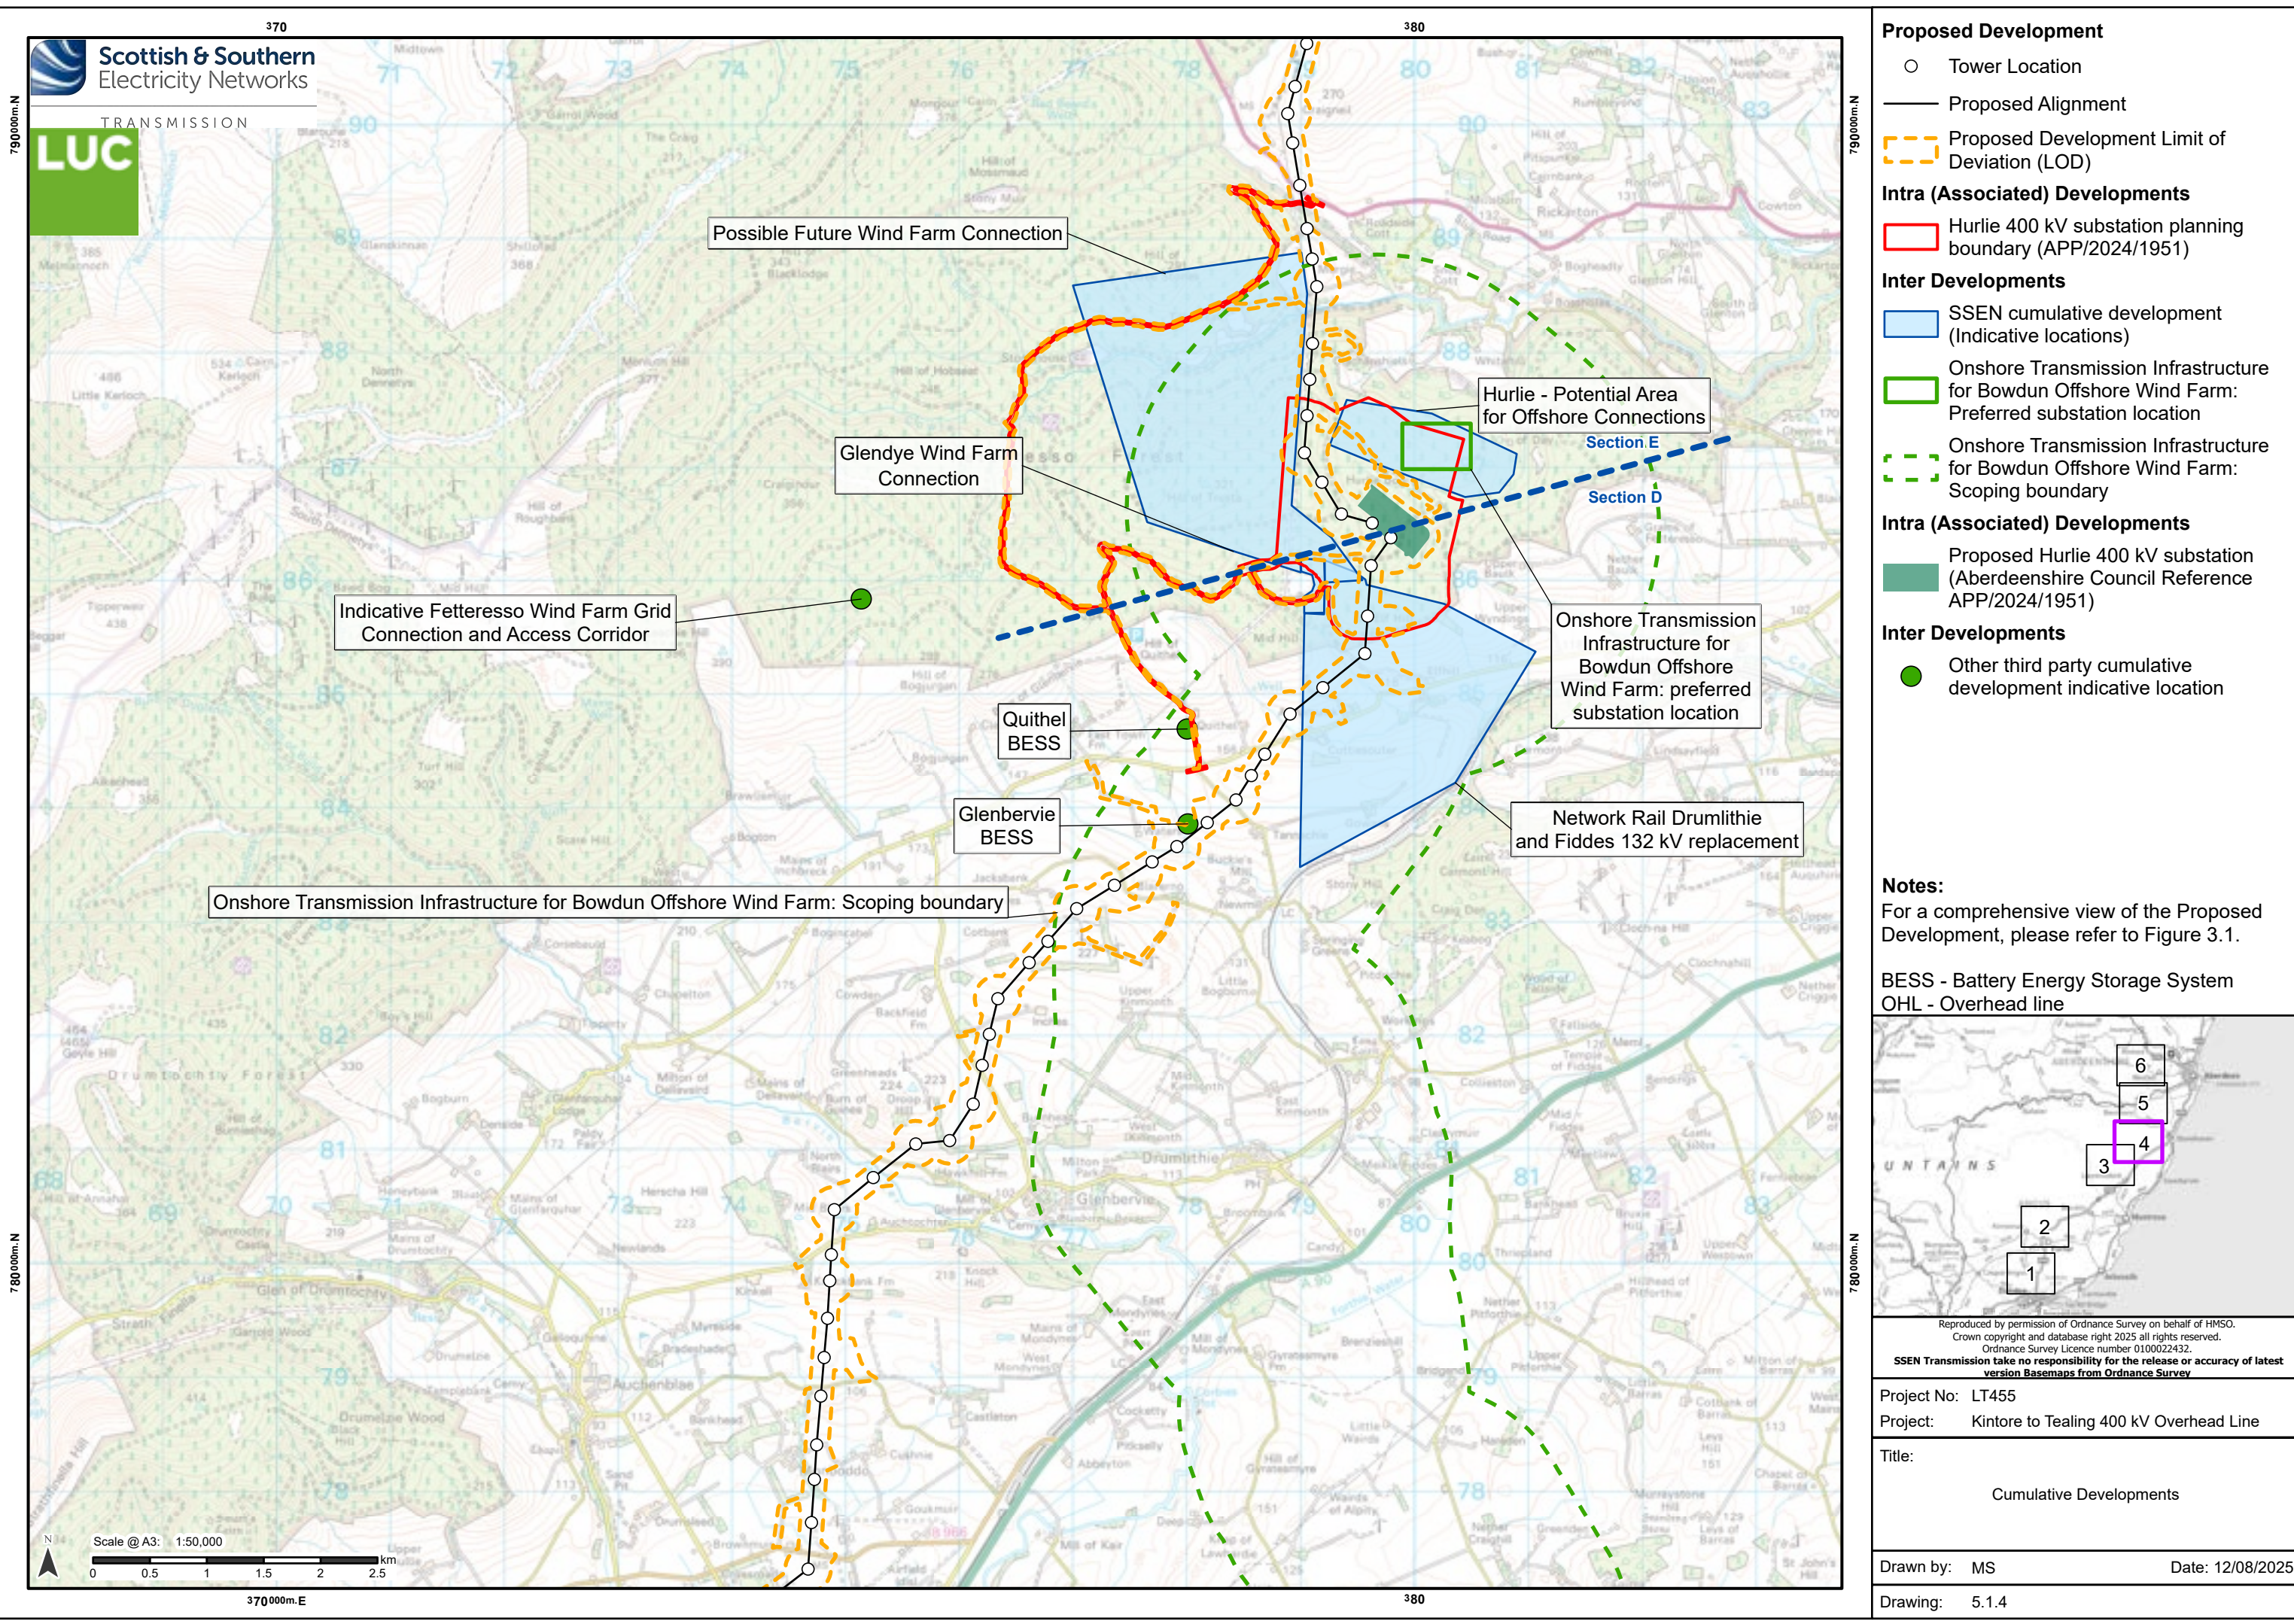

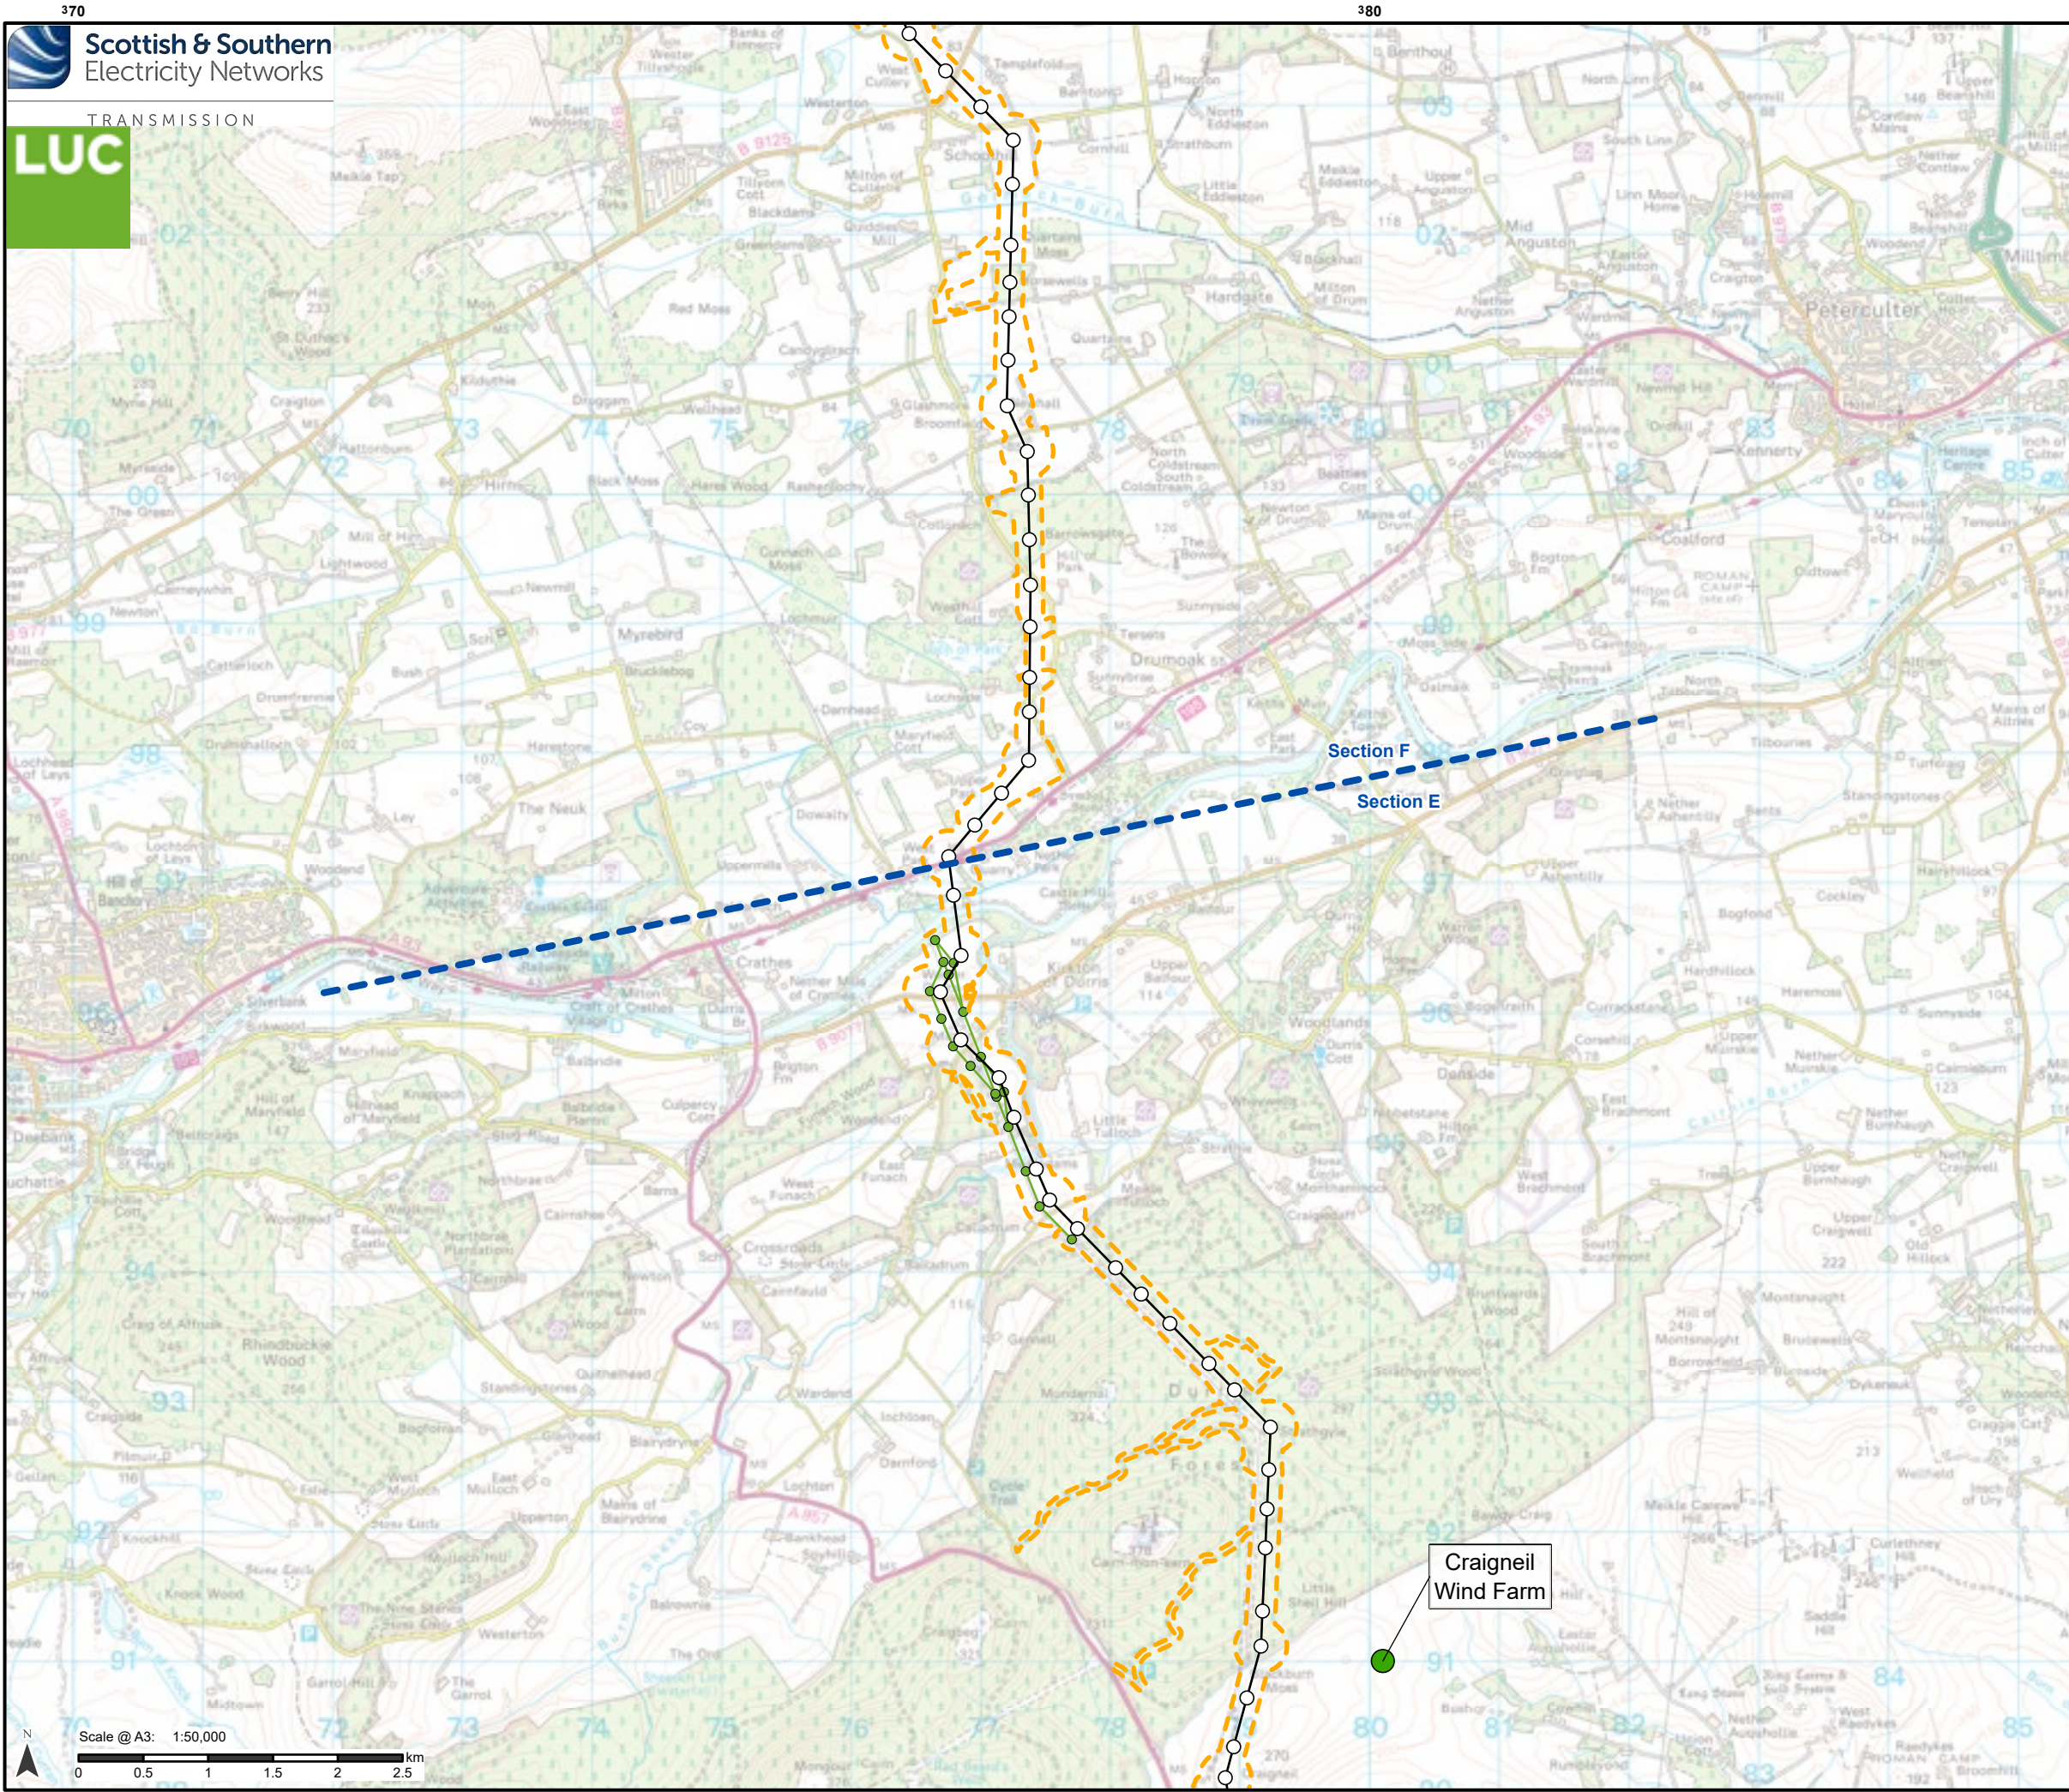

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Inter Developments

- Other third party cumulative development indicative location

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Cumulative Developments

Drawn by: MS

Date: 12/08/2025

Drawing: 5.1.5

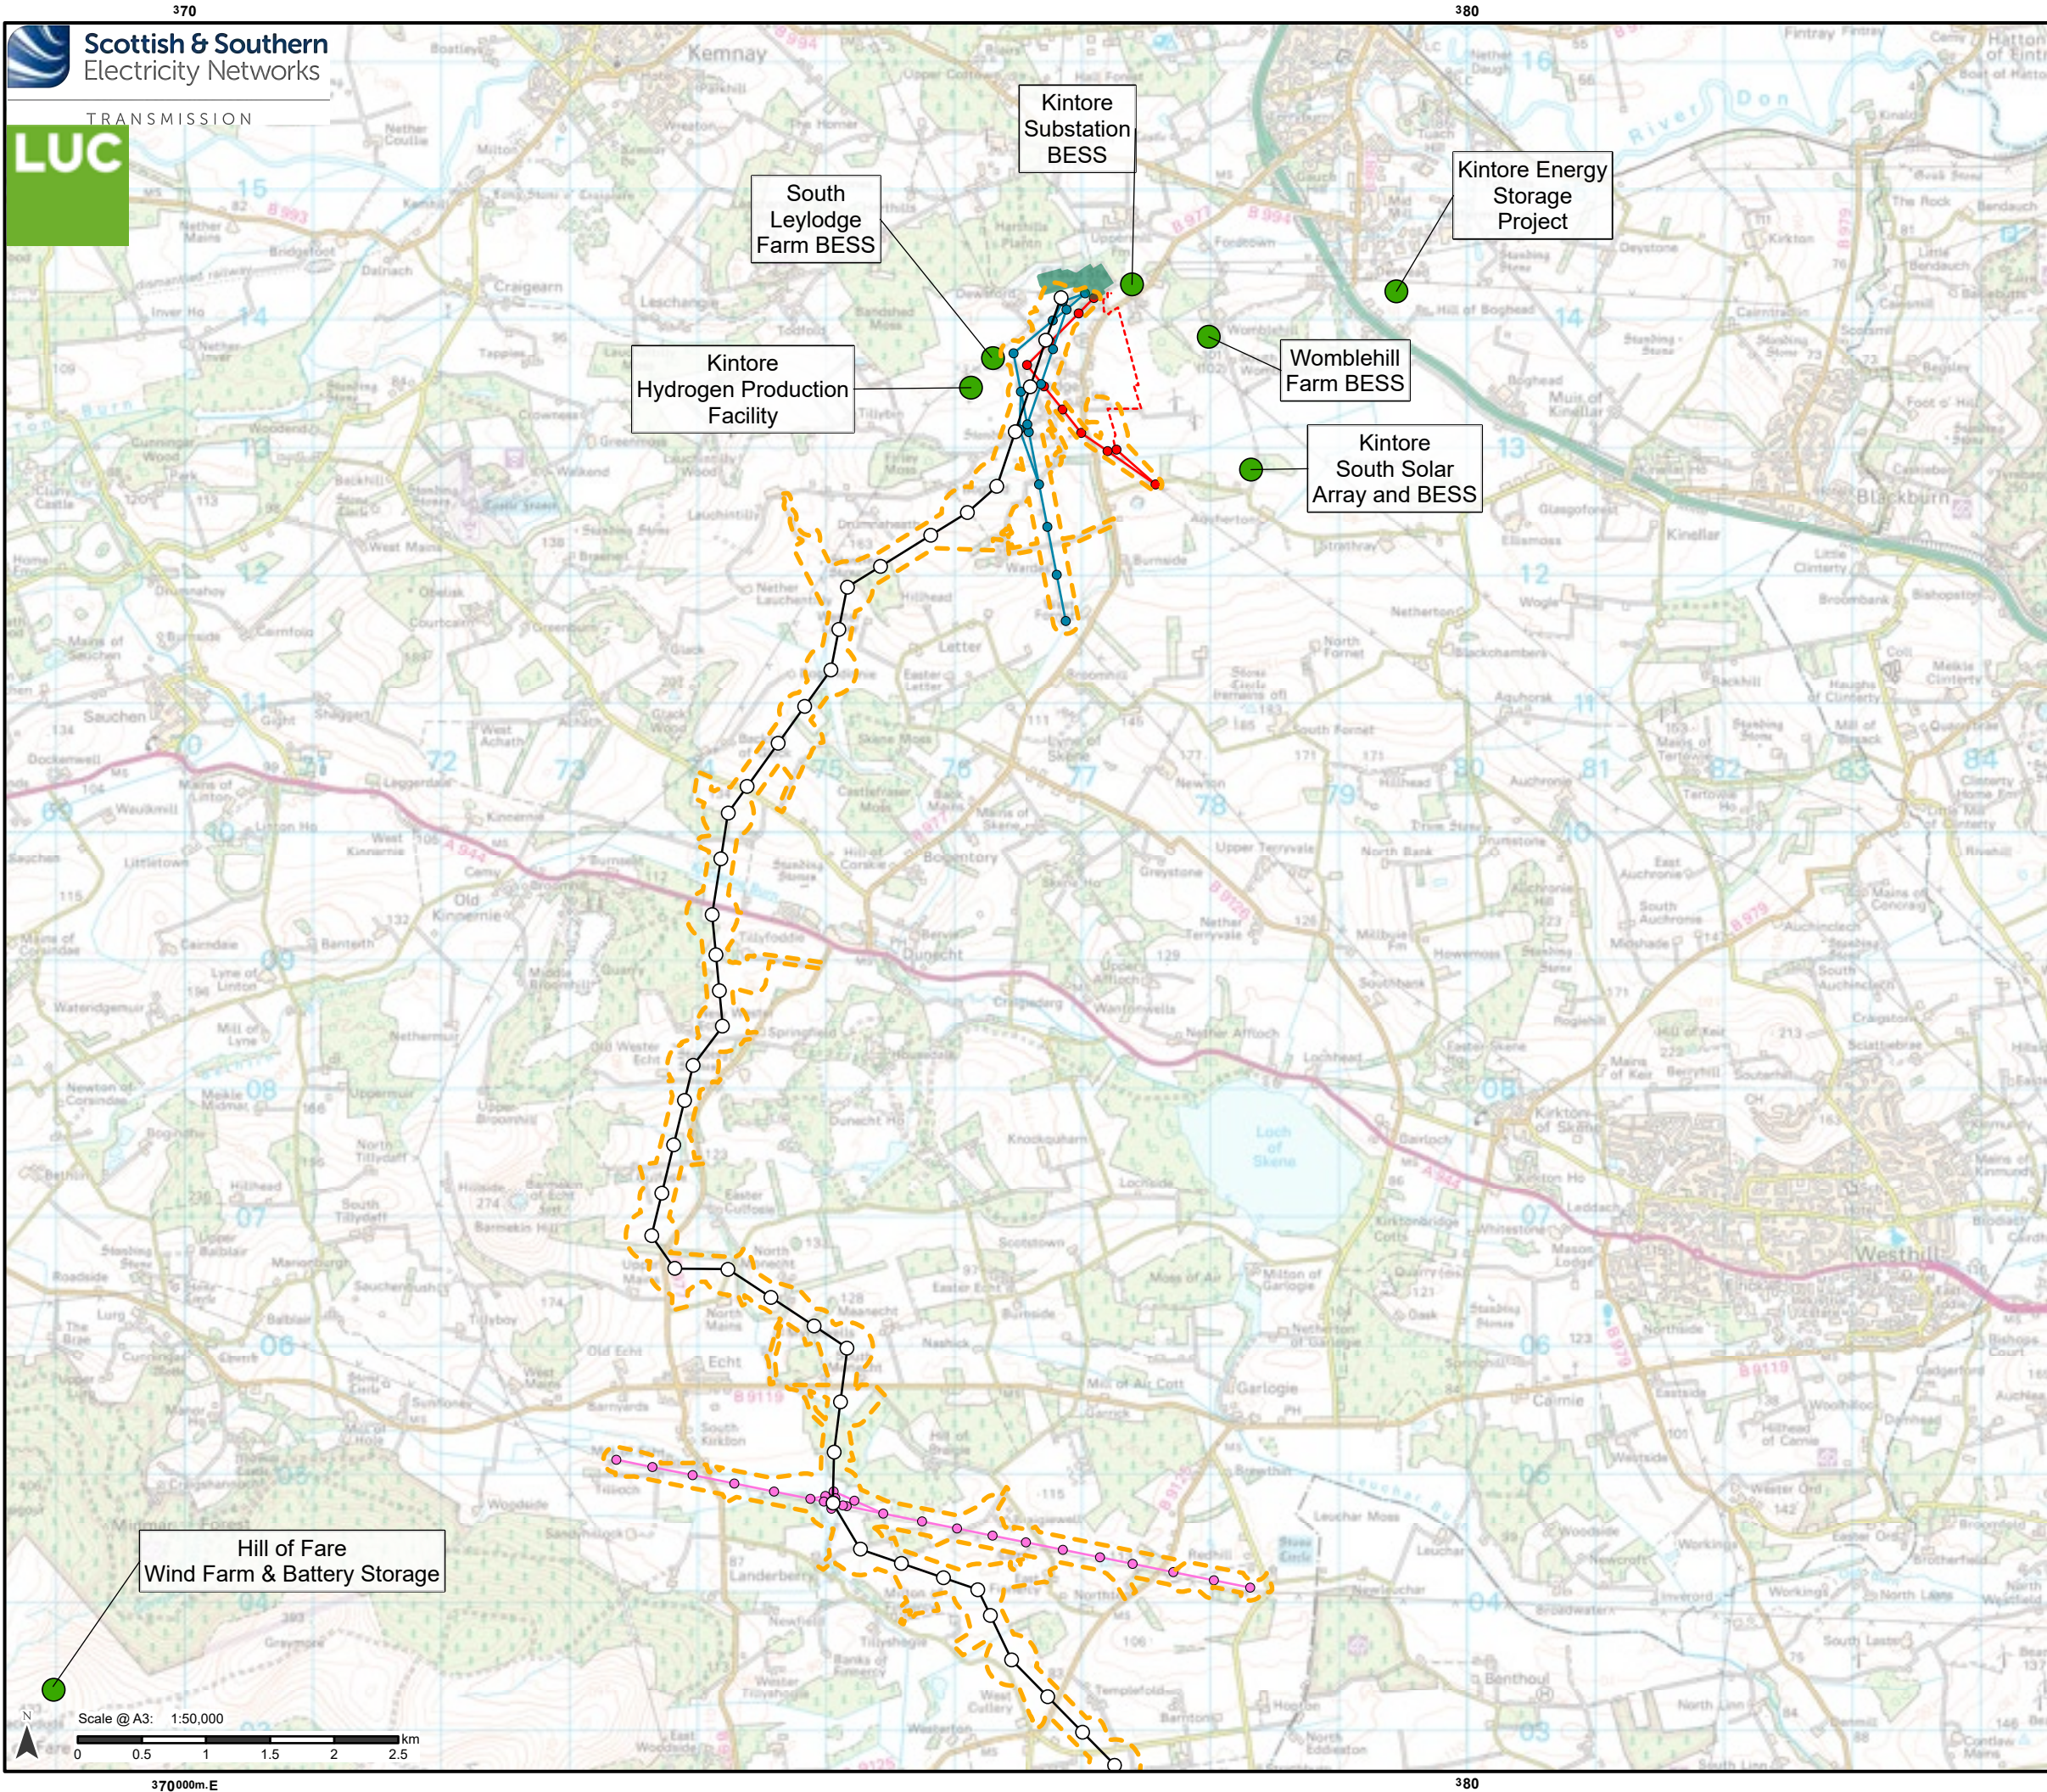

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Craigiebuckler - Tarland 132 kV Overhead Line Crossing

- Tower Location
- OHL

Additional development included in Section 37 application: Kintore - Craigiebuckler 132 kV

- Tower Location
- OHL

Existing/Other Infrastructure

- Existing Kintore Substation

Inter Developments

- Other third party cumulative development indicative location

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

BESS - Battery Energy Storage System
OHL - Overhead line

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Cumulative Developments

Drawn by: MS

Date: 12/08/2025

Drawing: 5.1.6