



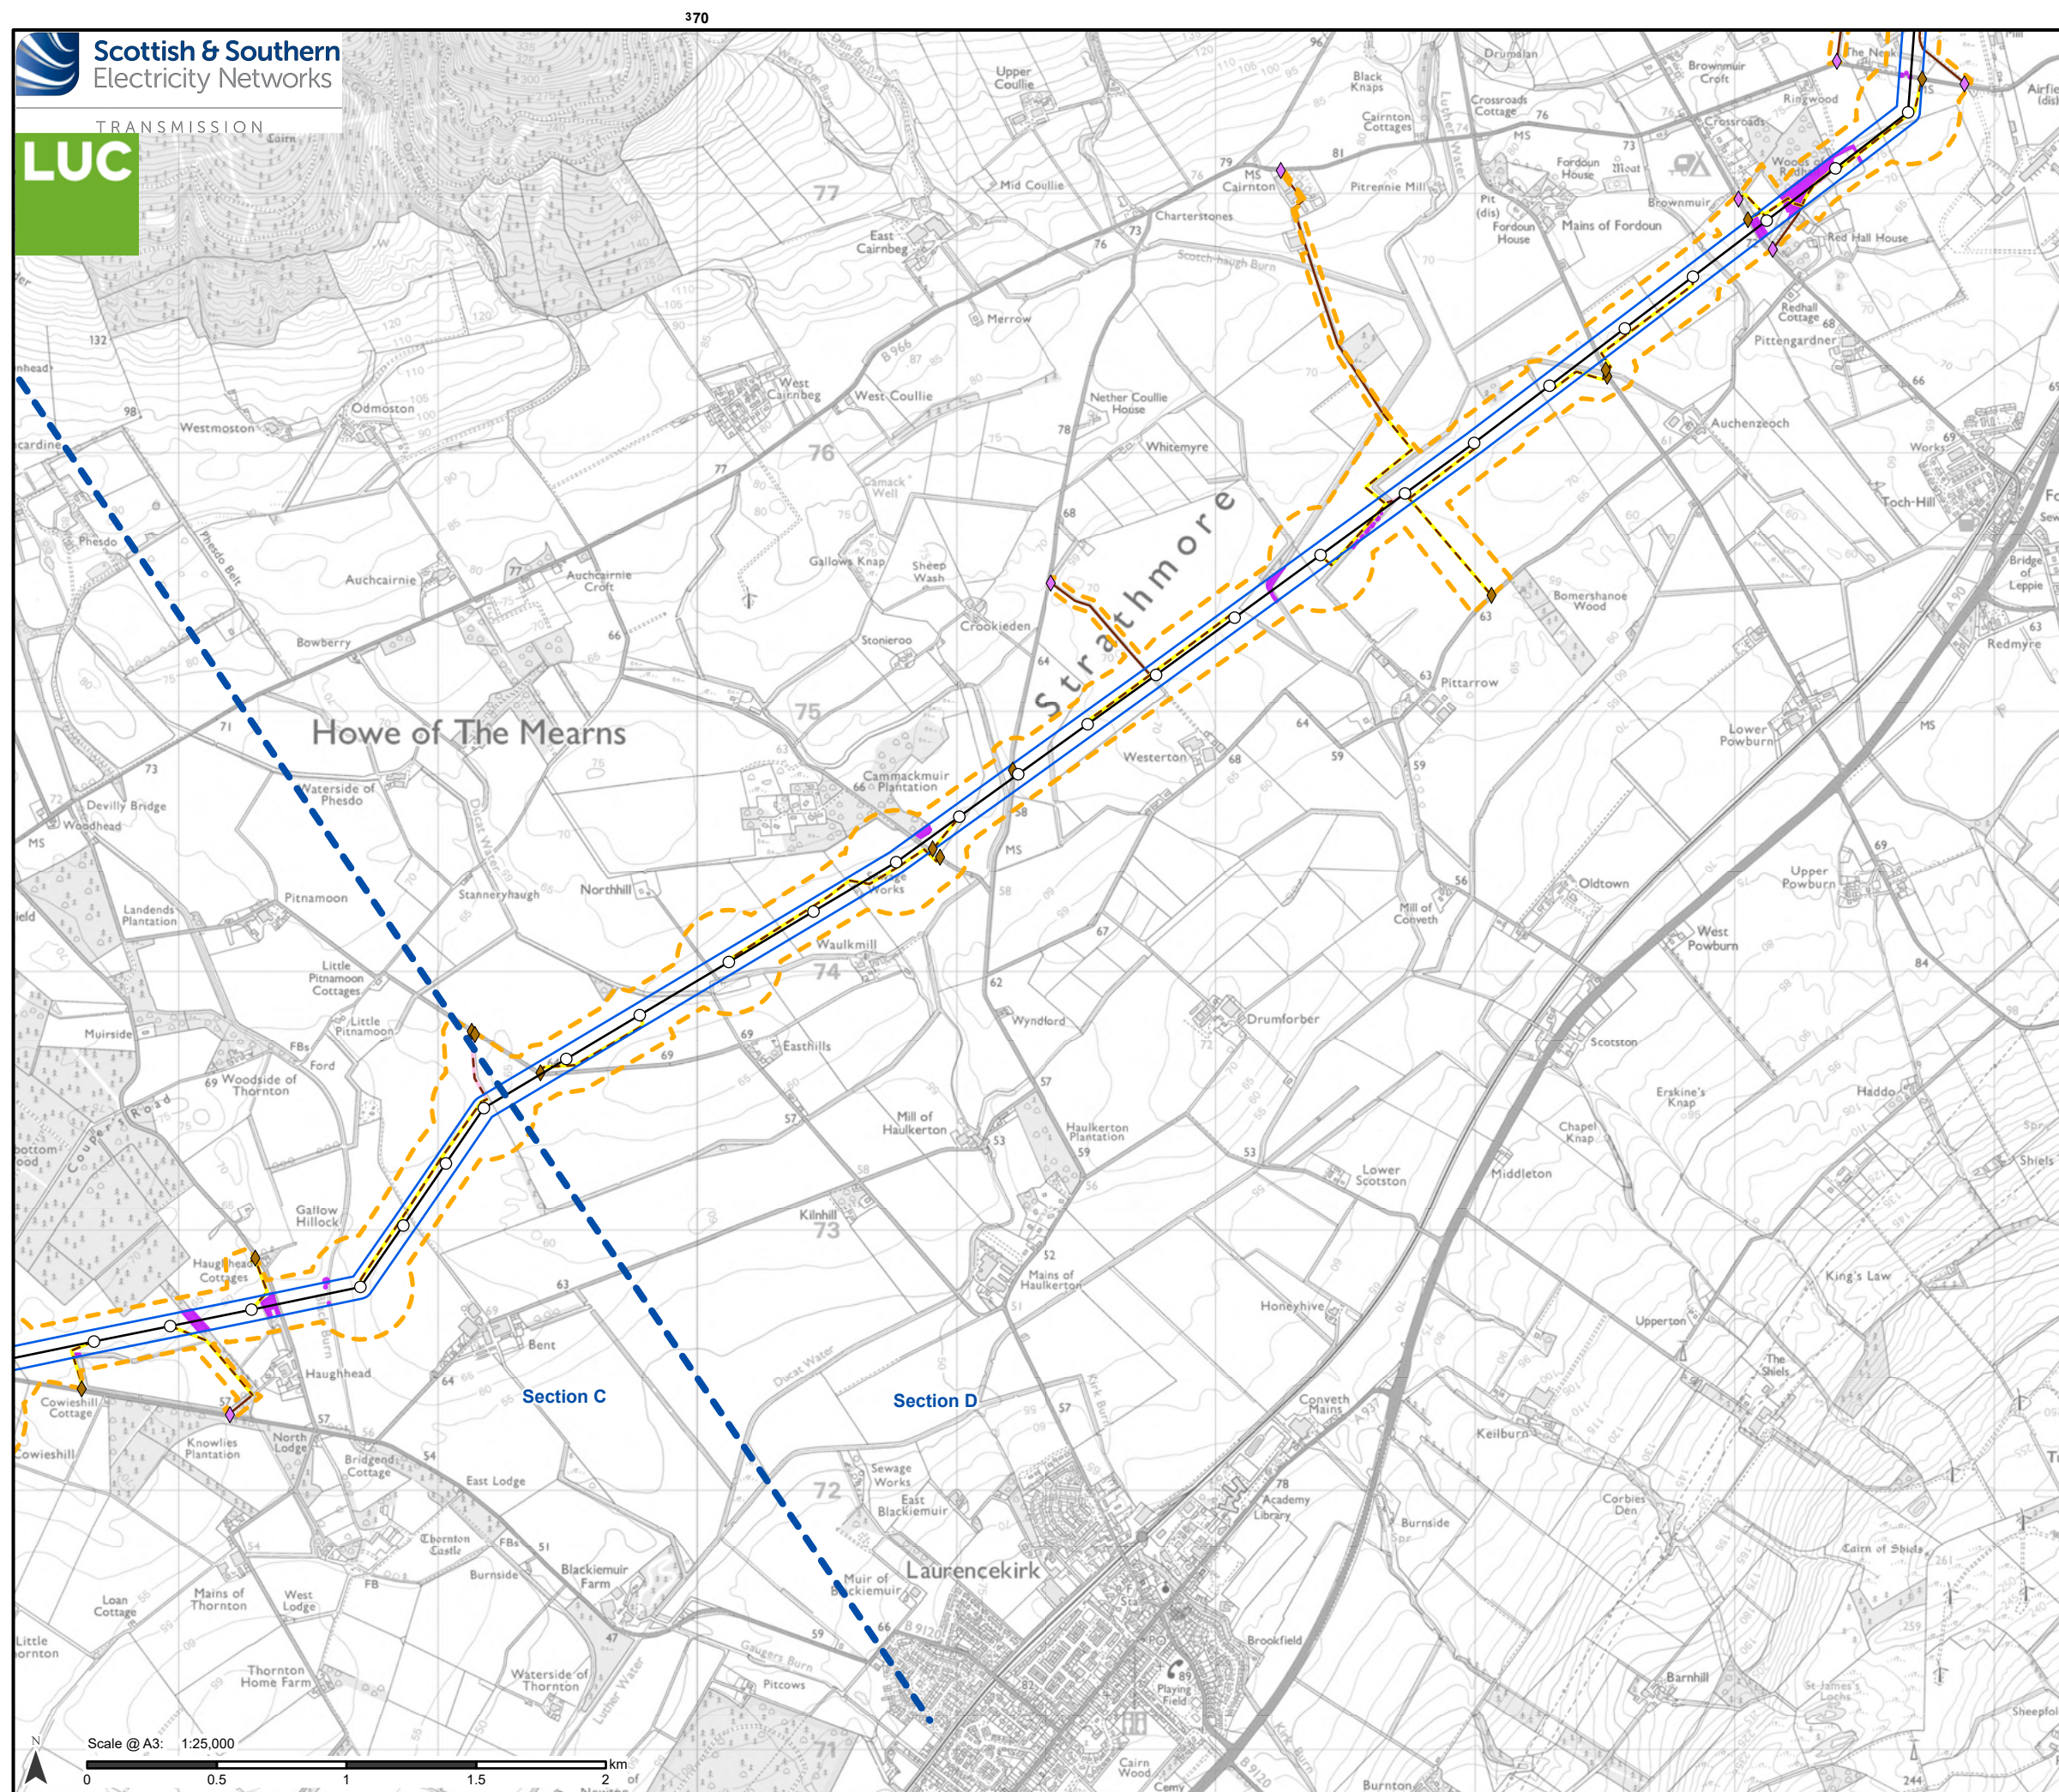

- Proposed Development**
- Tower Location
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Operational Corridor
 - Section boundary
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Baseline age structure**
- Mature


Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

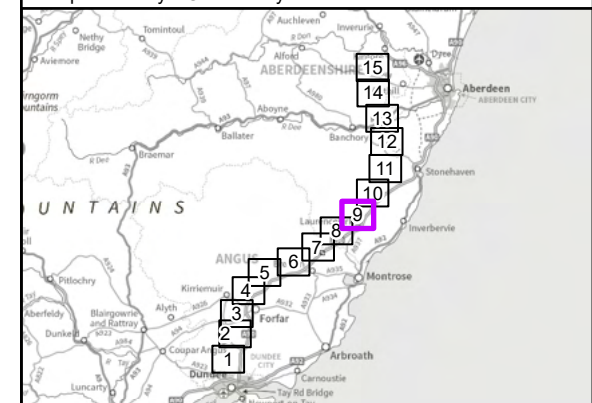

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Age Class Structure
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.2.9

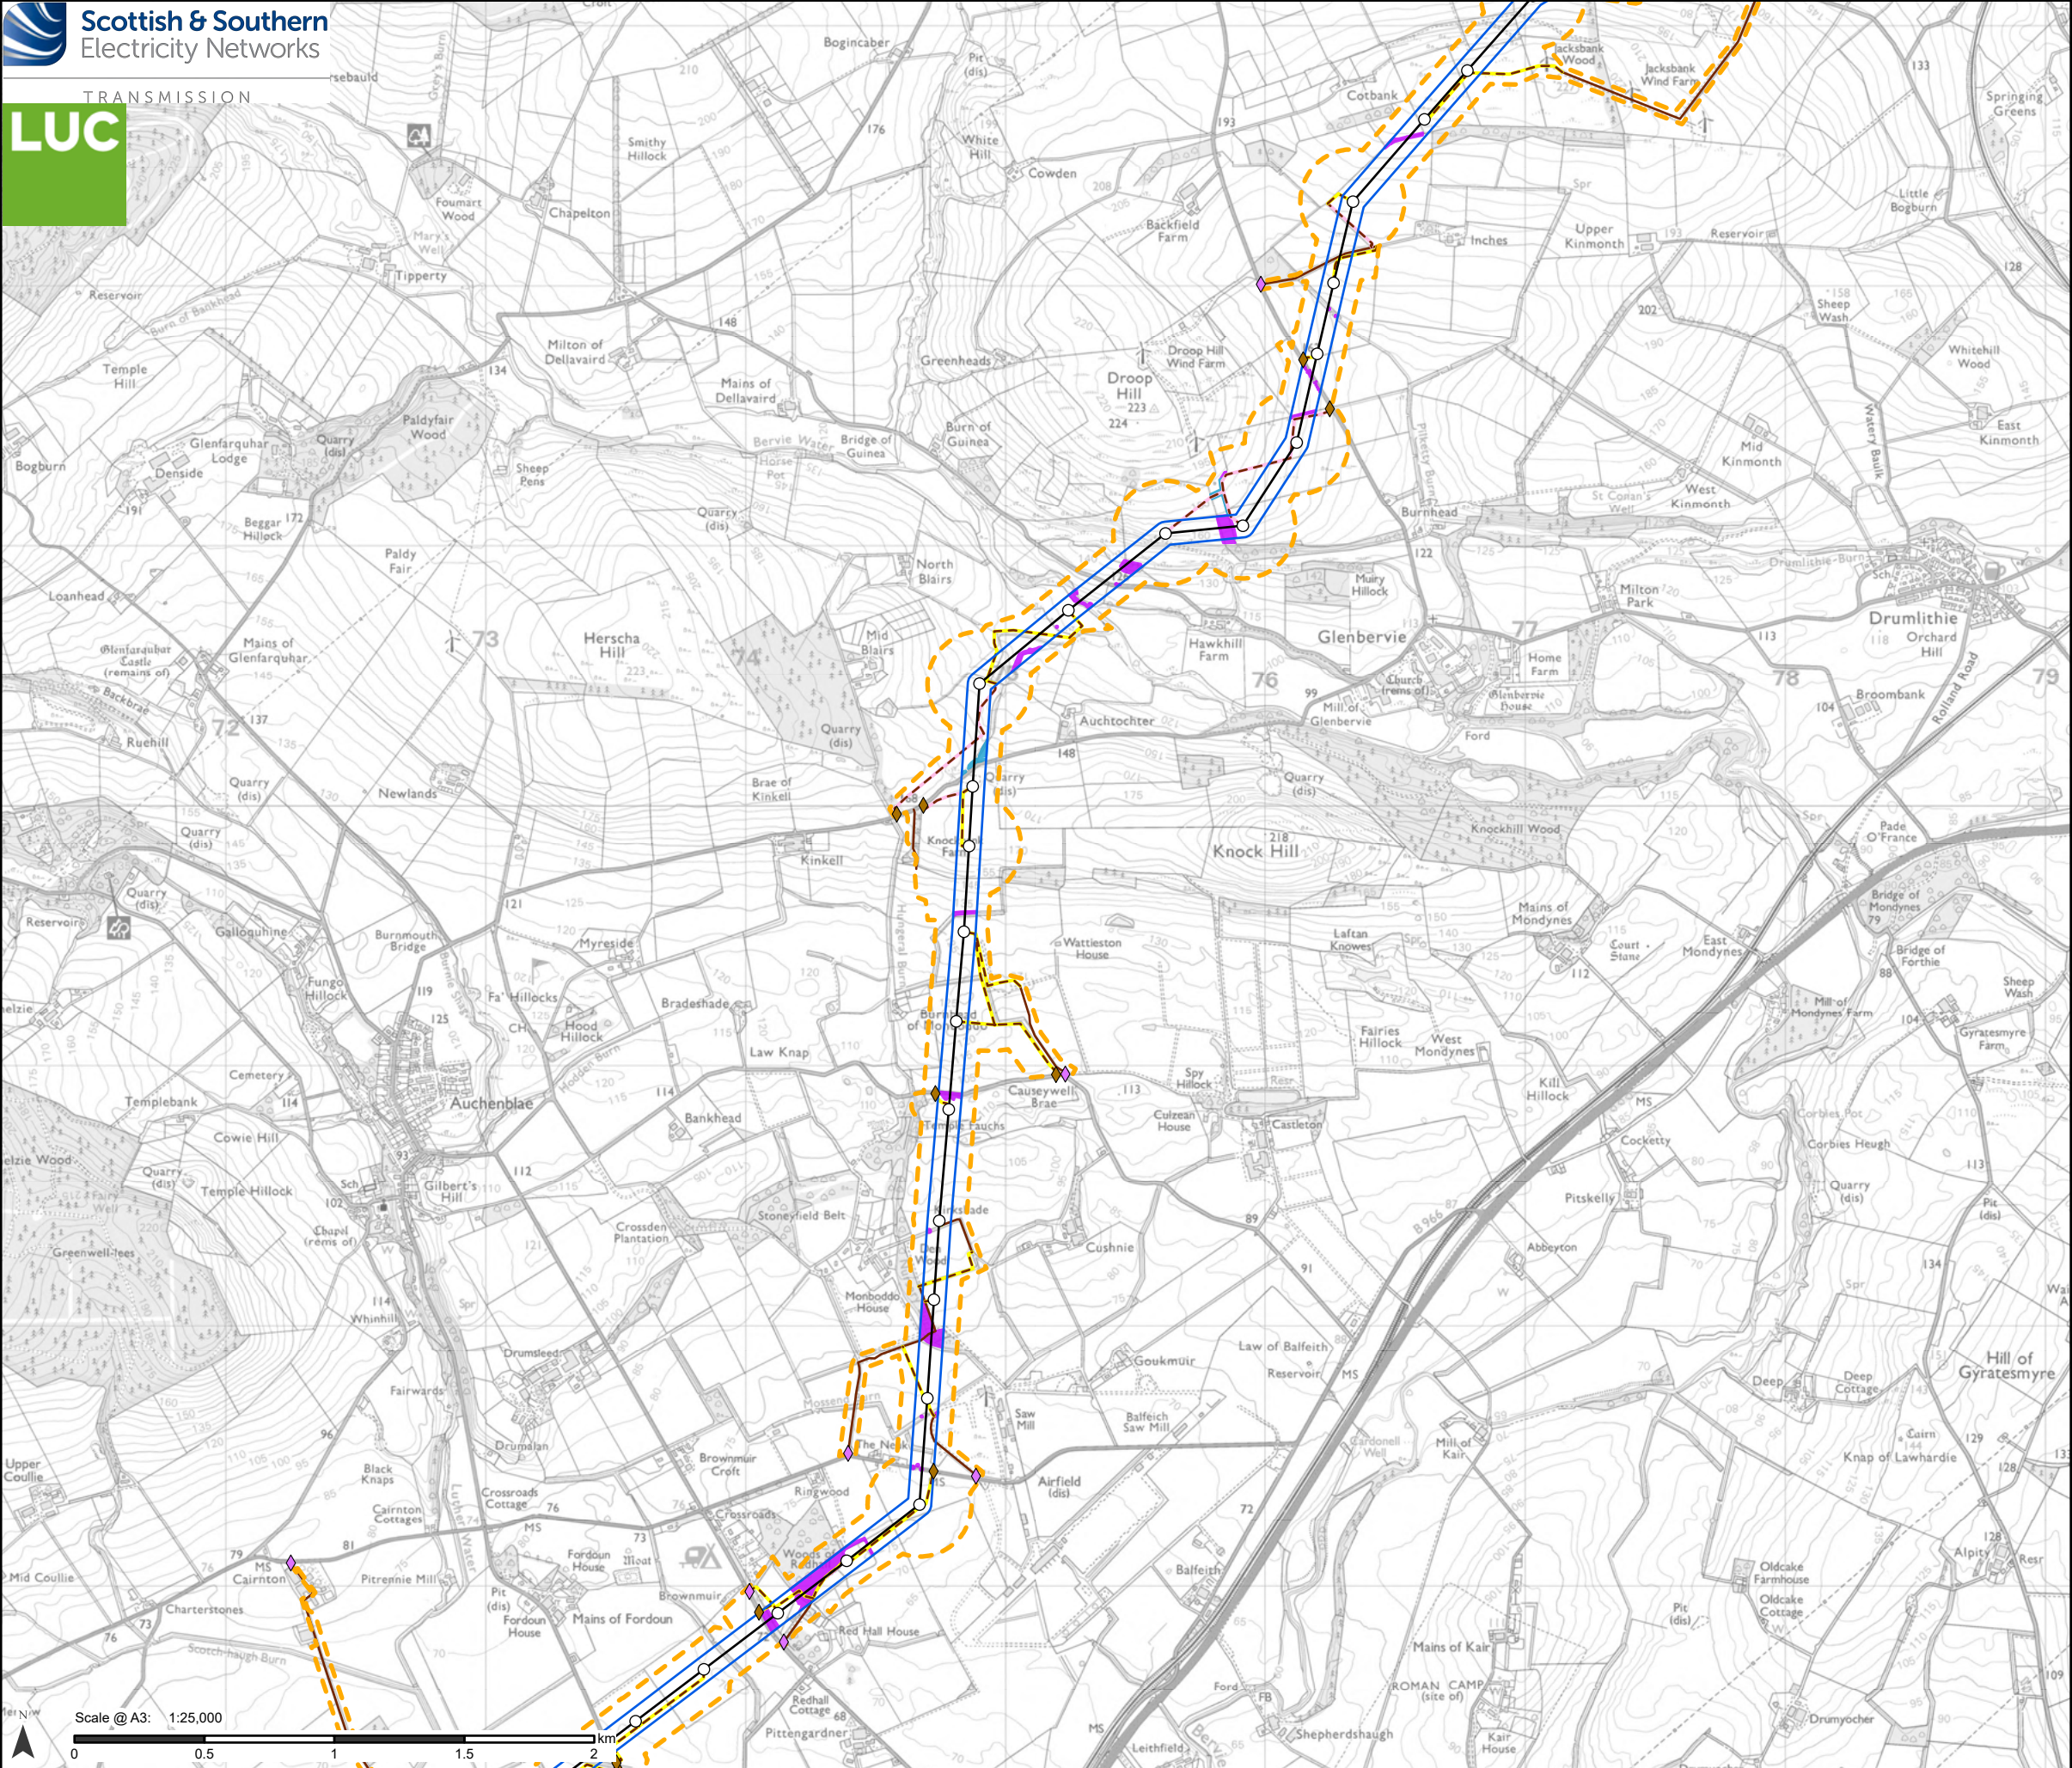

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Baseline age structure

- Mature
- Young

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

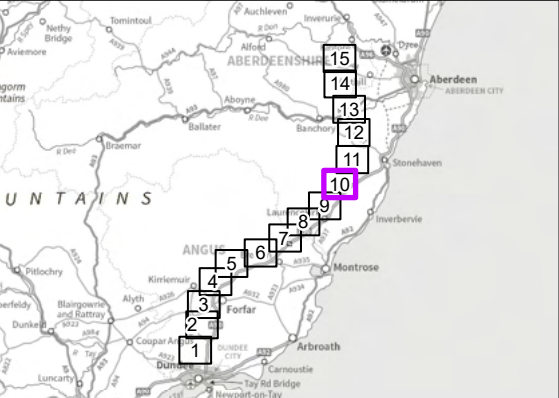

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Baseline Age Class Structure

Drawn by: MS

Date: 19/08/2025

Drawing: 8.2.10

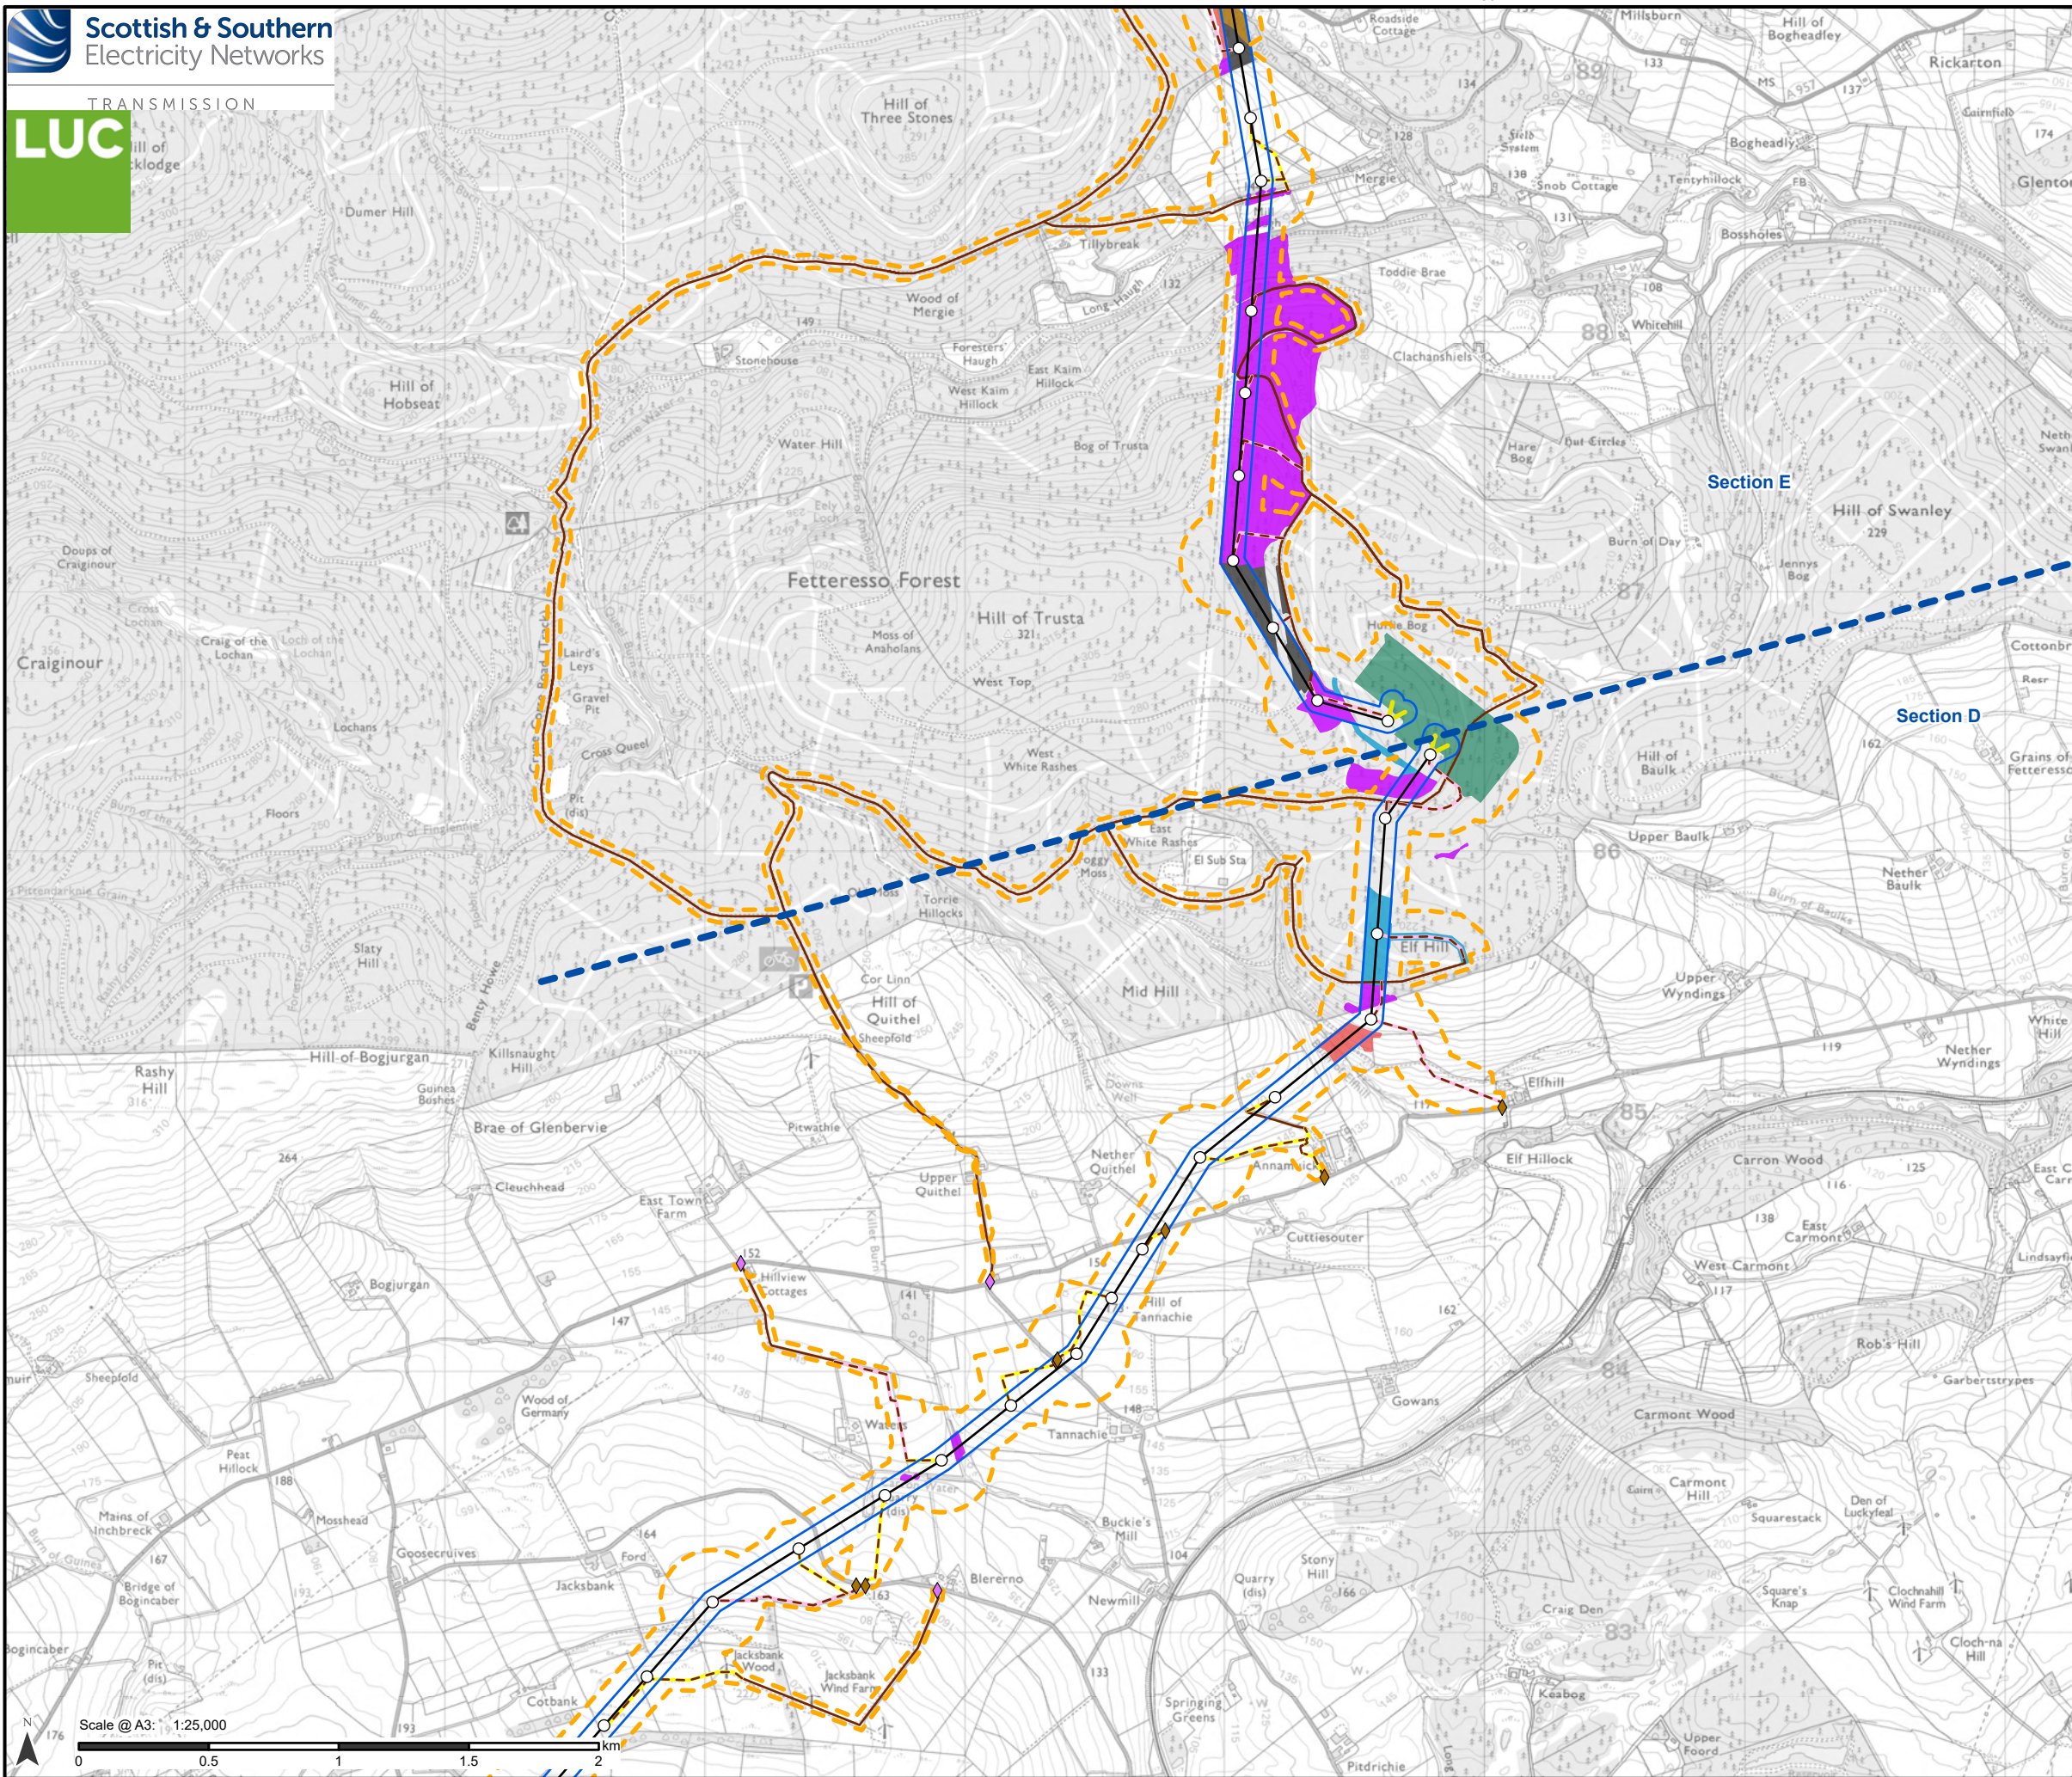

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor
- Section boundary

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Intra (Associated) Developments

Proposed Hurlie 400 kV substation
(Aberdeenshire Council Reference APP/
2024/1951)


Baseline age structure

- Mature
- Pole
- Regenerating
- Young
- N/A (awaiting restock)

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

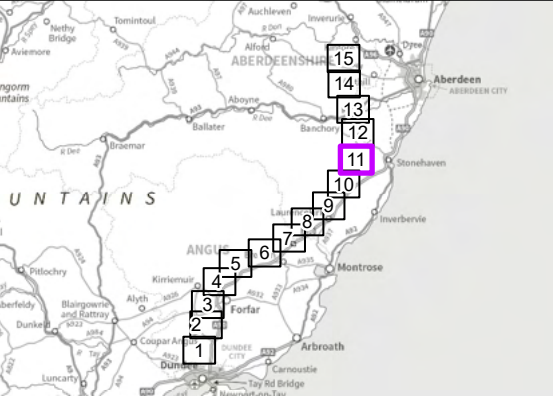

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Baseline Age Class Structure

Drawn by: MS

Date: 19/08/2025

Drawing: 8.2.11

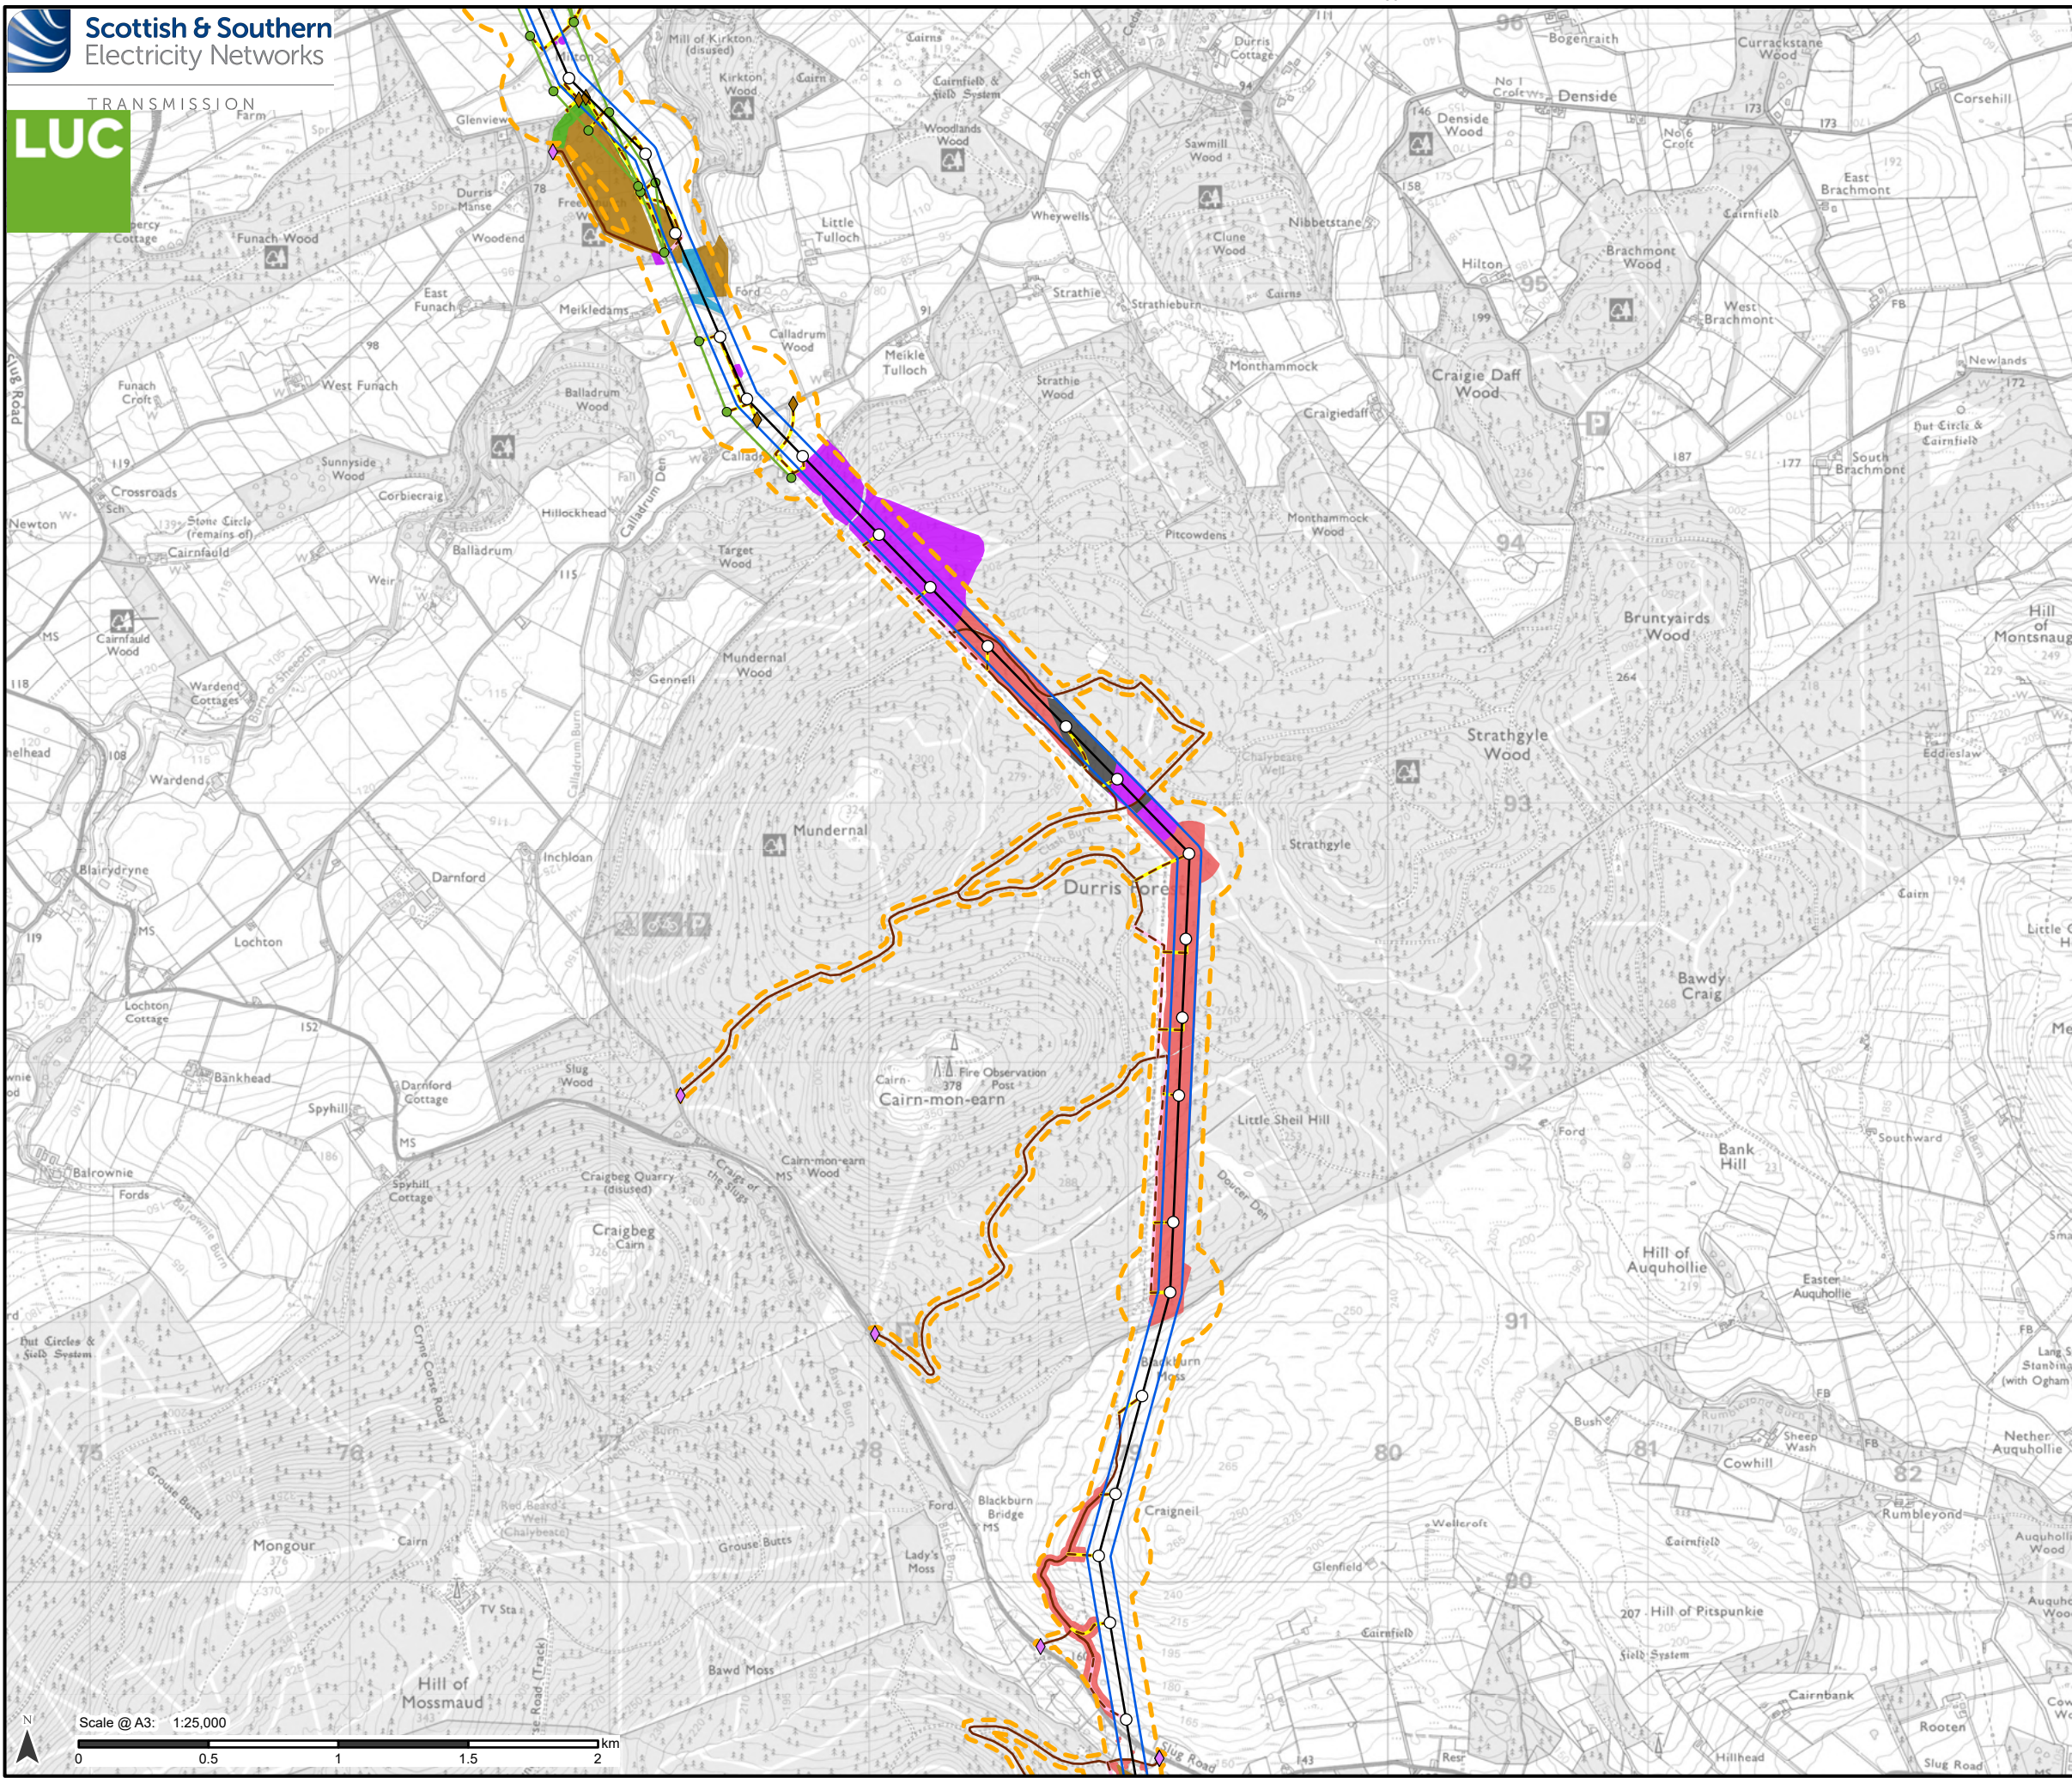

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- Proposed new
- Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Baseline age structure

- Established
- Mature
- Pole
- Regenerating
- Young
- N/A (awaiting restock)

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. **SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey**


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Baseline Age Class Structure

Drawn by: MS Date: 19/08/2025


Drawing: 8.2.12

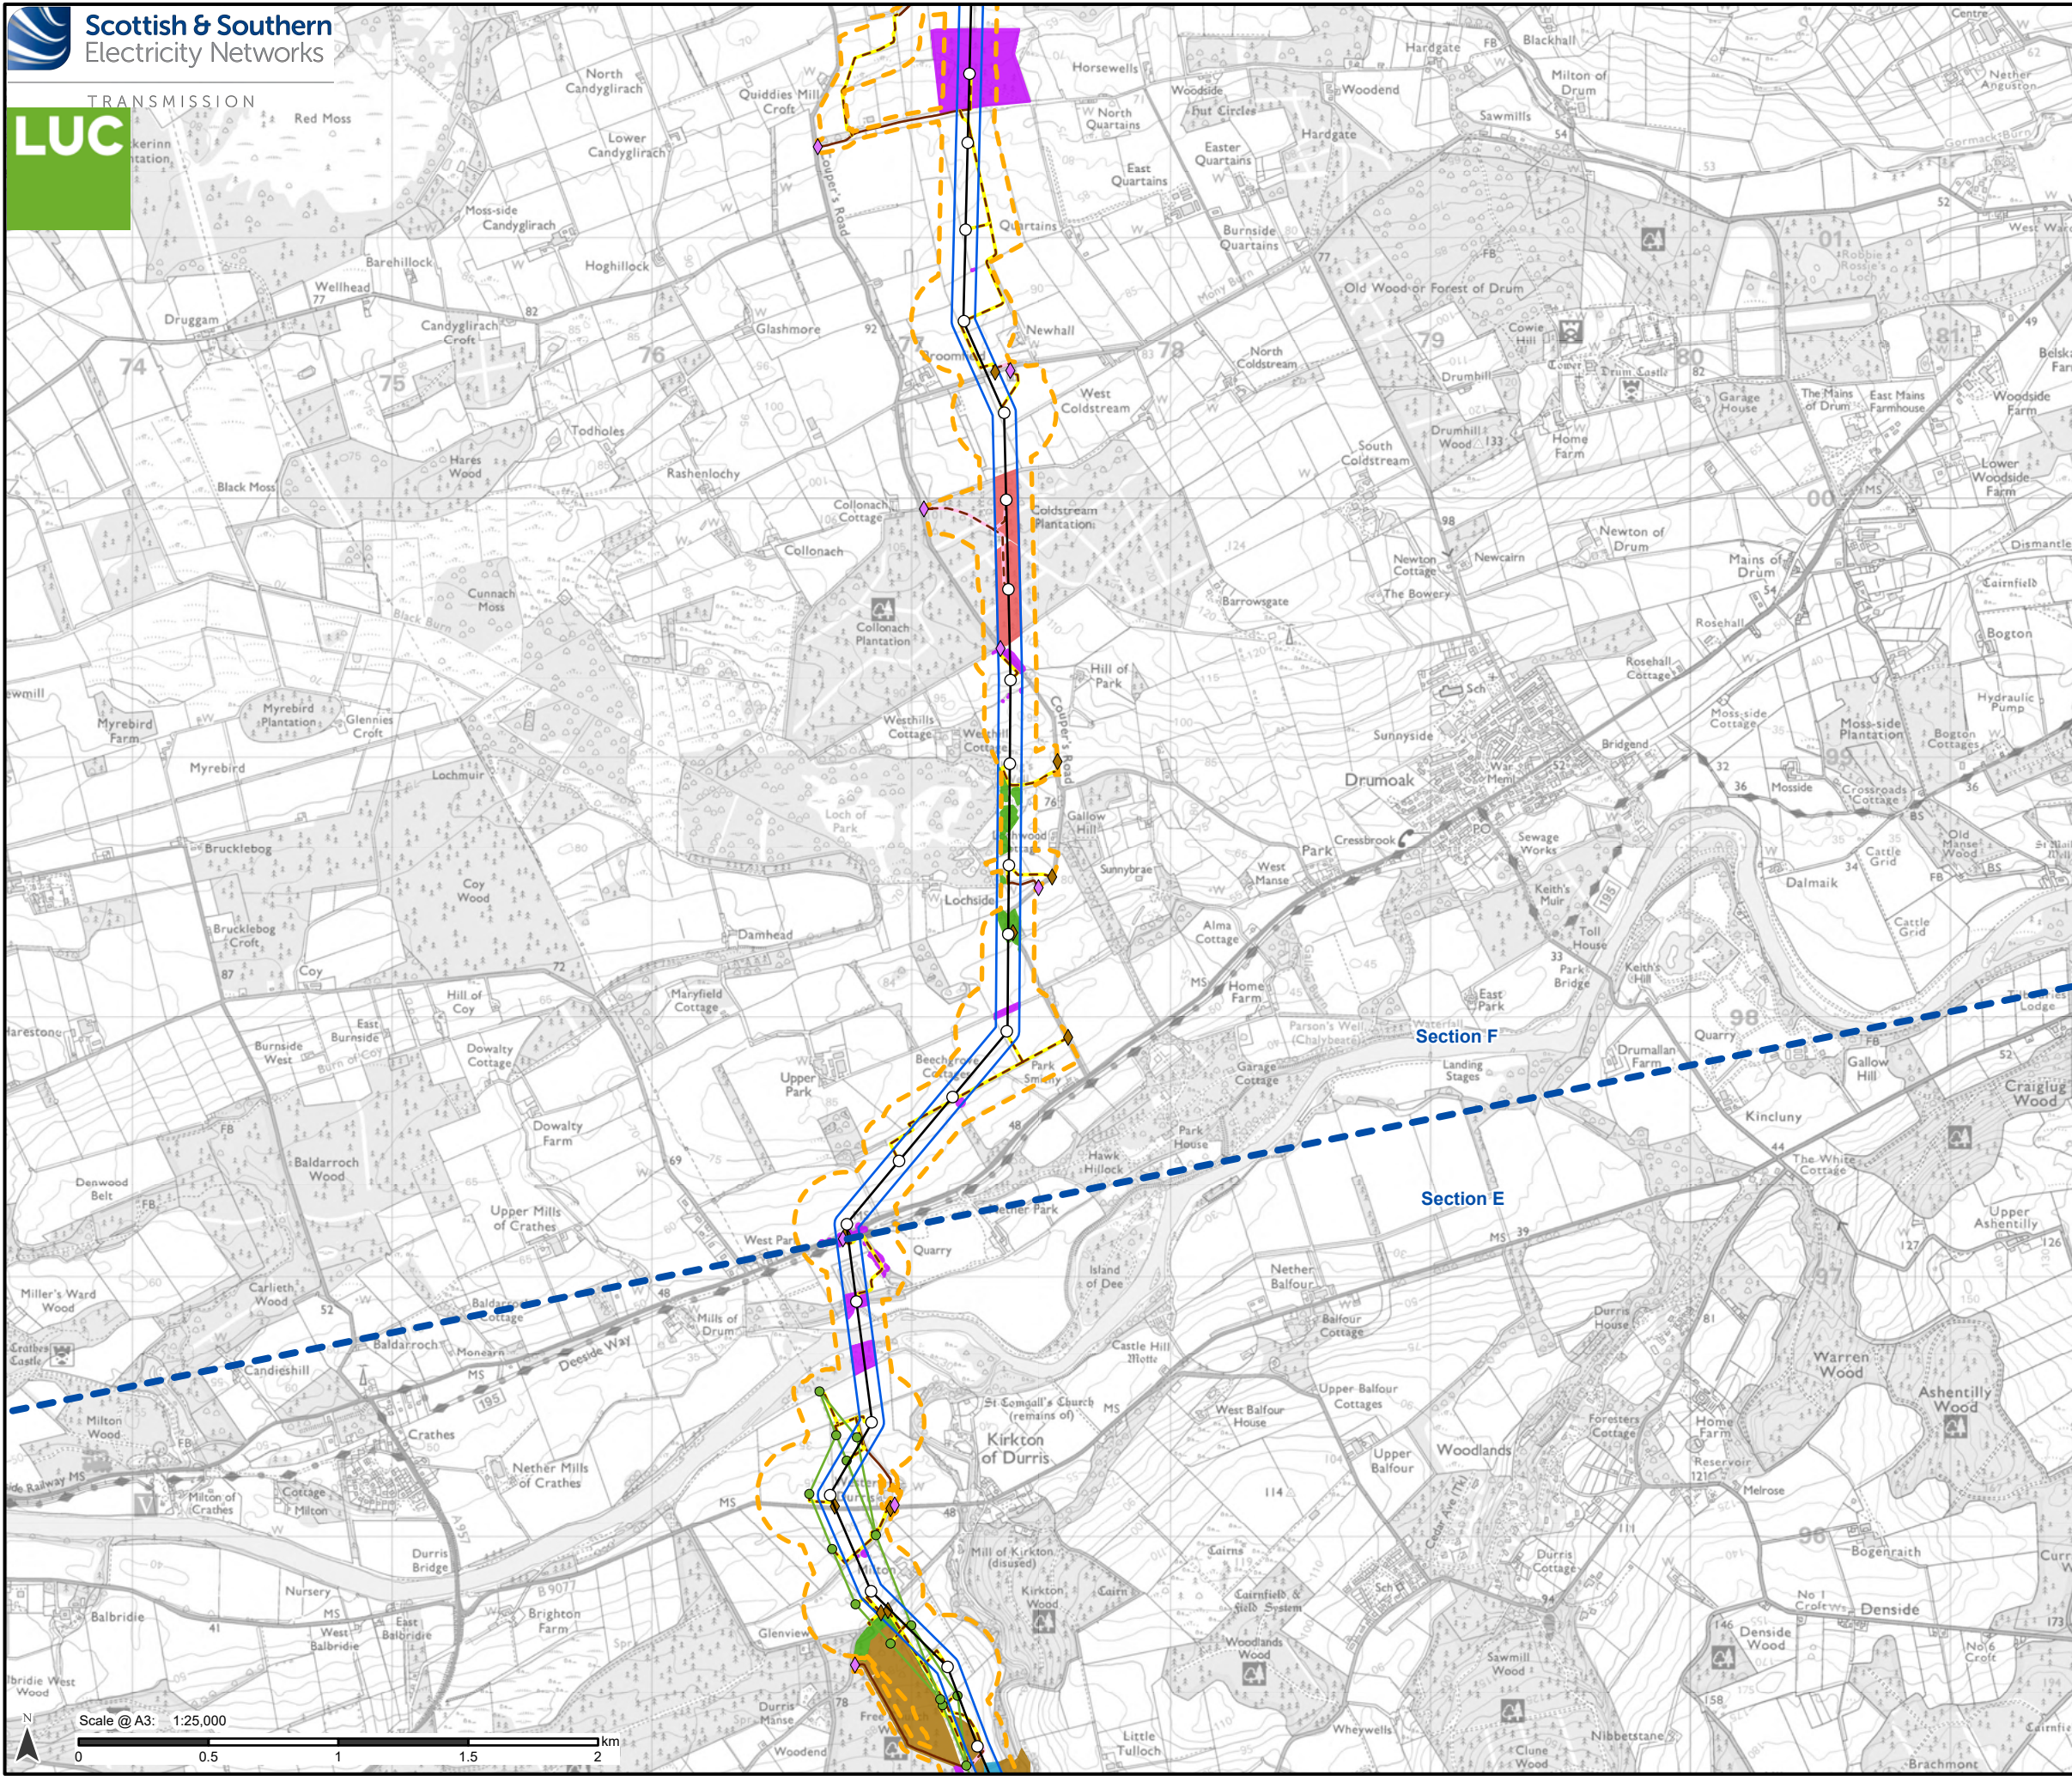

- Proposed Development**
- Tower Location
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Operational Corridor
 - Section boundary
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment**
- Tower Location
 - Overhead Line (OHL)
- Baseline age structure**
- Established
 - Mature
 - Regenerating
 - Young
 - N/A (awaiting restock)


Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

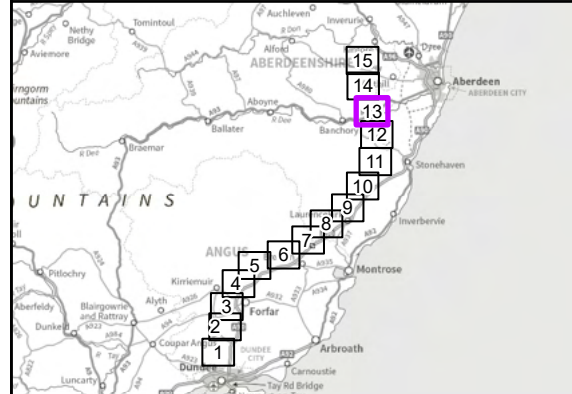

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Age Class Structure
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.2.13

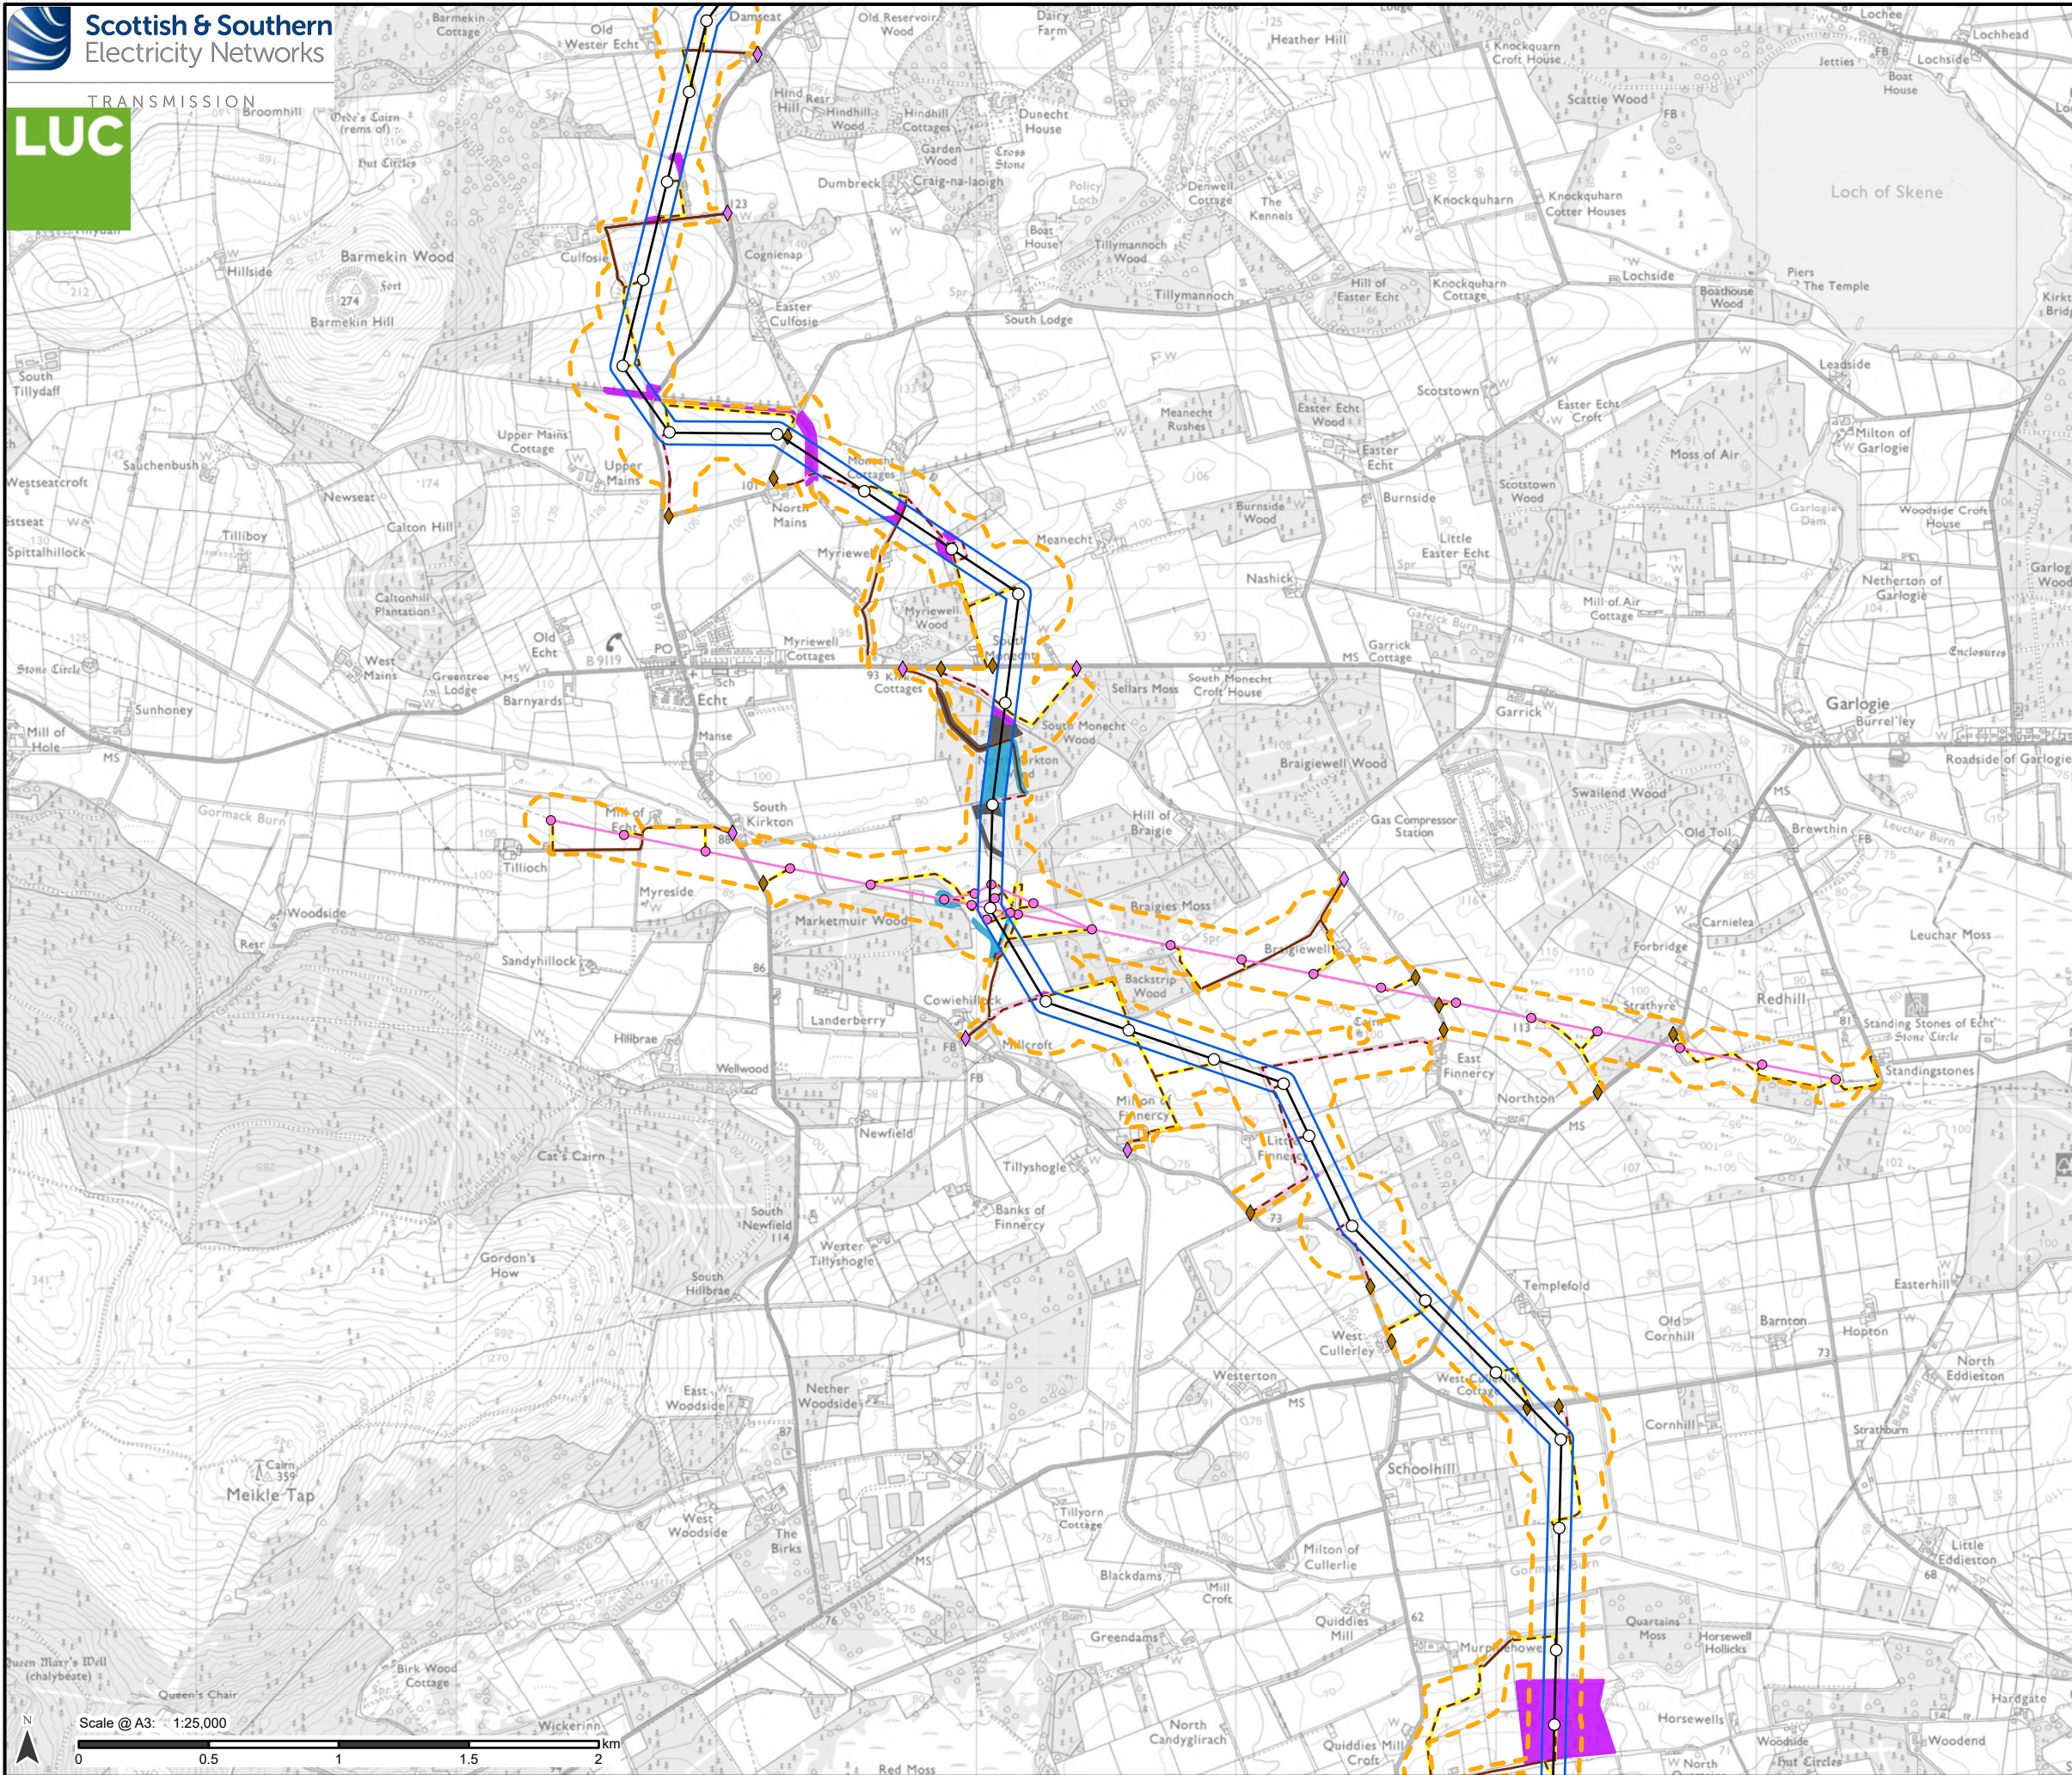

Proposed Development

- Tower Location
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Operational Corridor
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone permanent (operational and maintenance access track only - not for construction)
 - Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Craigiebuckler - Tarland 132 kV Overhead Line Crossing

- Tower Location
- Overhead Line (OHL)


Baseline age structure

- Mature
- Pole
- Young

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

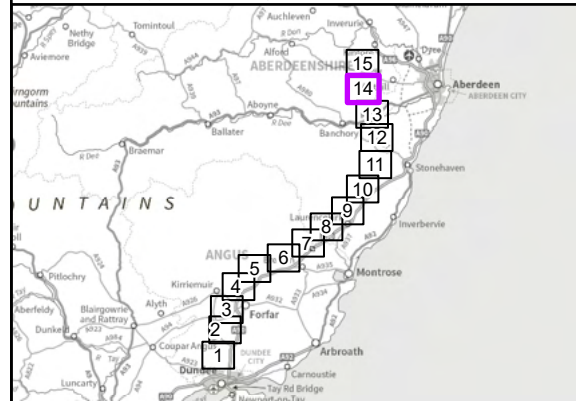

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 010002432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Baseline Age Class Structure

Drawn by: MS

Date: 19/08/2025

Drawing: 8.2.14

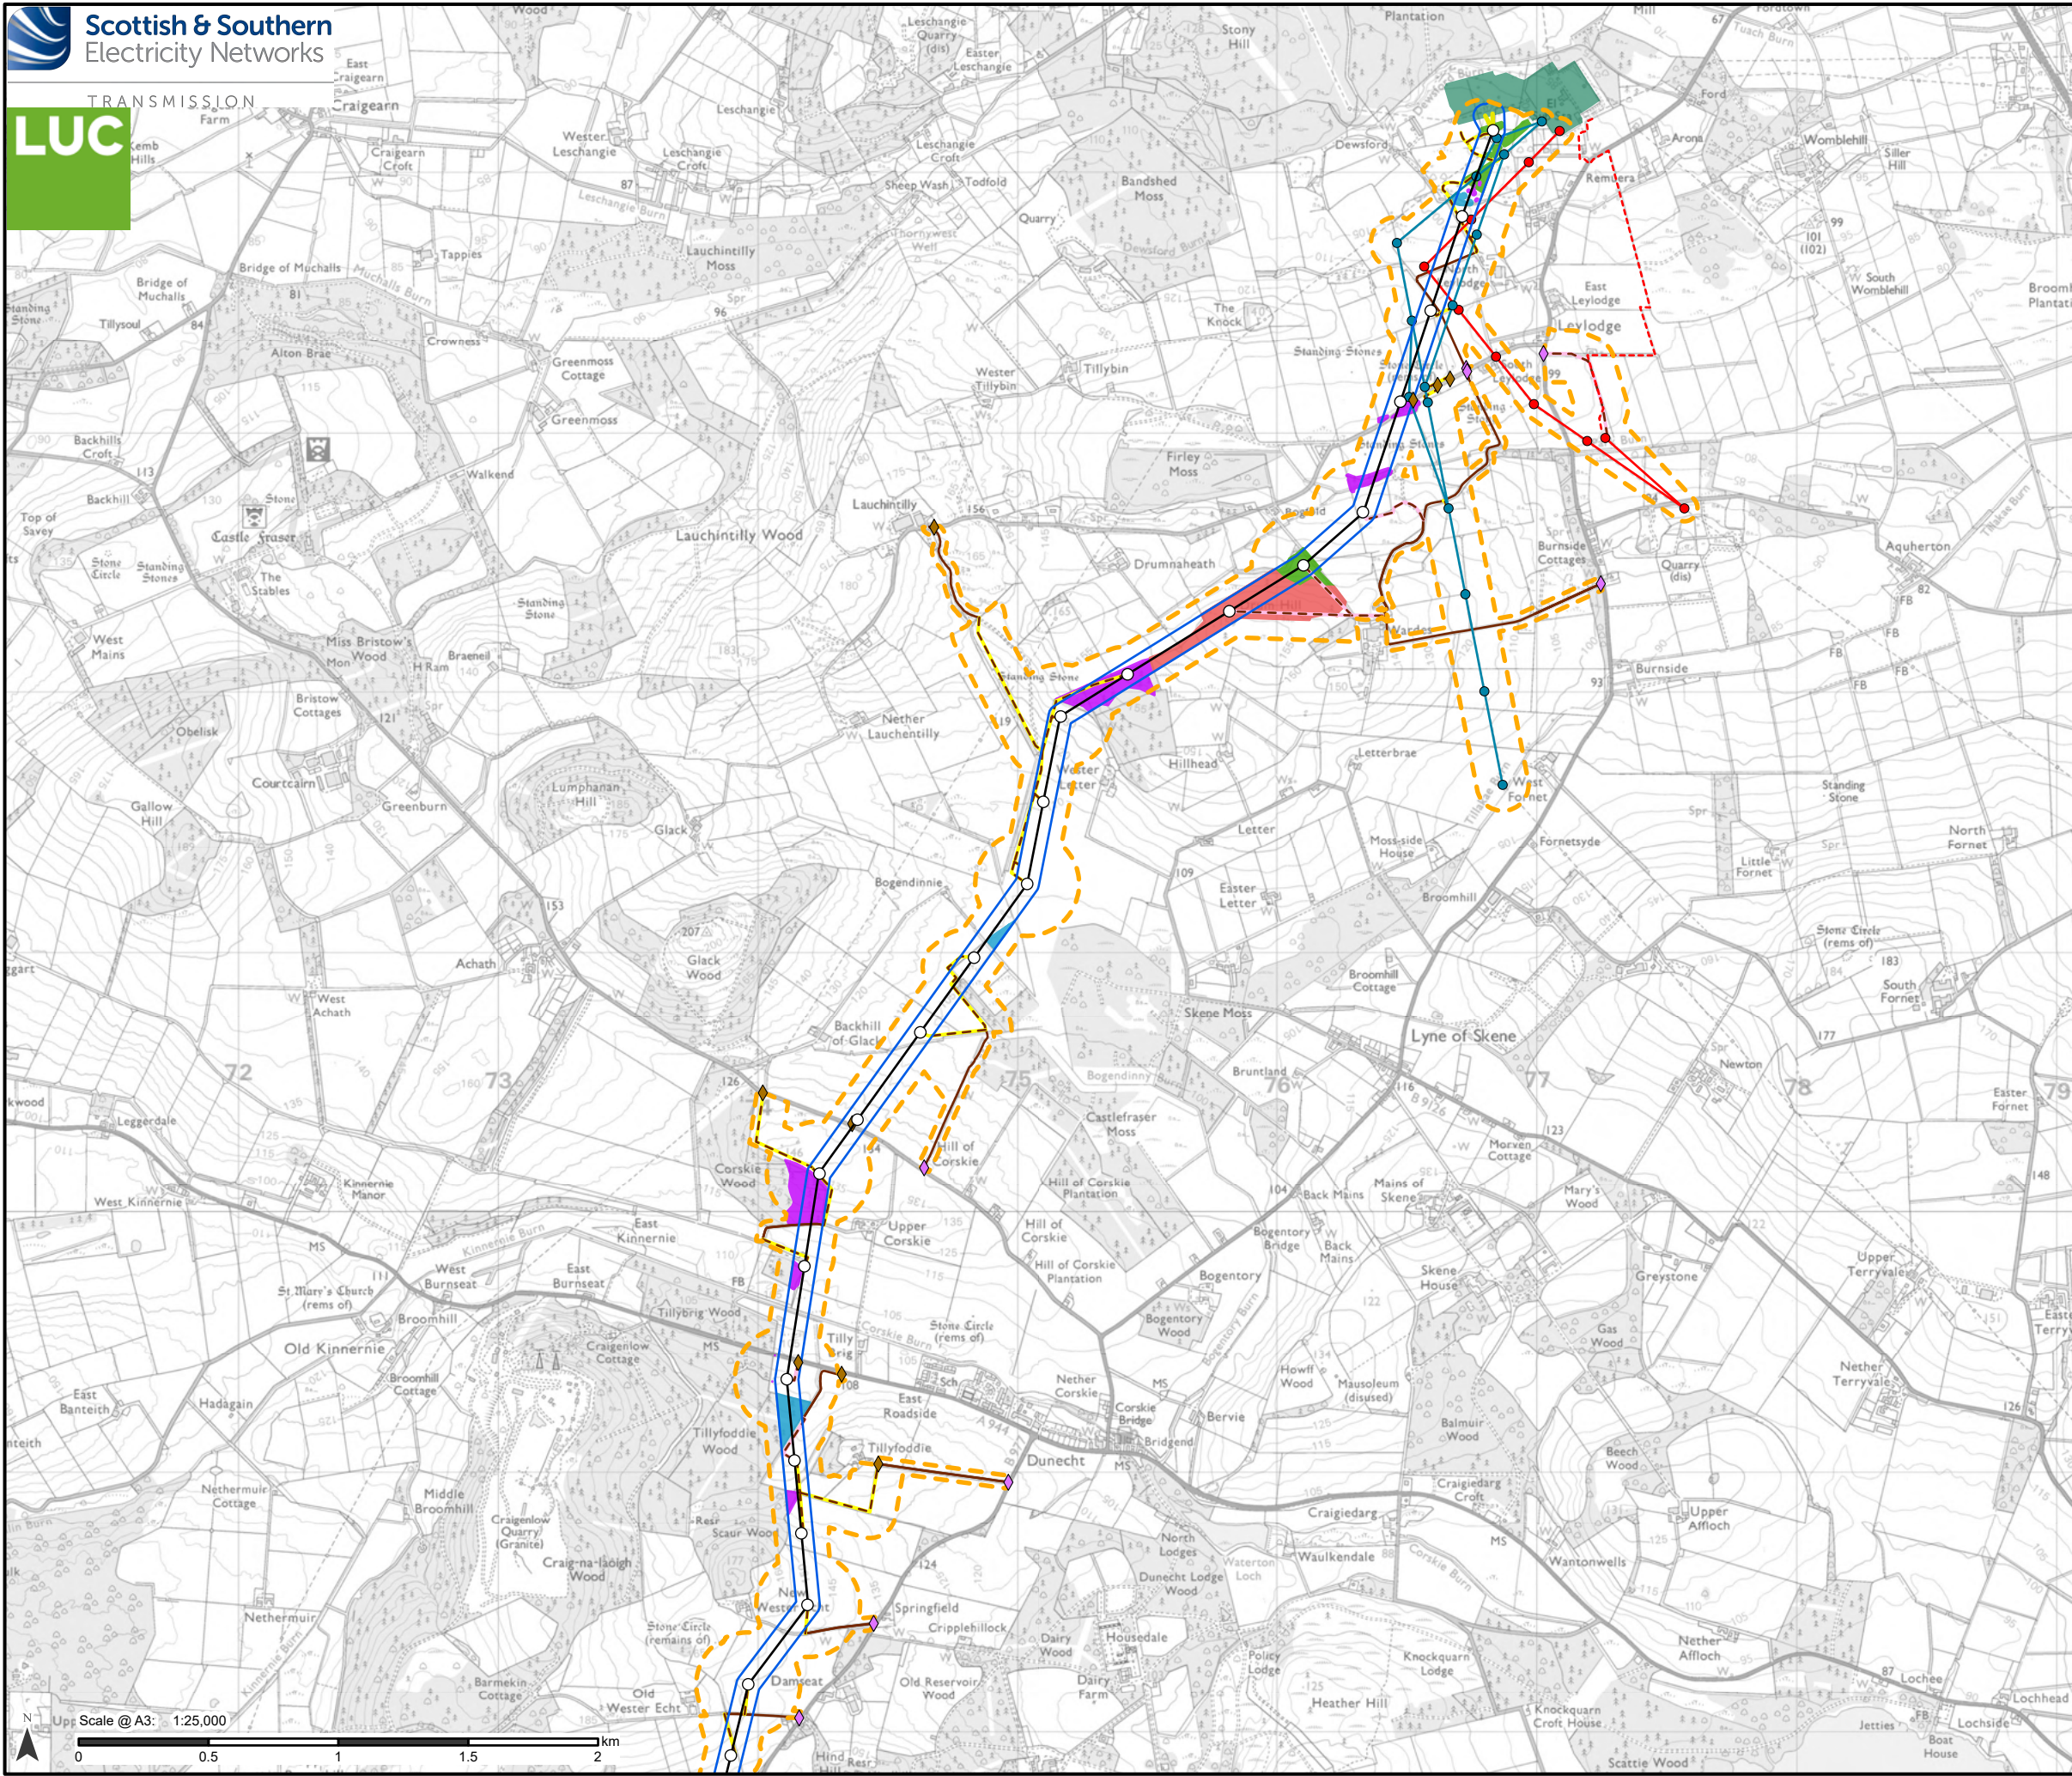

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Additional development included in Section 37 application: Kintore - Craigiebukler 132 kV

- Tower Location
- OHL

Existing/Other Infrastructure

- Existing Kintore Substation

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Baseline age structure

- Established
- Mature
- Young
- N/A (awaiting restock)

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Baseline Age Class Structure

Drawn by: MS

Date: 19/08/2025

Drawing: 8.2.15