


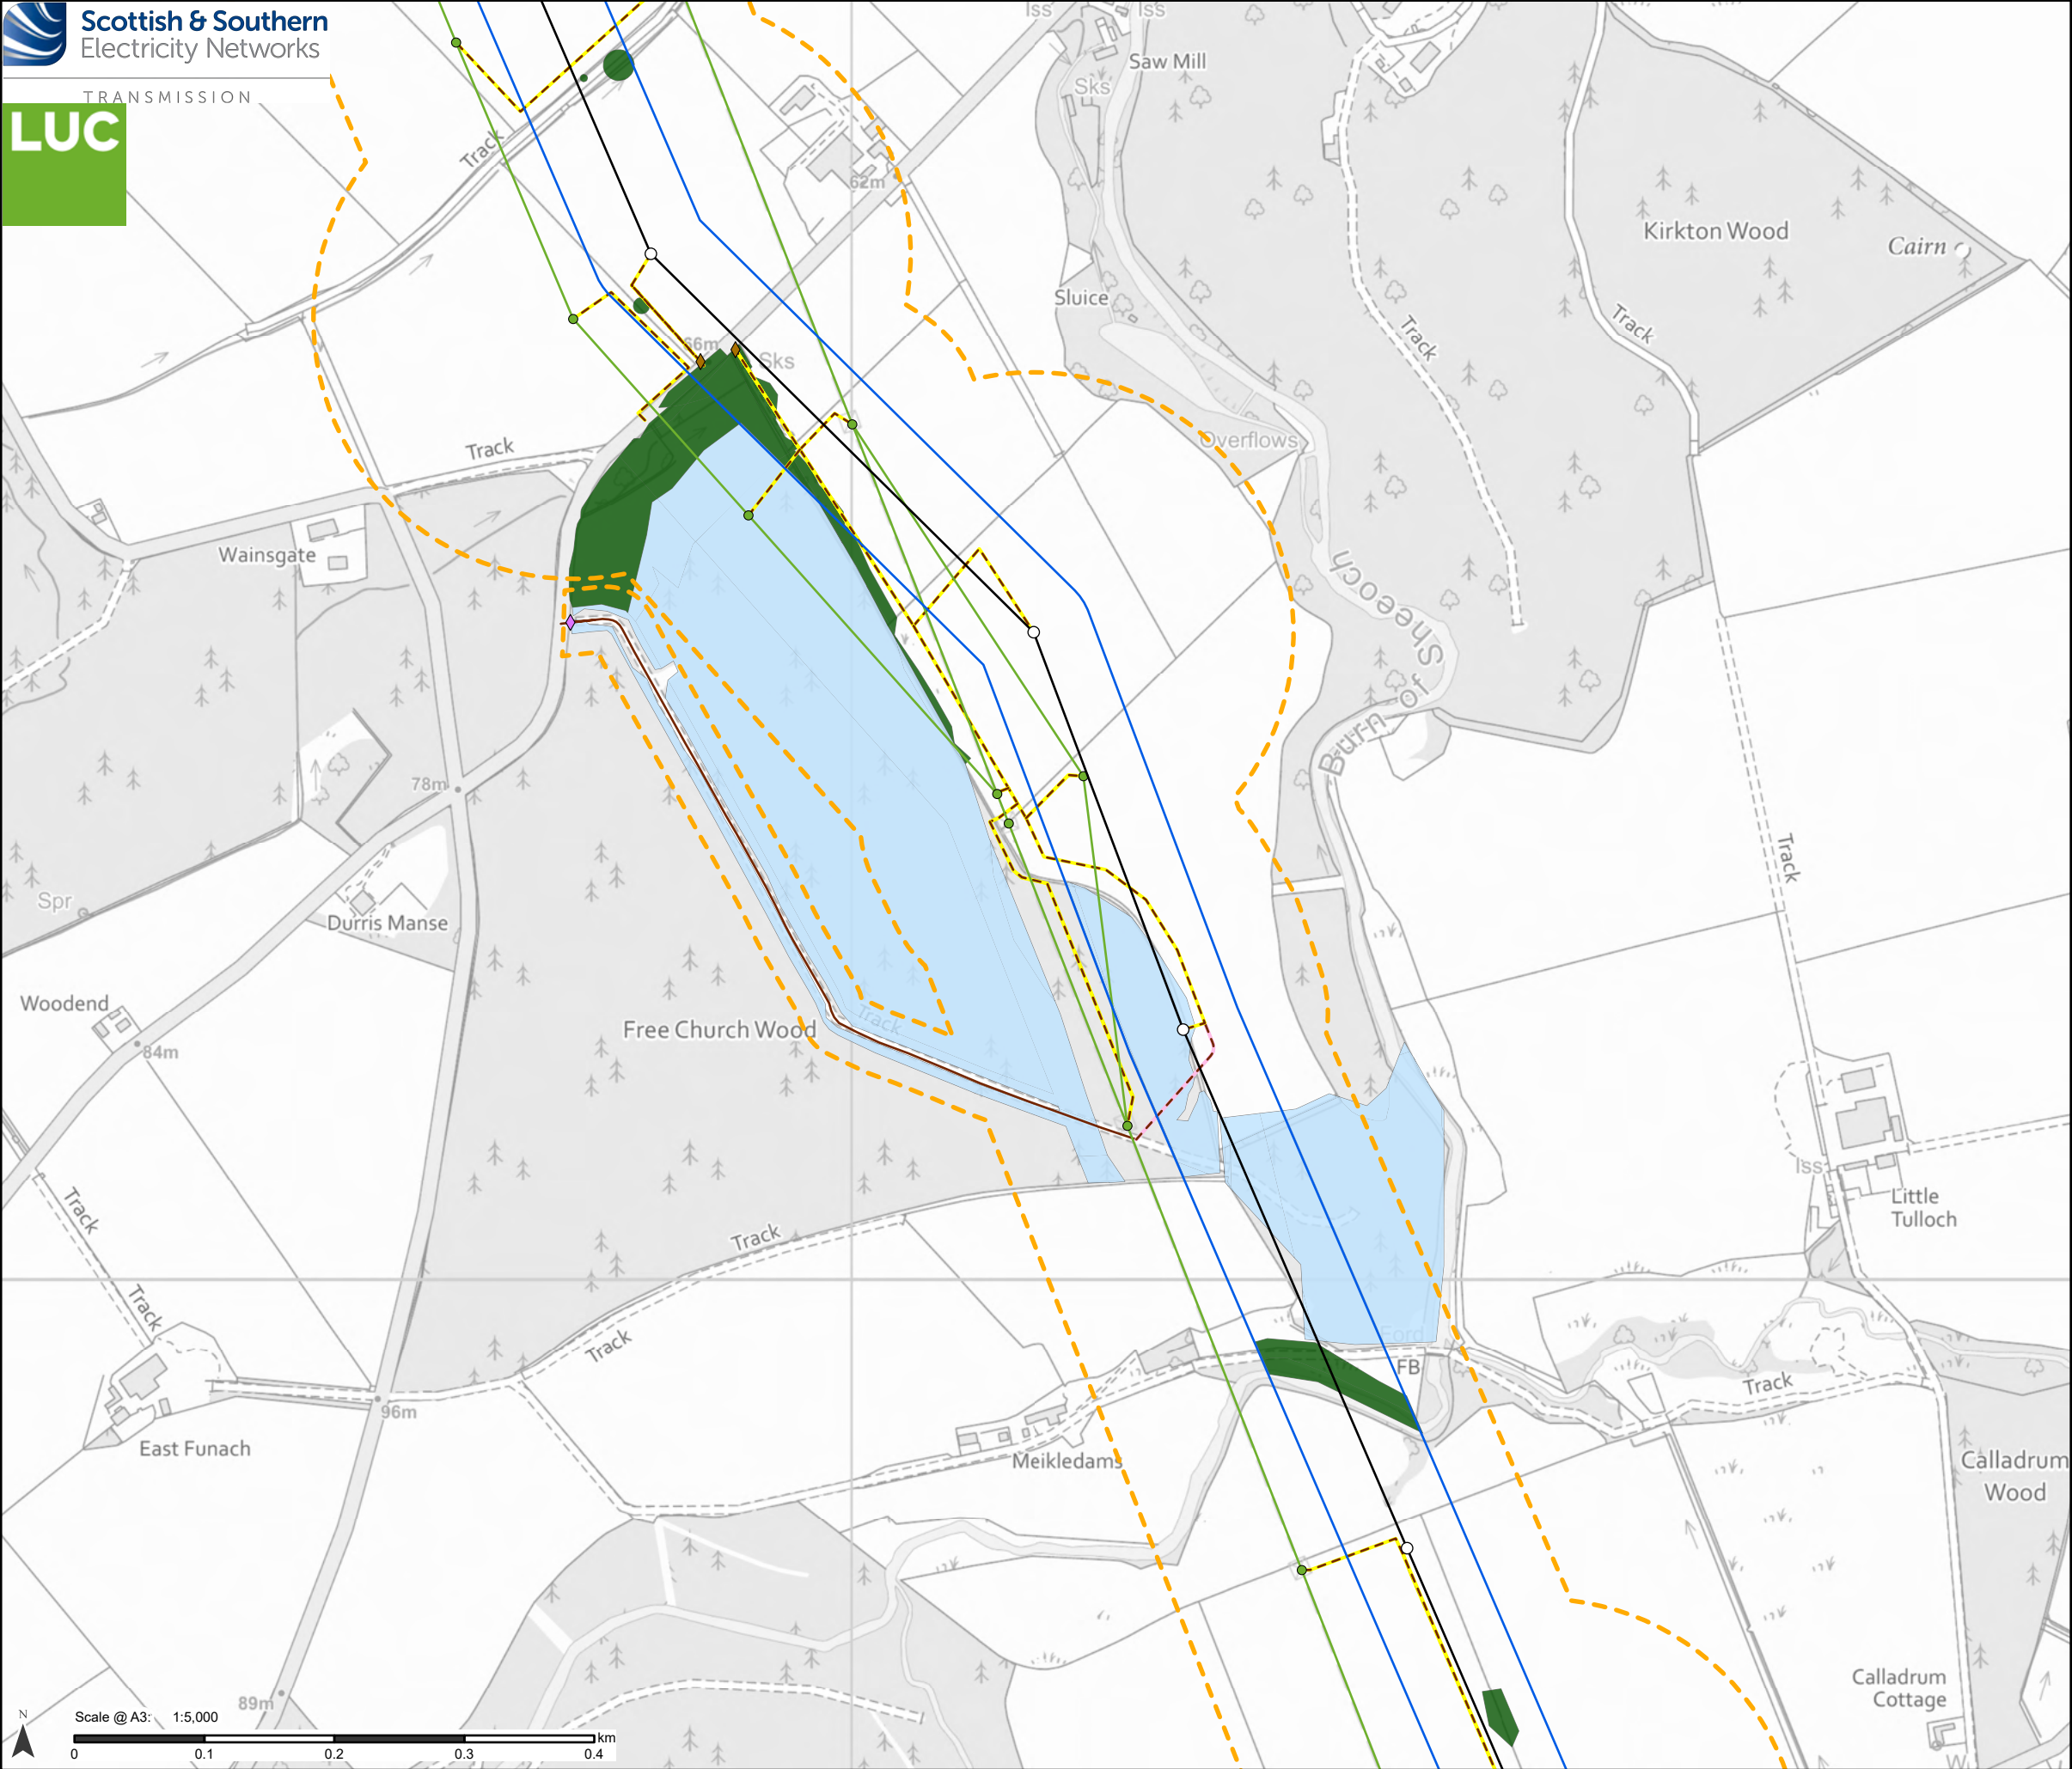

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/ 400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)


Restocking species

- Mixed broadleaves
- Sitka spruce

Notes:


For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

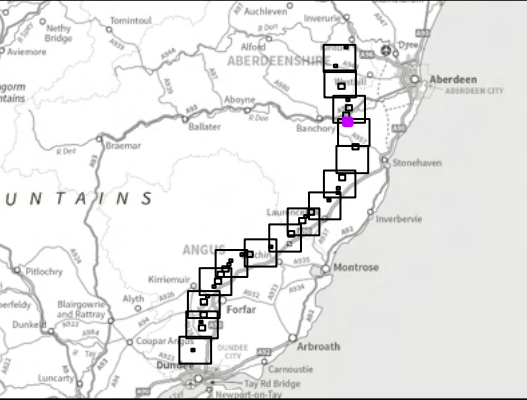

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Species Composition
Drawn by:	MS
Date:	20/08/2025
Drawing:	8.3.37

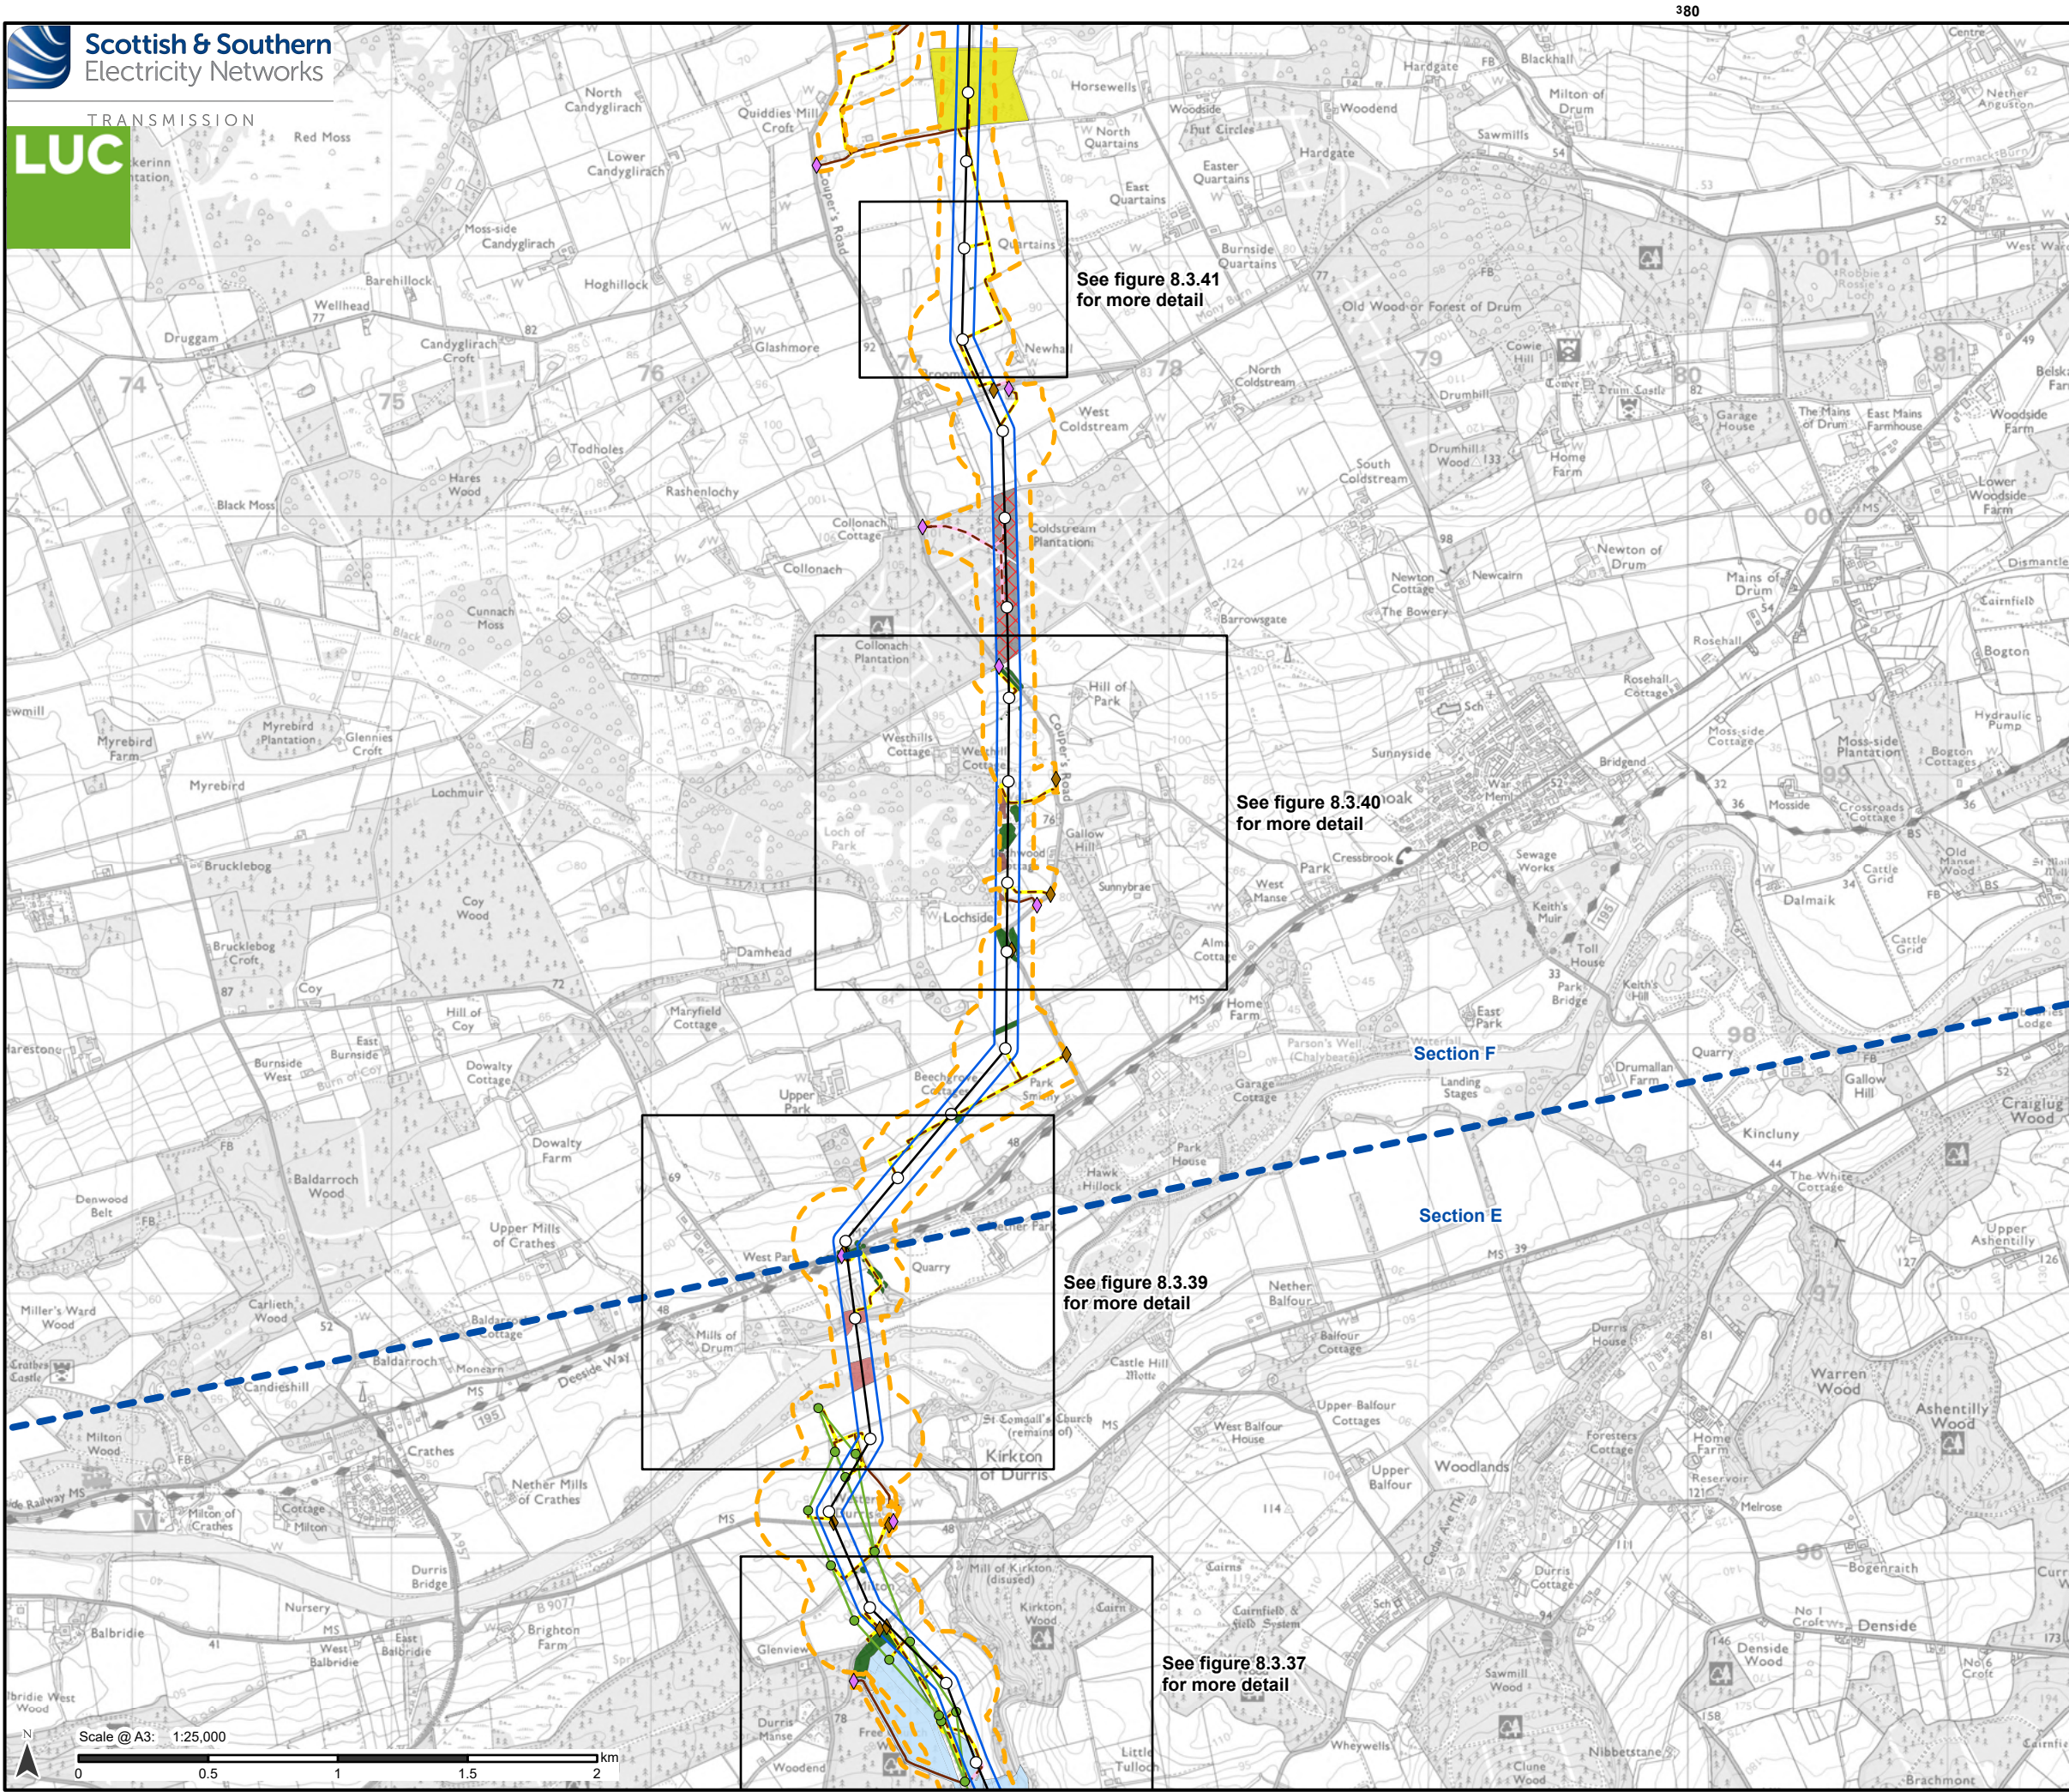

See figure 8.3.41
for more detail

See figure 8.3.40
for more detail

See figure 8.3.39
for more detail

See figure 8.3.37
for more detail

Section F

Section E

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor
- Section boundary

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/ 400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)


Restocking species

- Felled awaiting restock
- Mixed broadleaves
- Mixed woodland
- Native mixed woodland
- Other conifer
- Sitka spruce

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

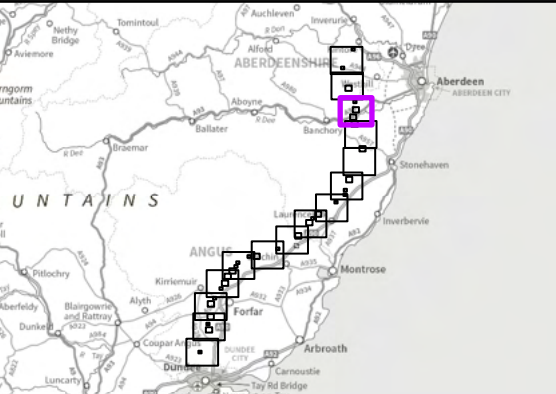


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title: Baseline Species Composition

Drawn by: MS Date: 20/08/2025

Drawing: 8.3.38

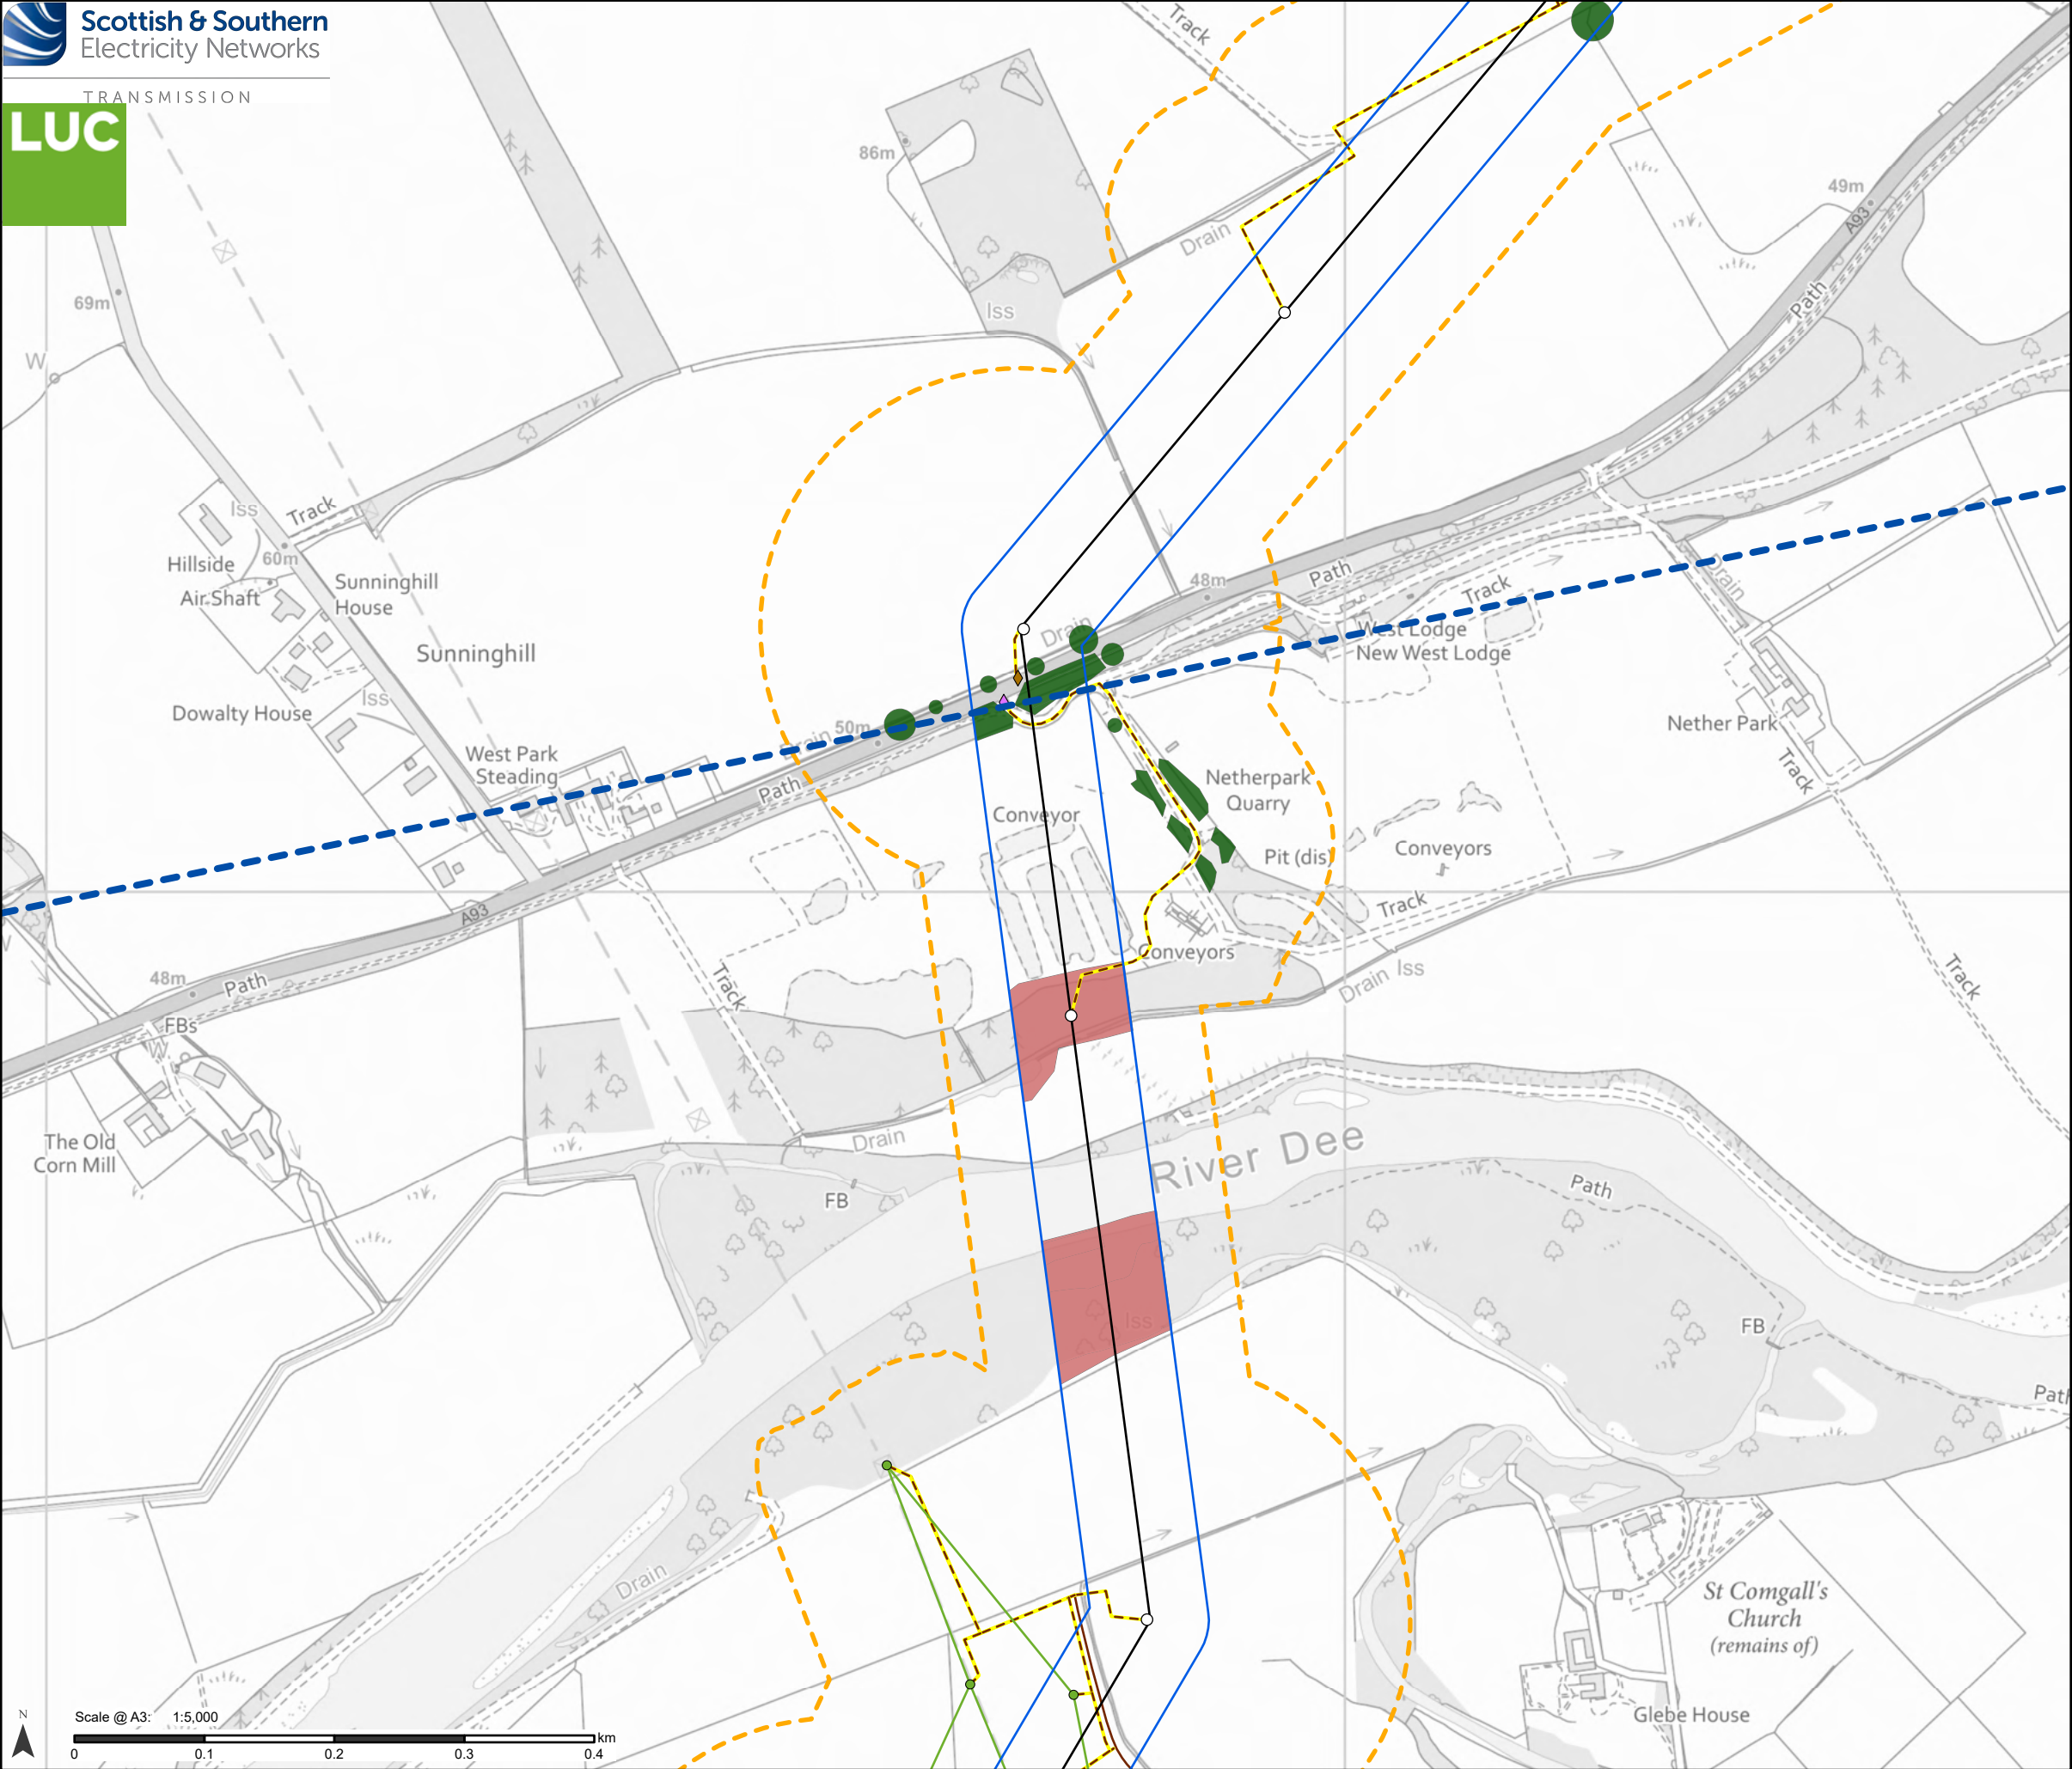

Proposed Development

-  Tower Location
-  Proposed Alignment
-  Proposed Development Limit of Deviation (LOD)
-  Operational Corridor
-  Section boundary

Access

-  Existing to be upgraded
-  Proposed new stone temporary

Bellmouth type

-  Proposed new
-  Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/ 400 kV Overhead Line Realignment


-  Tower Location
-  Overhead Line (OHL)

Restocking species

-  Mixed broadleaves
-  Mixed woodland


Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

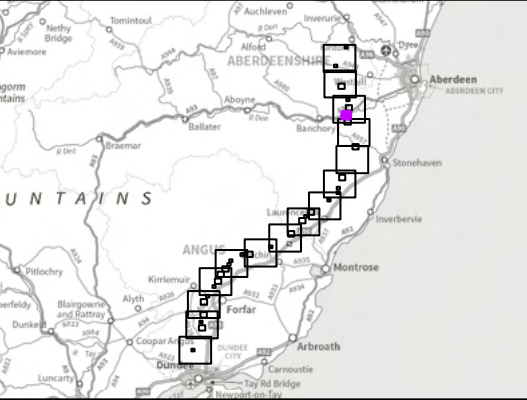

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Species Composition
Drawn by:	MS
Date:	20/08/2025
Drawing:	8.3.39

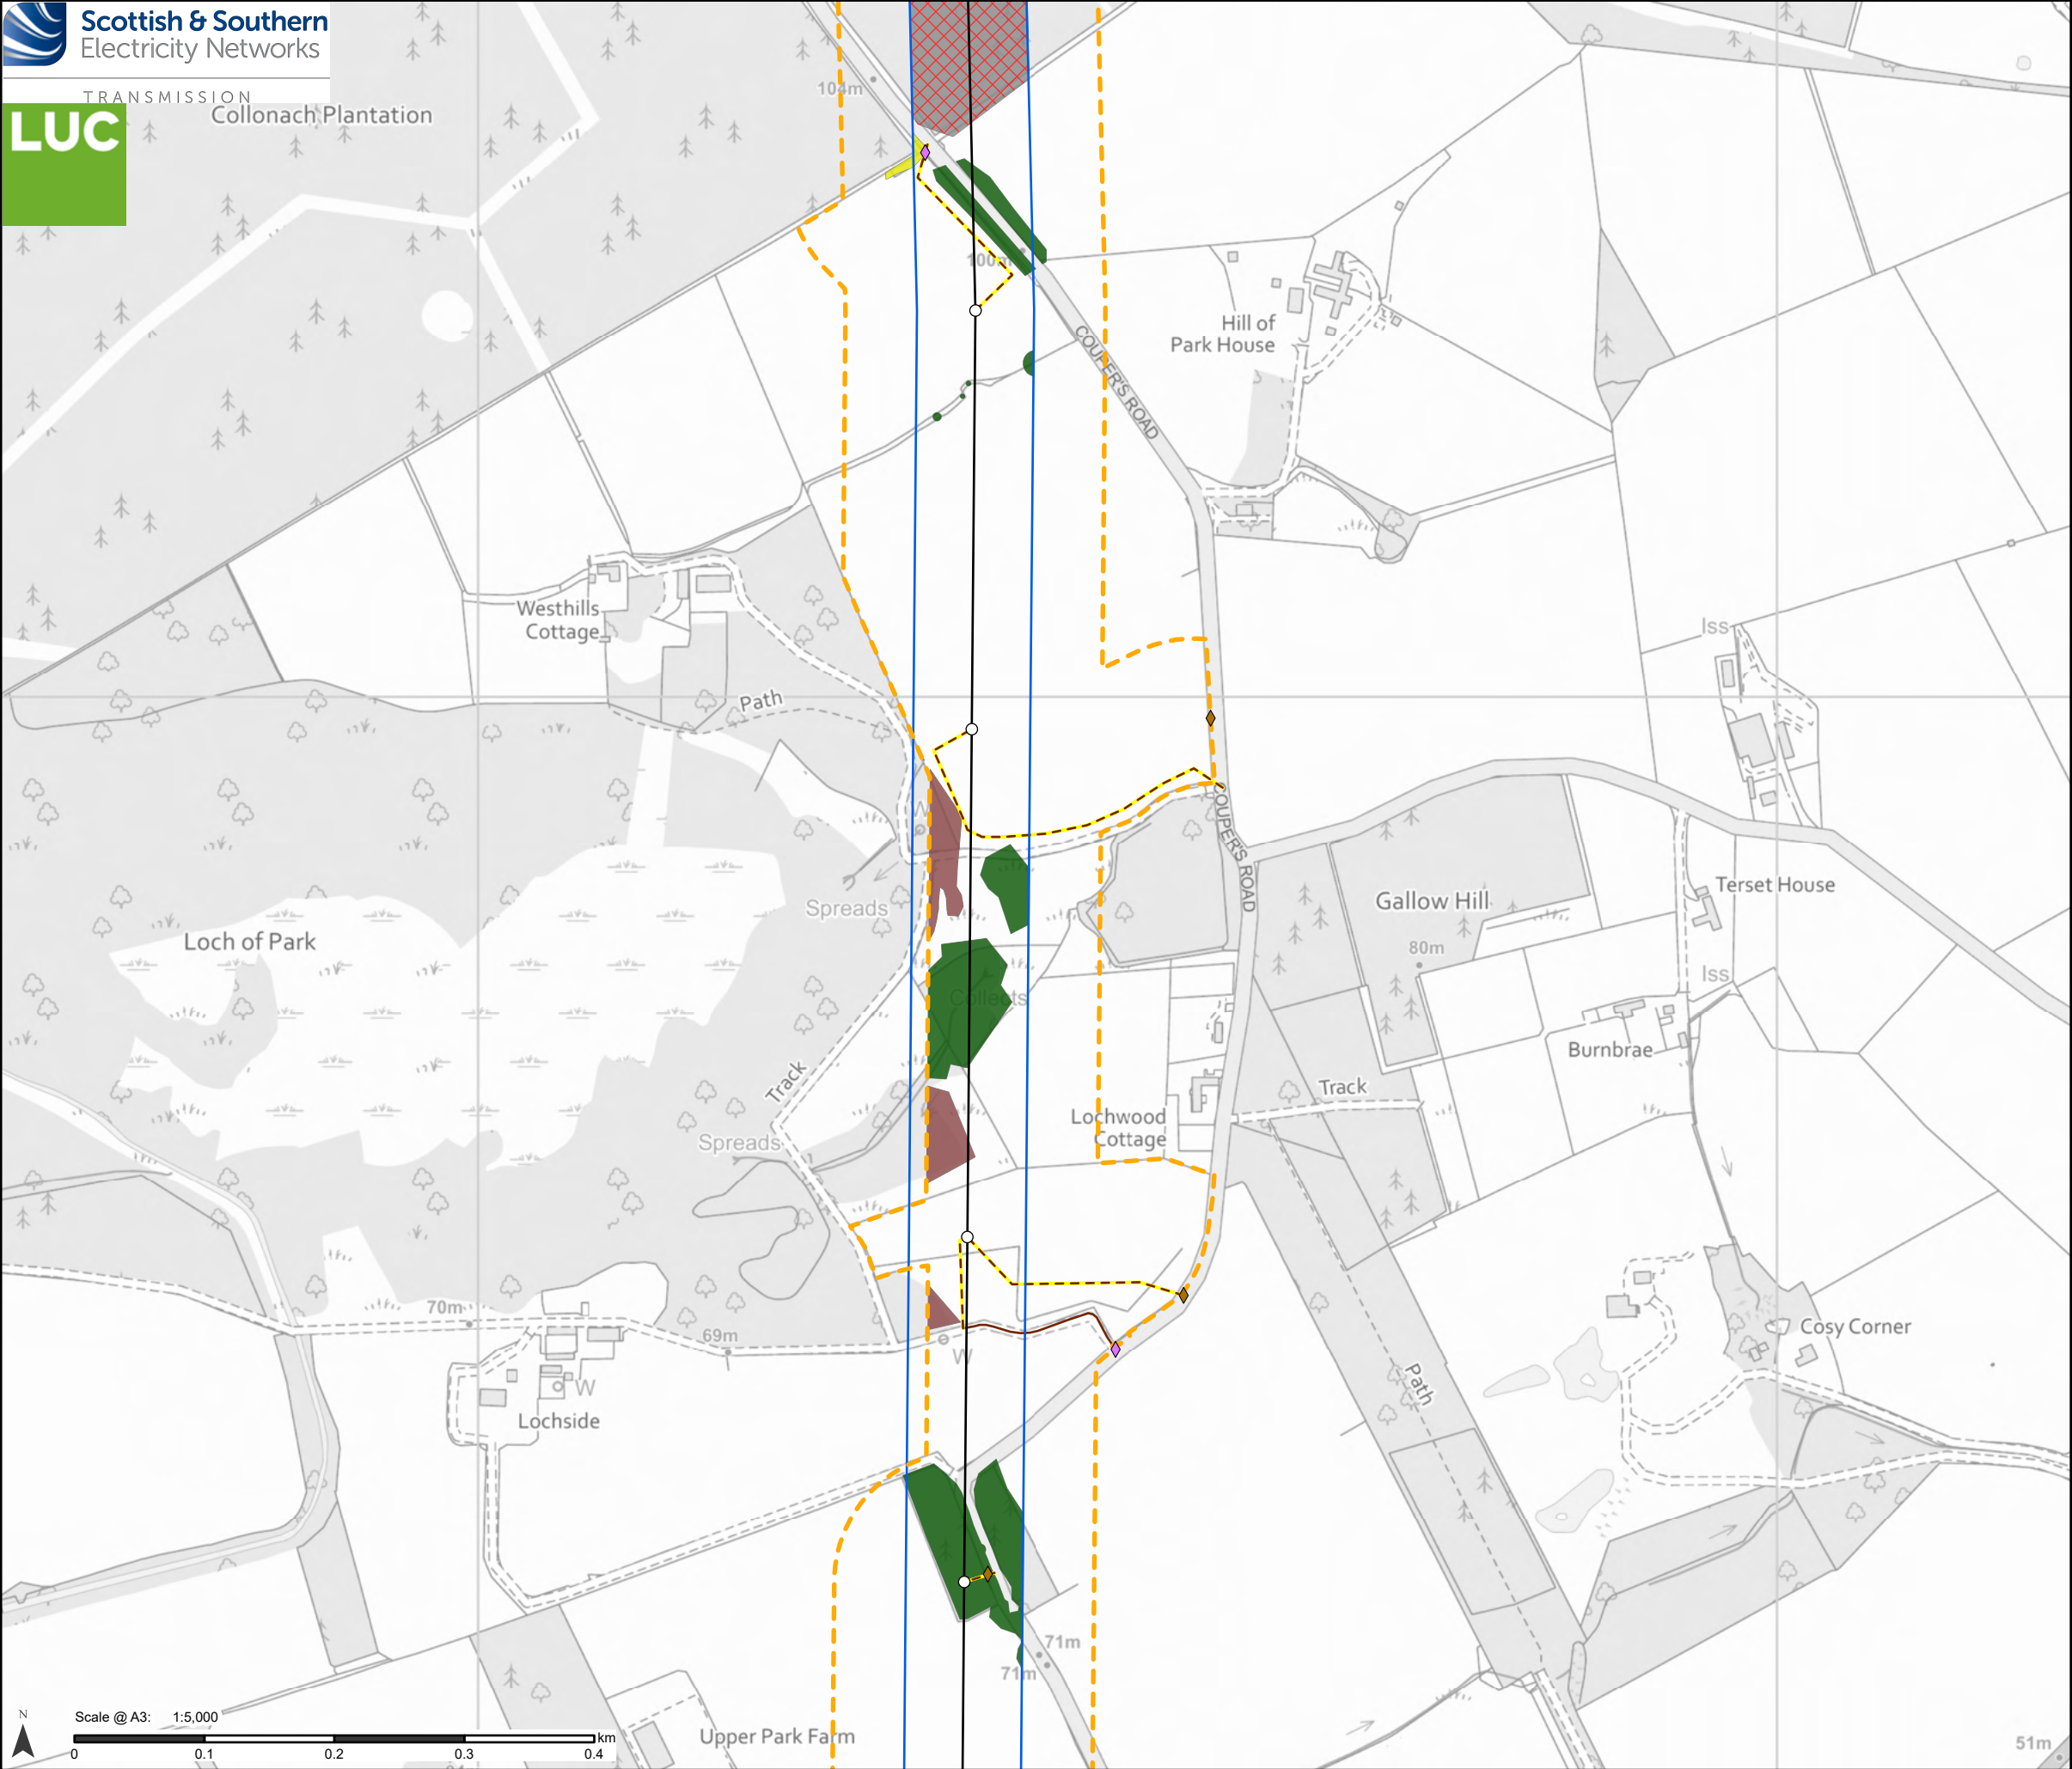

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone temporary

Bellmouth type


- Proposed new
- Existing to be upgraded

Restocking species

- Felled awaiting restock
- Mixed broadleaves
- Native mixed woodland
- Other conifer


Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

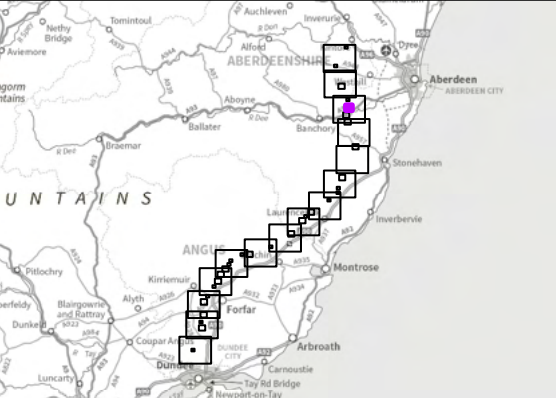

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Species Composition
Drawn by:	MS
Date:	20/08/2025
Drawing:	8.3.40

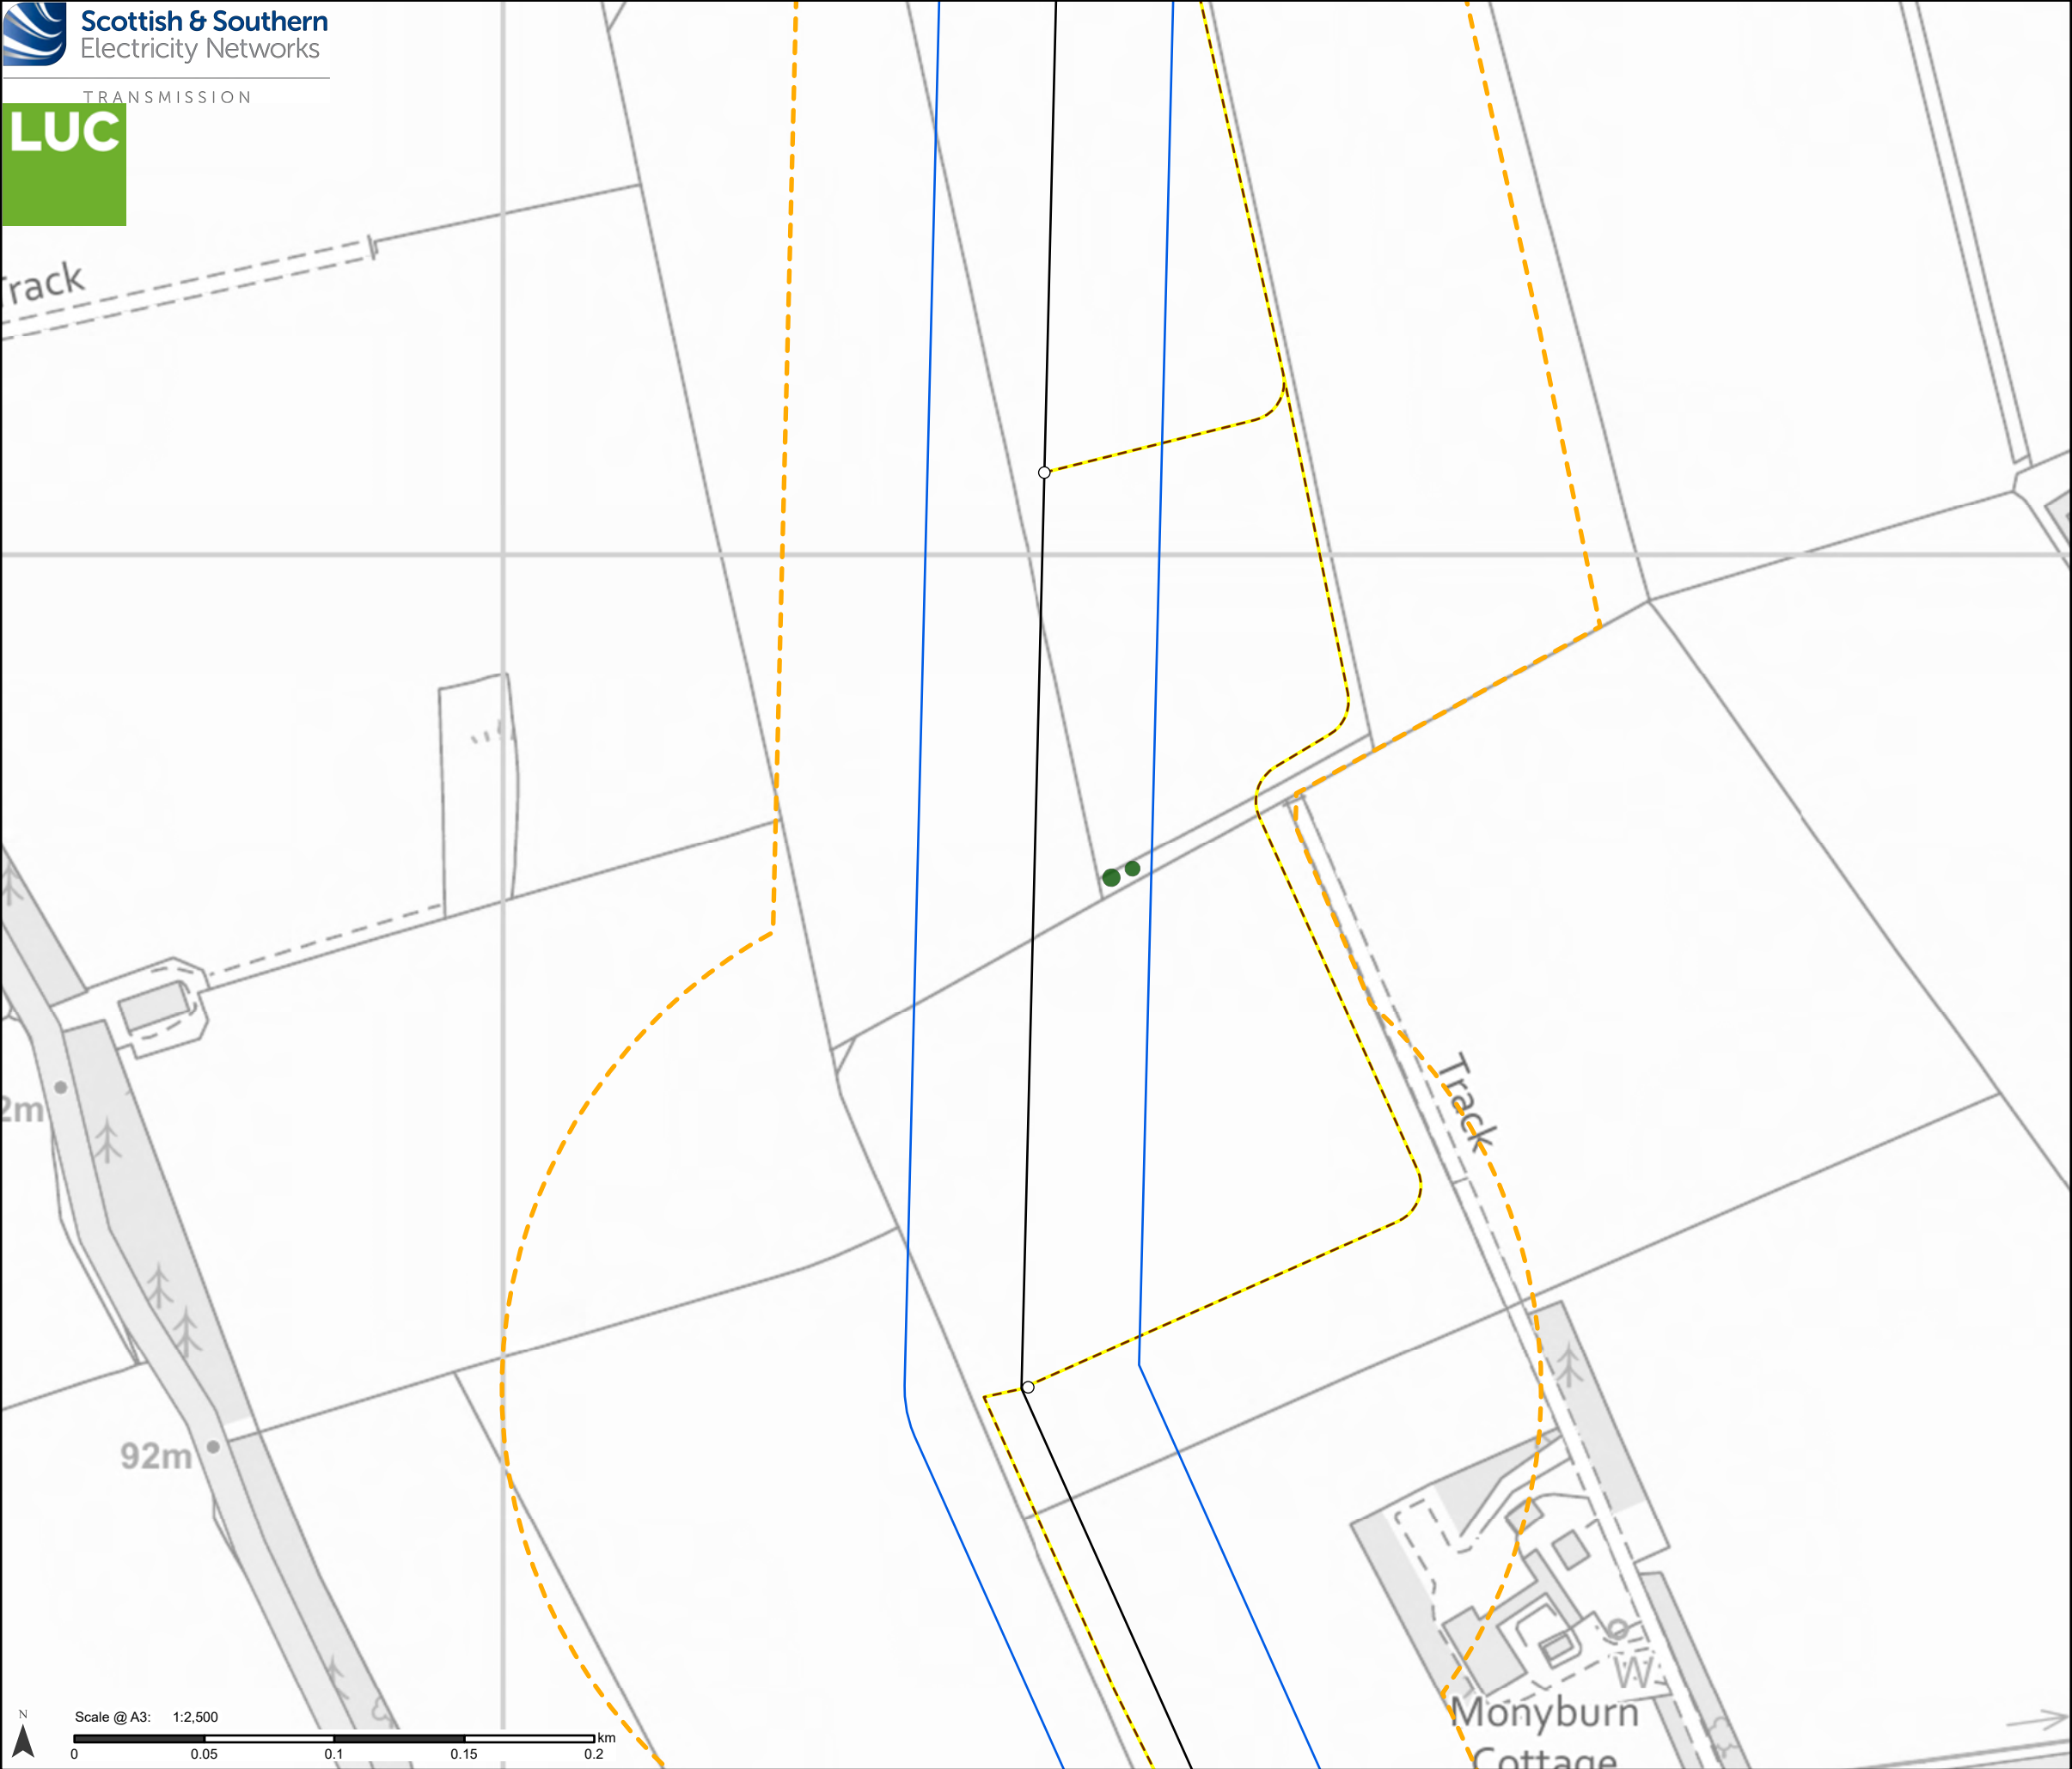

Proposed Development

 Tower Location

 Proposed Alignment

 Proposed Development Limit of Deviation (LOD)

 Operational Corridor

Access


 Proposed new stone temporary

Restocking species

 Mixed broadleaves

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

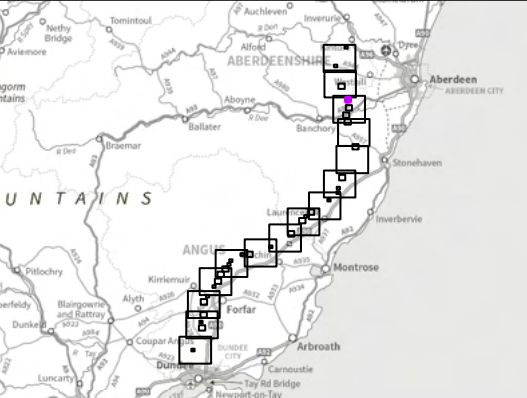

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Baseline Species Composition

Drawn by: MS

Date: 20/08/2025

Drawing: 8.3.41

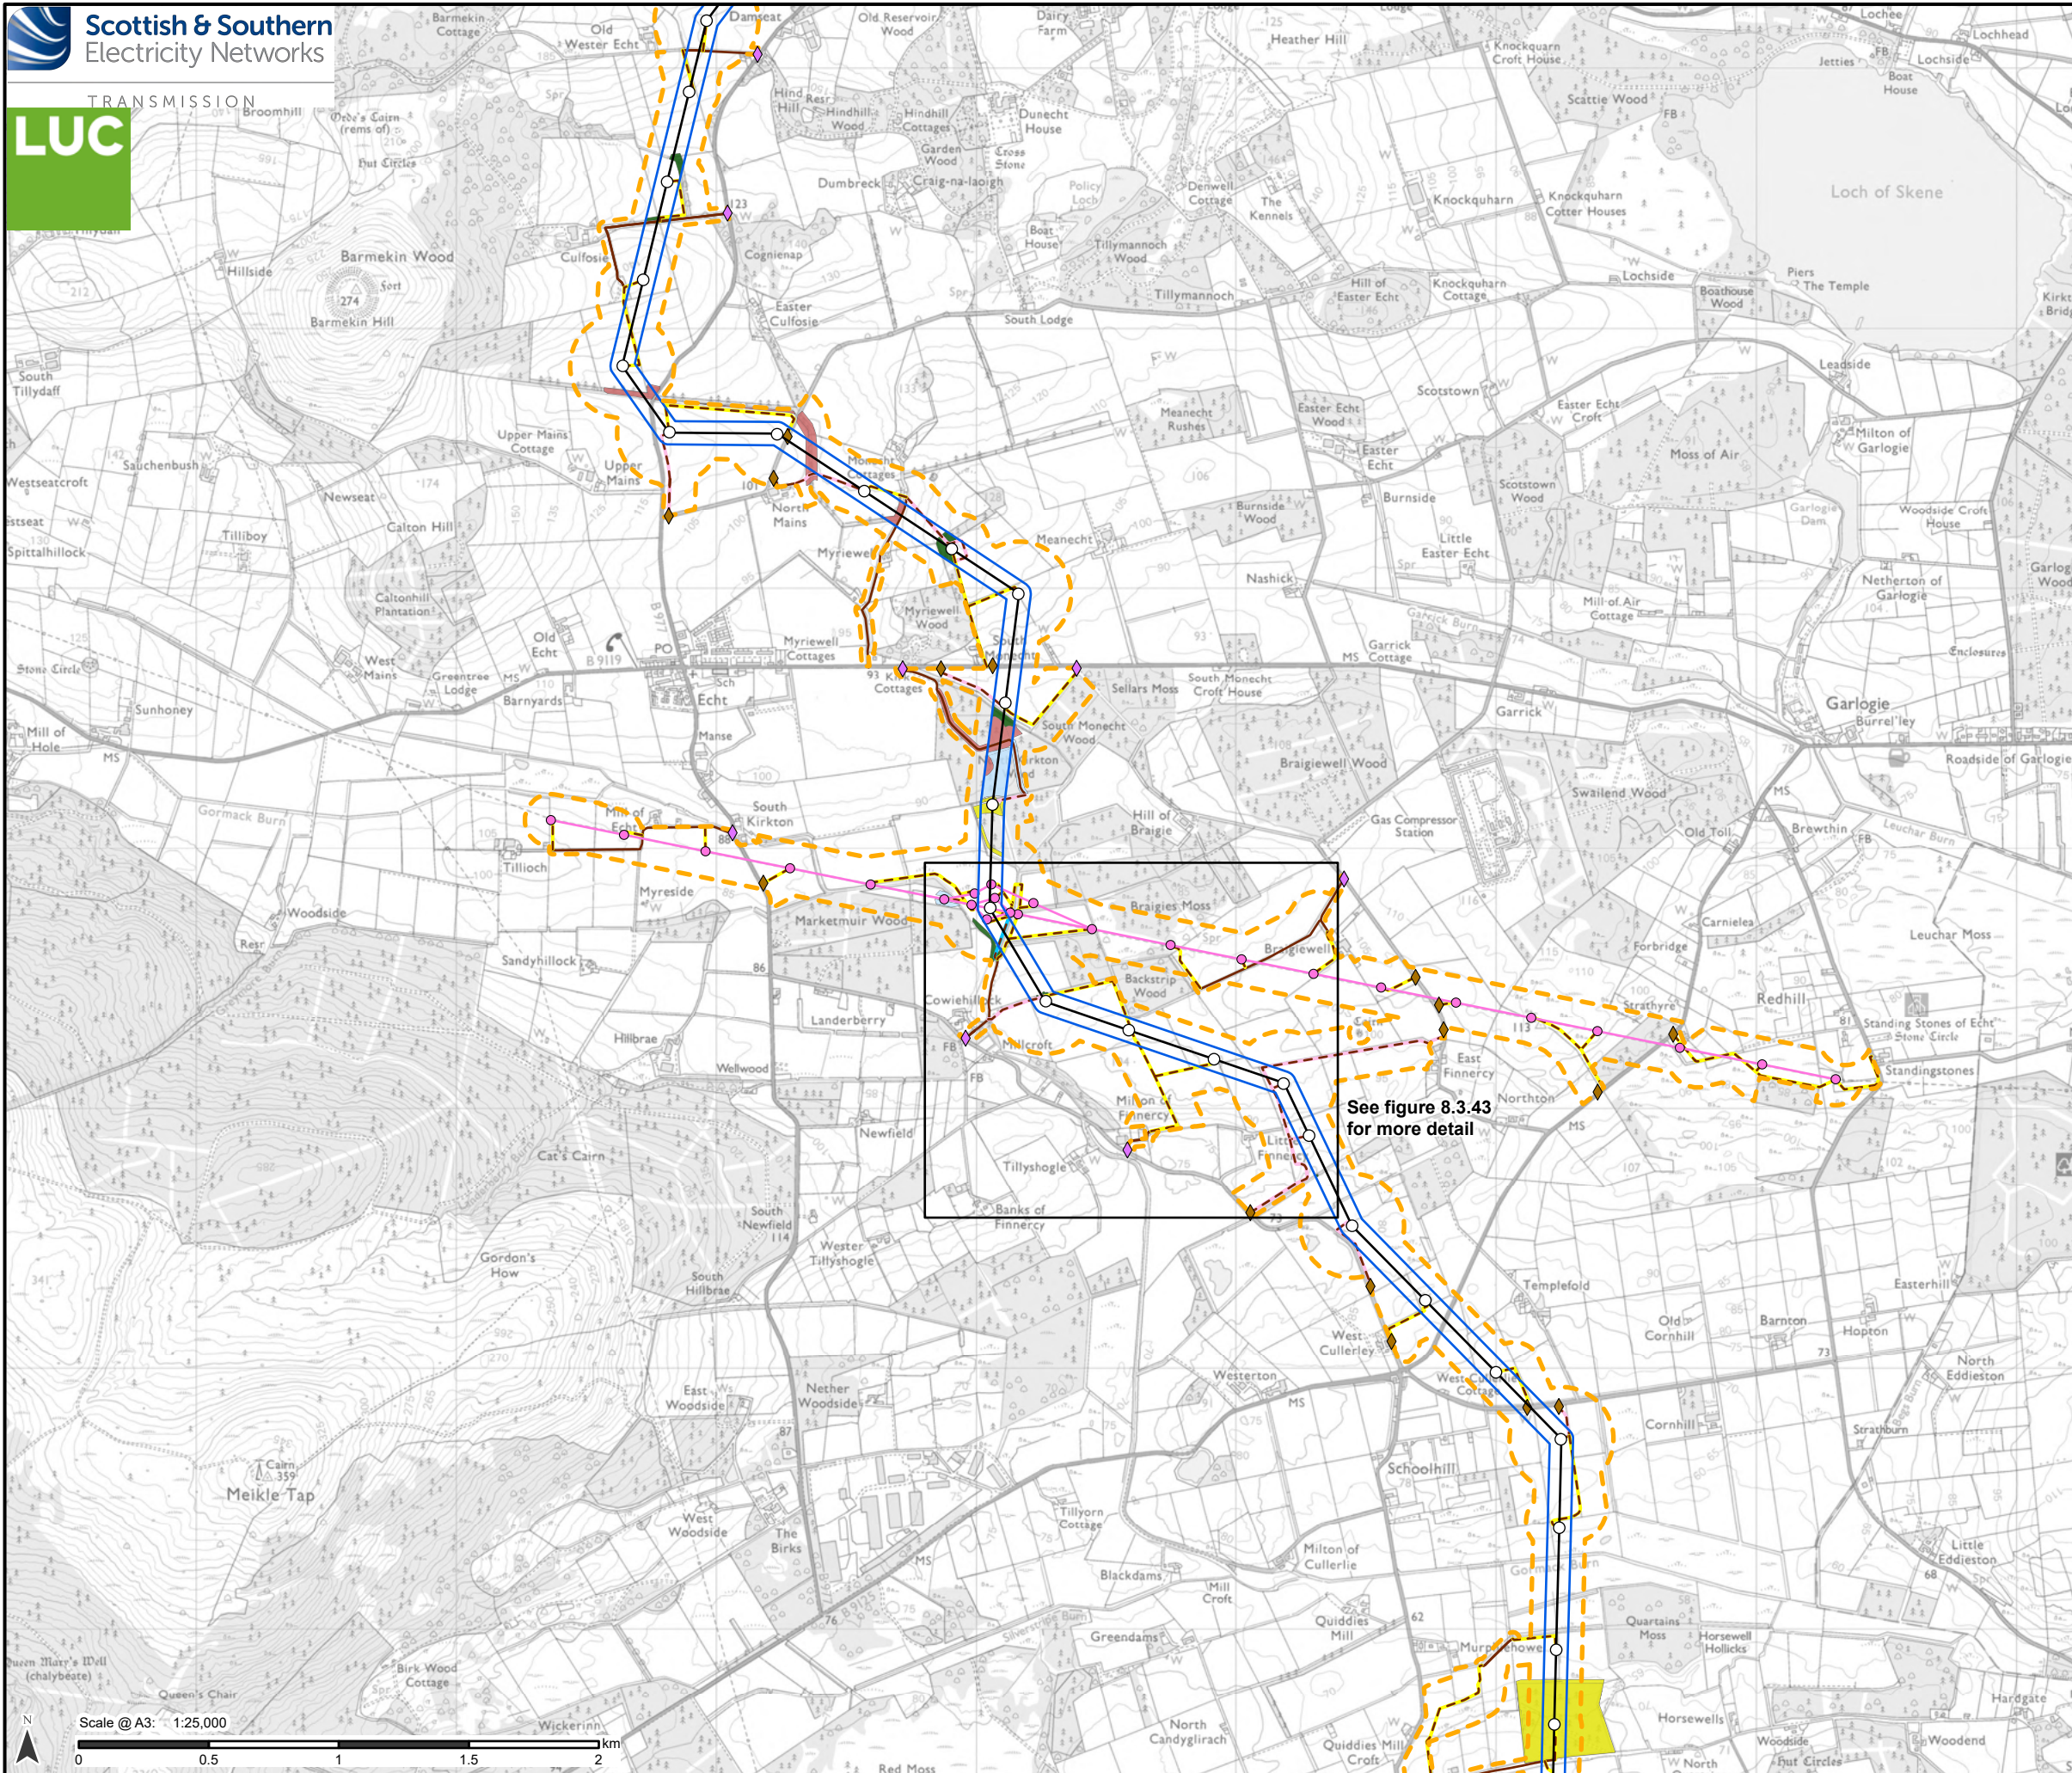

Proposed Development

- Tower Location
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Operational Corridor
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone permanent (operational and maintenance access track only - not for construction)
 - Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Craigiebuckler - Tarland 132 kV Overhead Line Crossing

- Tower Location
- Overhead Line (OHL)


Restocking species

- Mixed broadleaves
- Mixed woodland
- Other conifer
- Sitka spruce

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

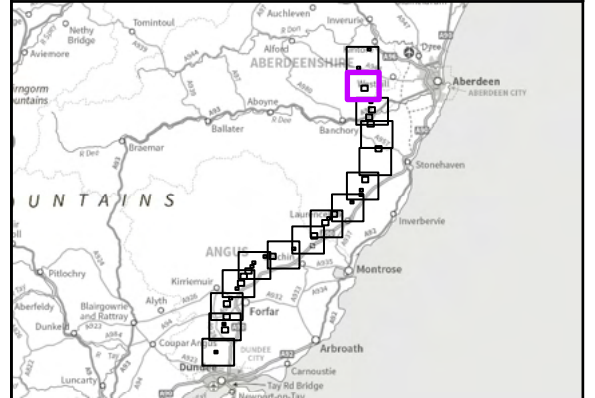


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Baseline Species Composition

Drawn by: MS Date: 20/08/2025

Drawing: 8.3.42

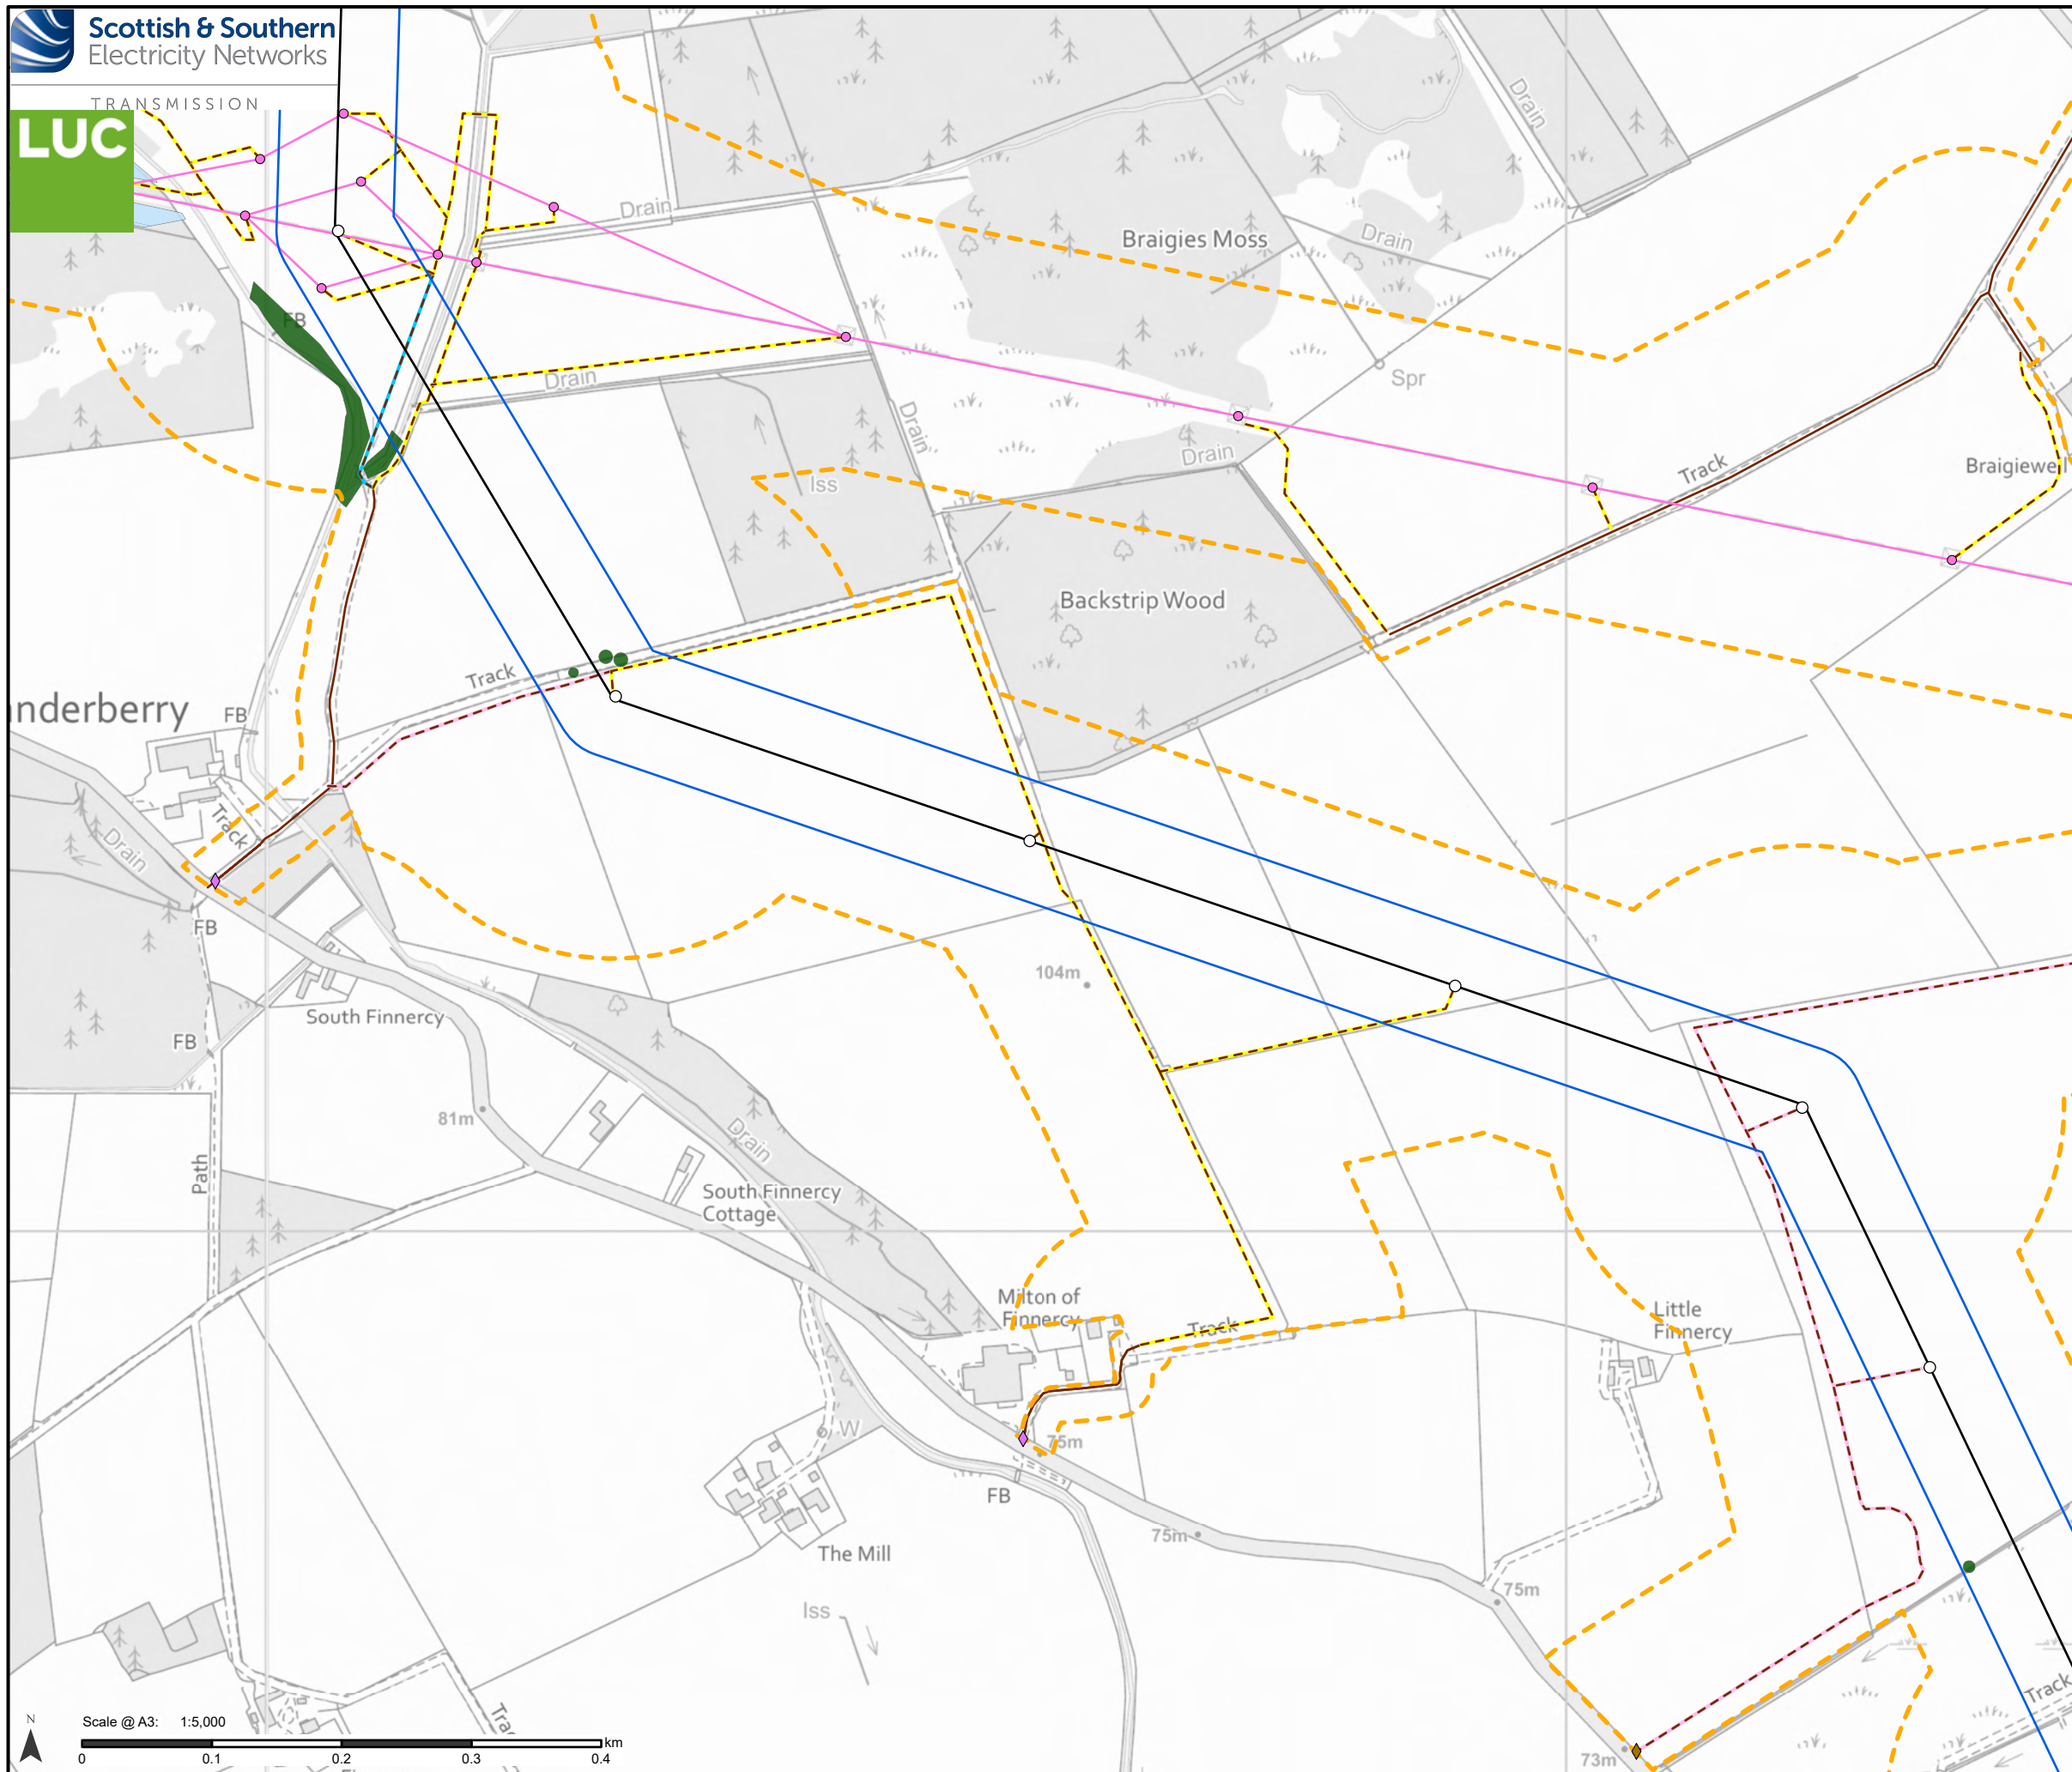

- Tower Location
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ▭ Operational Corridor

- Existing to be upgraded
- - - Proposed new stone permanent
- Proposed new stone permanent
(operational and maintenance access track
only - not for construction)
- - - Proposed new stone temporary


- ◆ Proposed new
- ◆ Existing to be upgraded

- Tower Location
- Overhead Line (OHL)

Mixed broadleaves
Sitka spruce

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

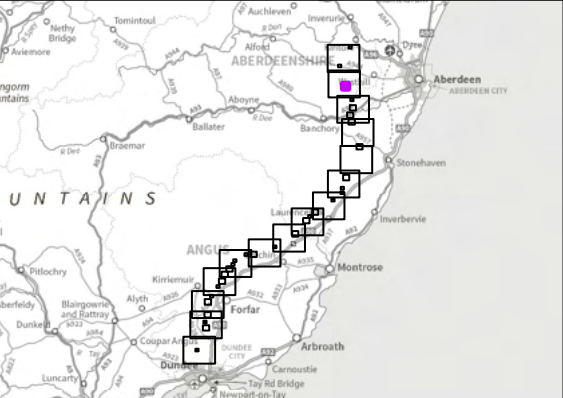


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
**SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title: Baseline Species Composition

Drawn by: MS Date: 20/08/2025

Drawing: 8.3.43

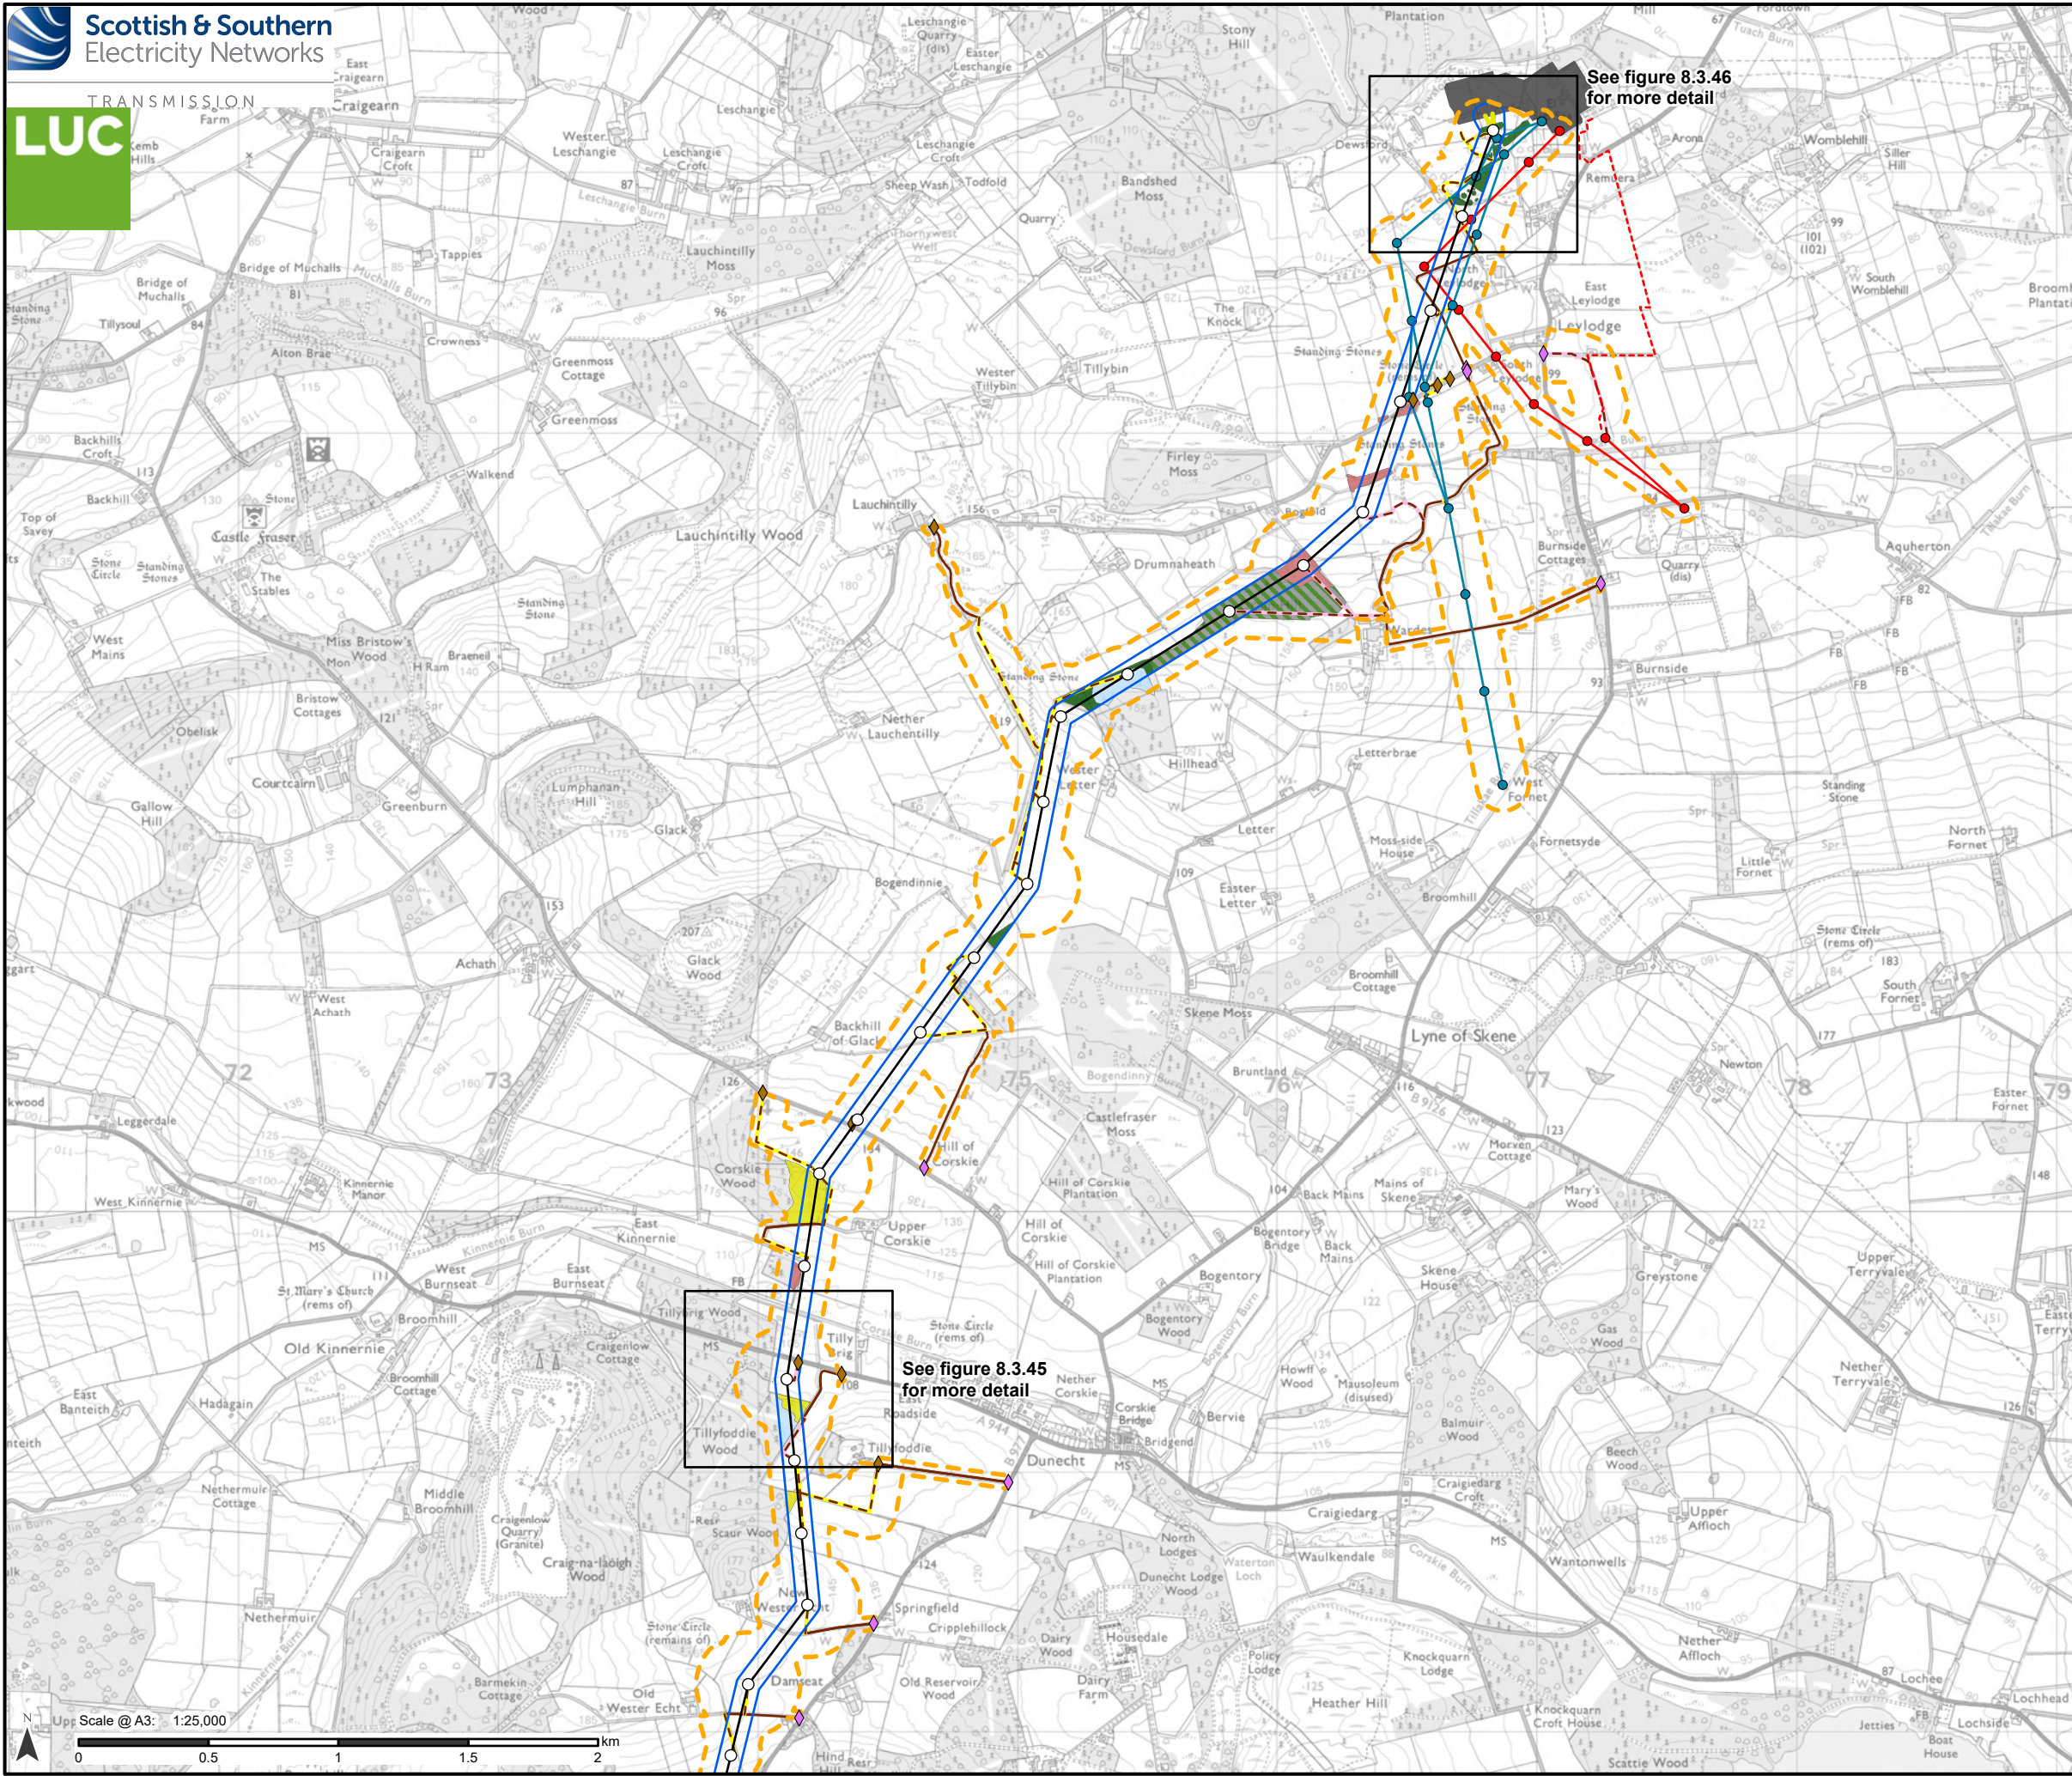

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- - - Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Additional development included in Section 37 application: Kintore - Craigiebukler 132 kV

- Tower Location
- OHL

Existing/Other Infrastructure

- Existing Kintore Substation

Permitted Development (not part of this Proposed Development)

- - - Proposed underground cable (indicative)

Restocking species

- Mixed broadleaves
- Mixed woodland
- Other conifer
- Scrub/Regen
- Sitka spruce

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Baseline Species Composition


Drawn by: MS

Date: 20/08/2025

Drawing: 8.3.44

810000m.N

810000m.N

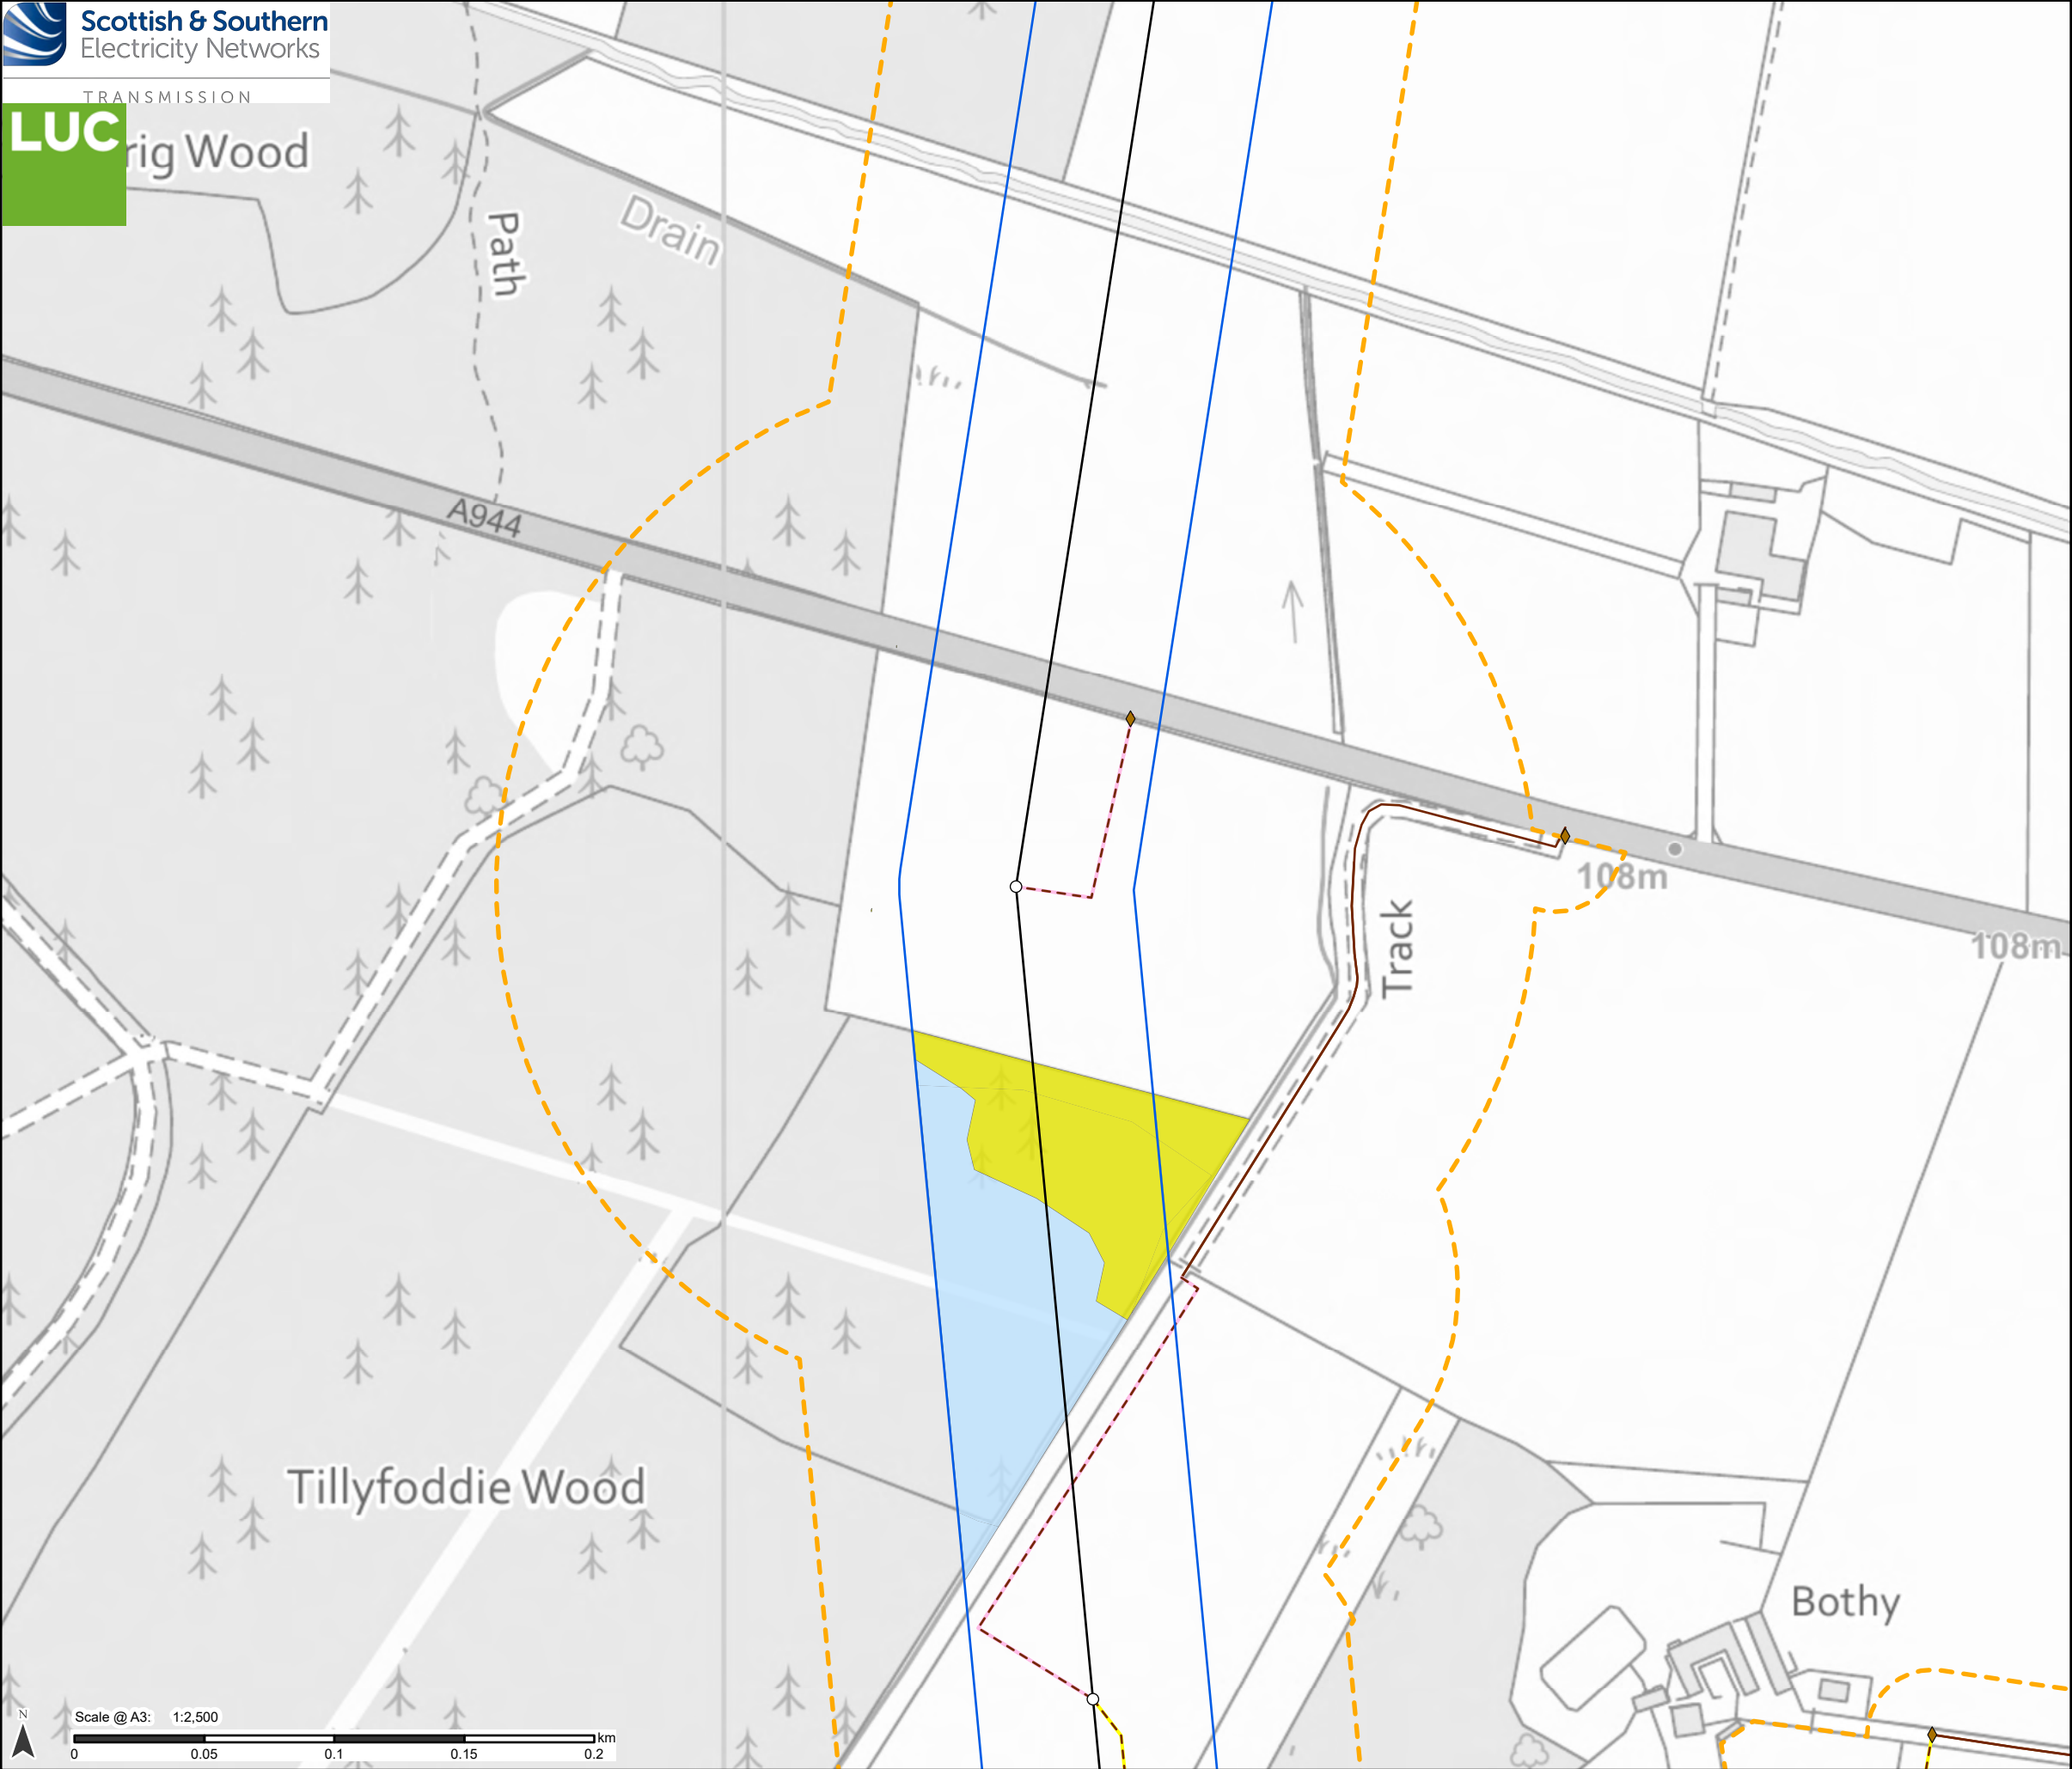

Proposed Development

 Tower Location

 Proposed Alignment

 Proposed Development Limit of Deviation (LOD)

 Operational Corridor

Access

 Existing to be upgraded

 Proposed new stone permanent

 Proposed new stone temporary

Bellmouth type

 Proposed new


Restocking species

 Other conifer

 Sitka spruce


Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

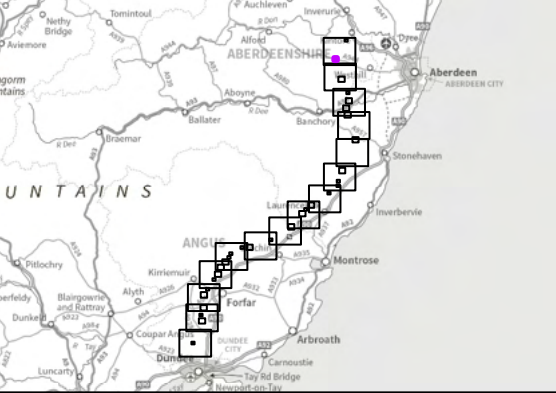

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Baseline Species Composition
Drawn by:	MS
Date:	20/08/2025
Drawing:	8.3.45

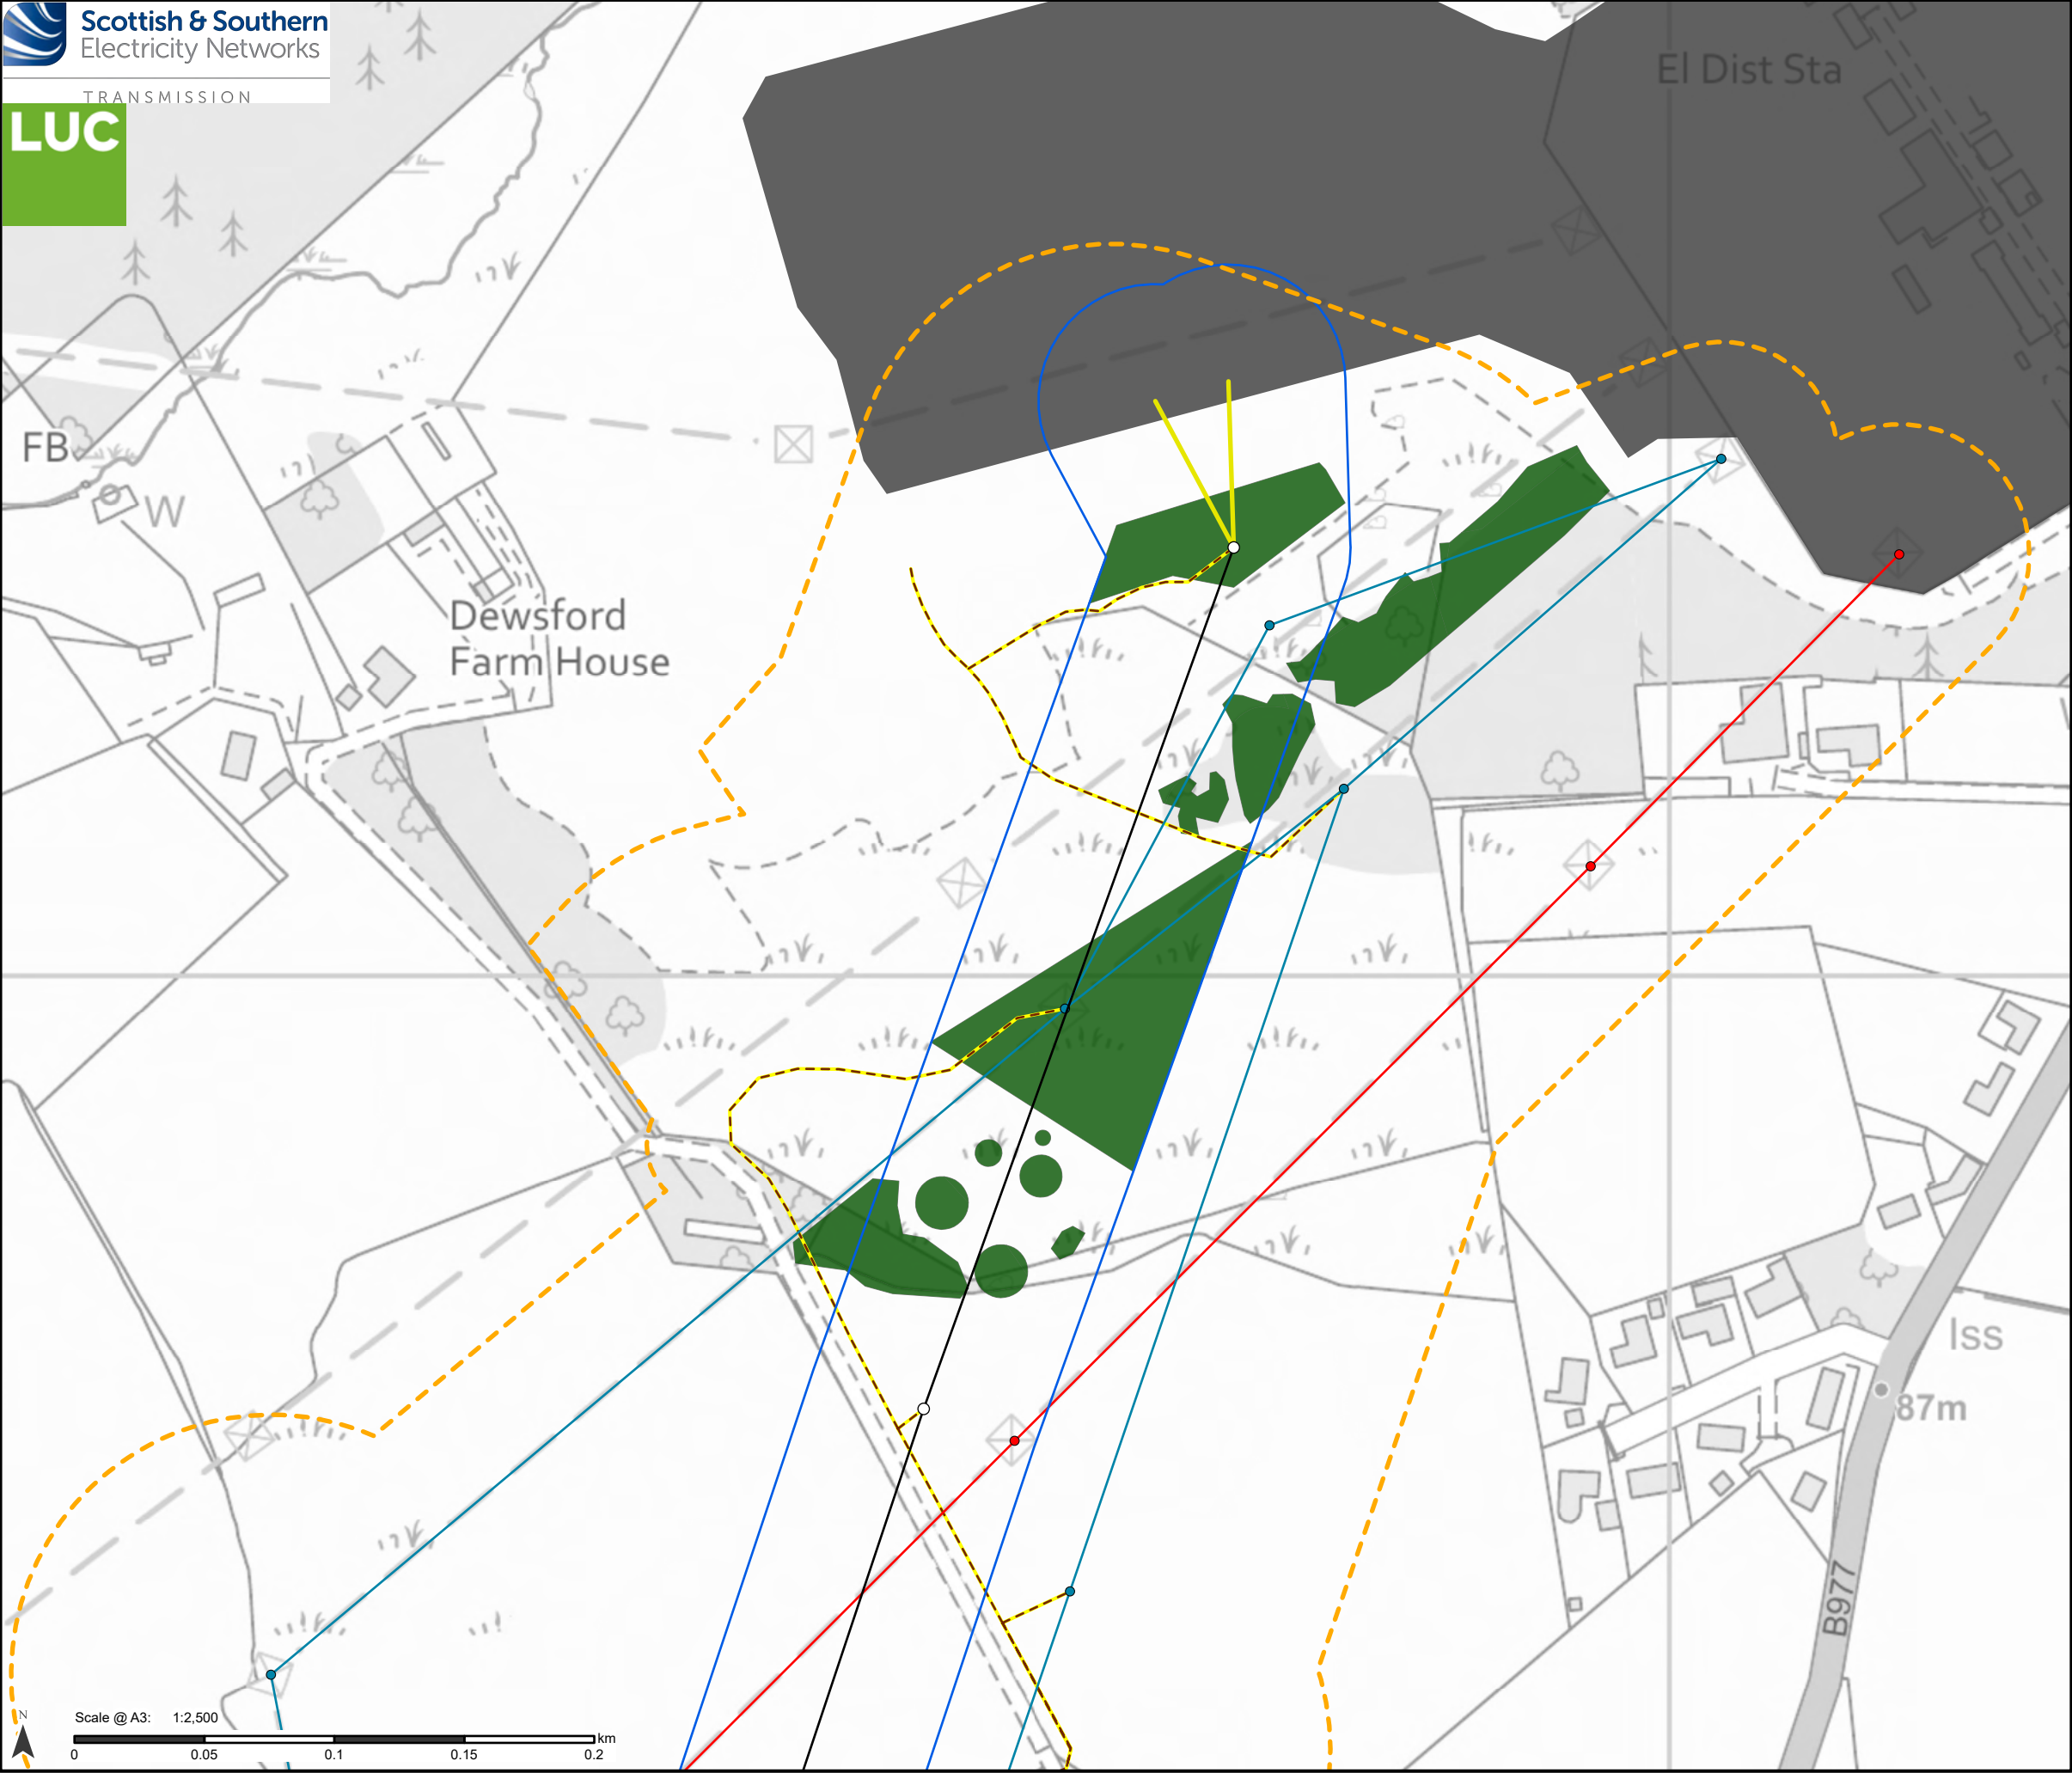

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone temporary

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Additional development included in Section 37 application: Kintore - Craigiebuckler 132 kV

- Tower Location
- OHL

Existing/Other Infrastructure


- Existing Kintore Substation

Restocking species

- Mixed broadleaves

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

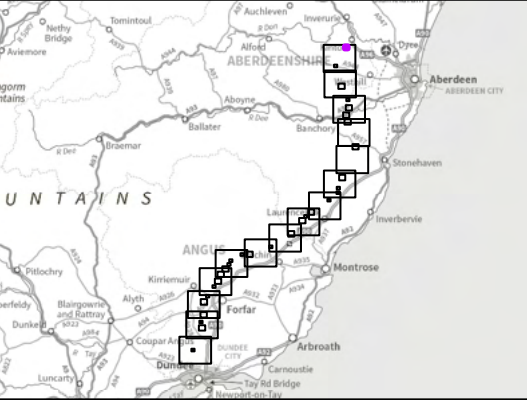

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Baseline Species Composition

Drawn by: MS Date: 20/08/2025

Drawing: 8.3.46