


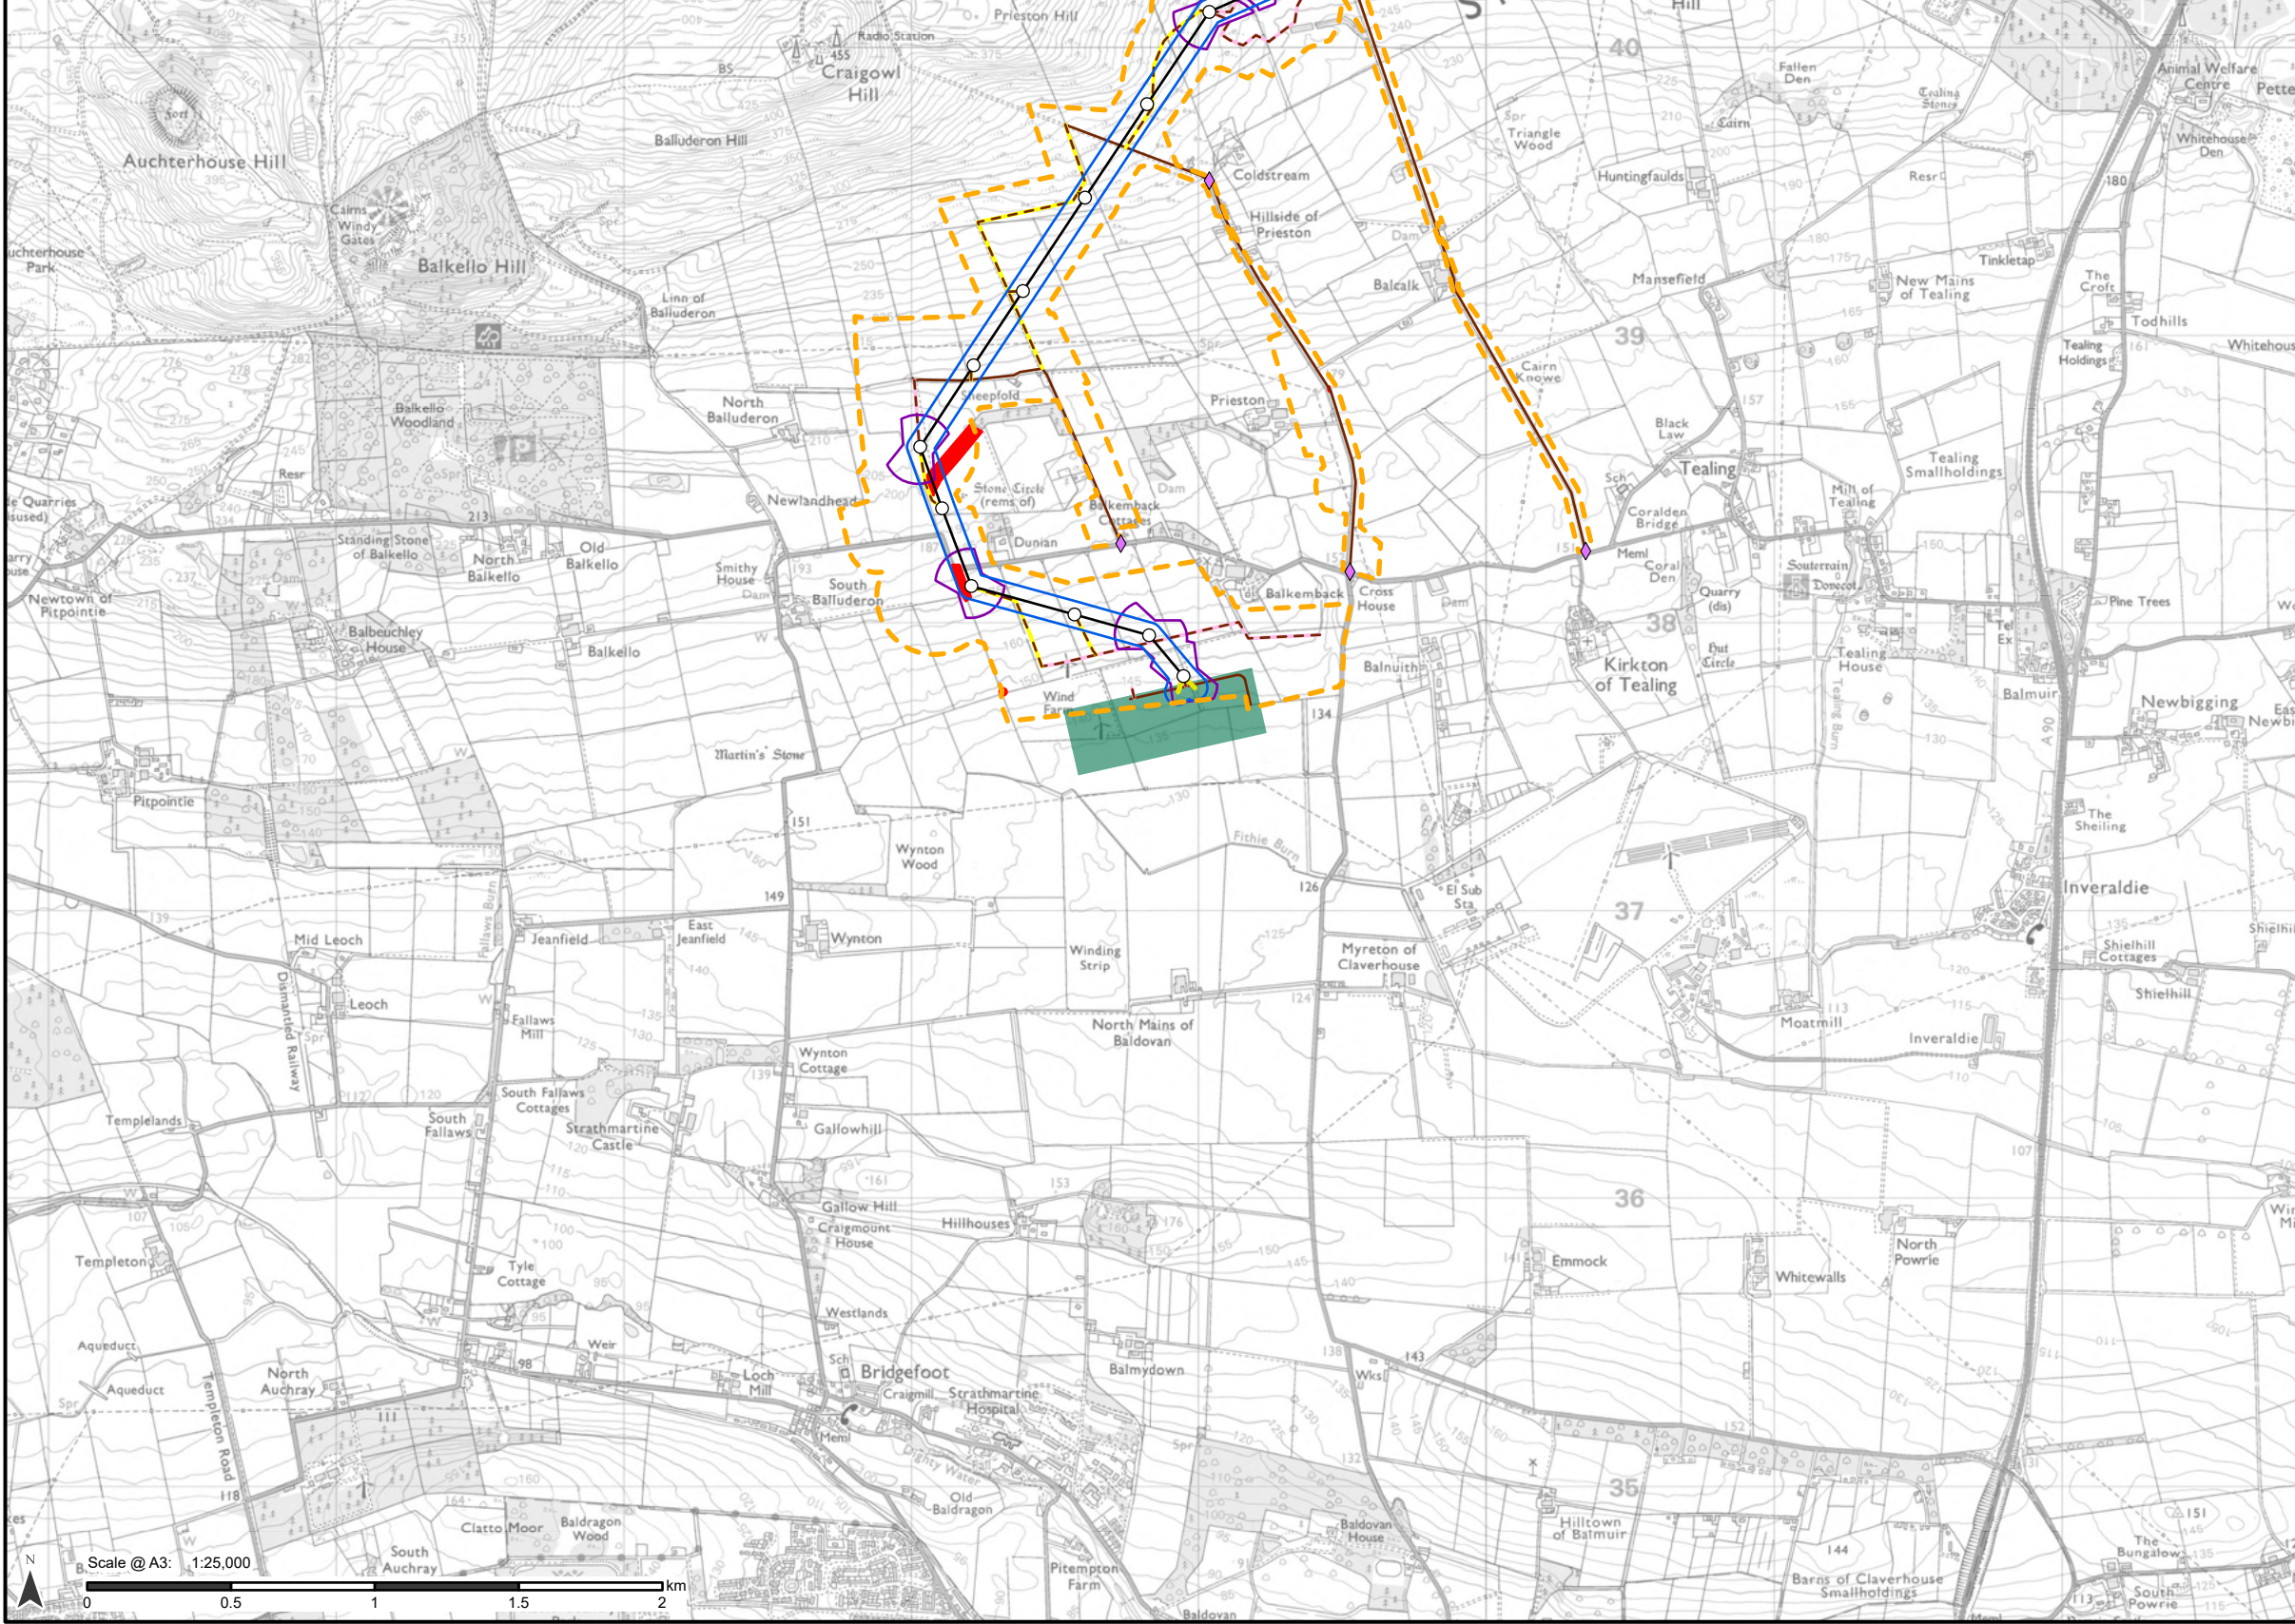

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- - - Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Intra (Associated) Developments

- Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/FULN)

Felling

- Infrastructure felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.


The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIA. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.



Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Felling Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.4.1

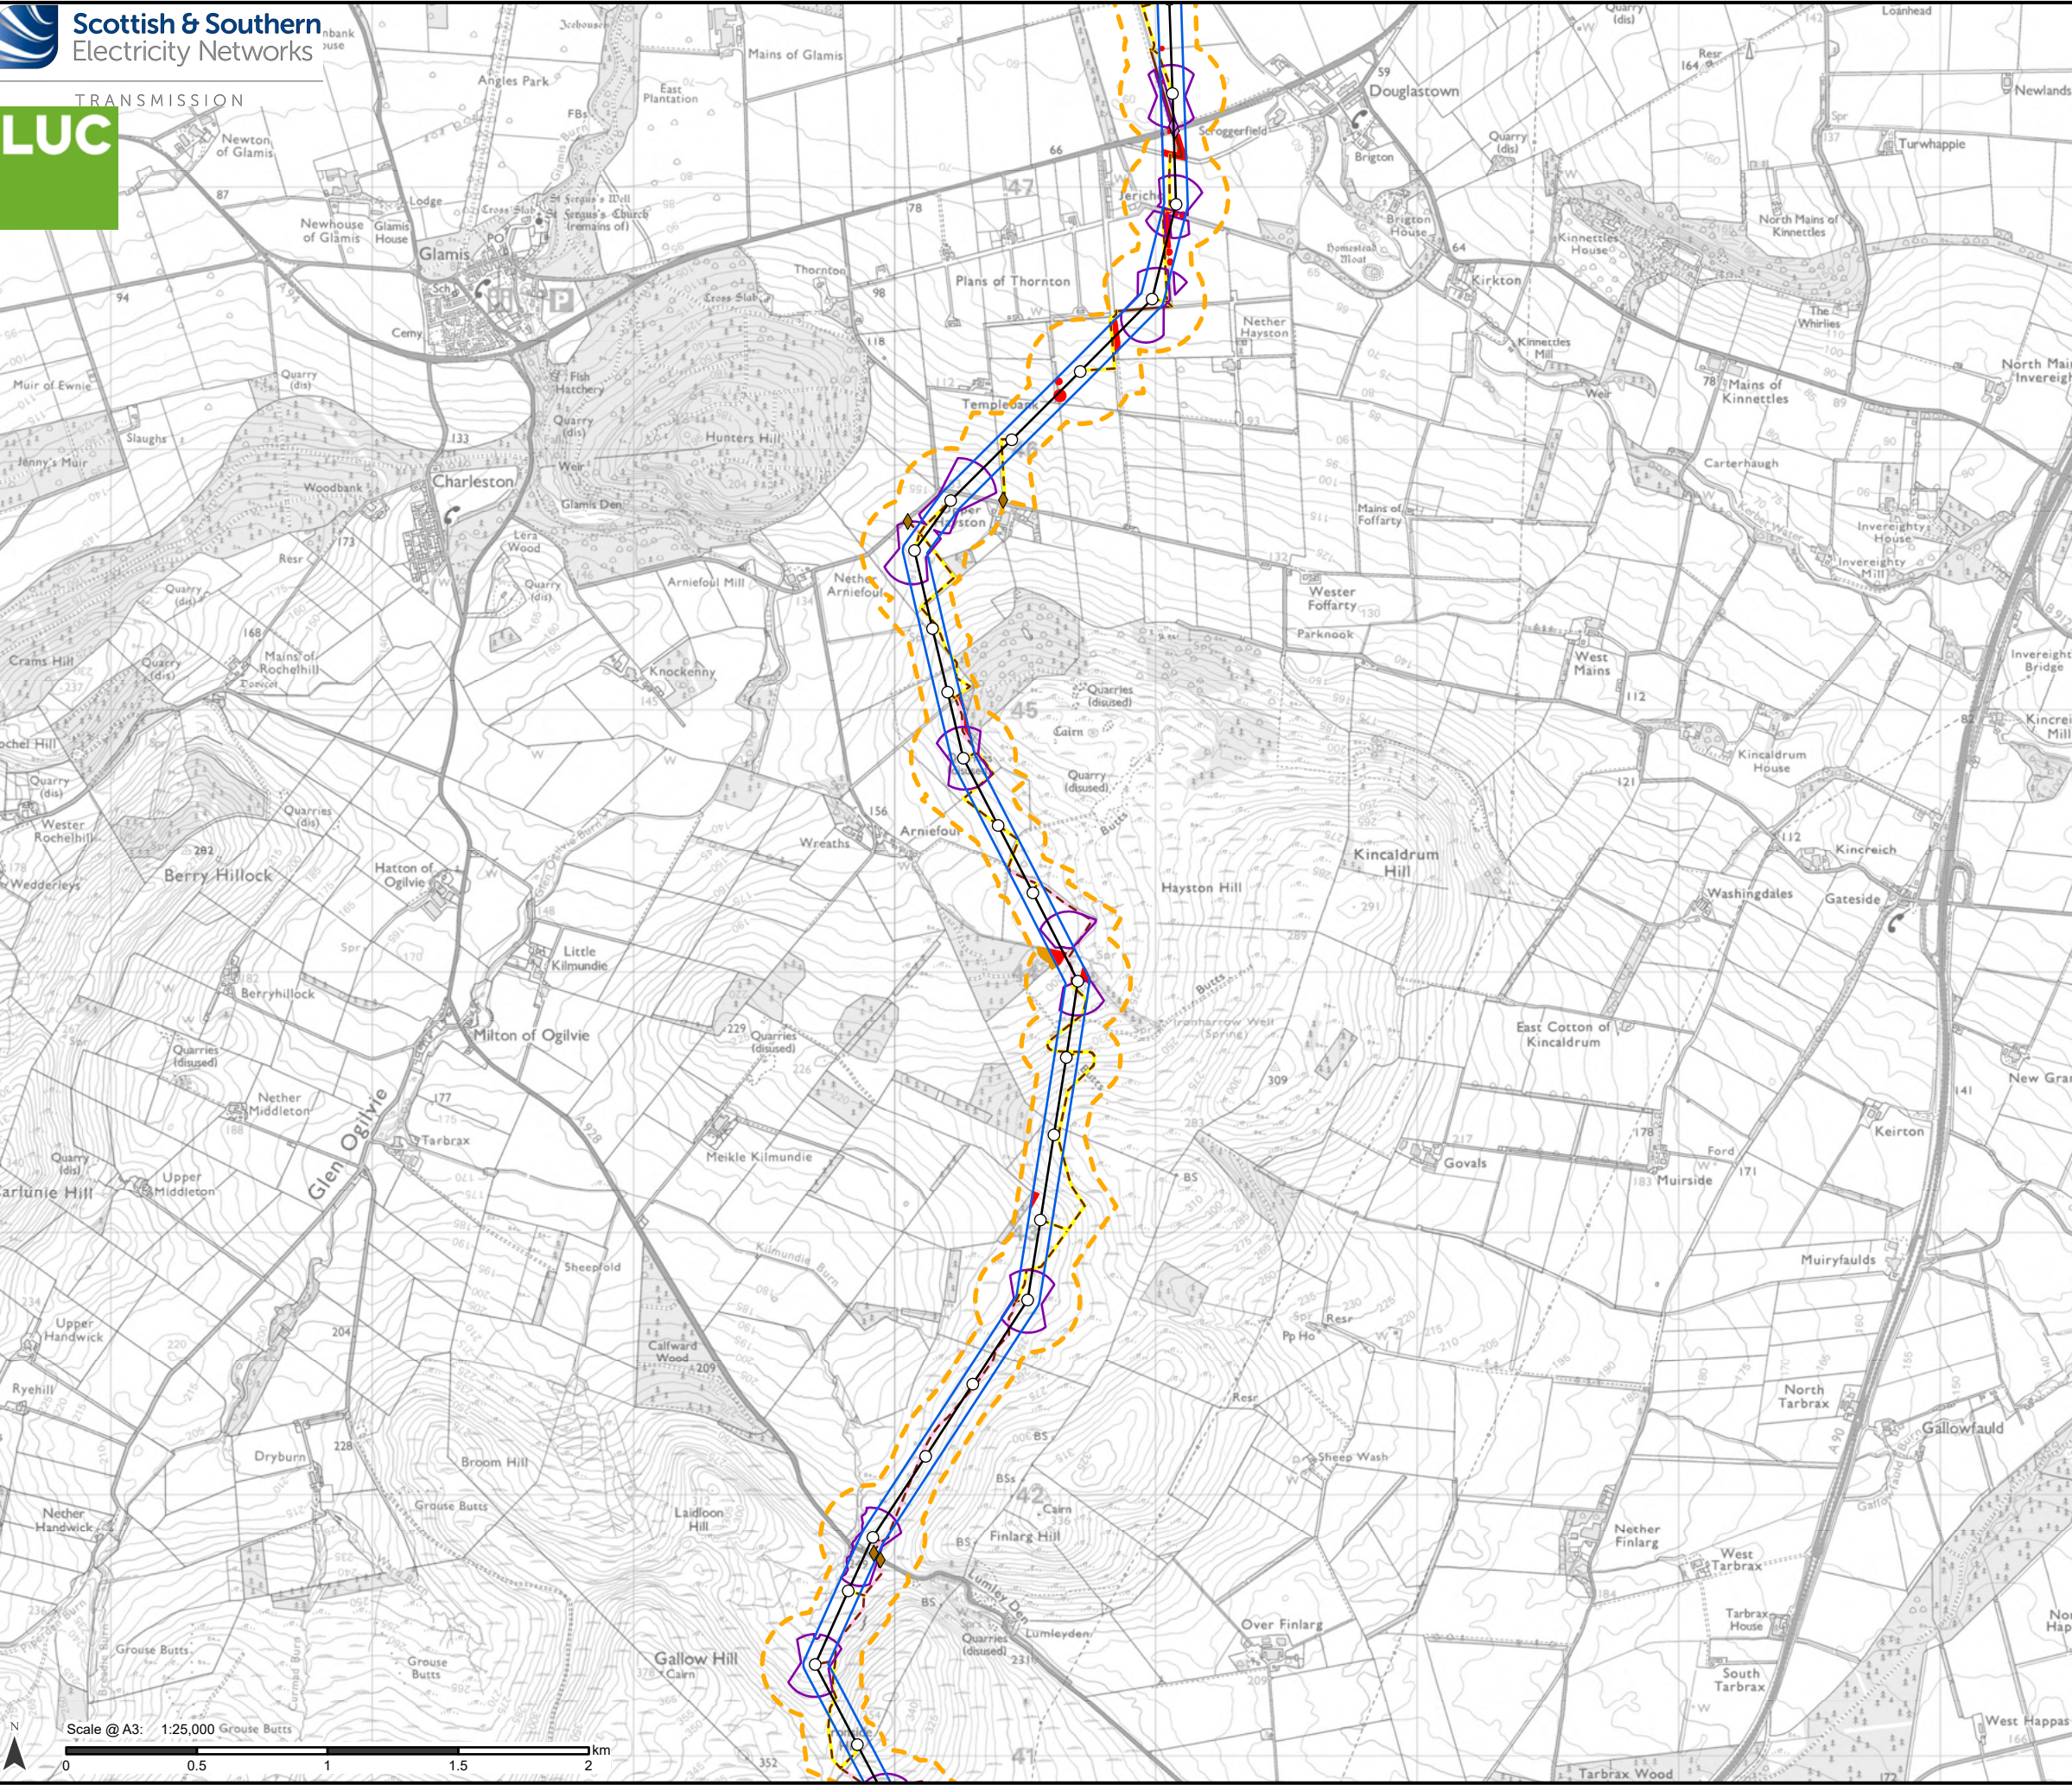

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Felling


- Infrastructure felling
- Management felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIAR. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

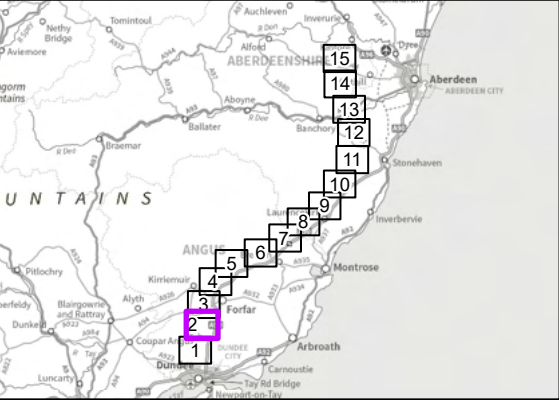


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Felling Plan

Drawn by: MS Date: 19/08/2025
Drawing: 8.4.2

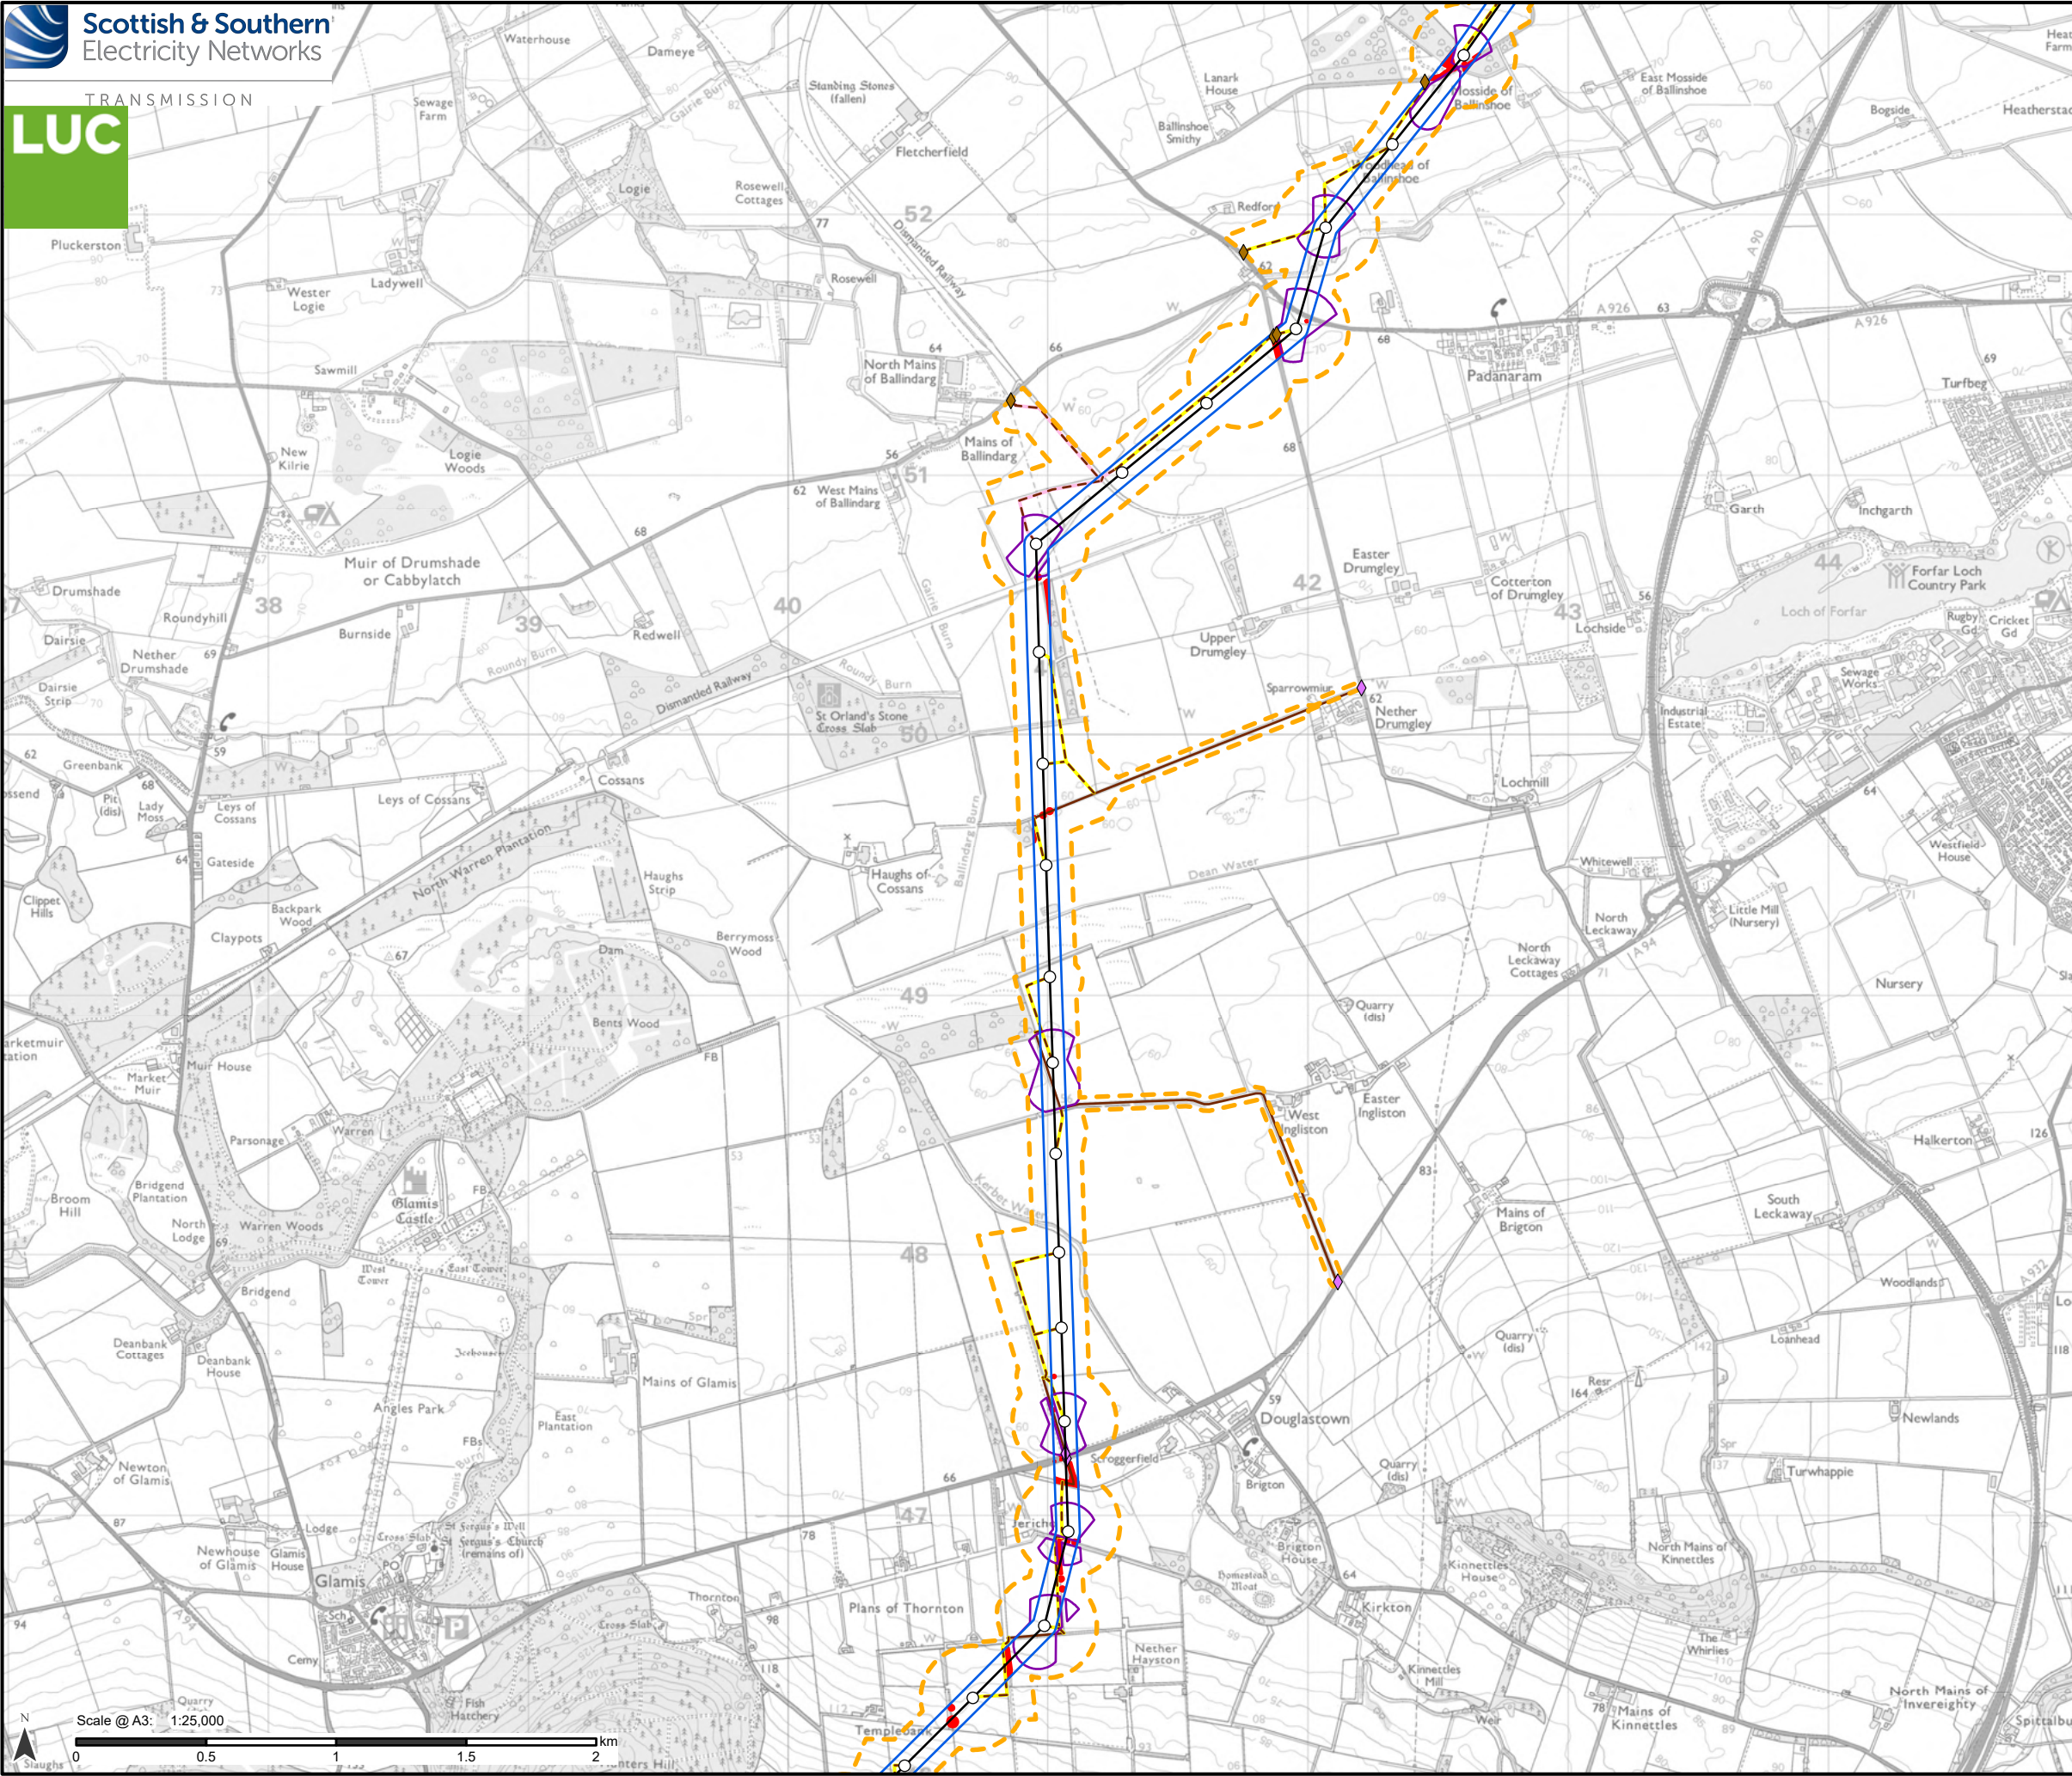

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- Proposed new
- Existing to be upgraded

Felling


- Infrastructure felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIA. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

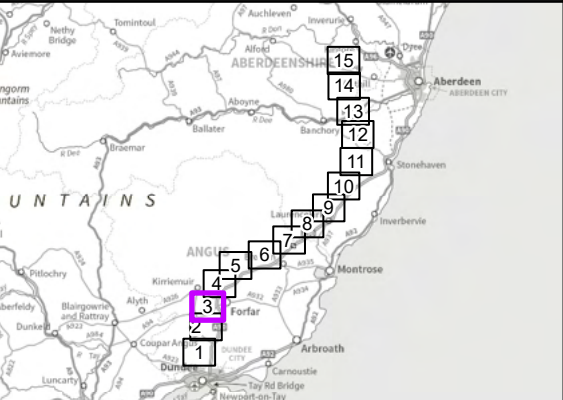


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Felling Plan

Drawn by: MS Date: 19/08/2025
Drawing: 8.4.3

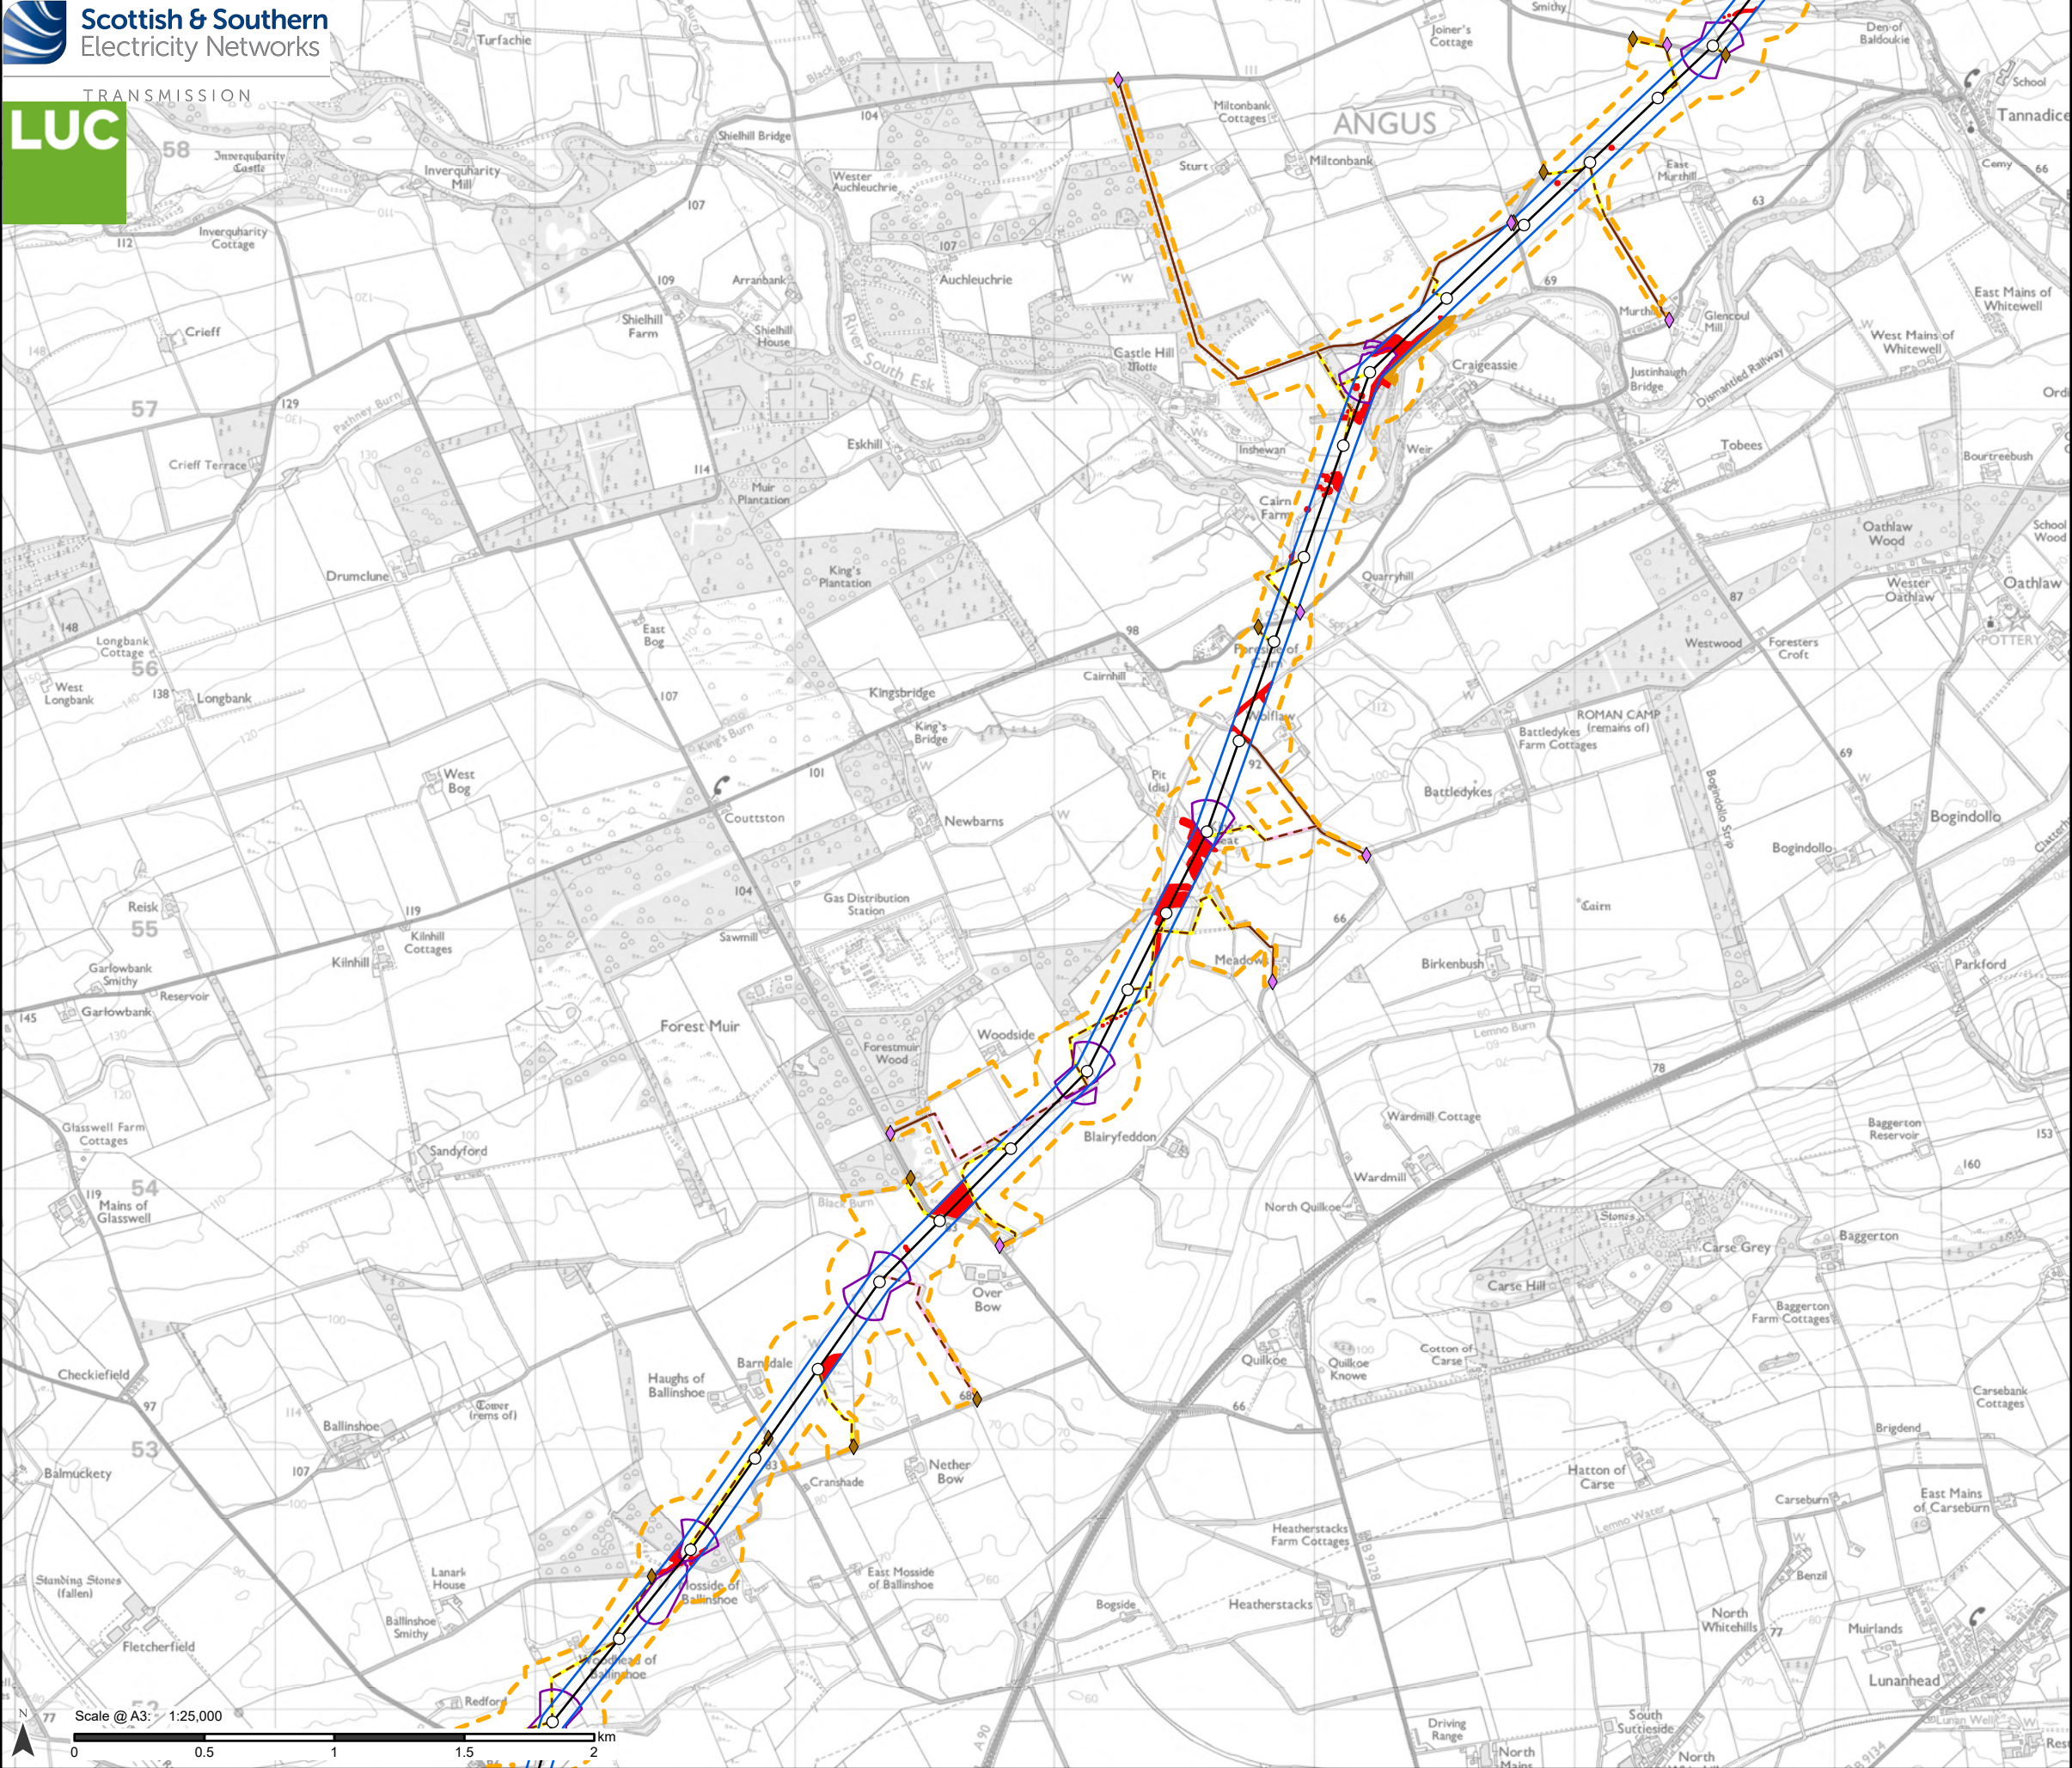

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Felling


- Infrastructure felling
- Management felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIAR. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

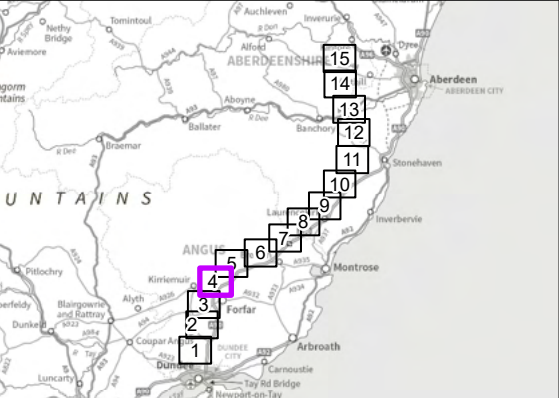


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Felling Plan

Drawn by: MS Date: 19/08/2025
Drawing: 8.4.4

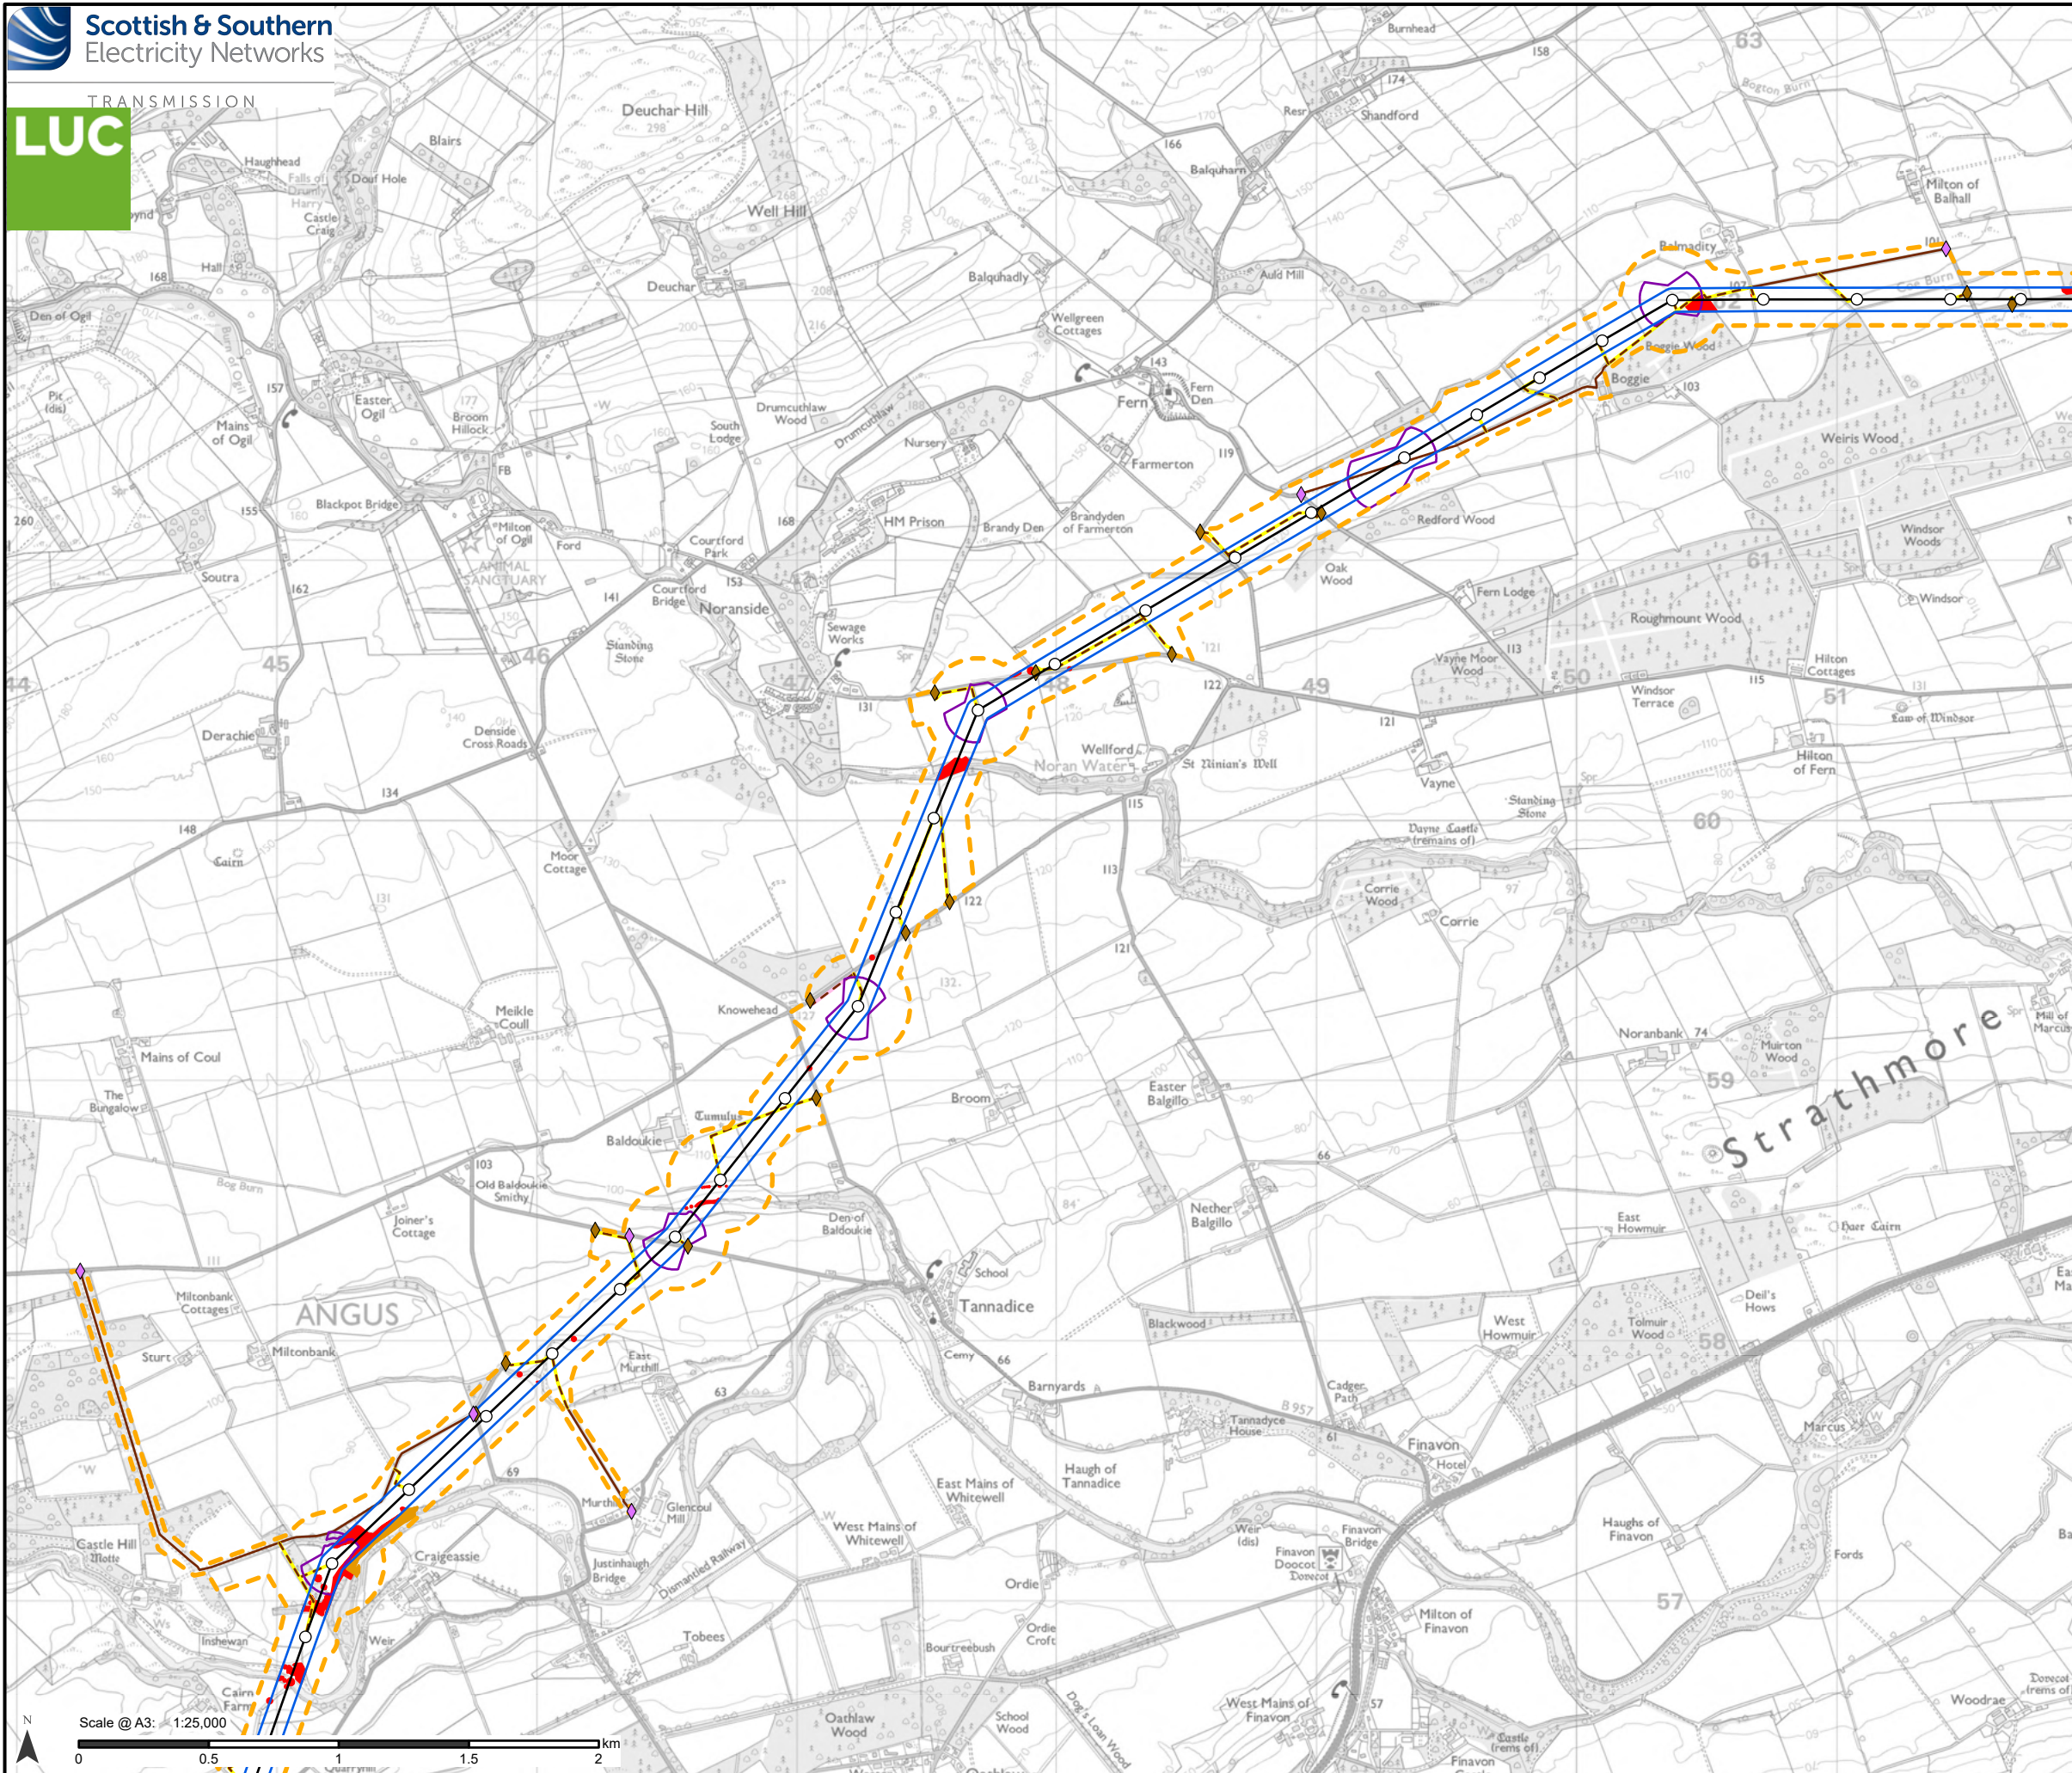

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Felling


- Infrastructure felling
- Management felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIAR. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

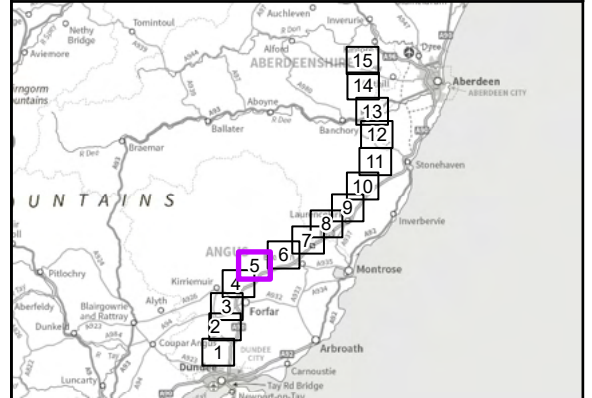


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Felling Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.4.5

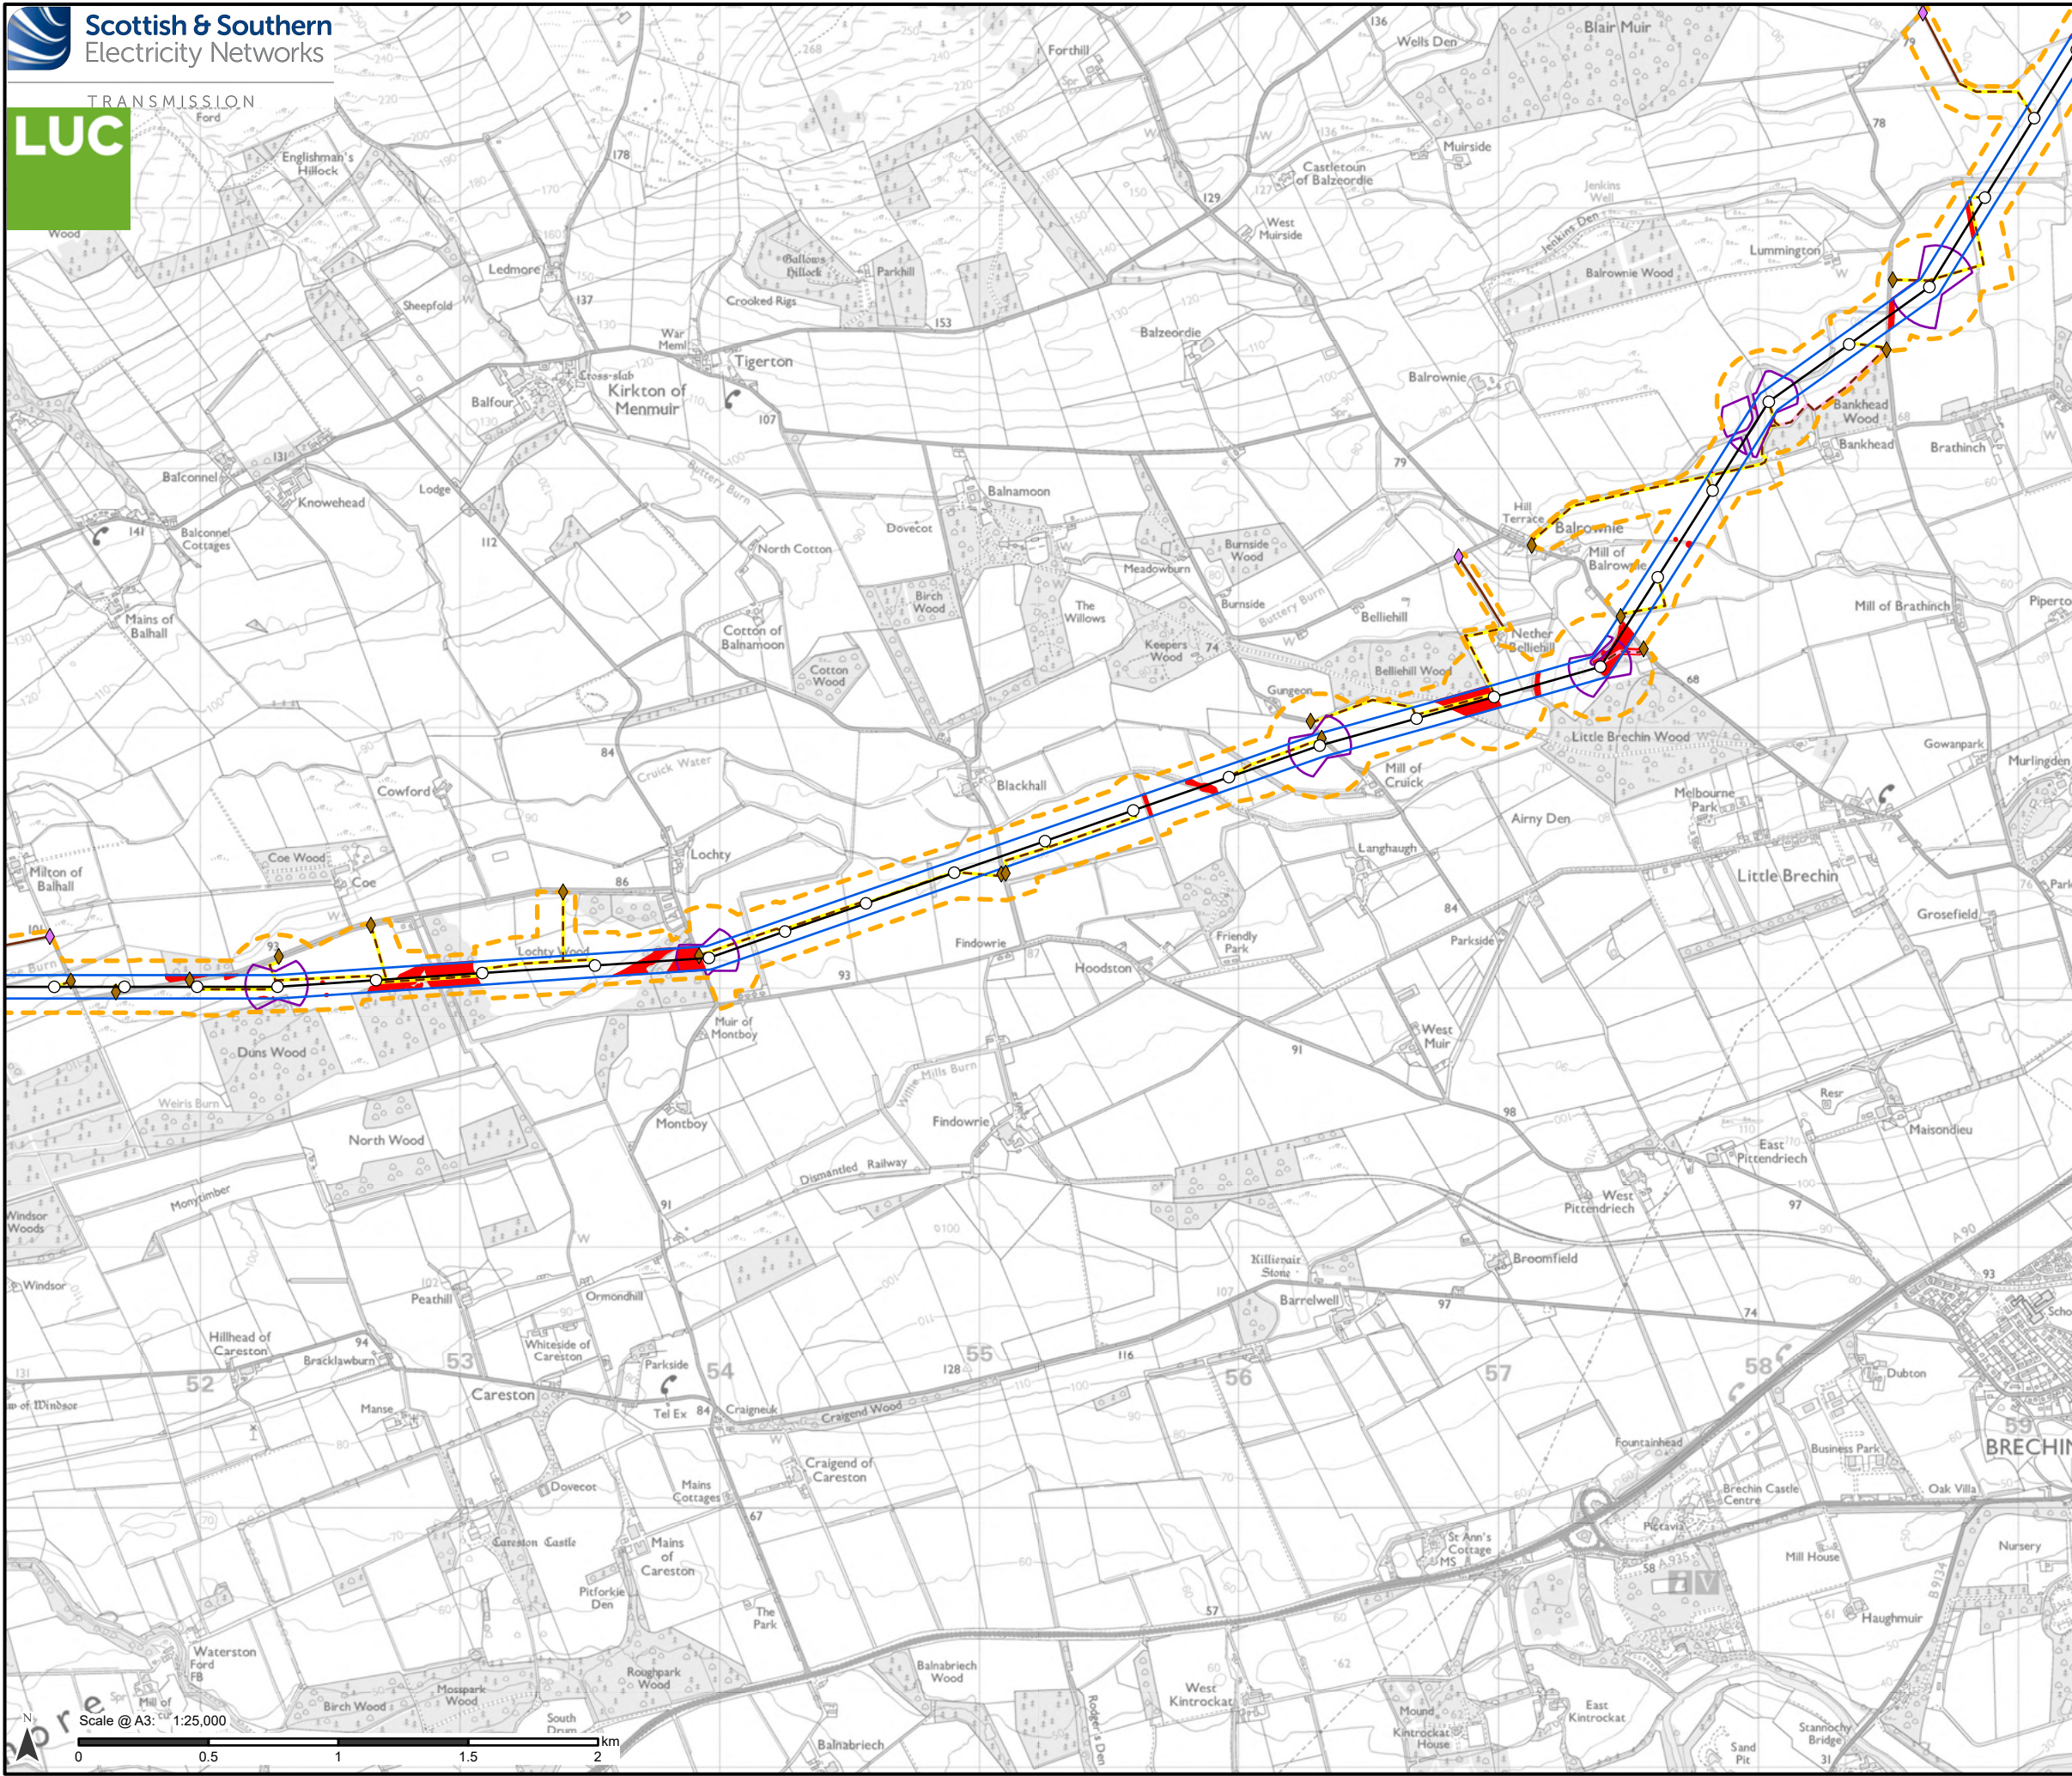

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Temporary Working Areas

- Proposed conductor pulling area (Equipotential Zone (EPZ))

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Felling

- Infrastructure felling

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIAR. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title: Proposed Development Felling Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.4.6



Drawing: 8.4.7

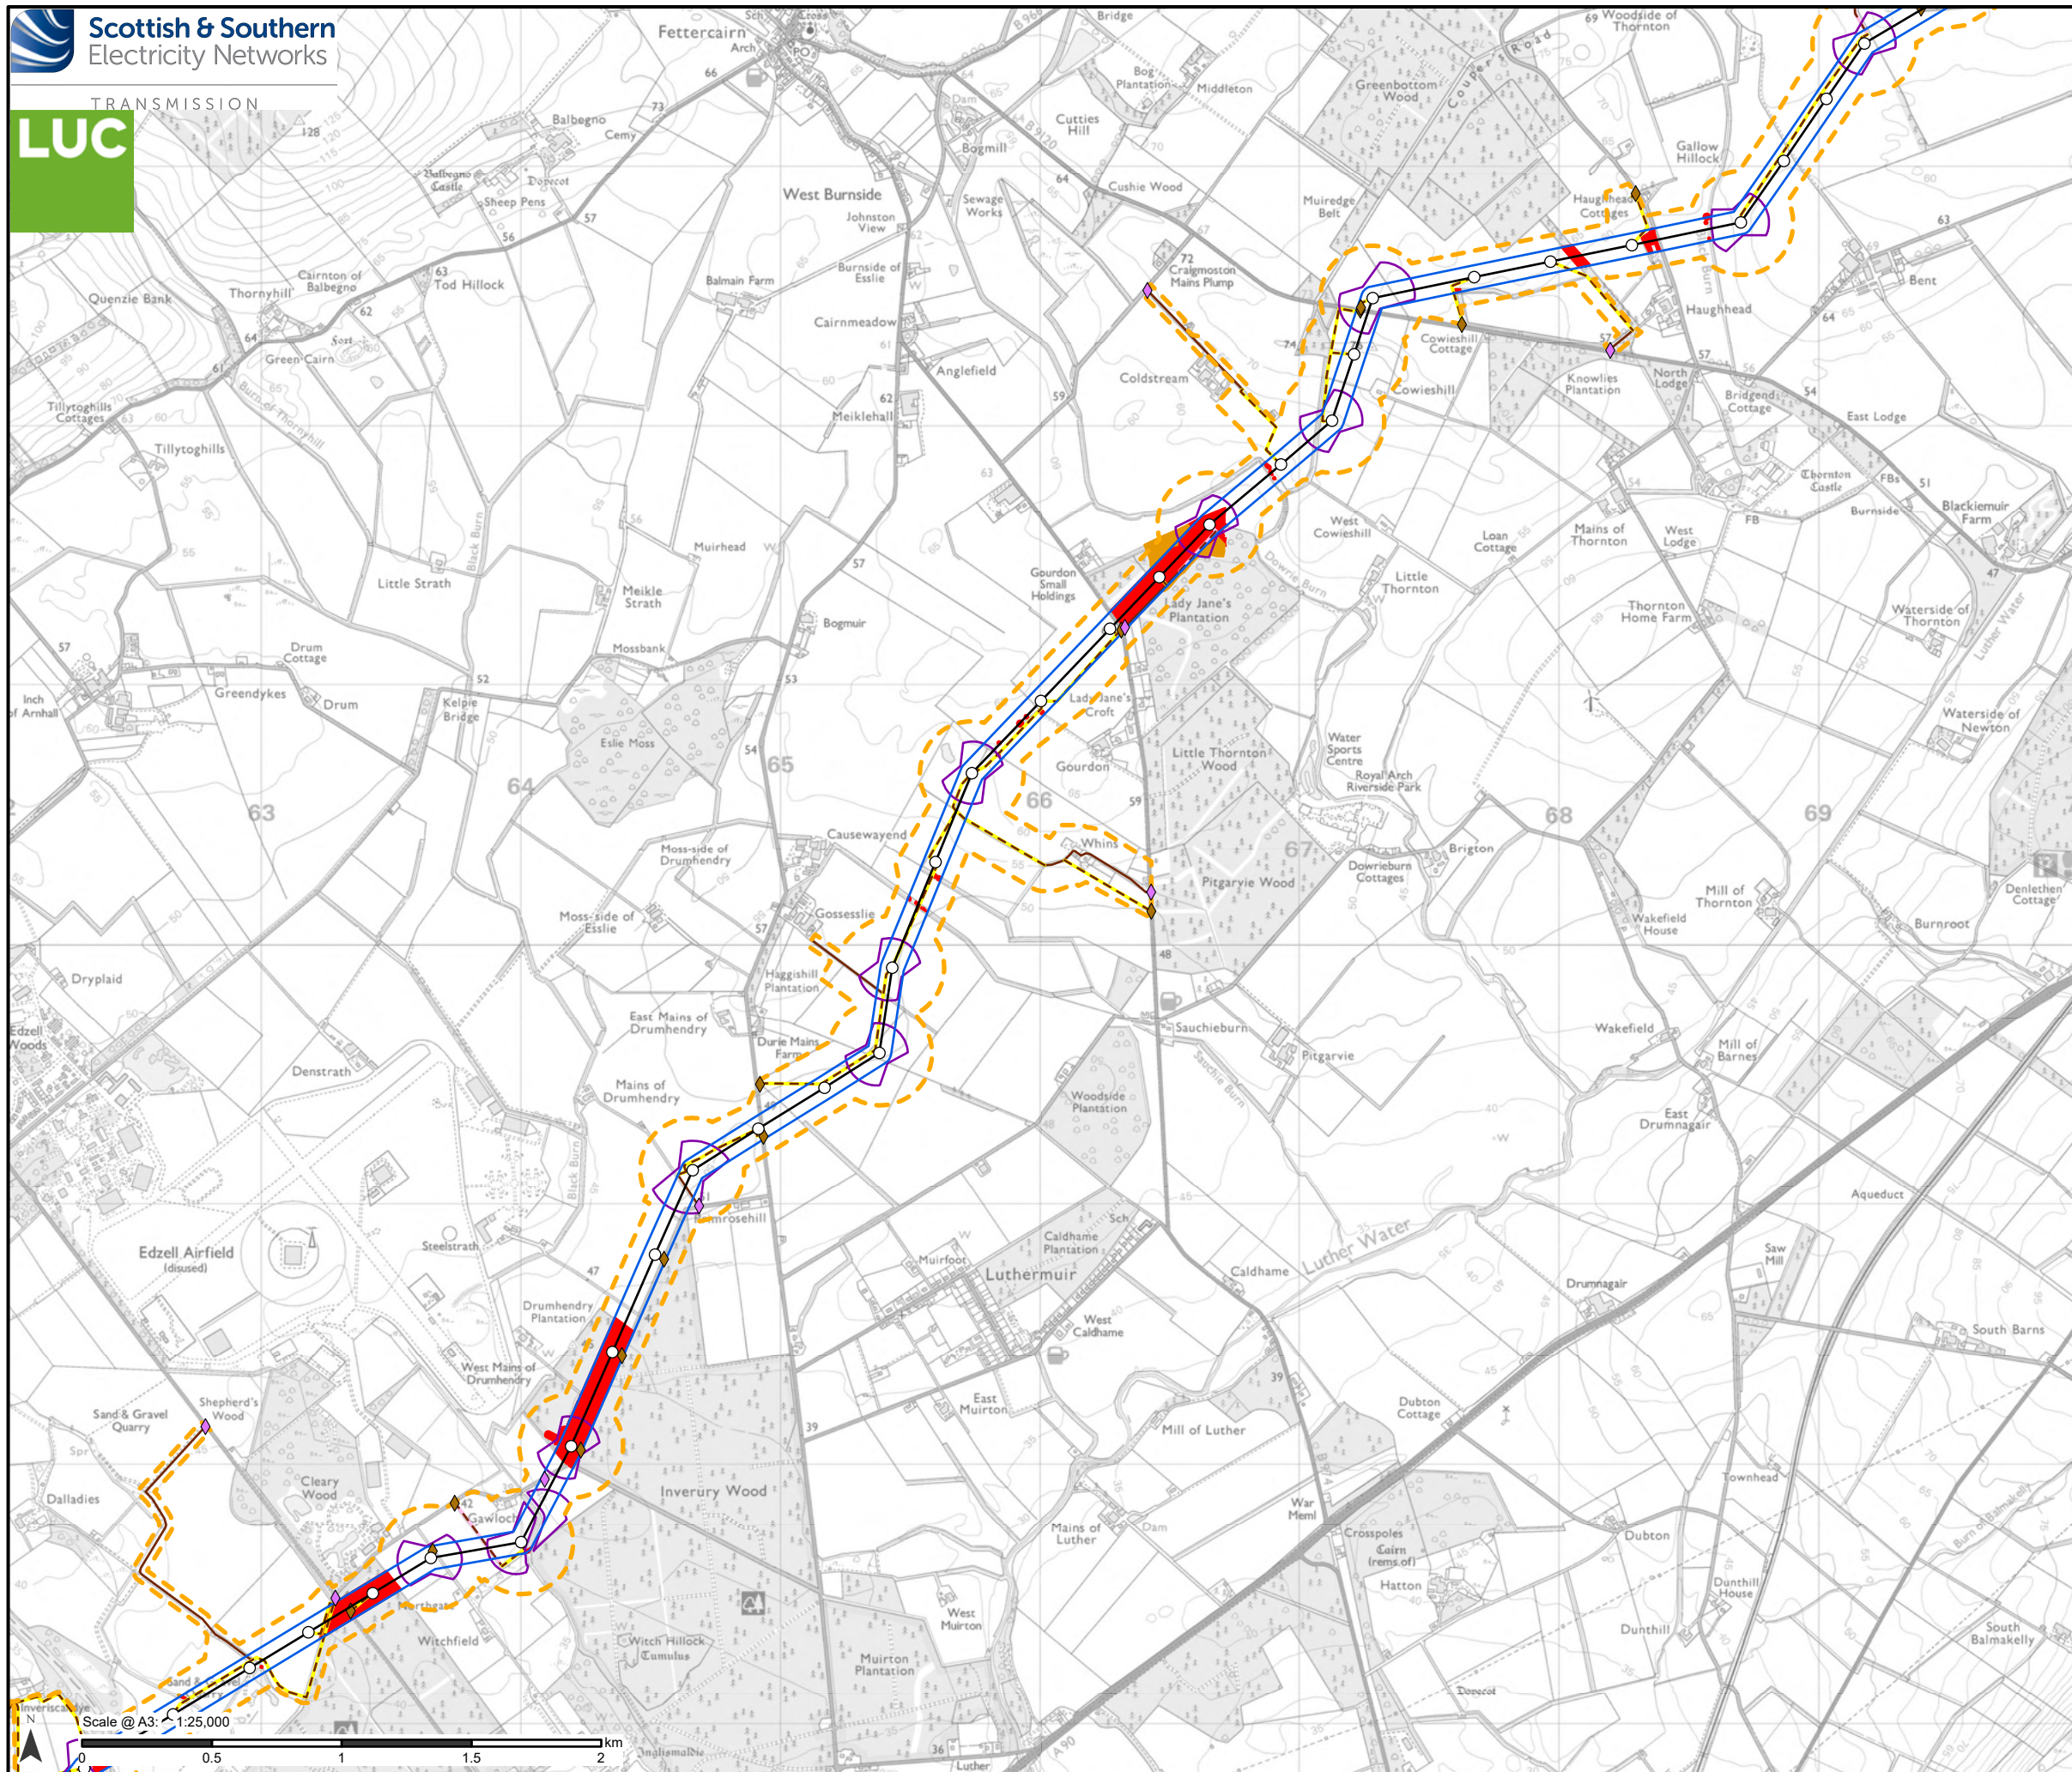

○ Tower Location
— Proposed Alignment

☐ Operational Corridor

 Proposed conductor pulling area
(Equipotential Zone (EPZ))

— Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone temporary


- Proposed new
- Existing to be upgraded

- Infrastructure felling
- Management felling

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

The Applicant has included an assessment of the indirect effects of management felling within the scope of the EIA. However, it should be noted that the Applicant has no control over when management felling will take place and any felling of this nature will require separate permission under the Forestry and Land Management (Scotland) Act 2018."

Data provided by DGA Forestry LLP.

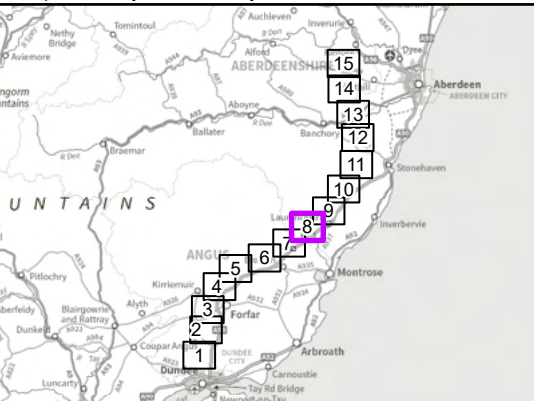

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Felling Plan

Drawn by: MS	Date: 19/08/2025
Drawing: 8.4.8	