


740000m.N

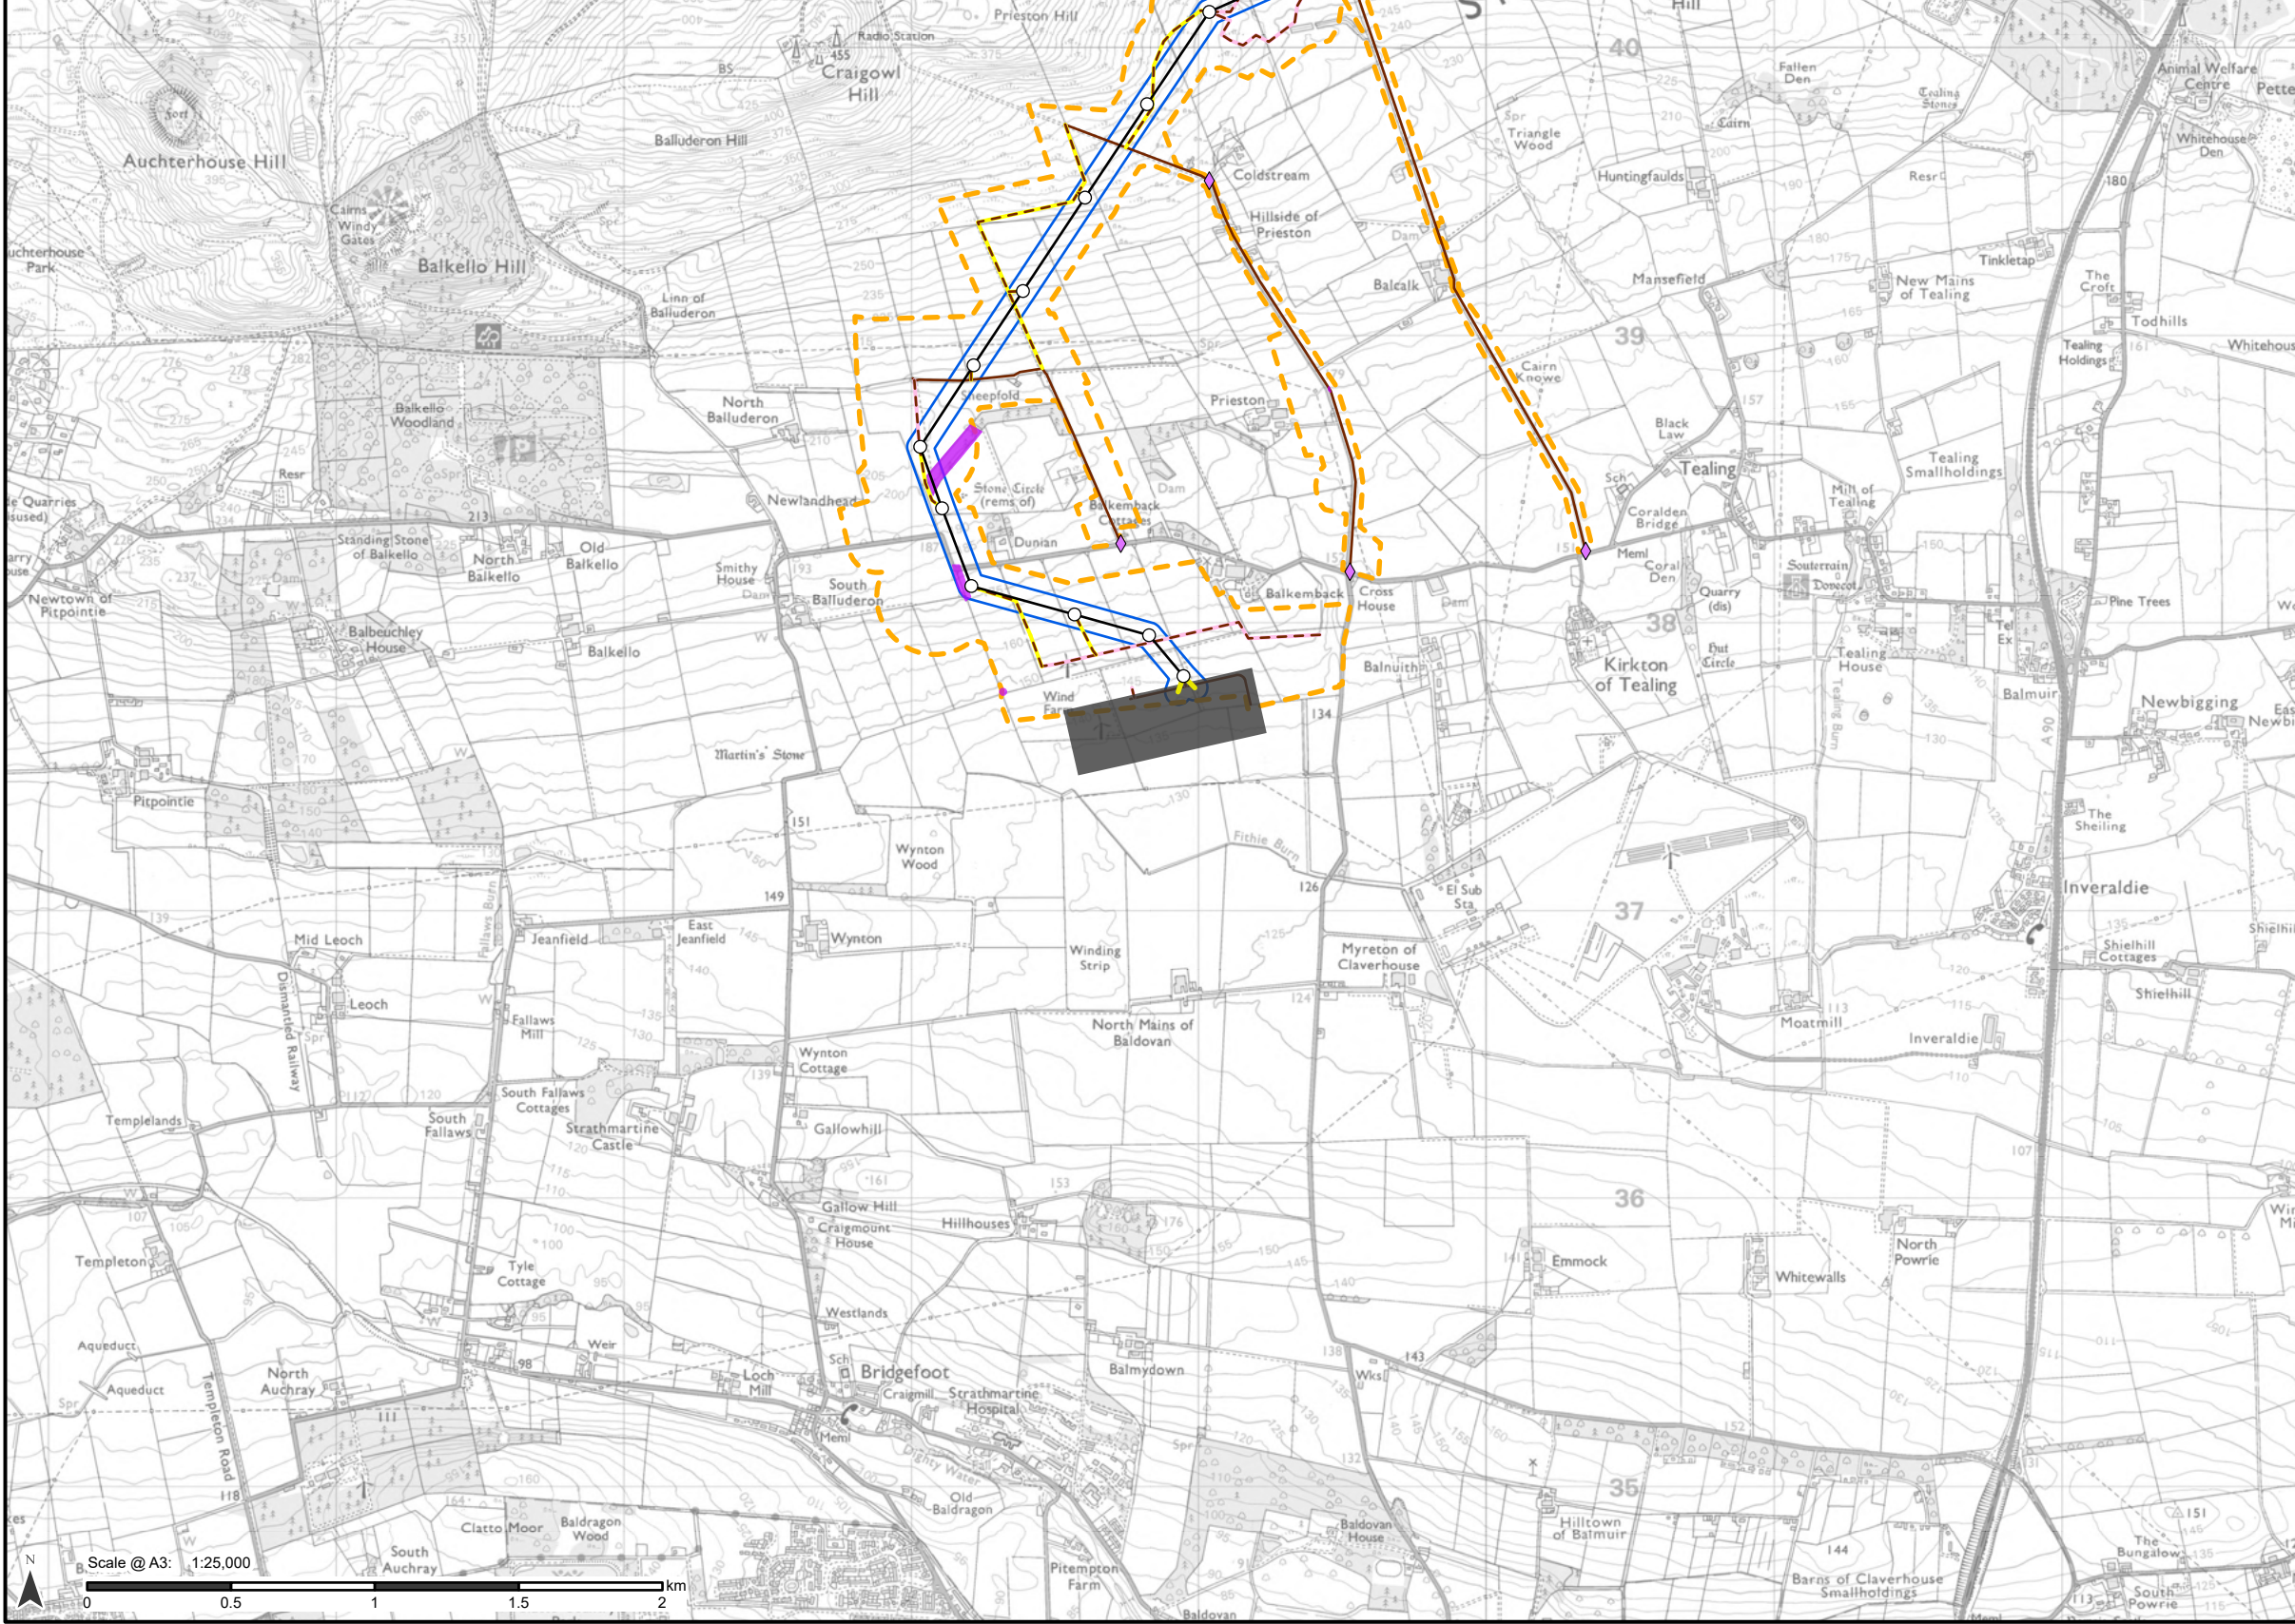

340

340000m.E


740000m.N

- Proposed Development**
- Tower Location
 - Proposed Alignment
 - Download
 - Proposed Development Limit of Deviation (LOD)
 - Operational Corridor
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Intra (Associated) Developments**
- Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/FULN)
- Baseline species**
- Operational corridor felling/open ground

Notes:


For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

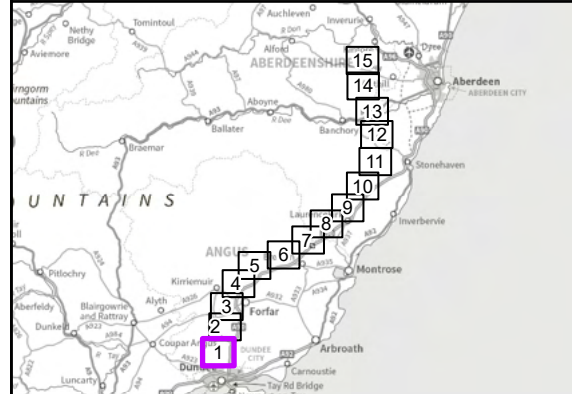

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Restocking Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.5.1

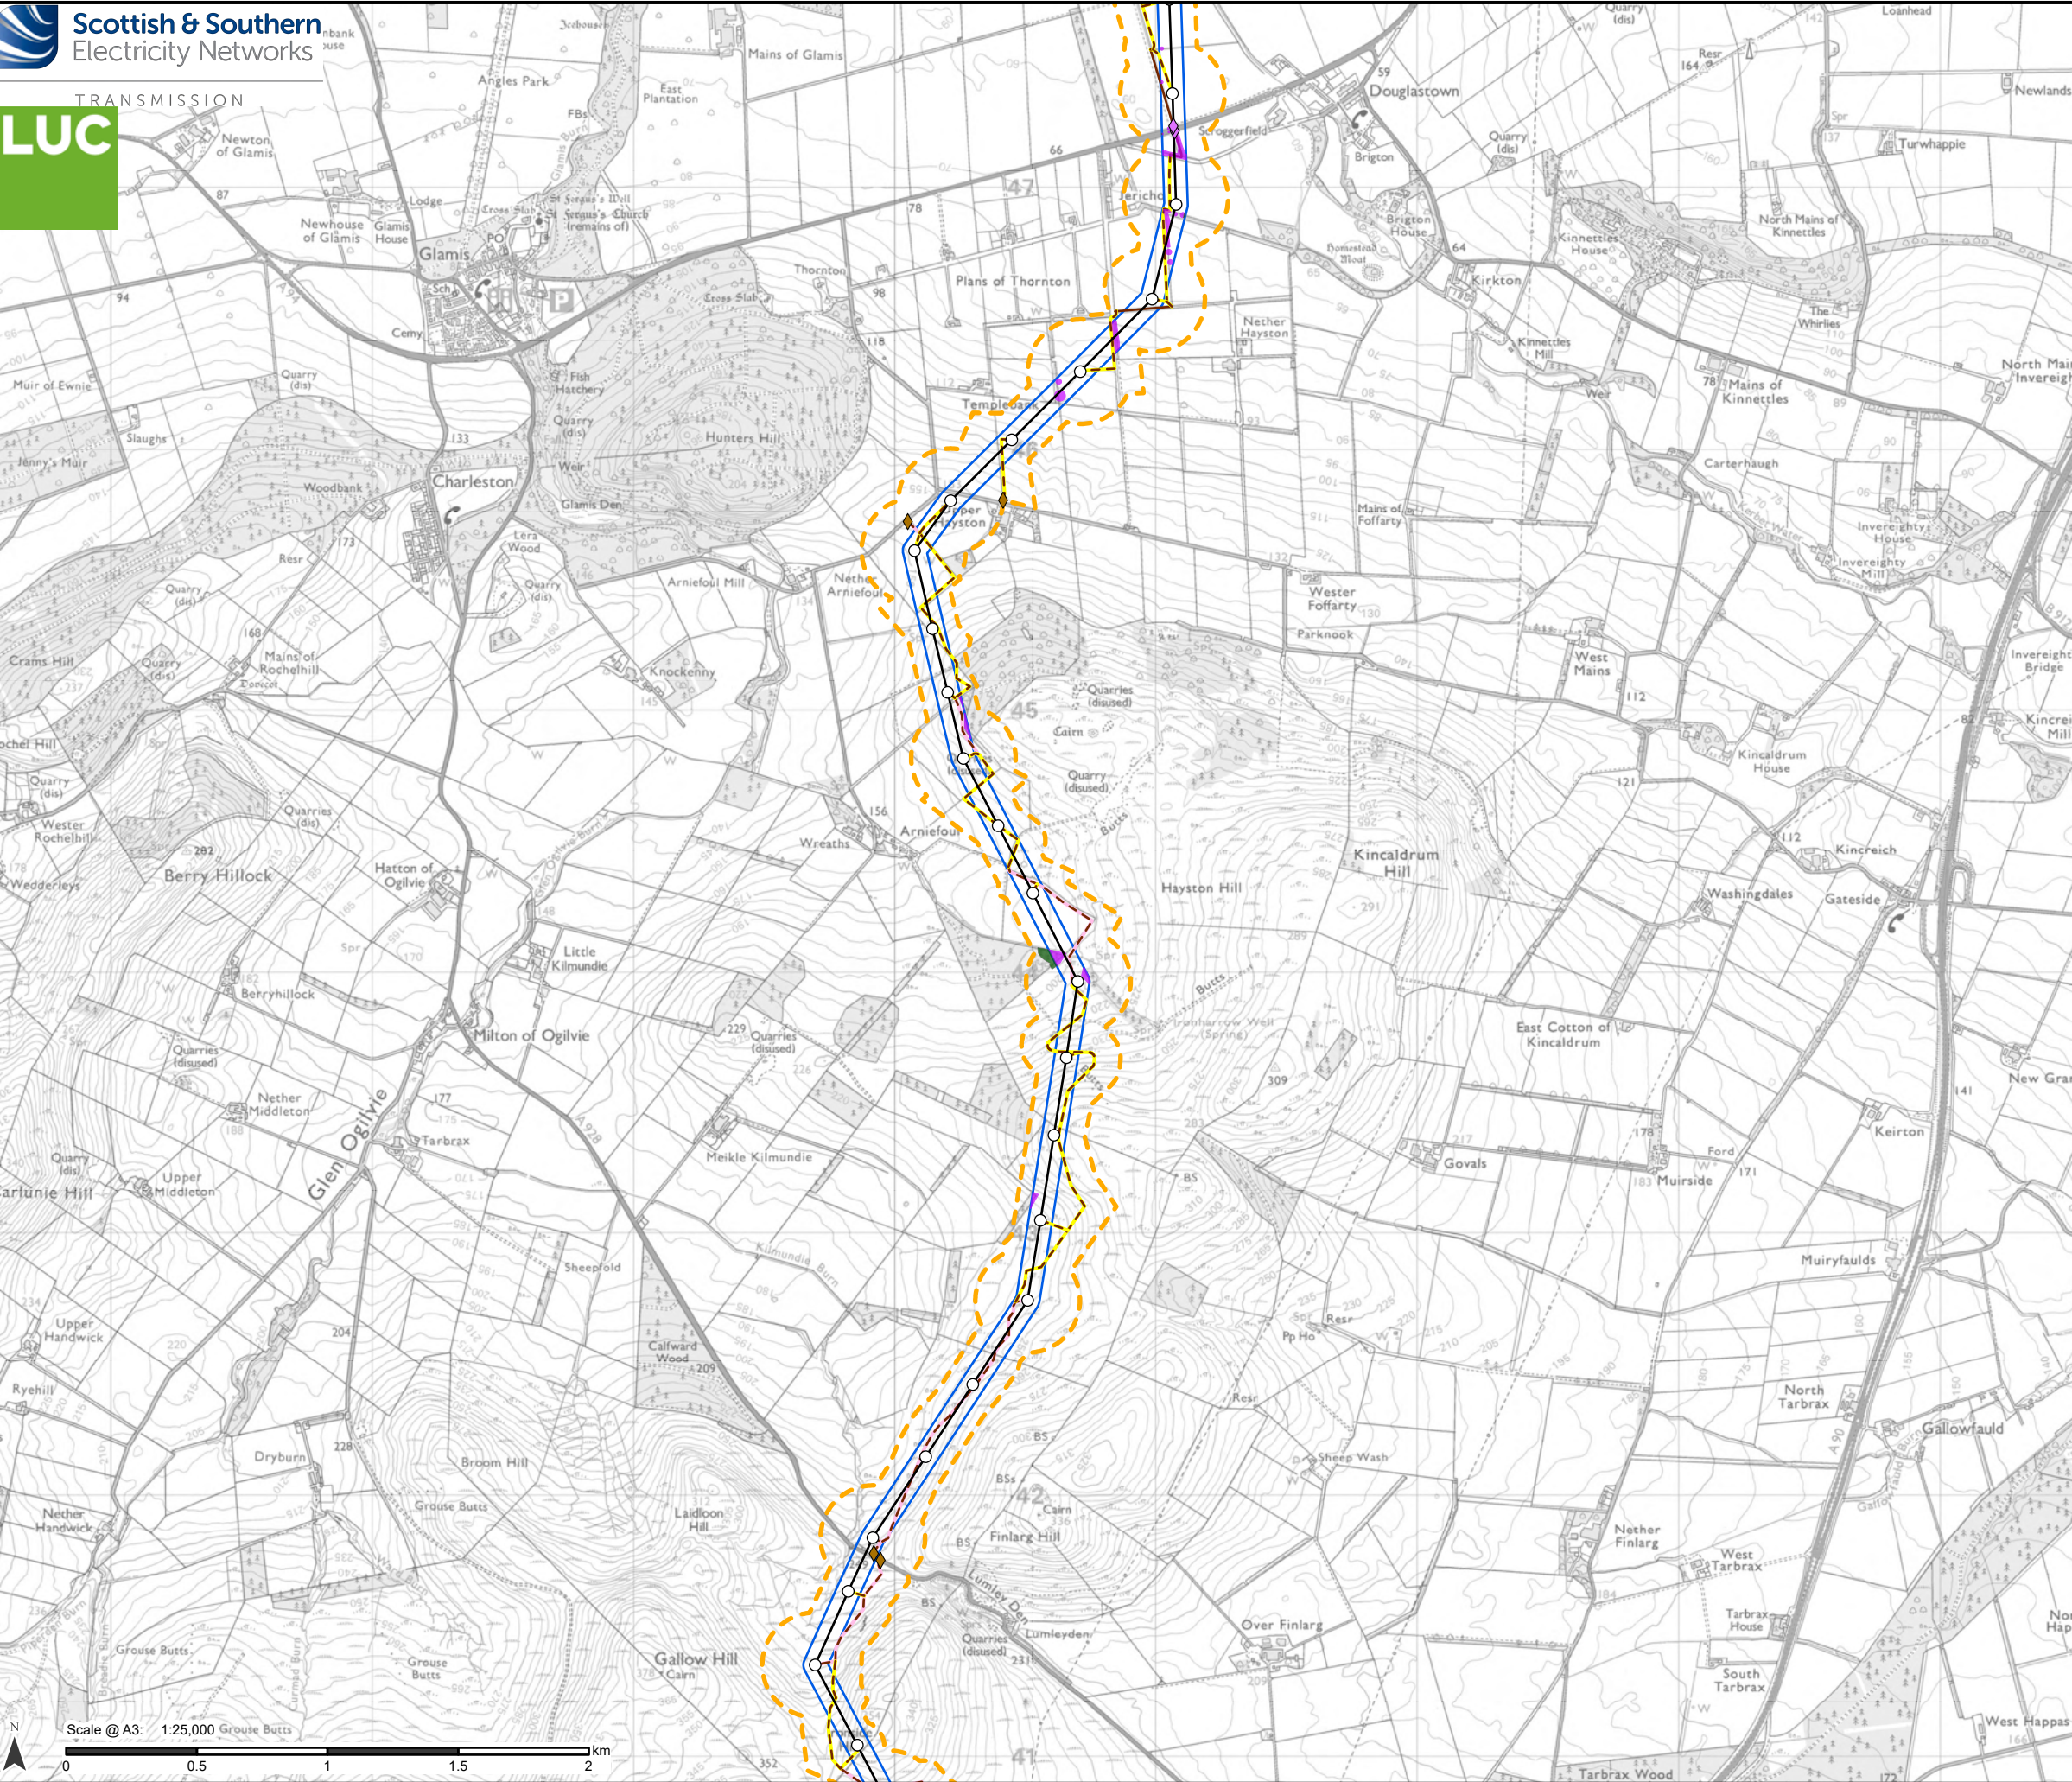

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Baseline species

- Mixed broadleaves
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

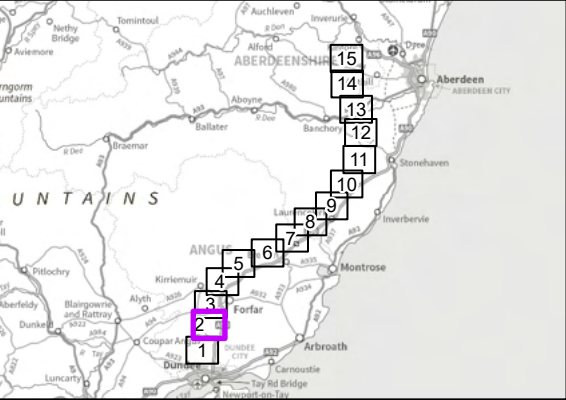


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025
Drawing: 8.5.2

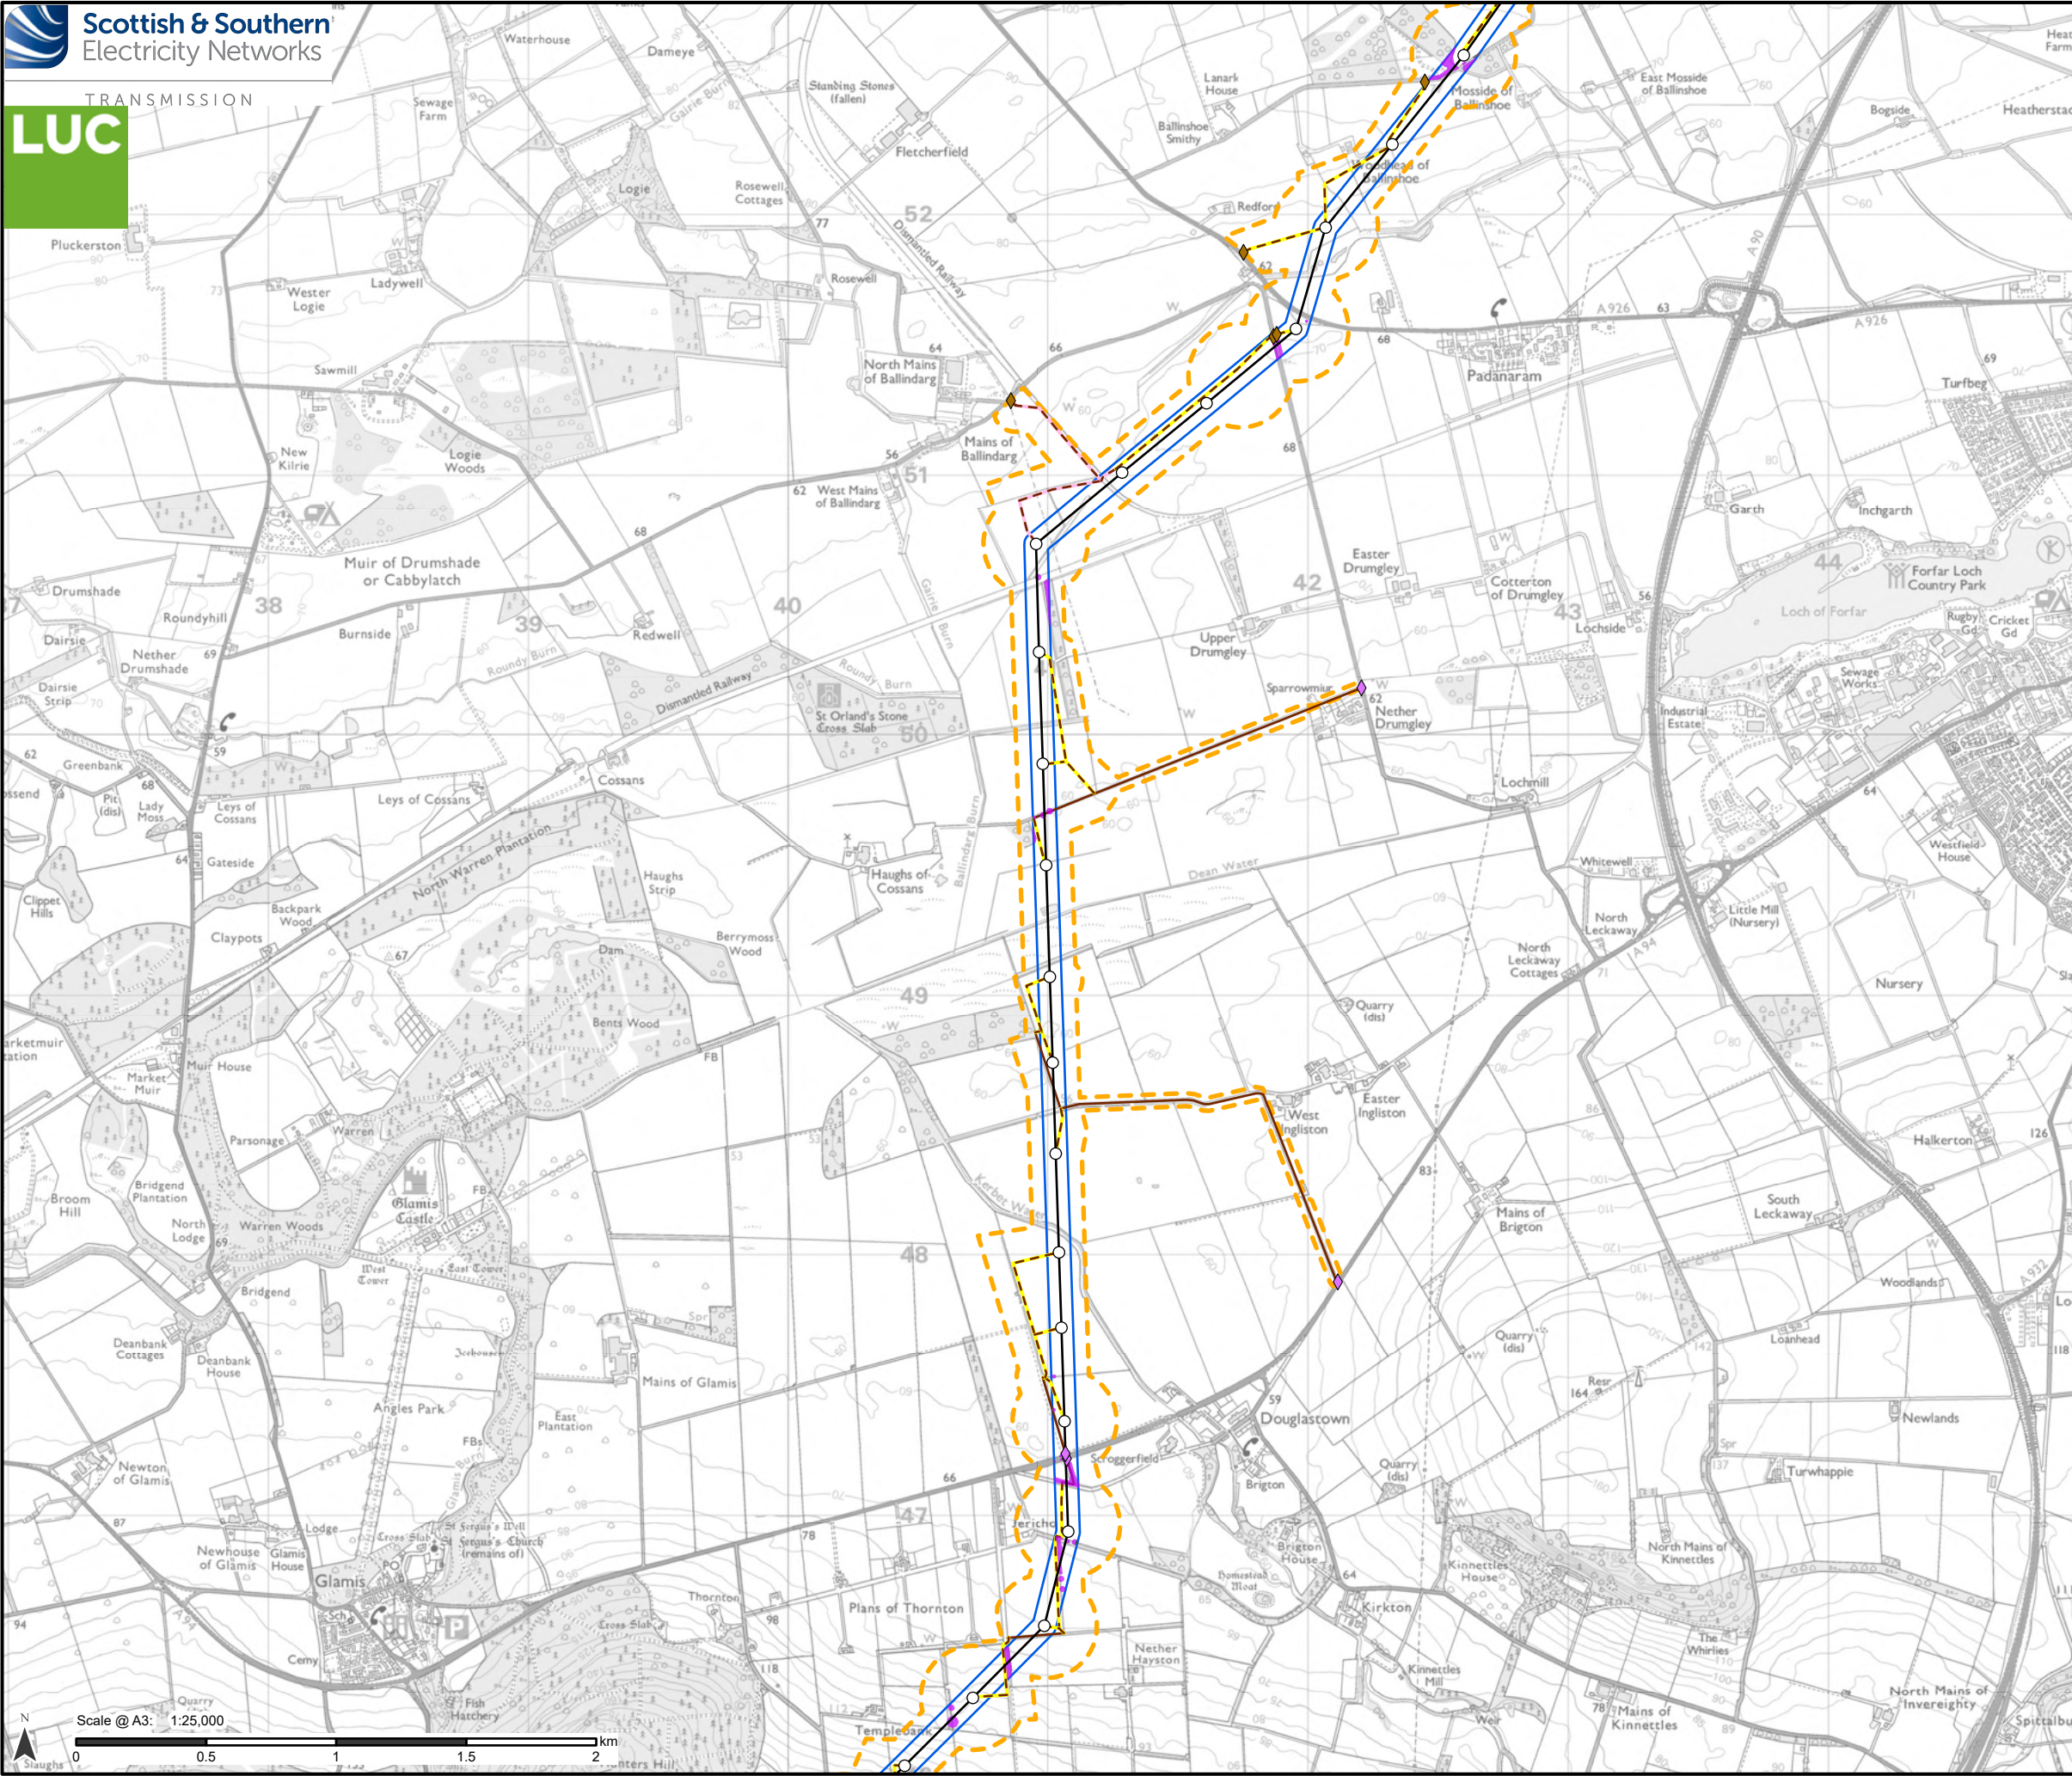

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone temporary

Bellmouth type


- ◆ Proposed new
- ◆ Existing to be upgraded

Baseline species


- Mixed broadleaves
- Native mixed woodland
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

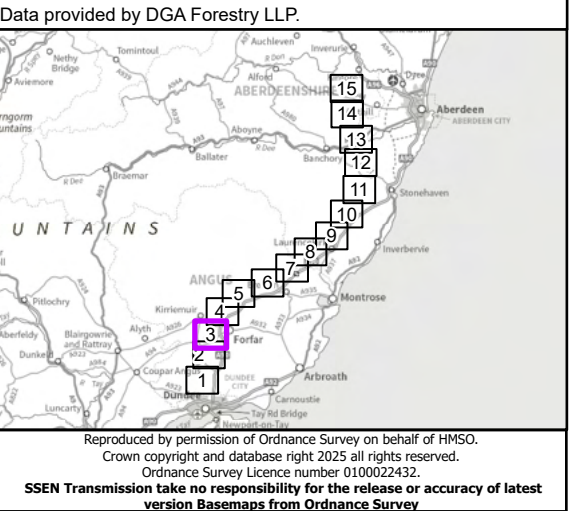

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Restocking Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.5.3

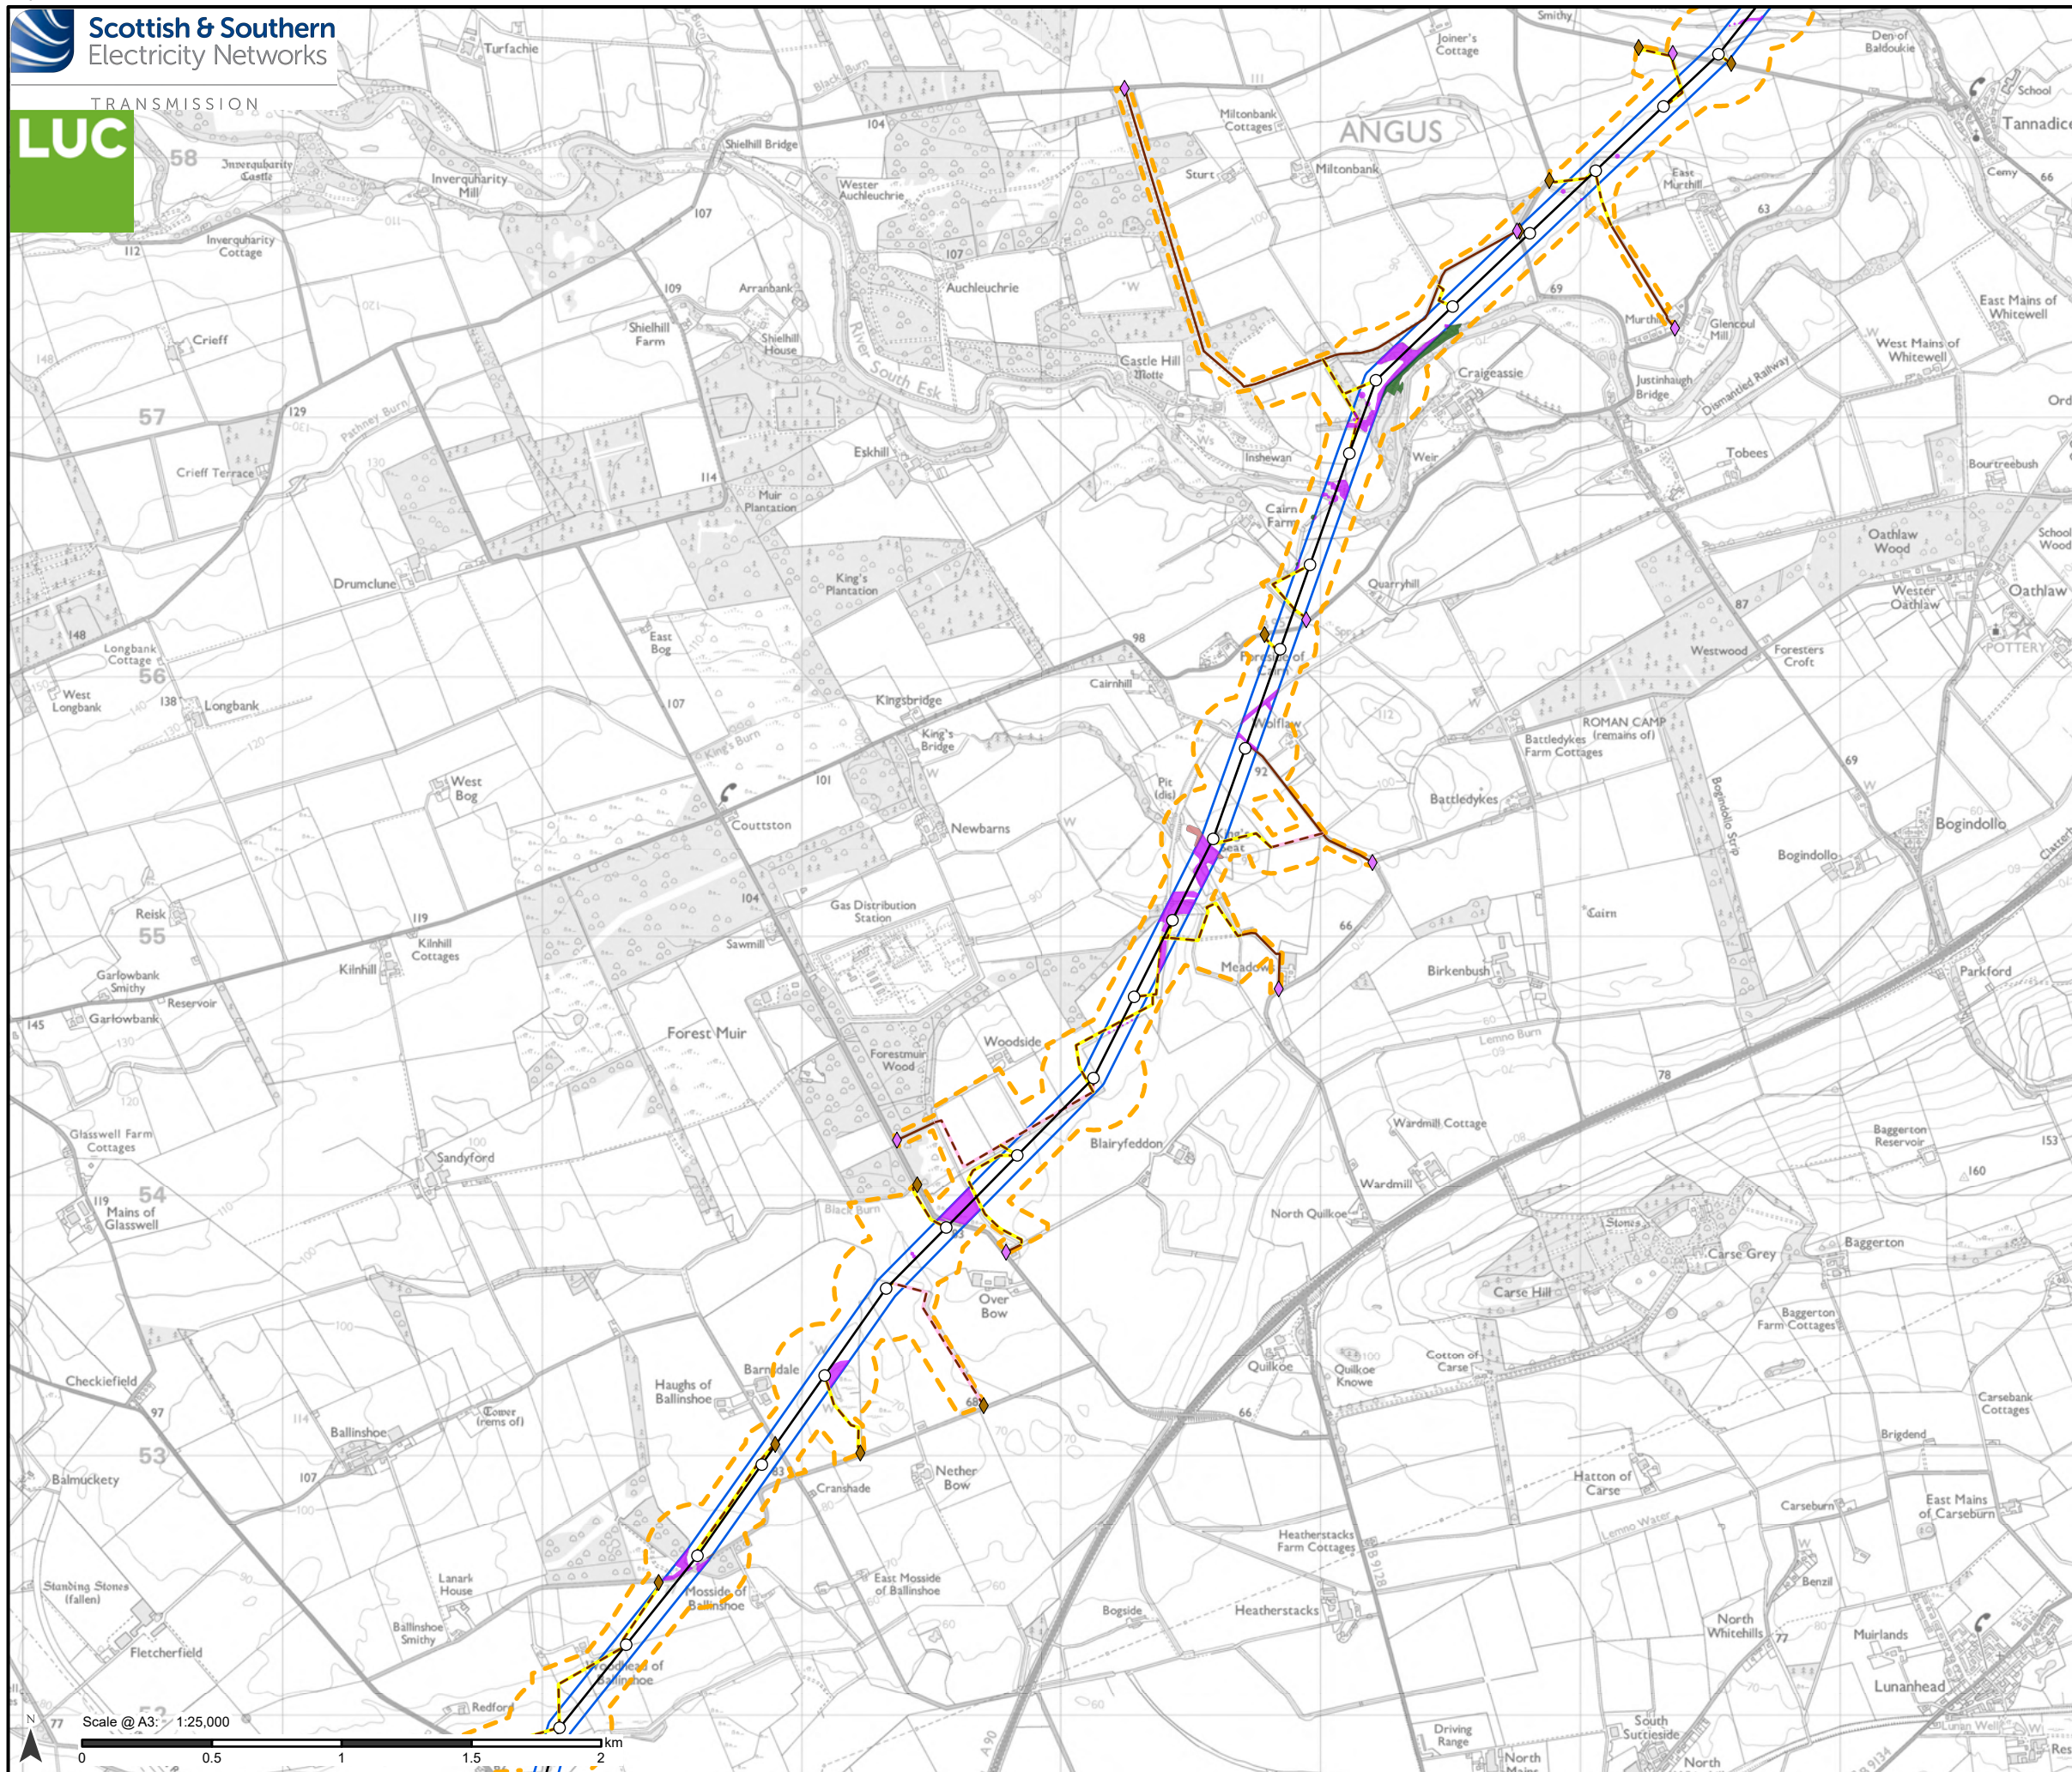

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- ▭ Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Baseline species

- Mixed broadleaves
- Mixed woodland
- Native mixed woodland
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

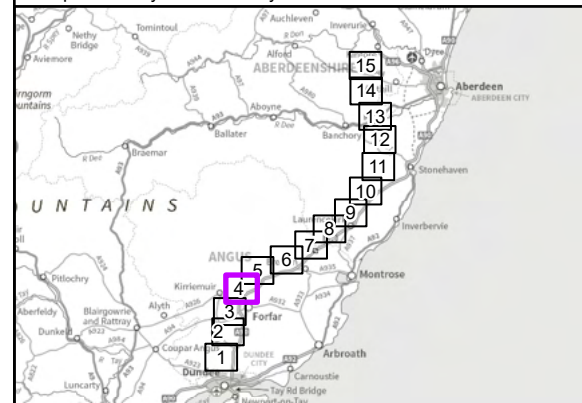

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.

Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Proposed Development Restocking Plan

Drawn by: MS

Date: 19/08/2025

Drawing: 8.5.4

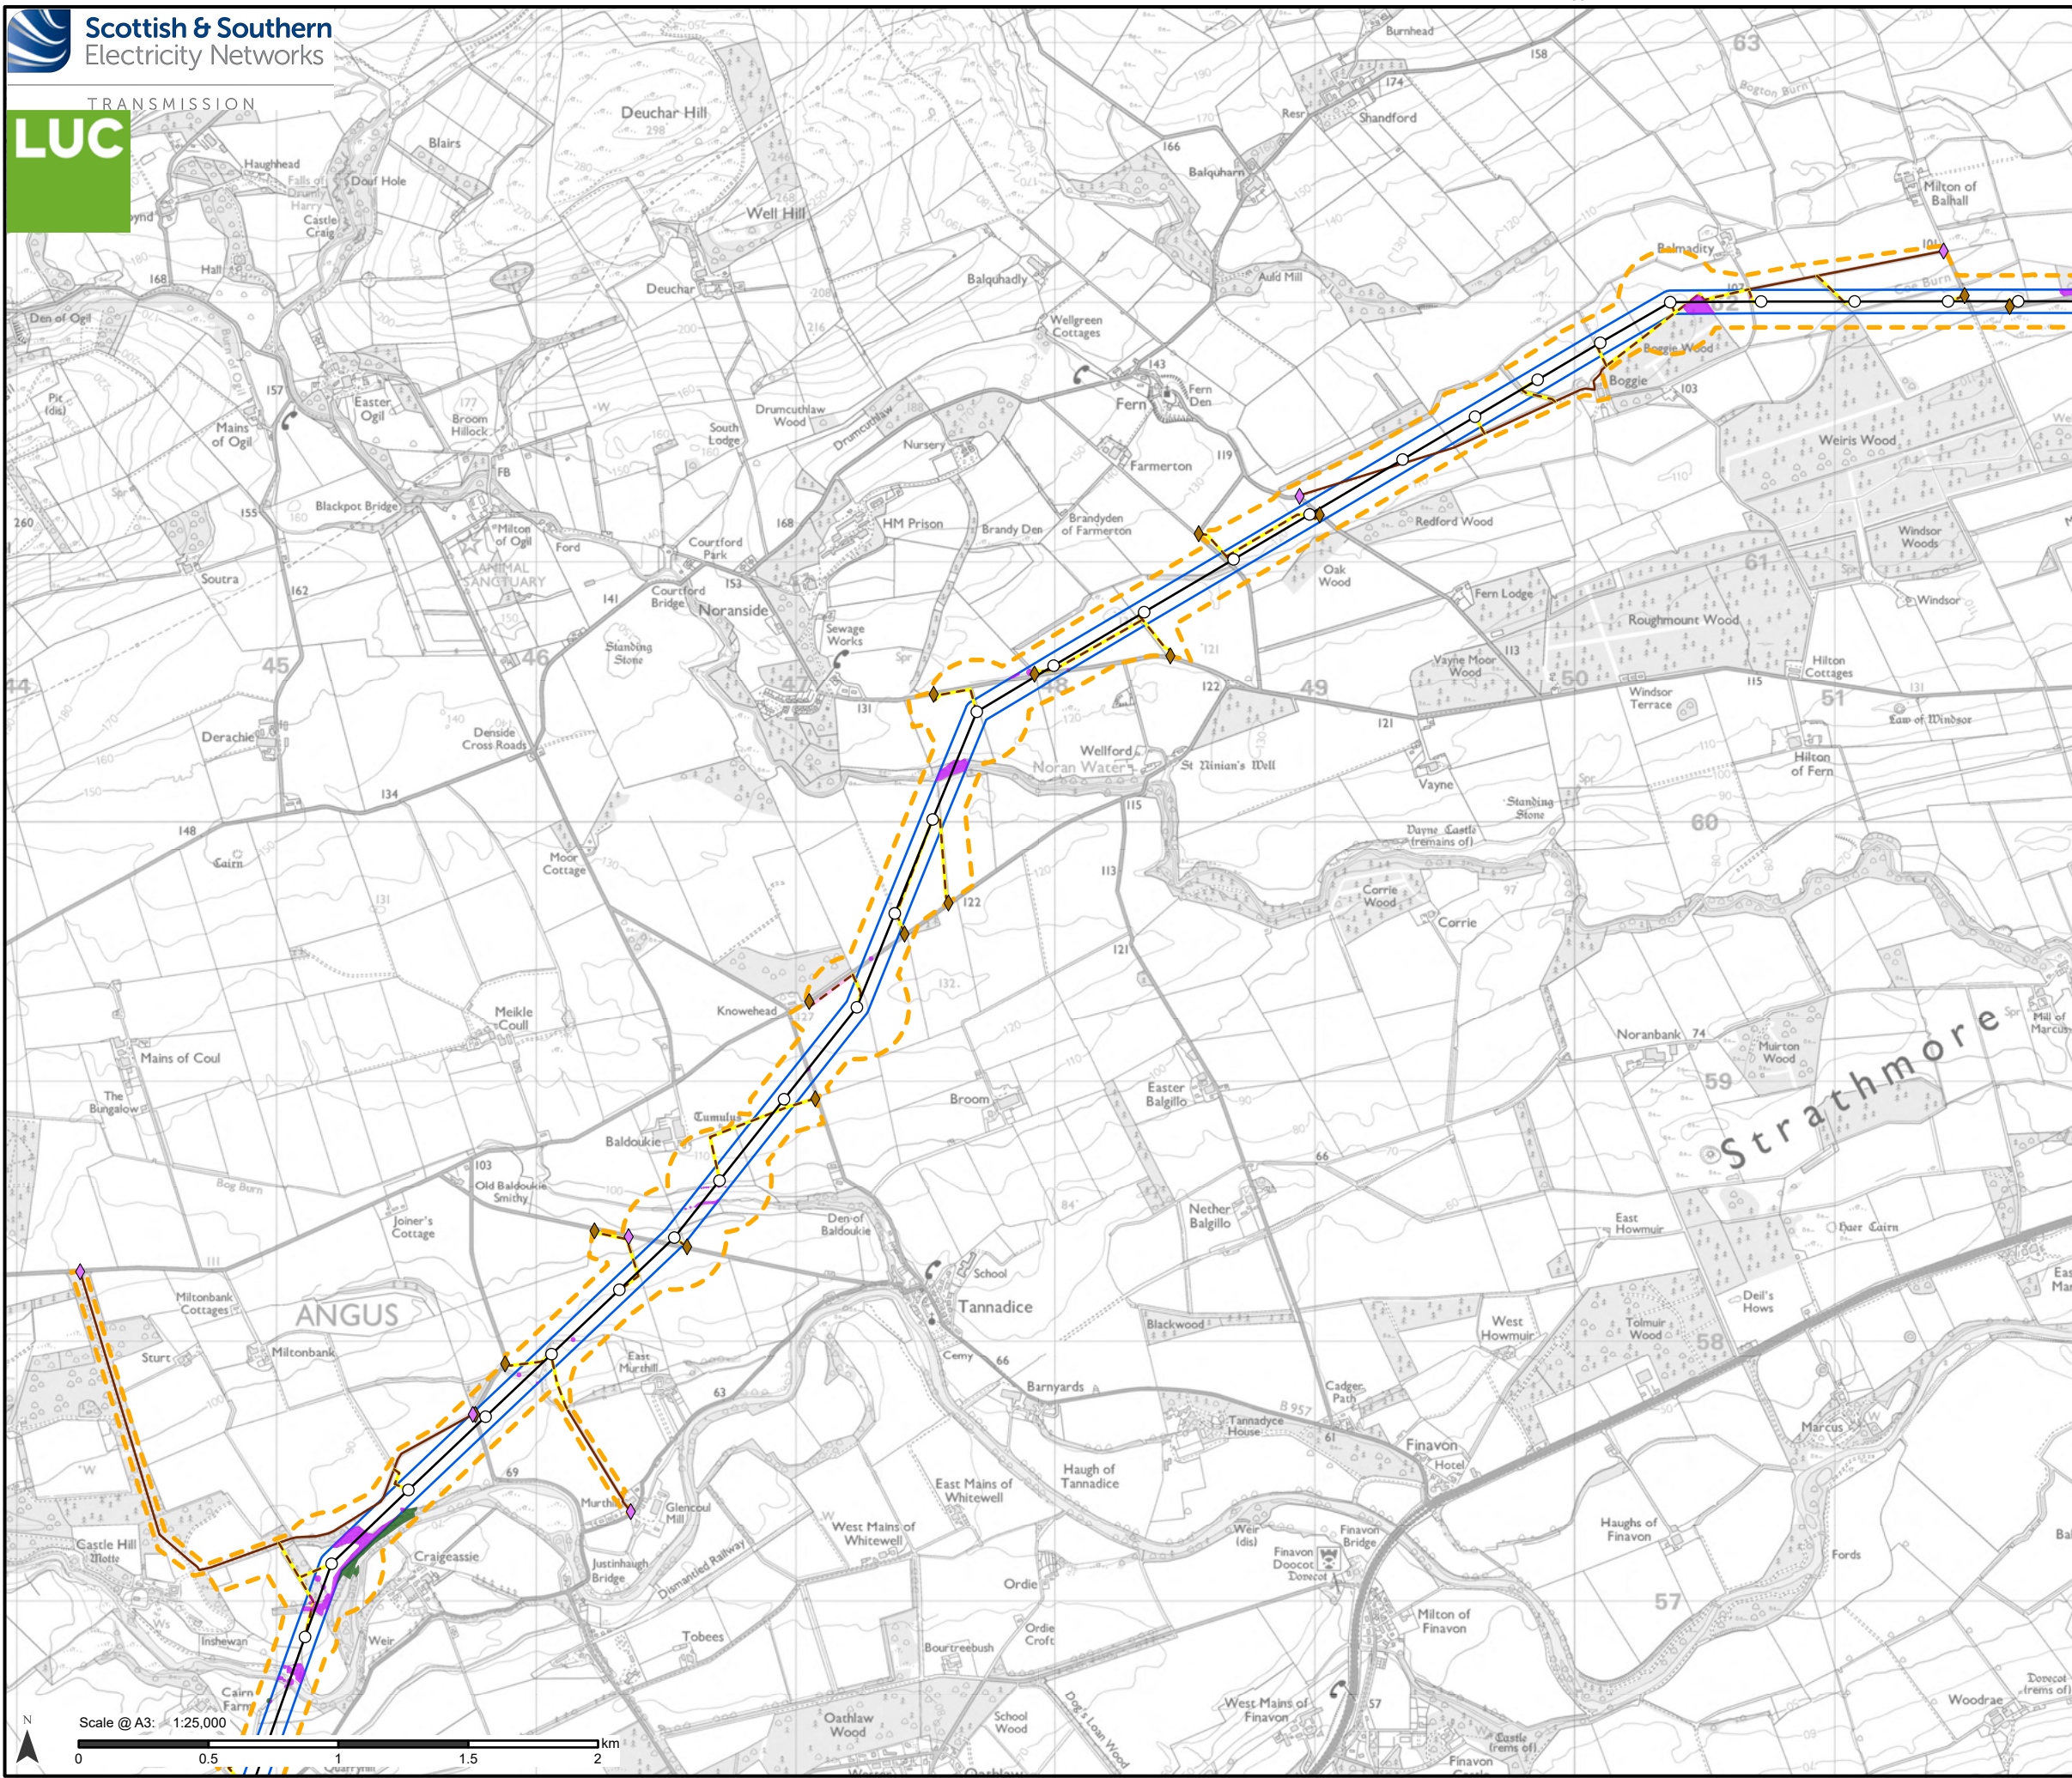

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Baseline species

- Mixed broadleaves
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.5

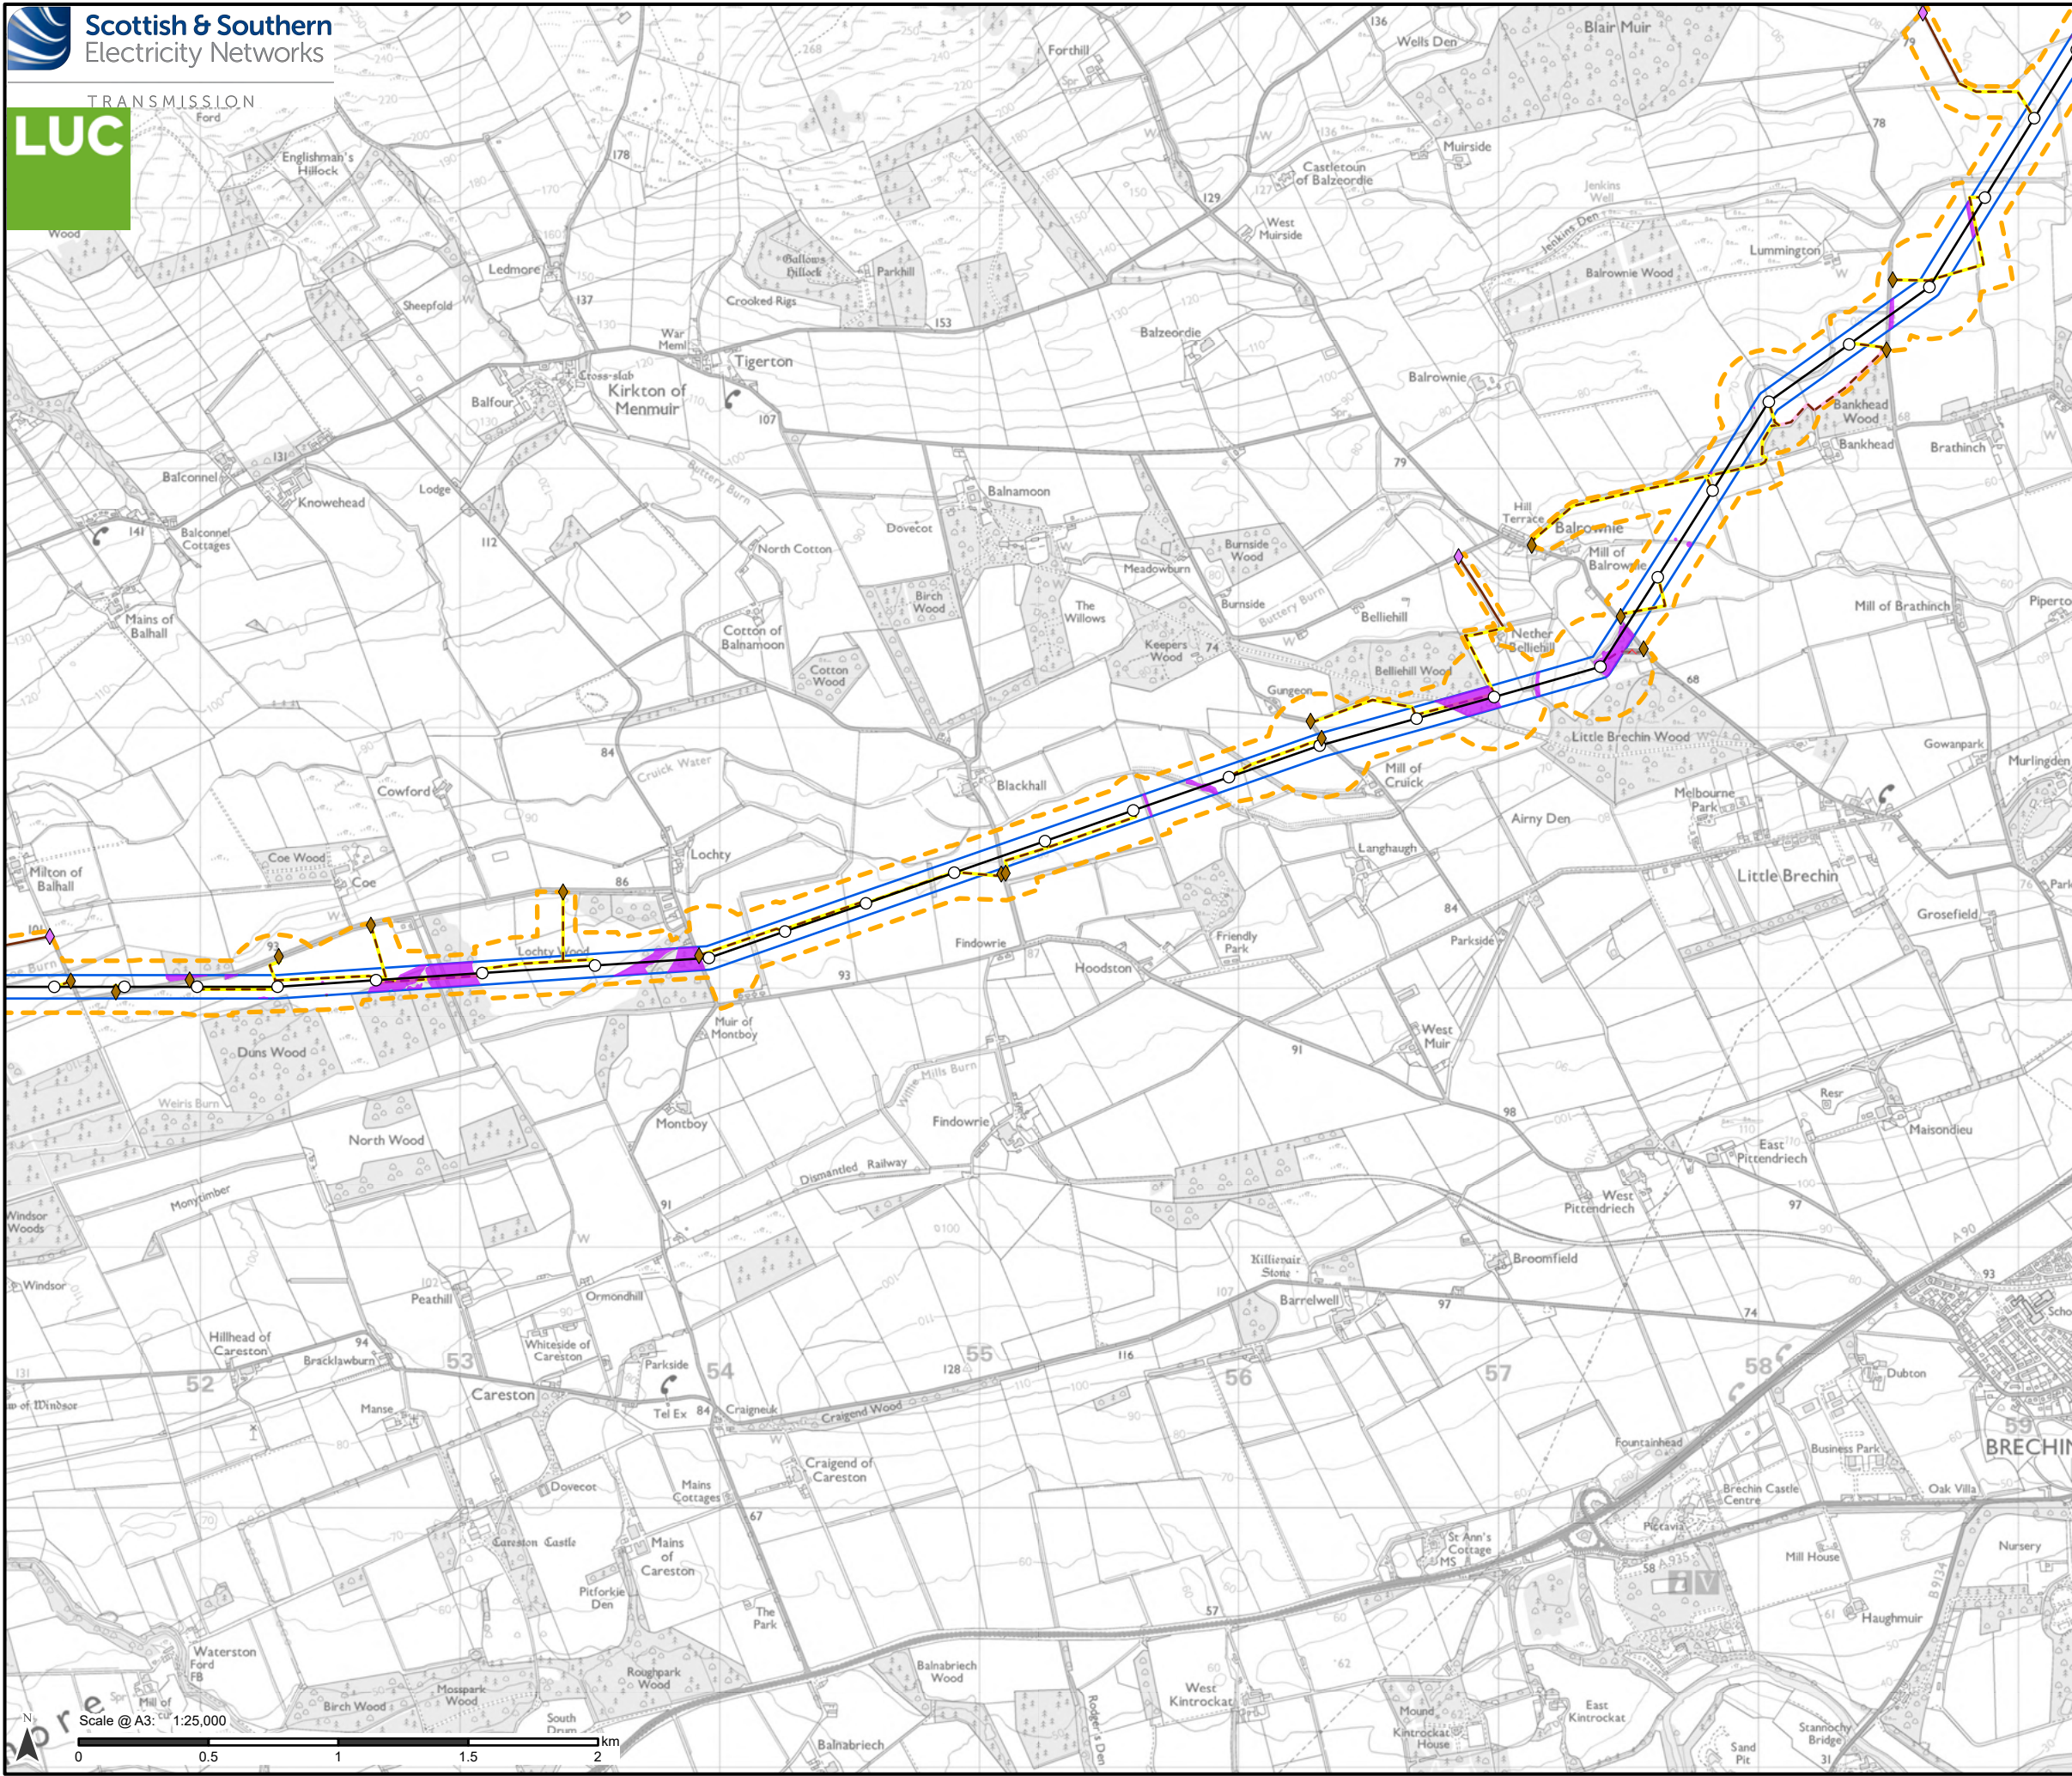

Proposed Development

- Tower Location
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- ▭ Operational Corridor

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone temporary


Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Baseline species

- ▨ Felled awaiting restock
- ▨ Mixed broadleaves
- ▨ Operational corridor felling/open ground

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

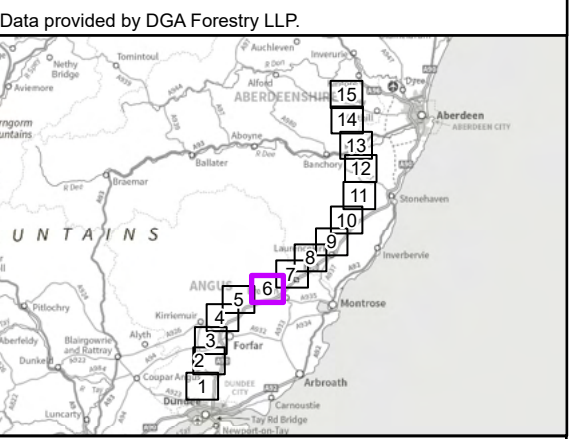

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Restocking Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.5.6

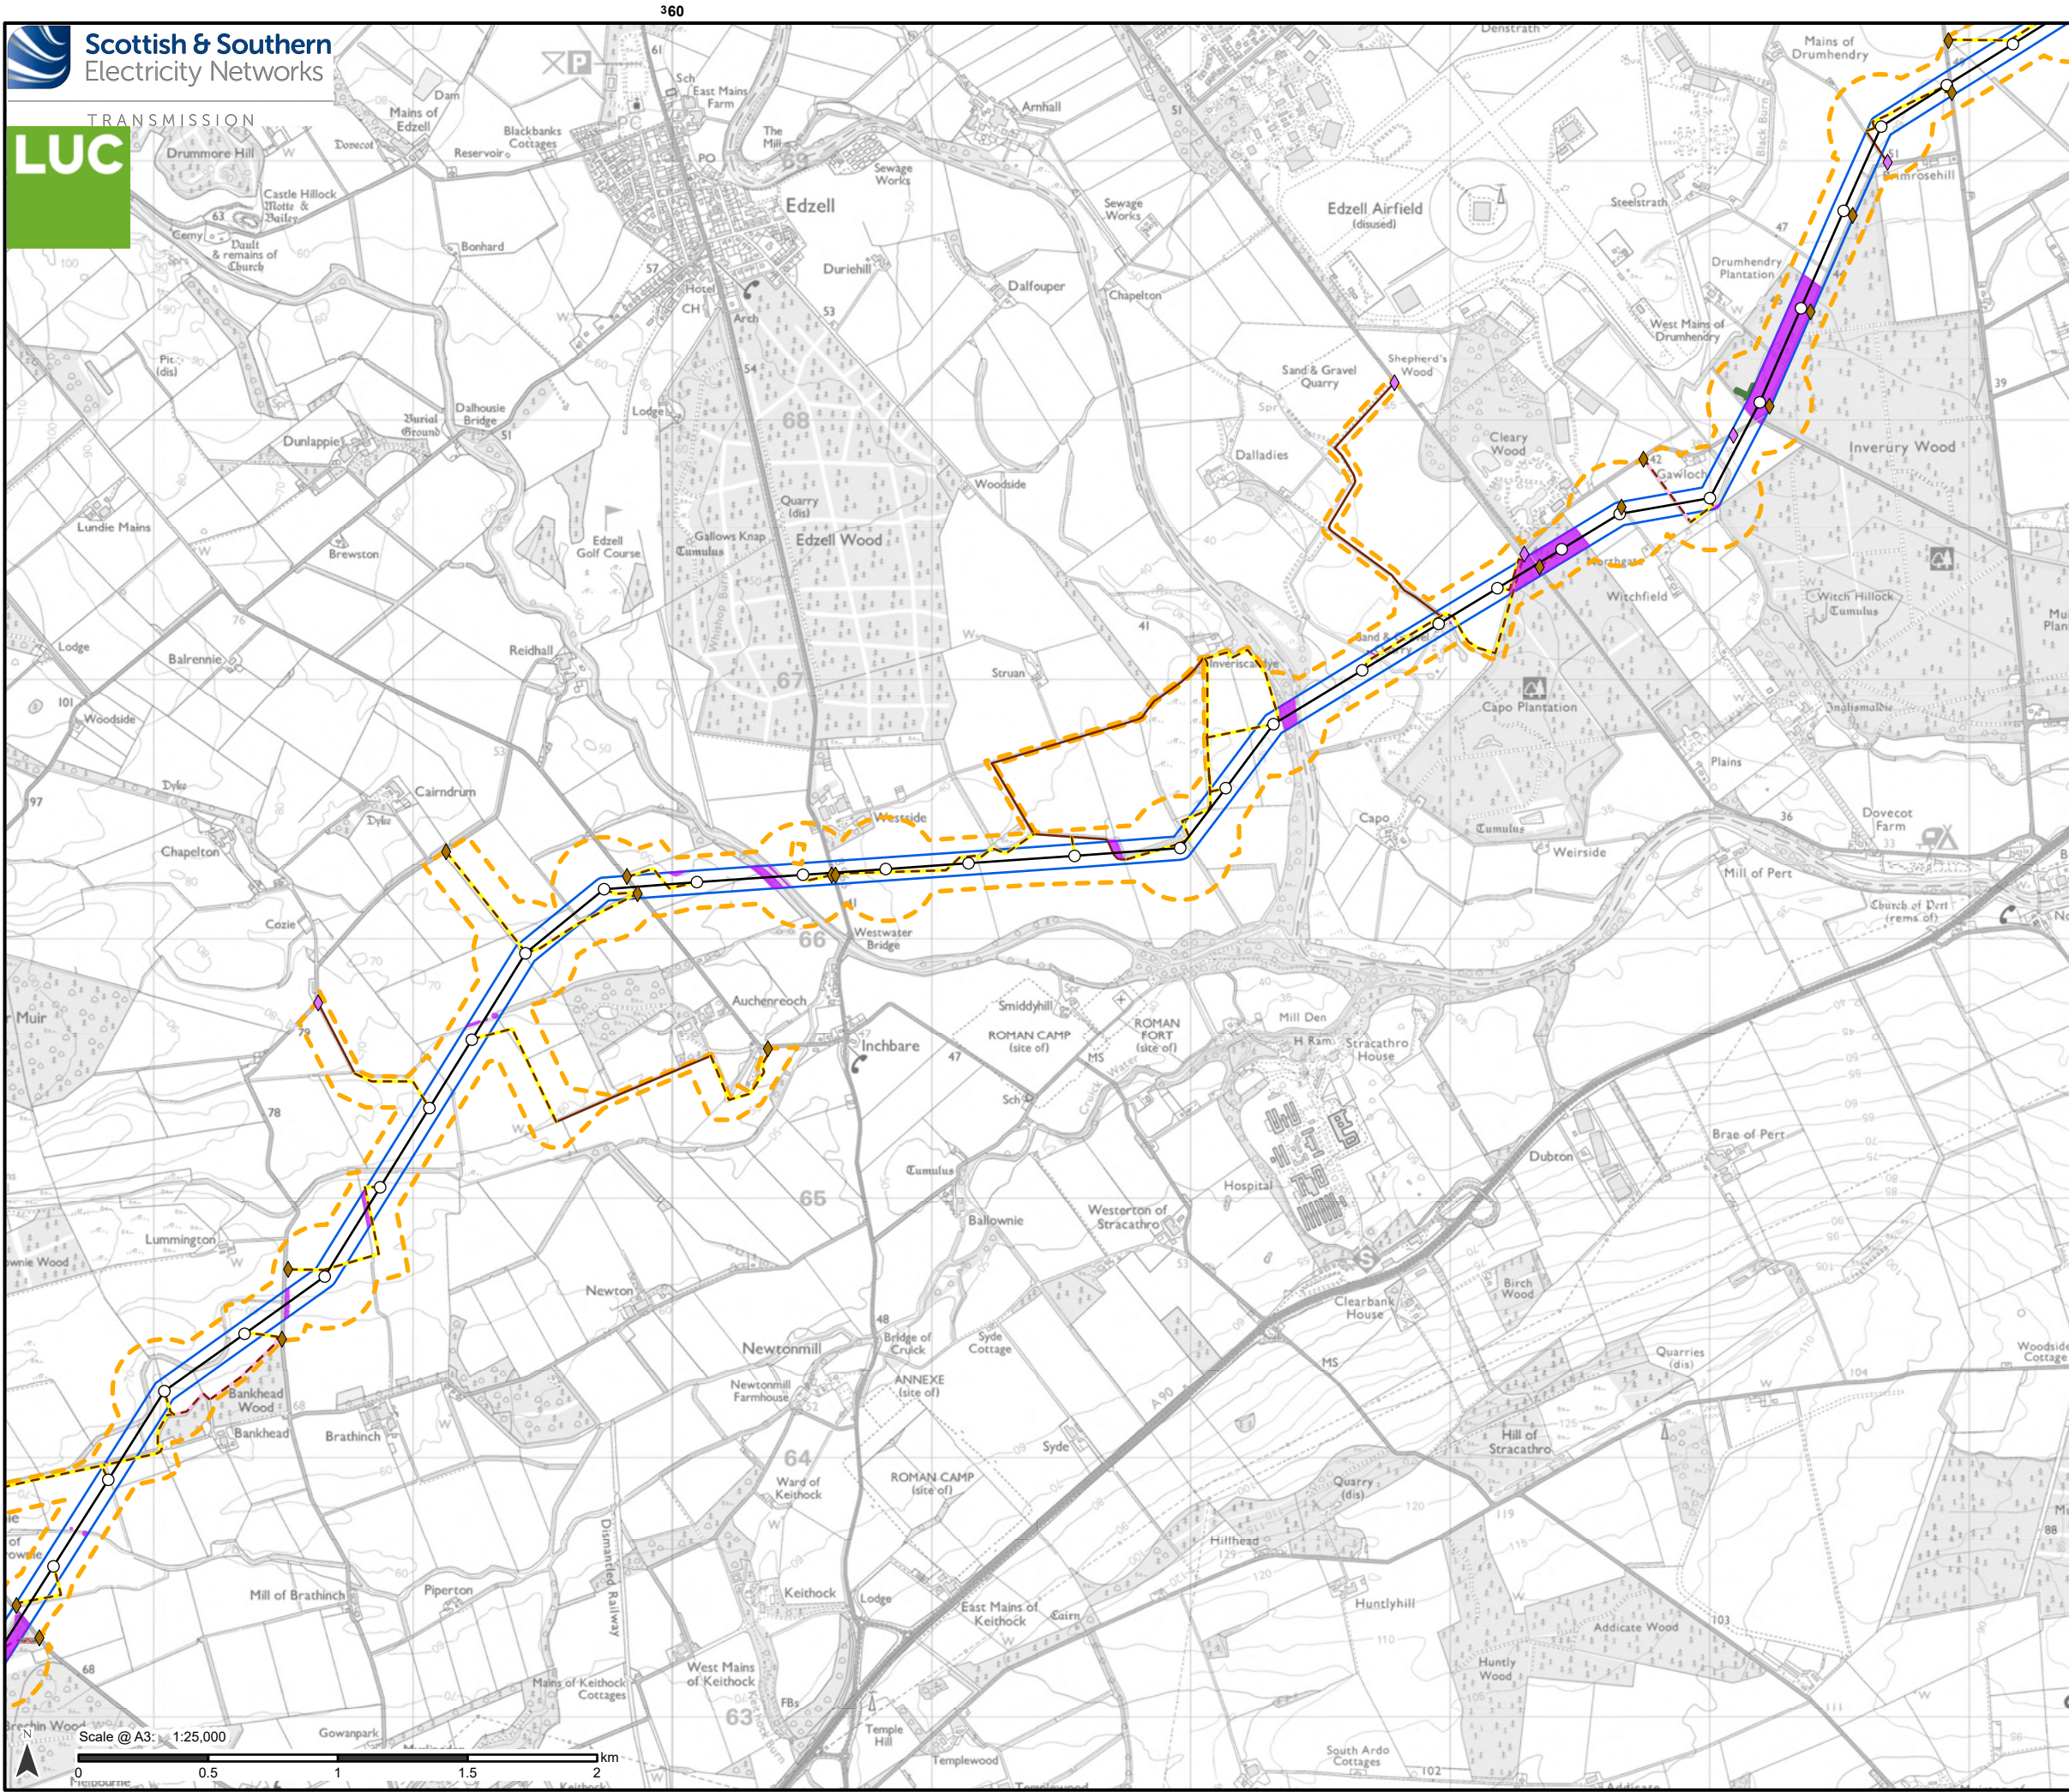

Proposed Development

Tower Location

Proposed Alignment

Proposed Development Limit of Deviation (LOD)

Operational Corridor

Access

Existing to be upgraded

Proposed new stone permanent

Proposed new stone temporary

Bellmouth type

Proposed new

Existing to be upgraded

Baseline species

Felled awaiting restock

Mixed broadleaves


Operational corridor felling/open ground

Notes:
For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Restocking Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.5.7

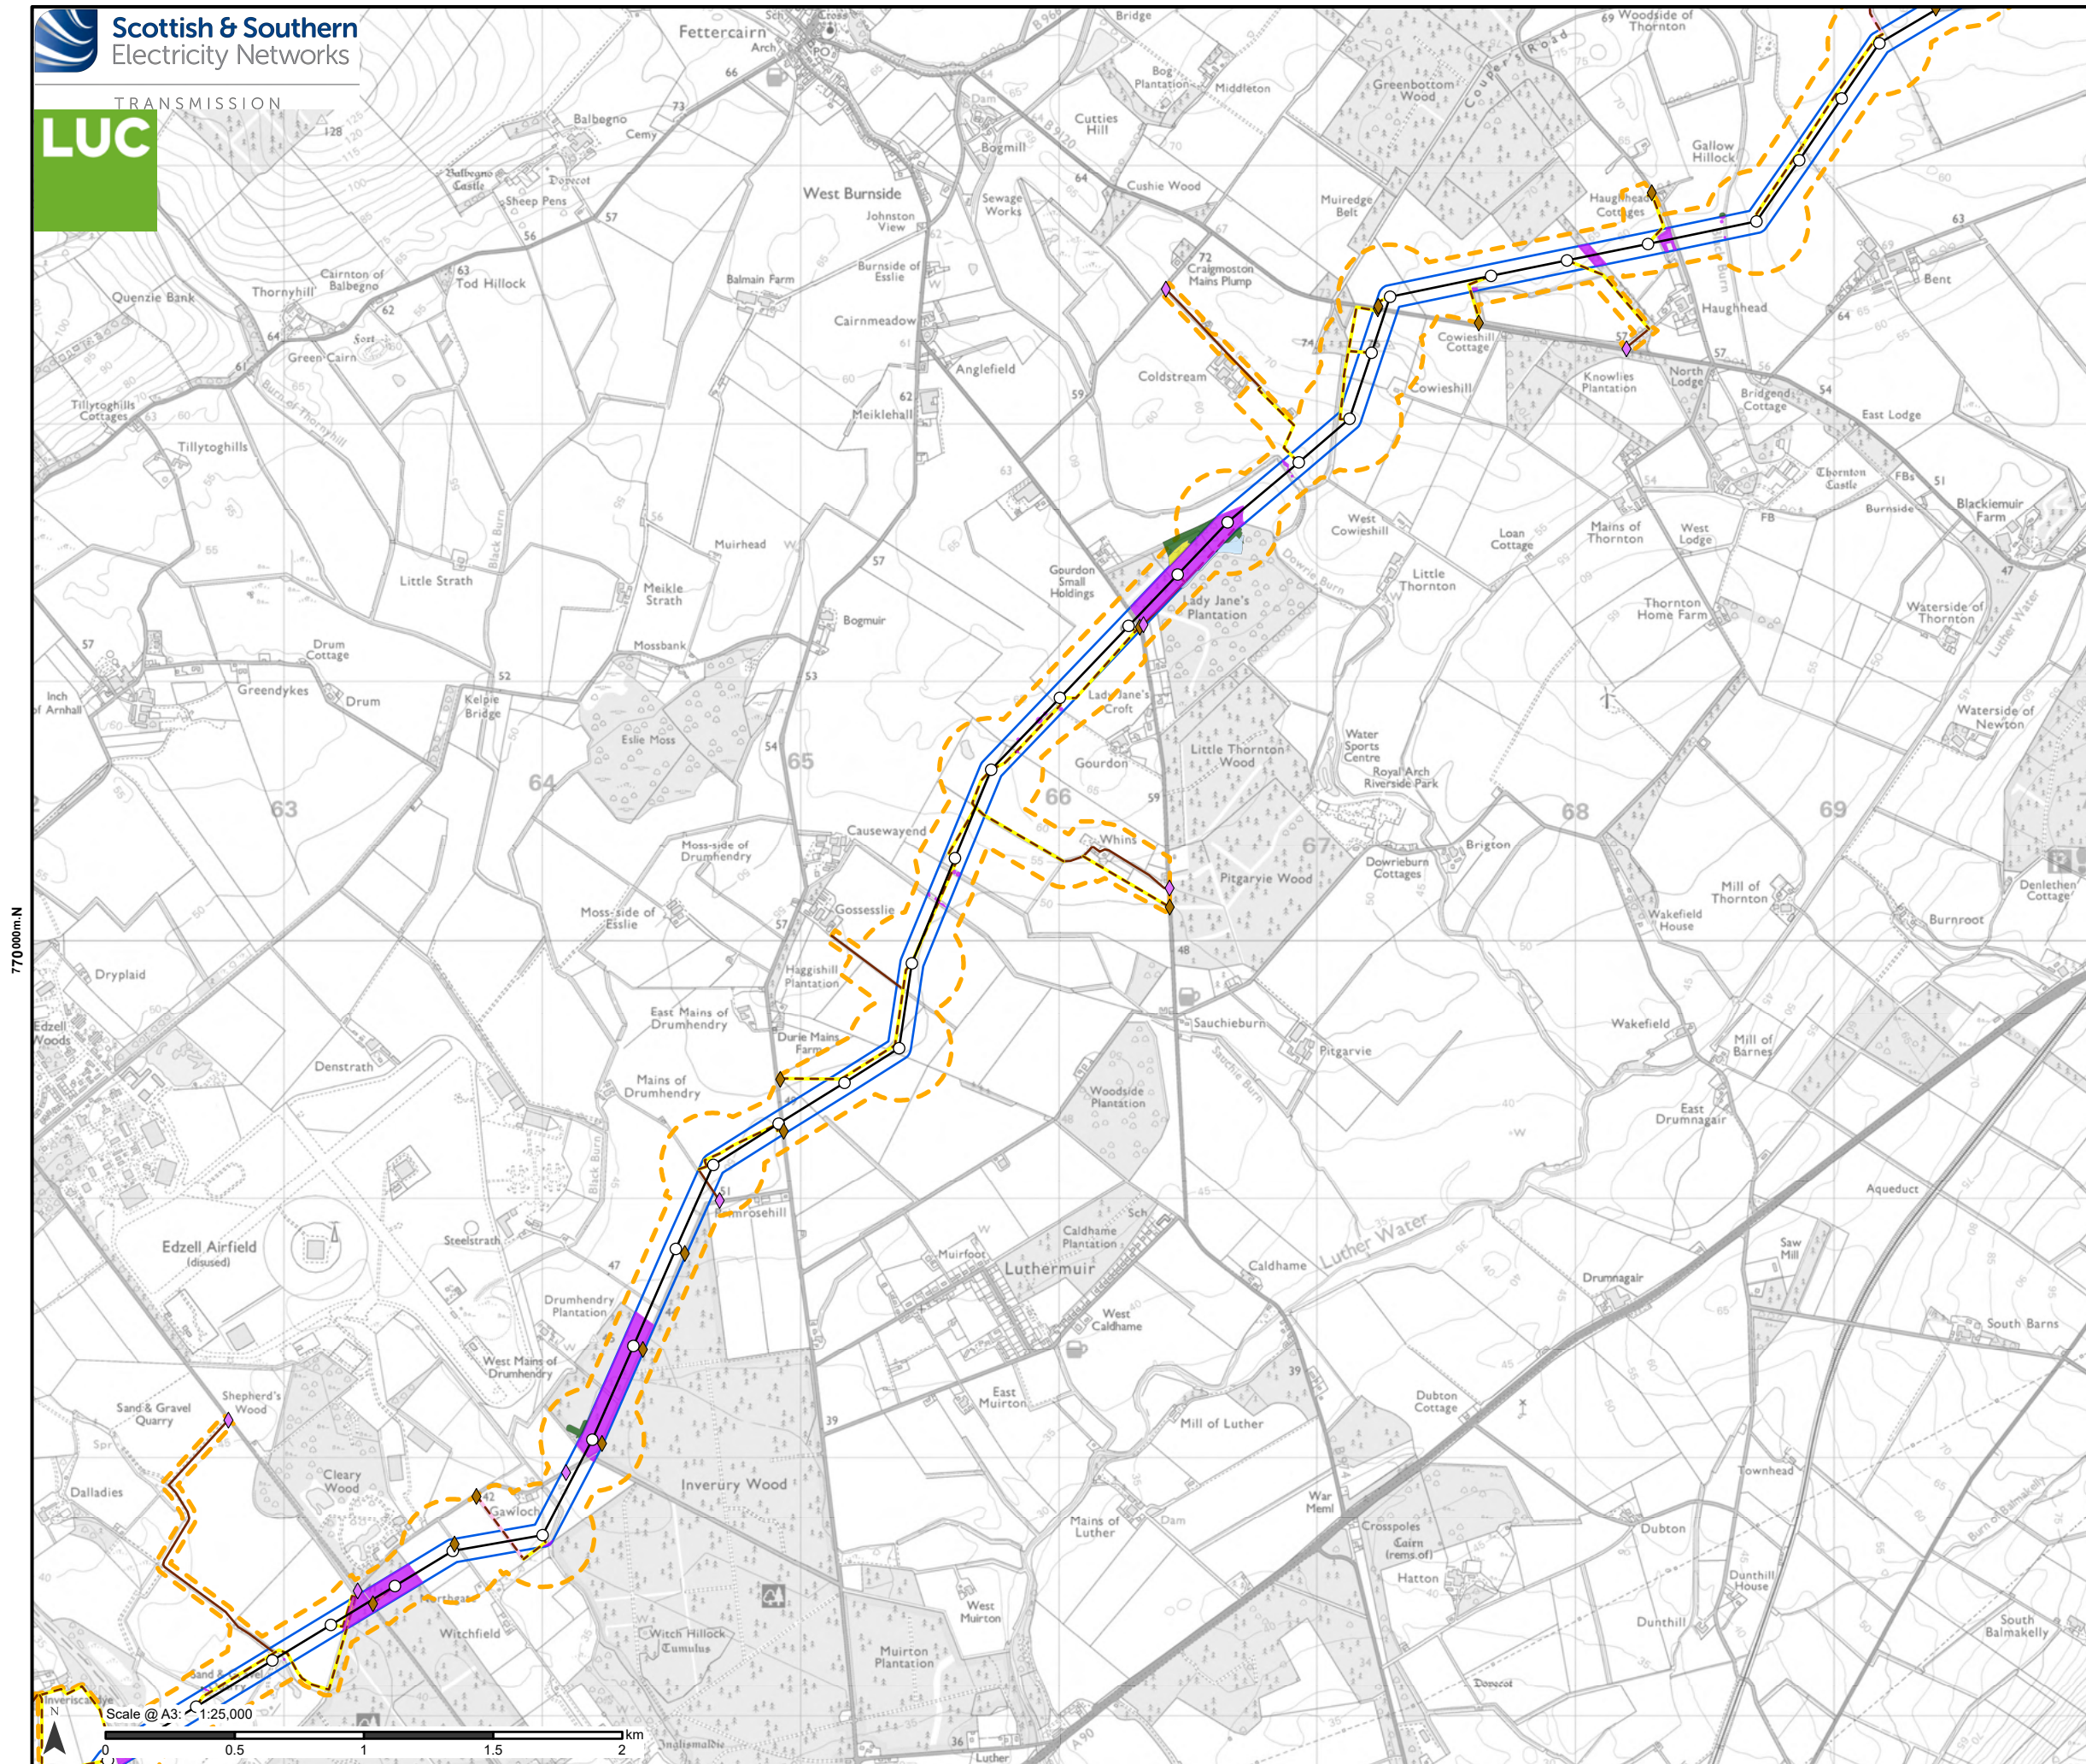

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type


- ◆ Proposed new
- ◆ Existing to be upgraded

Baseline species

- Mixed broadleaves
- Other conifer
- Sitka spruce
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

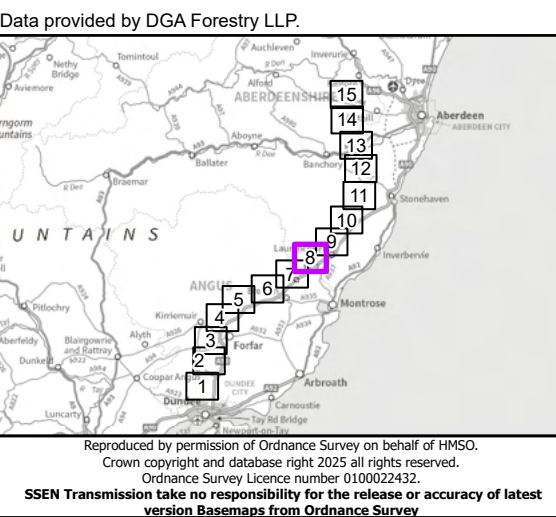

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.8