


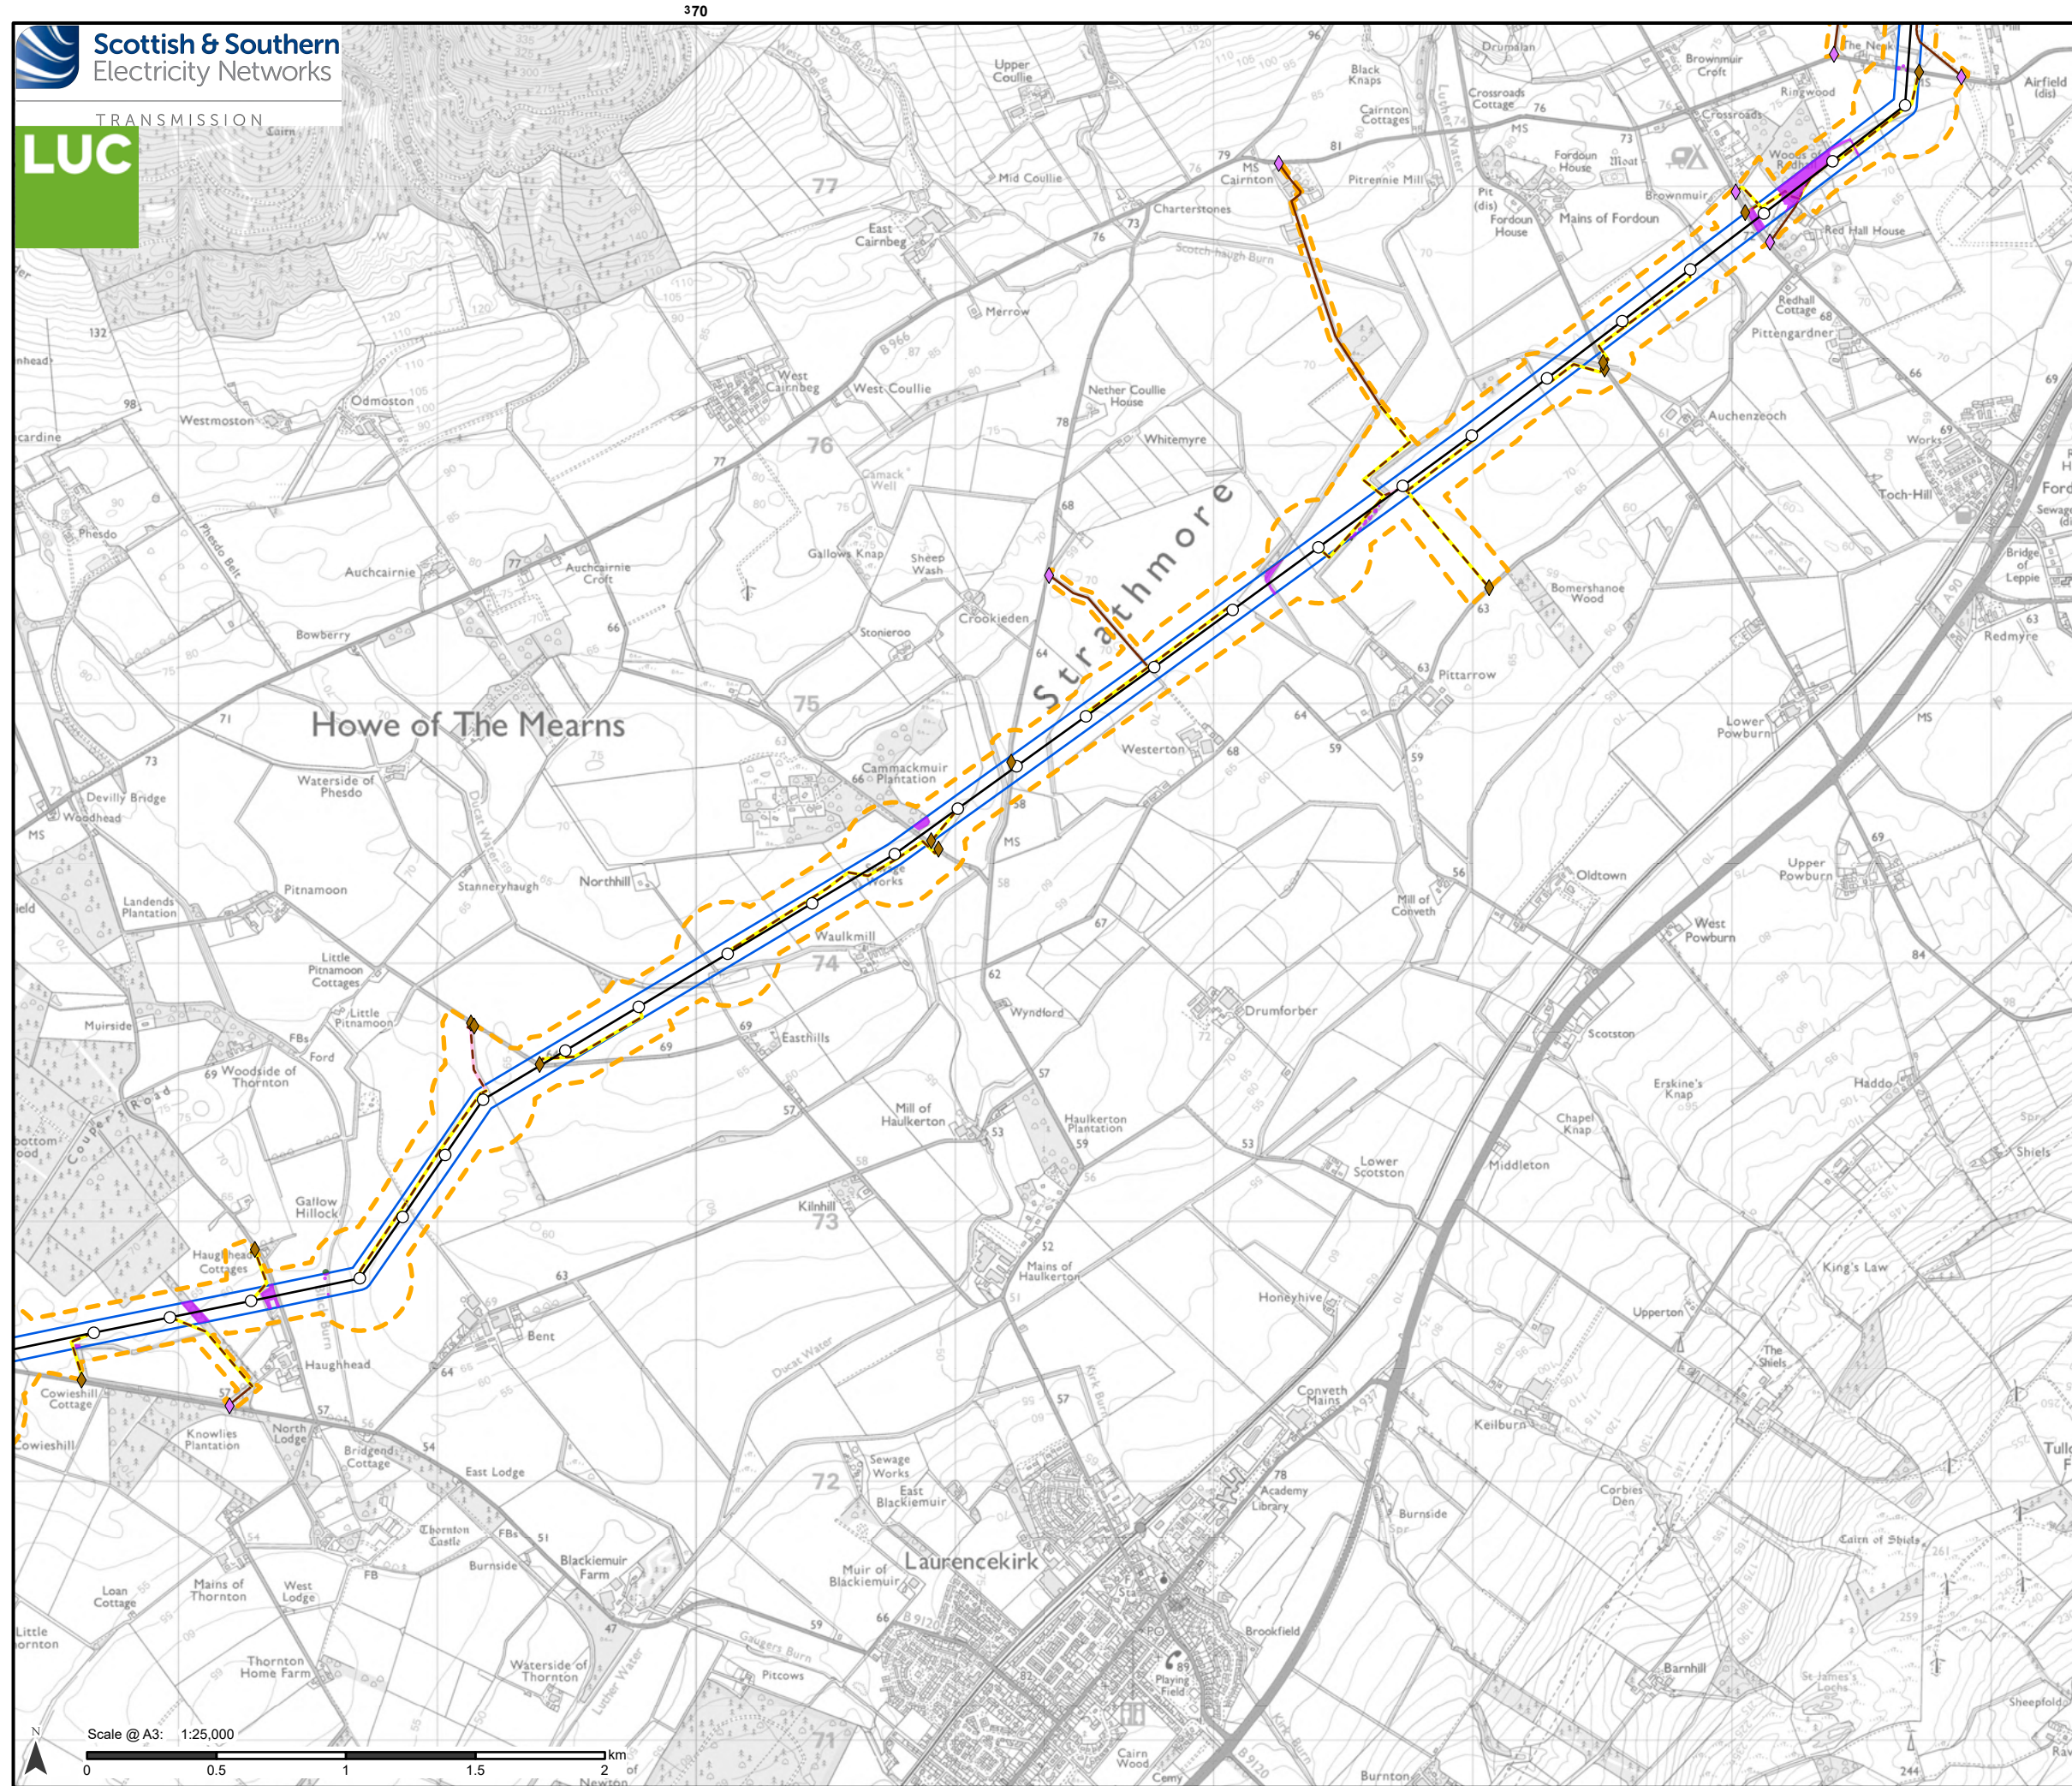

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- ▭ Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Baseline species

- ▭ Mixed broadleaves
- ▭ Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.9

780 000m. N

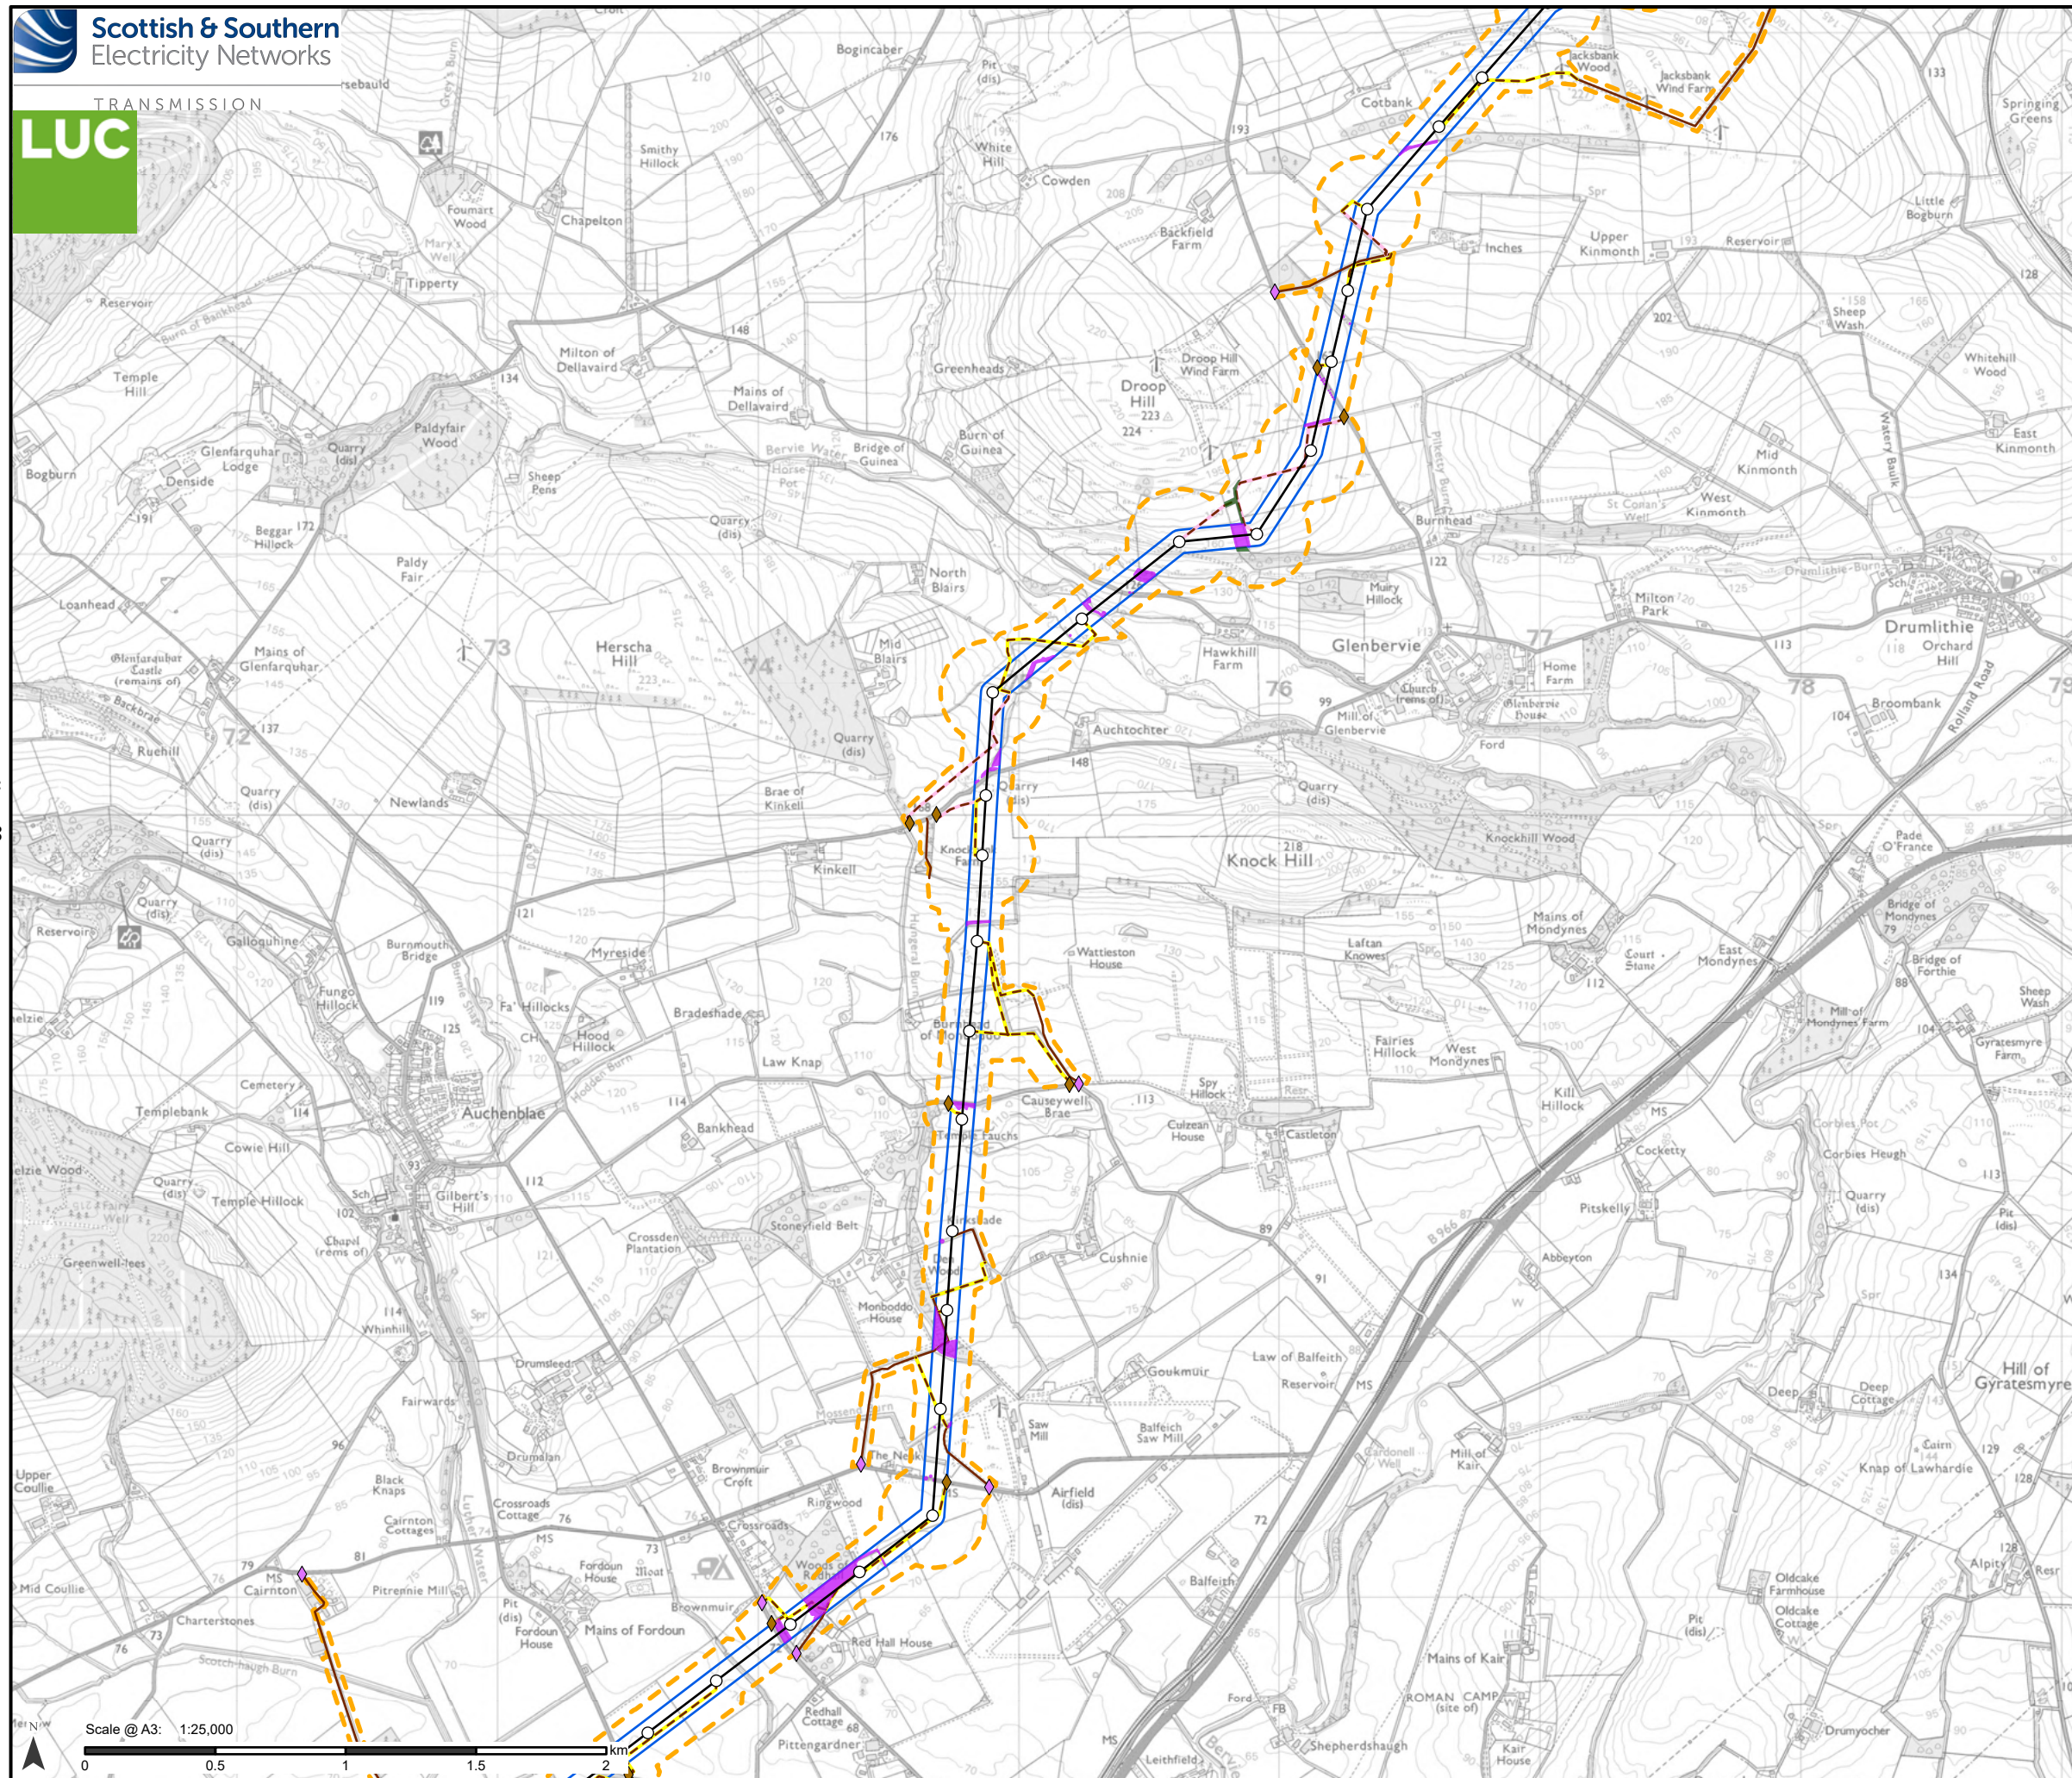

780 000m. N

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Baseline species

- Mixed broadleaves
- Mixed woodland
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

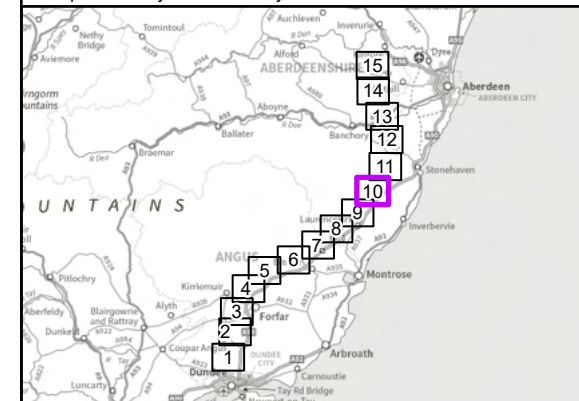

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Proposed Development Restocking Plan

Drawn by: MS

Date: 19/08/2025

Drawing: 8.5.10

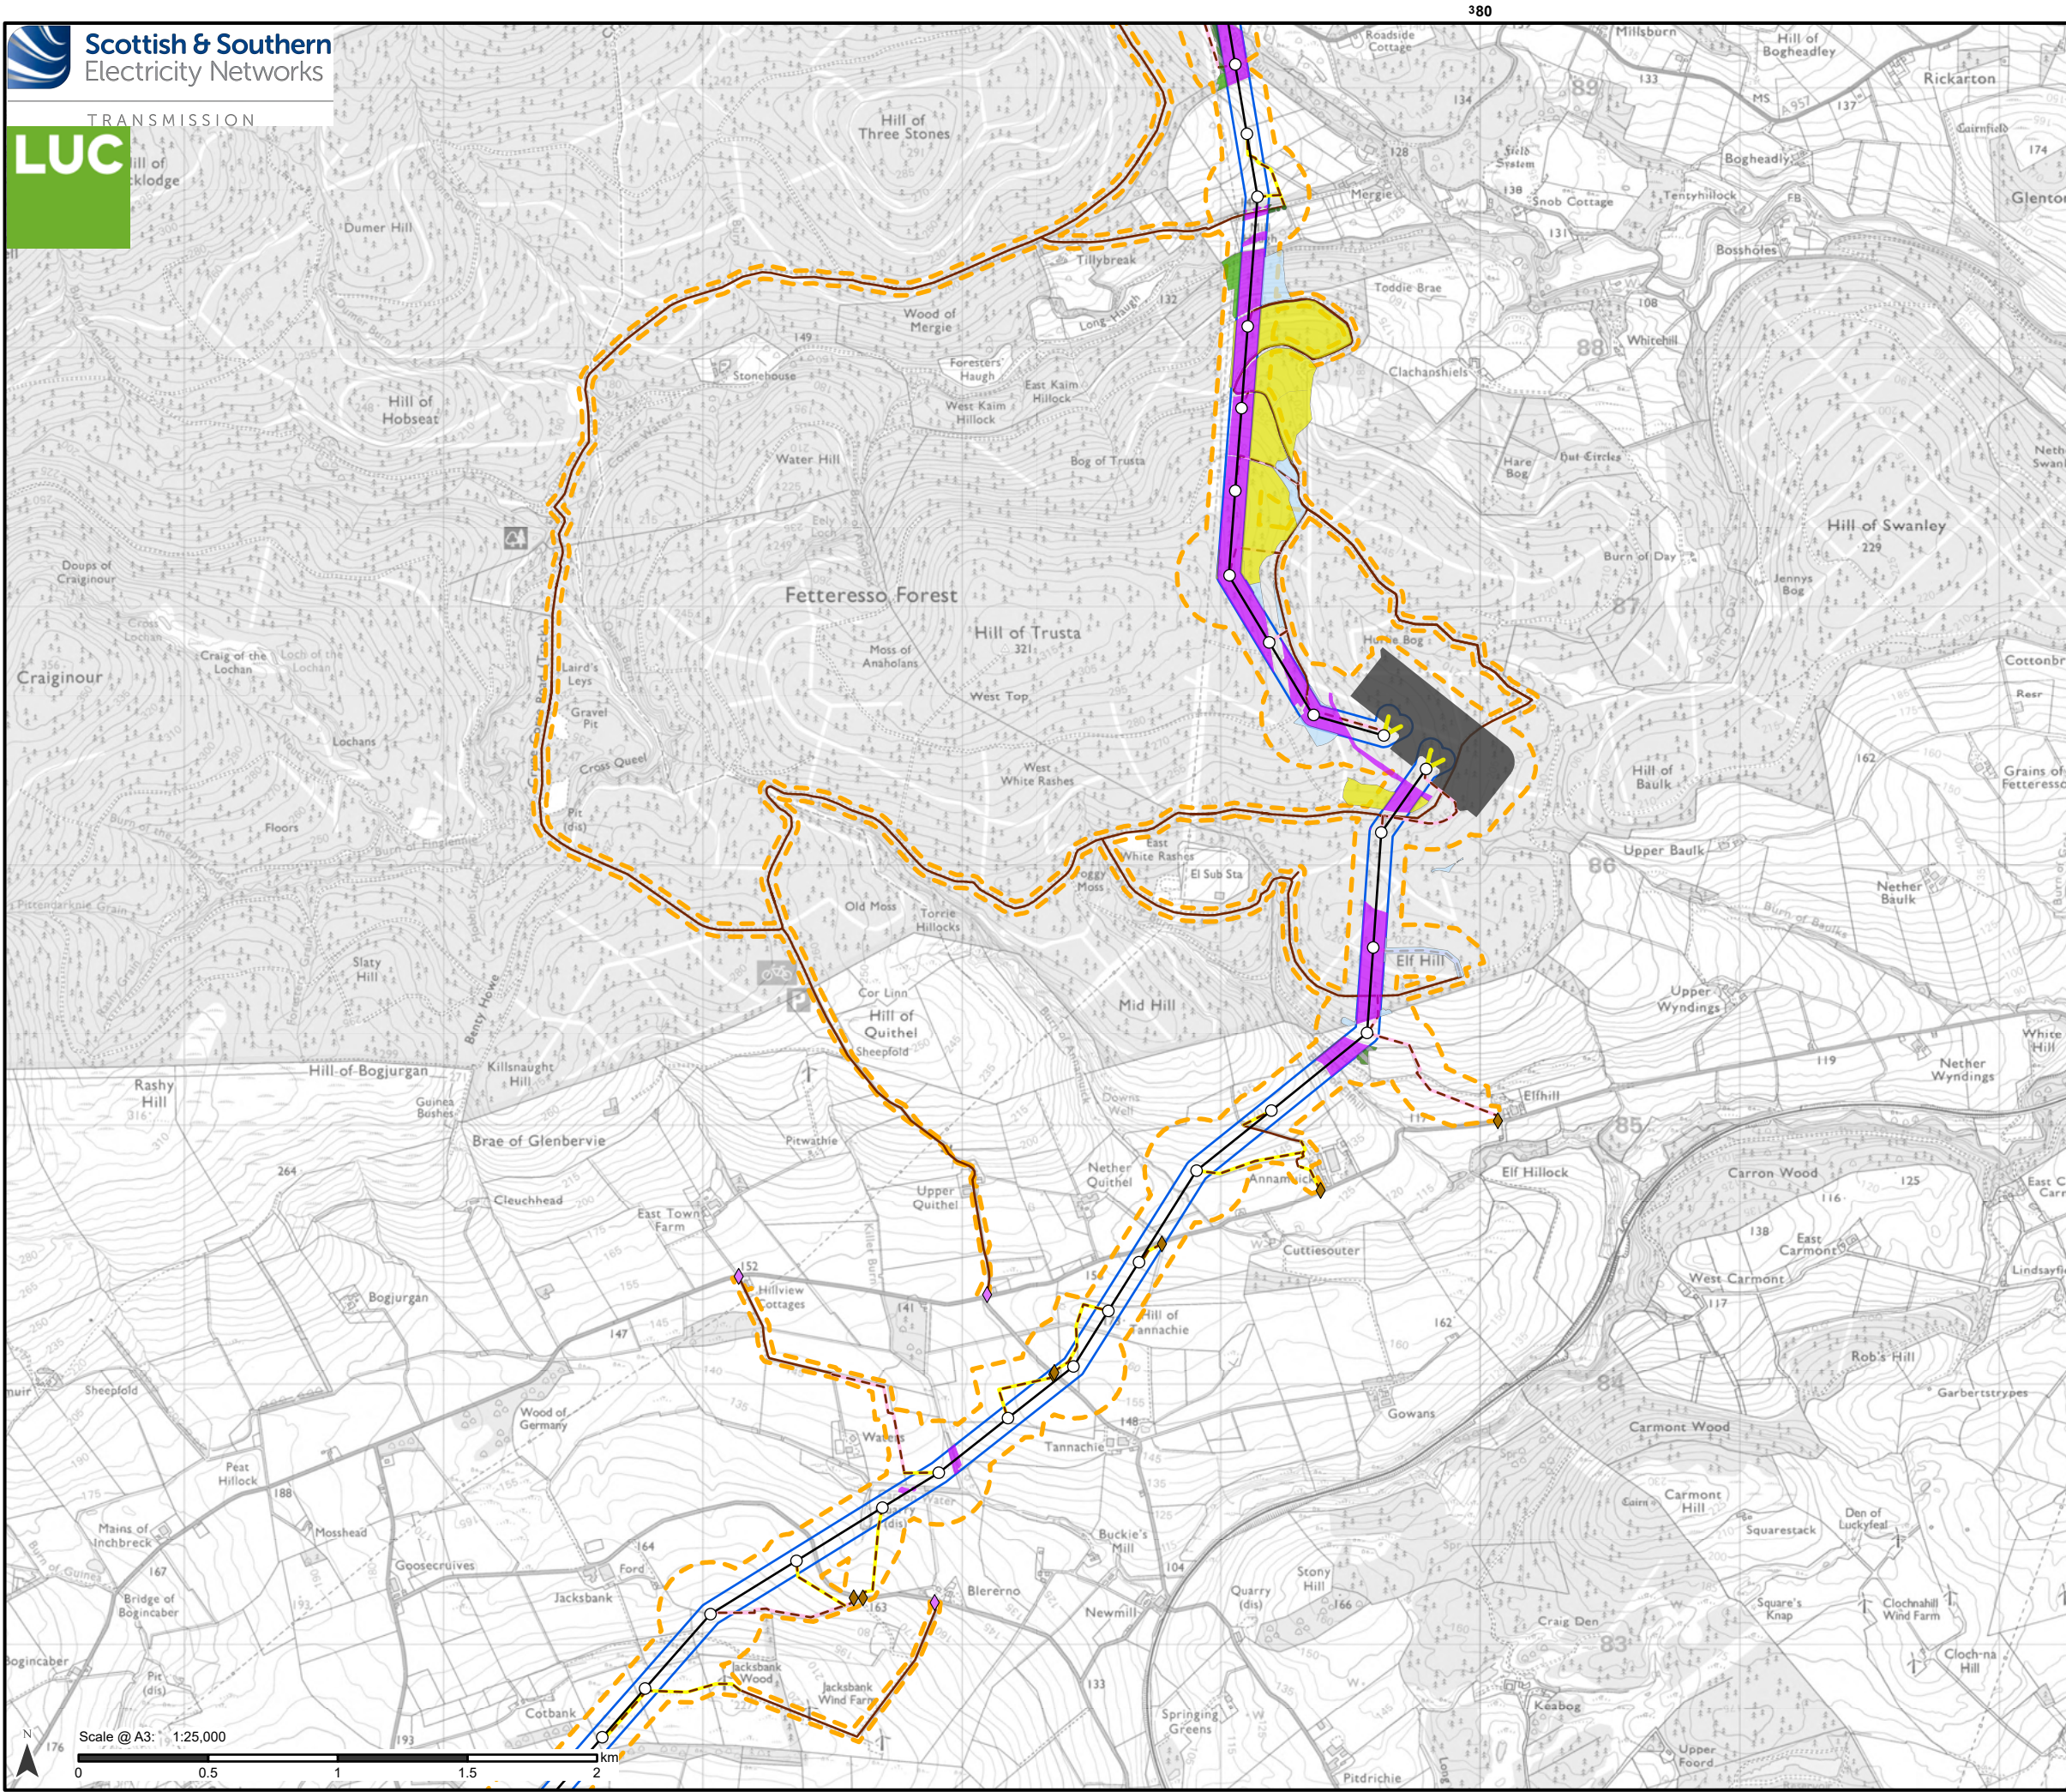

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- Proposed new
- Existing to be upgraded

Intra (Associated) Developments

- Proposed Hurlie 400 kV substation (Aberdeenshire Council Reference APP/ 2024/1951)

Baseline species

- Mixed broadleaves
- Other conifer
- Scrub/Regen
- Sitka spruce
- Sitka spruce/other conifer
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.11

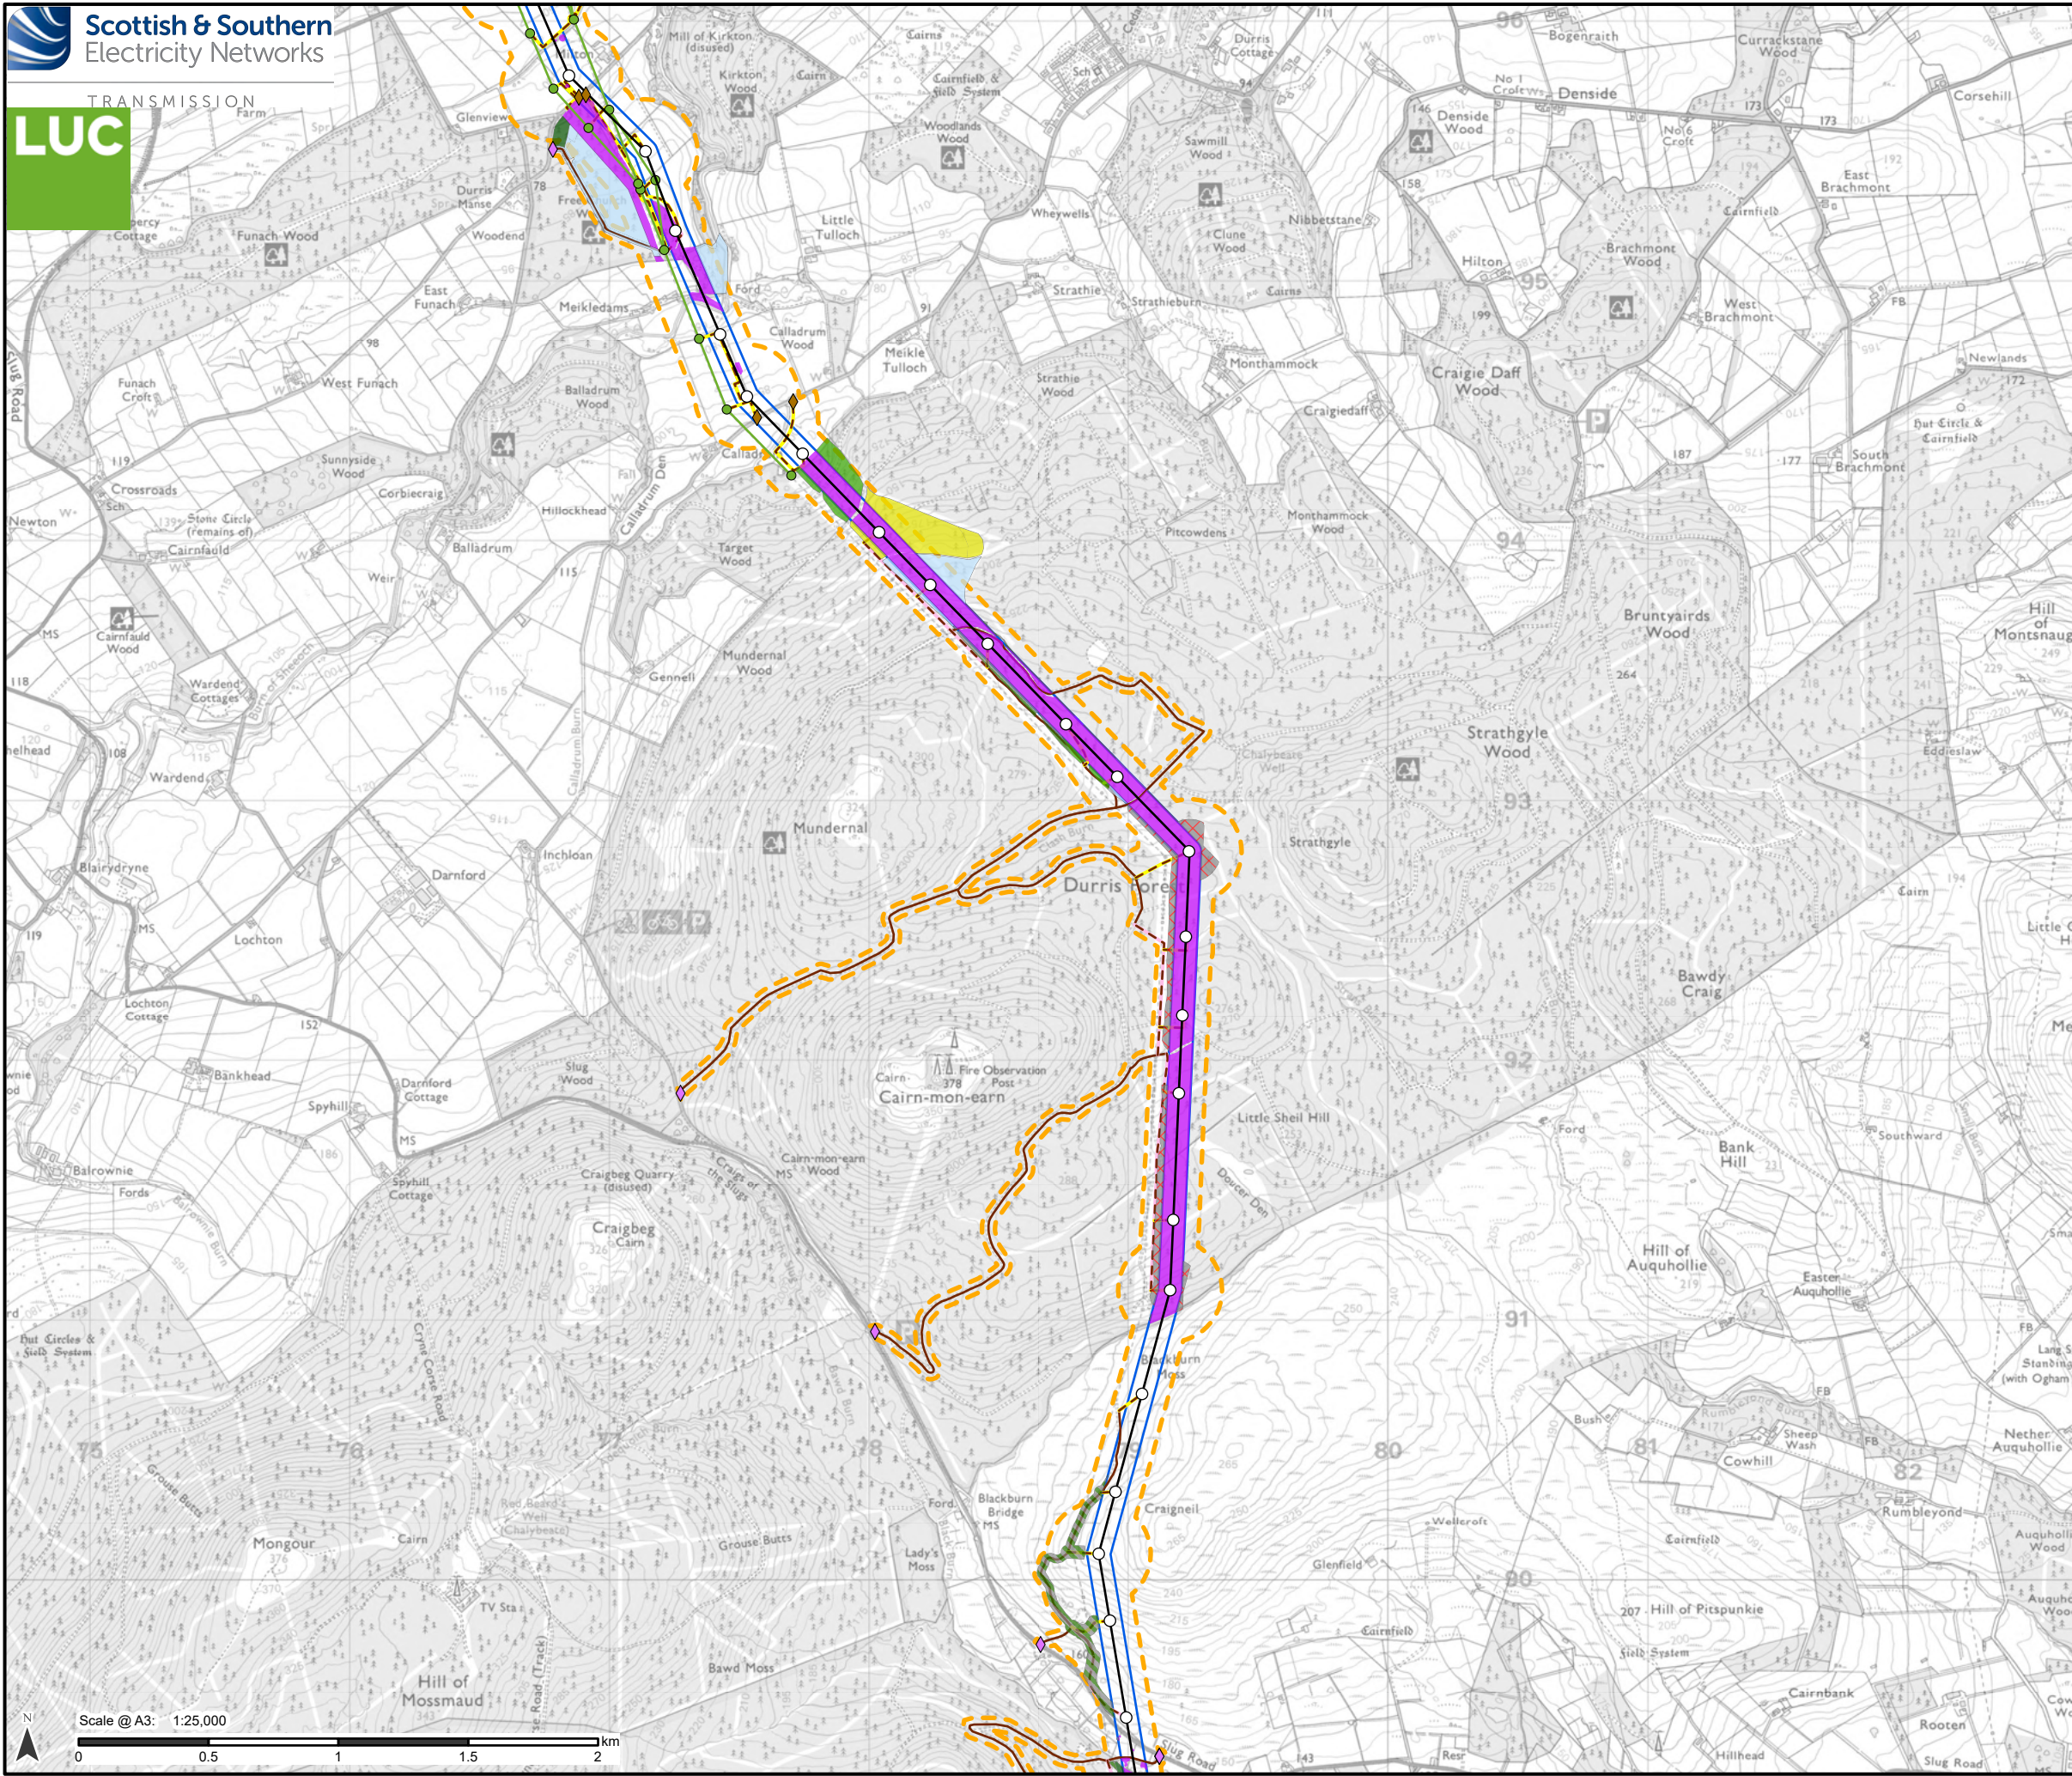

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment


- Tower Location
- Overhead Line (OHL)

Baseline species


- ▨ Felled awaiting restock
- Mixed broadleaves
- Other conifer
- ▨ Scrub/Regen
- Sitka spruce
- Sitka spruce/other conifer
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

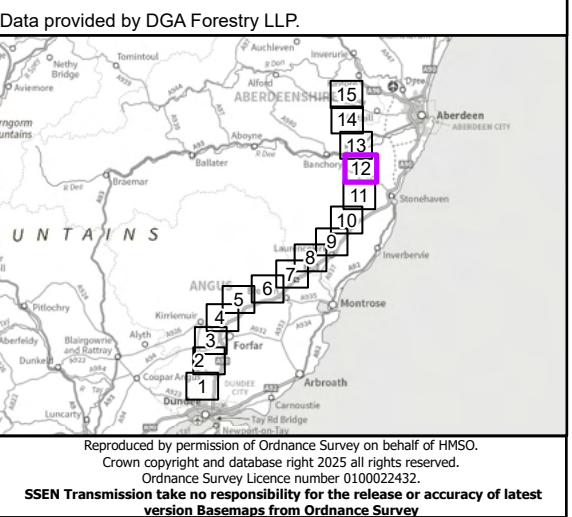

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey	
Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development Restocking Plan
Drawn by:	MS
Date:	19/08/2025
Drawing:	8.5.12

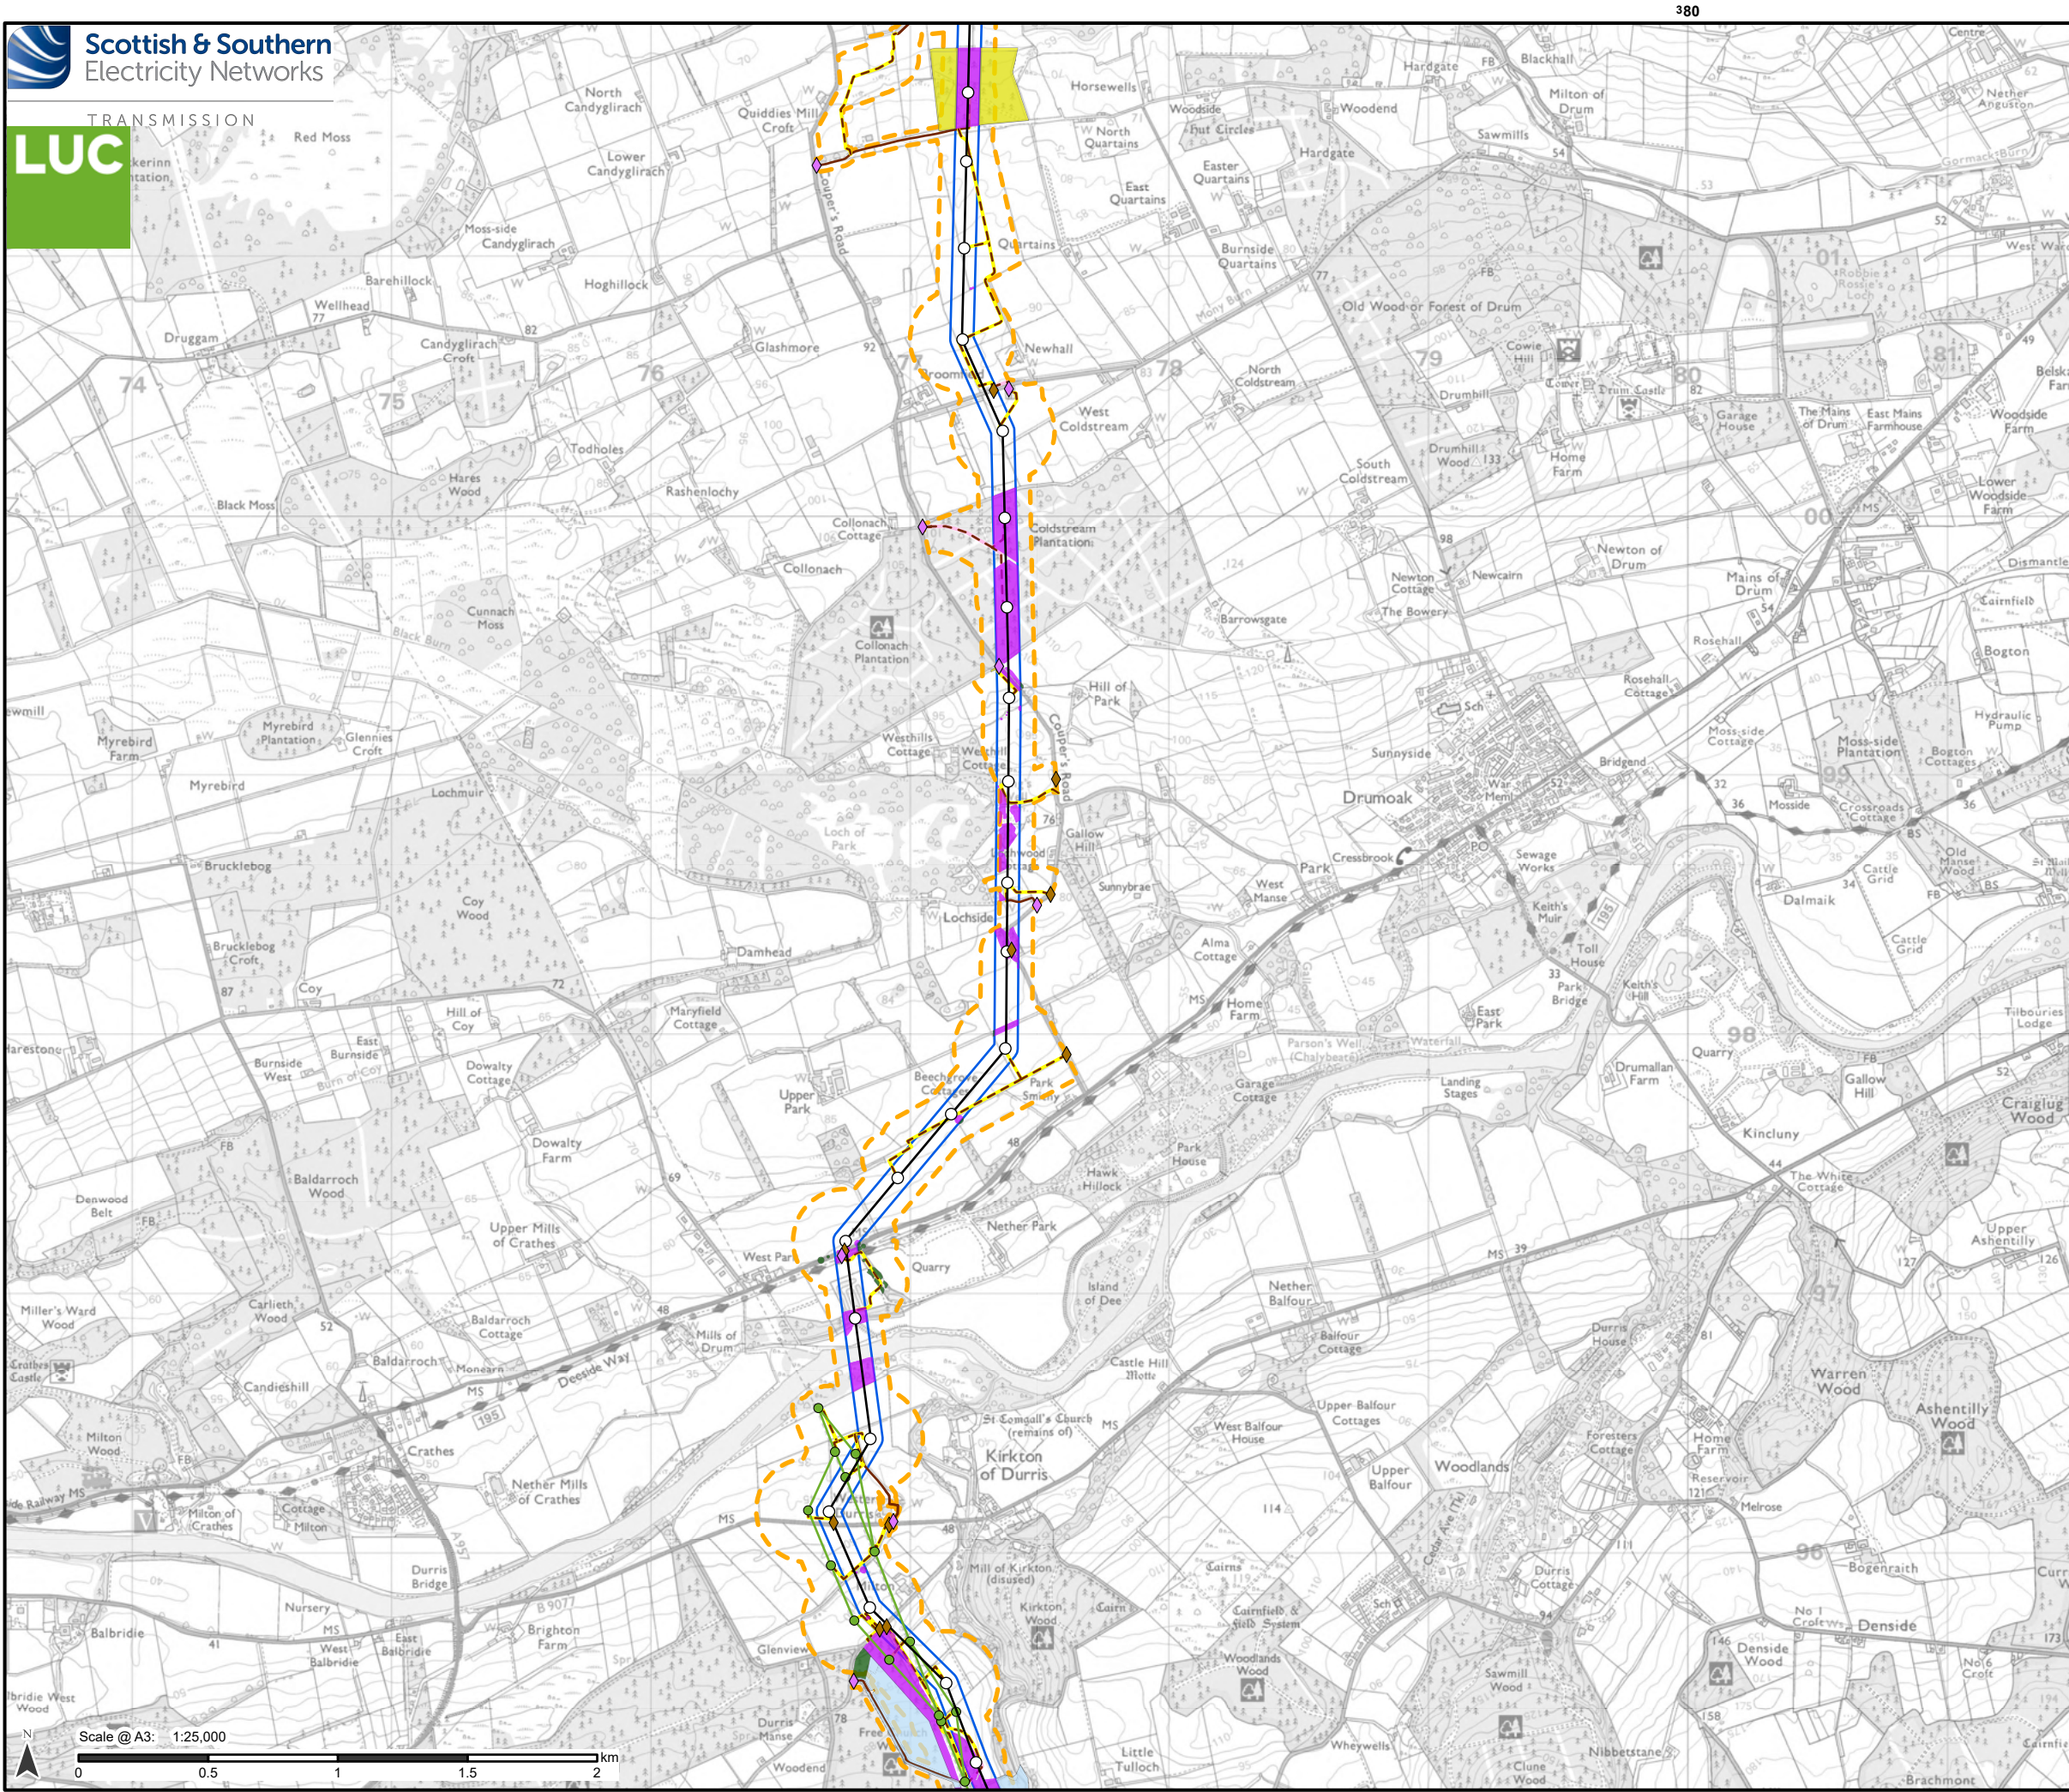

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- Proposed new
- Existing to be upgraded

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Baseline species

- Mixed broadleaves
- Other conifer
- Sitka spruce
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.13

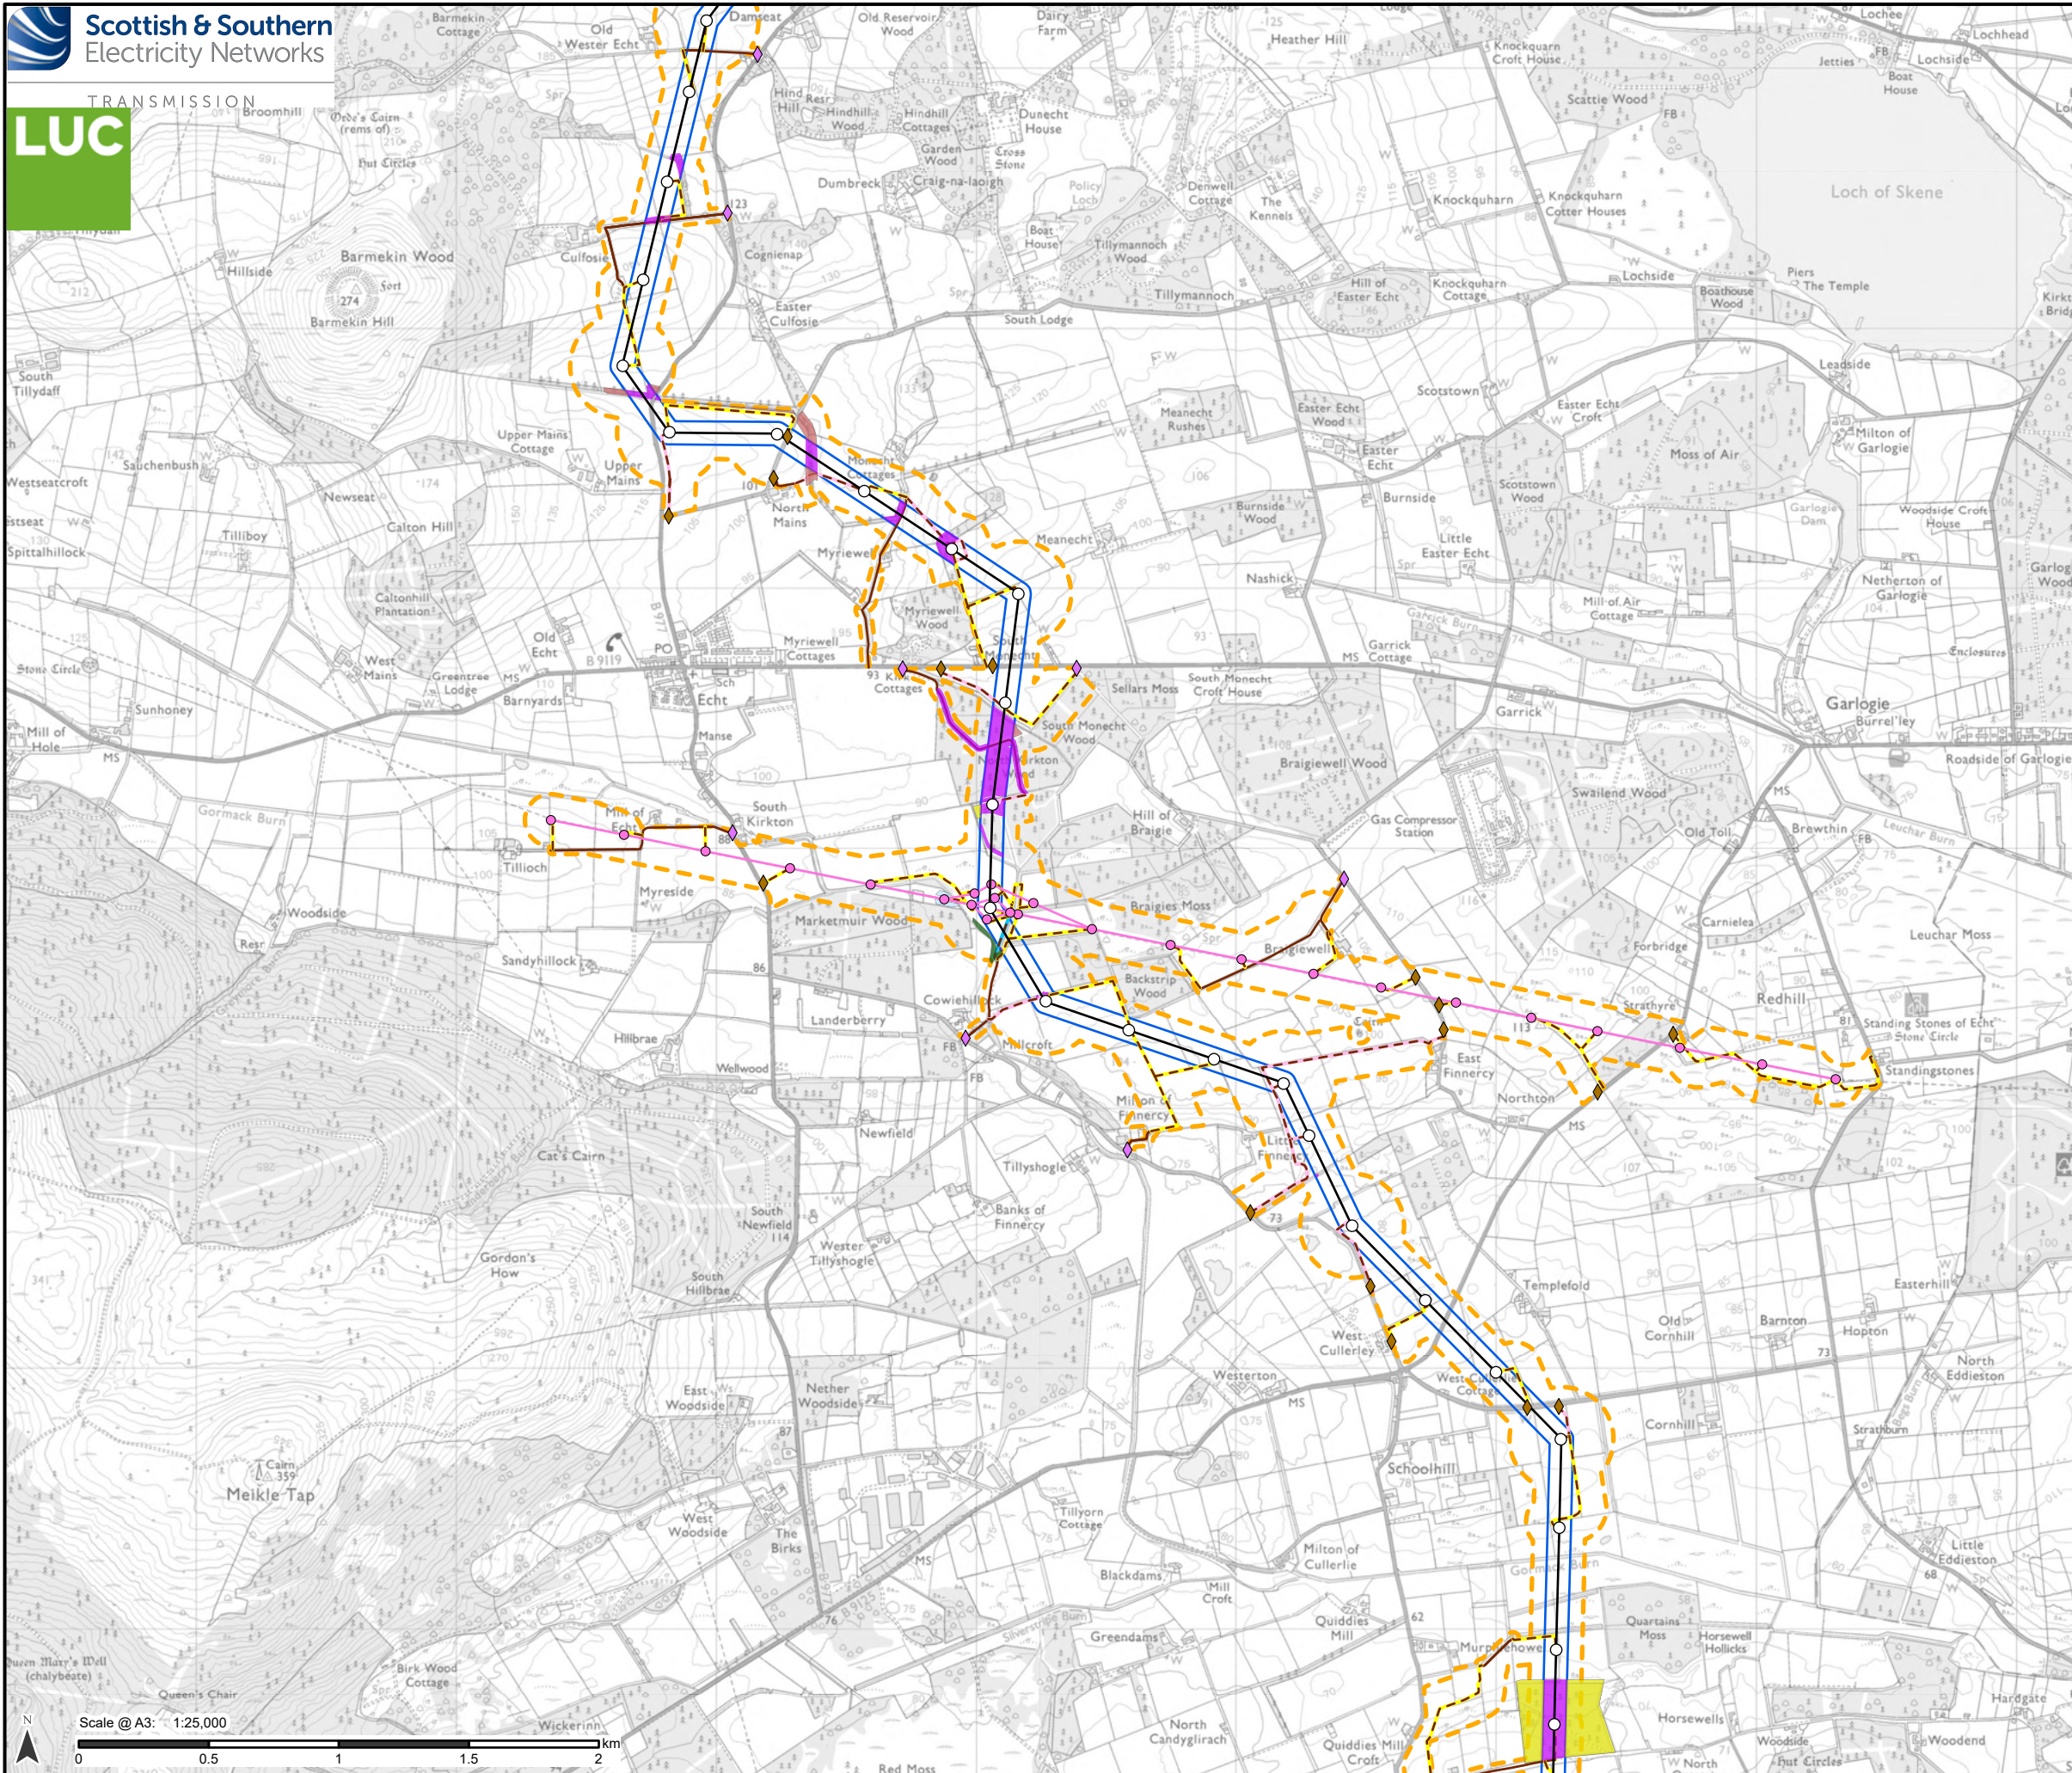

Proposed Development

- Tower Location
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)
- ▭ Operational Corridor

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- Proposed new stone permanent (operational and maintenance access track only - not for construction)
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Craigiebuckler - Tarland 132 kV Overhead Line Crossing

- Tower Location
- OHL


Baseline species

- Mixed broadleaves
- Mixed woodland
- Other conifer
- Sitka spruce
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

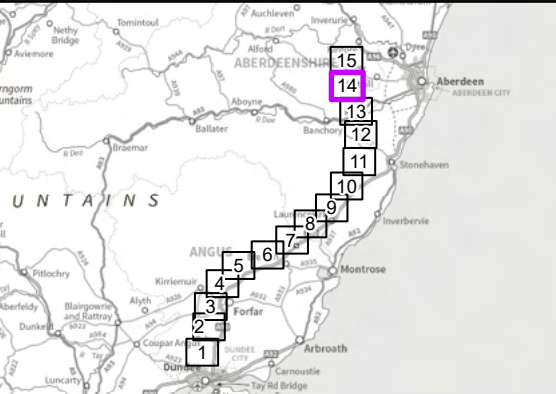


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025
Drawing: 8.5.14

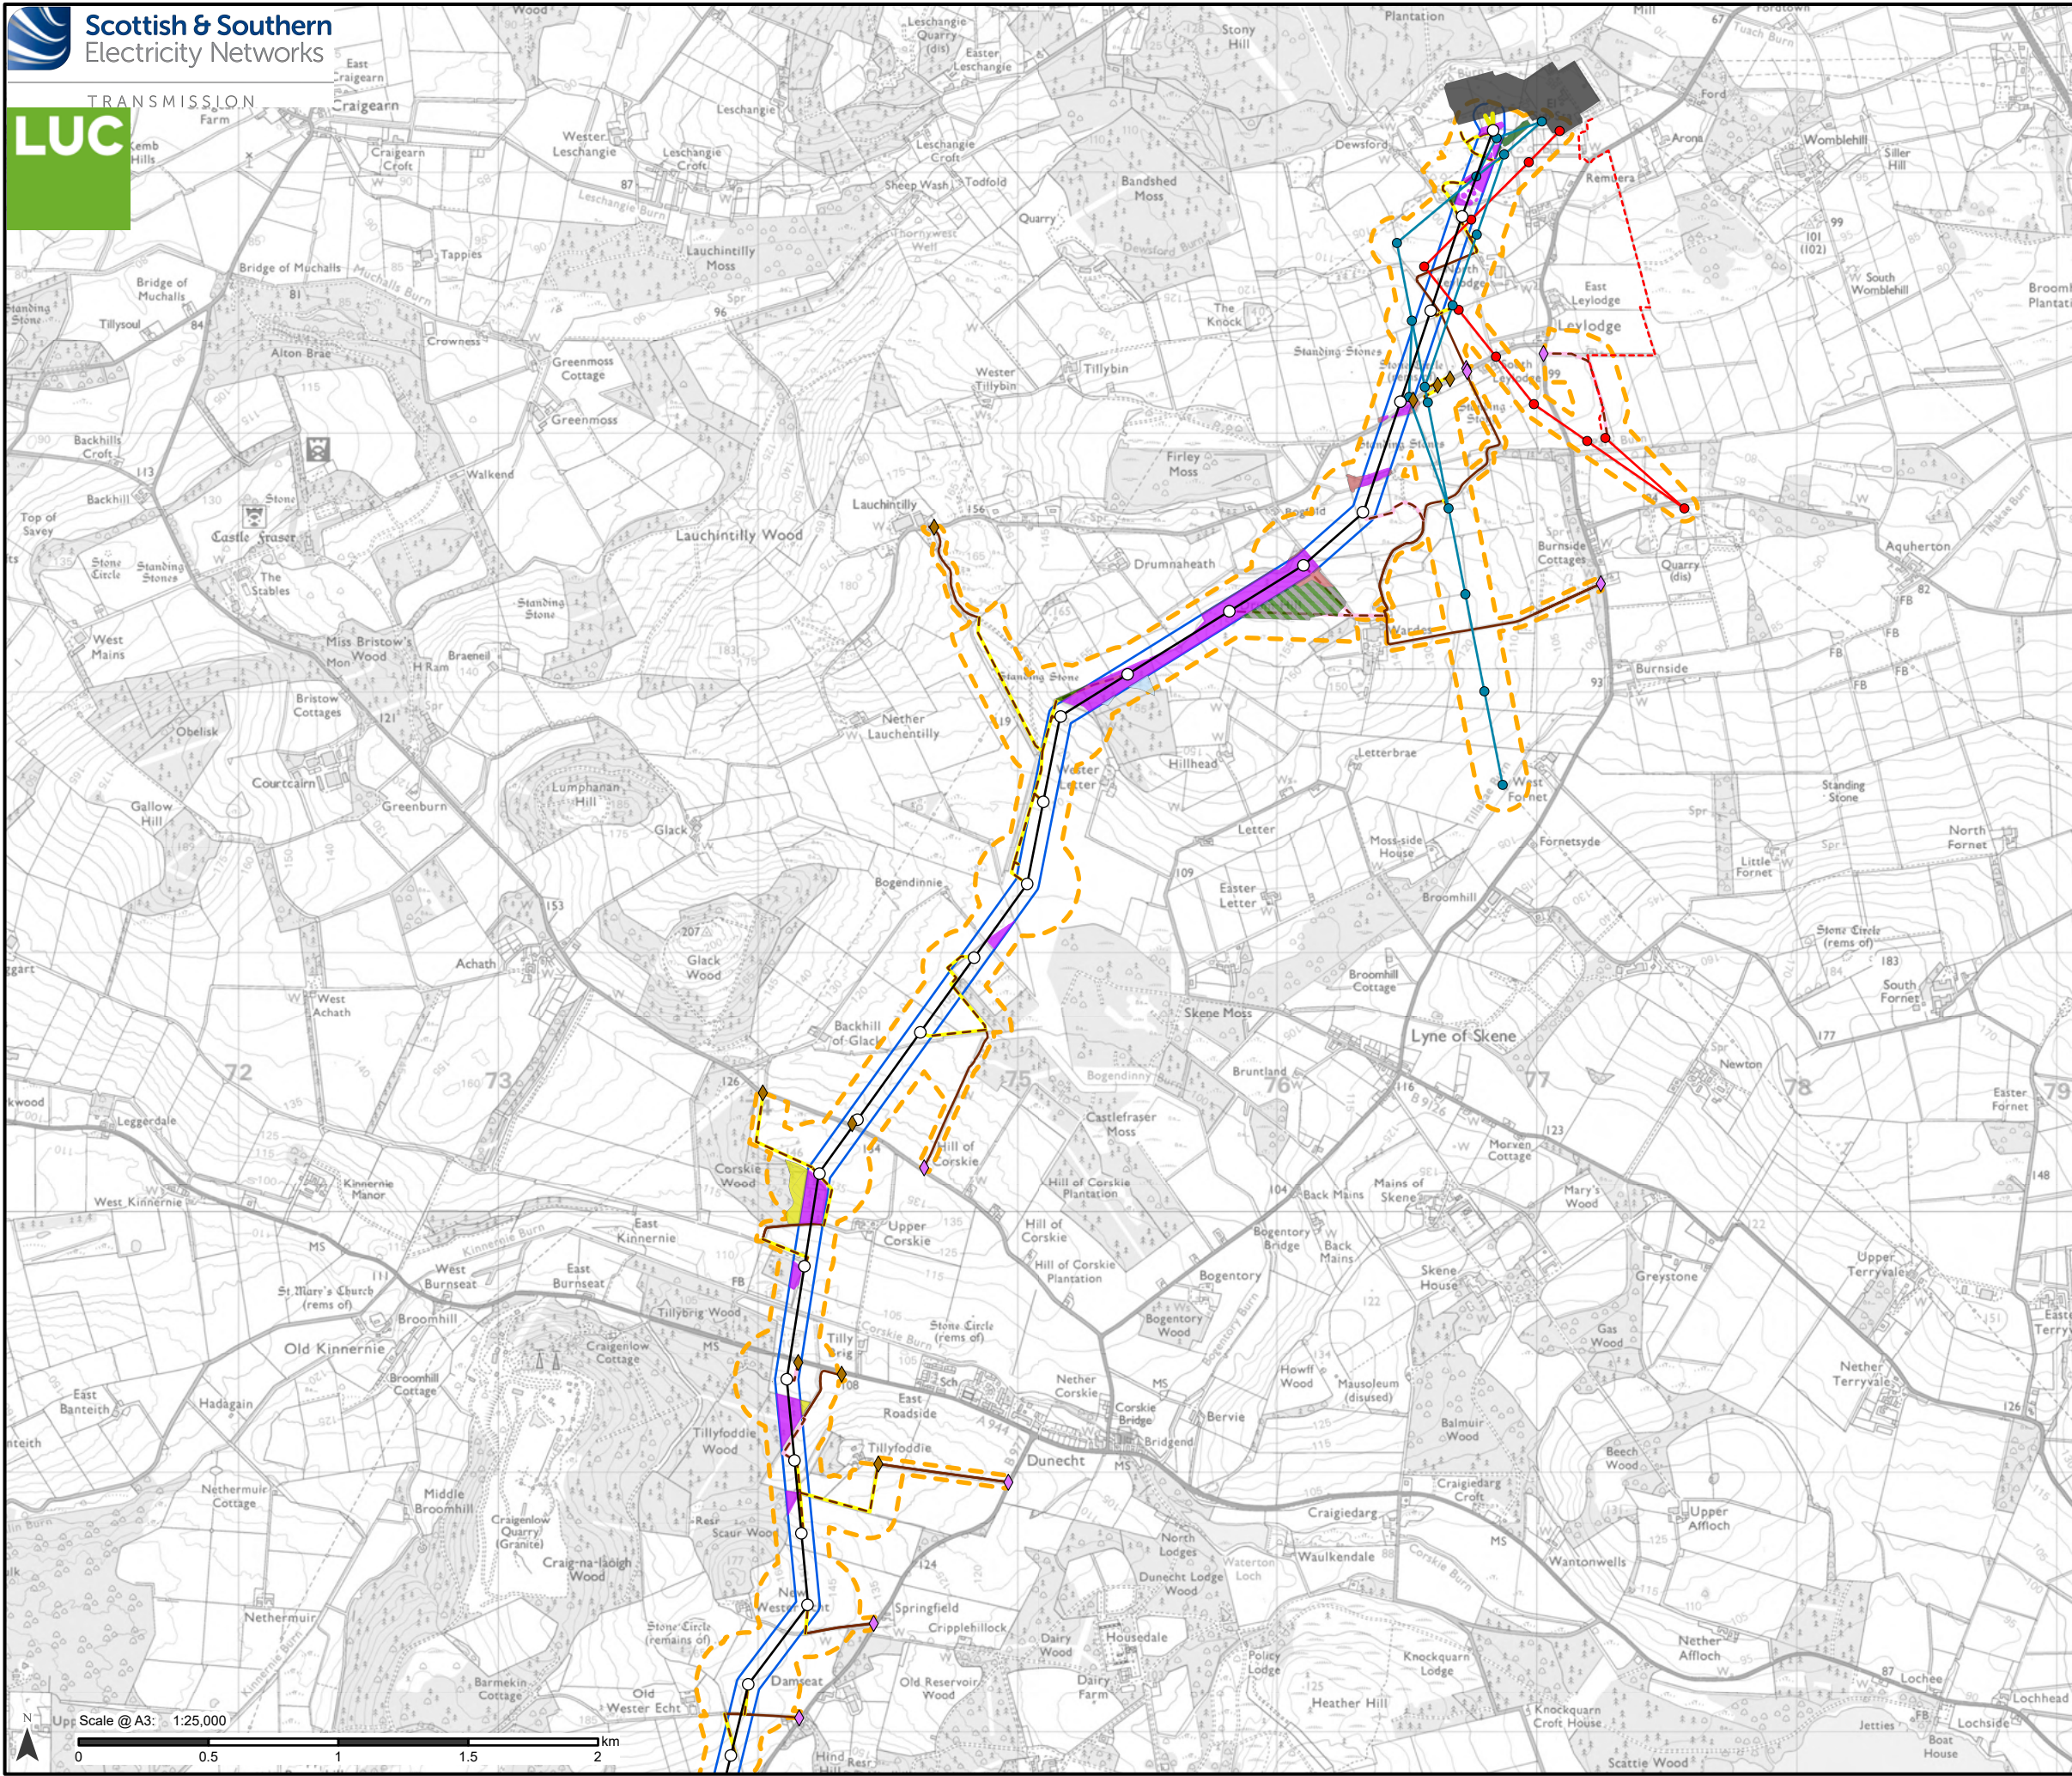

Proposed Development

- Tower Location
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)
- Operational Corridor

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Additional development included in Section 37 application: Kintore - Tealing 275 kV Overhead Line Realignment

- Tower Location
- Overhead Line (OHL)

Additional development included in Section 37 application: Kintore - Craigiebuckler 132 kV

- Tower Location
- OHL

Existing/Other Infrastructure

- Existing Kintore Substation

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Baseline species

- Mixed broadleaves
- Mixed woodland
- Other conifer
- Scrub/Regen
- Sitka spruce
- Operational corridor felling/open ground

Notes:

For a comprehensive view of the Proposed Development, please refer to Figure 3.1.

Data provided by DGA Forestry LLP.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development Restocking Plan

Drawn by: MS Date: 19/08/2025

Drawing: 8.5.15