



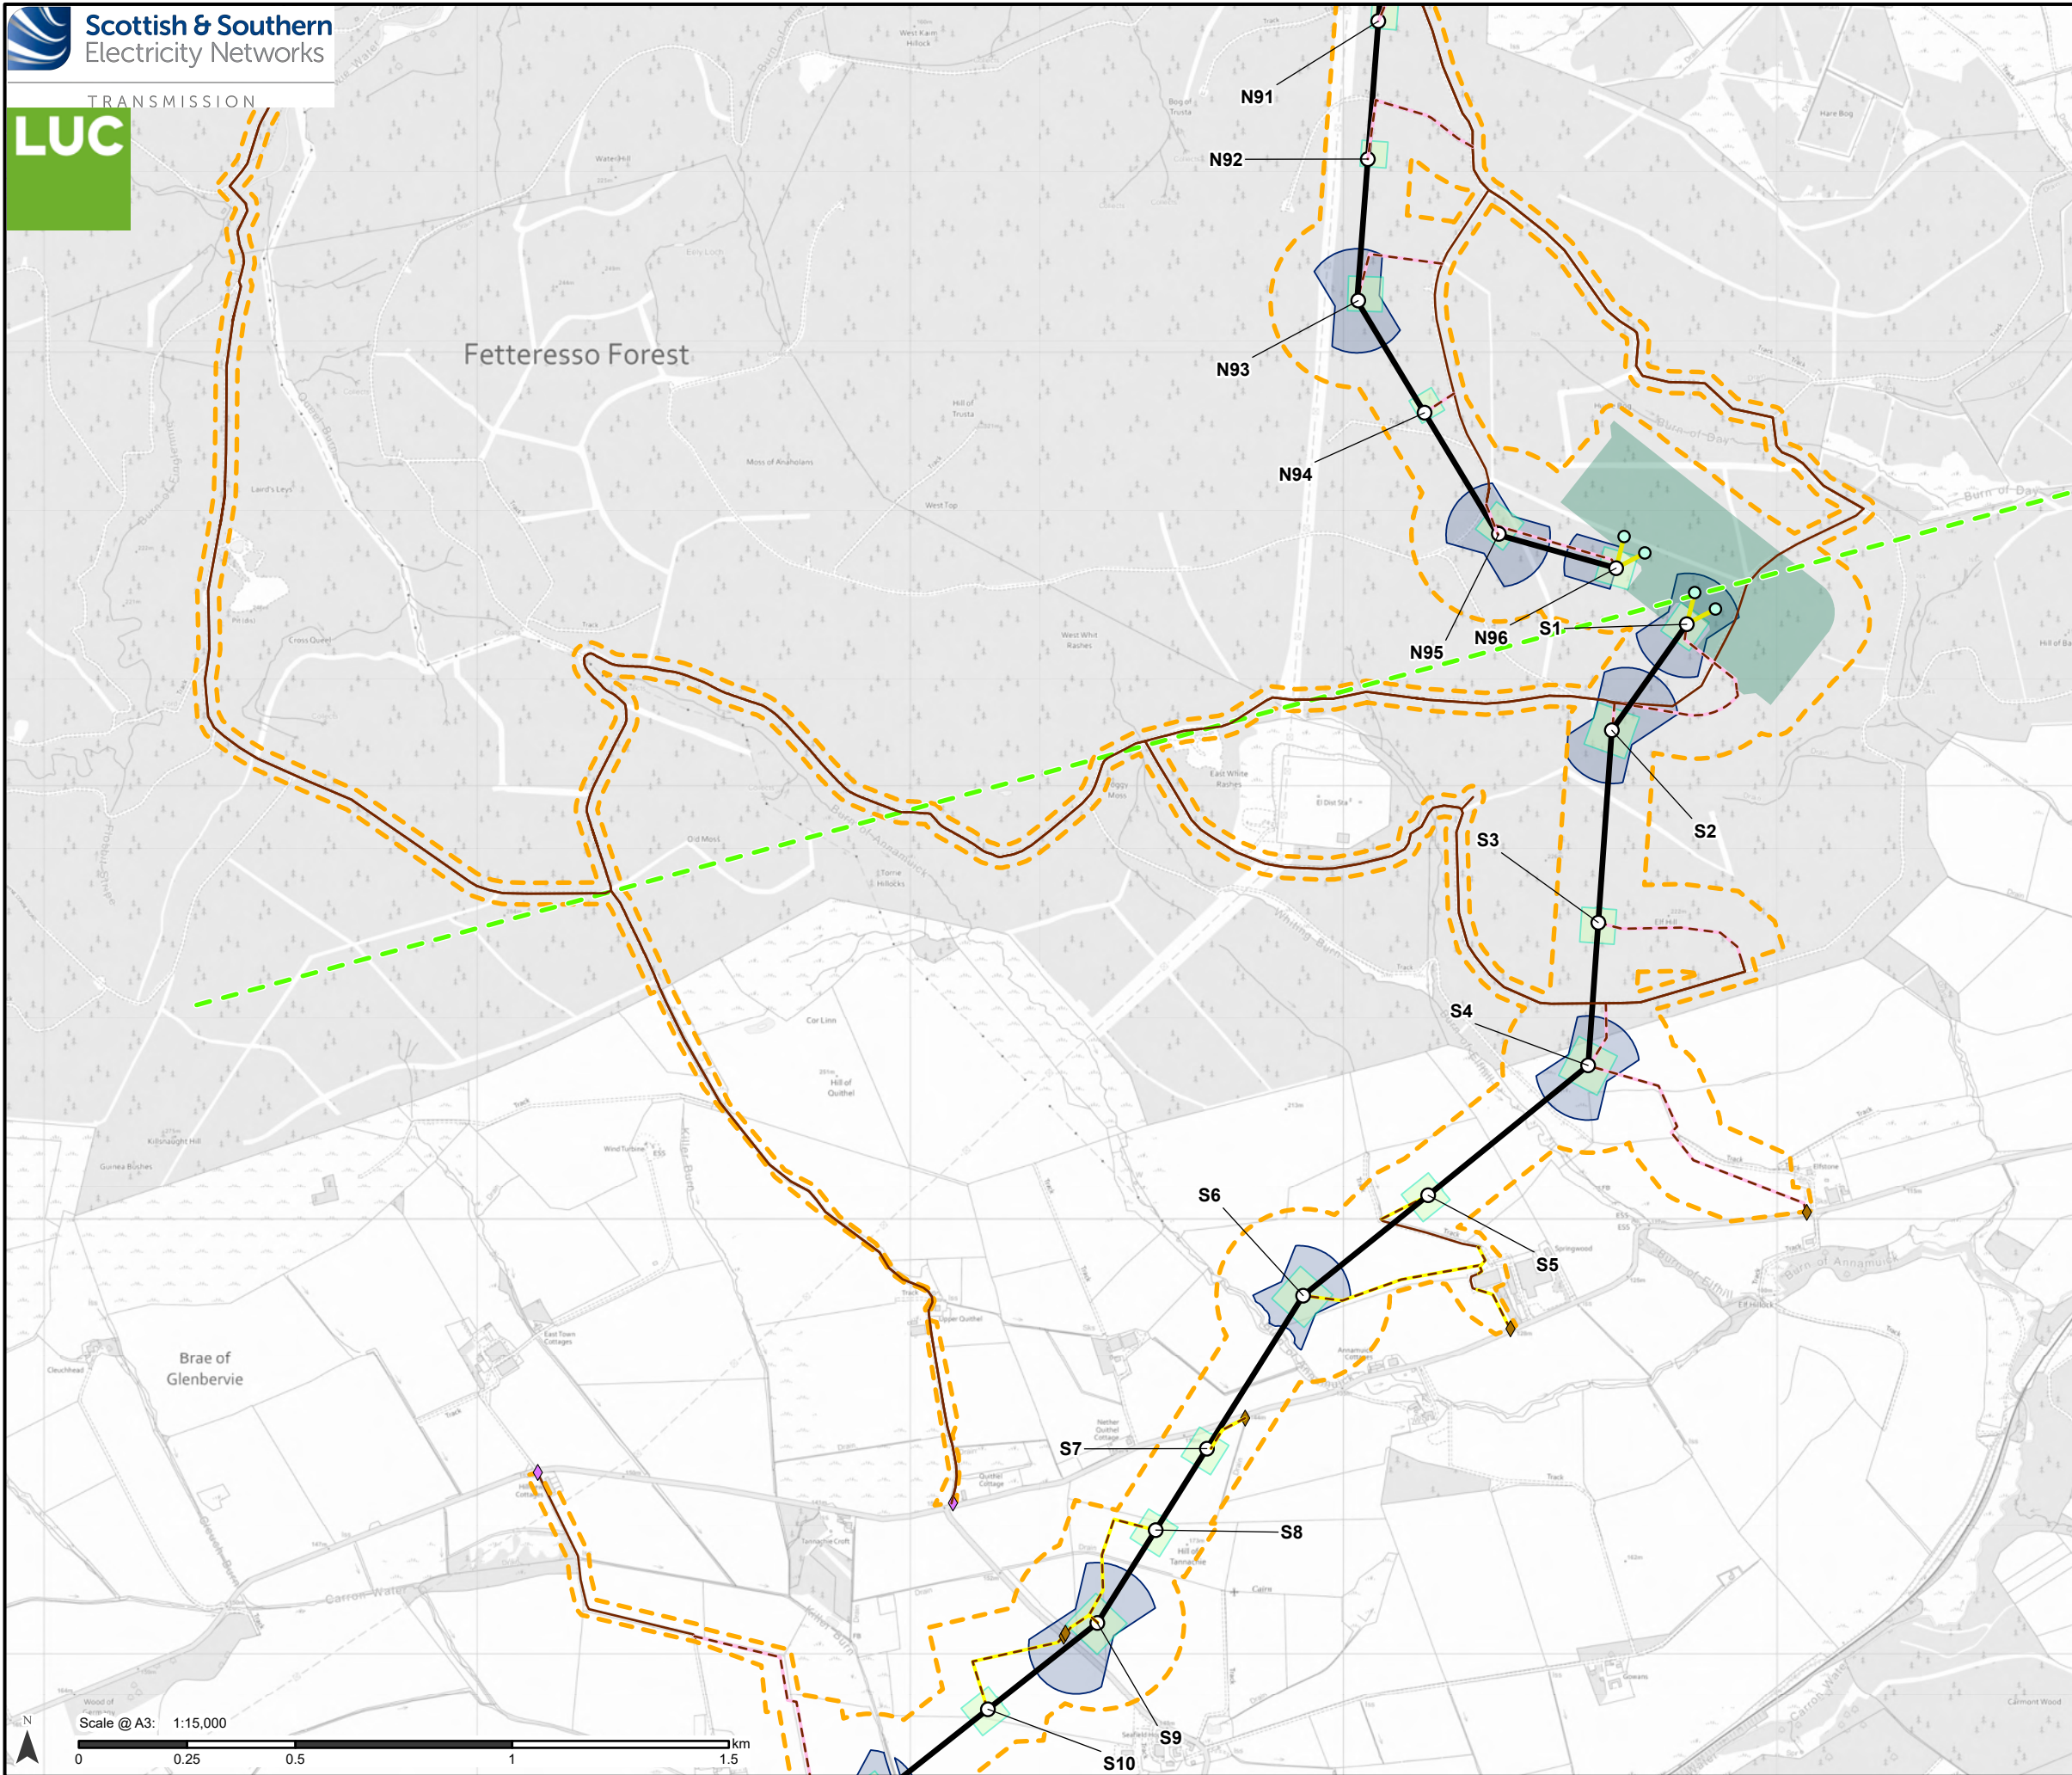


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Download
 - Proposed Development Limit of Deviation (LOD)
 - Section boundary
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))
- Intra (Associated) Developments**
- Gantry location
 - Proposed Hurlie 400 kV substation (Aberdeenshire Council Reference APP/2024/1951)

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

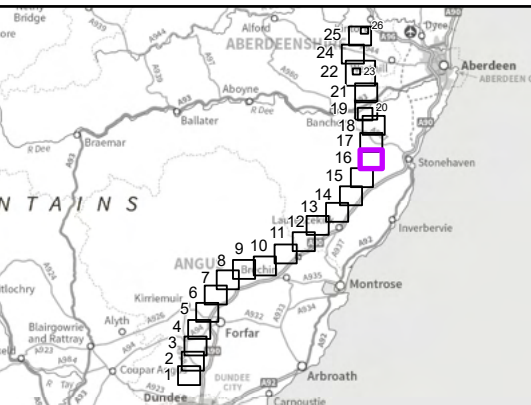

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 16
Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.16

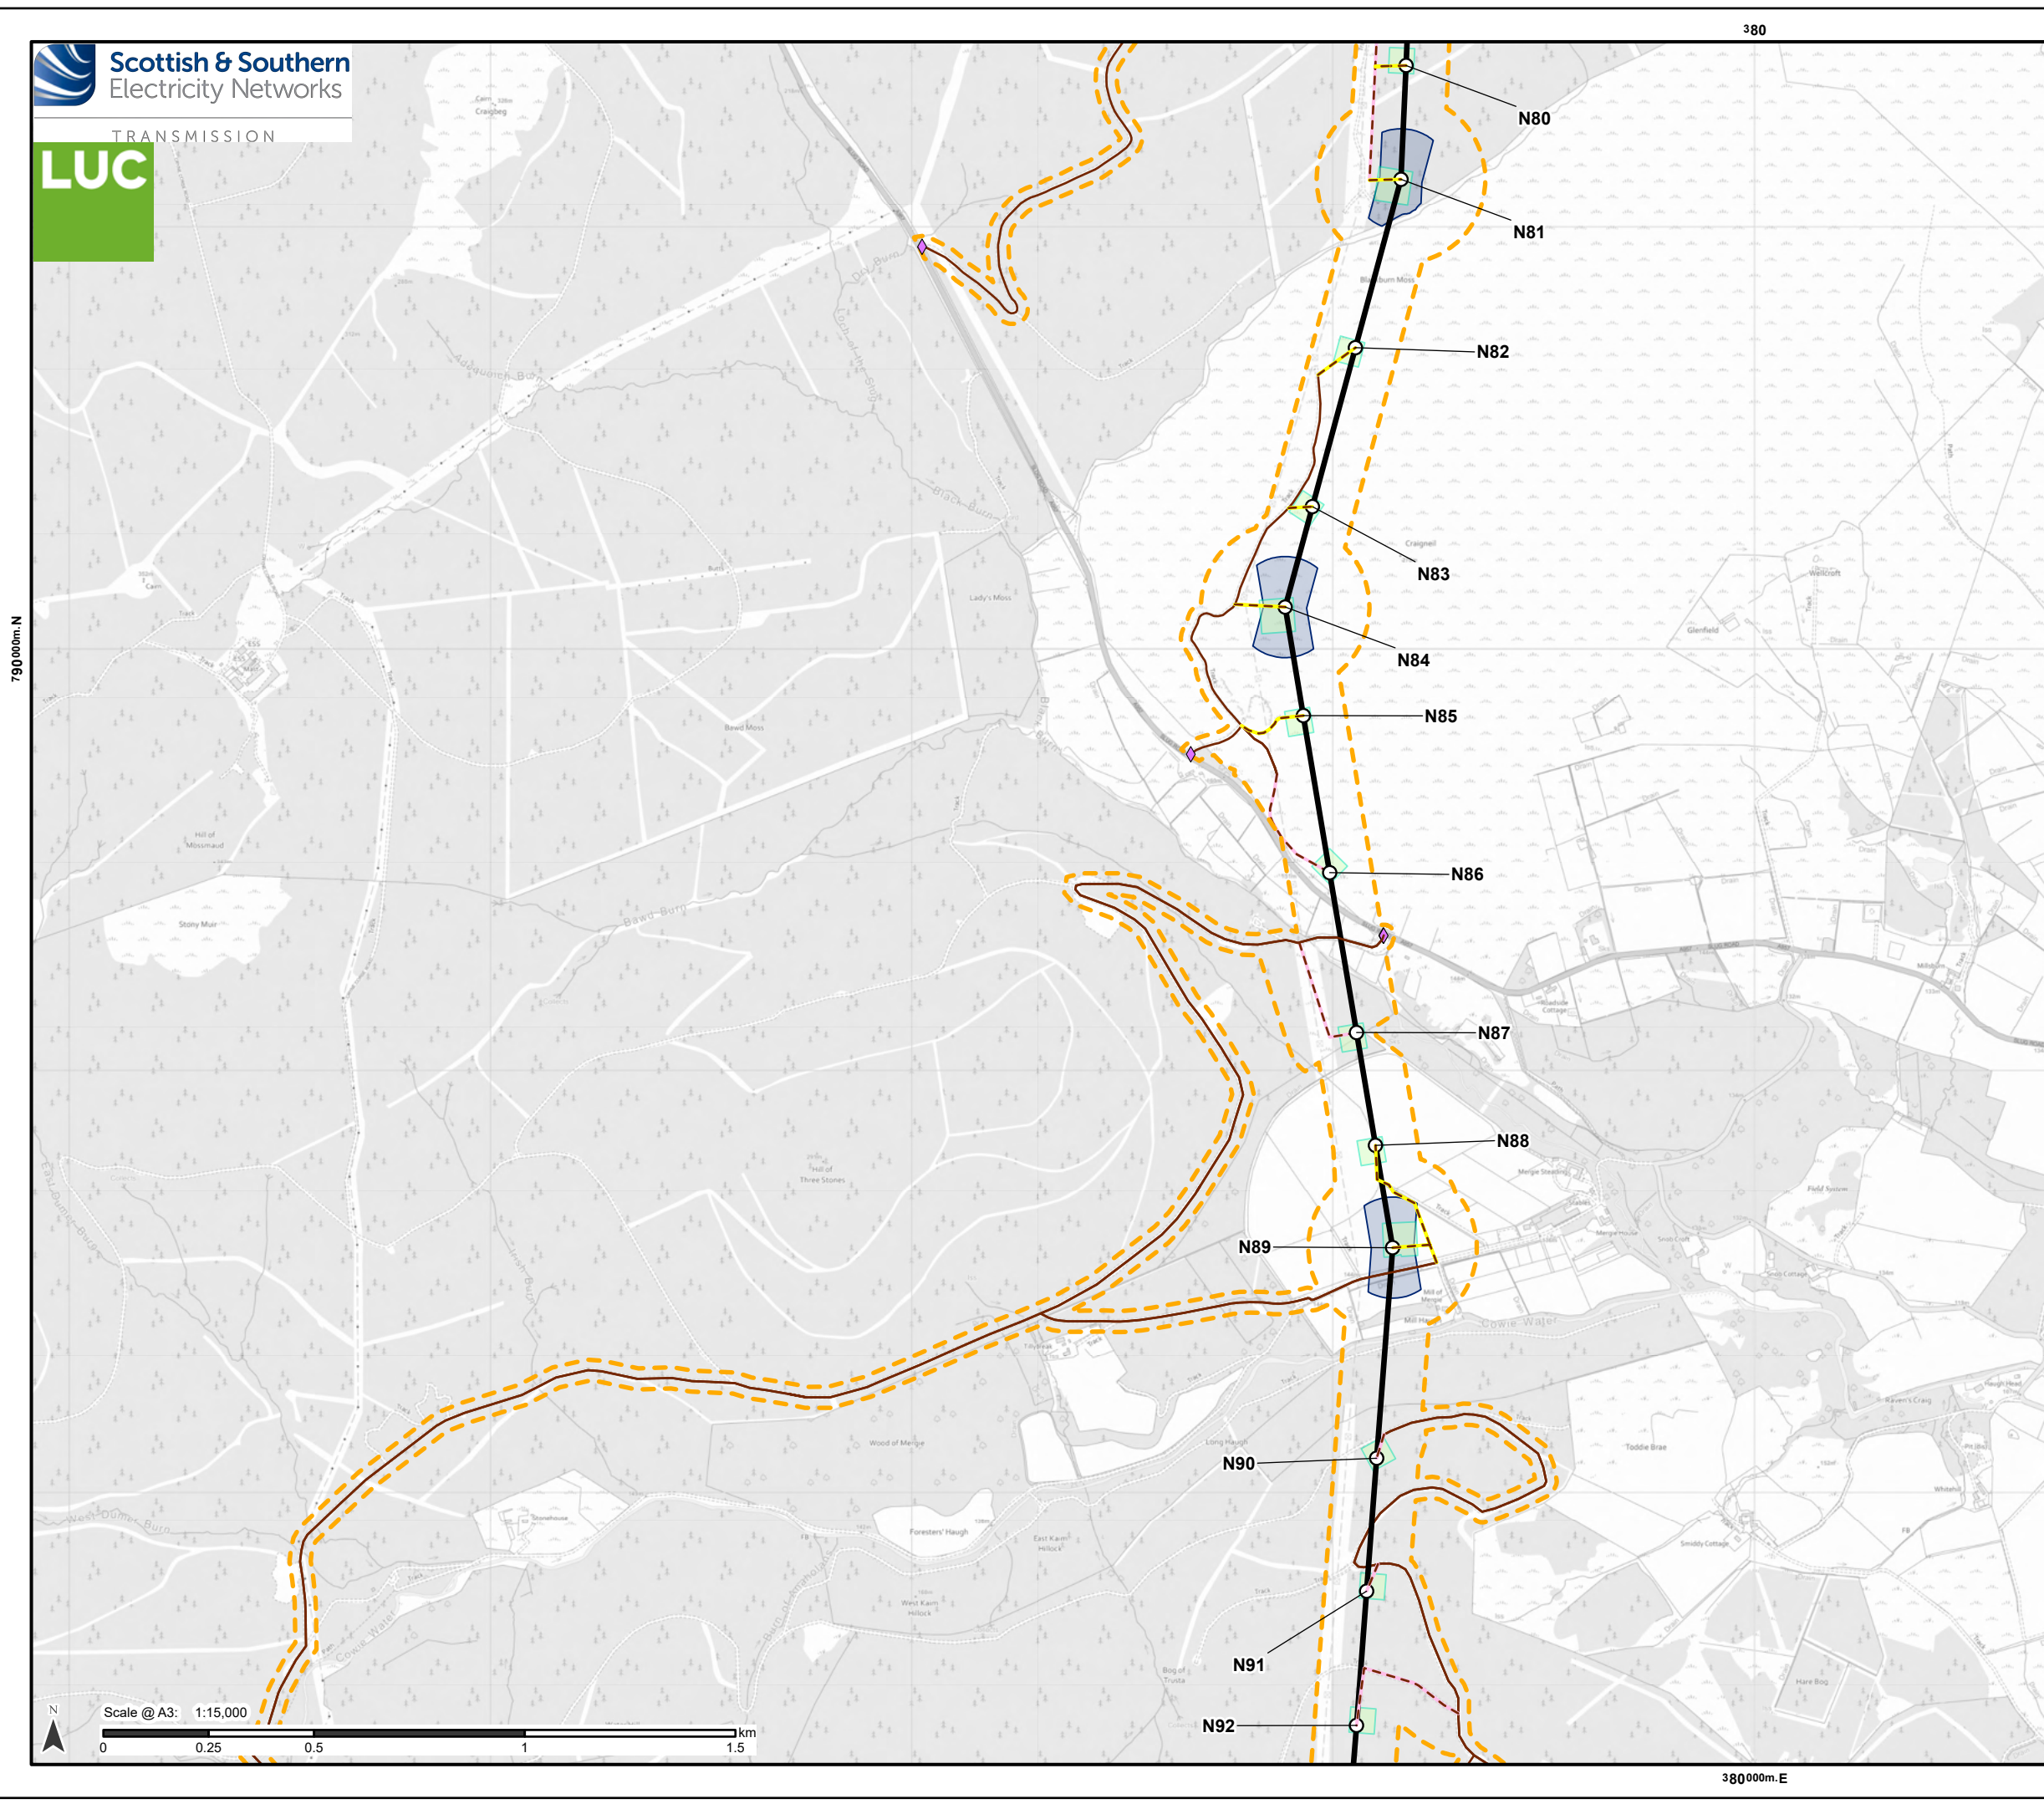

Proposed Development

- Tower Location and number
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◇ Existing to be upgraded

Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 17

Drawn by: MS

Date: 13/08/2025

Drawing: 3.1.17

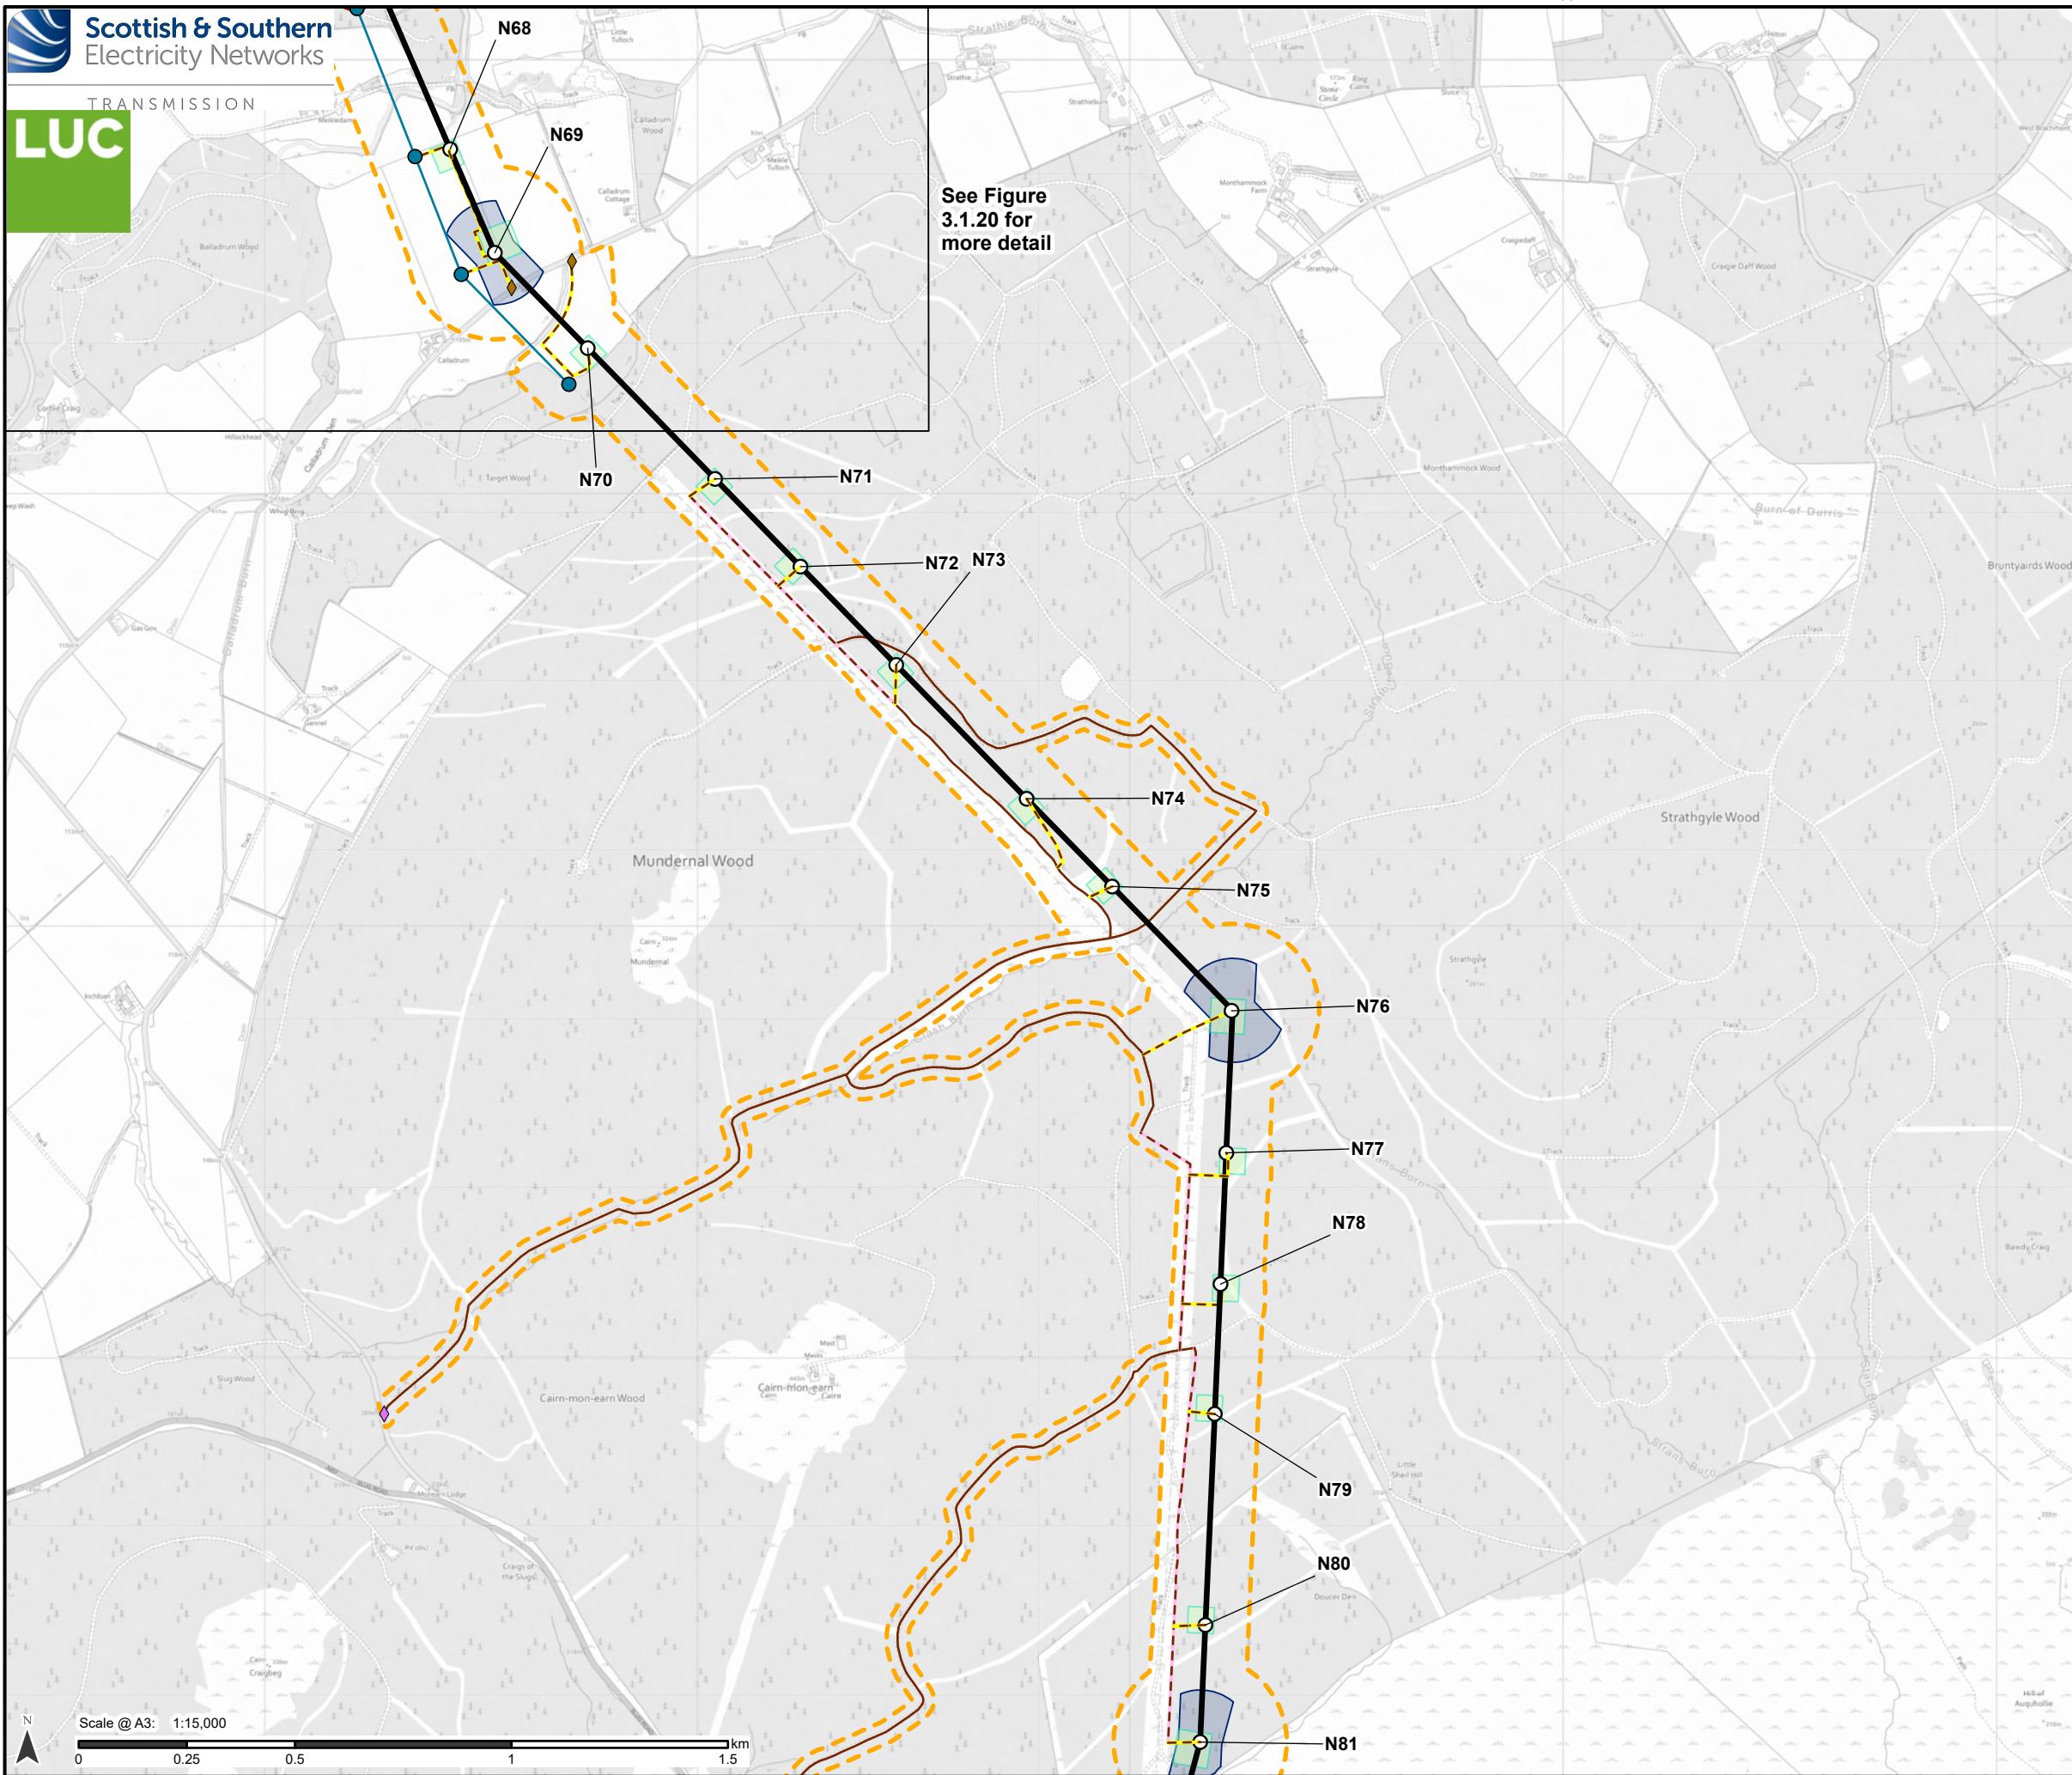

Proposed Development

- Tower Location and number
- Proposed Alignment
- Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment

- Existing tower position to be retained
- Temporary diversion overhead line
- Existing overhead line reconductoring

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2025 all rights reserved. Ordnance Survey Licence number 0100022432. SSSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 18

Drawn by: MS Date: 13/08/2025

Drawing: 3.1.18

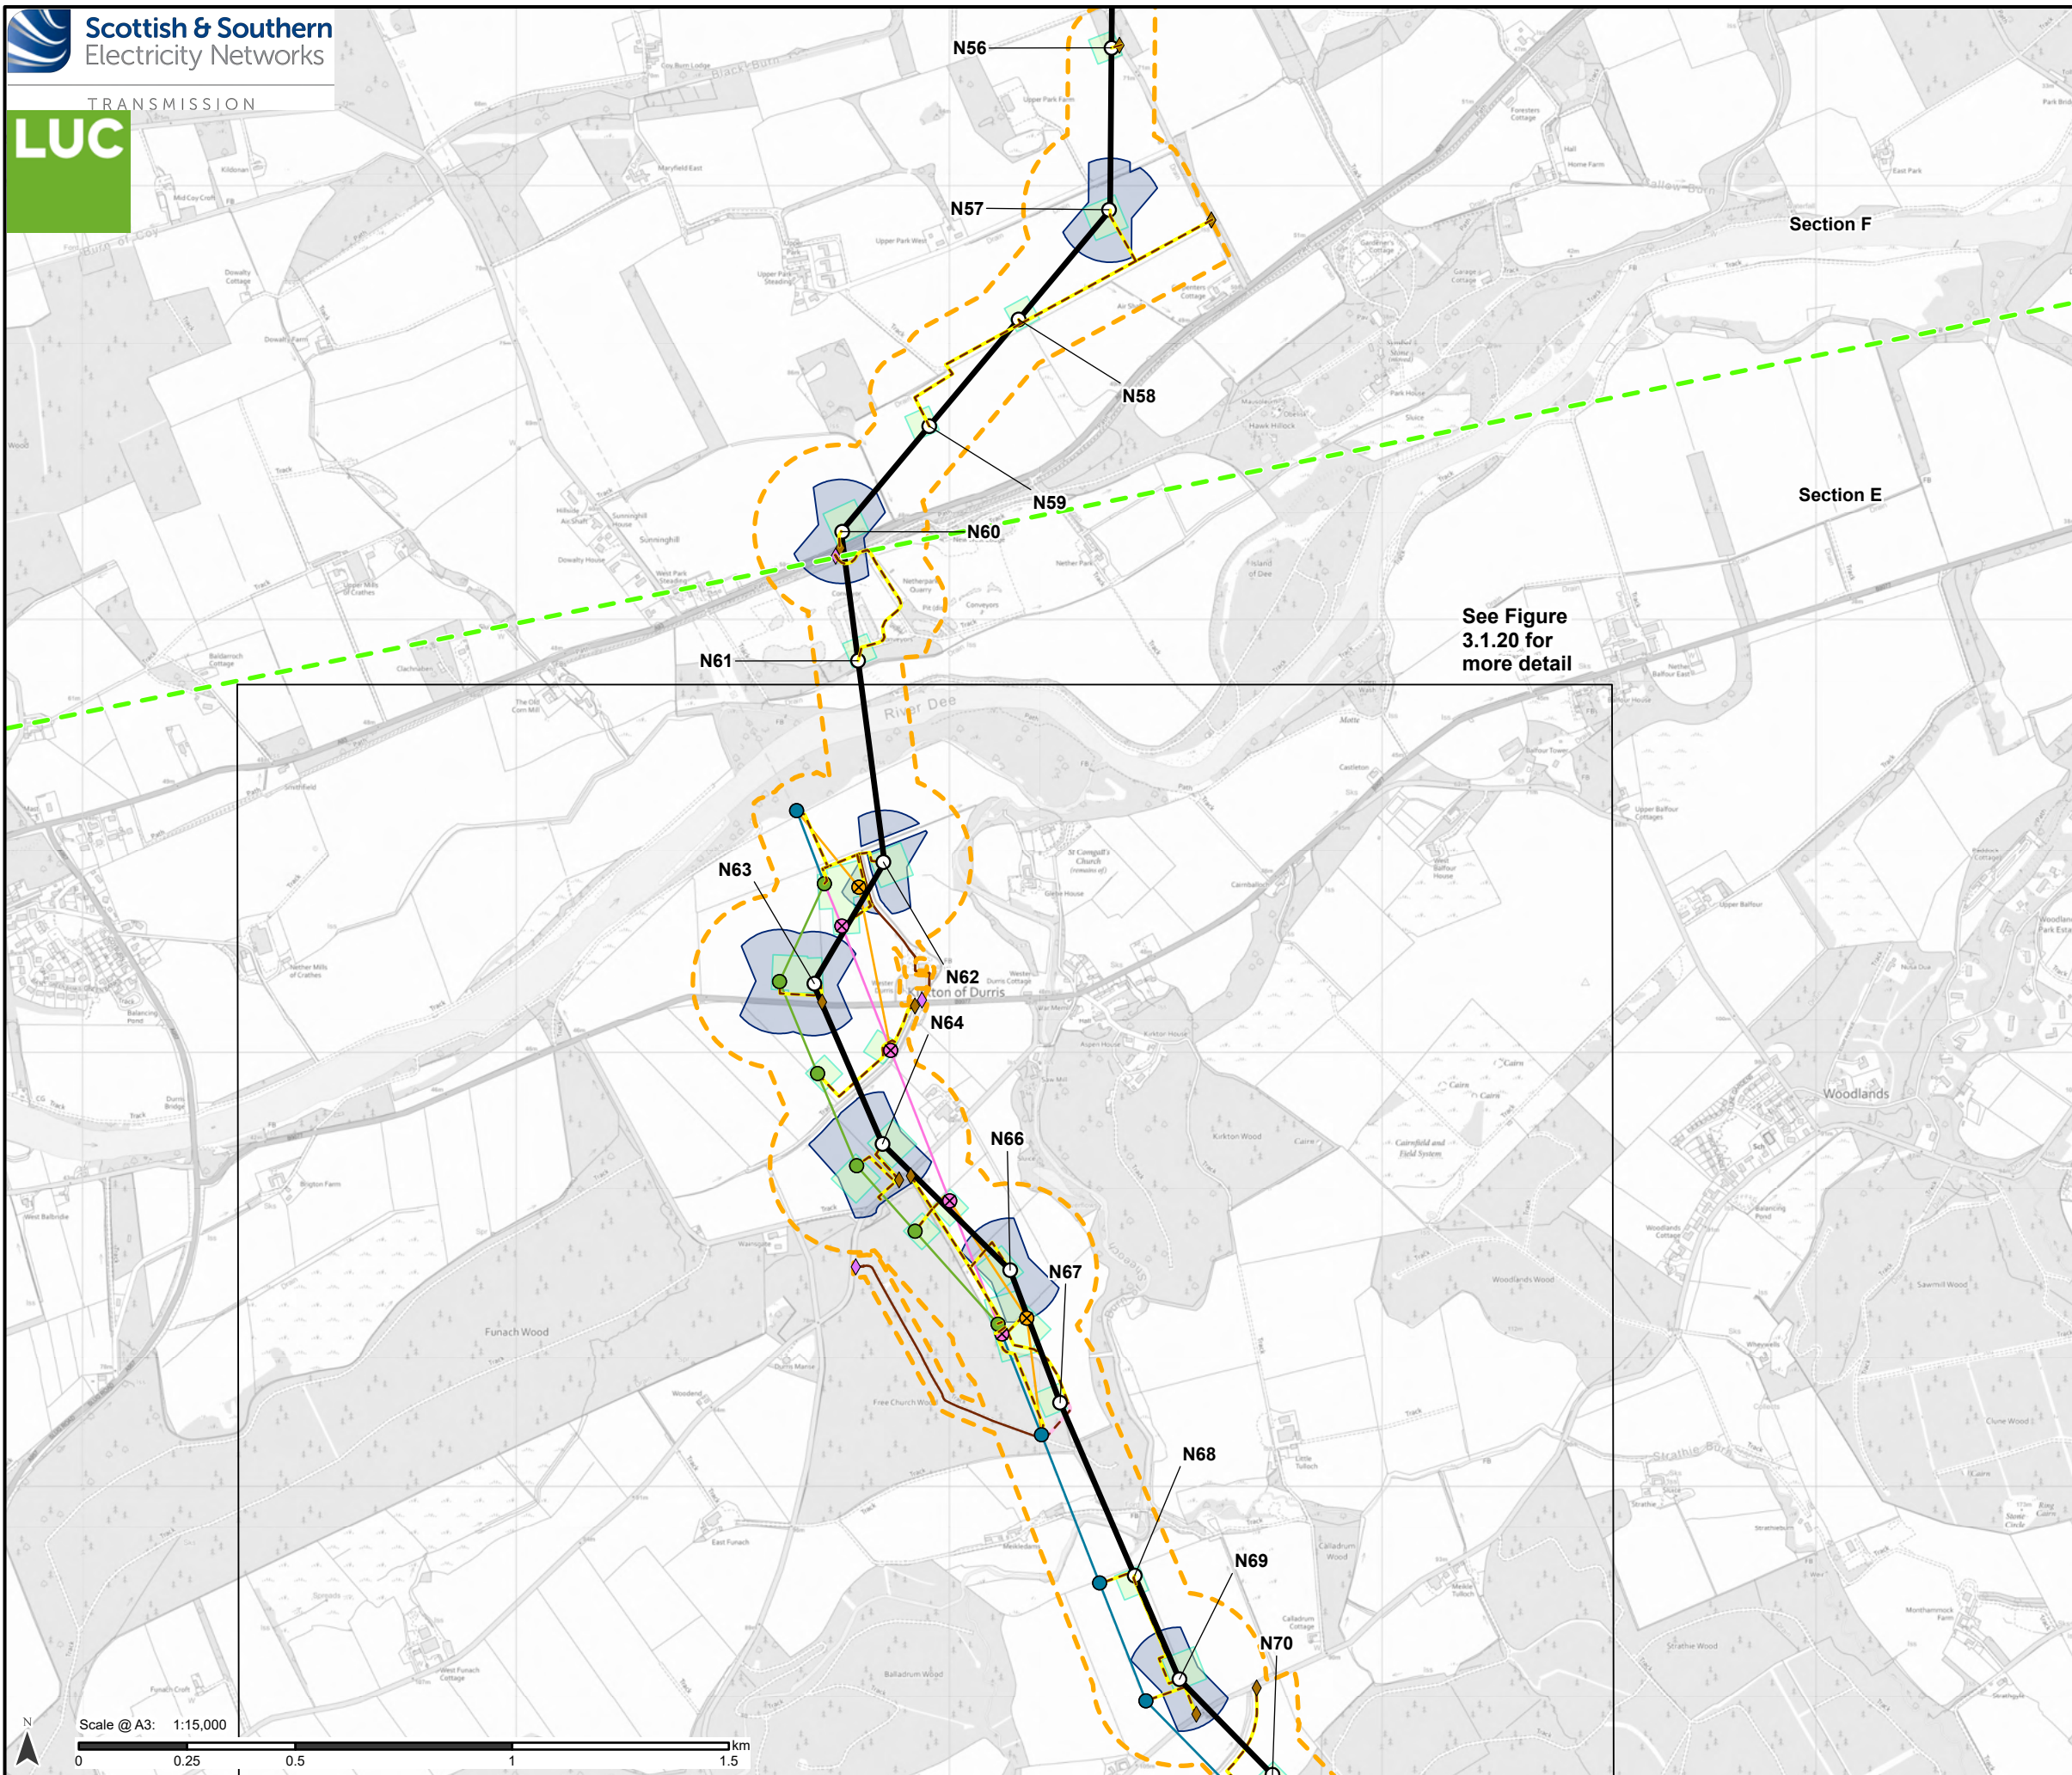

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)
- - - Section boundary

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded


Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

**Additional development included in Section 37 application:
Kintore - Fetteresso 275 kV/400 kV Overhead Line
Realignment**

- ⊗ Existing tower to be dismantled
- ⊗ Temporary diversion tower position
- Existing tower position to be retained
- Realignment tower position
- Existing overhead line to be removed
- Temporary diversion overhead line
- Existing overhead line reconductoring
- Realignment overhead line

Note: Refer to Figure 3.3 for Overview of the LOD Variations/
Restrictions

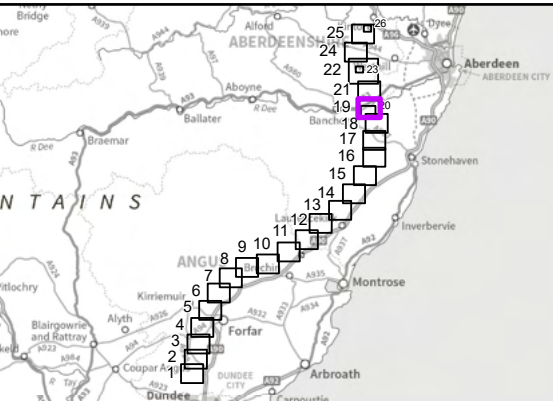

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
**SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line


Title:

Proposed Development for which Section 37 consent
(Electricity Act, 1989) is sought - Page 19

Drawn by: MS


Date: 13/08/2025

Drawing: 3.1.19

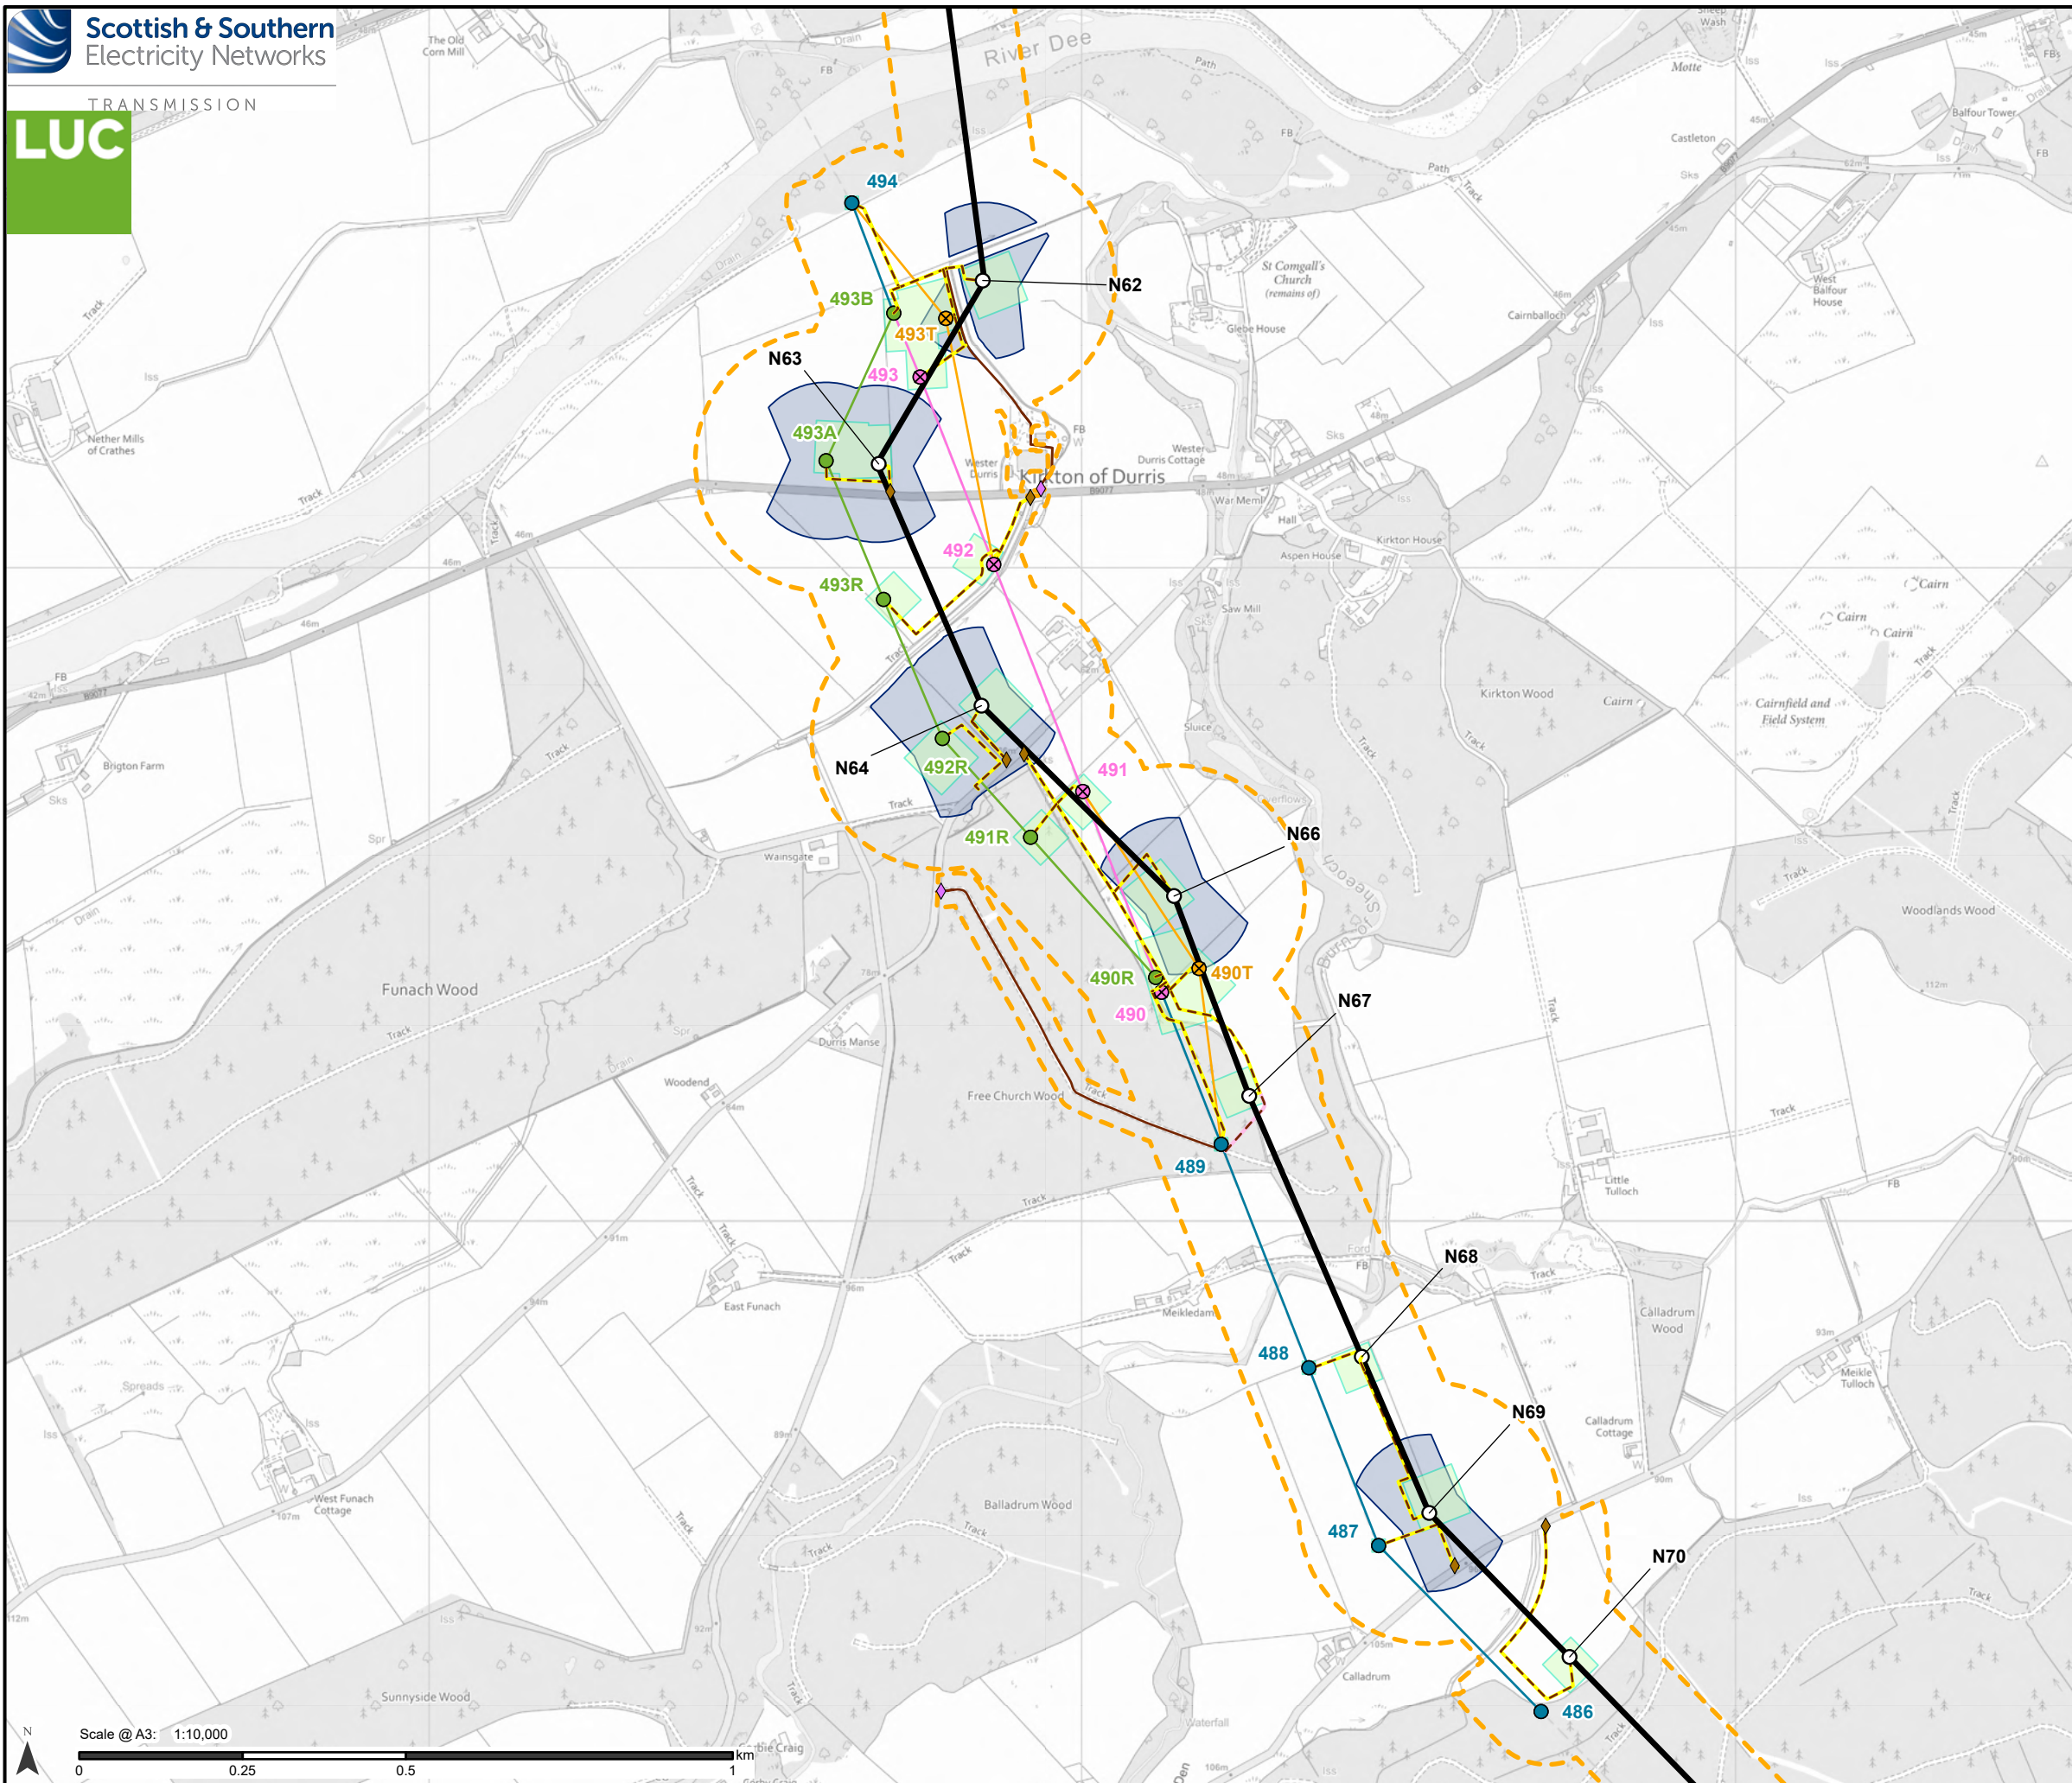

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Section boundary
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))
- Additional development included in Section 37 application: Kintore - Fetteresso 275 kV/400 kV Overhead Line Realignment**
- ⊗ Existing tower to be dismantled
 - ⊗ Temporary diversion tower position
 - Existing tower position to be retained
 - Realignment tower position
 - Existing overhead line to be removed
 - Temporary diversion overhead line
 - Existing overhead line reconductoring
 - Realignment overhead line

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

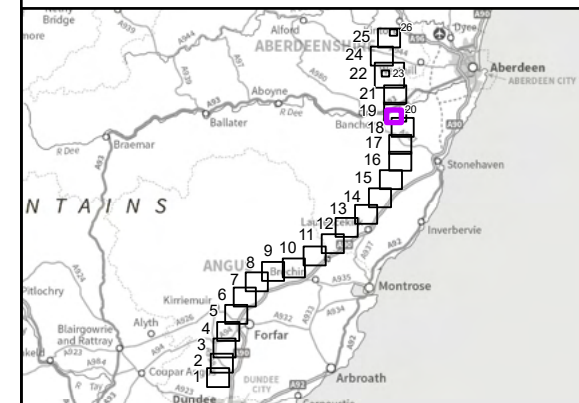


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 20


Drawn by: MS Date: 13/08/2025

Drawing: 3.1.20

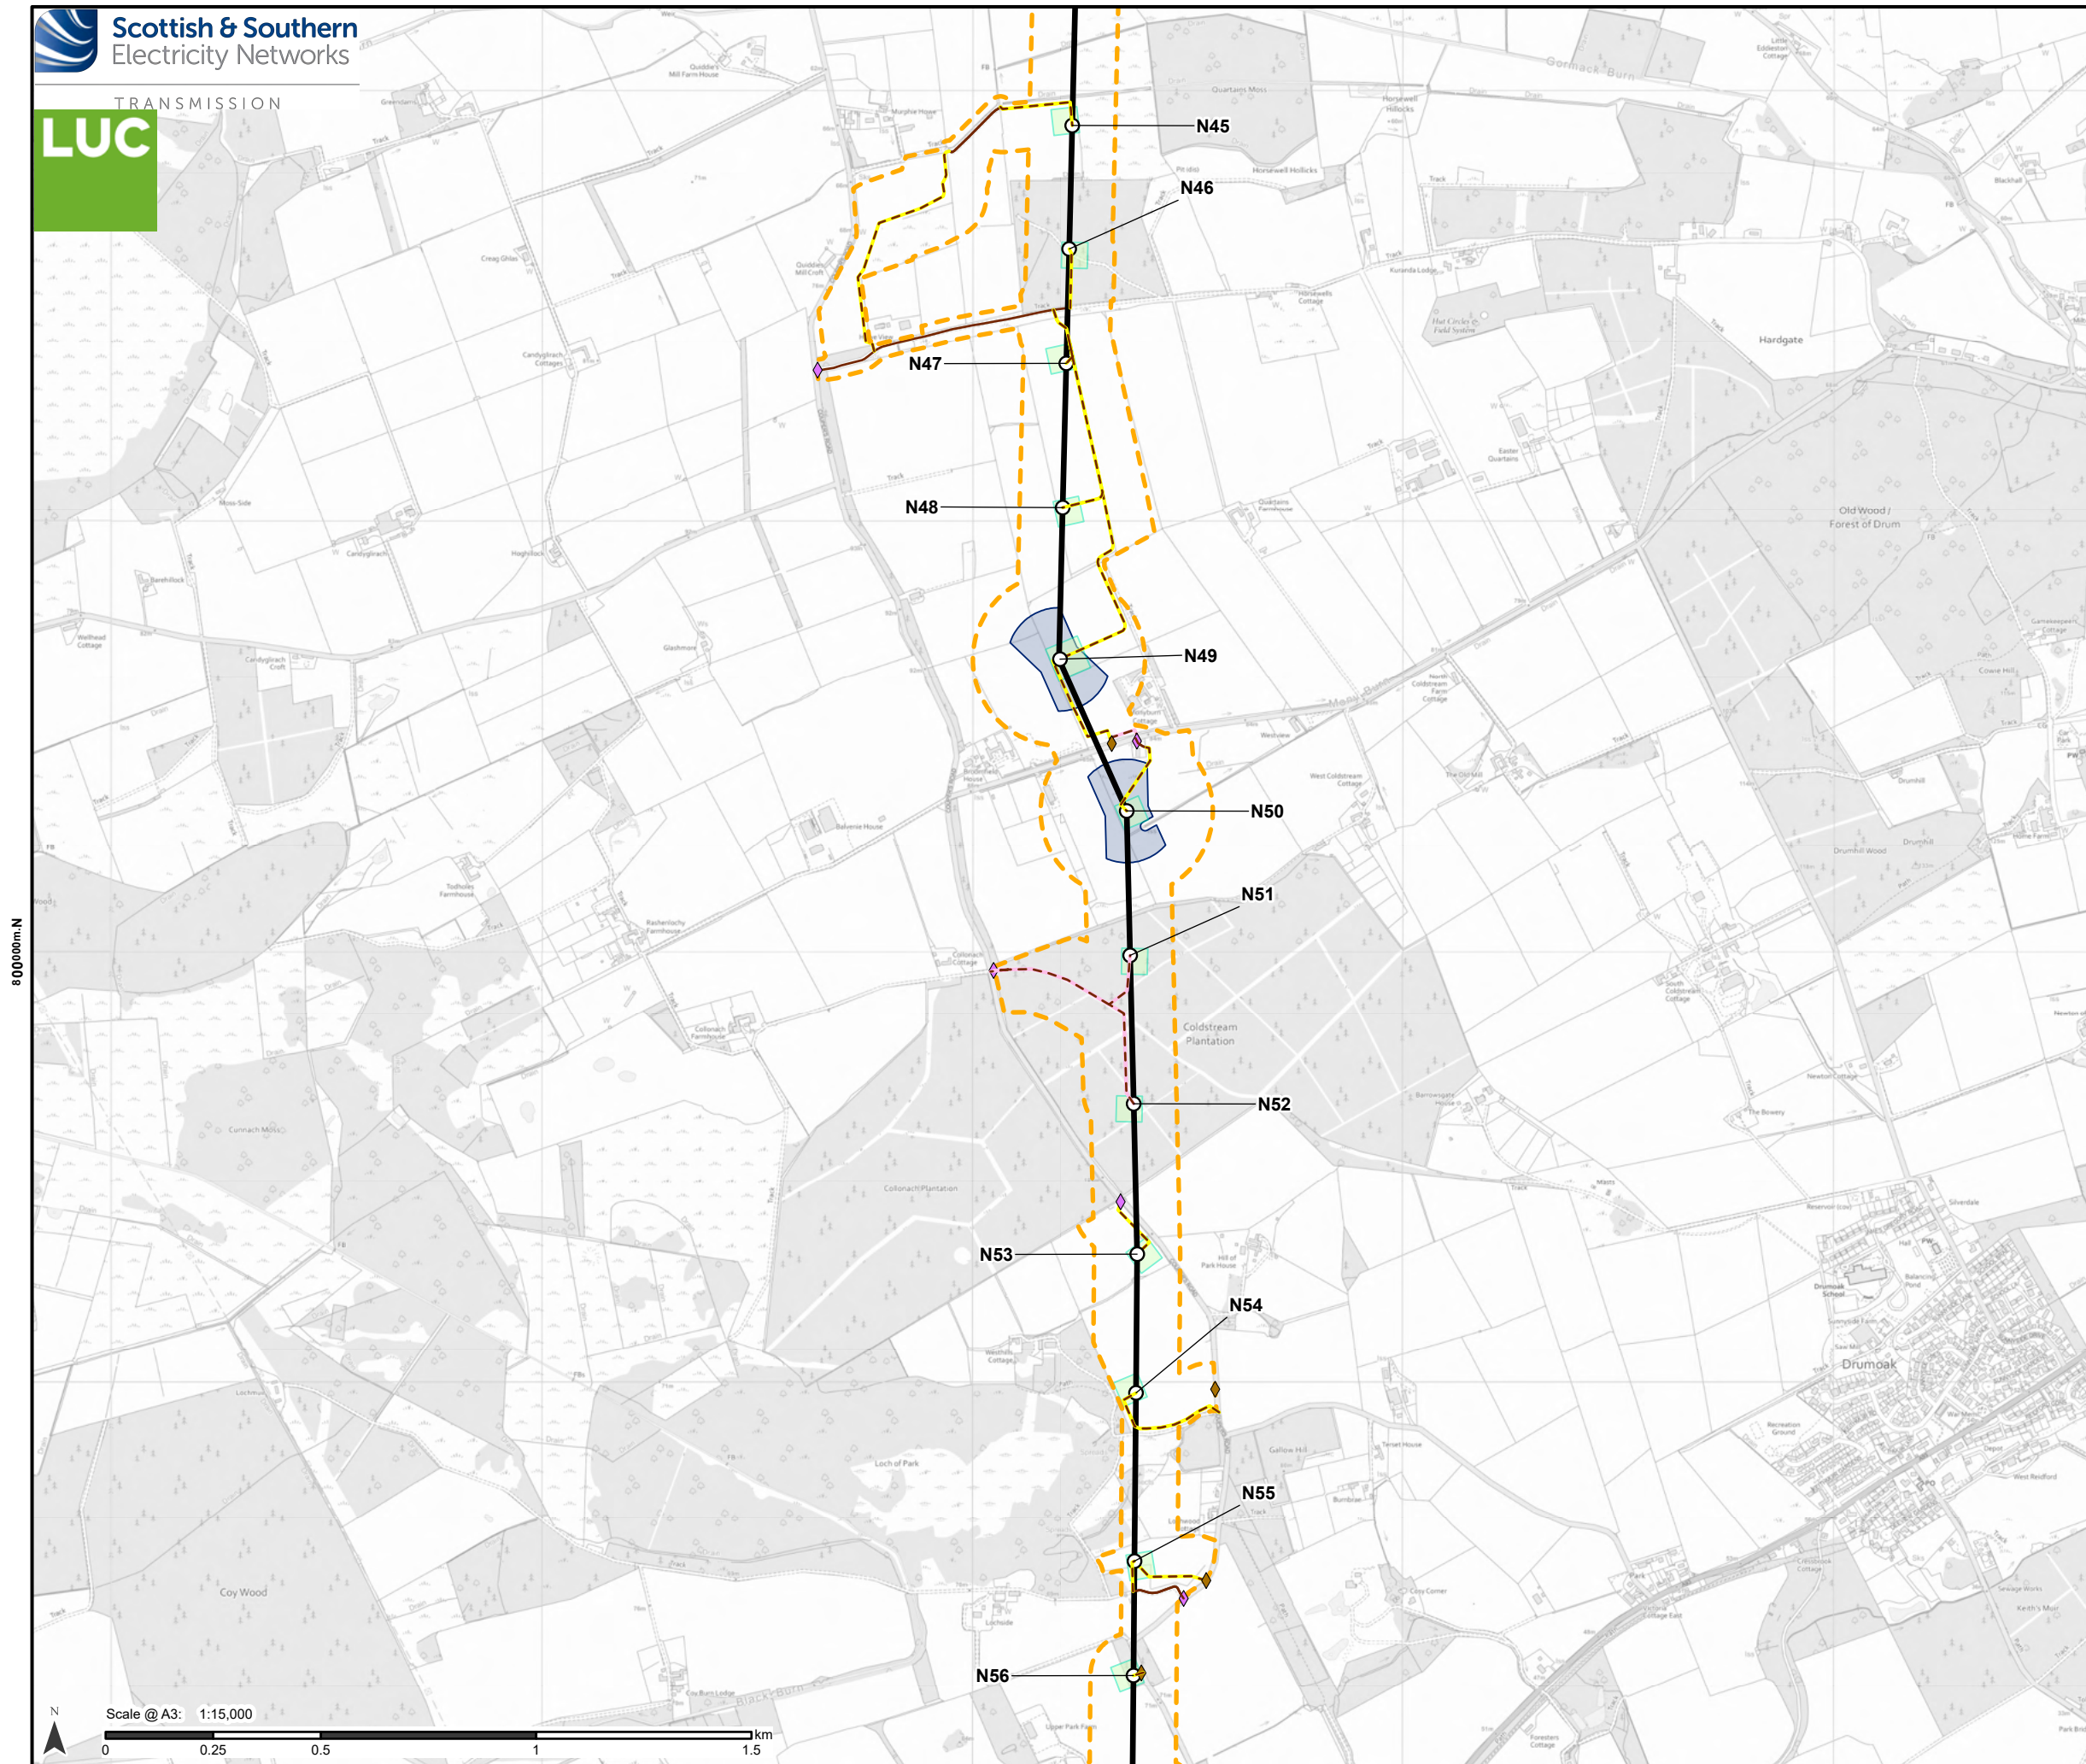

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))


Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

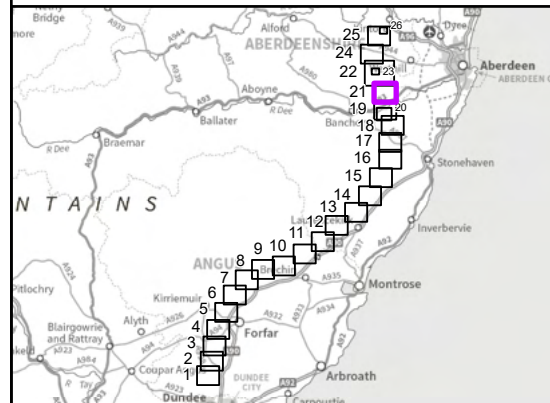

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 21

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.21

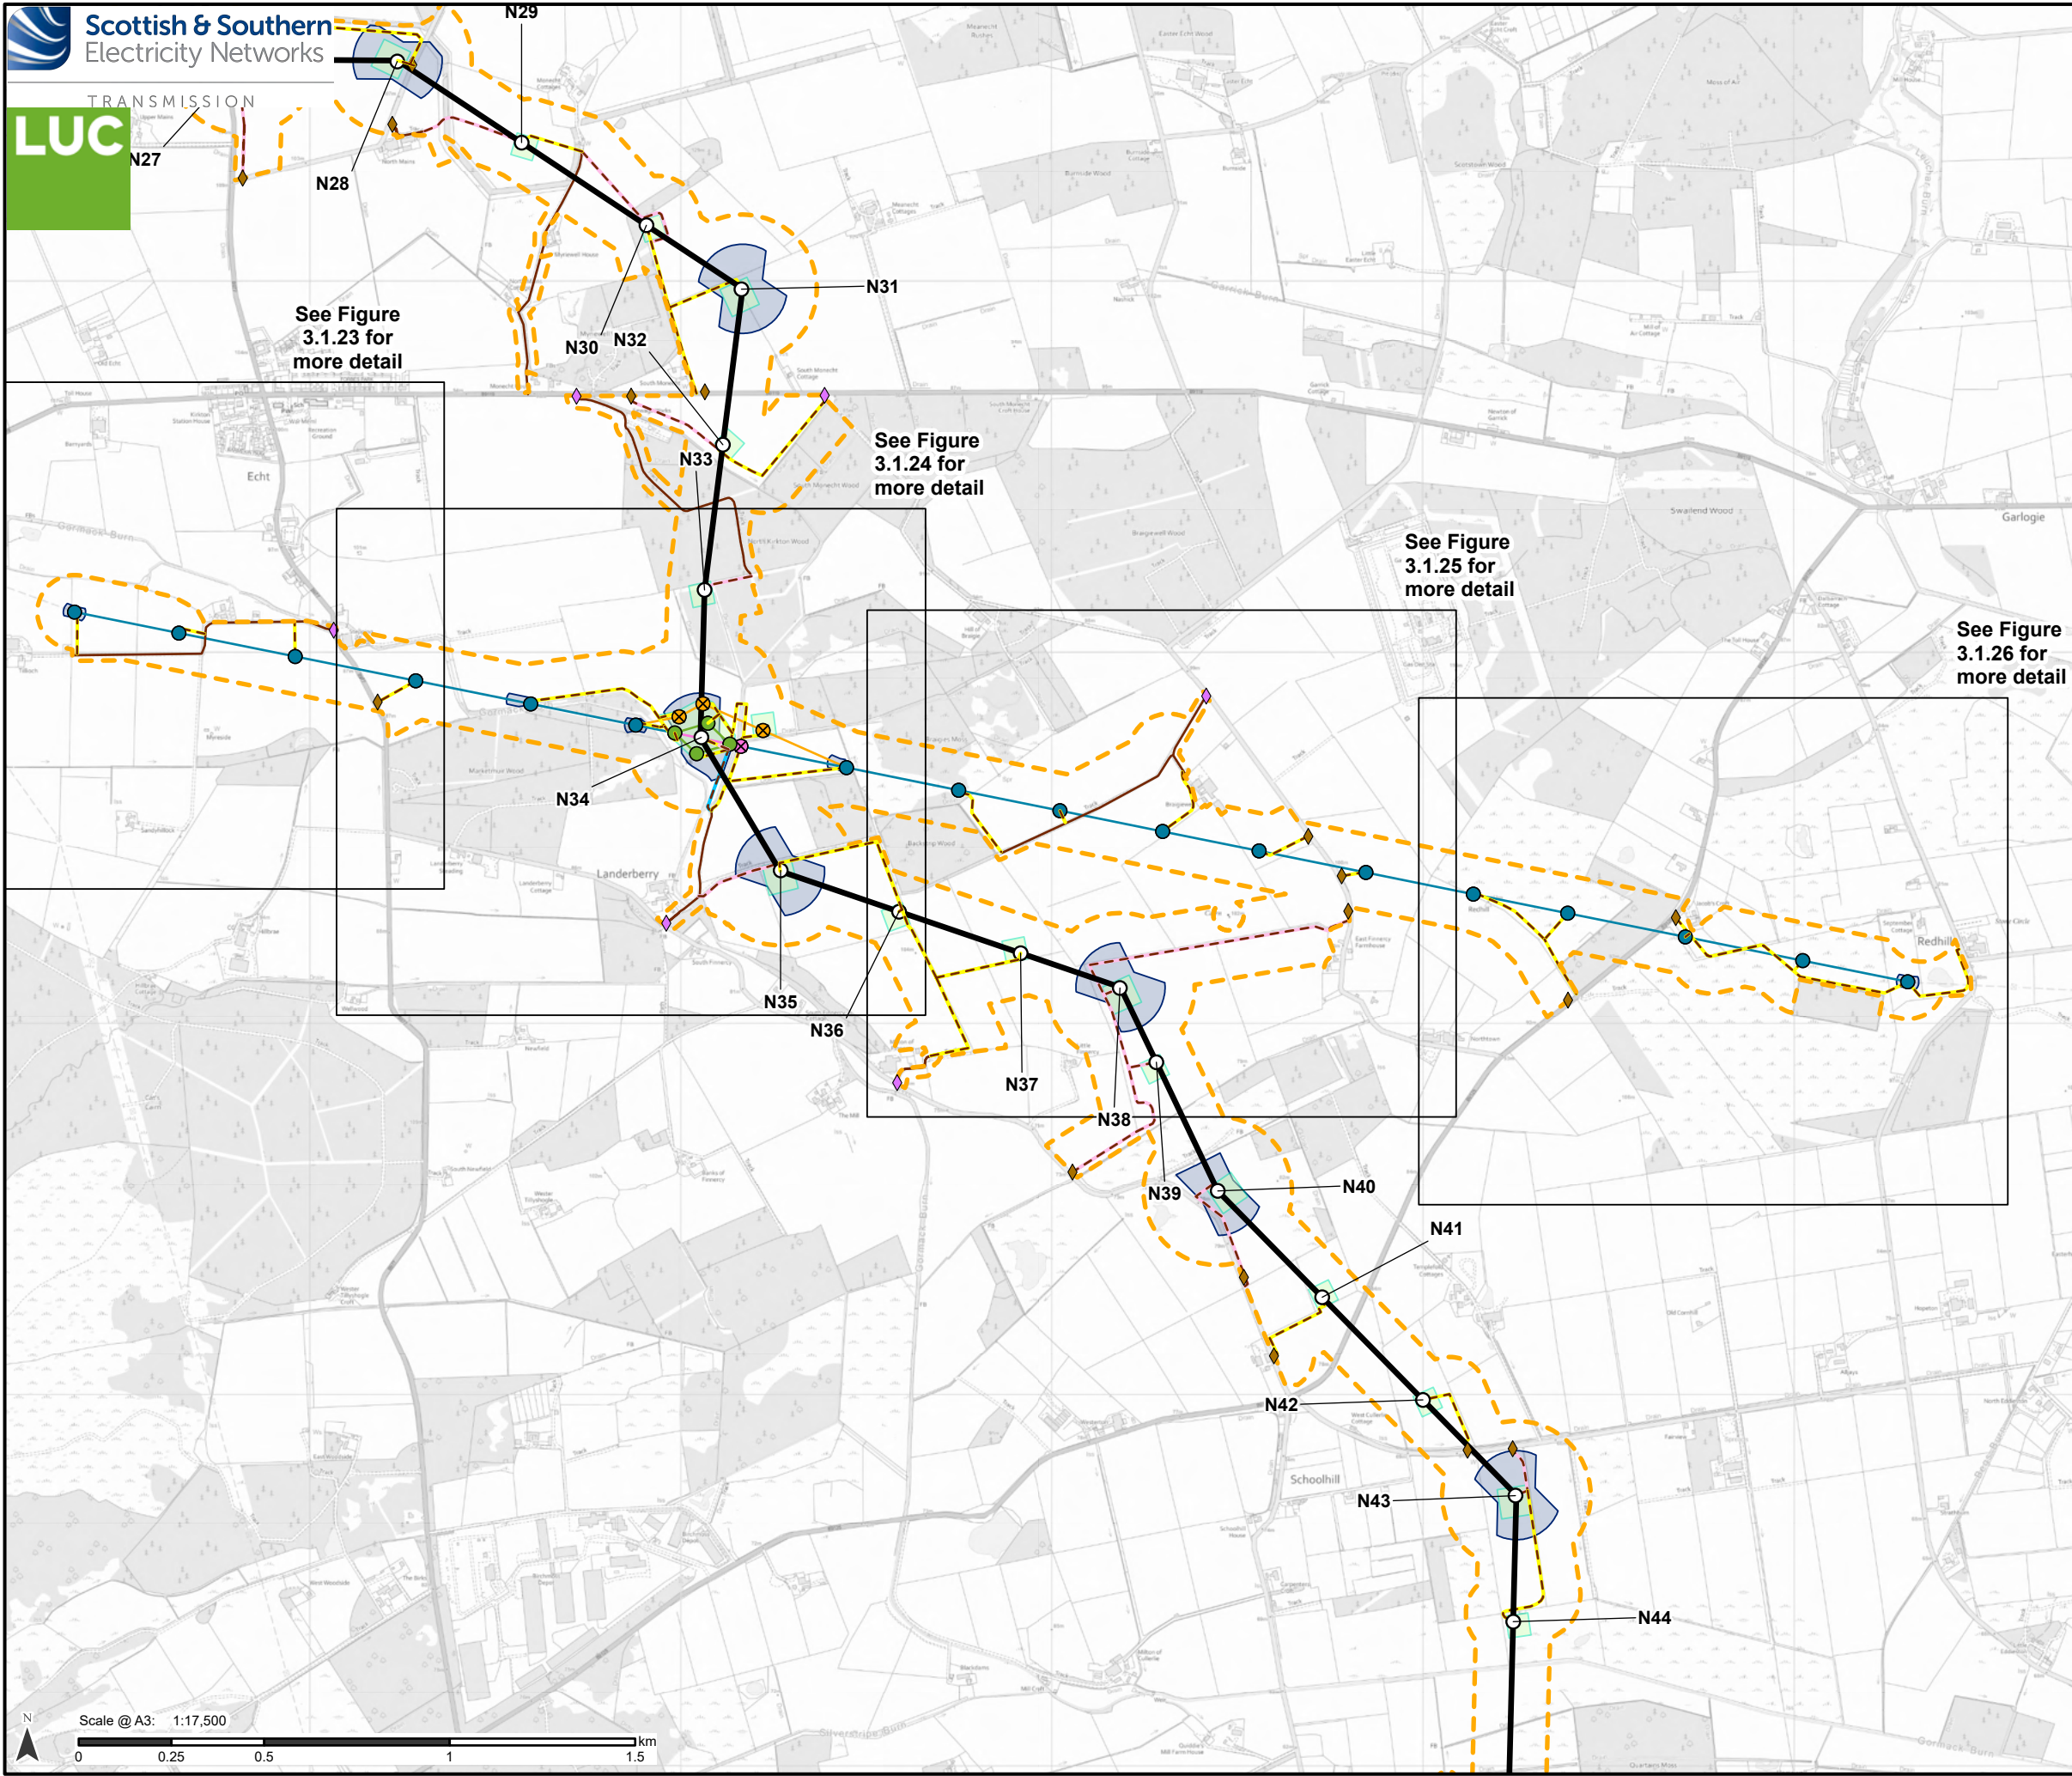


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - - - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - - - Proposed new stone permanent
 - - - Proposed new stone permanent (operational and maintenance access track only - not for construction)
 - - - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))
- Additional development included in Section 37 application: Craigiebuckler - Tarland 132 kV Overhead Line Realignment**
- ⊗ Existing tower to be dismantled
 - ⊗ Temporary diversion tower position
 - Existing tower position to be retained
 - Diamond crossing tower position
 - Existing overhead line to be removed
 - Temporary diversion overhead line
 - Existing overhead line reconductoring
 - Diamond crossing overhead line

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

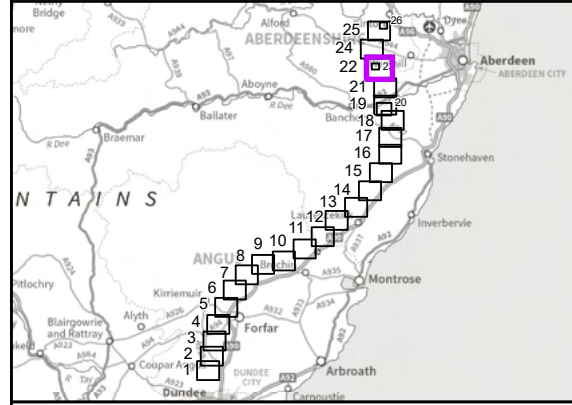

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 22
Drawn by:	MS
Date:	13/08/2025
Drawing:	3.1.22

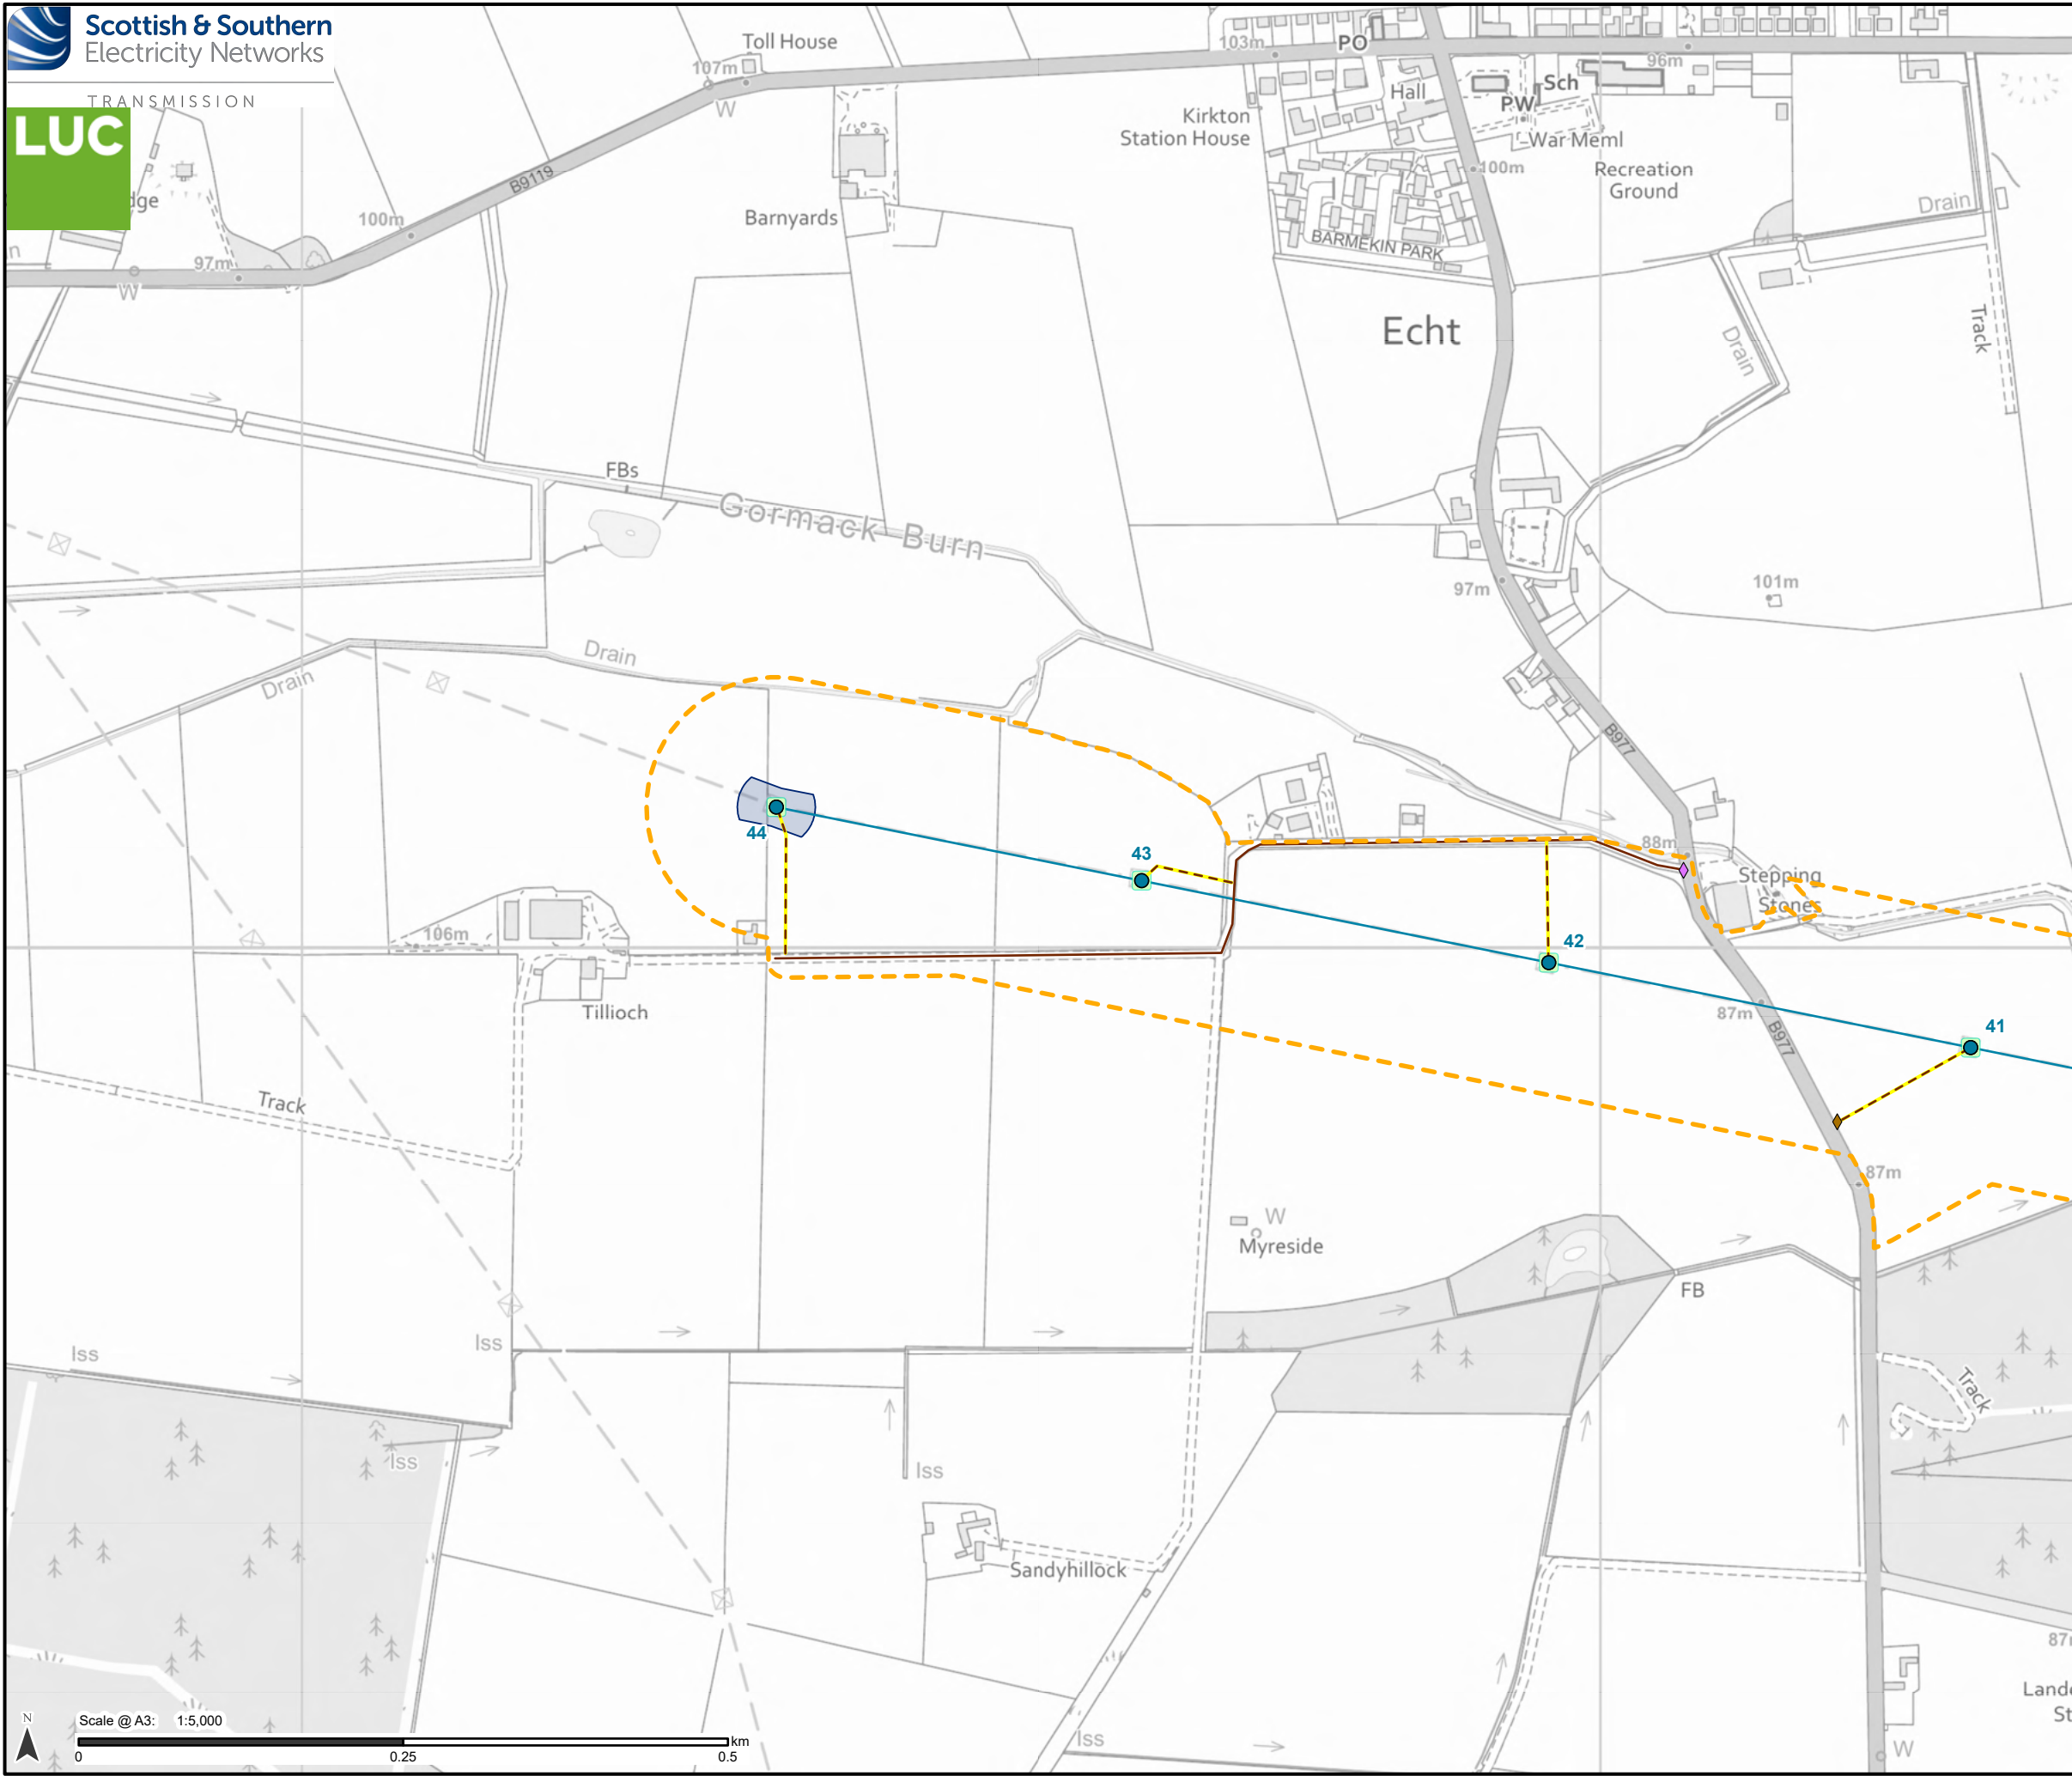

Proposed Development

Proposed Development Limit of Deviation (LOD)

Access

Existing to be upgraded

Proposed new stone temporary

Bellmouth type

Proposed new

Existing to be upgraded

Temporary Working Areas

Tower working area

Proposed conductor pulling area (Equipotential Zone (EPZ))

Additional development included in Section 37 application: Craigiebuckler - Tarland 132 kV Overhead Line Realignment

Existing tower position to be retained

Existing overhead line reconductoring

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455


Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 23

Drawn by: MS

Date: 13/08/2025

Drawing: 3.1.23

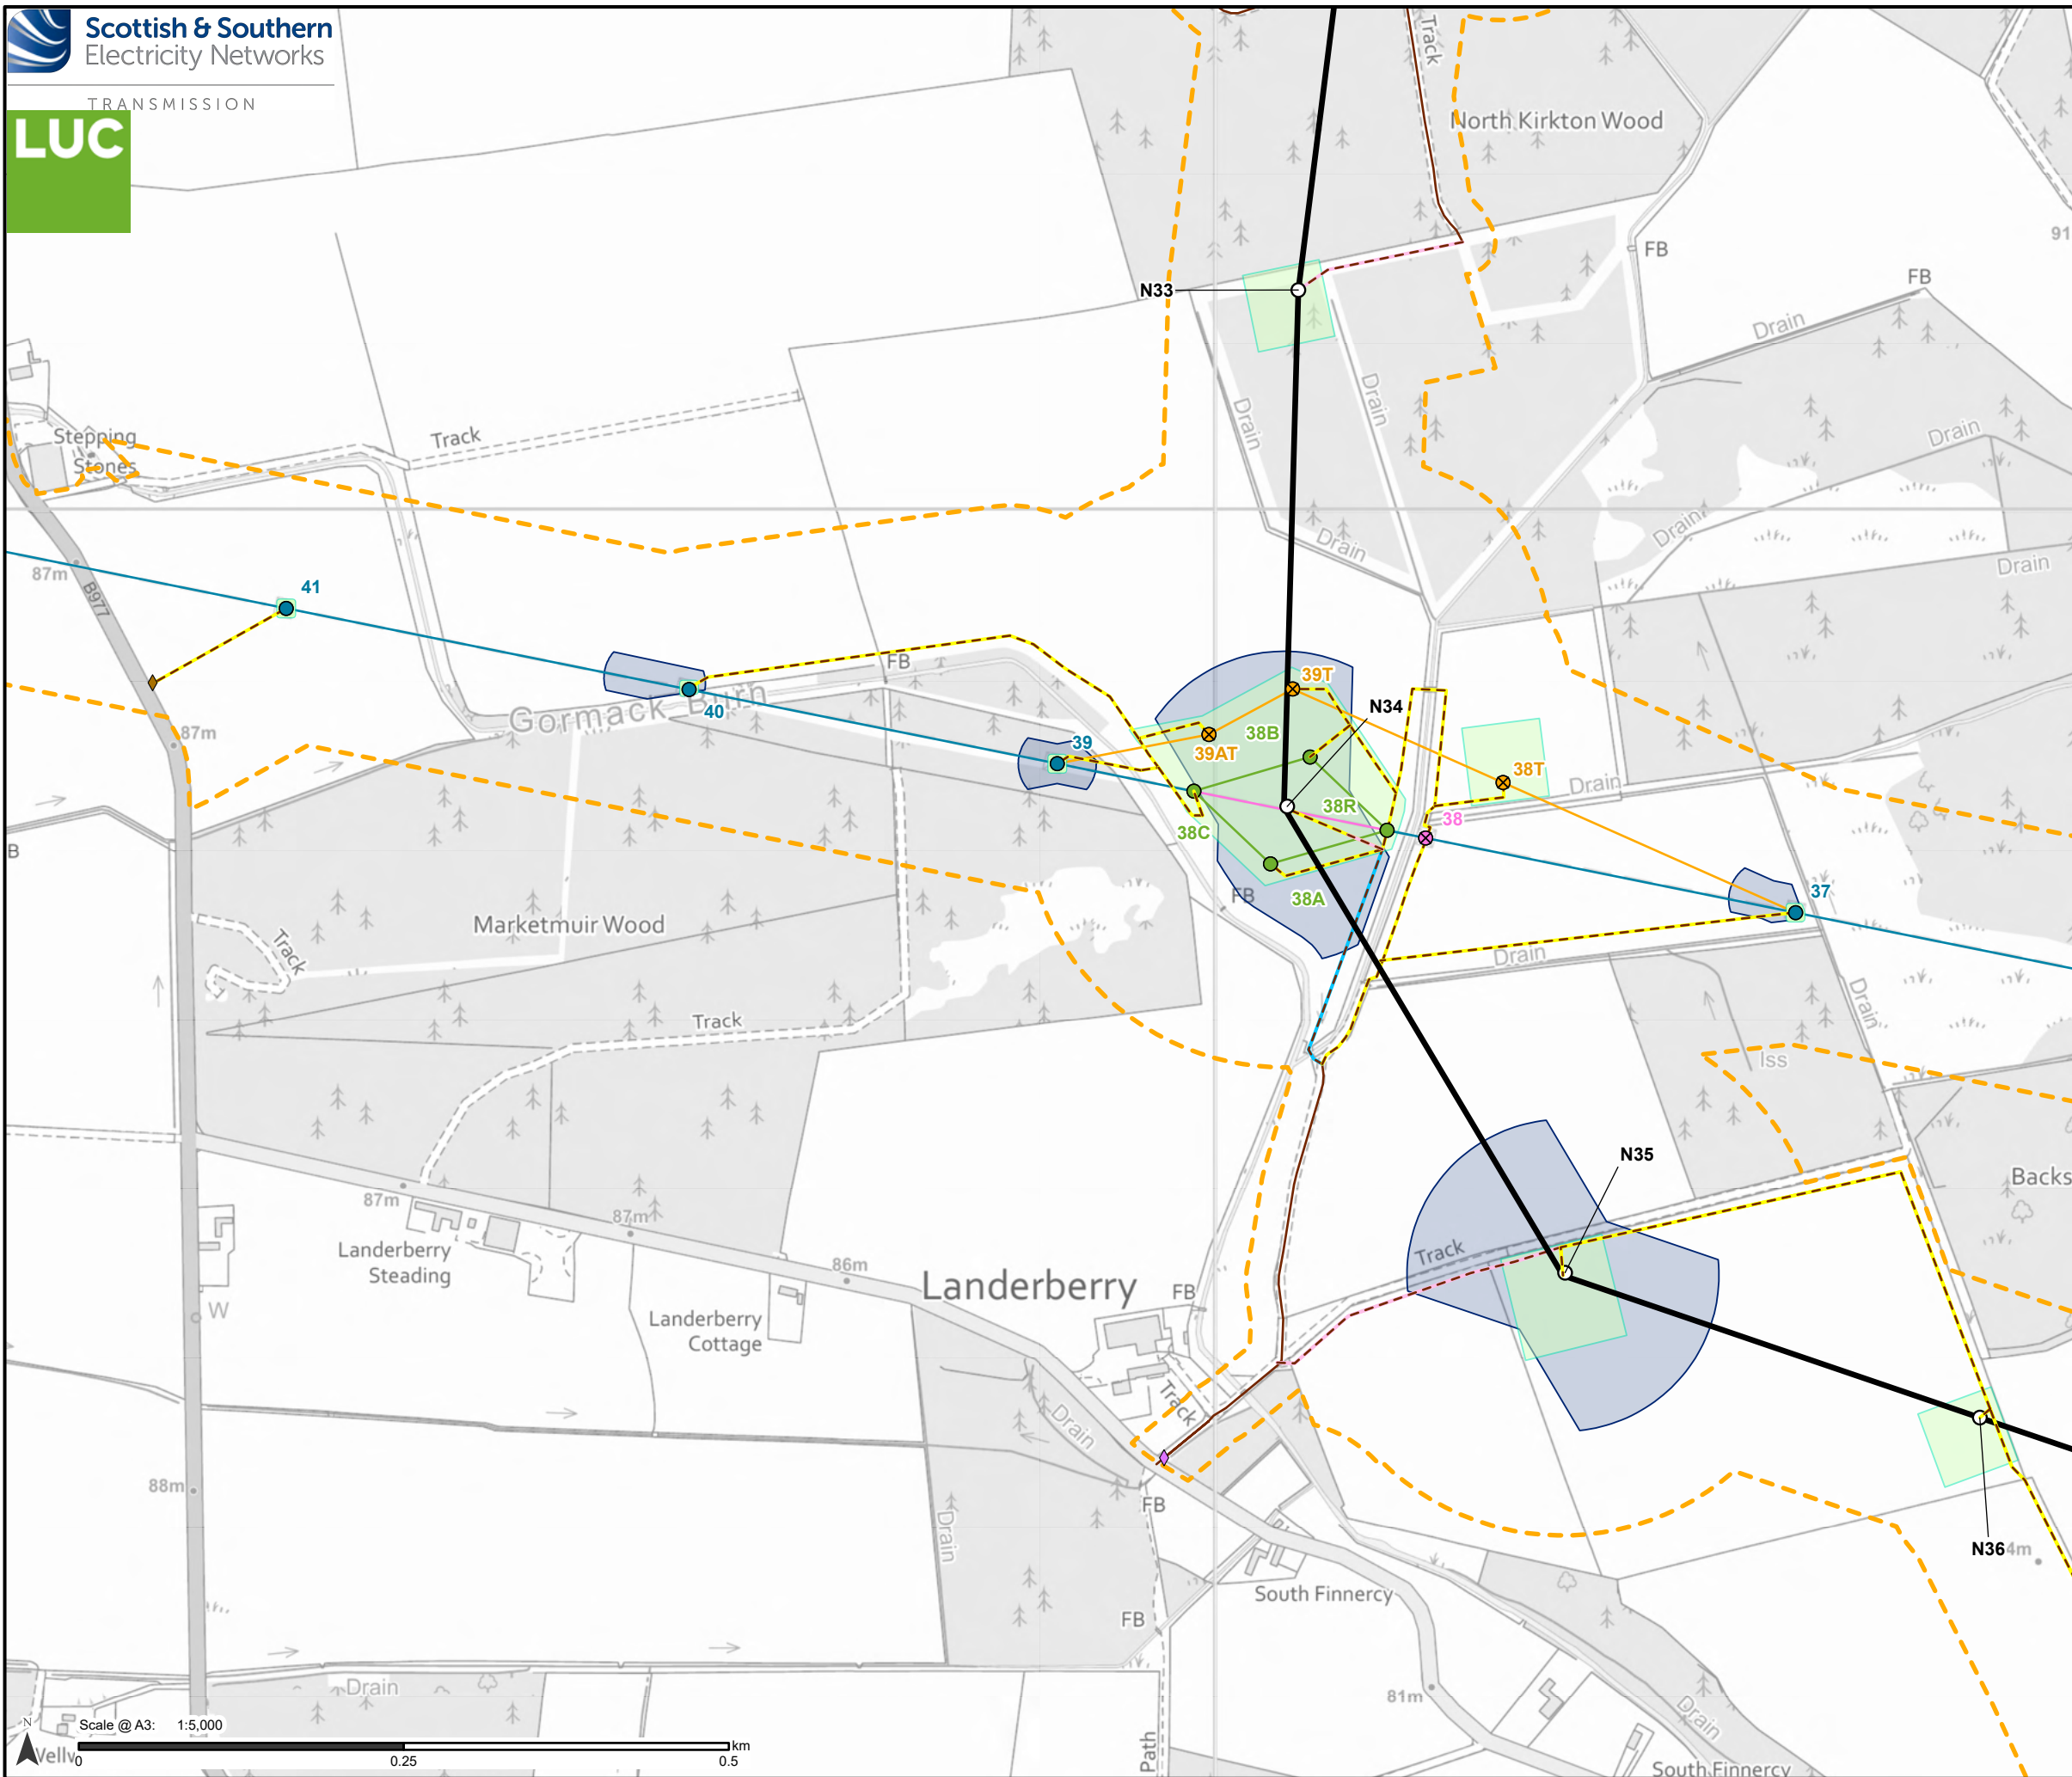

Proposed Development

- Tower Location and number
- Proposed Alignment
- - - Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- - - Proposed new stone permanent
- - - Proposed new stone permanent (operational and maintenance access track only - not for construction)
- - - Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))


Additional development included in Section 37 application: Craigiebuckler - Tarland 132 kV Overhead Line Realignment

- ⊗ Existing tower to be dismantled
- ⊗ Temporary diversion tower position
- Existing tower position to be retained
- Diamond crossing tower position
- Existing overhead line to be removed
- Temporary diversion overhead line
- Existing overhead line reconductoring
- Diamond crossing overhead line

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title: Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 24
Drawn by: MS Date: 13/08/2025
Drawing: 3.1.24

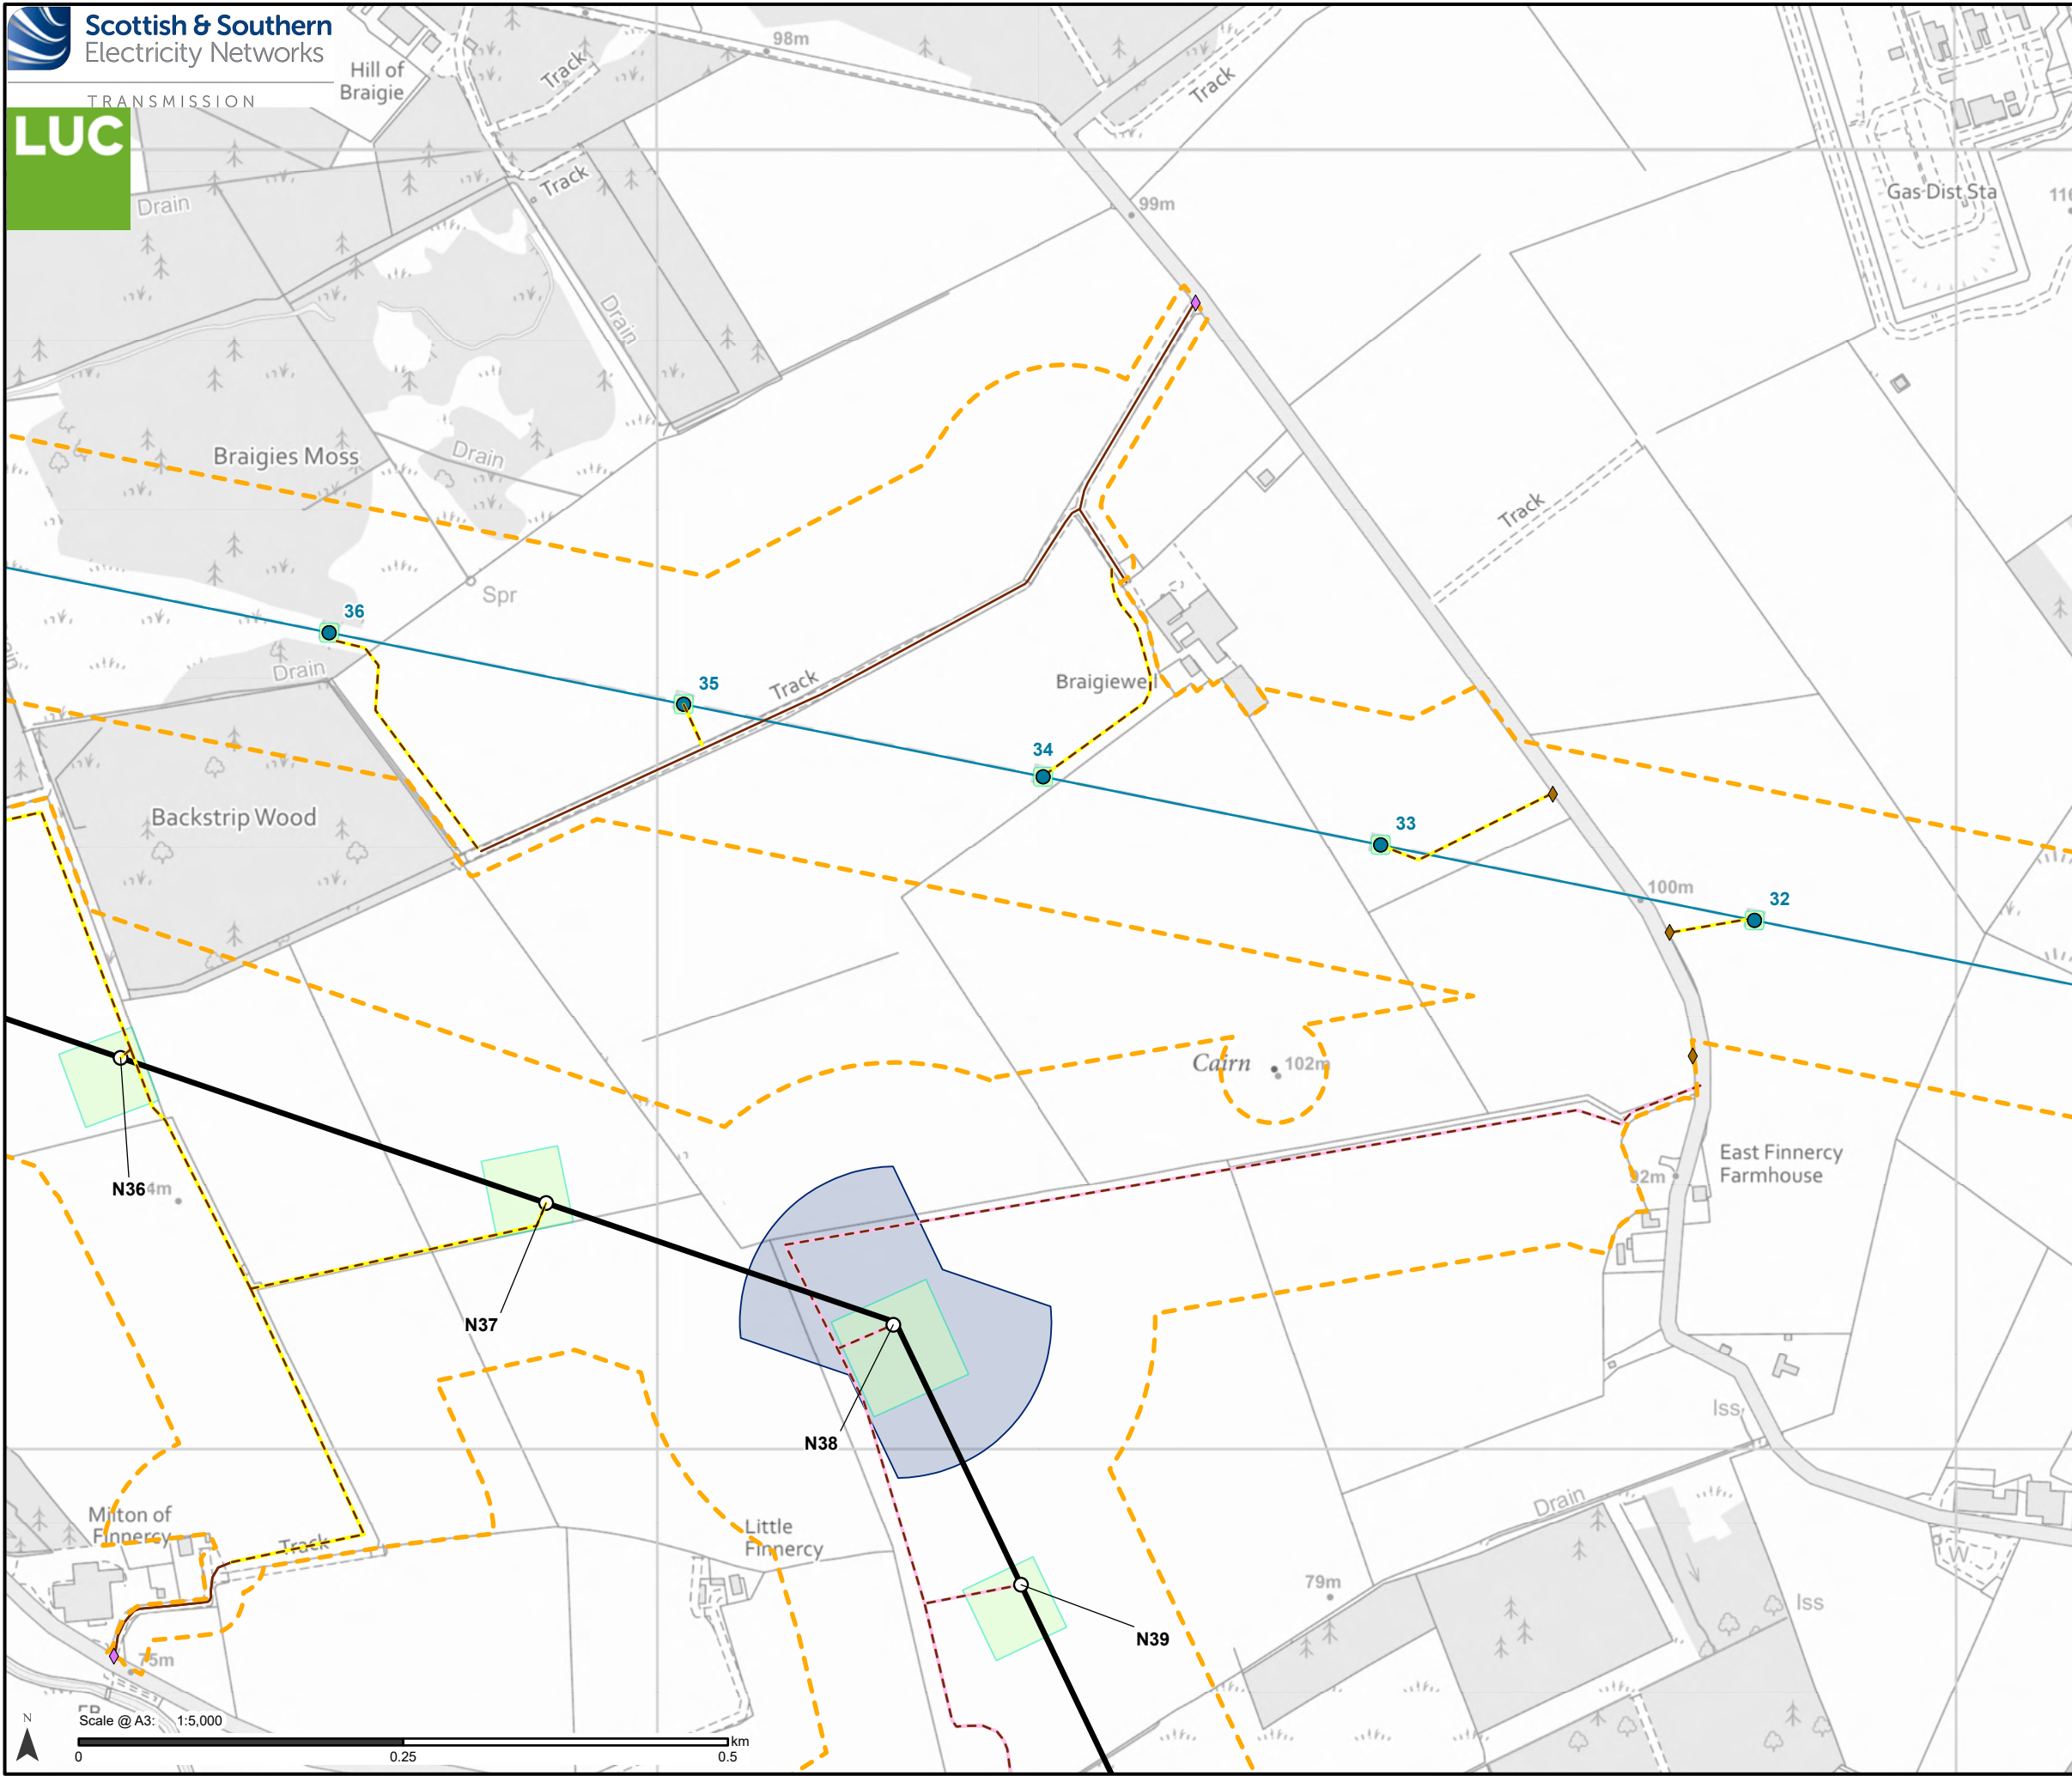


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))
- Additional development included in Section 37 application:
Craigiebuckler - Tarland 132 kV Overhead Line Realignment**
- Existing tower position to be retained
 - Existing overhead line reconductoring

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

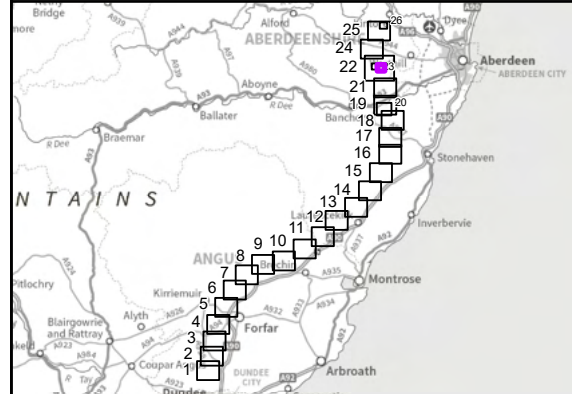

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 25
Drawn by:	MS
Date:	13/08/2025
Drawing:	3.1.25

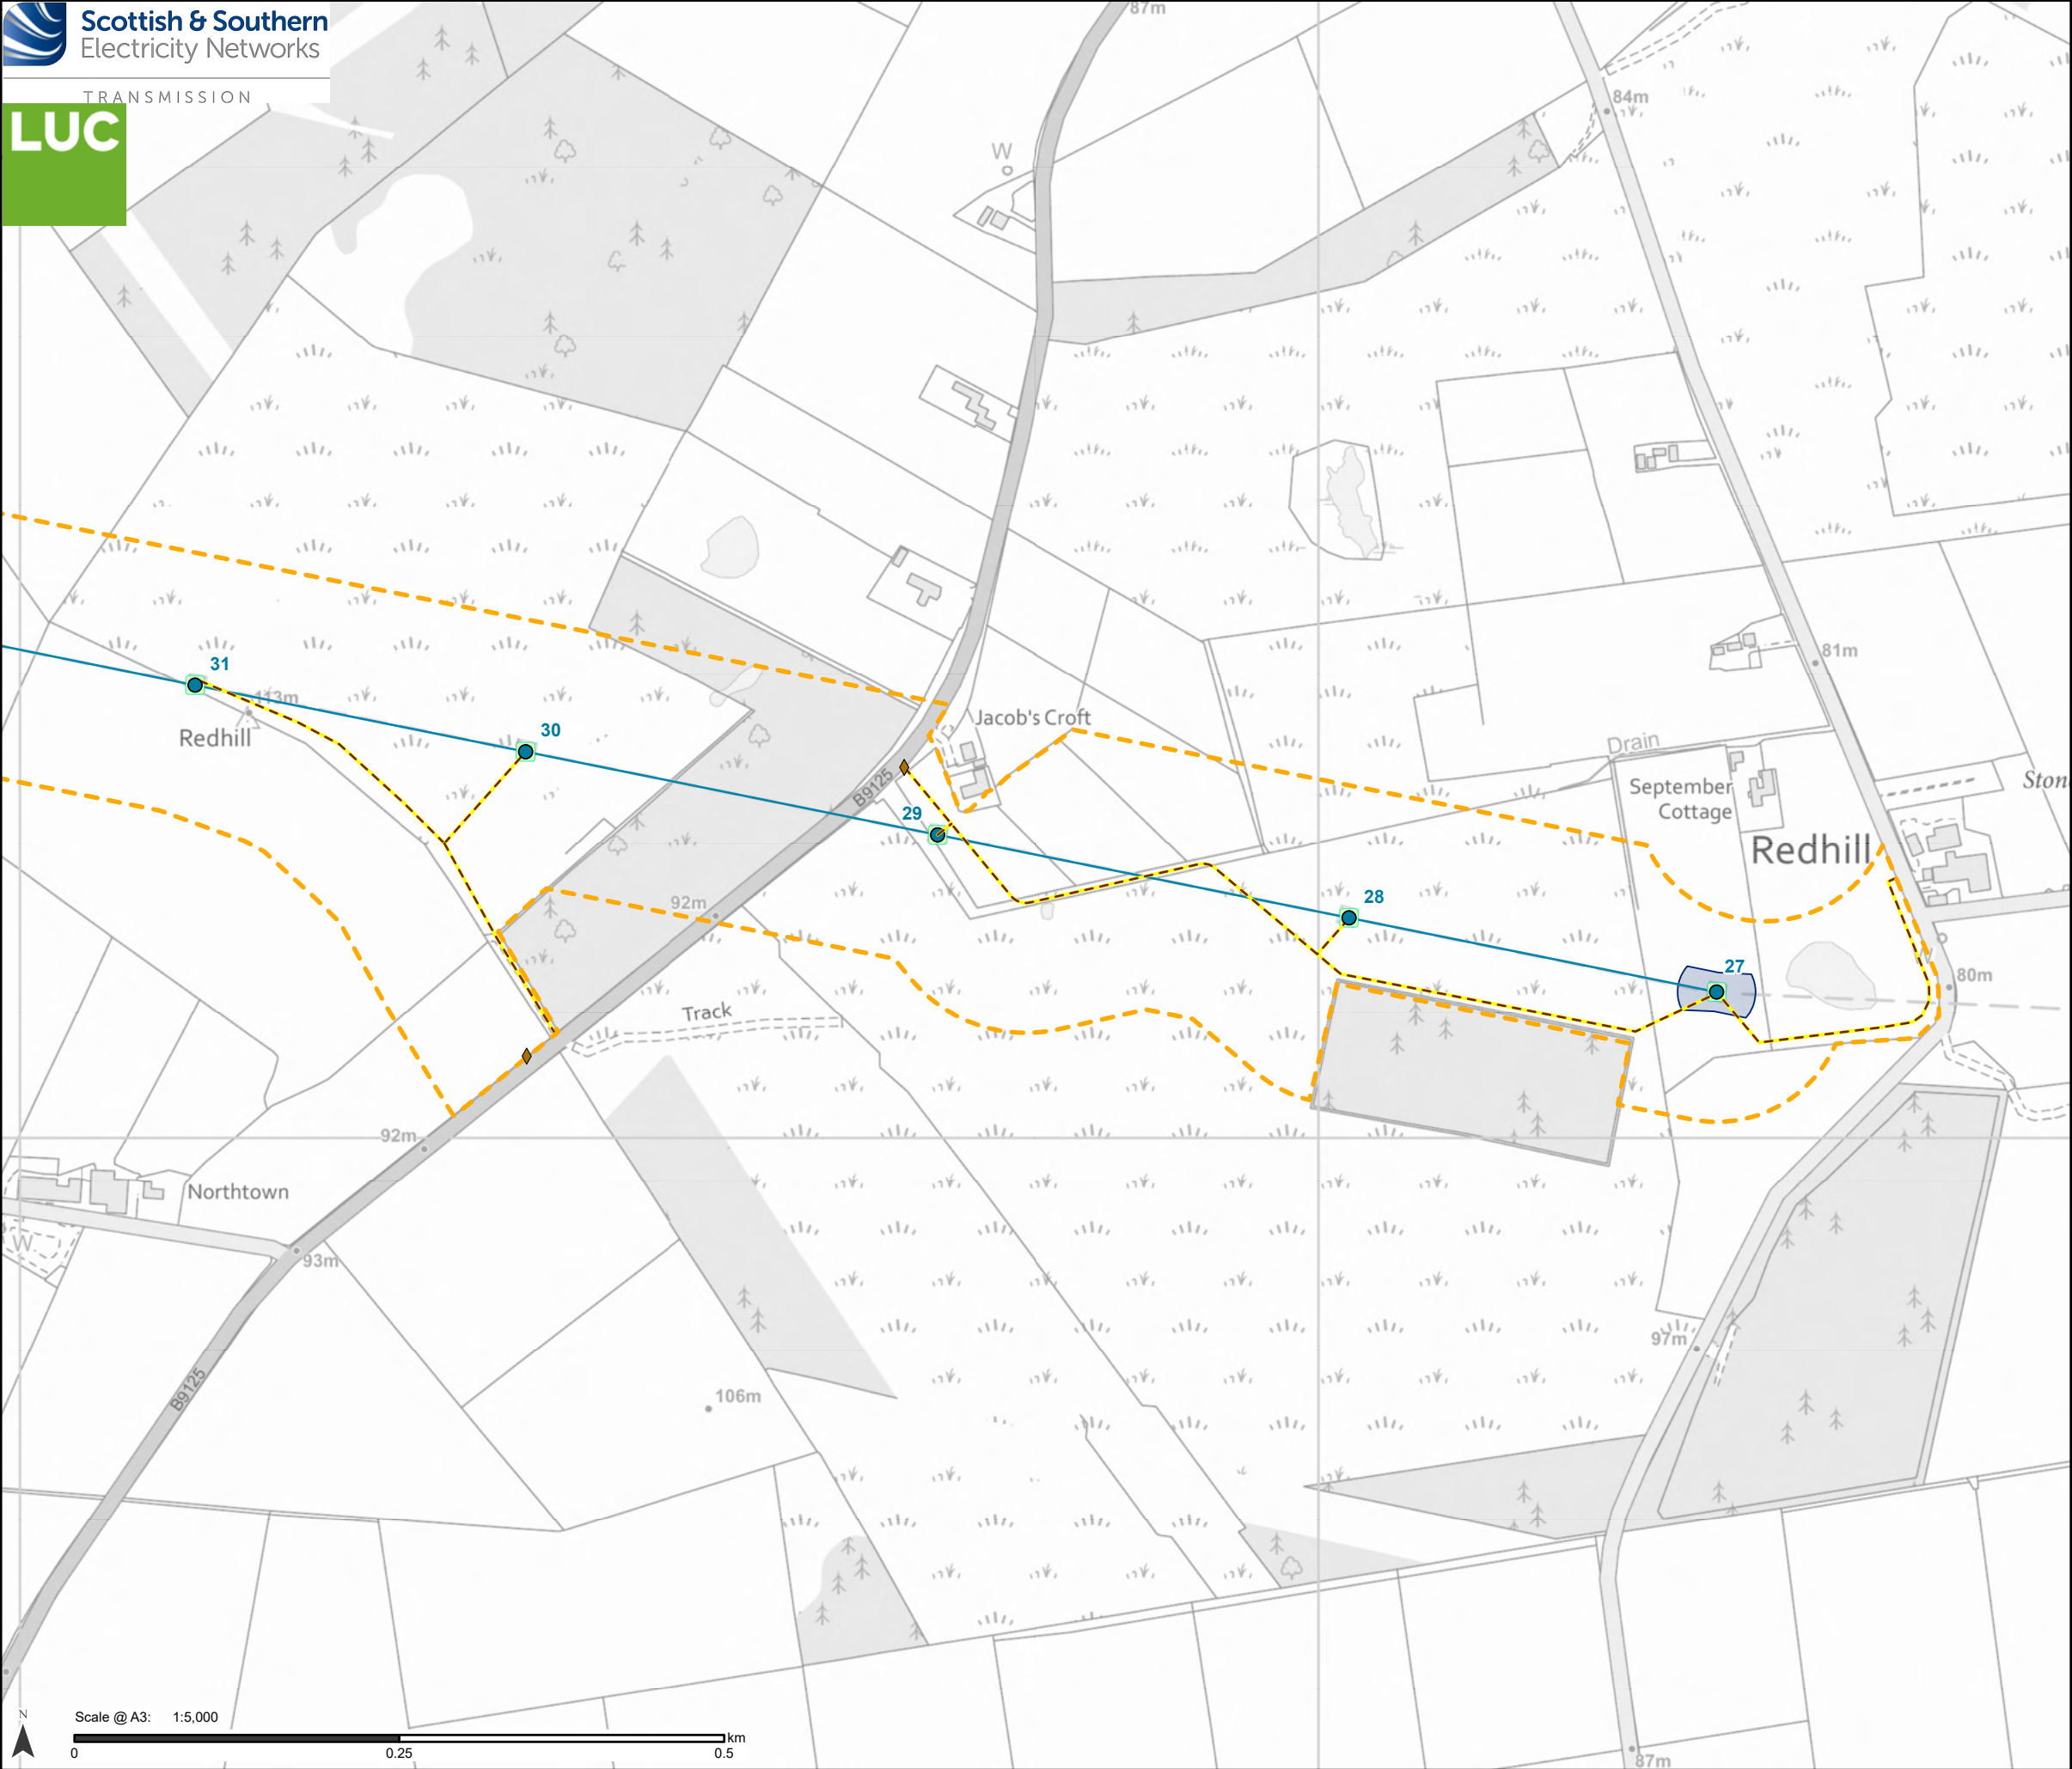

Proposed Development

 Proposed Development Limit of Deviation (LOD)

Access

 Proposed new stone temporary

Bellmouth type

 Proposed new

Temporary Working Areas

 Tower working area


 Proposed conductor pulling area (Equipotential Zone (EPZ))

**Additional development included in Section 37 application:
Craigiebuckler - Tarland 132 kV Overhead Line Realignment**

 Existing tower position to be retained

 Existing overhead line reconductoring

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

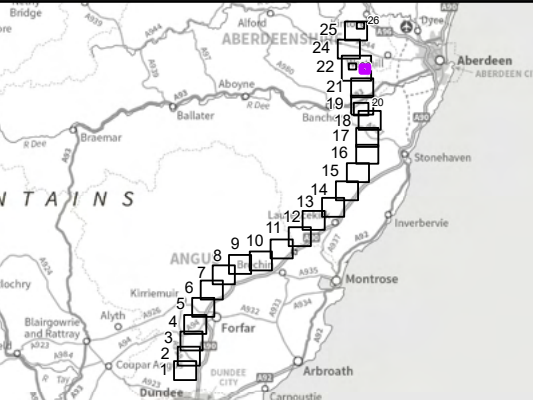


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 26
Drawn by:	MS
Date:	13/08/2025
Drawing:	3.1.26


81000m.N

81000m.N

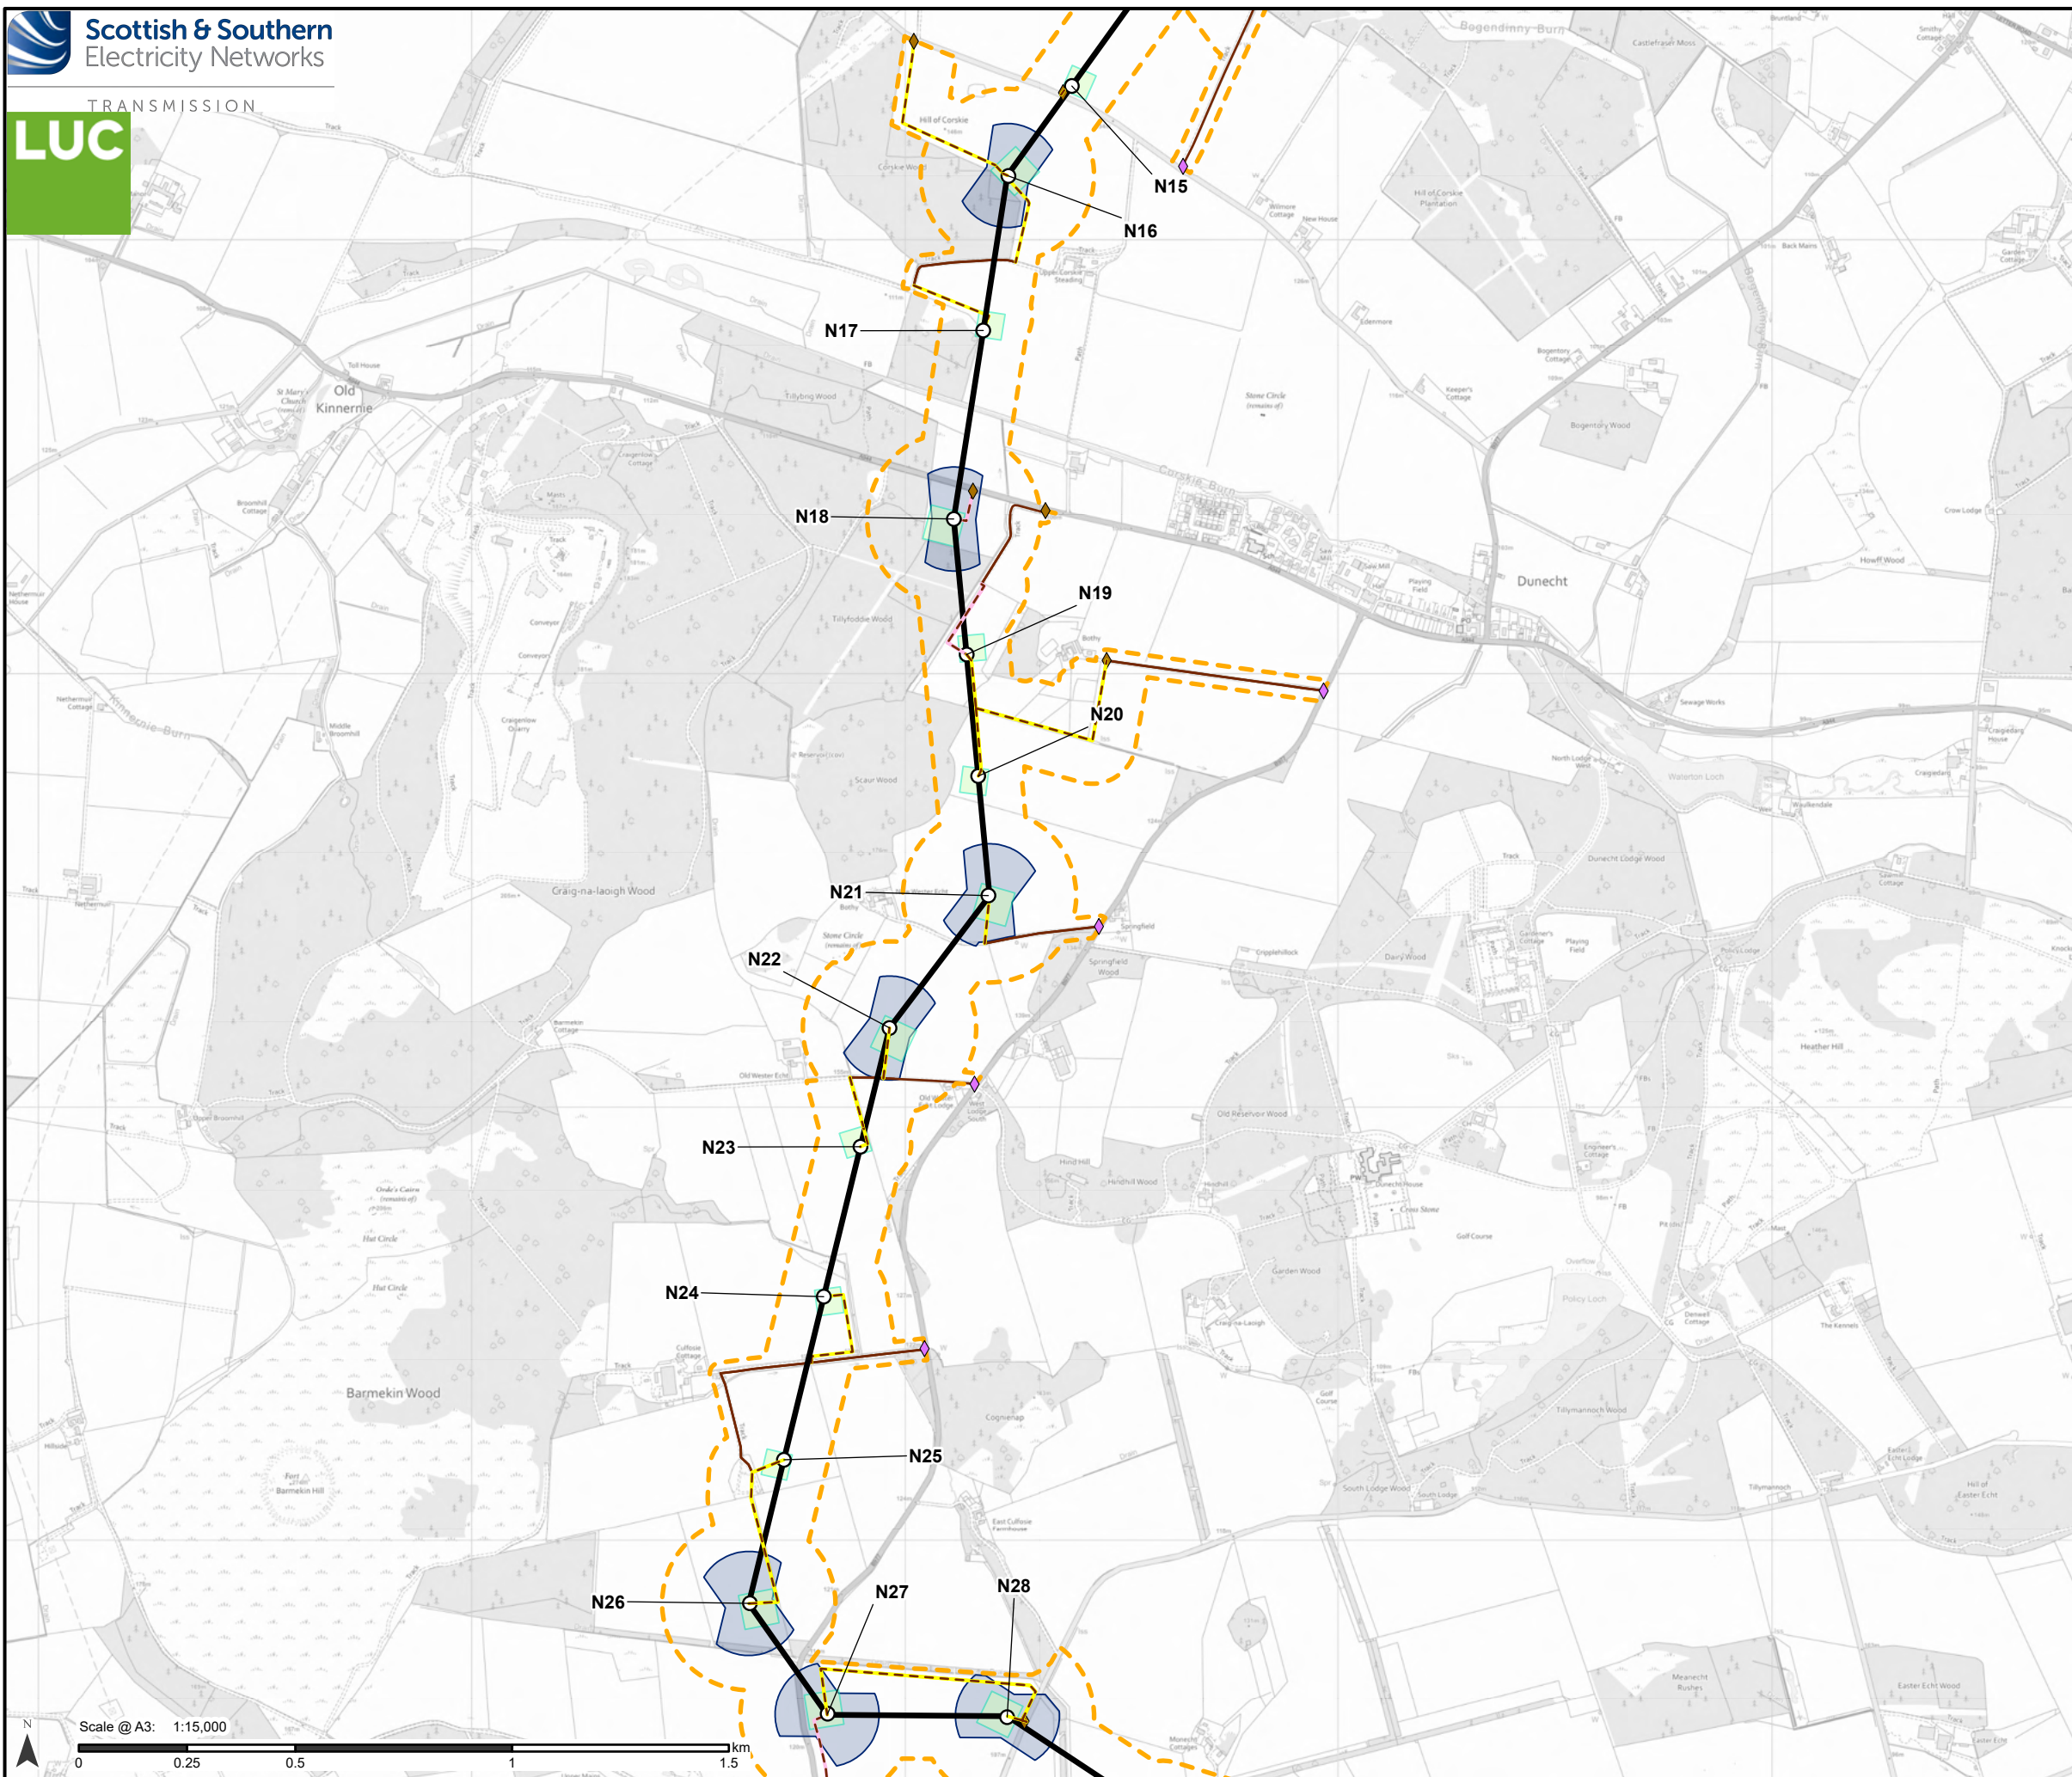

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

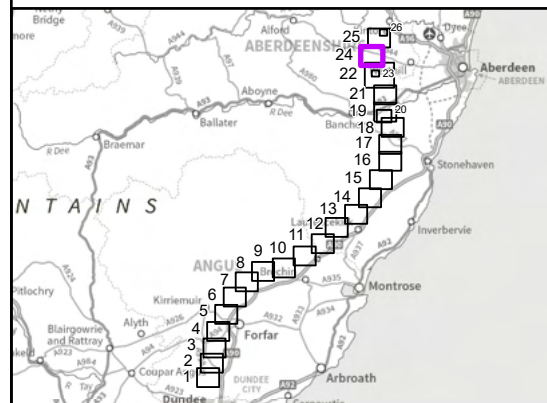


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 27

Drawn by: MS Date: 13/08/2025

Drawing: 3.1.27

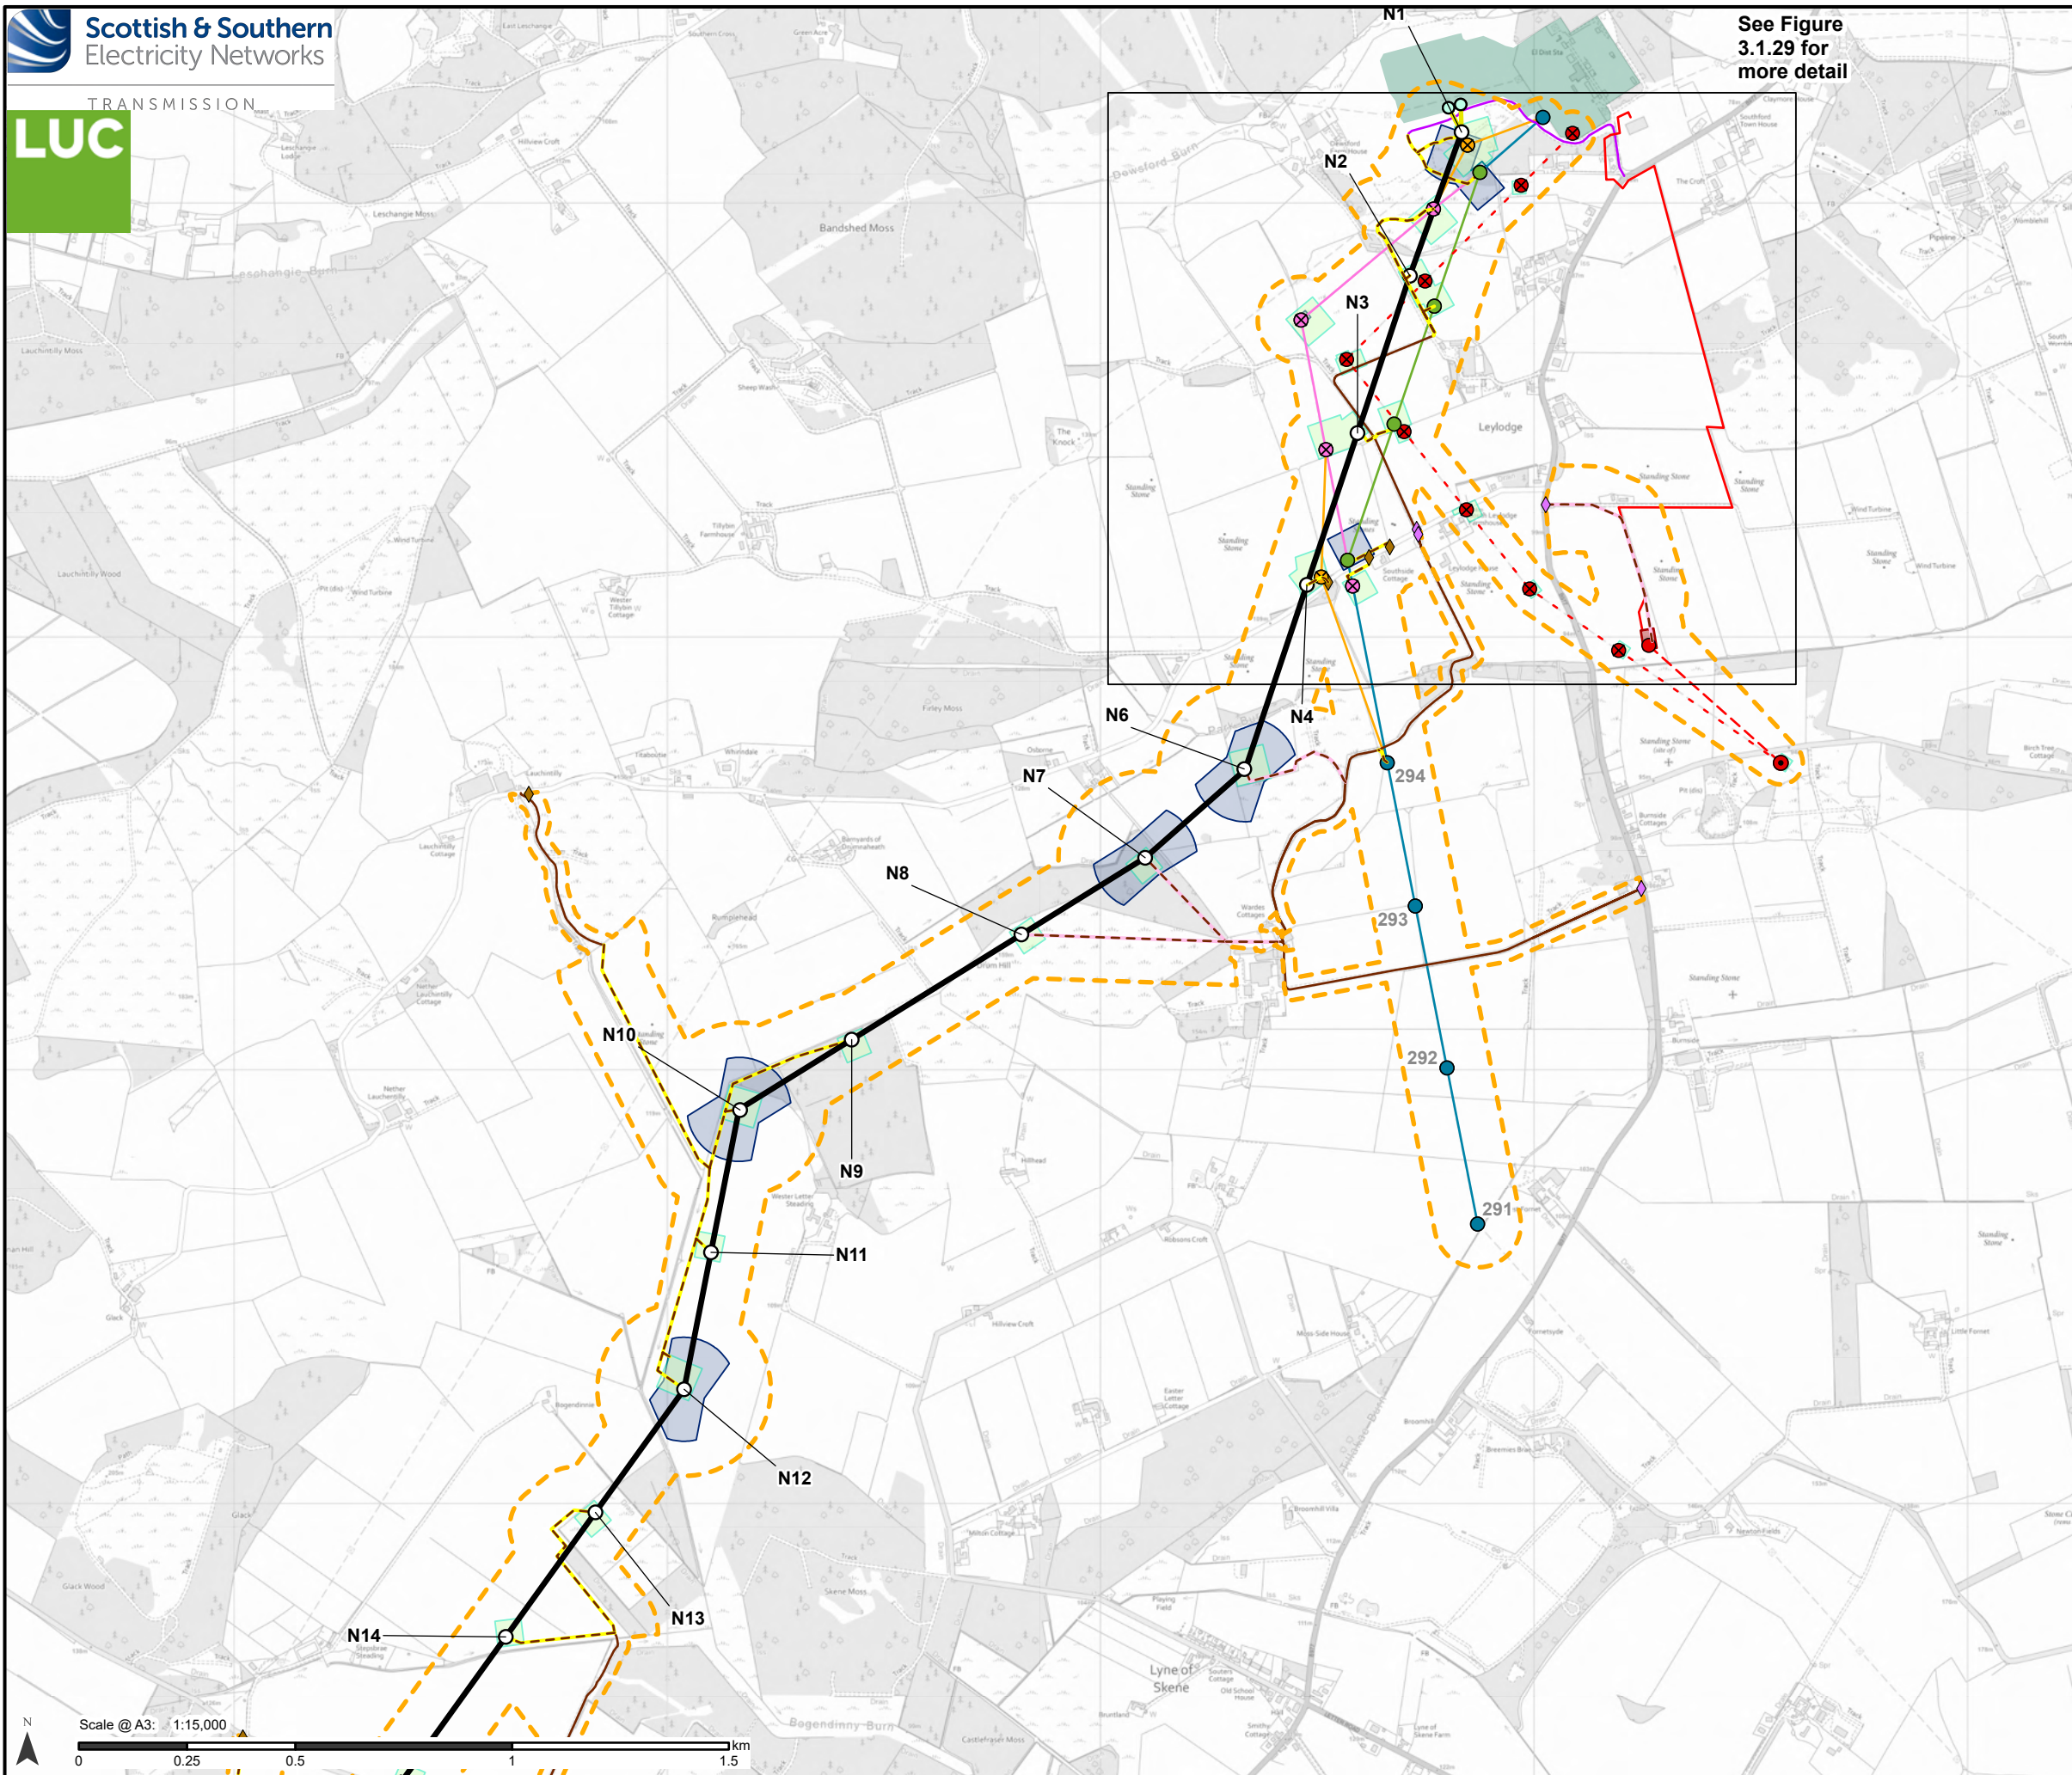

Proposed Development

- Tower Location and number
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

**Additional development included in Section 37 application:
Kintore - Tealing 275 kV Overhead Line Realignment**

- ⊗ Existing tower to be dismantled
- ⊗ Temporary diversion tower position
- Existing tower position to be retained
- New realignment tower position
- Existing overhead line to be removed
- Temporary diversion overhead line
- Existing overhead line reconductoring
- New permanent realignment

**Additional development included in Section 37 application:
Kintore - Craigiebuckler 132 kV**

- Terminal tower position
- Existing tower position
- ⊗ Existing tower to be dismantled
- Overhead line to be removed
- Realignment overhead line
- Cable Sealing End Compound

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Existing/Other Infrastructure

- Gantry location
- Existing access track
- Existing Kintore Substation

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 28

Drawn by: MS Date: 13/08/2025

Drawing: 3.1.28

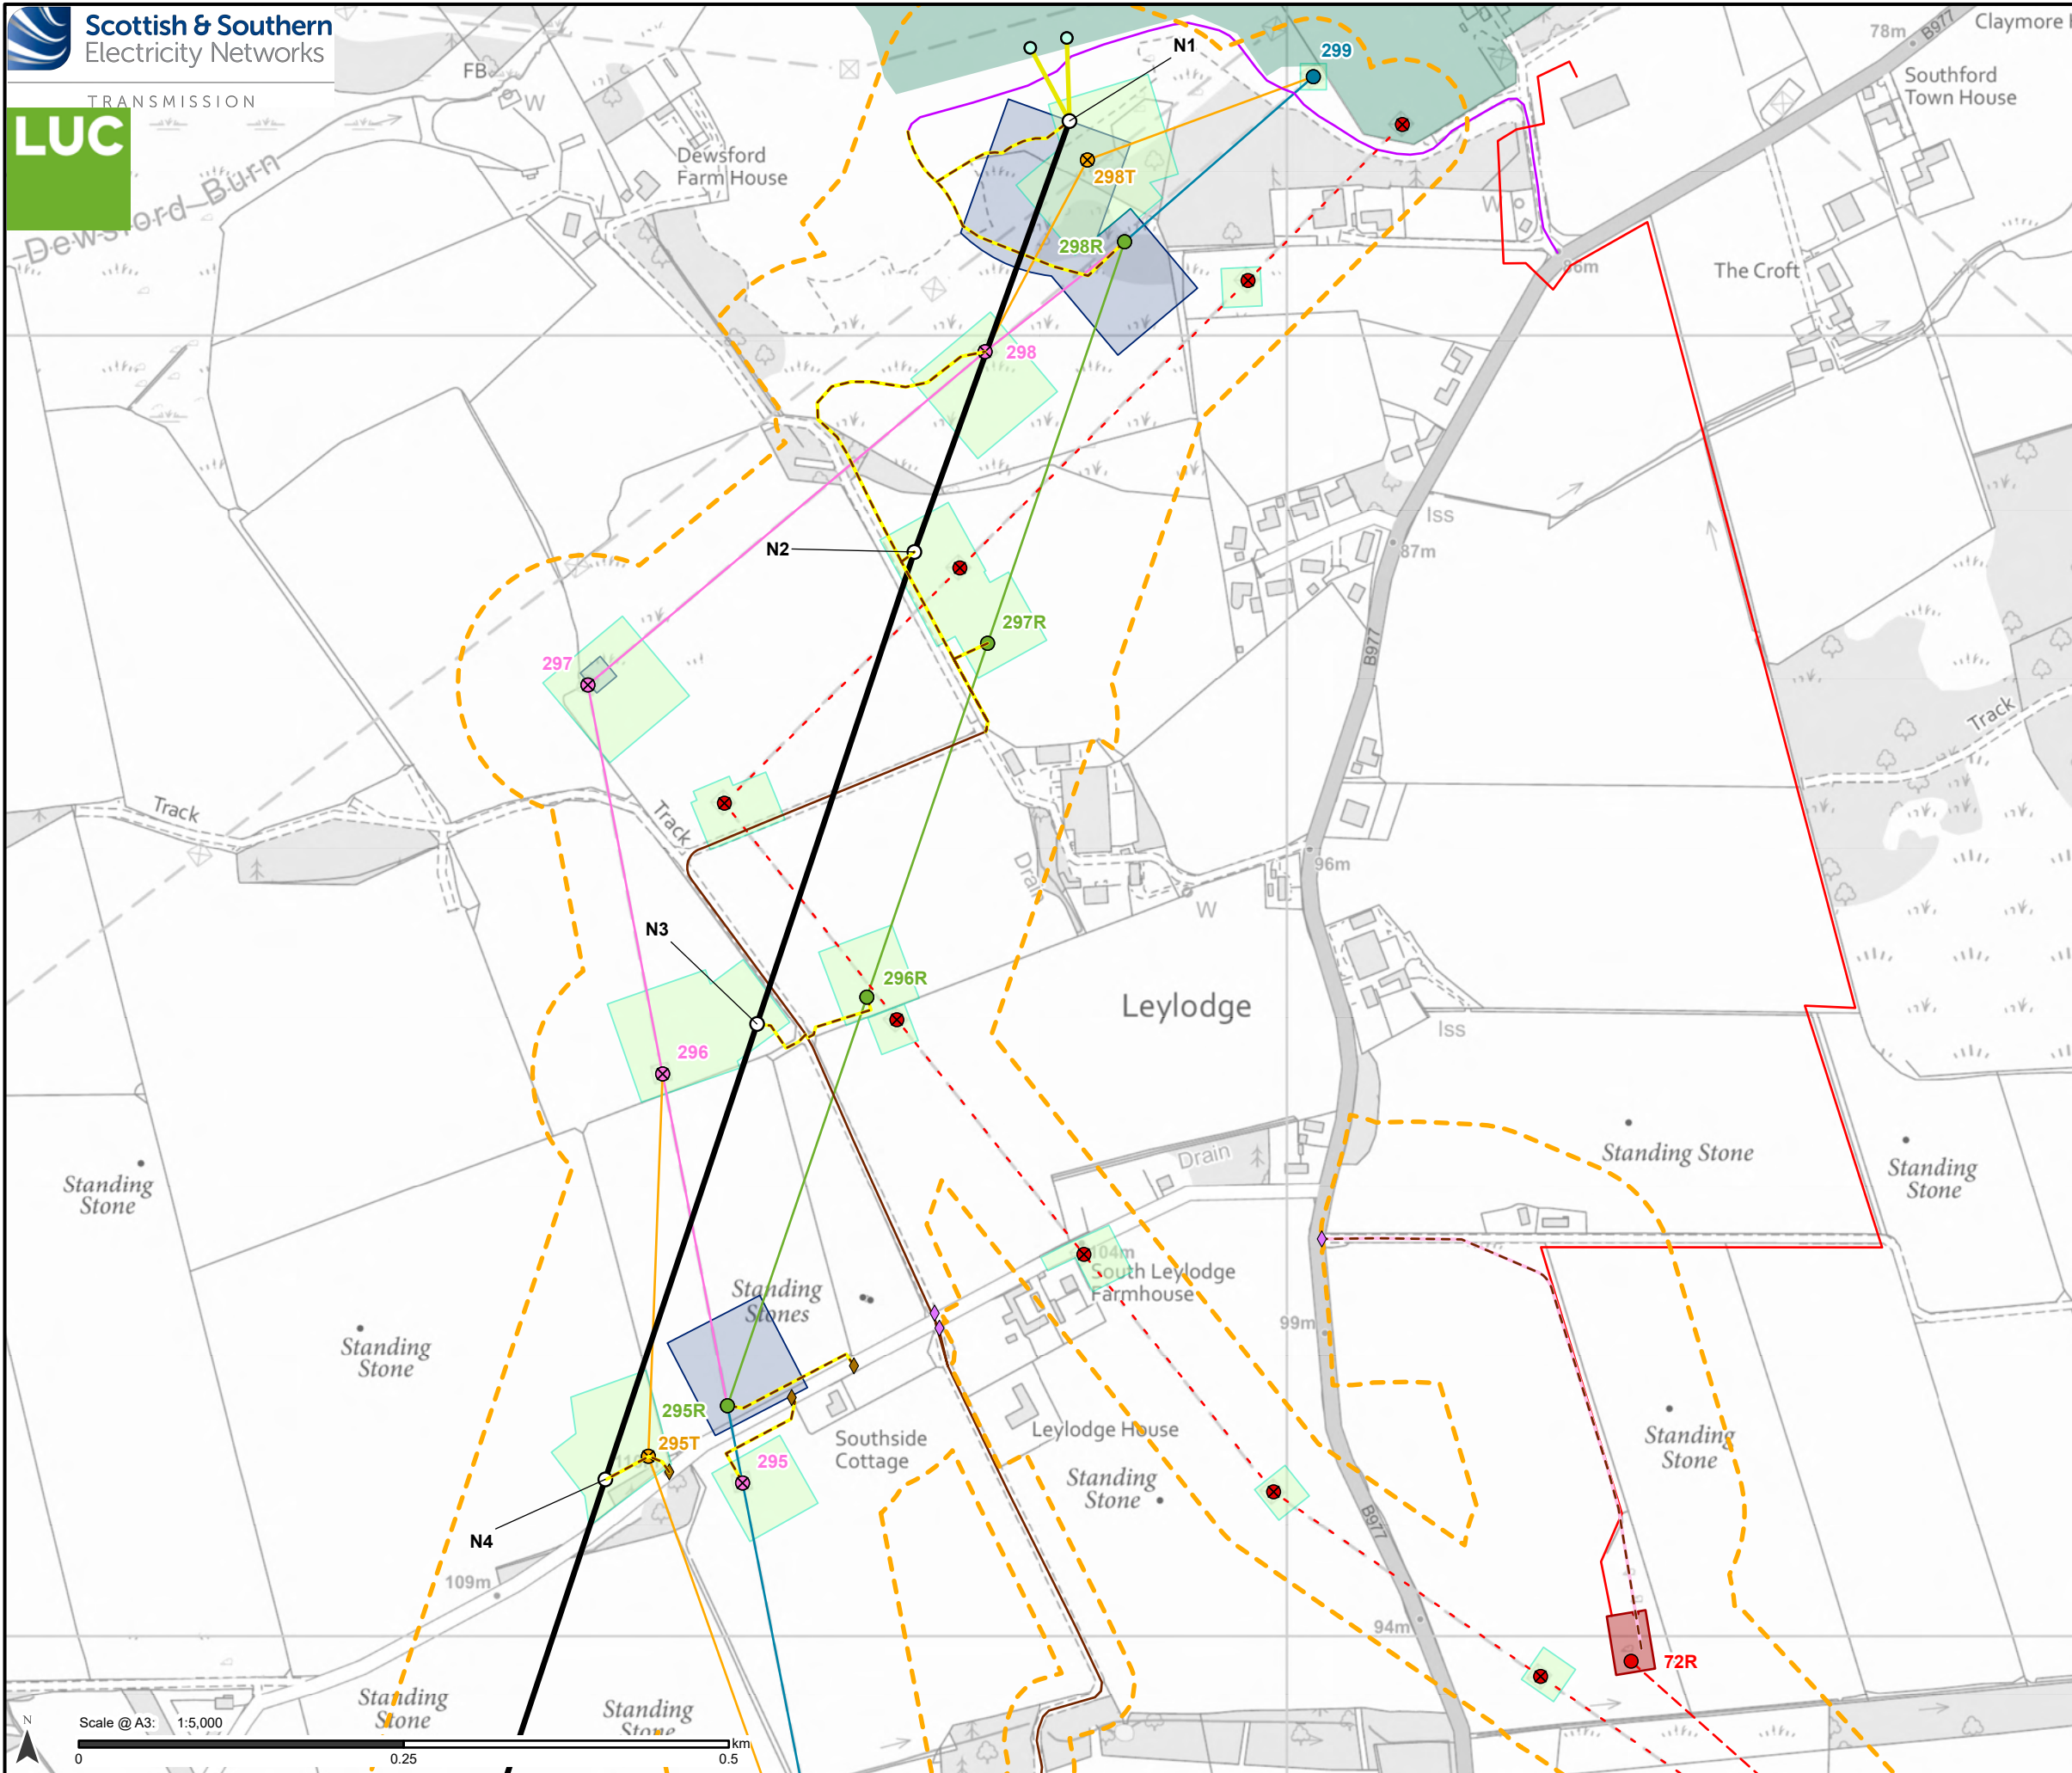

Proposed Development

- Tower Location and number
- Proposed Alignment
- Download
- Proposed Development Limit of Deviation (LOD)

Access

- Existing to be upgraded
- Proposed new stone permanent
- Proposed new stone temporary

Bellmouth type

- ◆ Proposed new
- ◆ Existing to be upgraded

Temporary Working Areas

- Tower working area
- Proposed conductor pulling area (Equipotential Zone (EPZ))

Additional development included in Section 37 application:

Kintore - Tealing 275 kV Overhead Line Realignment

- ⊗ Existing tower to be dismantled
- ⊗ Temporary diversion tower position
- Existing tower position to be retained
- New realignment tower position
- Existing overhead line to be removed
- Temporary diversion overhead line
- Existing overhead line reconductoring
- New permanent realignment

Additional development included in Section 37 application:

Kintore - Craigiebuckler 132 kV

- Terminal tower position
- ⊗ Existing tower to be dismantled
- Overhead line to be removed
- Realignment overhead line
- Cable Sealing End Compound

Permitted Development (not part of this Proposed Development)

- Proposed underground cable (indicative)

Existing/Other Infrastructure

- Gantry location
- Existing access track
- Existing Kintore Substation

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455

Project: Kintore to Tealing 400 kV Overhead Line

Title: Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 29

Drawn by: MS Date: 13/08/2025

Drawing: 3.1.29