


740000m.N

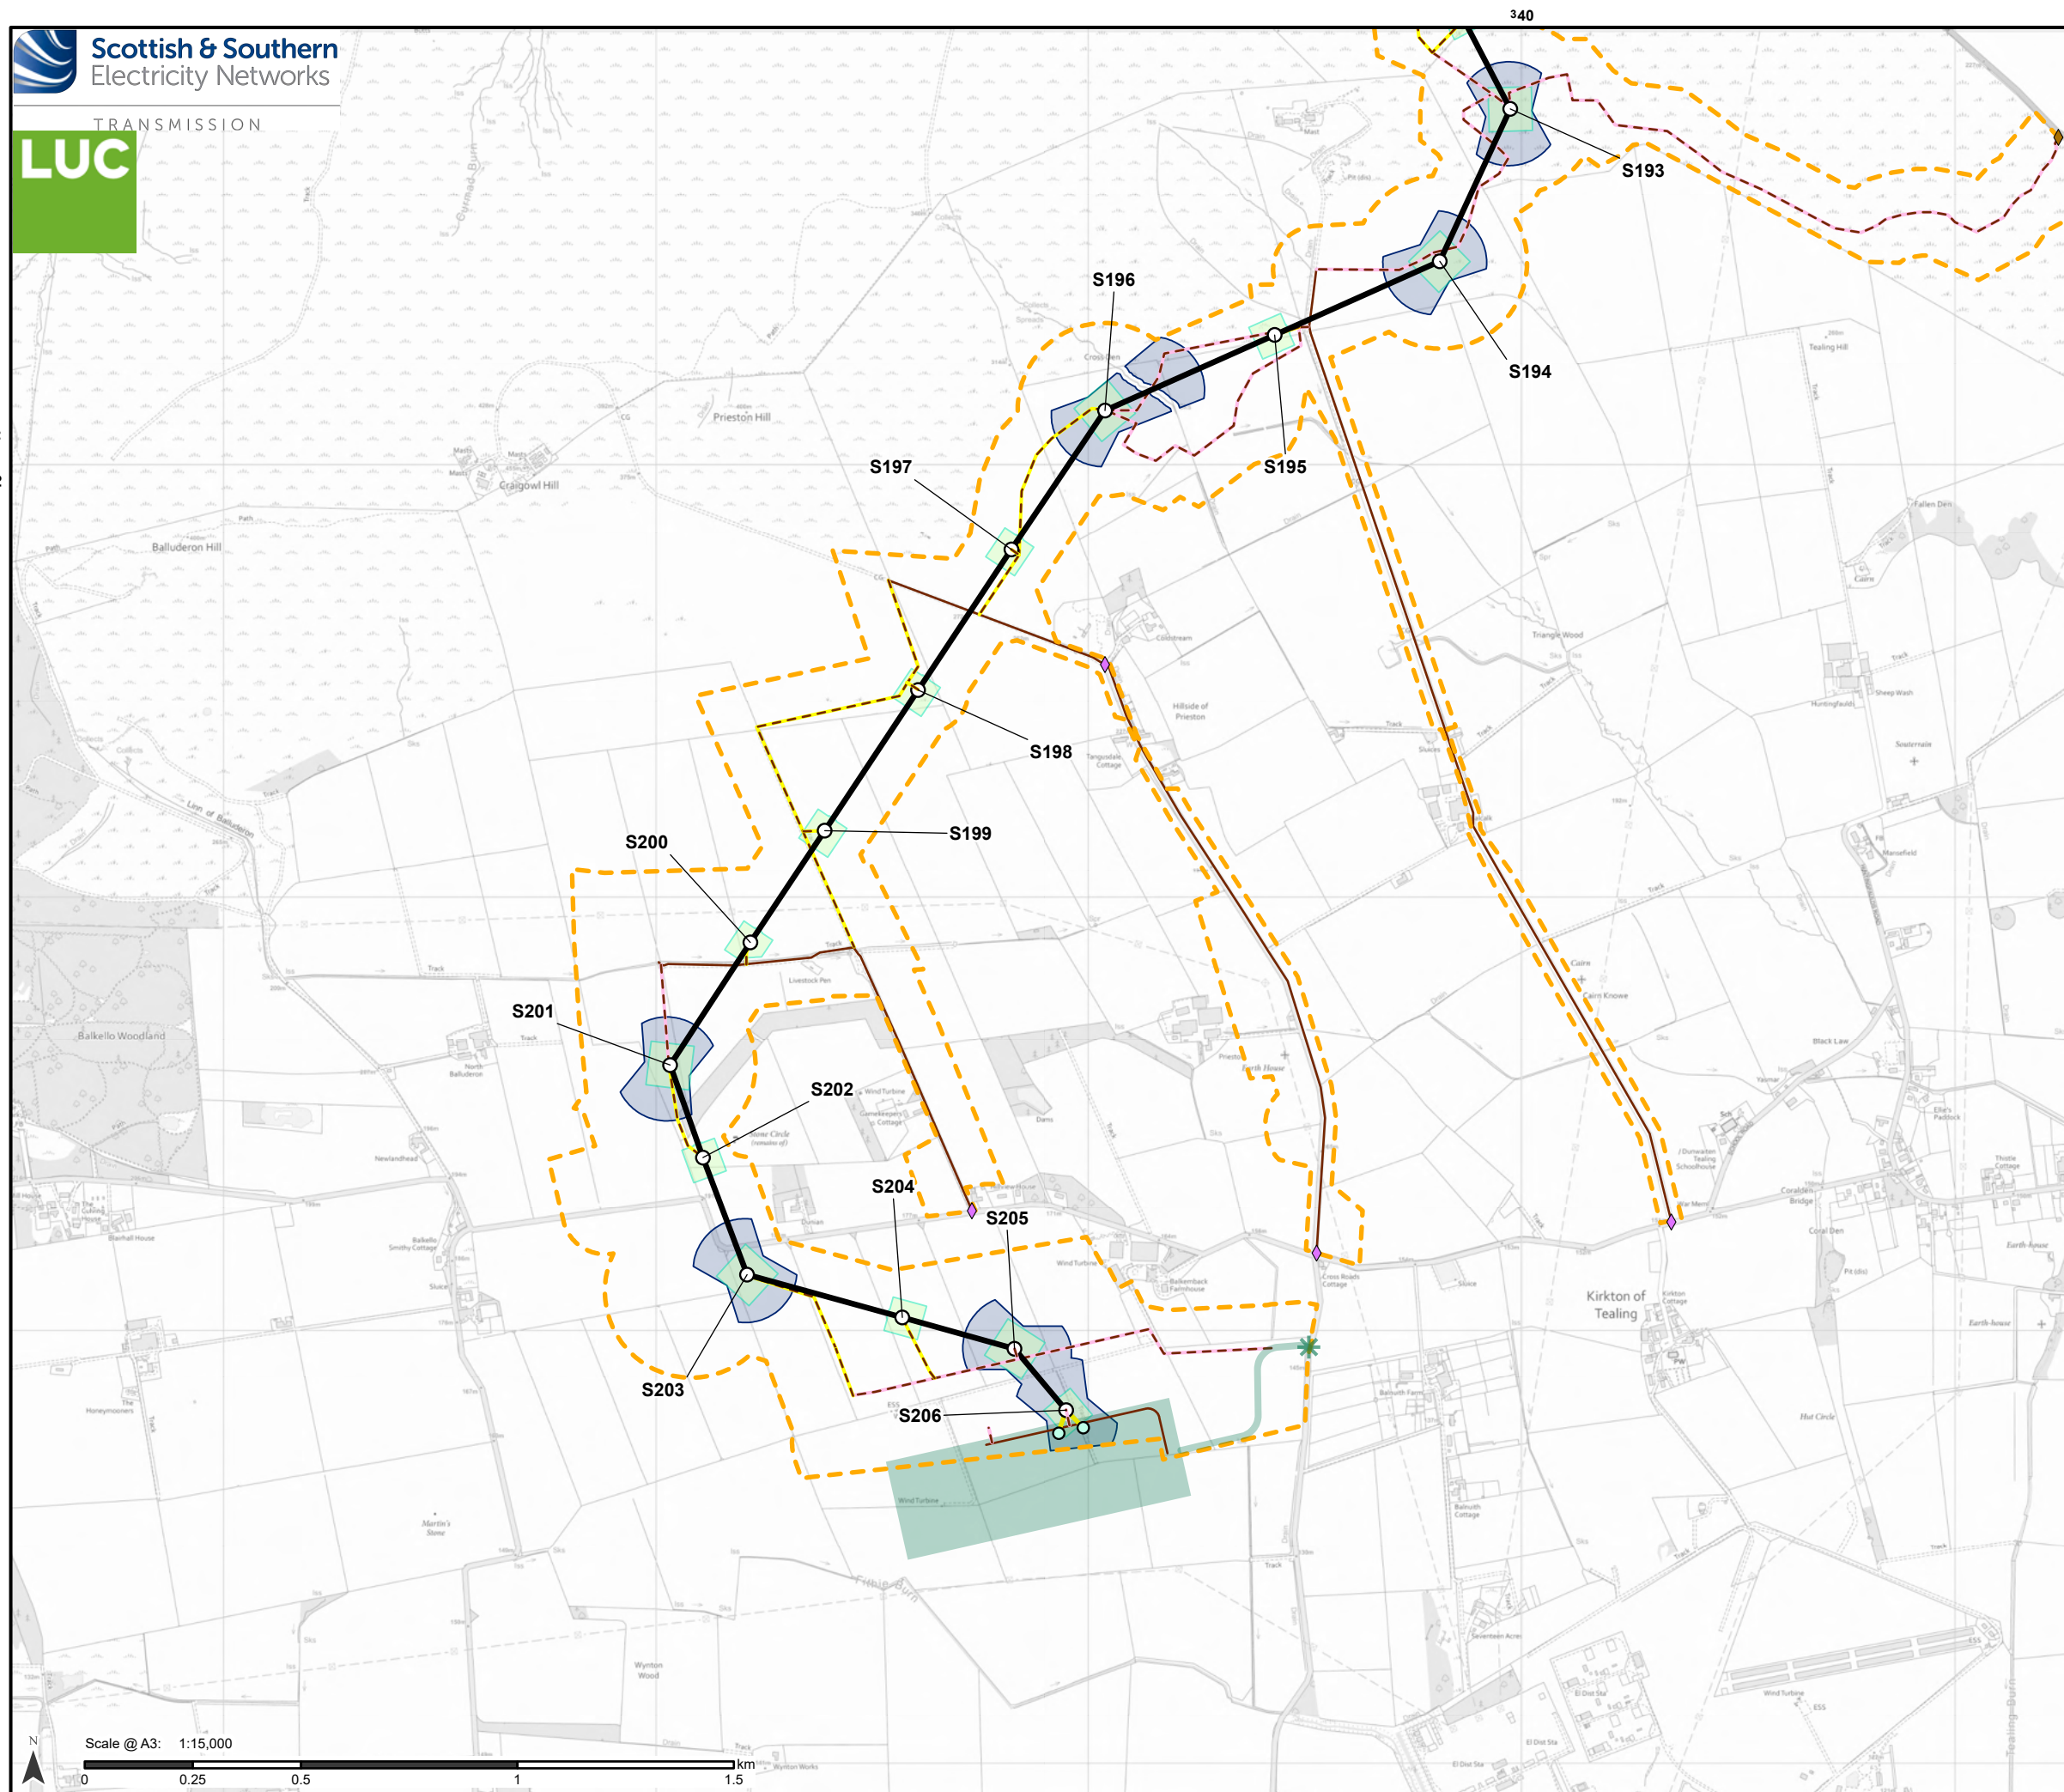


740000m.N

340000m.E


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Download
 - - - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - - - Proposed new stone permanent
 - - - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))
- Intra (Associated) Developments**
- Gantry location
 - Proposed Emmock 400 kV substation (Angus Council Reference 24/00699/FULN)
 - * New bellmouth as part of Proposed Emmock 400 kV substation
 - Existing access track to be upgraded as part of Proposed Emmock 400 kV substation

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

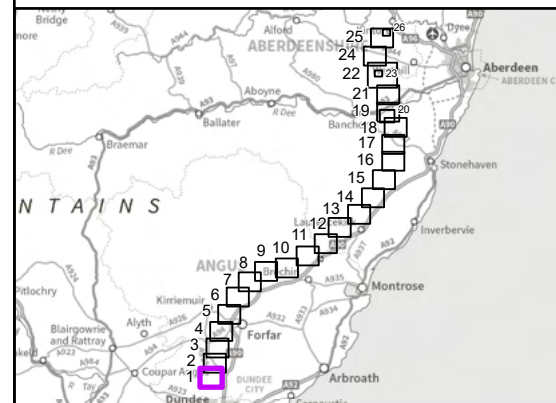


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 1
Drawn by: MS Date: 13/08/2025
Drawing: 3.1.1

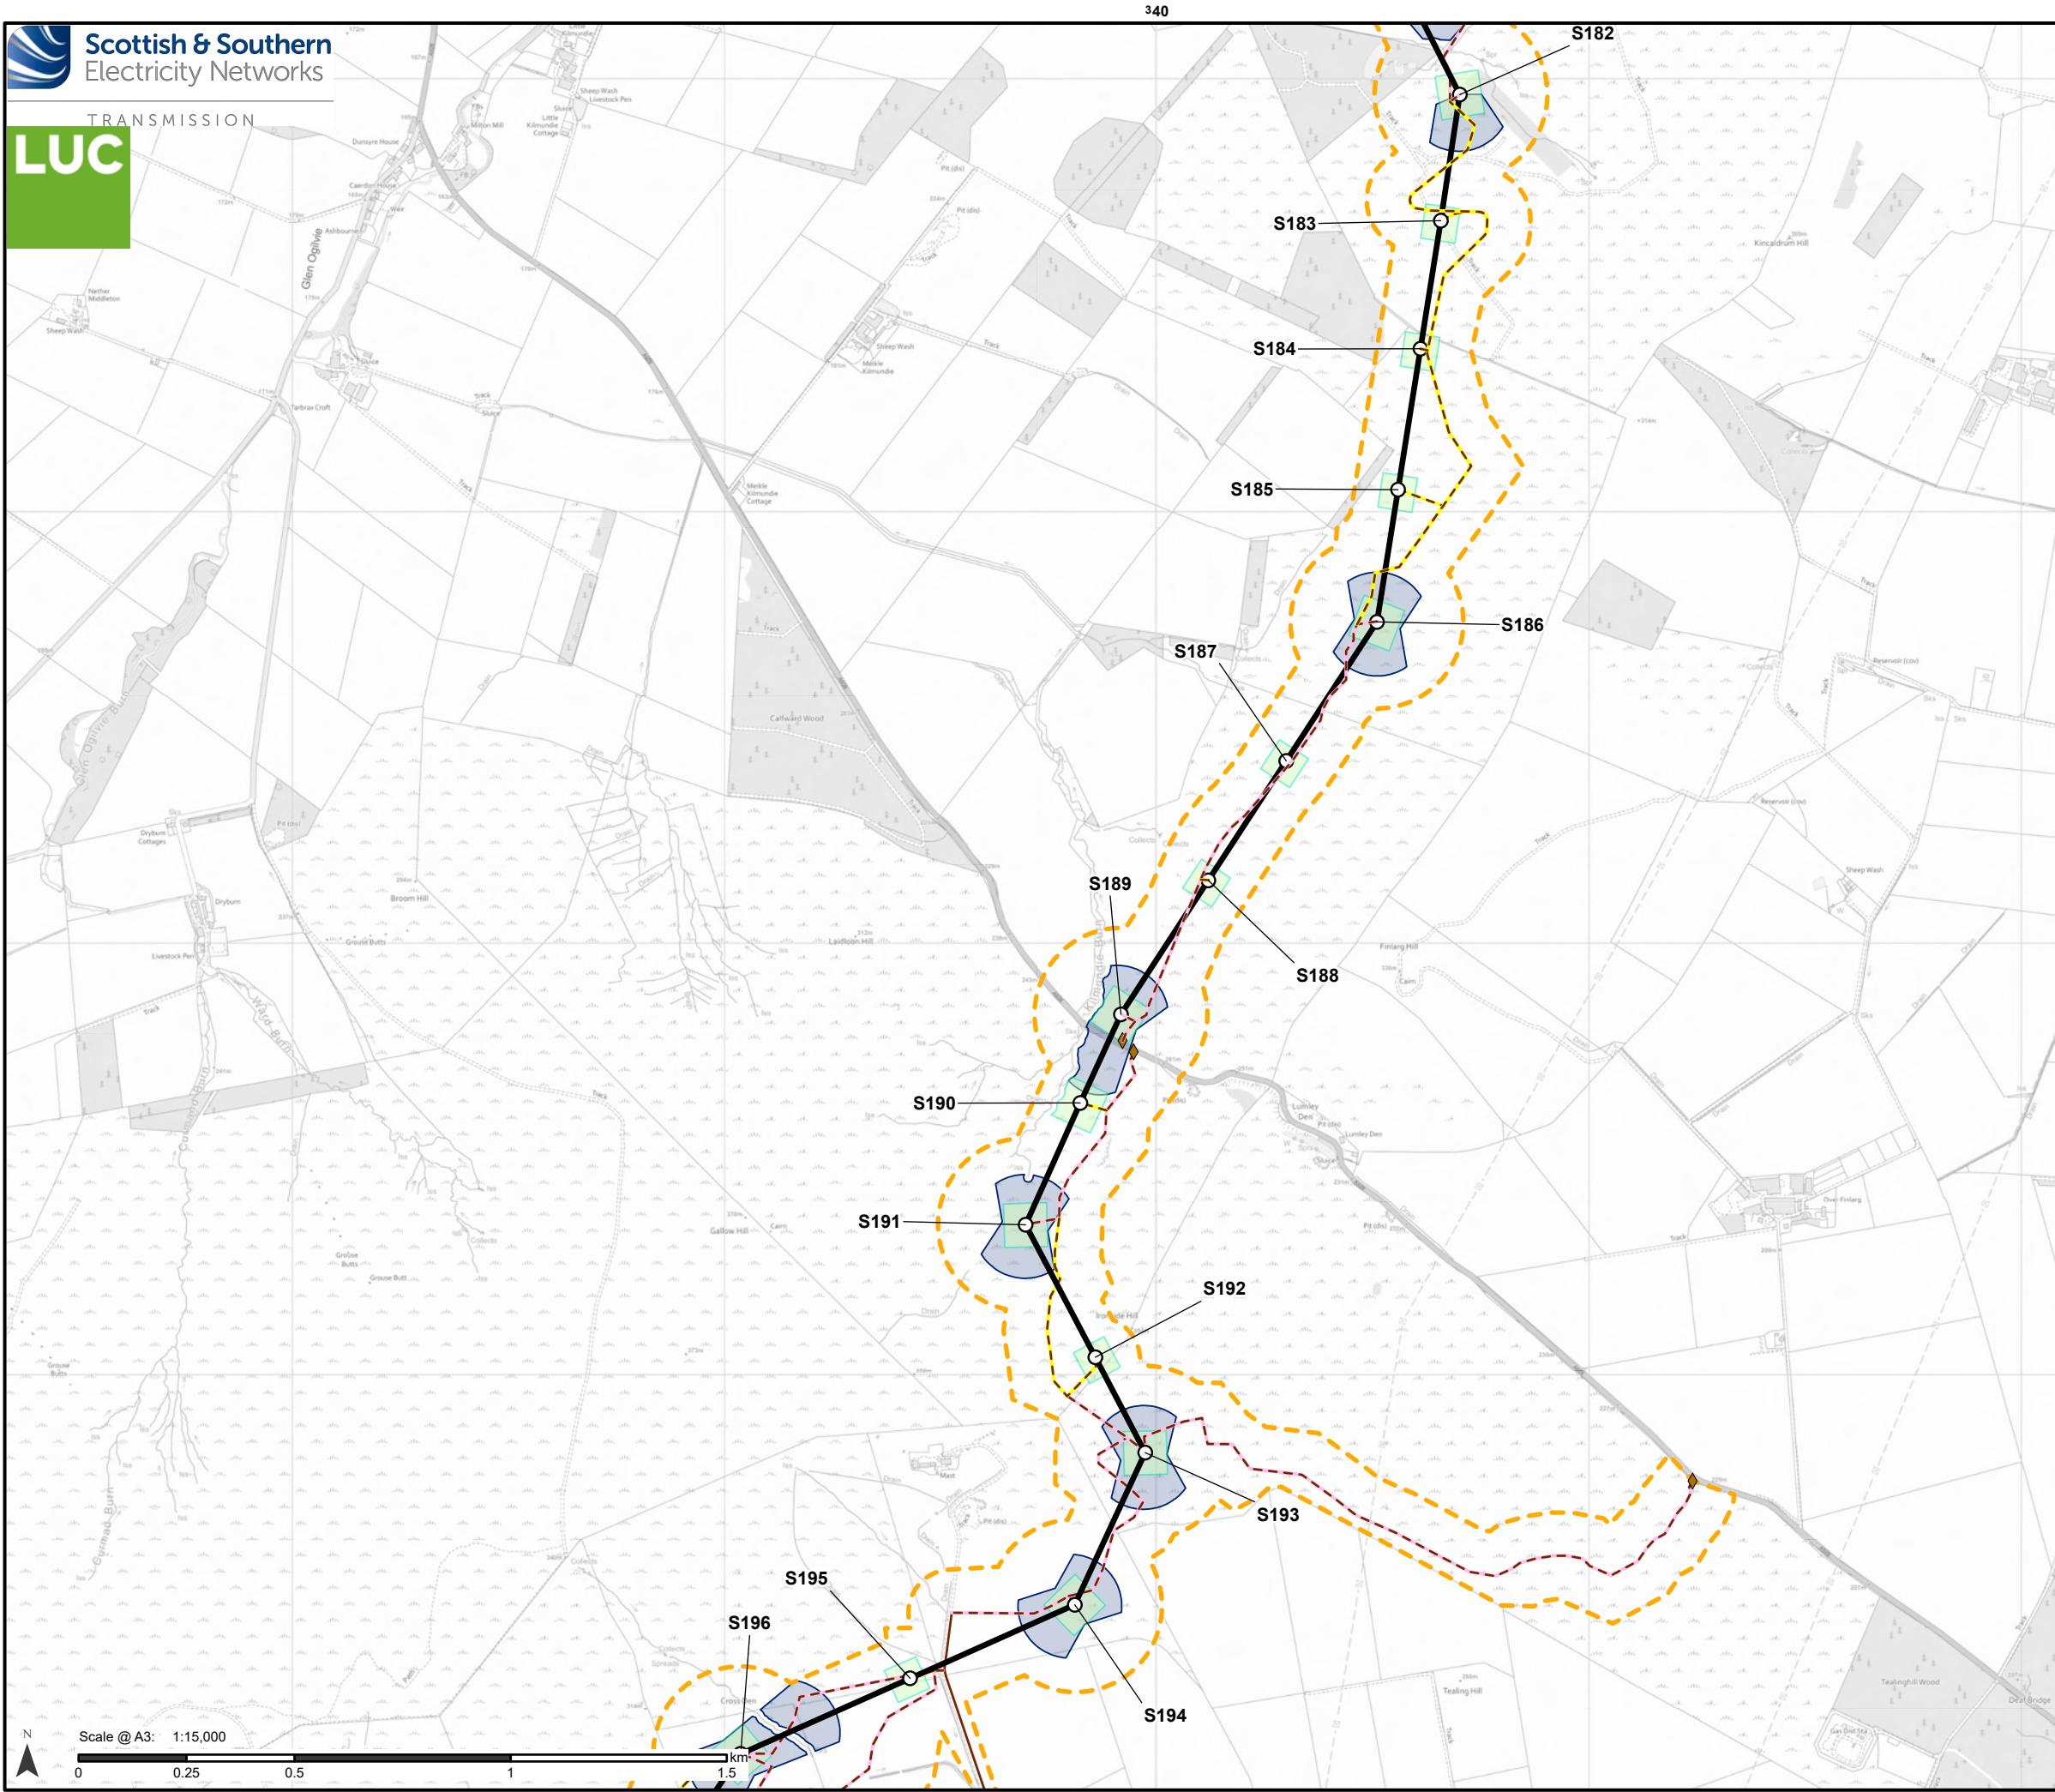

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

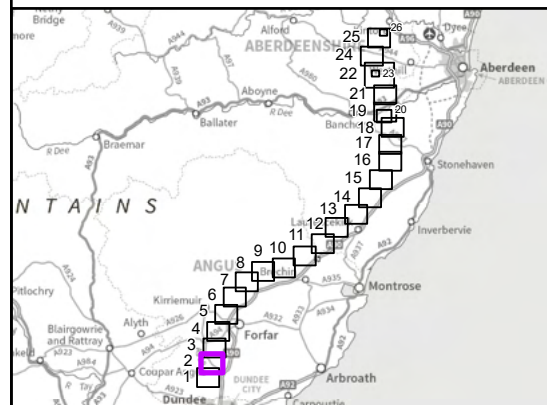


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 2


Drawn by: MS
Date: 13/08/2025

Drawing: 3.1.2

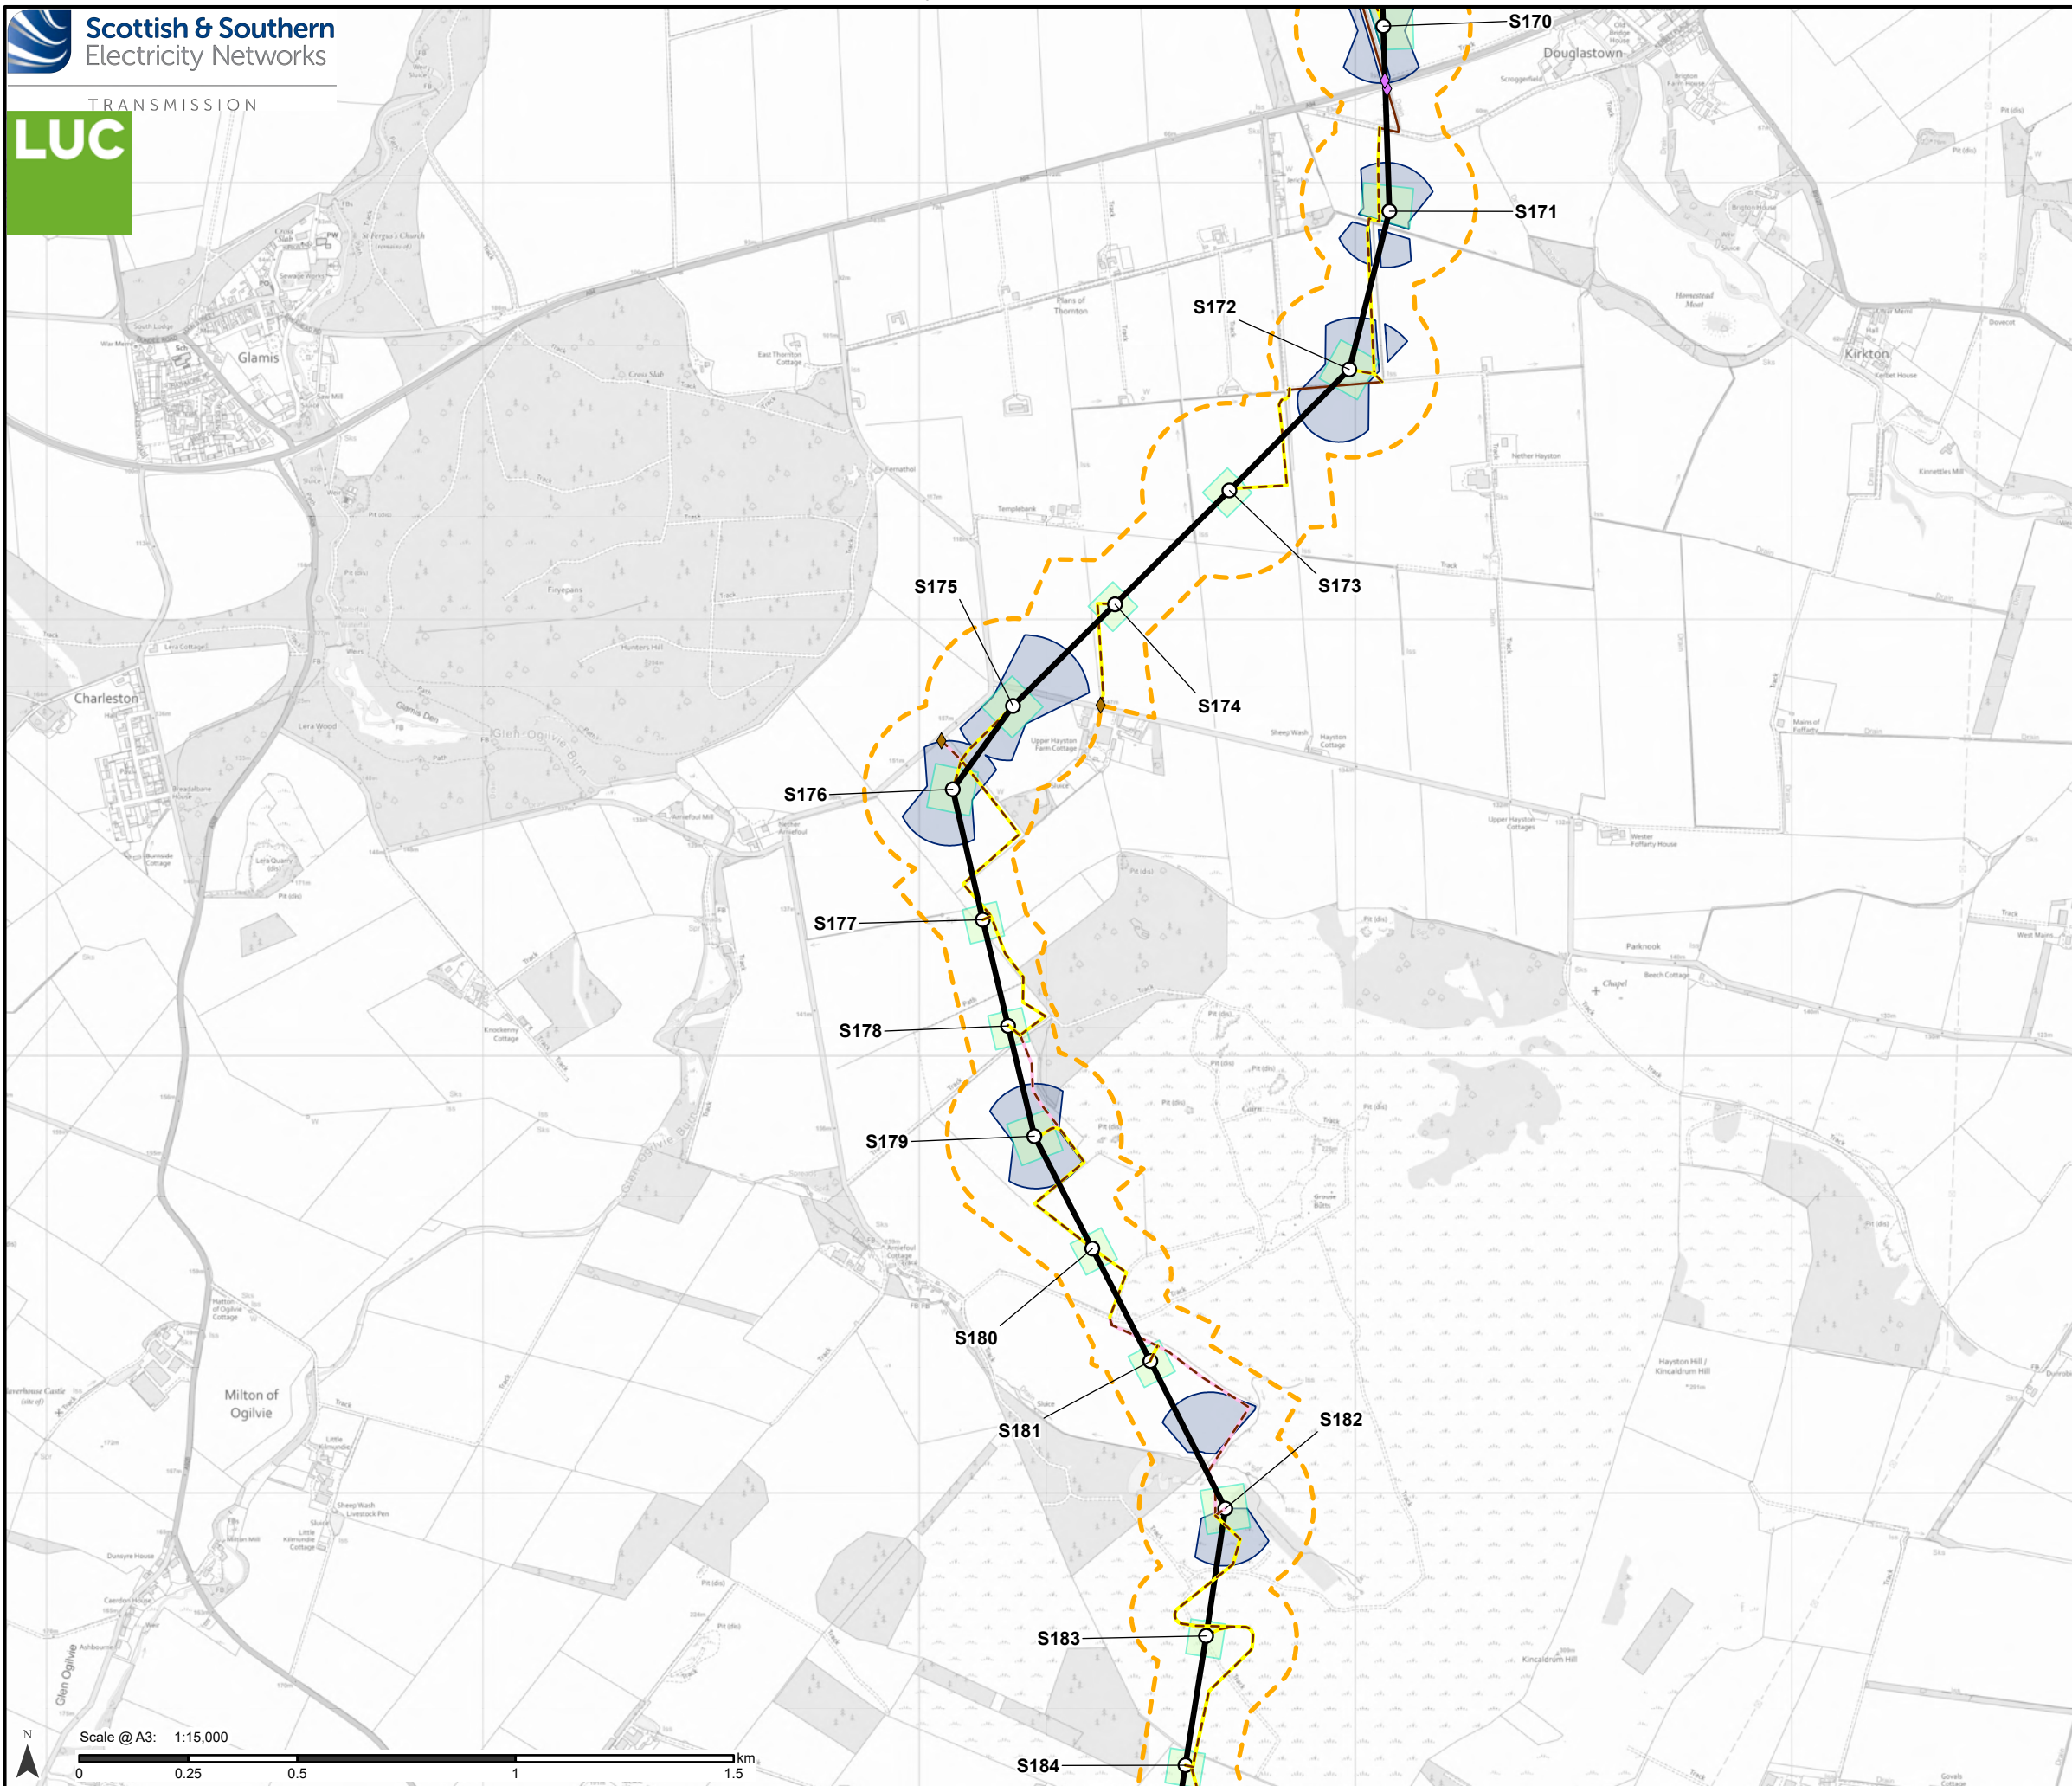

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

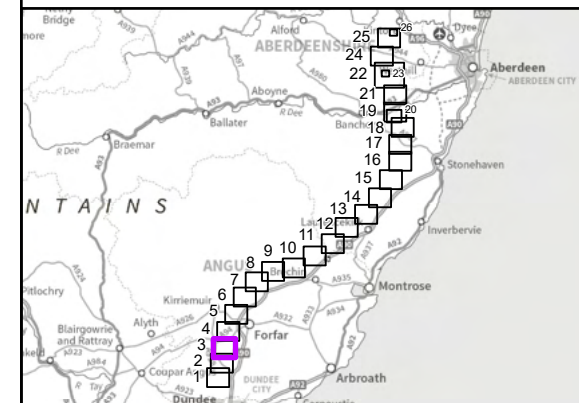


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 3
Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.3



- Note: Refer to Figure 3.3 for Overview of the LOD Variations/
Restrictions

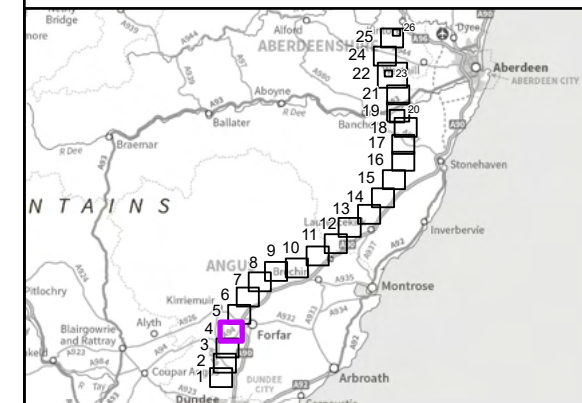


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
**! Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent
(Electricity Act, 1989) is sought - Page 4


Drawn by: MS Date: 13/08/2025

Drawing: 3.1.4

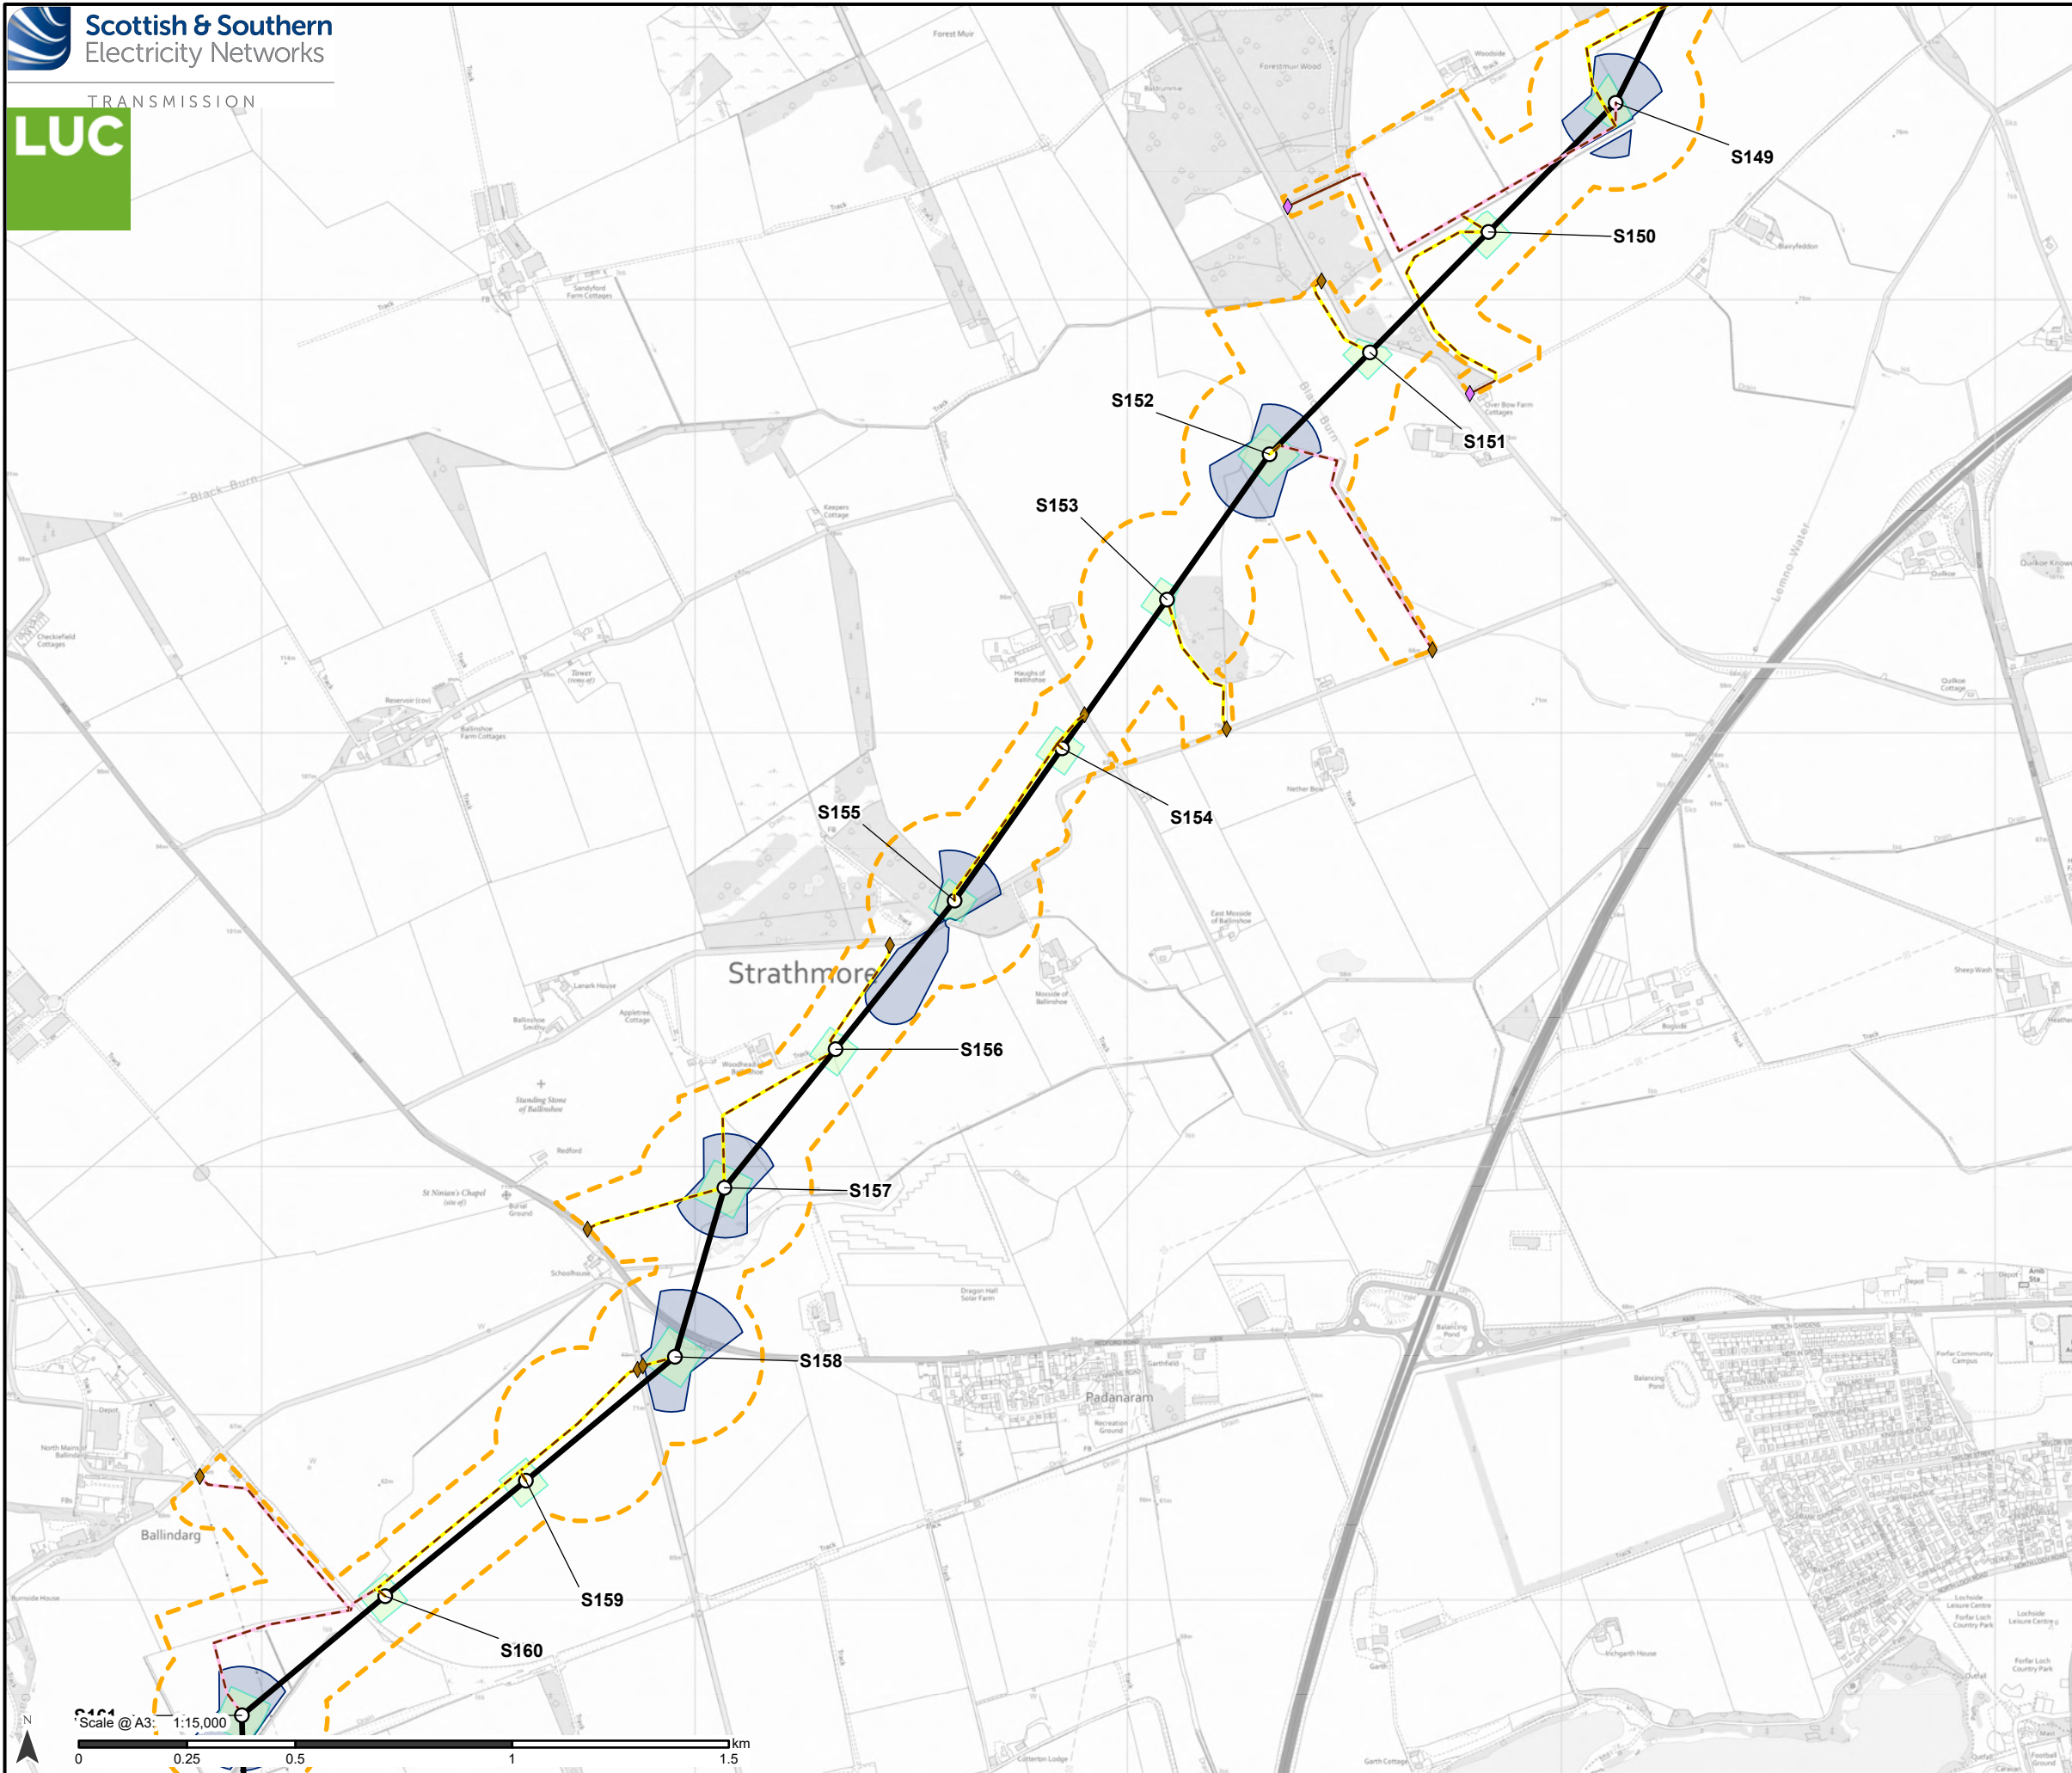

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

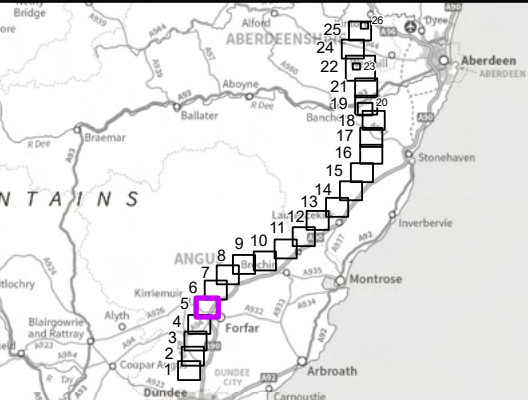


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line


Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 5

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.5

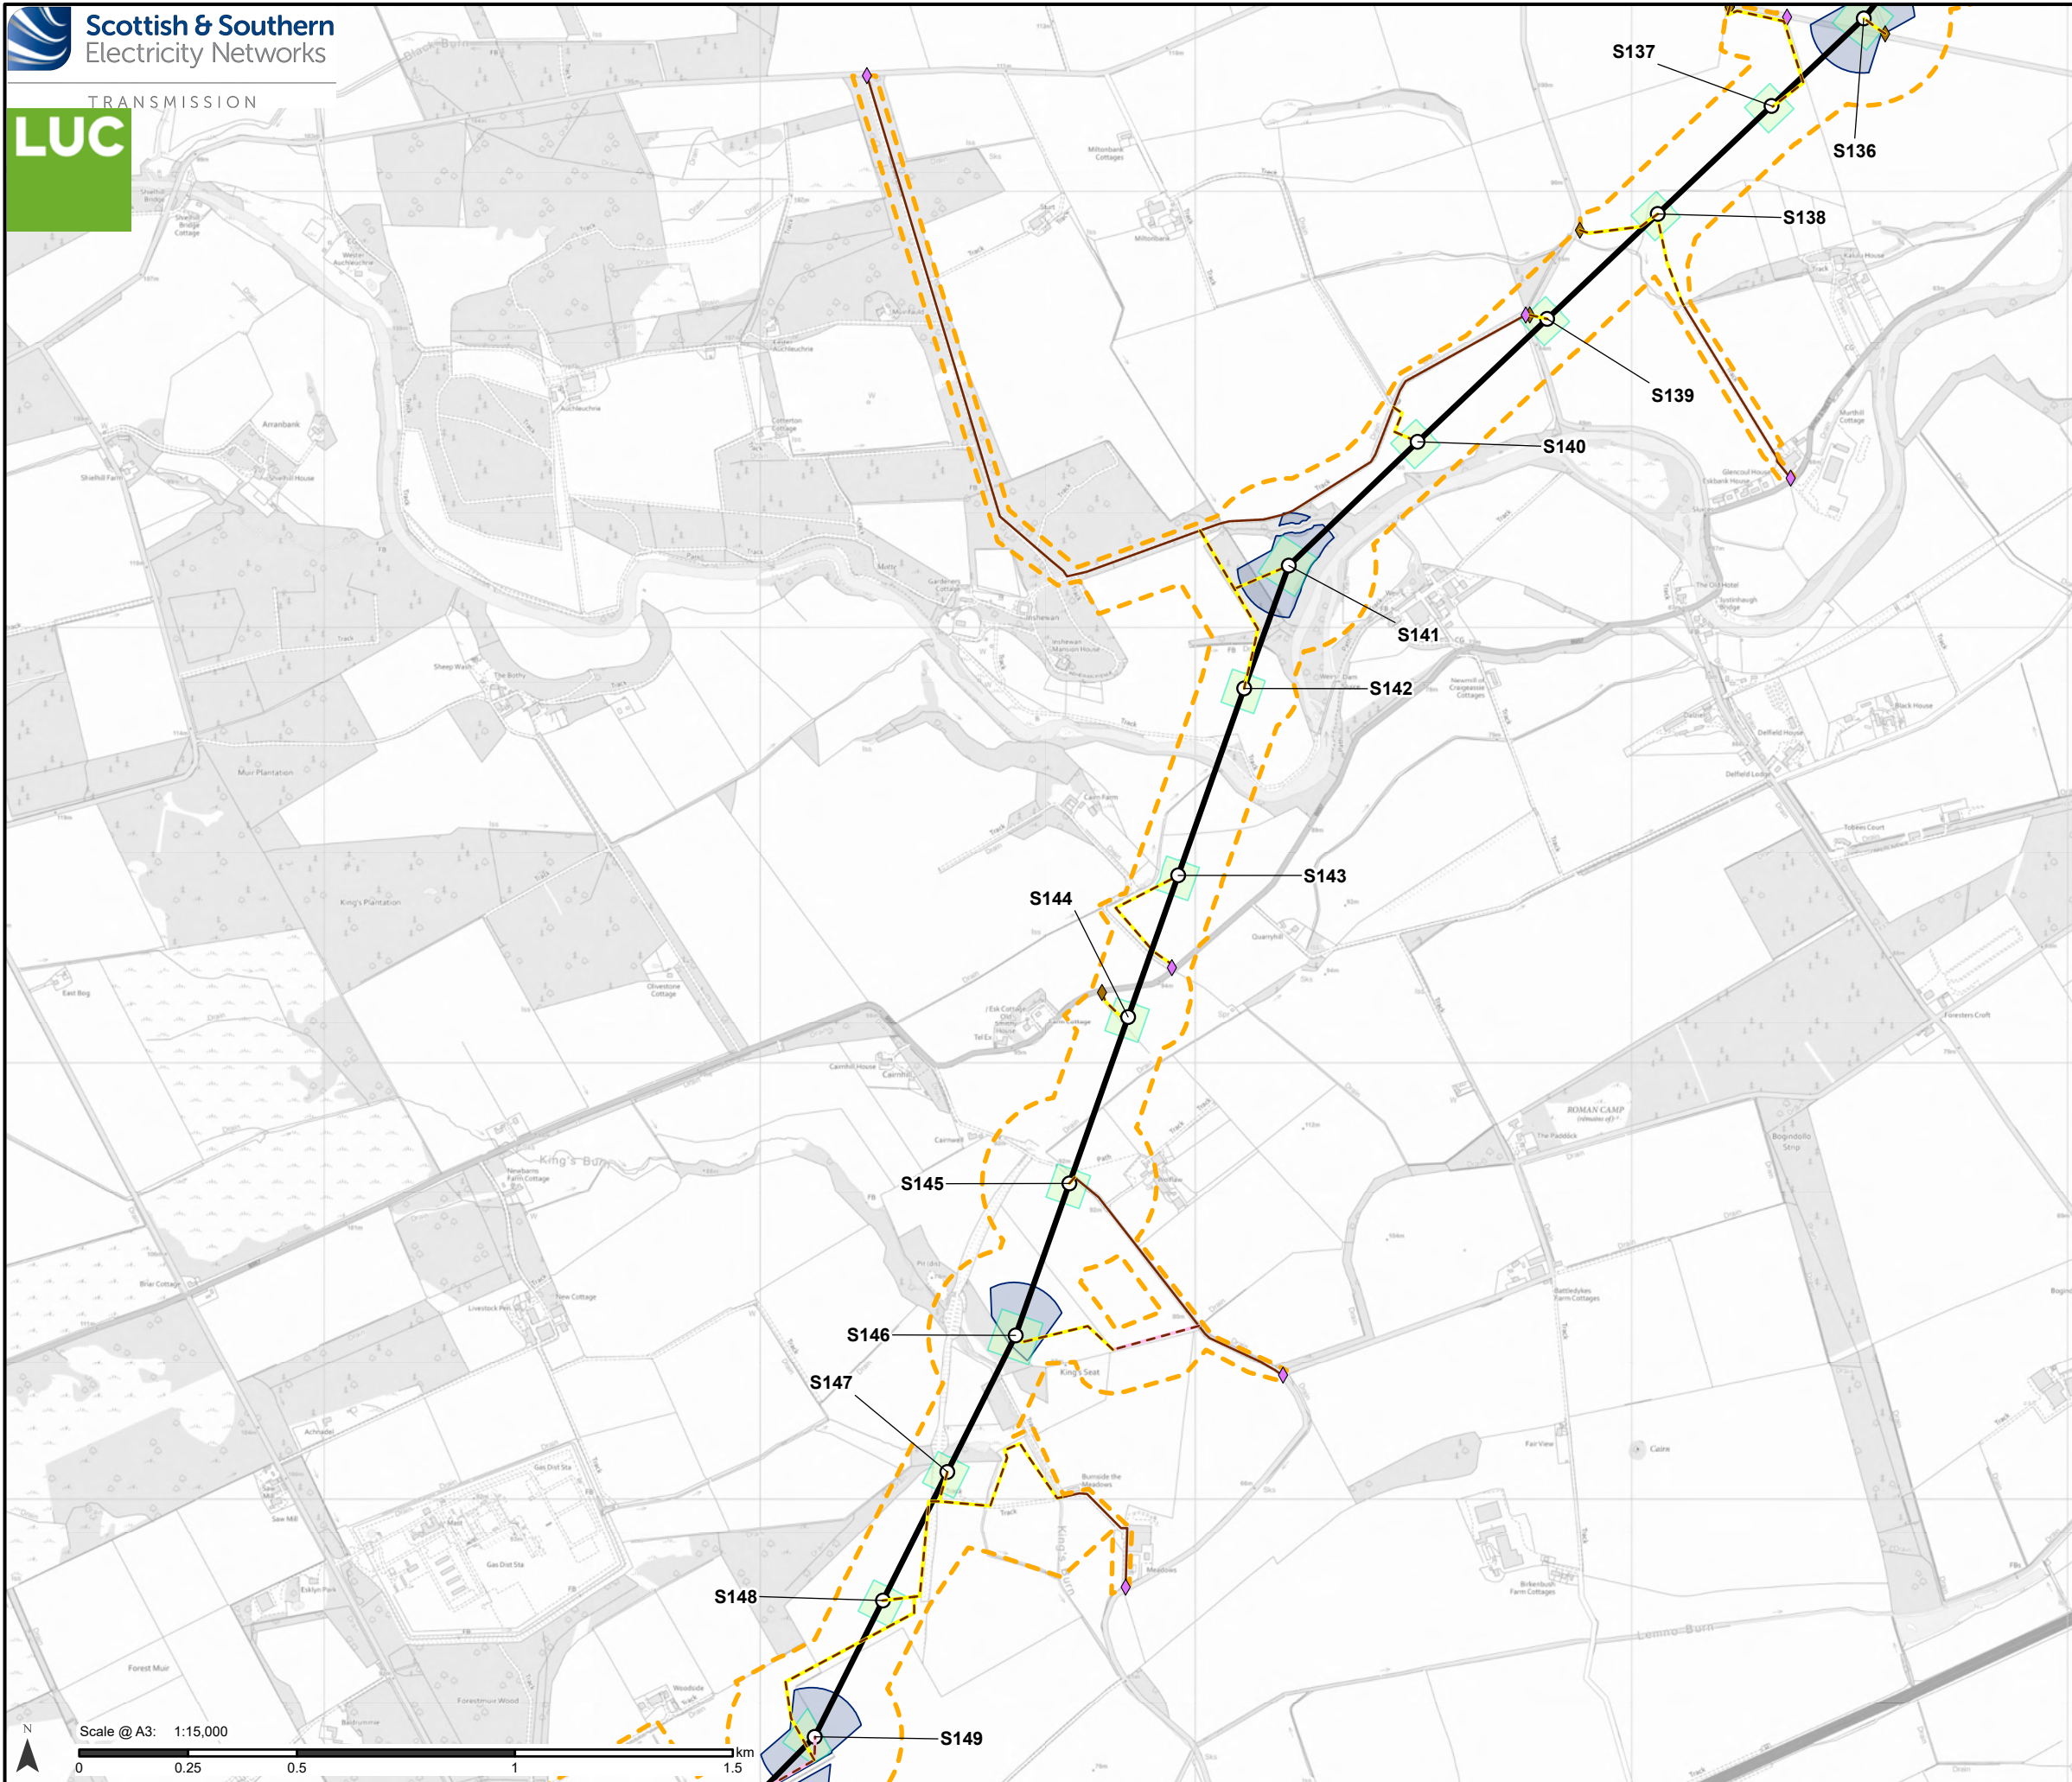

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

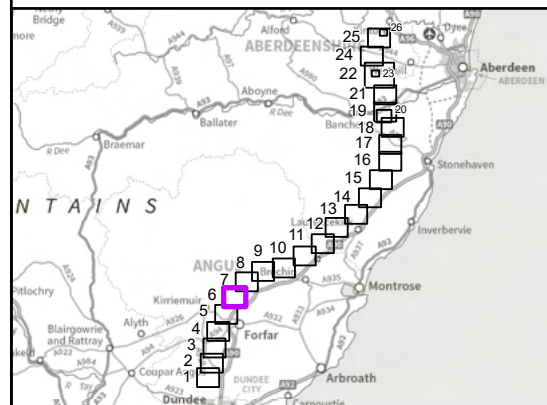


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line


Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 6

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.6

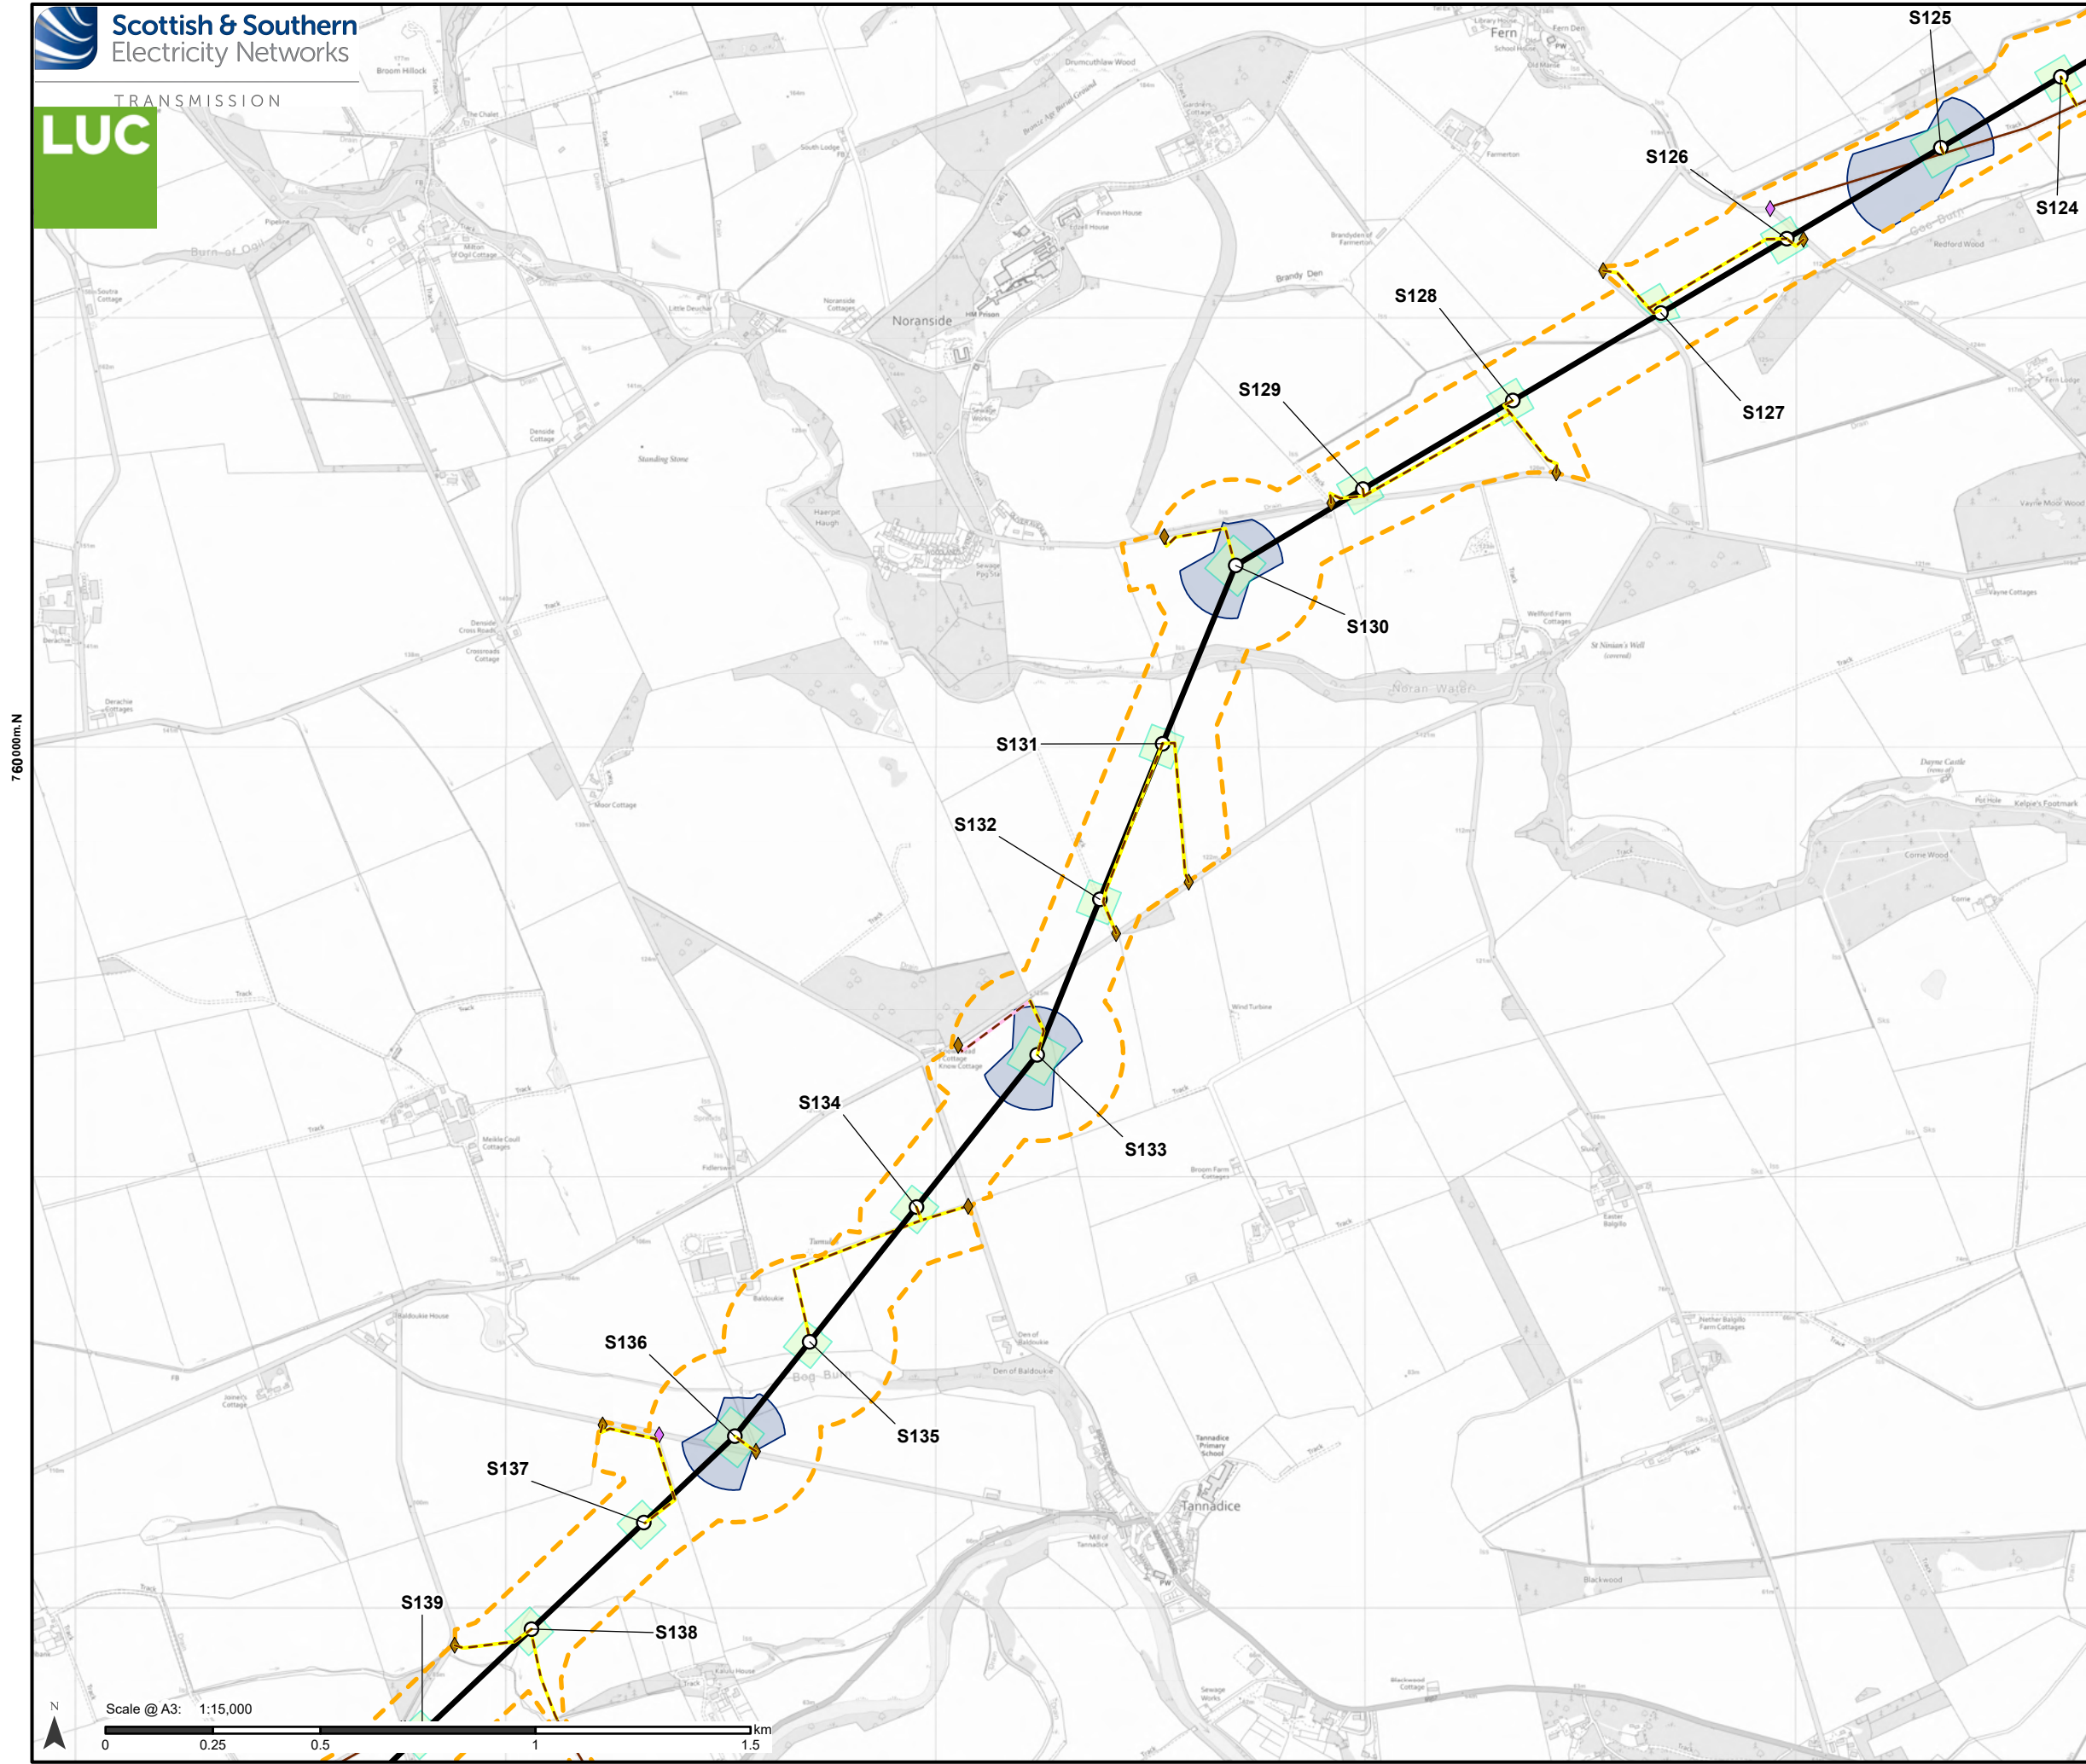

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

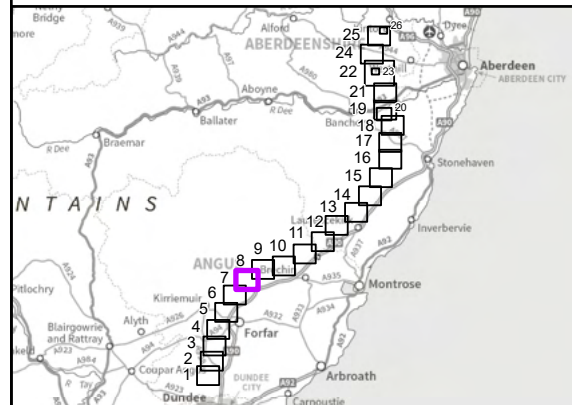


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 7


Drawn by: MS
Date: 13/08/2025

Drawing: 3.1.7

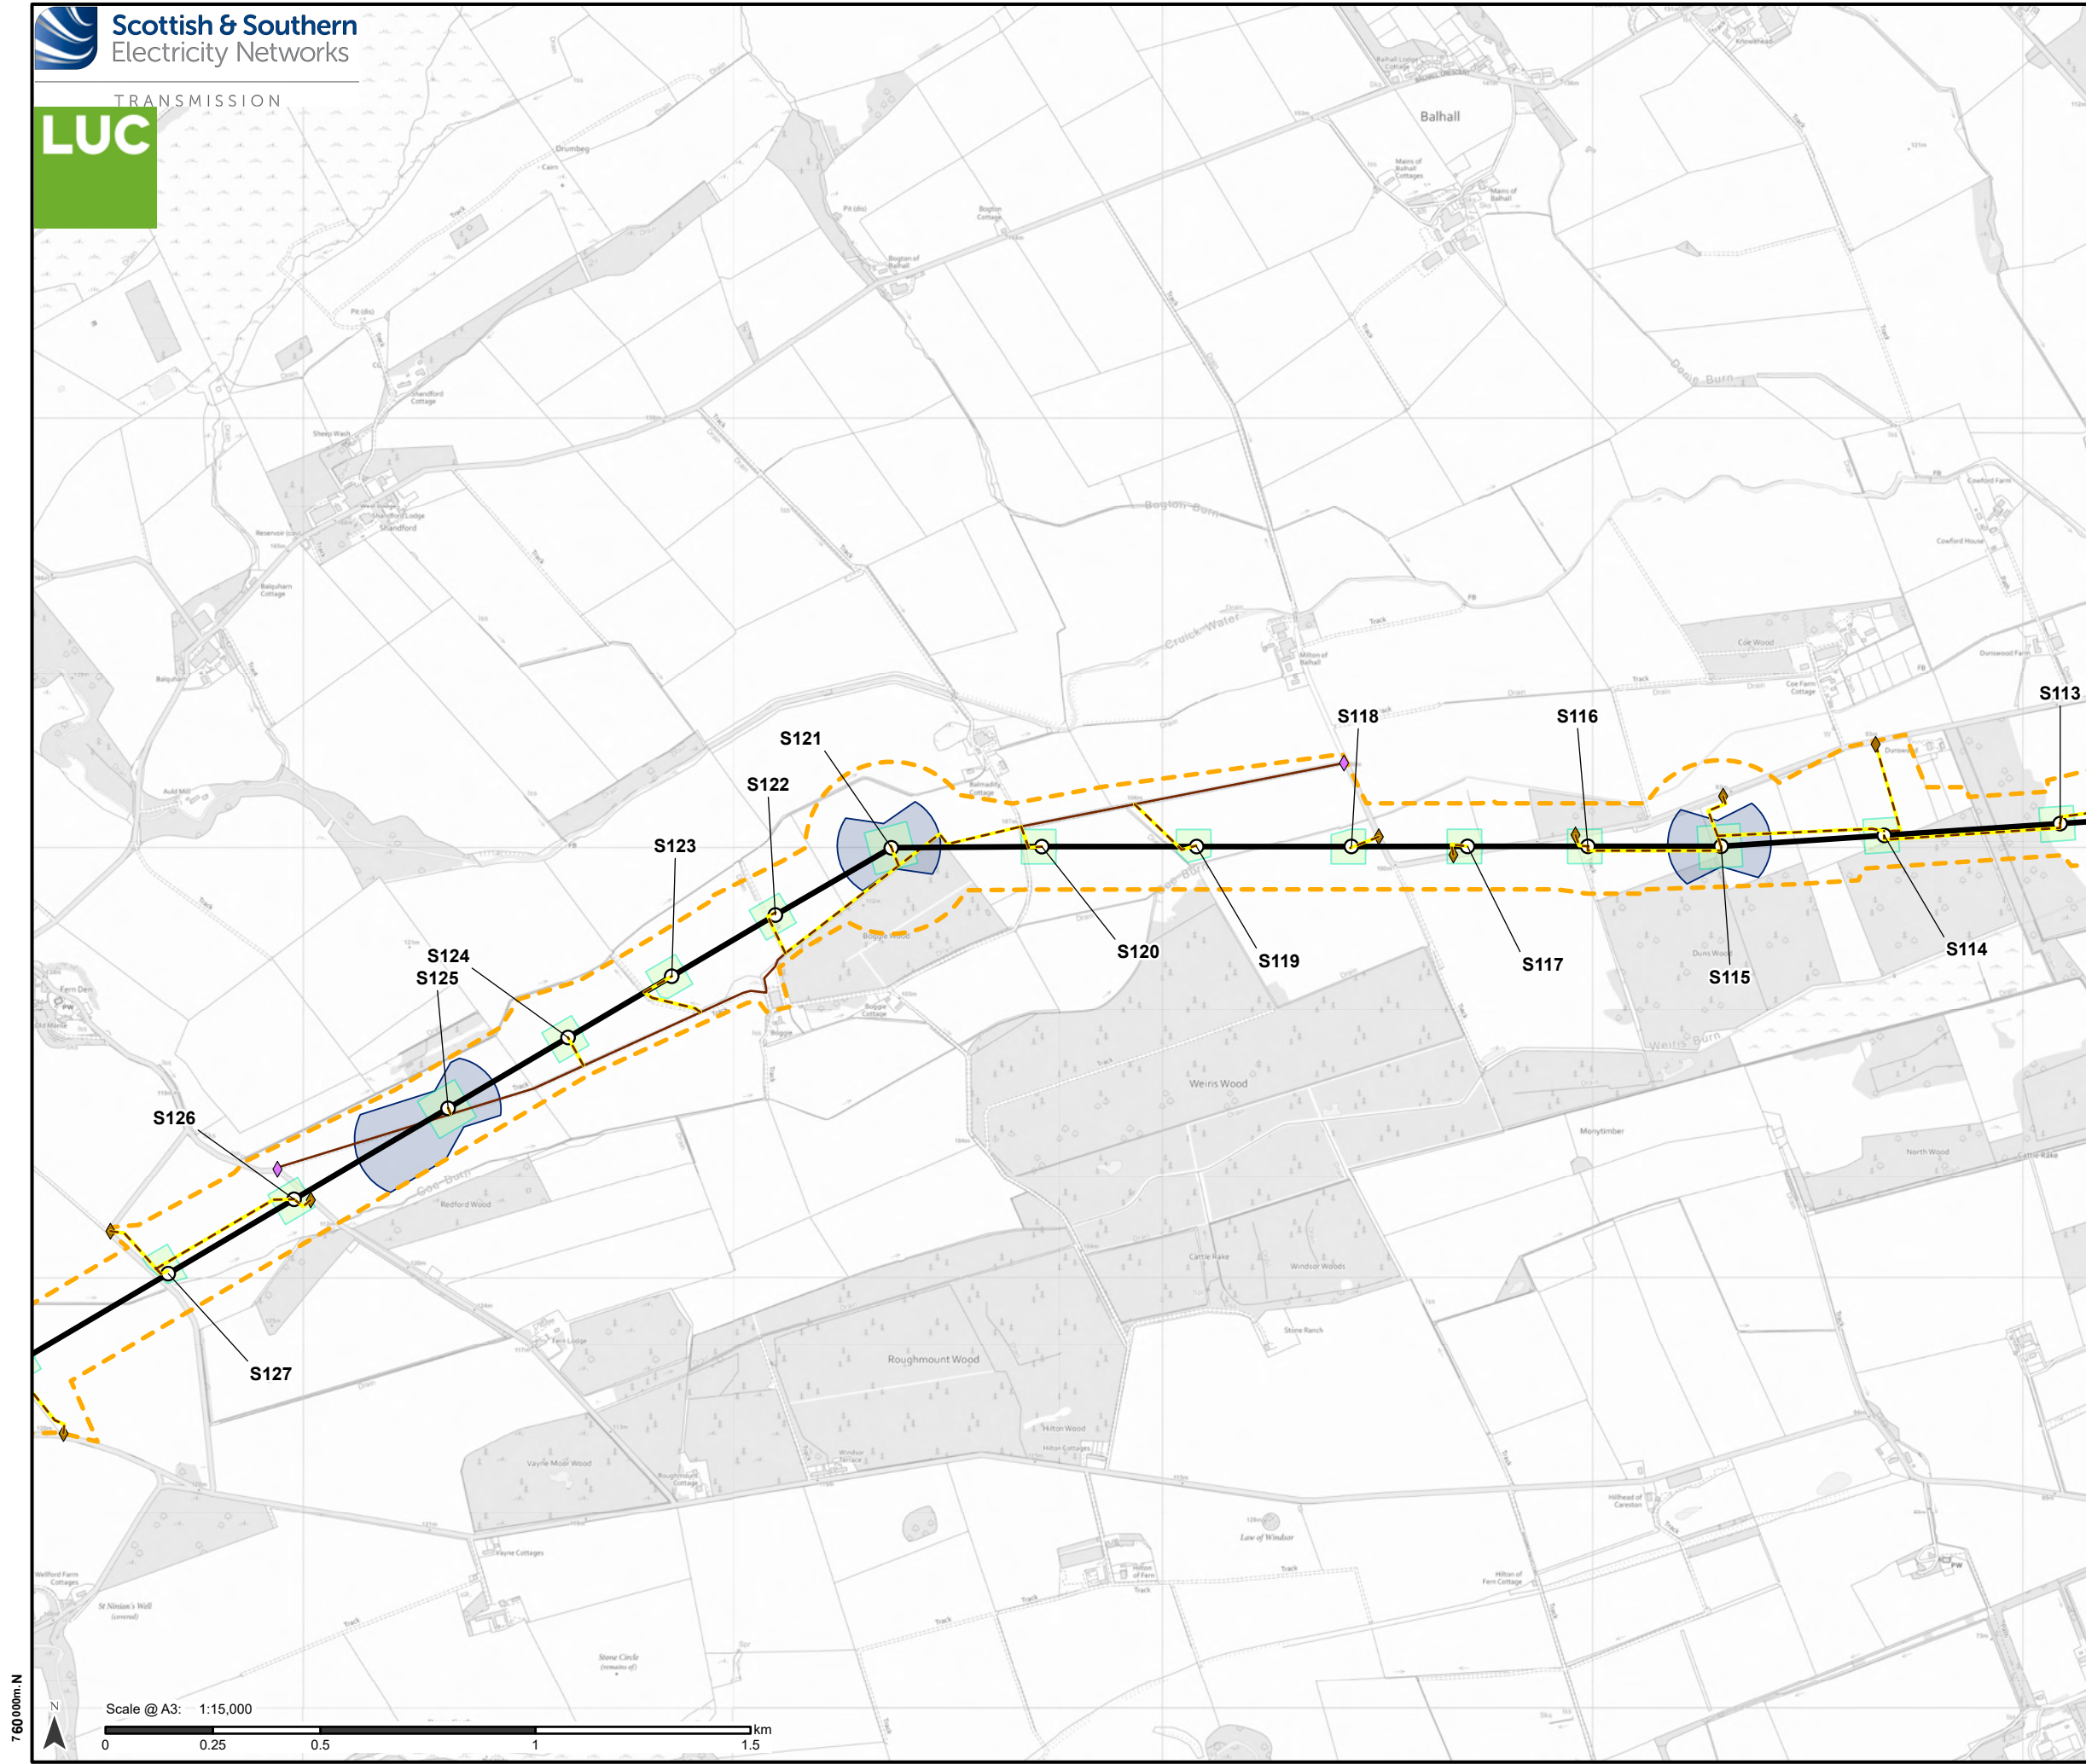


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

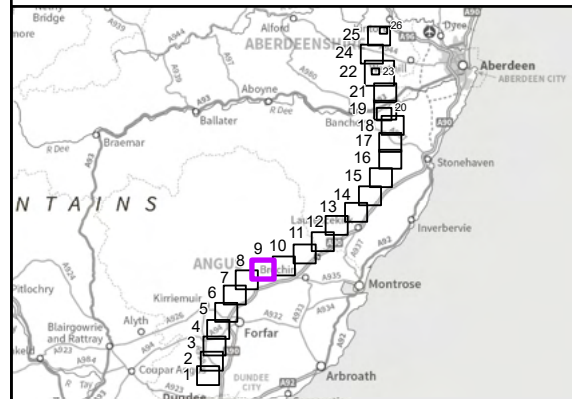


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line
Title:	Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 8
Drawn by:	MS
Date:	13/08/2025
Drawing:	3.1.8

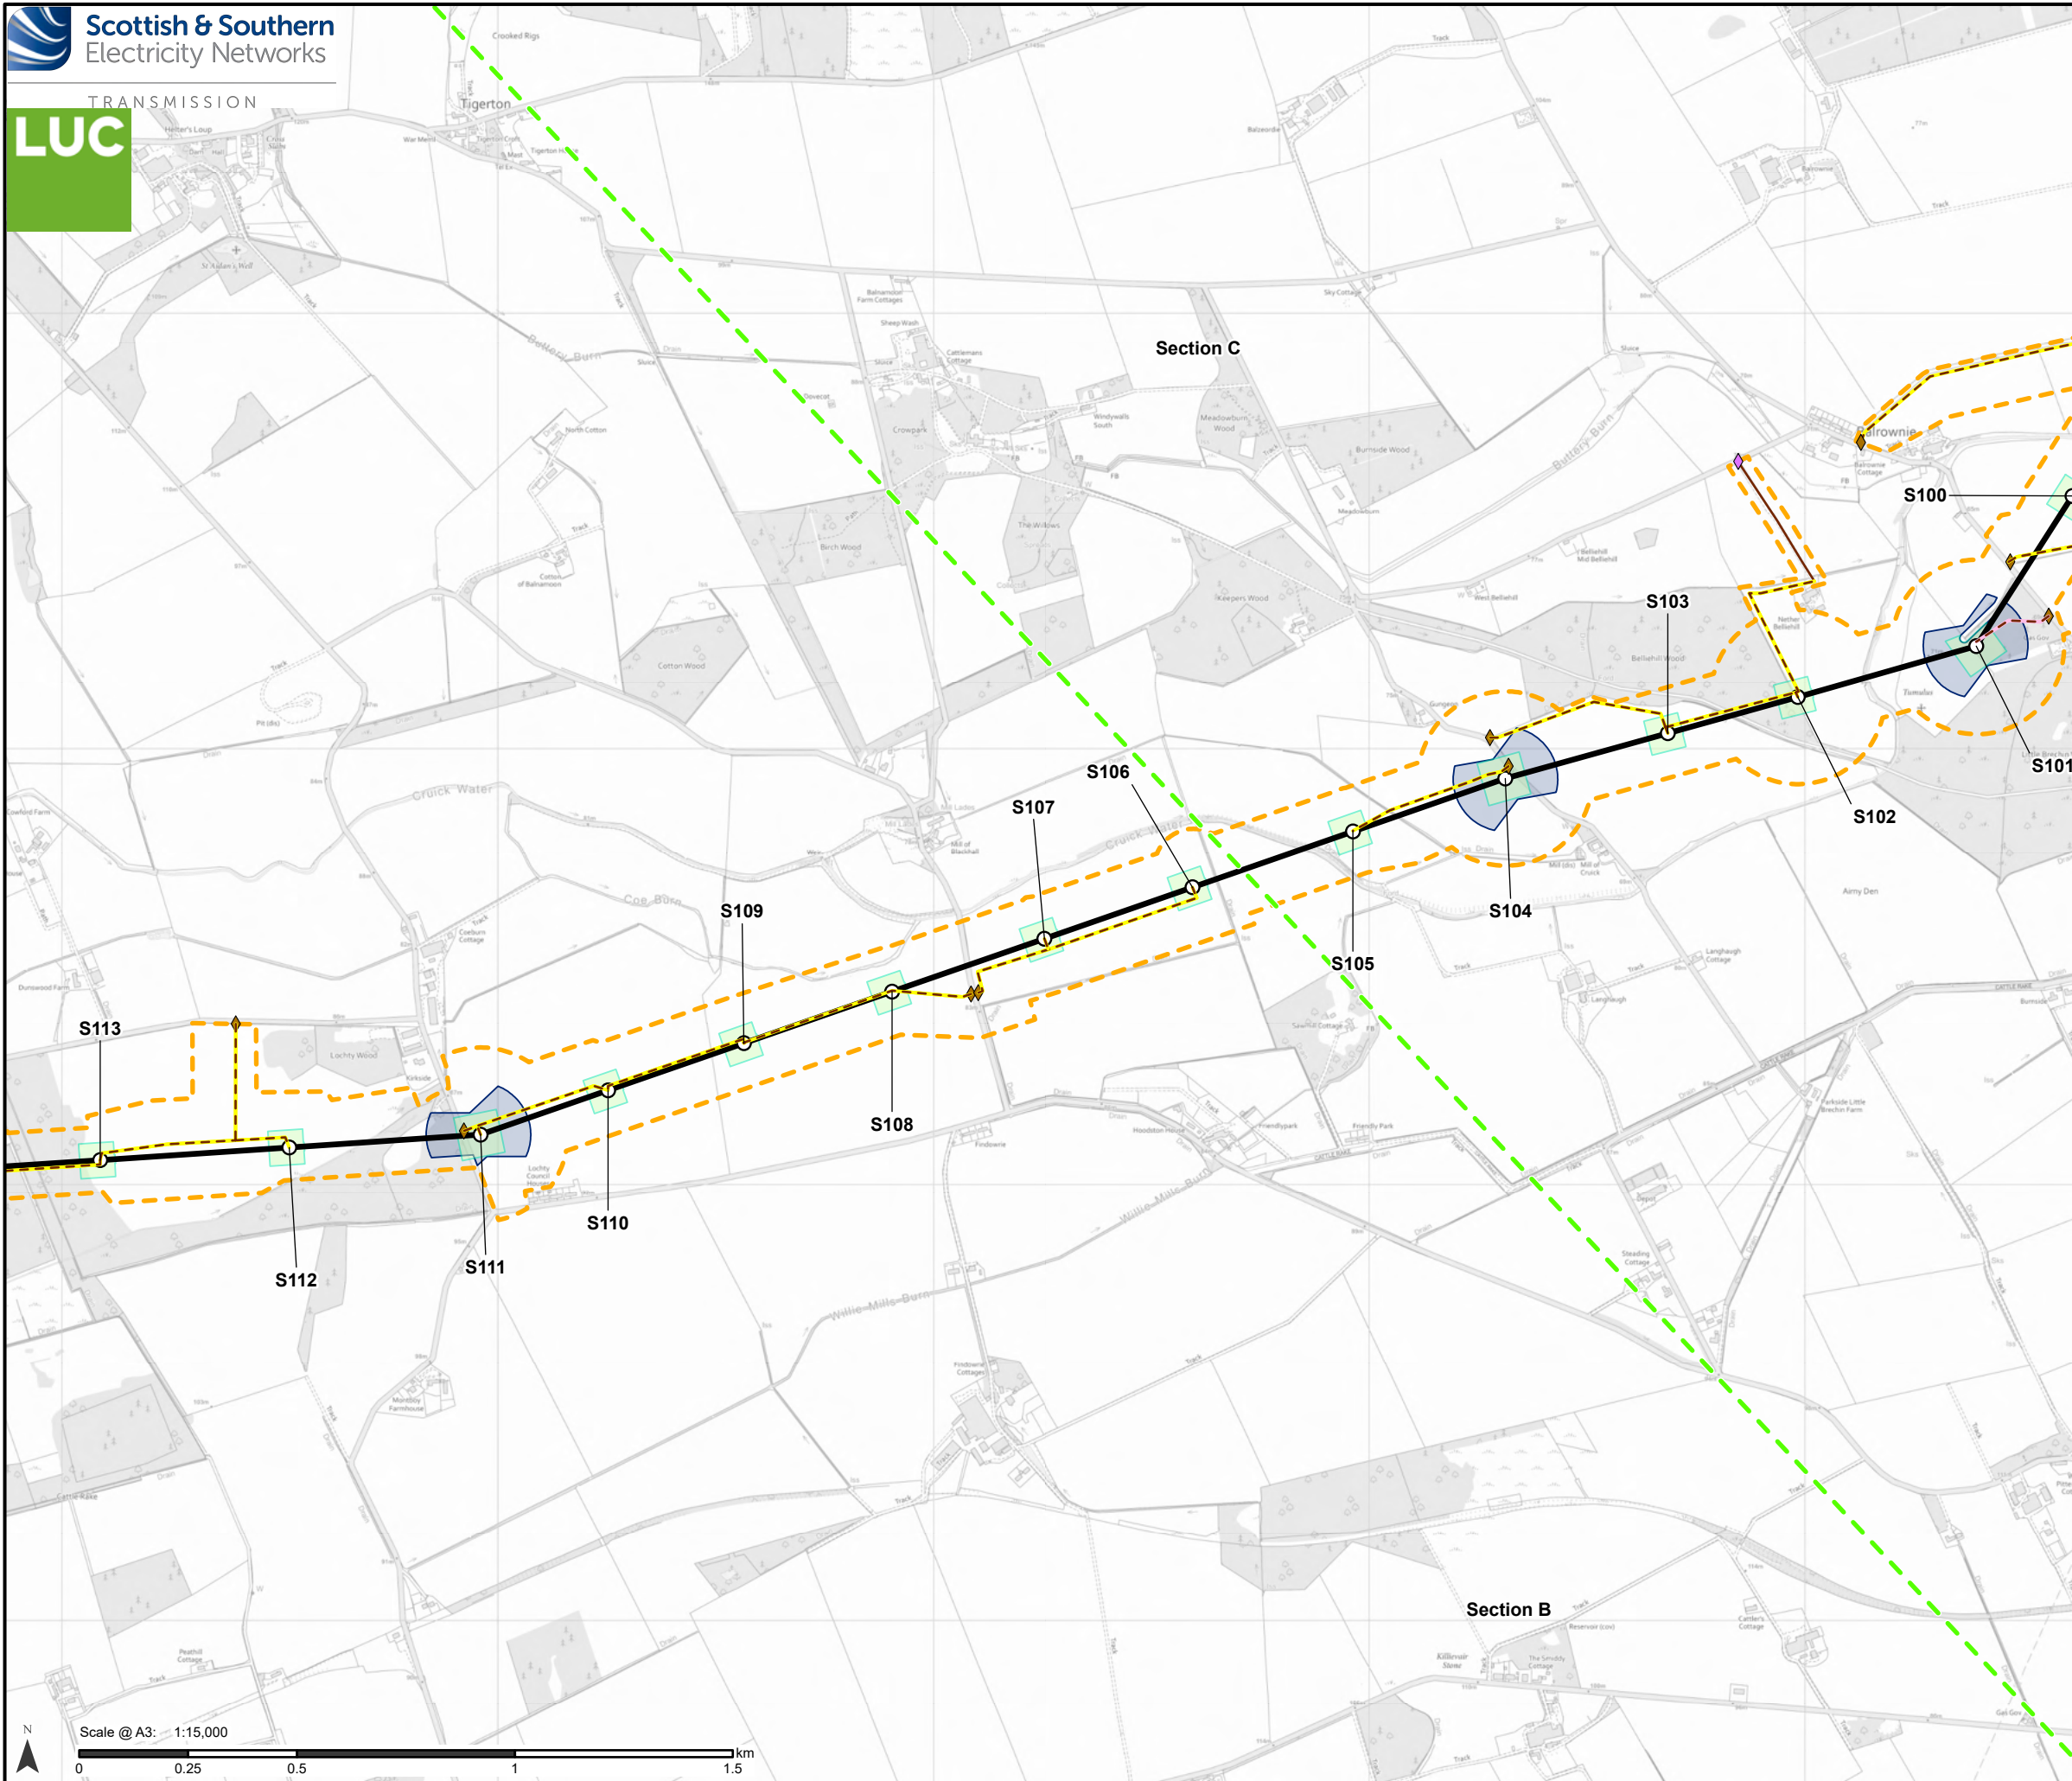

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
 - Section boundary
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

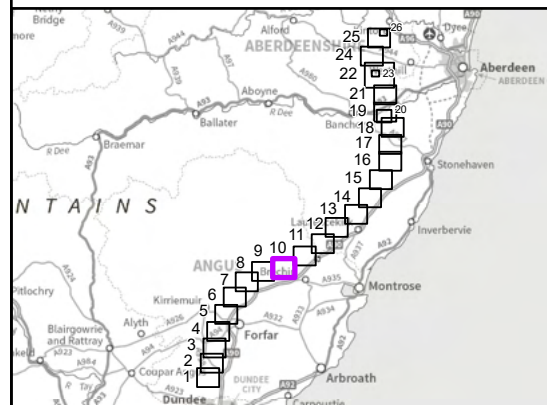


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 9


Drawn by: MS
Date: 13/08/2025

Drawing: 3.1.9

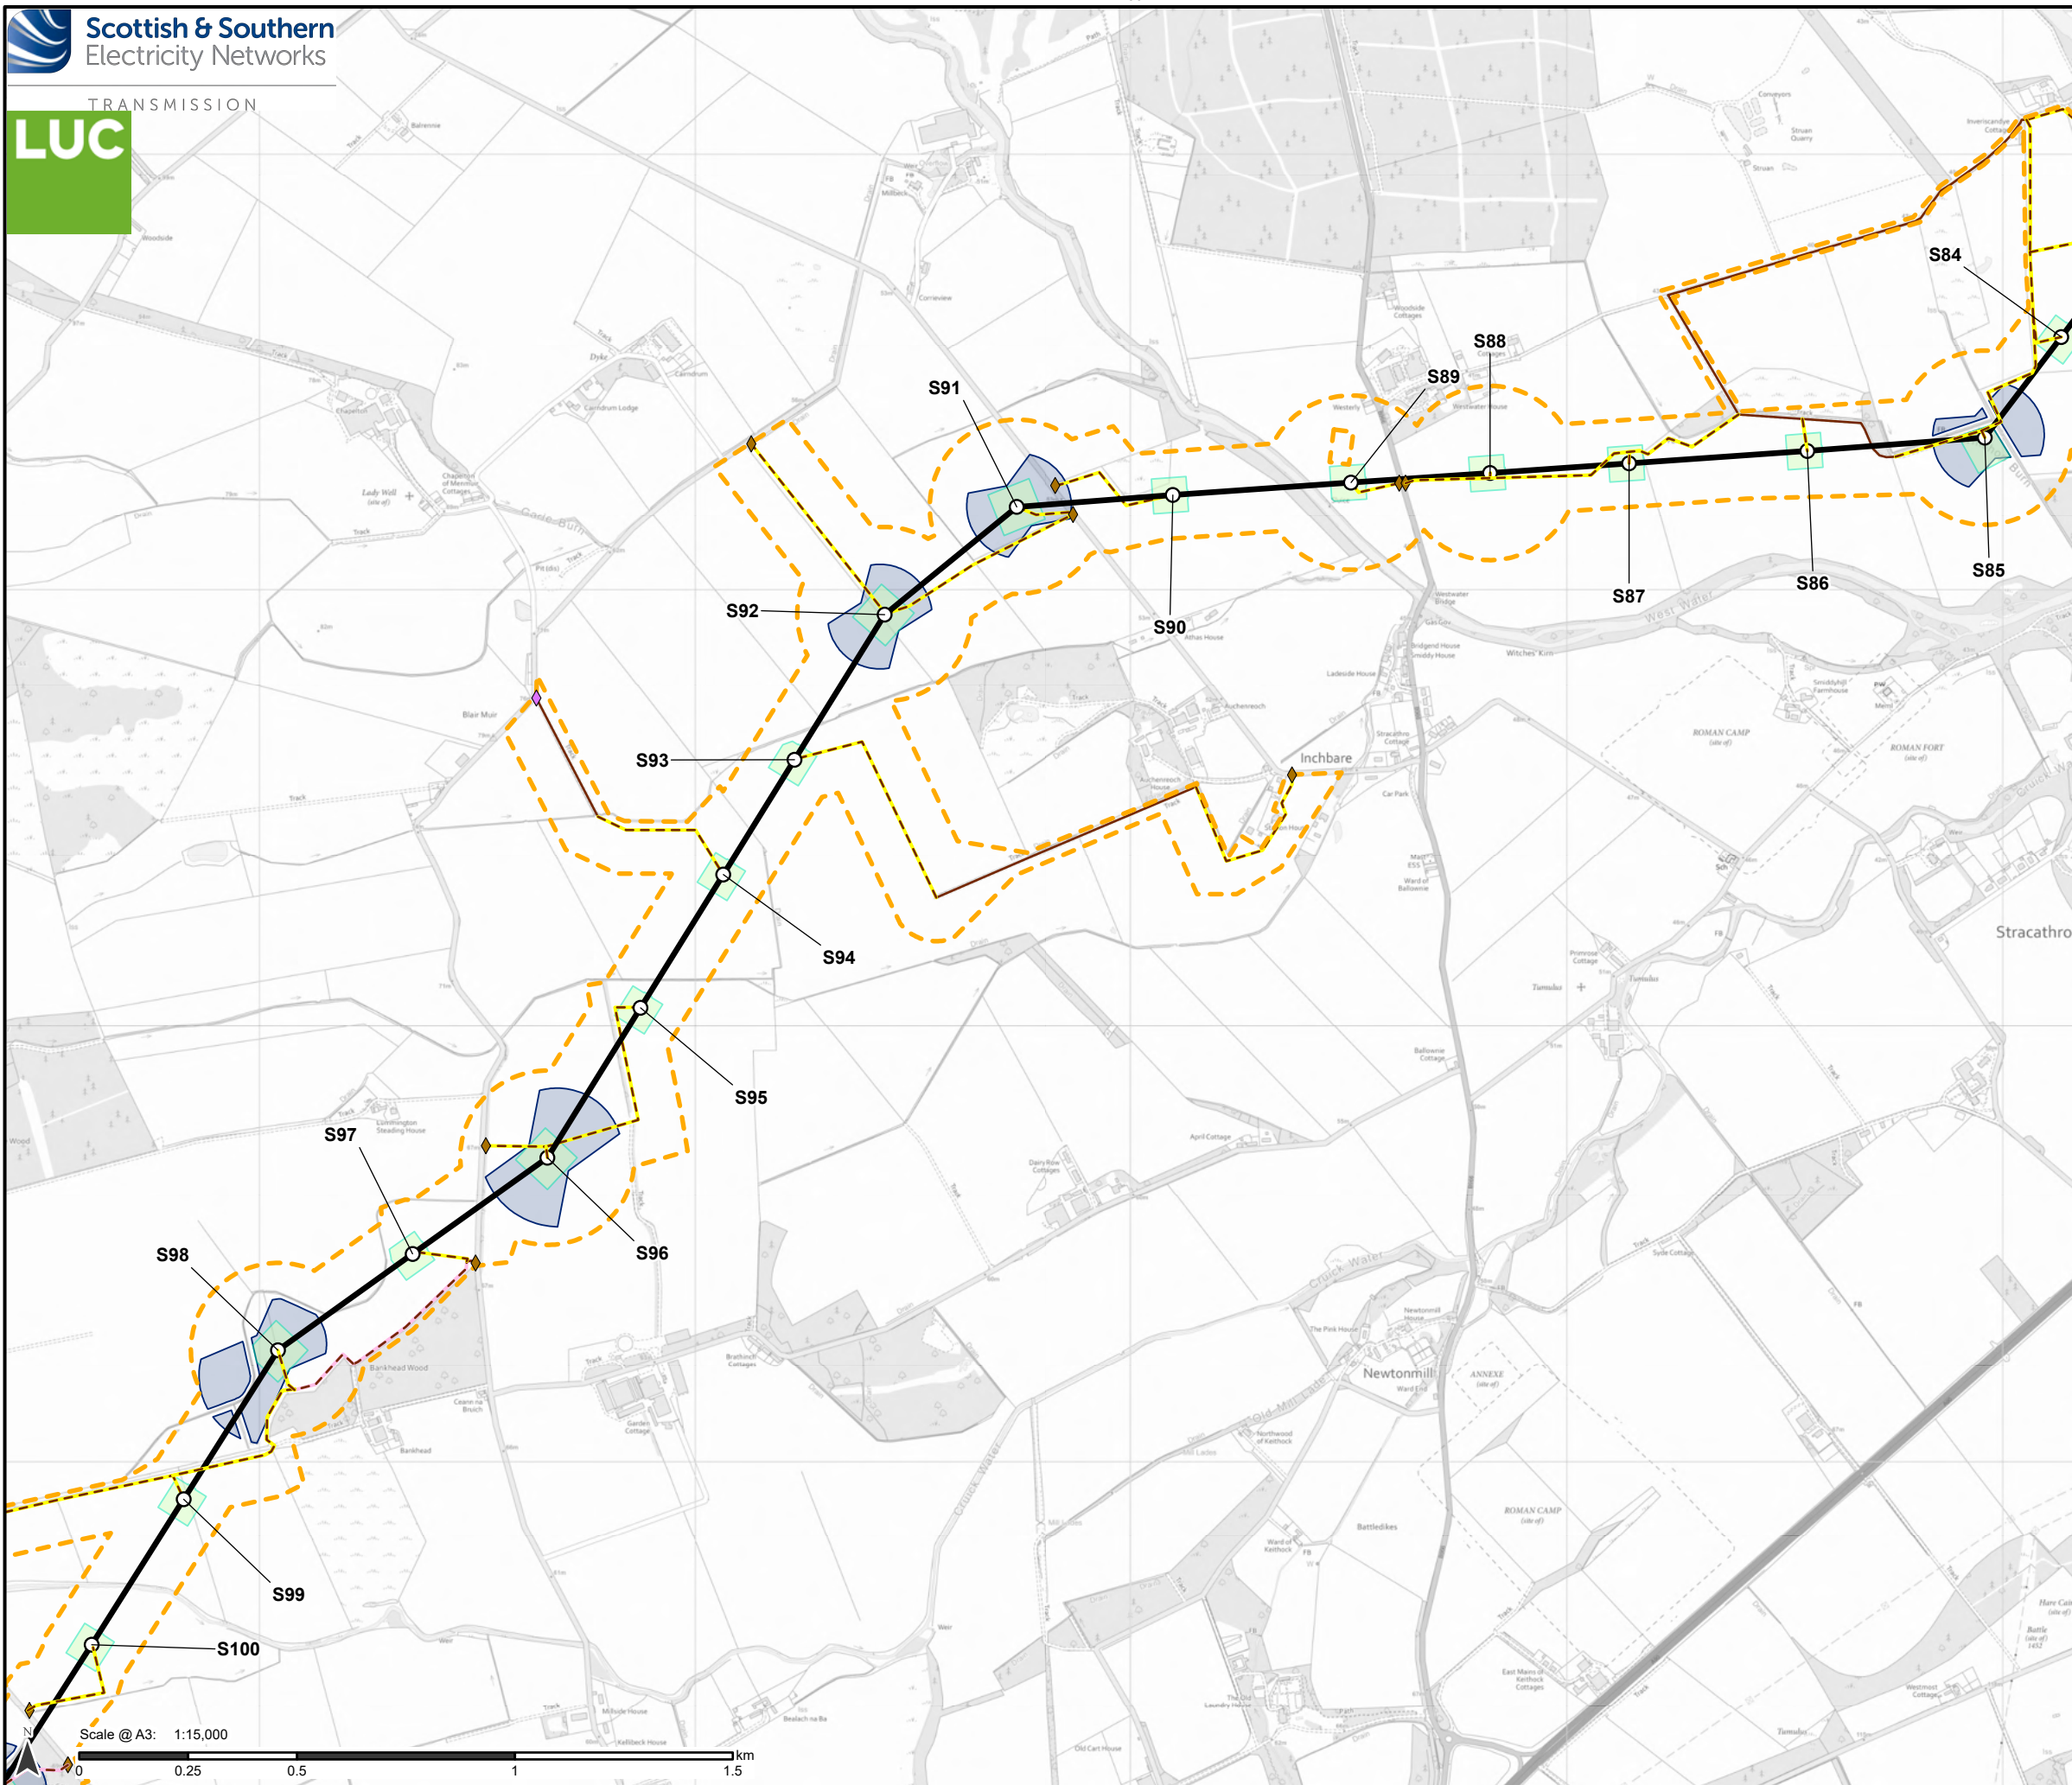

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

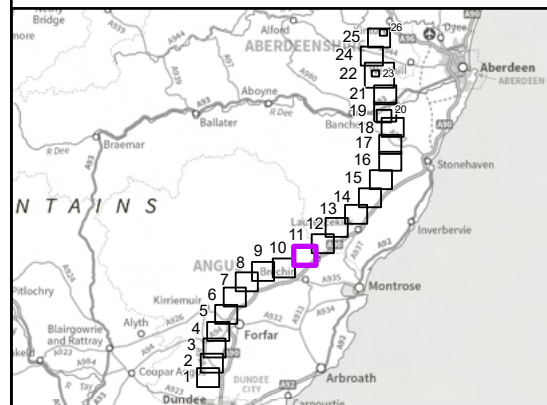


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line


Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 10

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.10

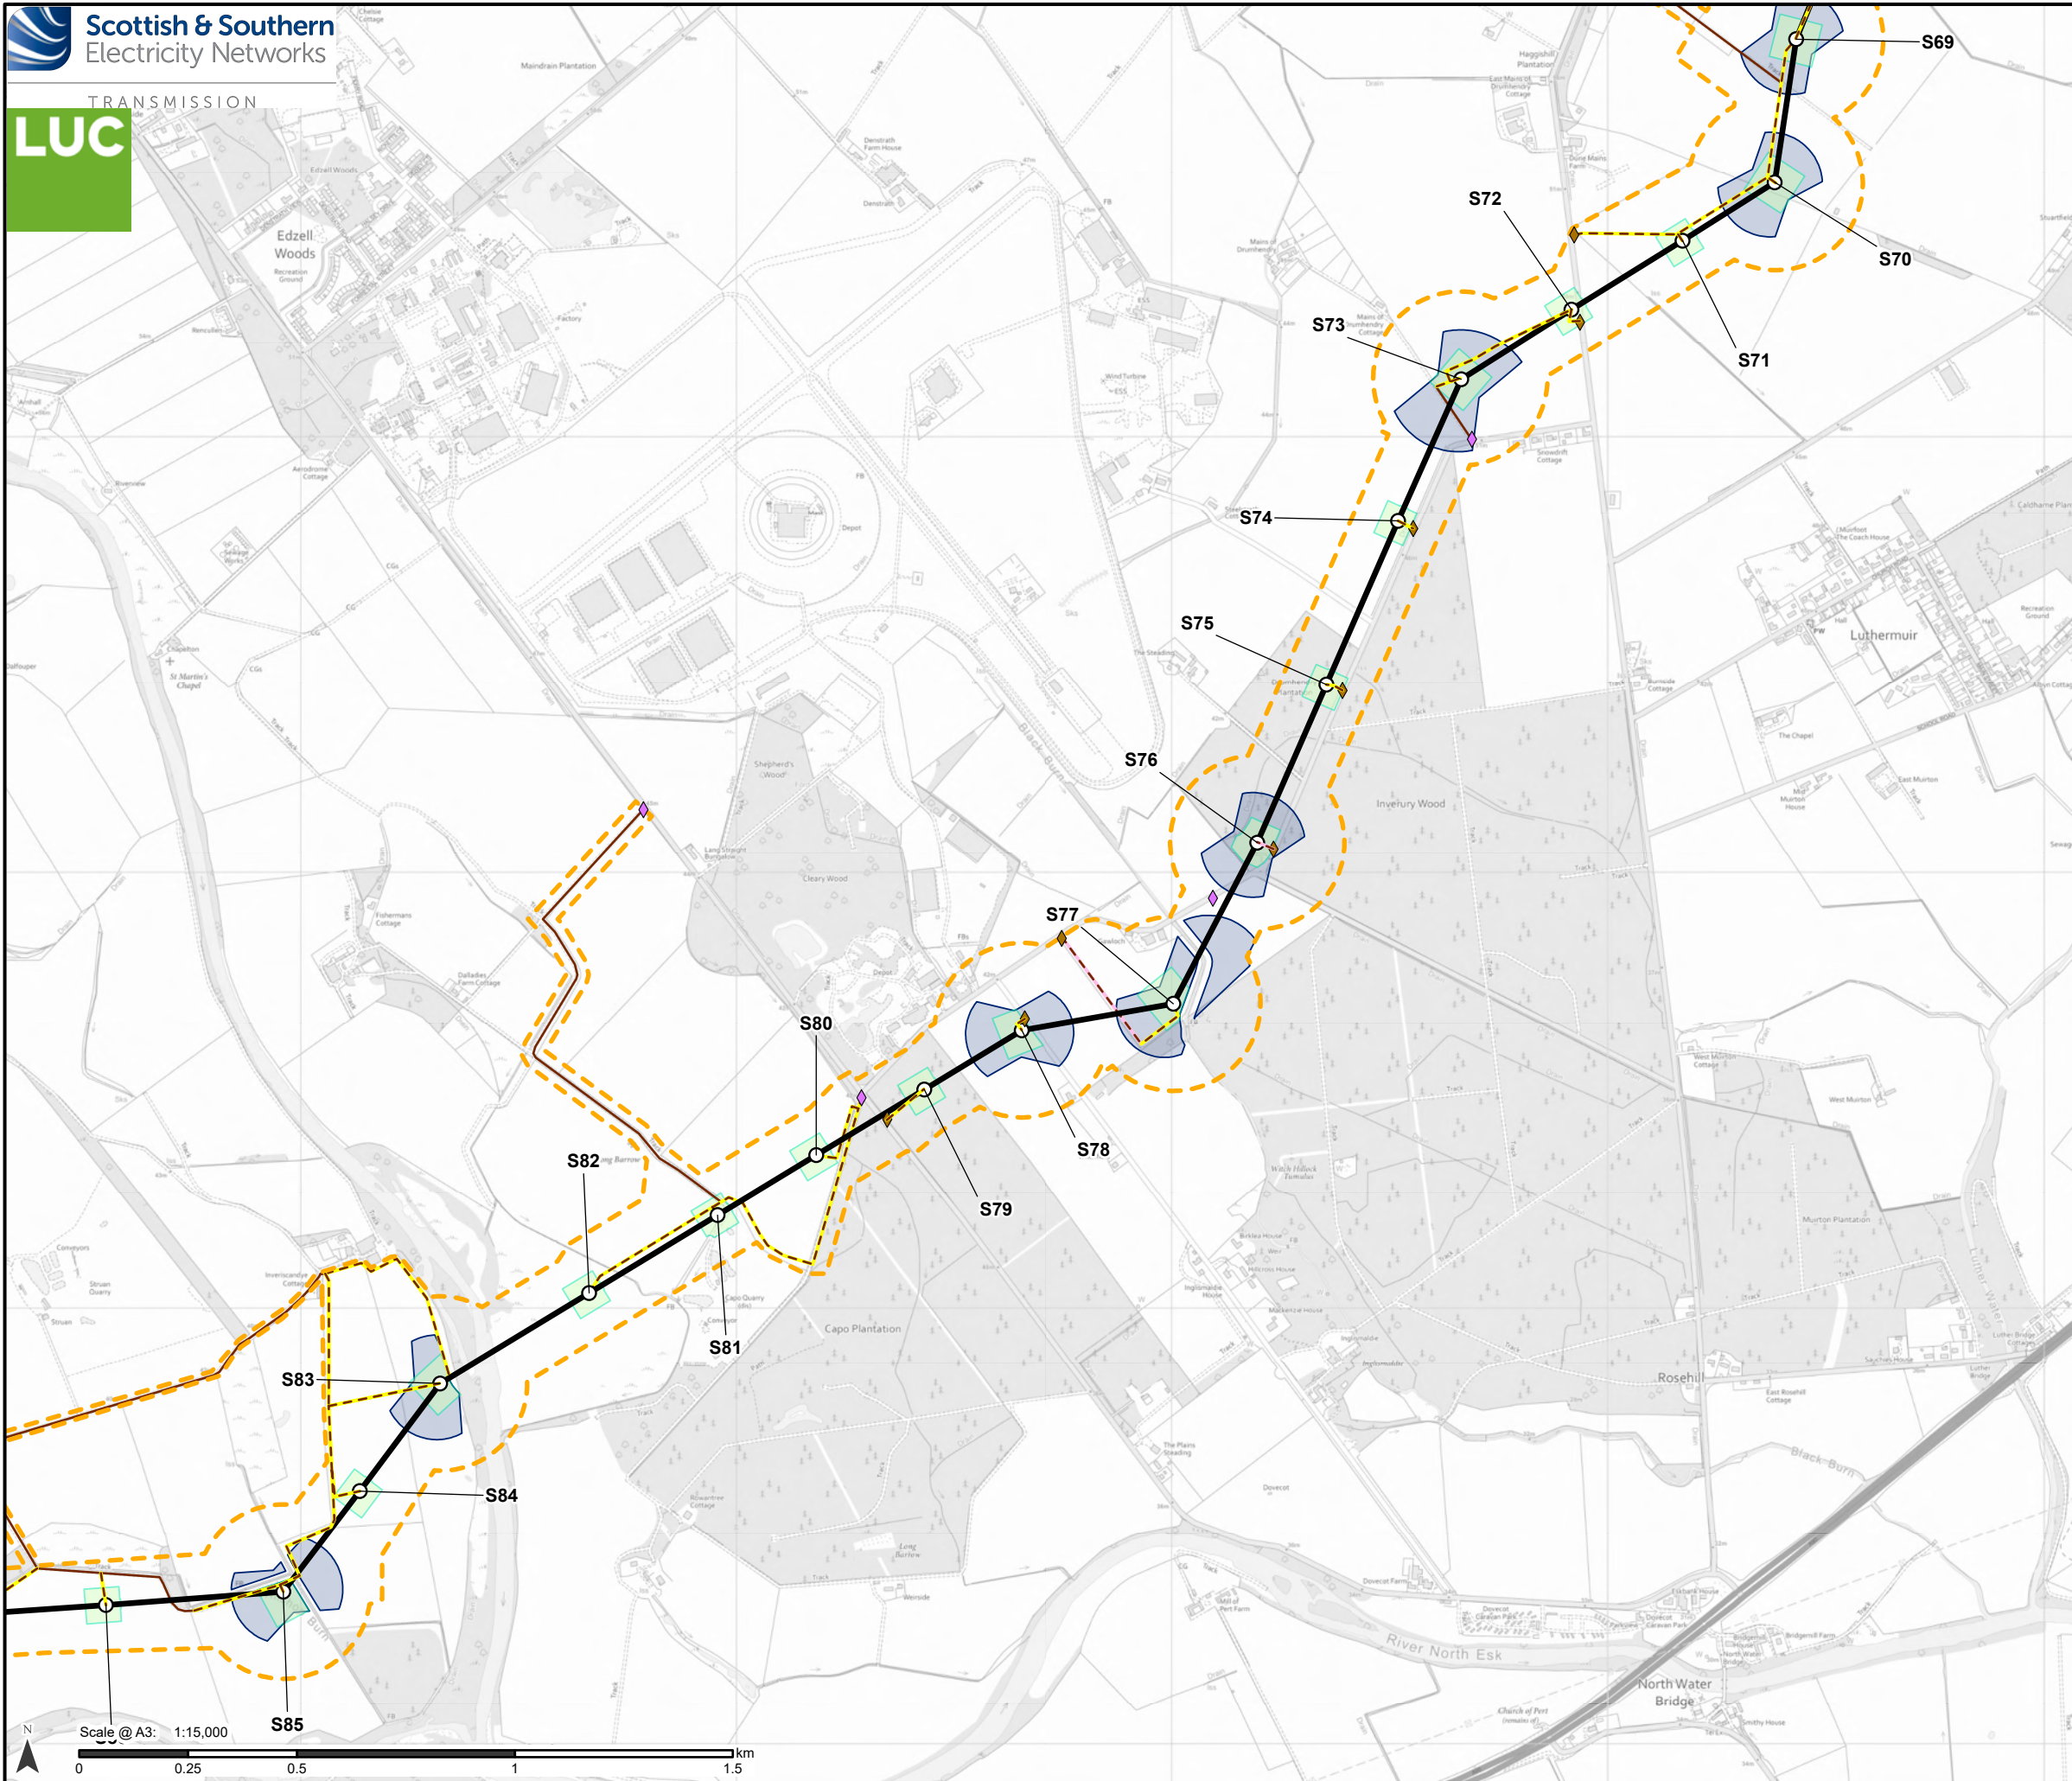

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

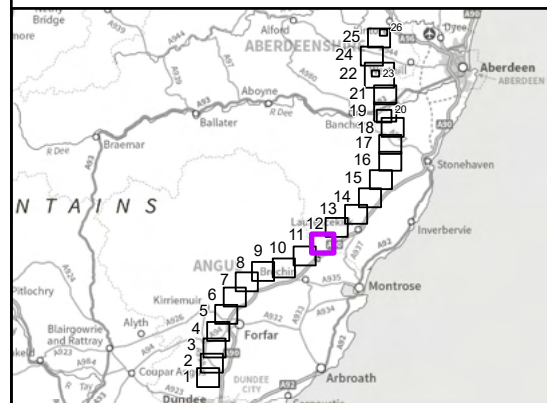


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line


Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 11

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.11

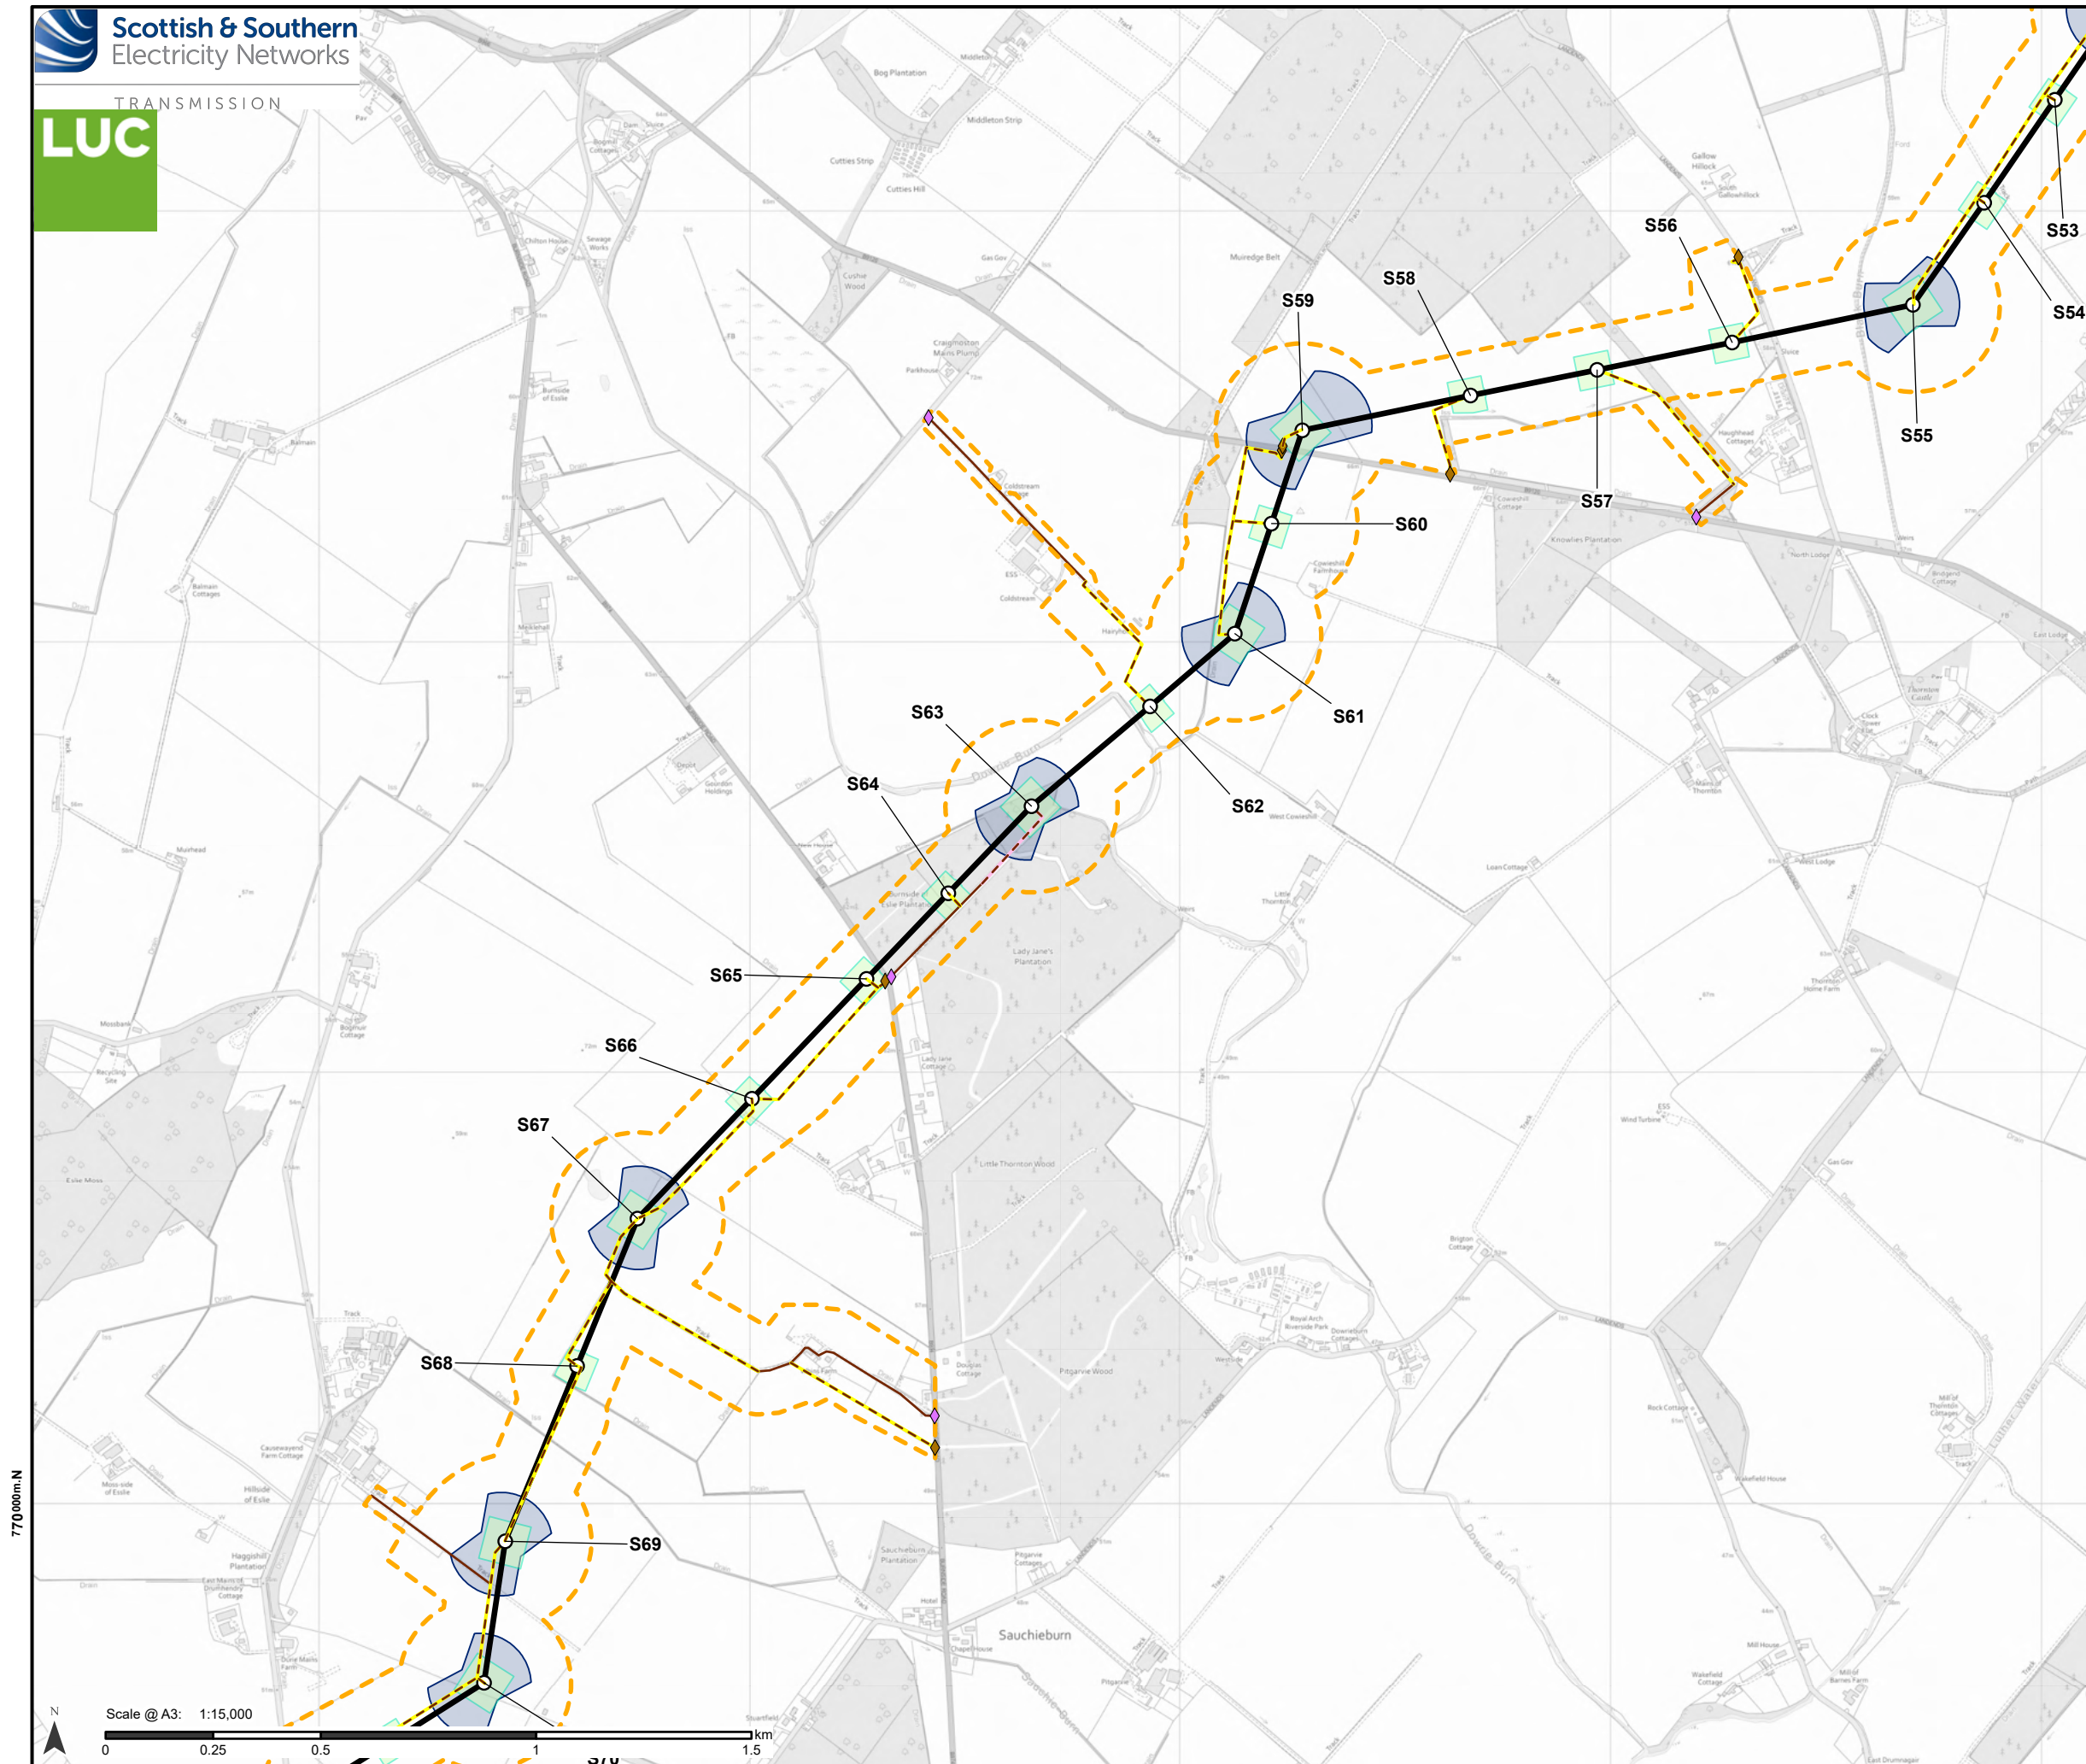

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

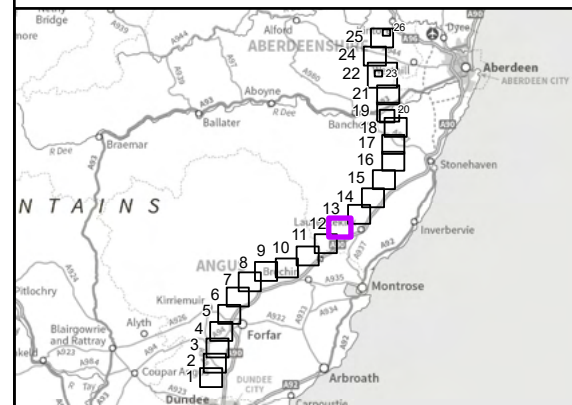

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 12

Drawn by: MS Date: 13/08/2025
Drawing: 3.1.12



○ Tower Location and number

— Proposed Alignment

— Proposed Development Limit of Deviation (LOD)

— Section boundary

Access

— Existing to be upgraded

— Proposed new stone permanent

— Proposed new stone temporary

Bellmouth type

◇ Proposed new

◇ Existing to be upgraded

Temporary Working Areas

□ Tower working area

□ Proposed conductor pulling area (Equipotential Zone (EPZ))

[illegible]


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
**SSEN Transmission take no responsibility for the release or accuracy of latest
version Basemaps from Ordnance Survey**

Project No:	LT455
Project:	Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent
(Electricity Act, 1989) is sought - Page 13


Drawn by: MS Date: 13/08/2025

Drawing: 3.1.13

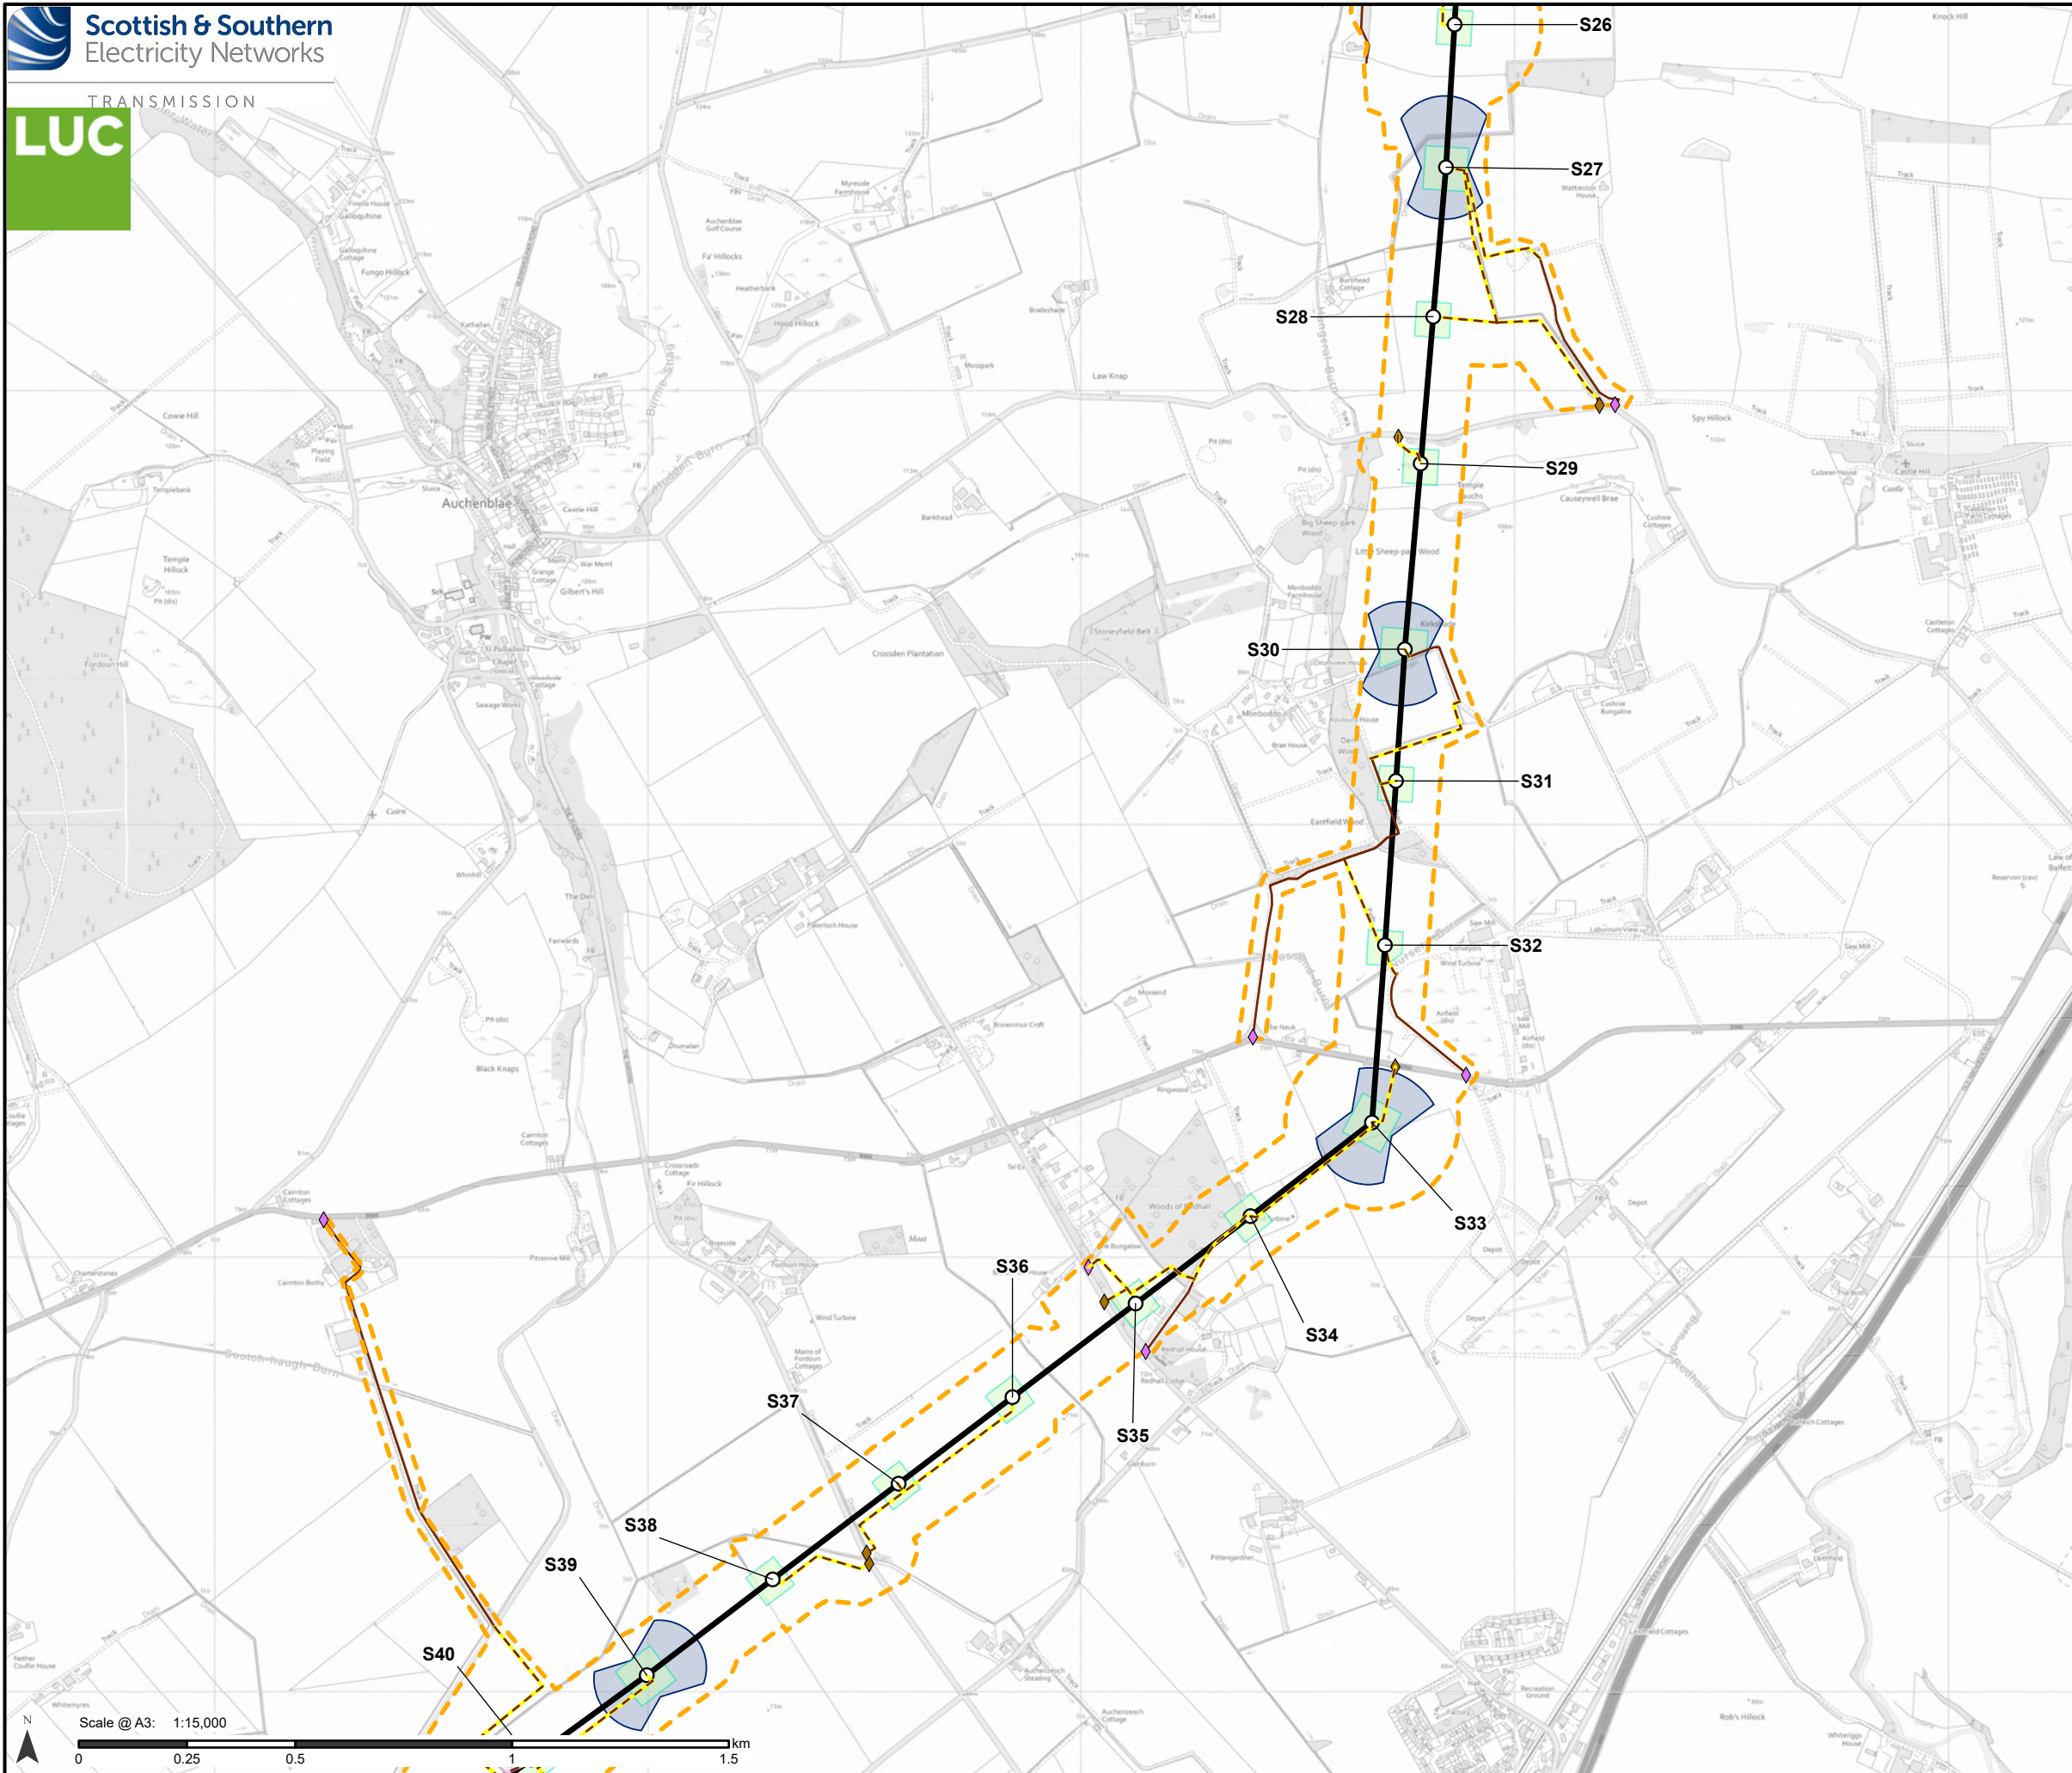


- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

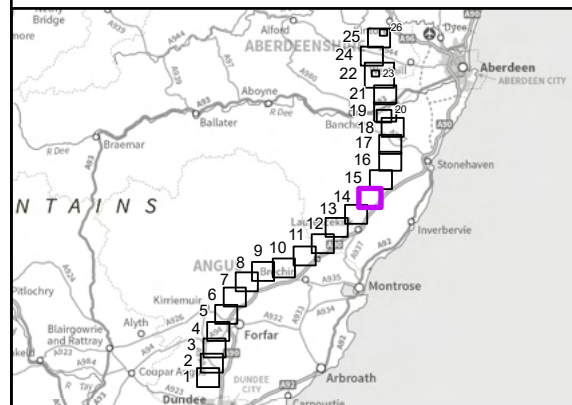


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line
Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 14
Drawn by: MS Date: 13/08/2025
Drawing: 3.1.14

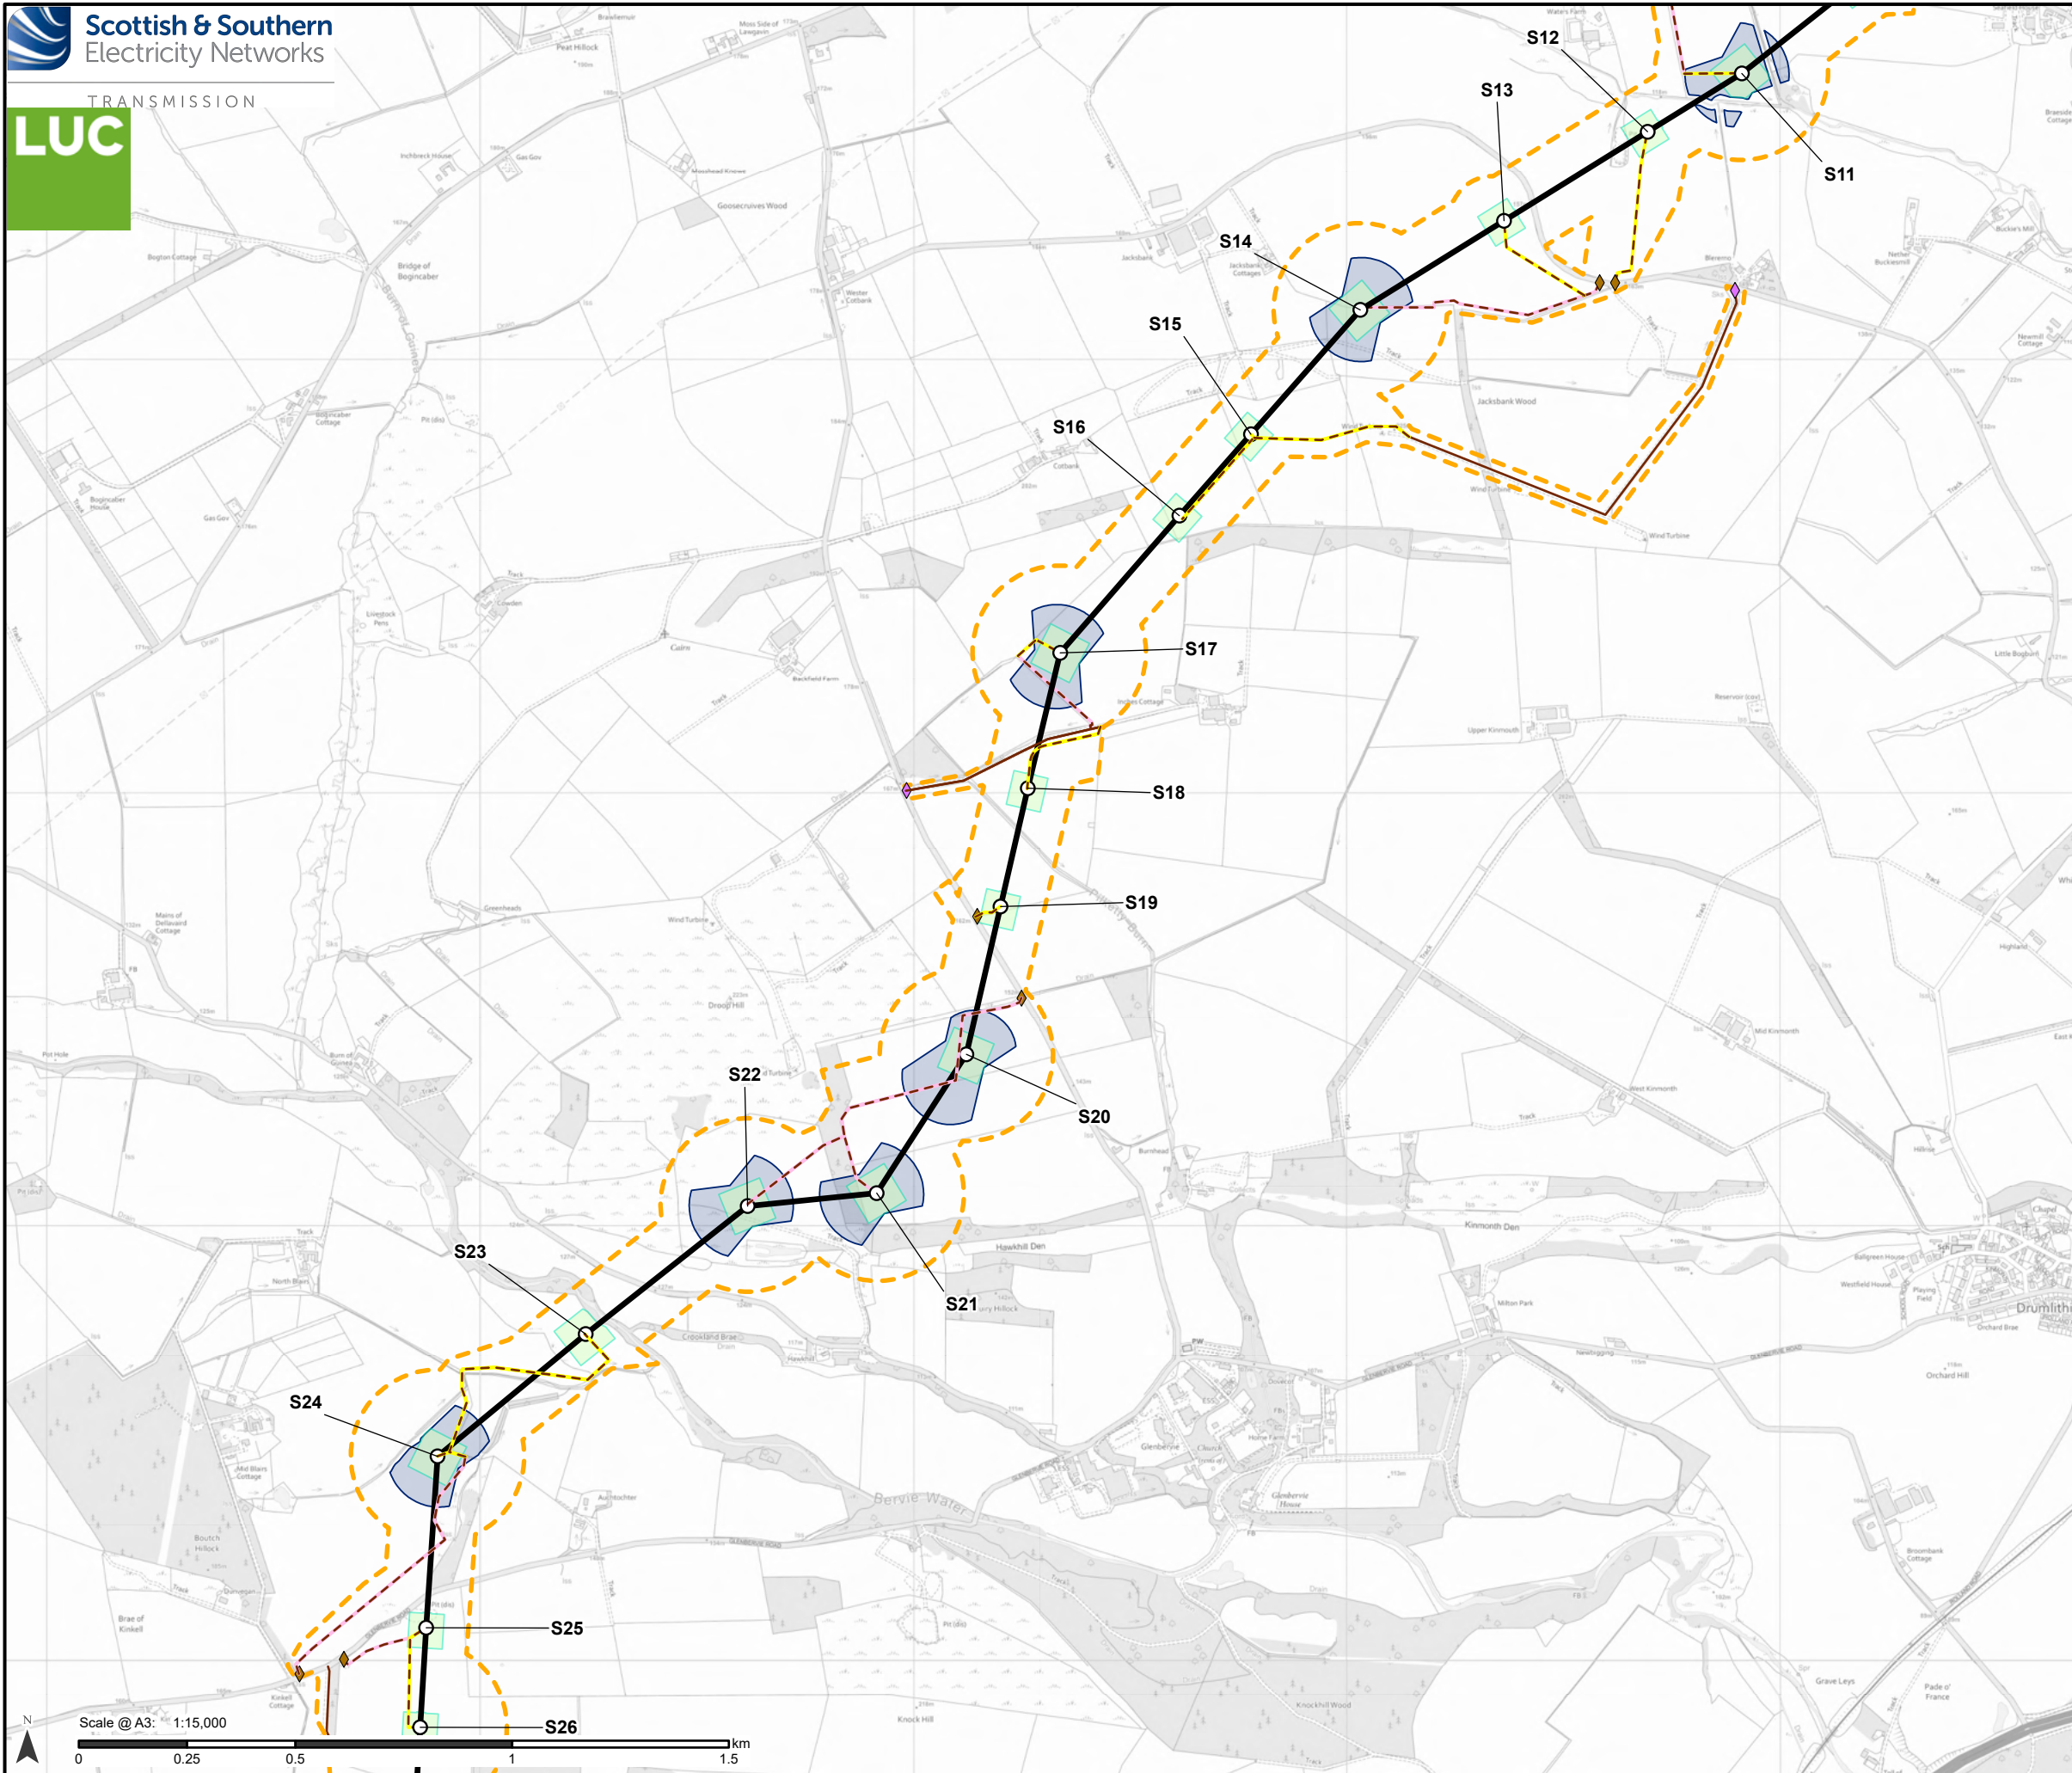

- Proposed Development**
- Tower Location and number
 - Proposed Alignment
 - Proposed Development Limit of Deviation (LOD)
- Access**
- Existing to be upgraded
 - Proposed new stone permanent
 - Proposed new stone temporary
- Bellmouth type**
- ◆ Proposed new
 - ◆ Existing to be upgraded
- Temporary Working Areas**
- Tower working area
 - Proposed conductor pulling area (Equipotential Zone (EPZ))

Note: Refer to Figure 3.3 for Overview of the LOD Variations/ Restrictions

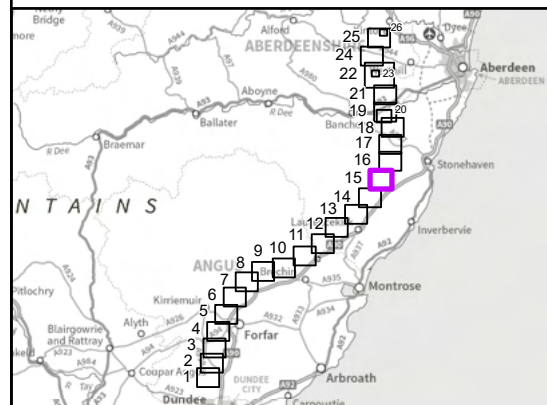

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT455
Project: Kintore to Tealing 400 kV Overhead Line

Title:
Proposed Development for which Section 37 consent (Electricity Act, 1989) is sought - Page 15

Drawn by: MS
Date: 13/08/2025
Drawing: 3.1.15