

Wireline drawing

190 200 210 220 230 240 250 260 270




OS reference: 374723E 806508N
 AOD: 108.57 m
 Direction of view: 229°
 Nearest tower: 204 m

Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm
 Paper size: 841 x 297 mm (half A1)
 Correct printed image size: 820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.62
Cairntoul

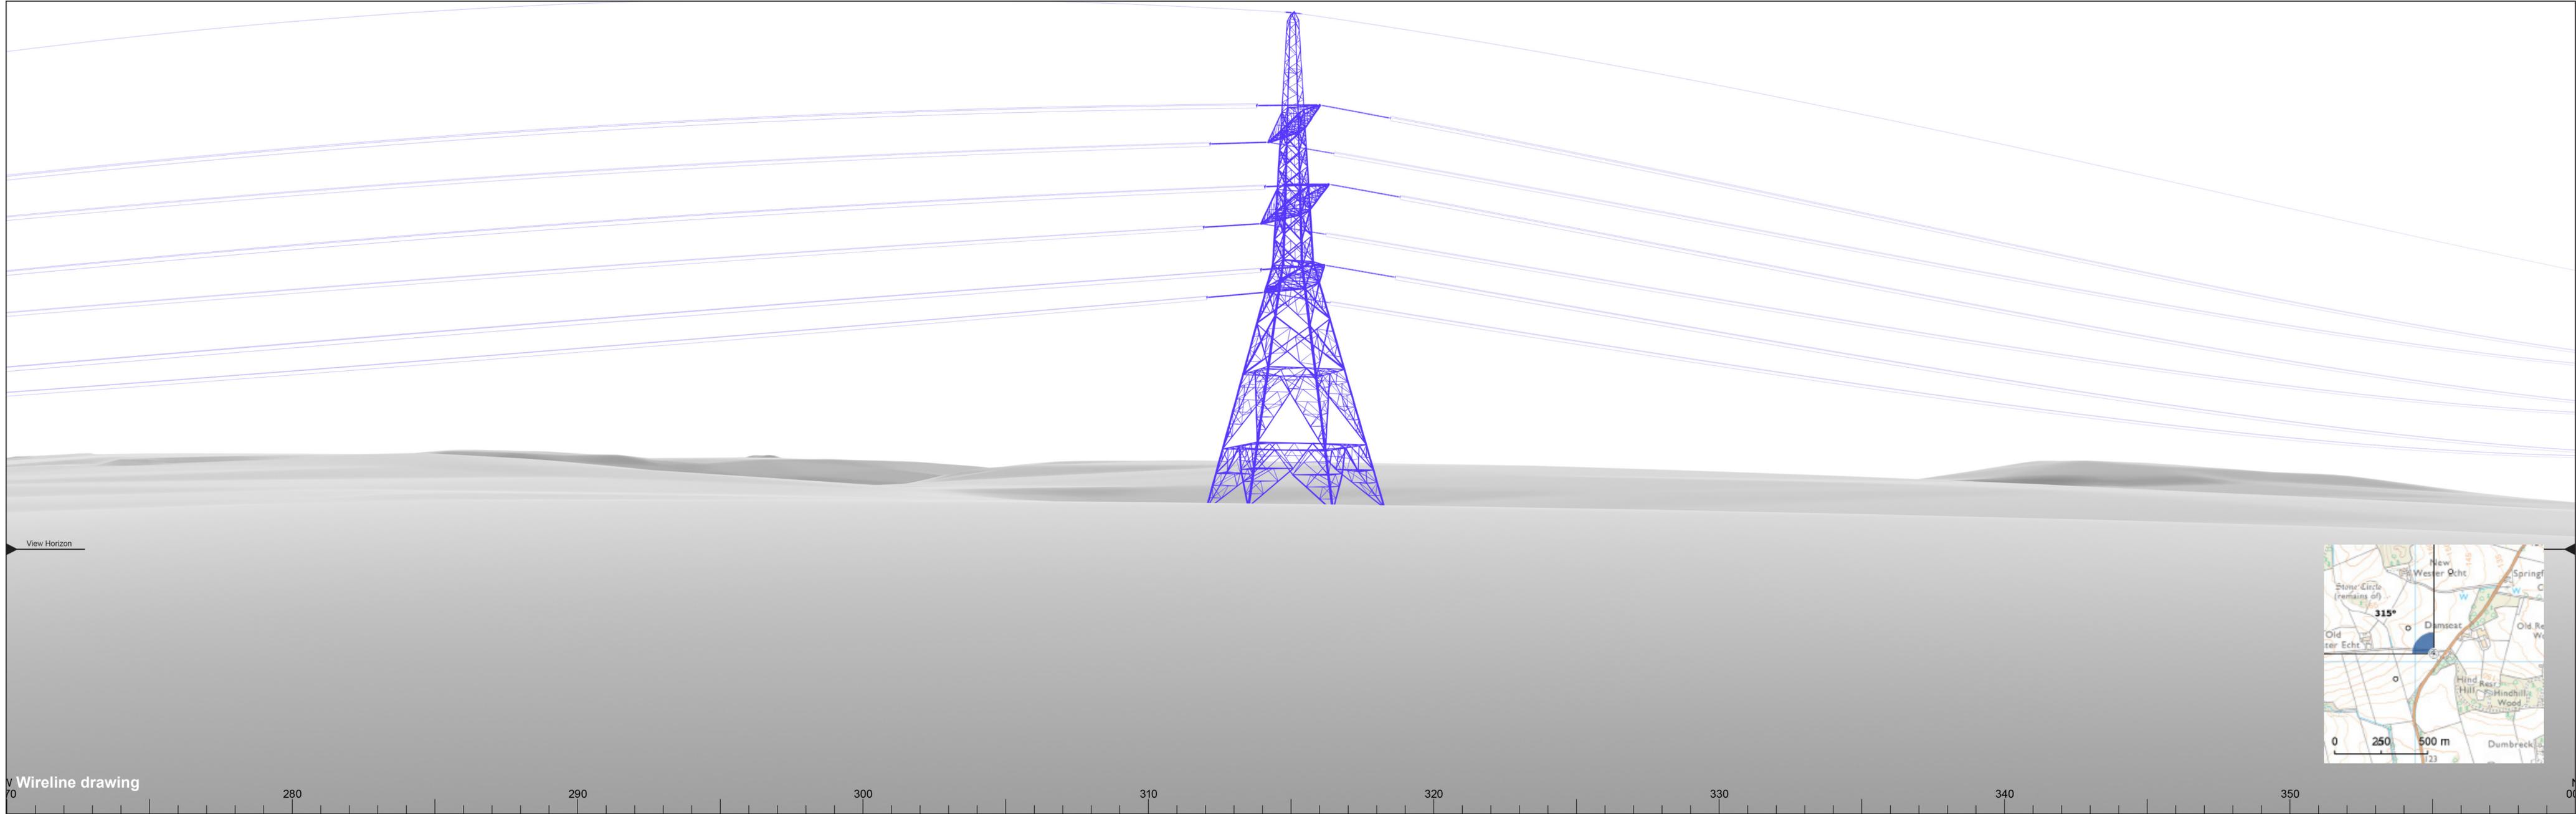

© Crown copyright and database rights 2025 Ordnance Survey data. Licence number: 0100051673

Wireline drawing



OS reference:	374101E 808044N	Horizontal field of view:	90° (cylindrical projection)
AOD:	143.31 m	Principal distance:	522 mm
Direction of view:	315°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	196 m	Correct printed image size:	820 x 260 mm


Note: The view horizon has been adjusted in this view to increase vertical visibility of towers

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.63a
Old Wester Echt Cottage

© Crown copyright and database rights 2025 Ordnance Survey data. Licence number: 0100051673

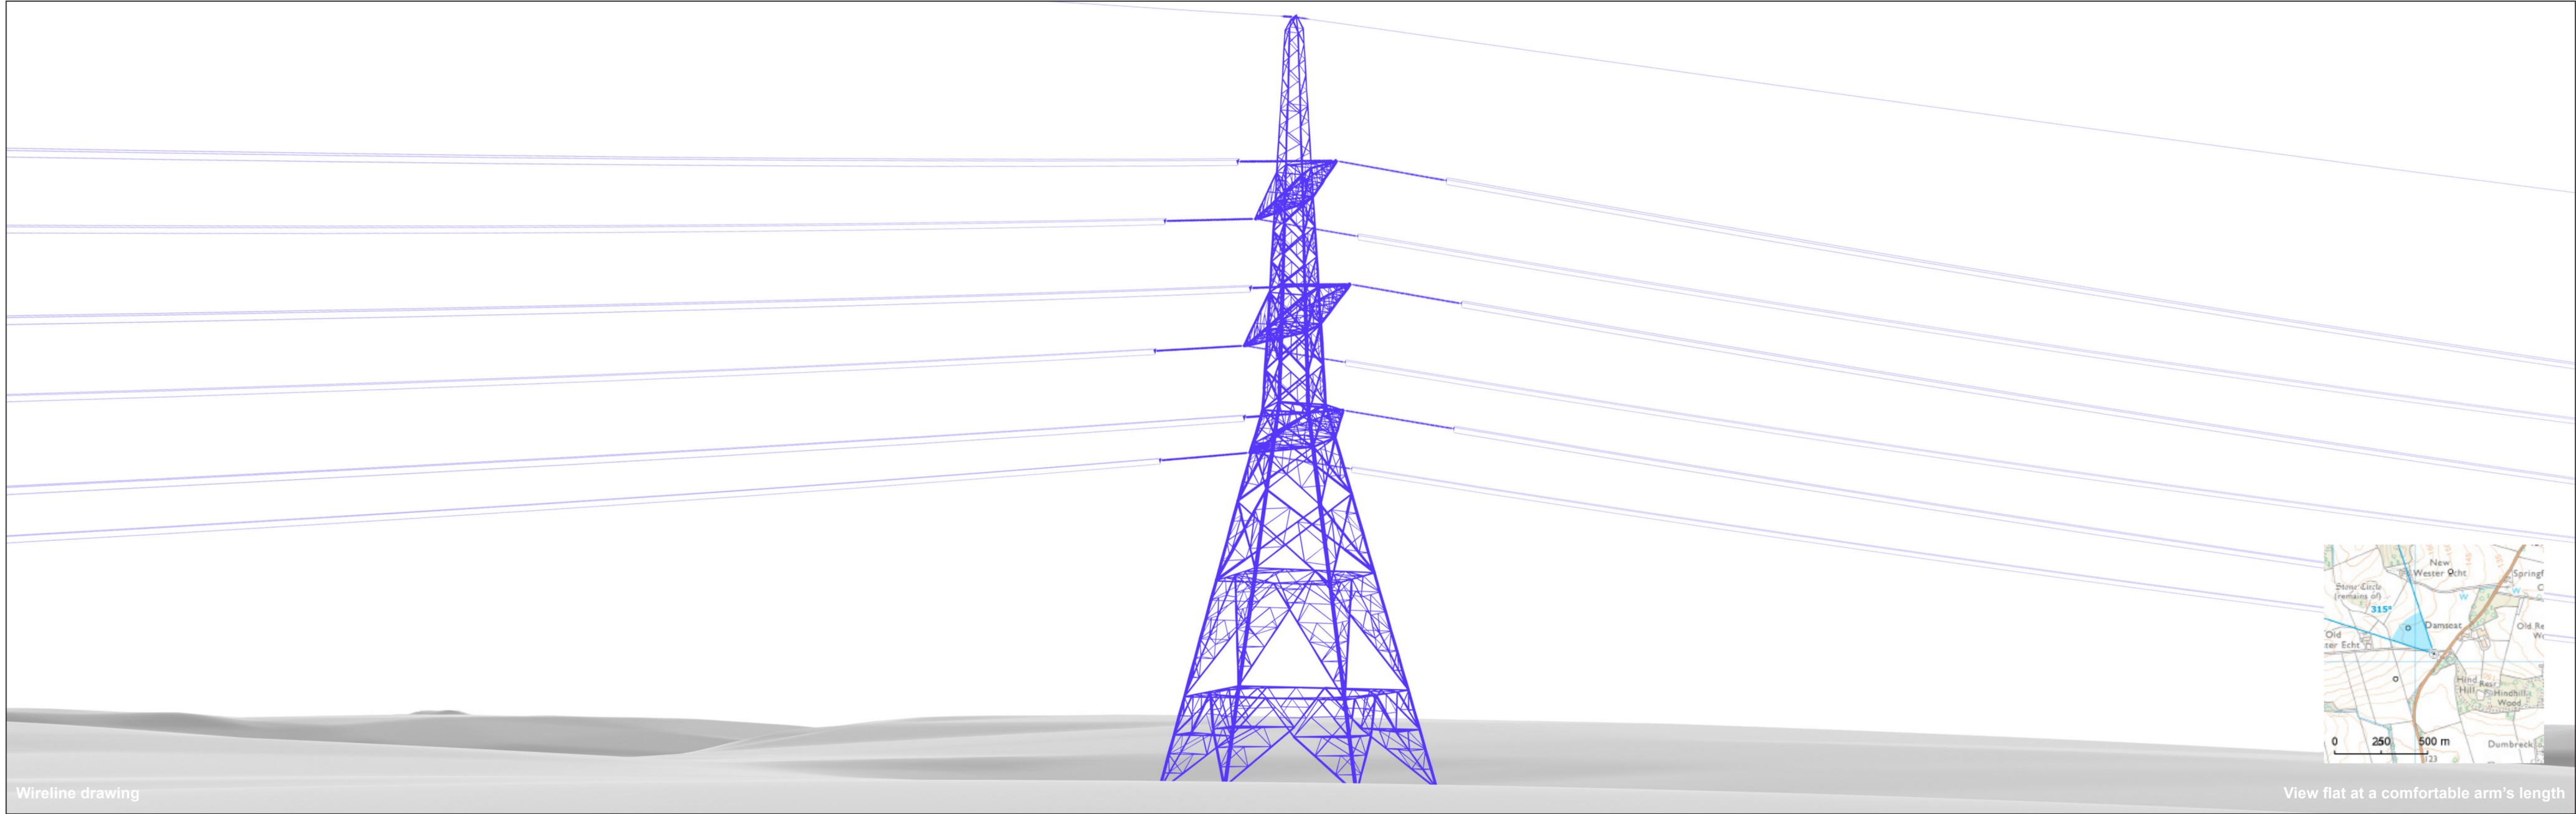

Wireline drawing



View flat at a comfortable arm's length





OS reference:	374101E 808044N	Horizontal field of view:	53.5° (planar projection)
AOD:	143.31 m	Principal distance:	812.5 mm
Direction of view:	315°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	196 m	Correct printed image size:	820 x 260 mm

Note: The view horizon has been adjusted in this view to increase vertical visibility of towers

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2025 all rights reserved.
Ordnance Survey Licence number 0100022432.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

 The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.63b
Old Wester Echt Cottage

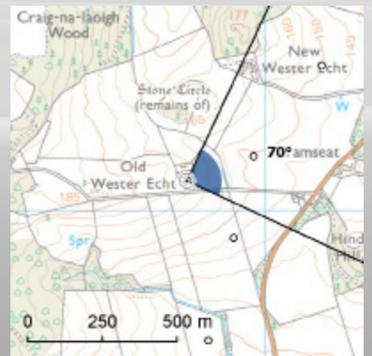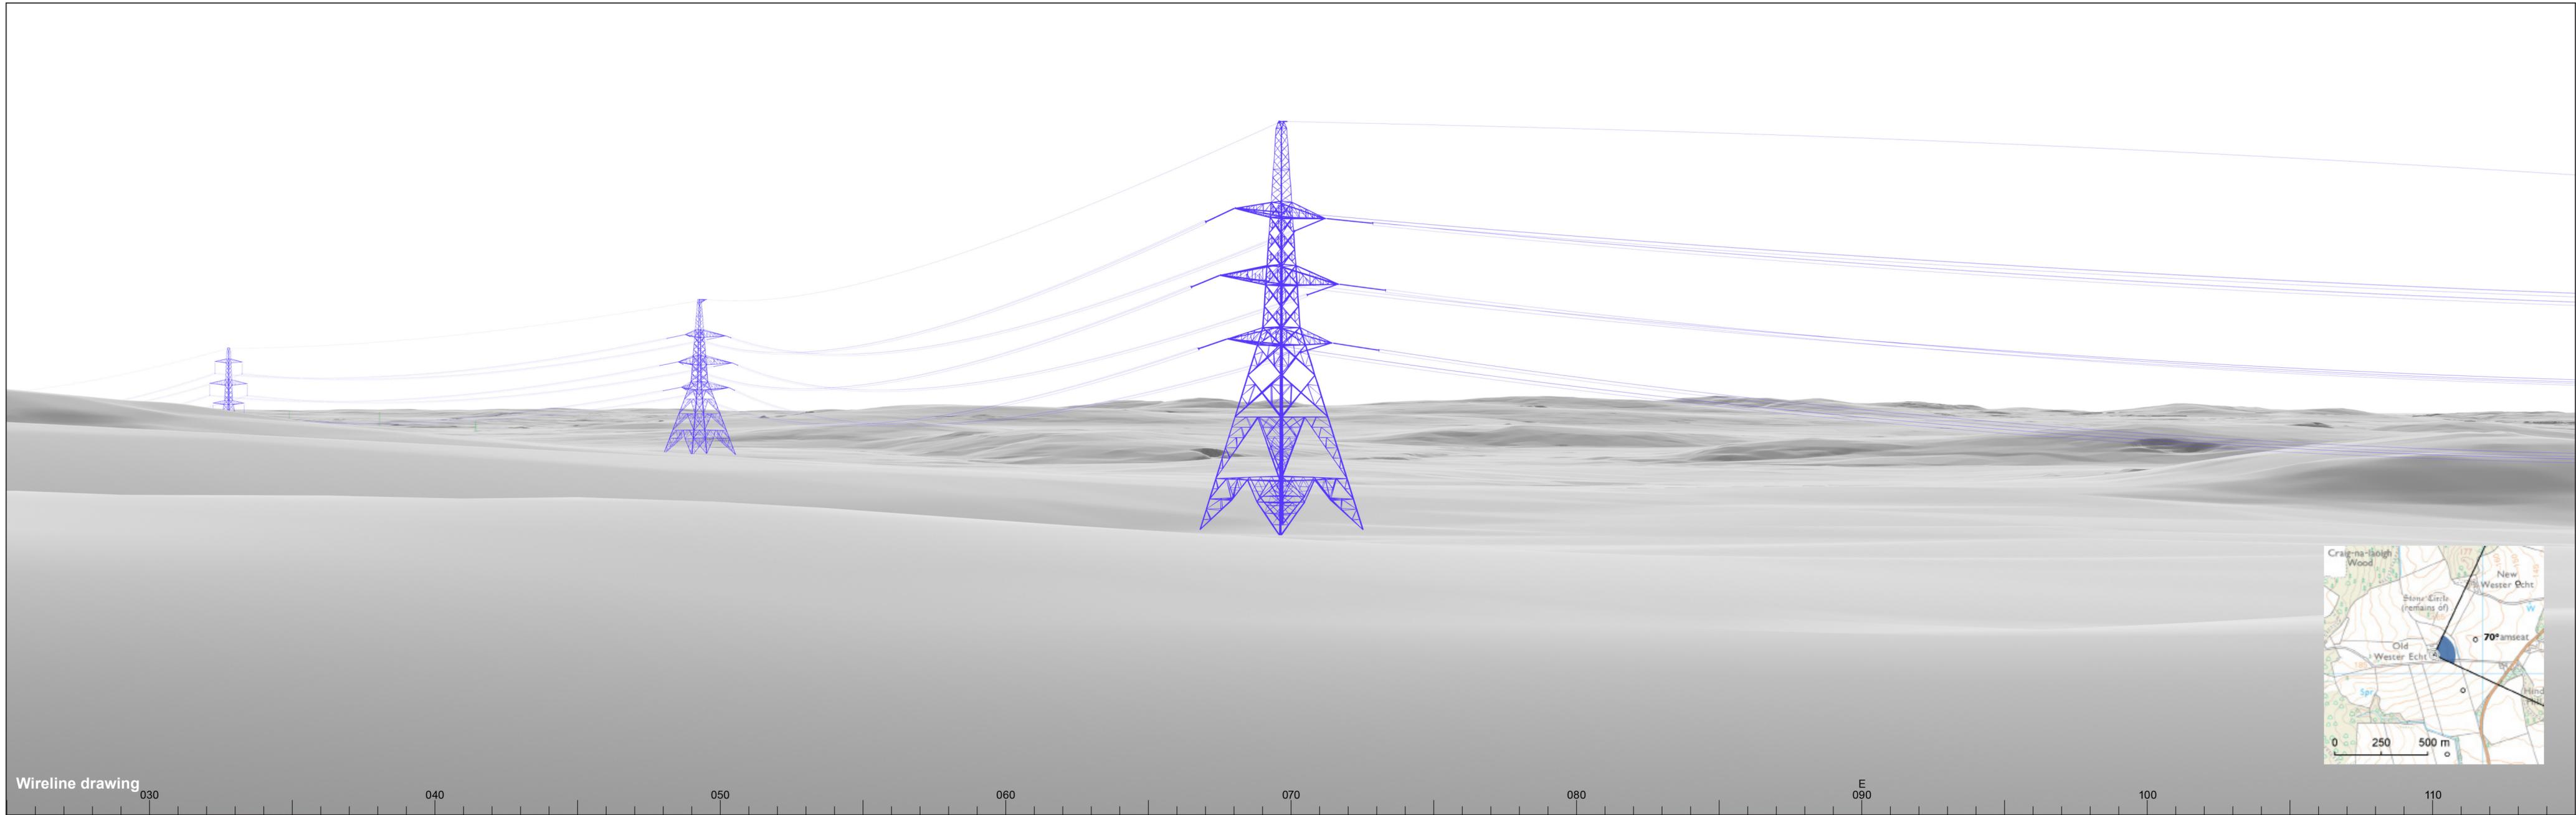

Wireline drawing

OS reference: 373740E 808100N
 AOD: 165.82 m
 Direction of view: 70°
 Nearest tower: 238 m



Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm
 Paper size: 841 x 297 mm (half A1)
 Correct printed image size: 820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.64
Old Wester Echt

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100051673

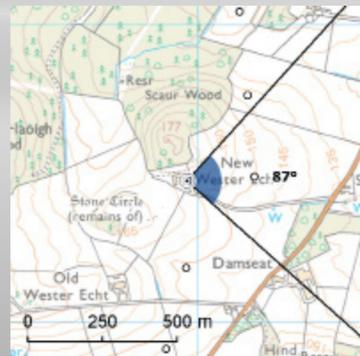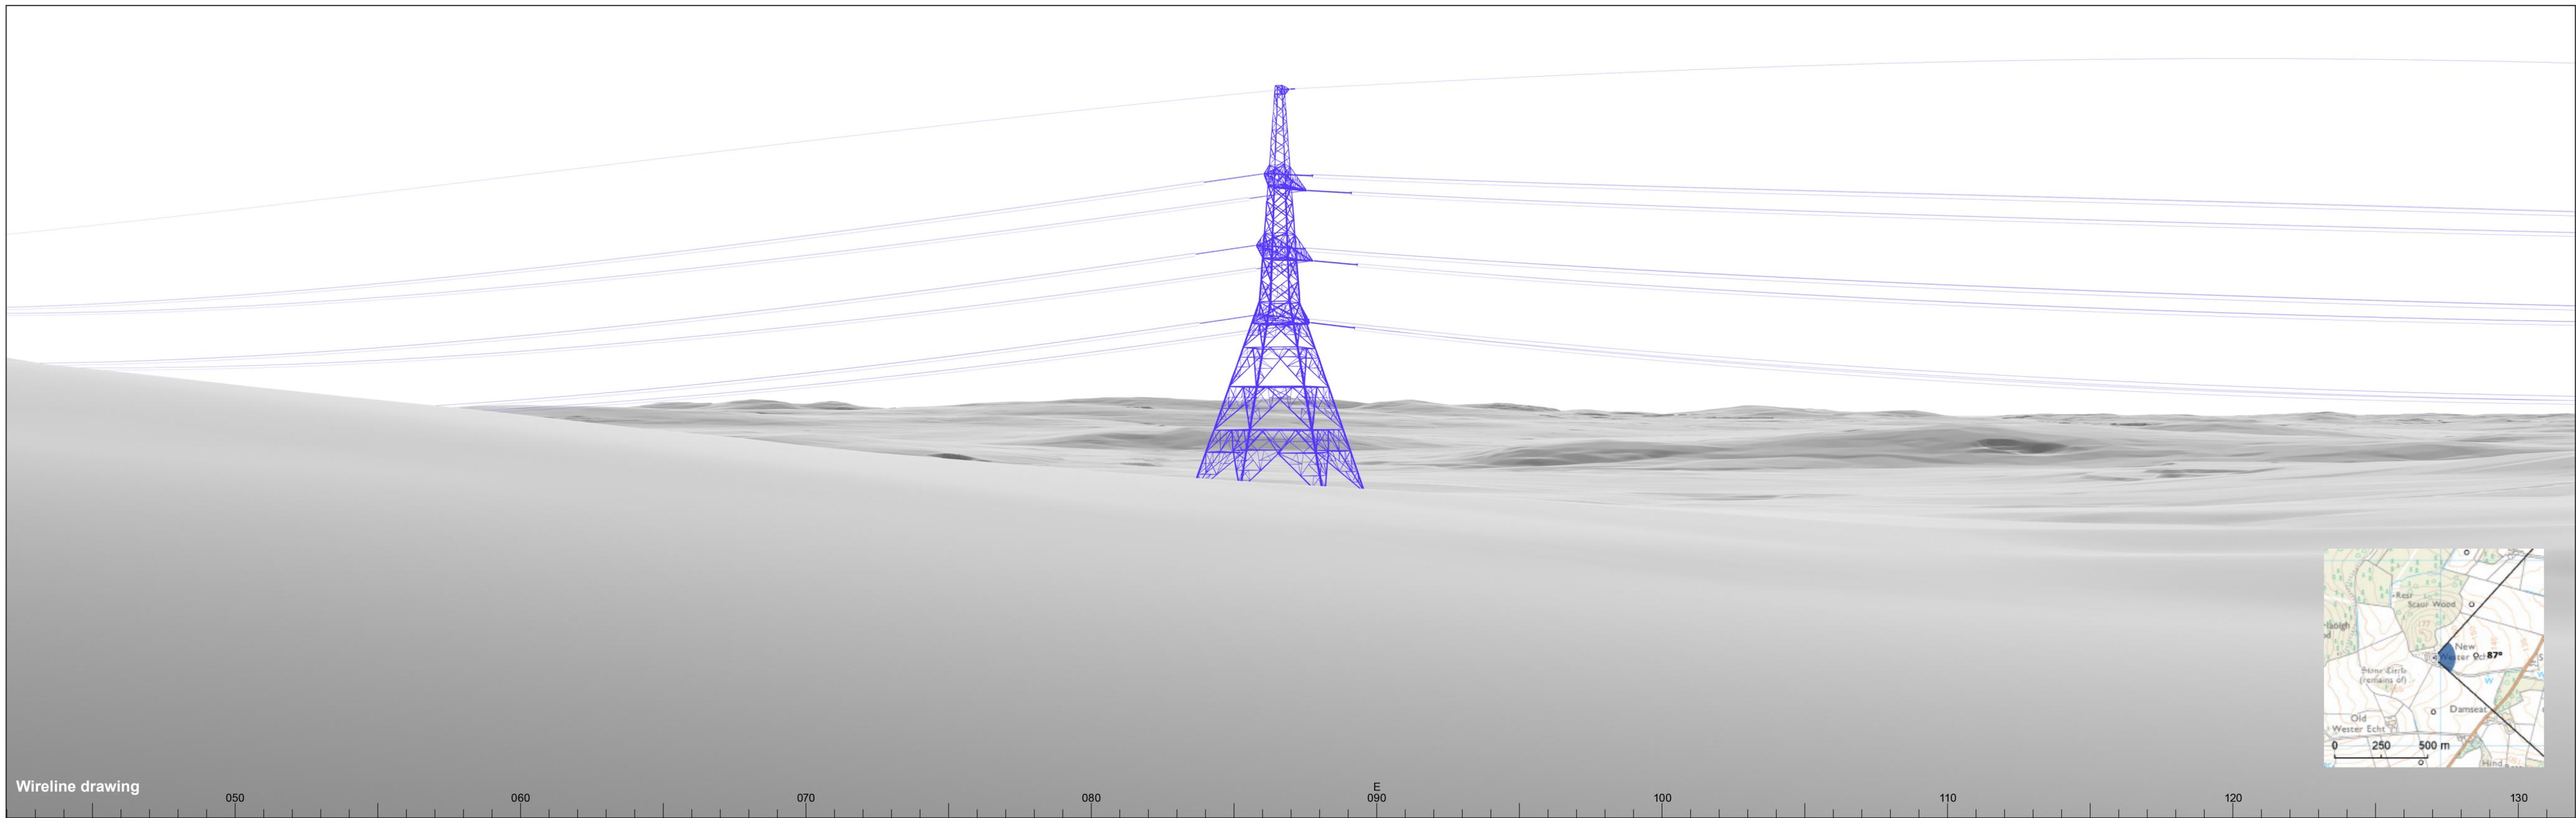

Wireline drawing




OS reference:	373965E 808475N	Horizontal field of view:	90° (cylindrical projection)
AOD:	160.66 m	Principal distance:	522 mm
Direction of view:	87°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	226 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.65
New Wester Ect

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100031673

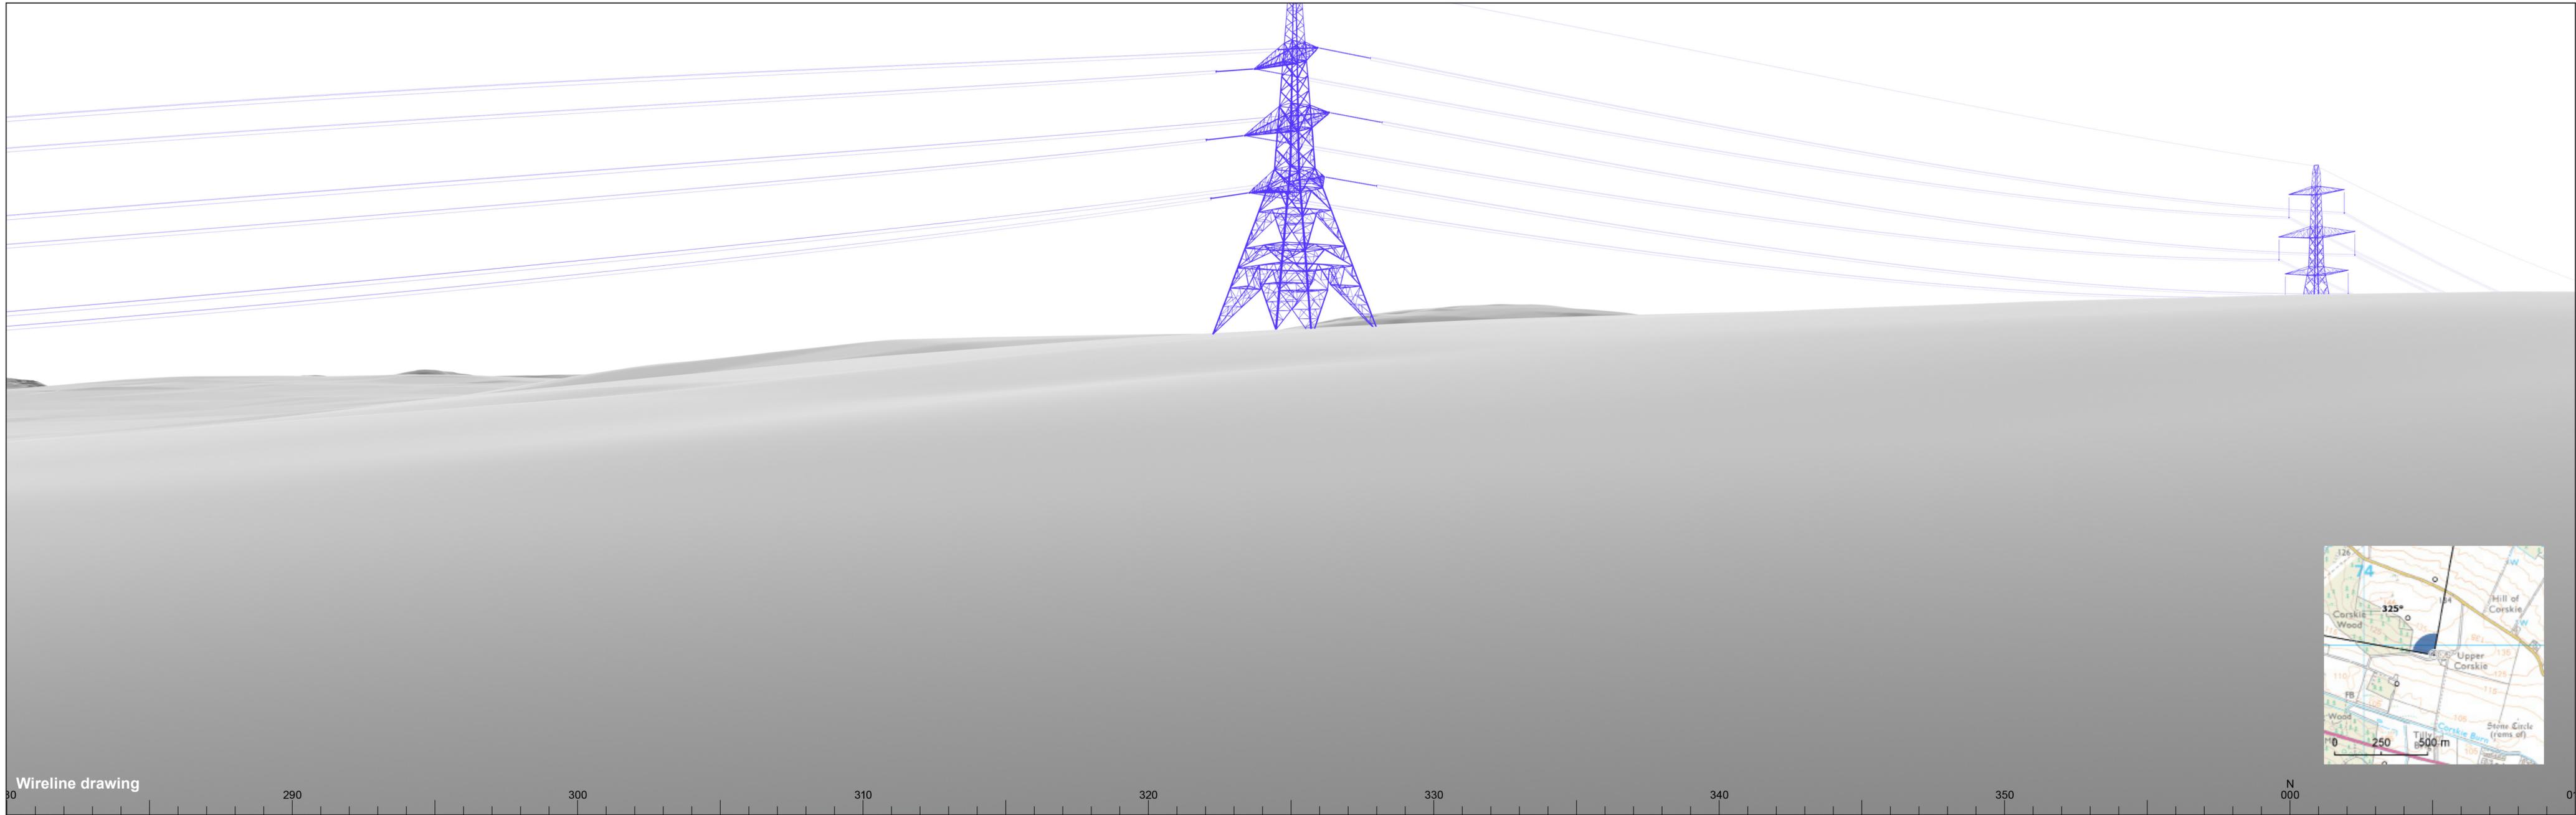

Wireline drawing




OS reference:	374377E 809948N	Horizontal field of view:	90° (cylindrical projection)
AOD:	124.12 m	Principal distance:	522 mm
Direction of view:	325°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	244 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

 The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.66
Upper Corskie

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100051673

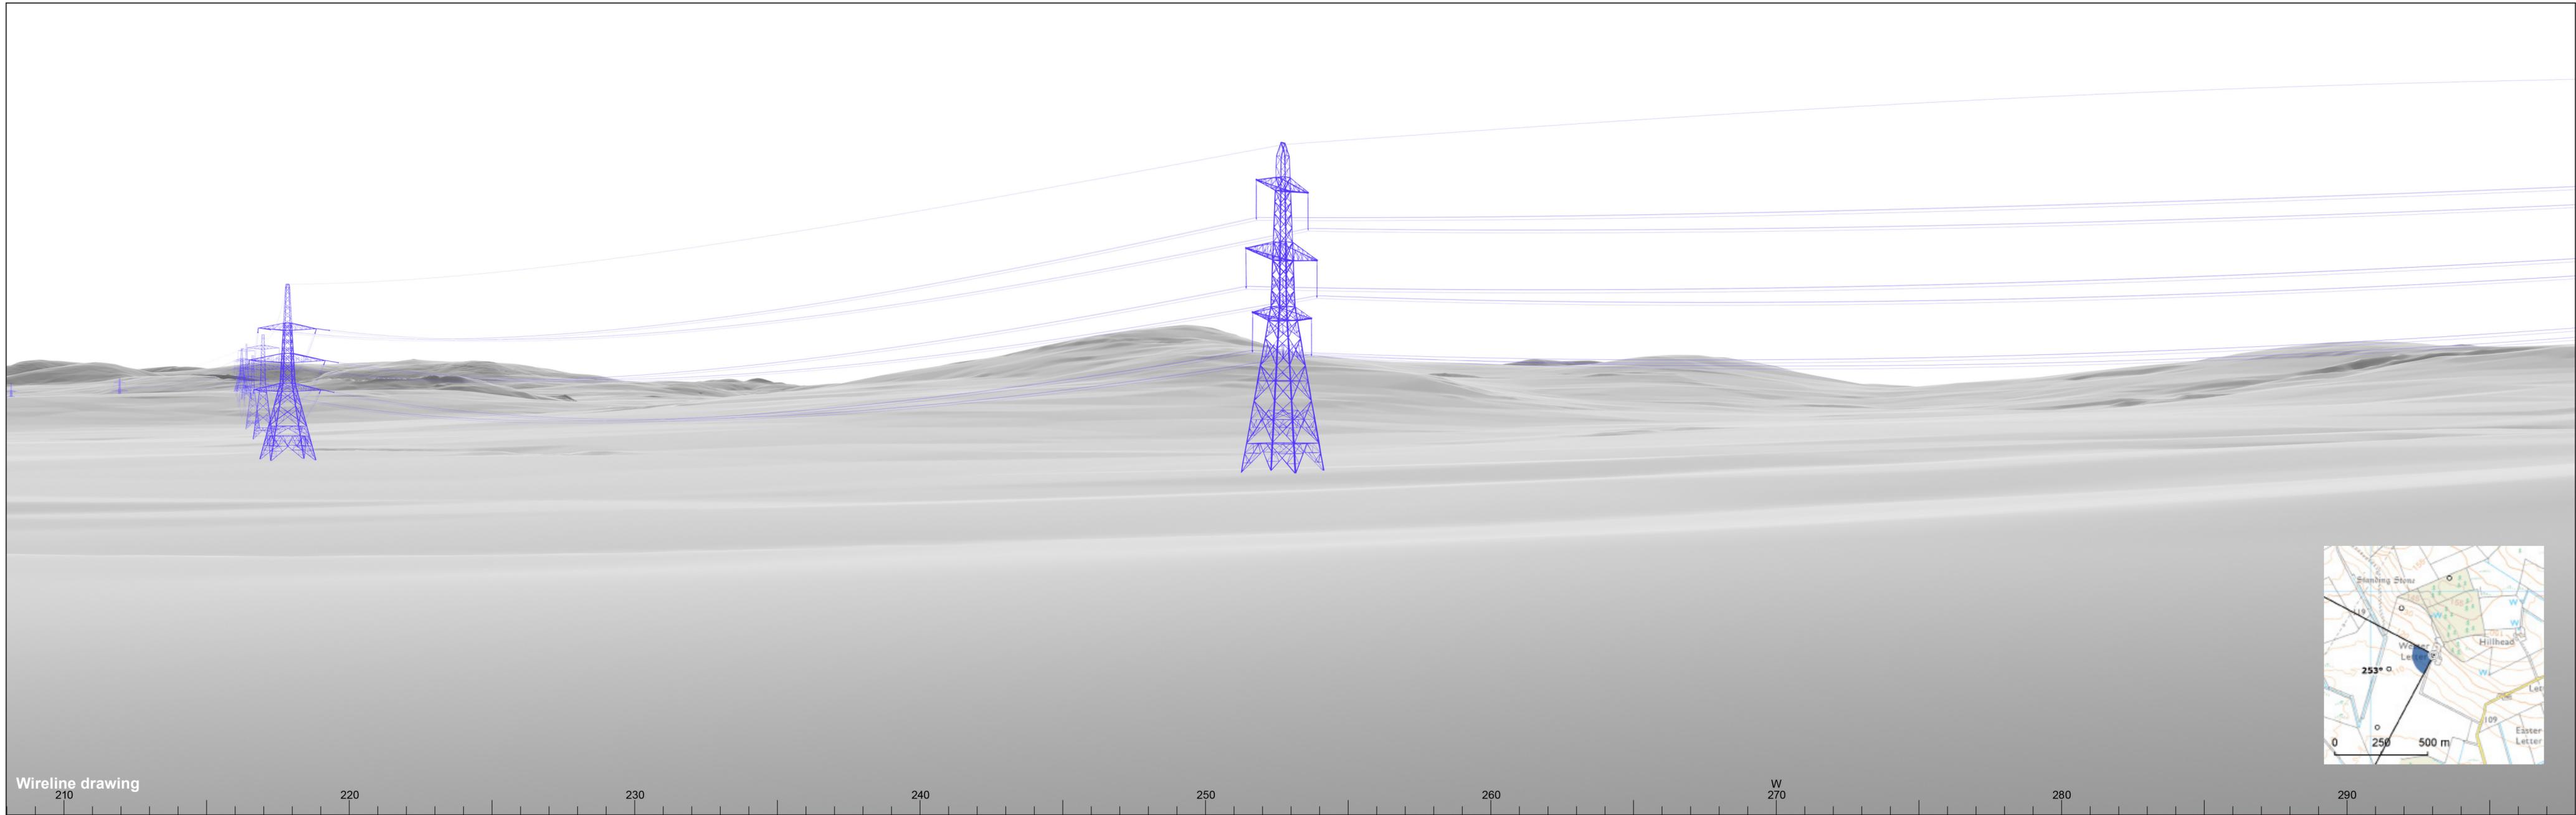

Wireline drawing




OS reference:	375341E 811655N	Horizontal field of view:	90° (cylindrical projection)
AOD:	120.66 m	Principal distance:	522 mm
Direction of view:	253°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	253 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

 The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.67
Wester Letter Steading

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100031673

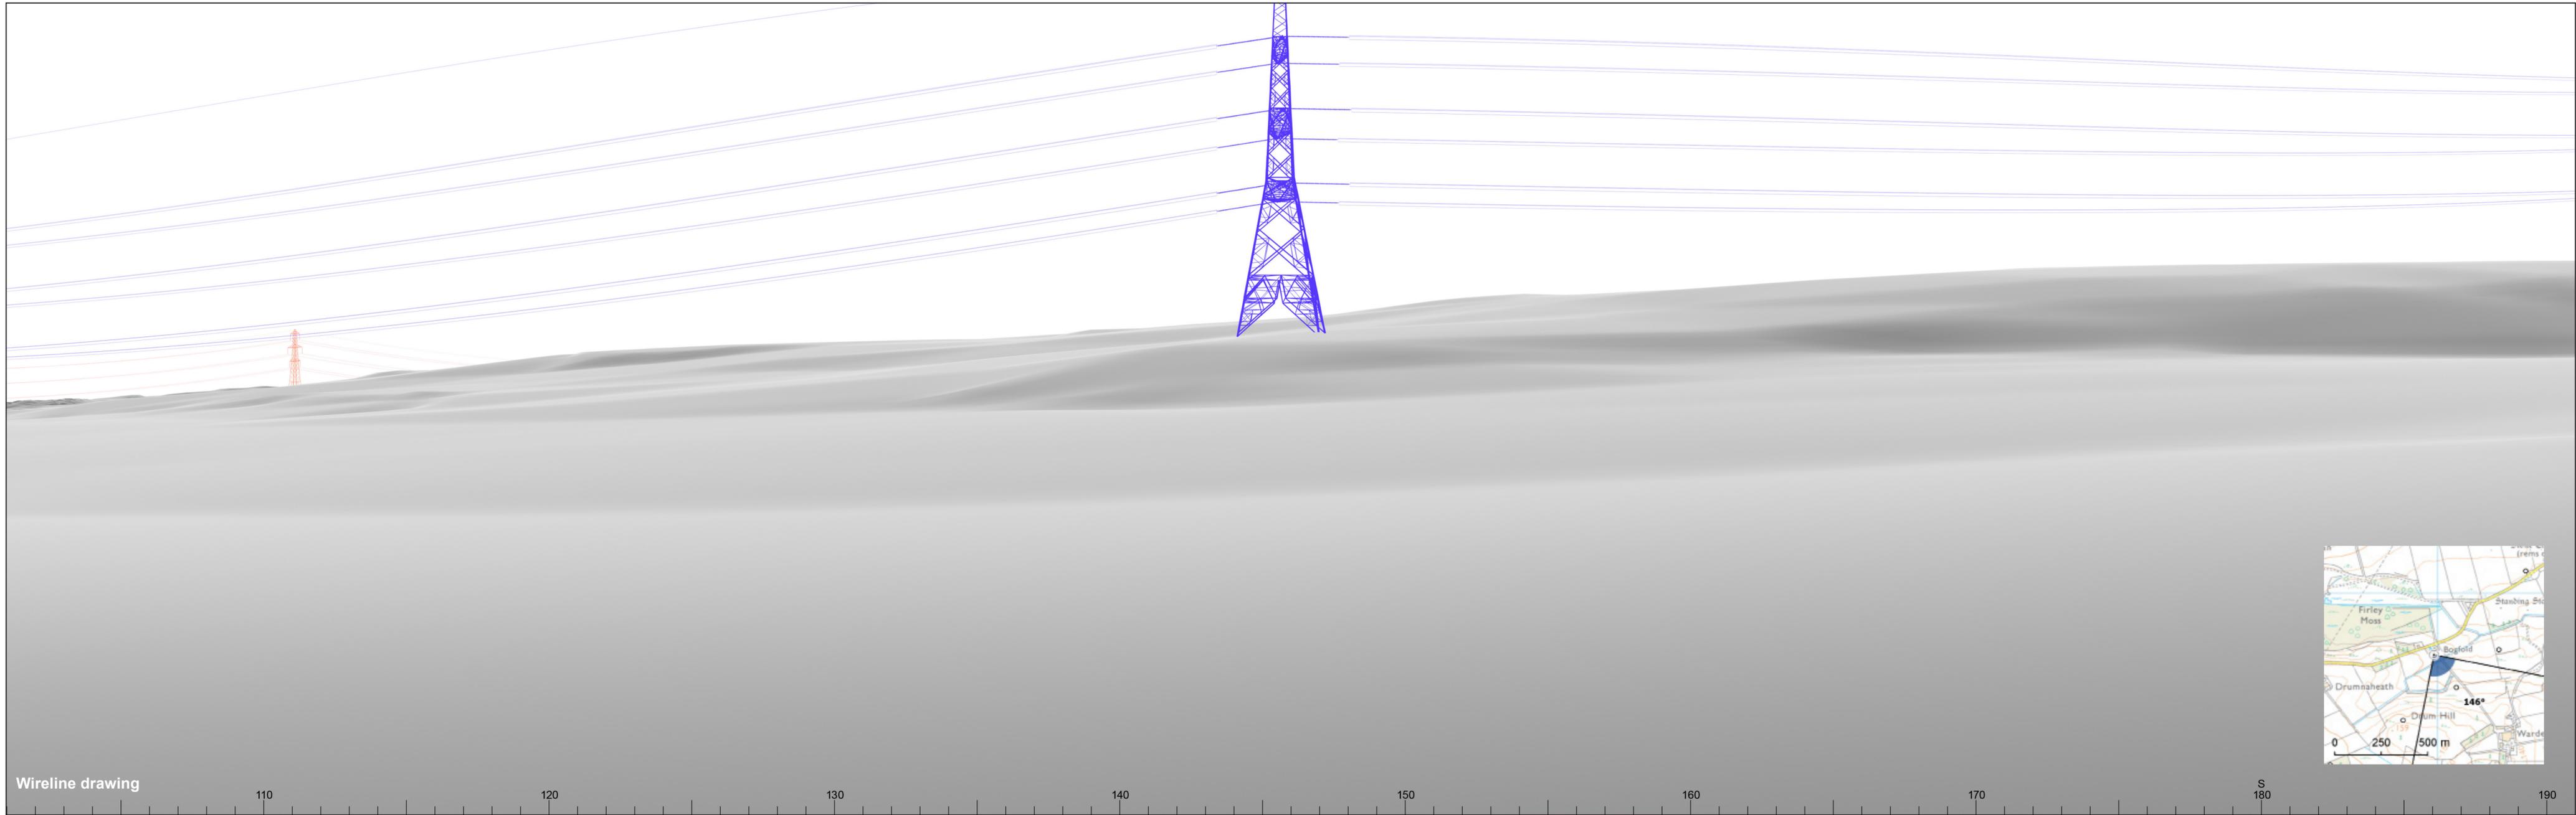

Wireline drawing



OS reference:	375981E 812666N	Horizontal field of view:	90° (cylindrical projection)
AOD:	119.1 m	Principal distance:	522 mm
Direction of view:	146°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	213 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL	The Proposed Development – Kintore to Tealing 400 kV OHL
---	--



Figure: A9.3.68
Bogfold