

Wireline drawing




OS reference:	376171E 812921N	Horizontal field of view:	90° (cylindrical projection)
AOD:	110.26 m	Principal distance:	522 mm
Direction of view:	145°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	276 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL	The Proposed Development – Kintore to Tealing 400 kV OHL
---	--



Figure: A9.3.69
Leylodge Schoolhouse

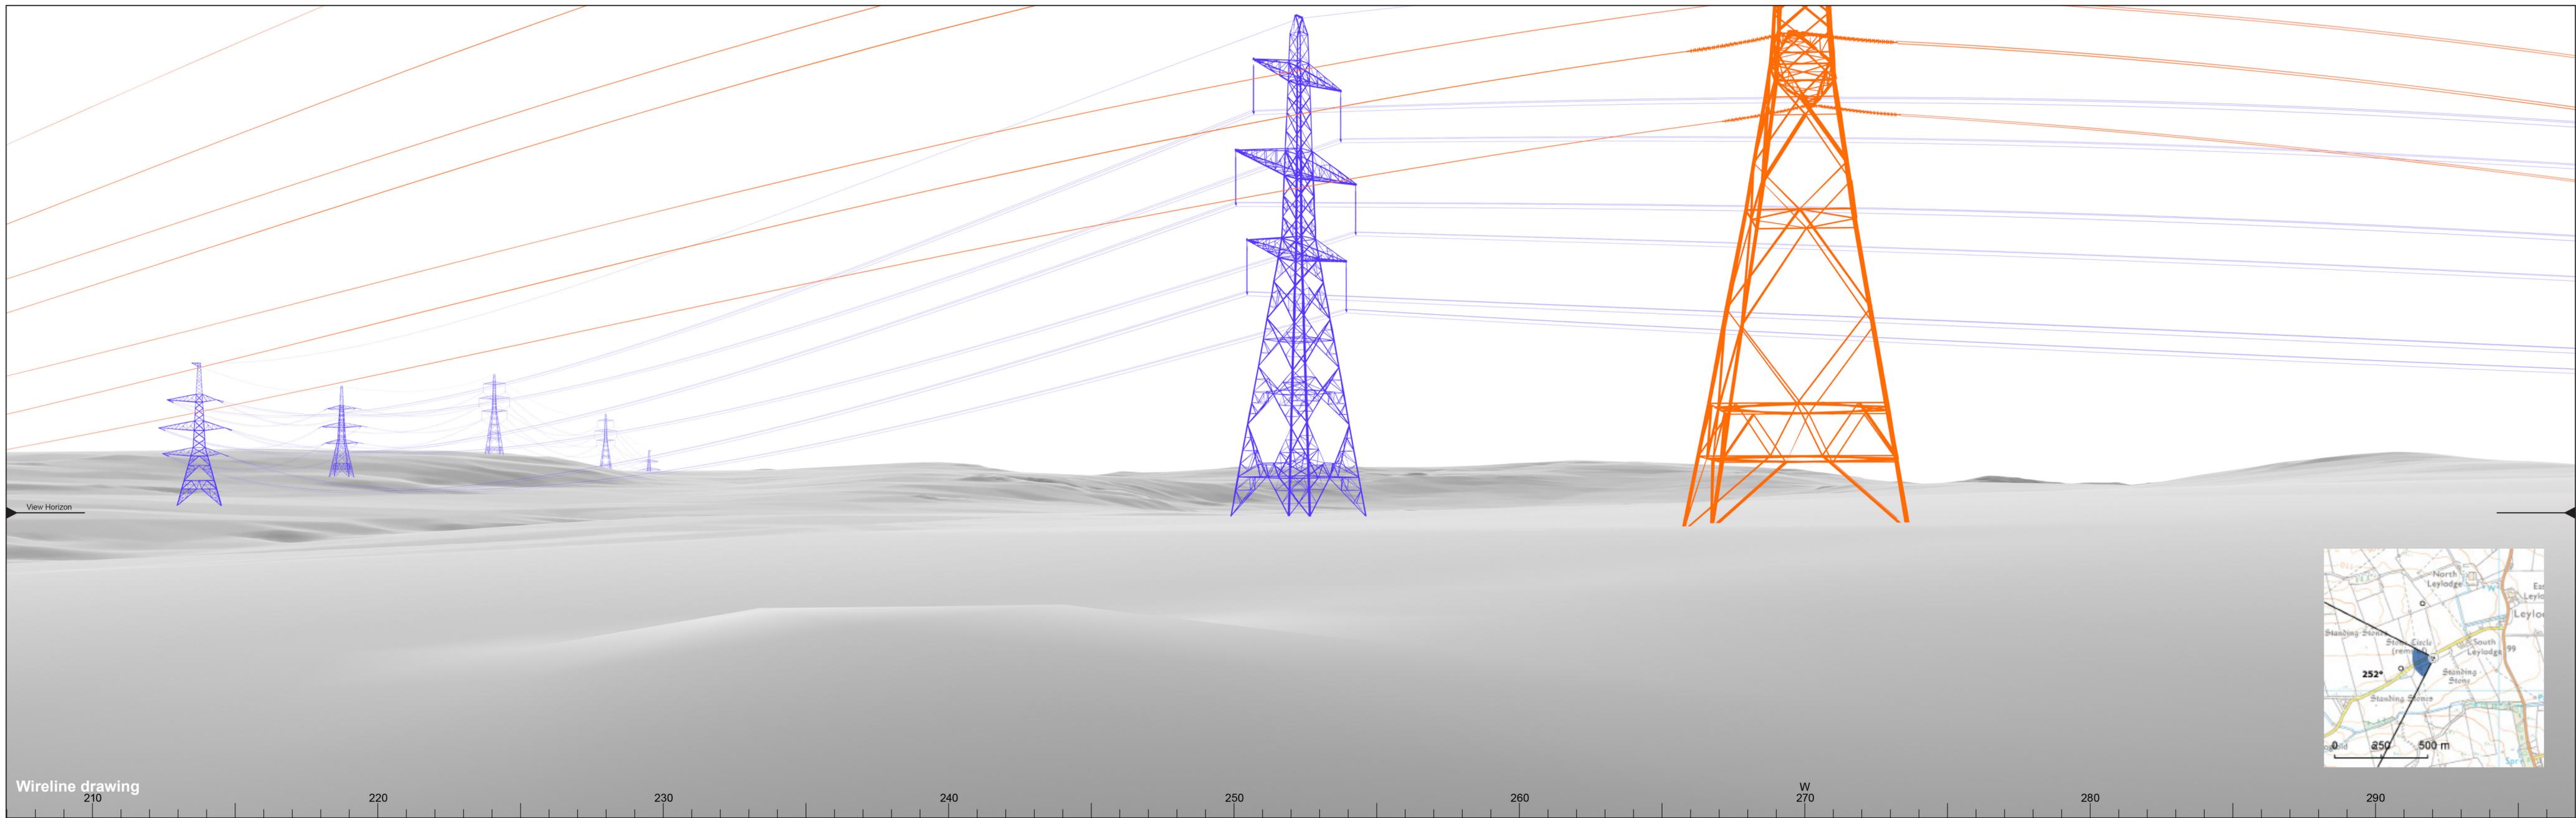

Wireline drawing
210 220 230 240 250 260 270 280 290

OS reference: 376652E 813177N
 AOD: 109.46 m
 Direction of view: 252°
 Nearest tower: 187 m

Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm
 Paper size: 841 x 297 mm (half A1)
 Correct printed image size: 820 x 260 mm

Note: The view horizon has been adjusted in this view to increase vertical visibility of towers


Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL
■ The Proposed Development – Kintore to Tealing 400 kV OHL



Figure: A9.3.70a
Southside Cottage Leylodge



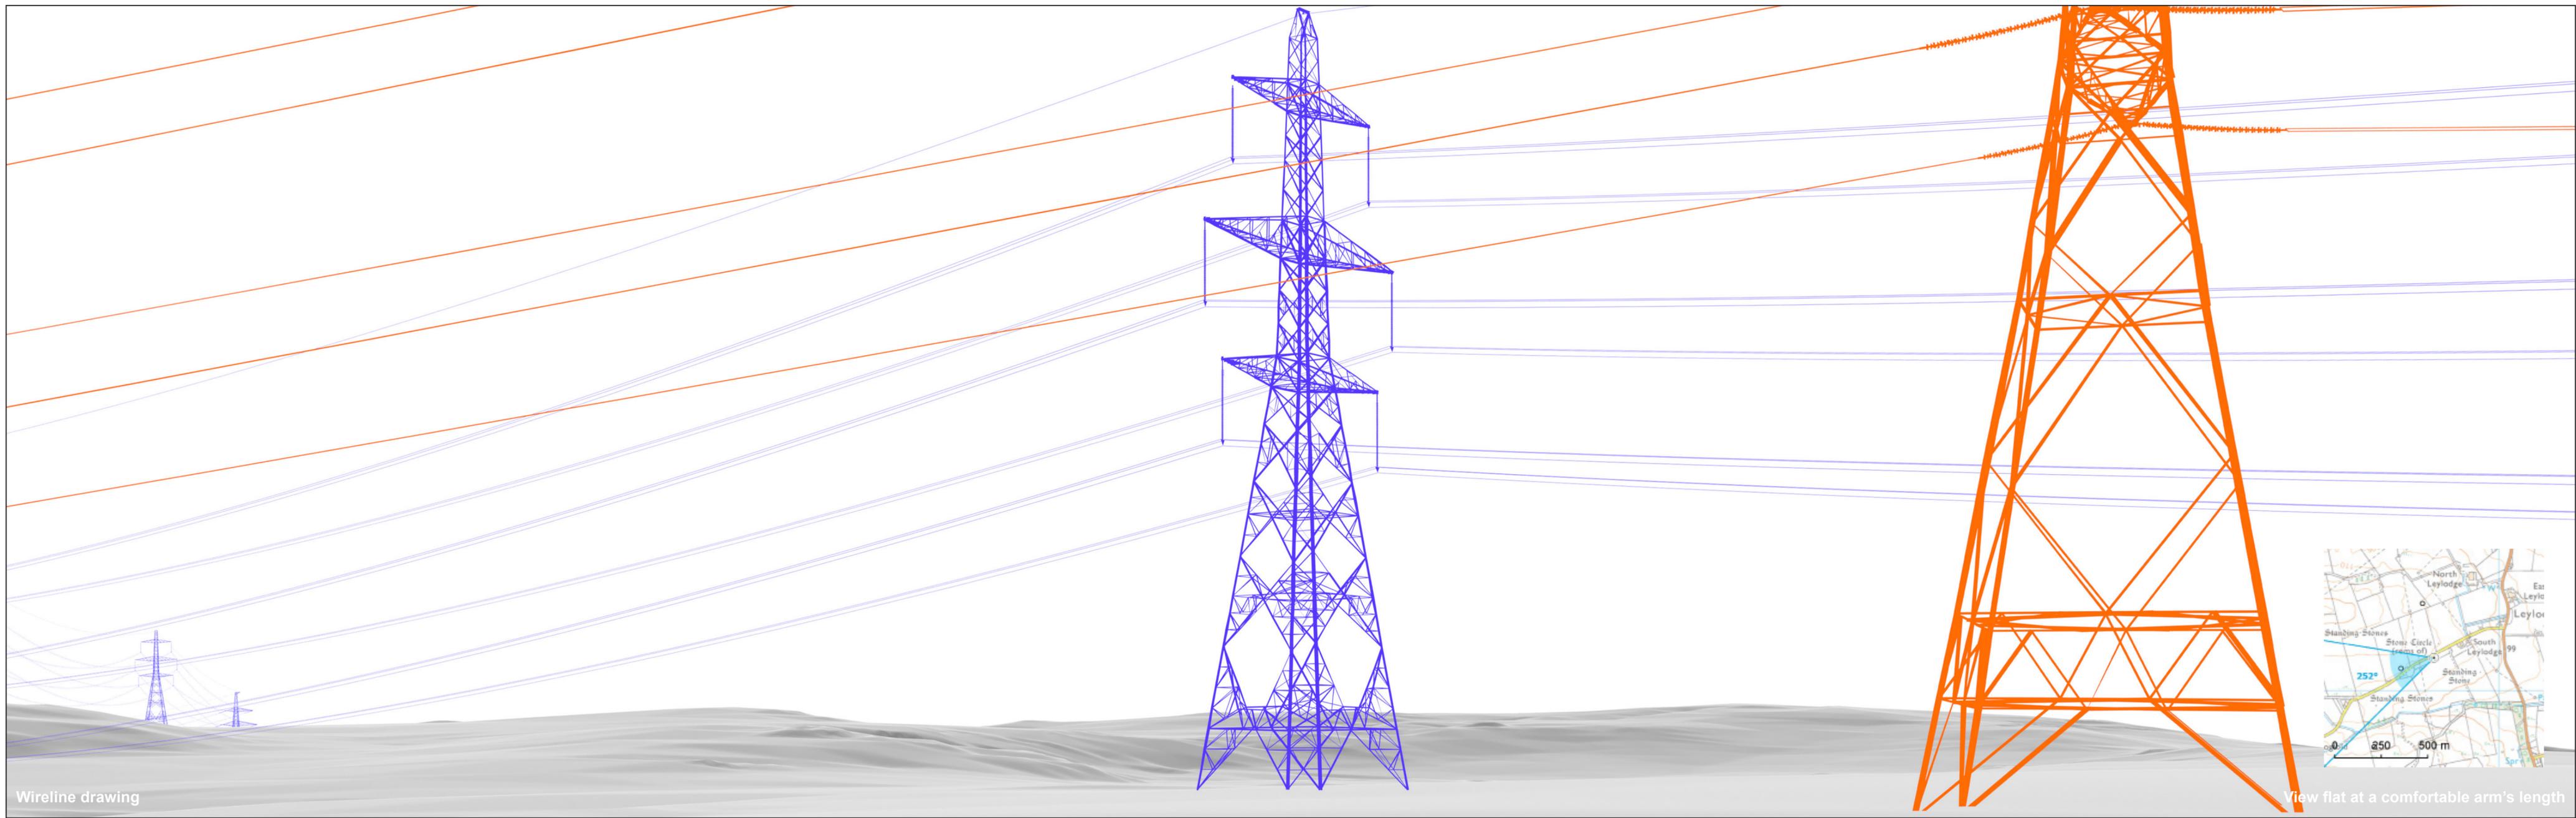

© Crown copyright and database rights 2025 Ordnance Survey data. Licence number: 0100051673

Wireline drawing



View flat at a comfortable arm's length


OS reference:	376652E 813177N	Horizontal field of view:	53.5° (planar projection)
AOD:	109.46 m	Principal distance:	812.5 mm
Direction of view:	252°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	187 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL	■ The Proposed Development – Kintore to Tealing 400 kV OHL
---	--

Figure: A9.3.70b
Southside Cottage Leylodge



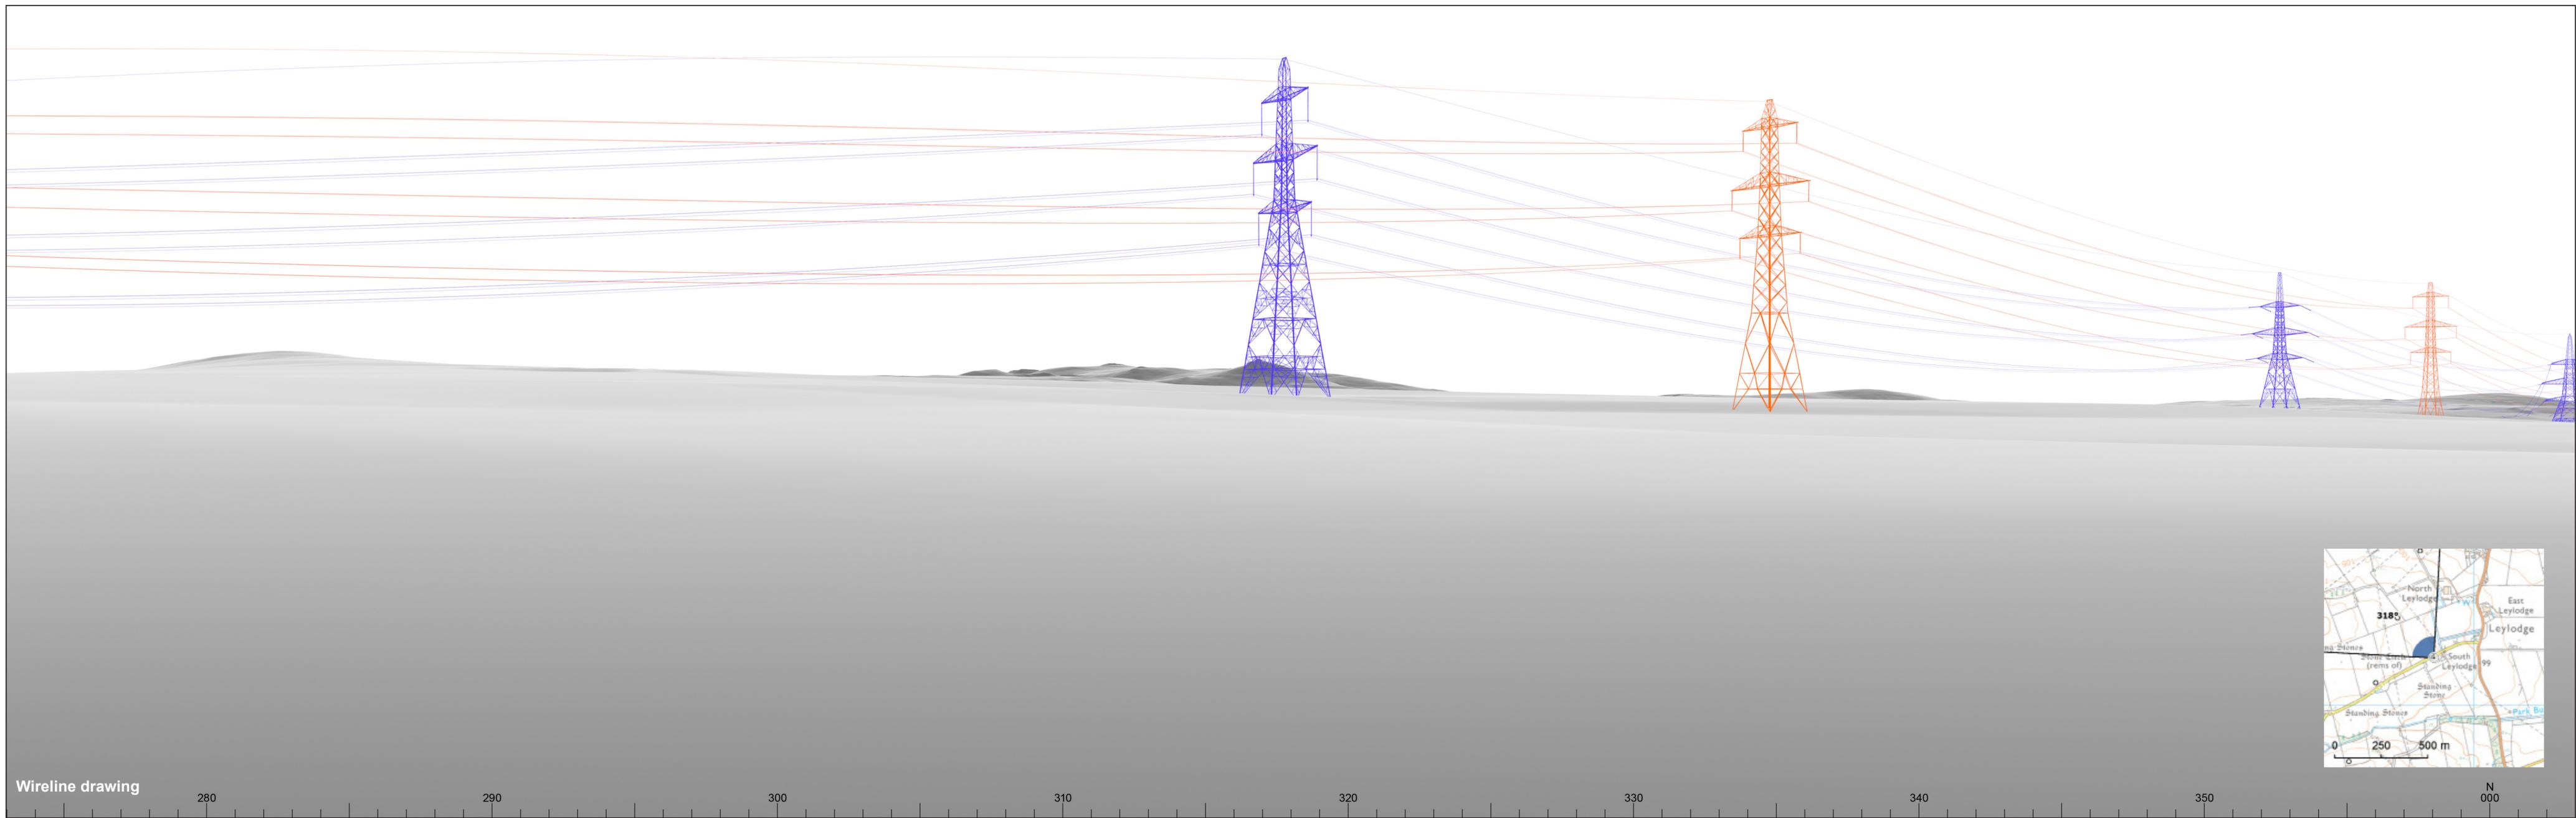

Wireline drawing

280

290

300

310

320

330

340

350

N
000




OS reference:	376787E 813255N	Horizontal field of view:	90° (cylindrical projection)
AOD:	105.48 m	Principal distance:	522 mm
Direction of view:	318°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	291 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

 Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL	 The Proposed Development – Kintore to Tealing 400 kV OHL
---	--

Figure: A9.3.71
South Leylodge Steading

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100022432

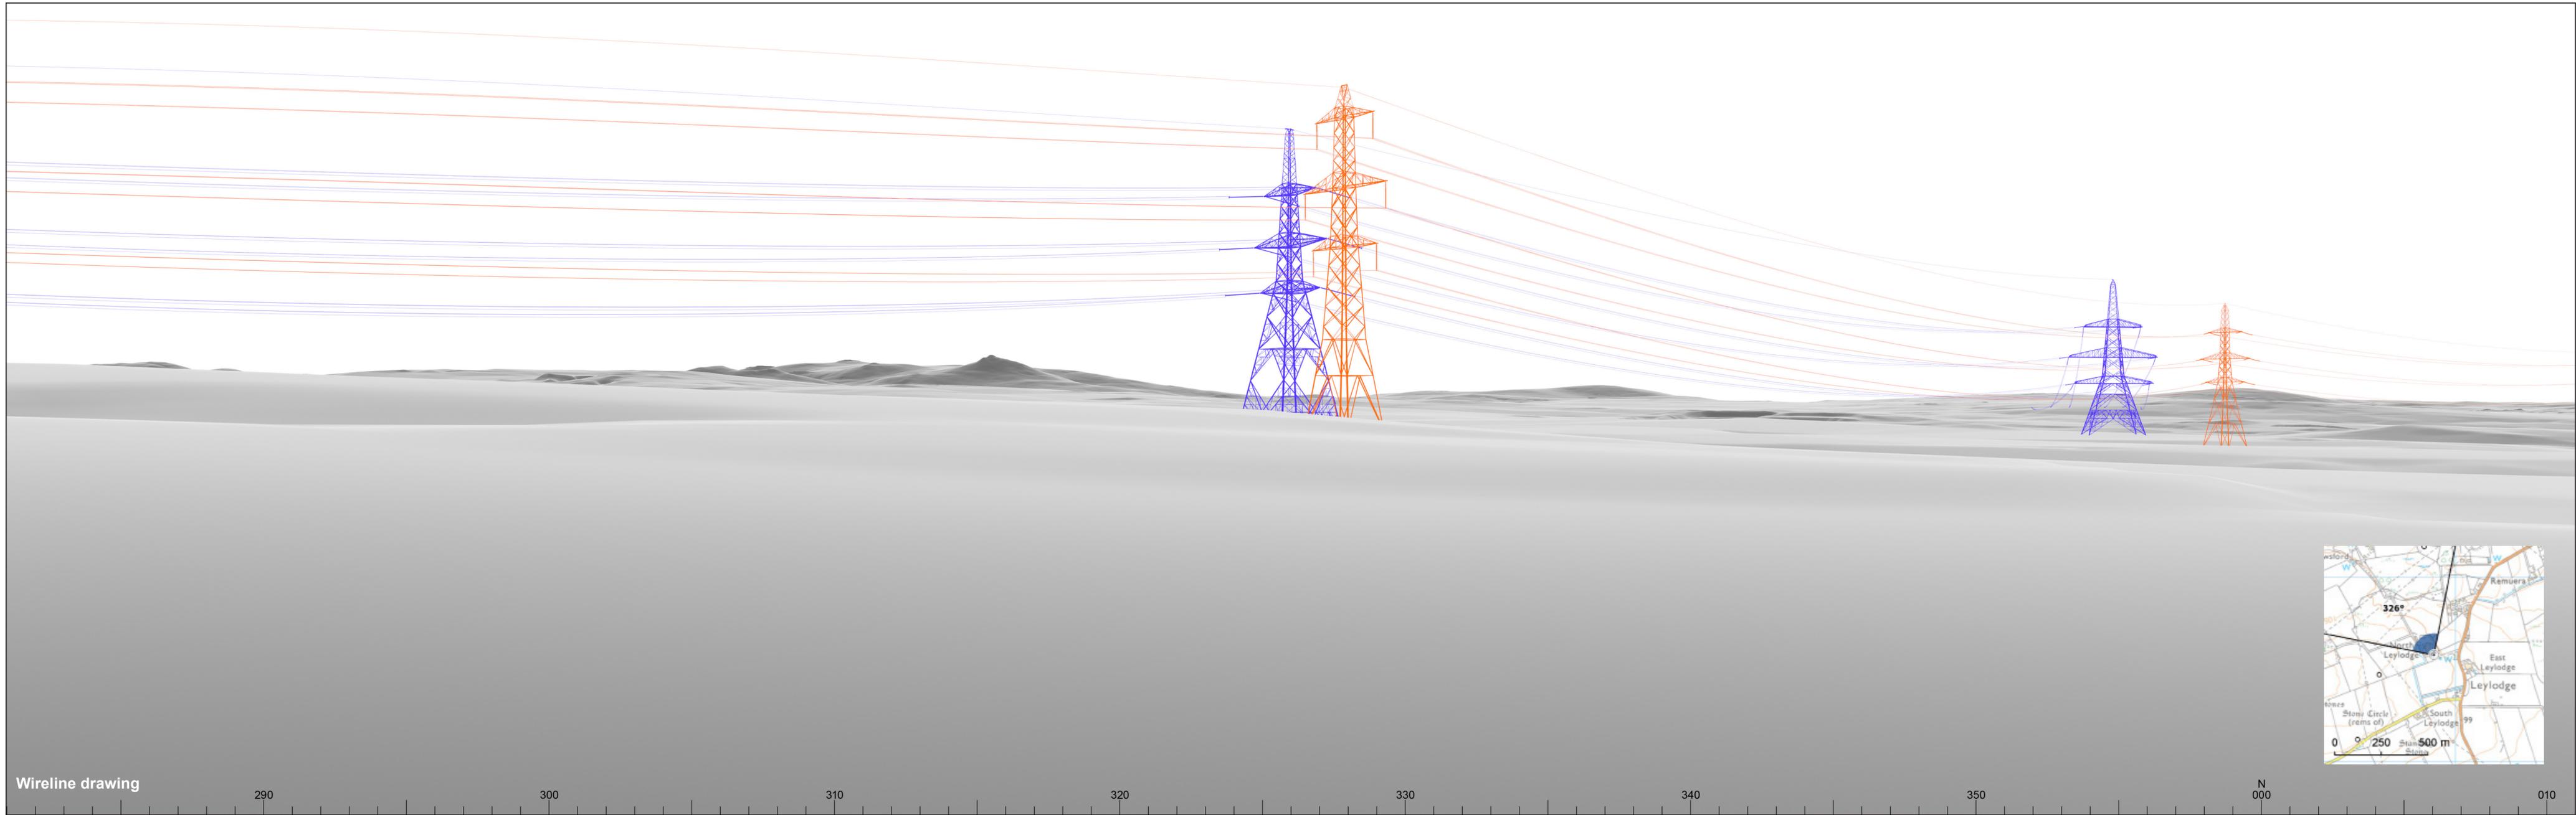

Wireline drawing




OS reference:	376885E 813578N	Horizontal field of view:	90° (cylindrical projection)
AOD:	102.29 m	Principal distance:	522 mm
Direction of view:	326°	Paper size:	841 x 297 mm (half A1)
Nearest tower:	308 m	Correct printed image size:	820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL	The Proposed Development – Kintore to Tealing 400 kV OHL
---	--




Figure: A9.3.72
North Leylodge Farm

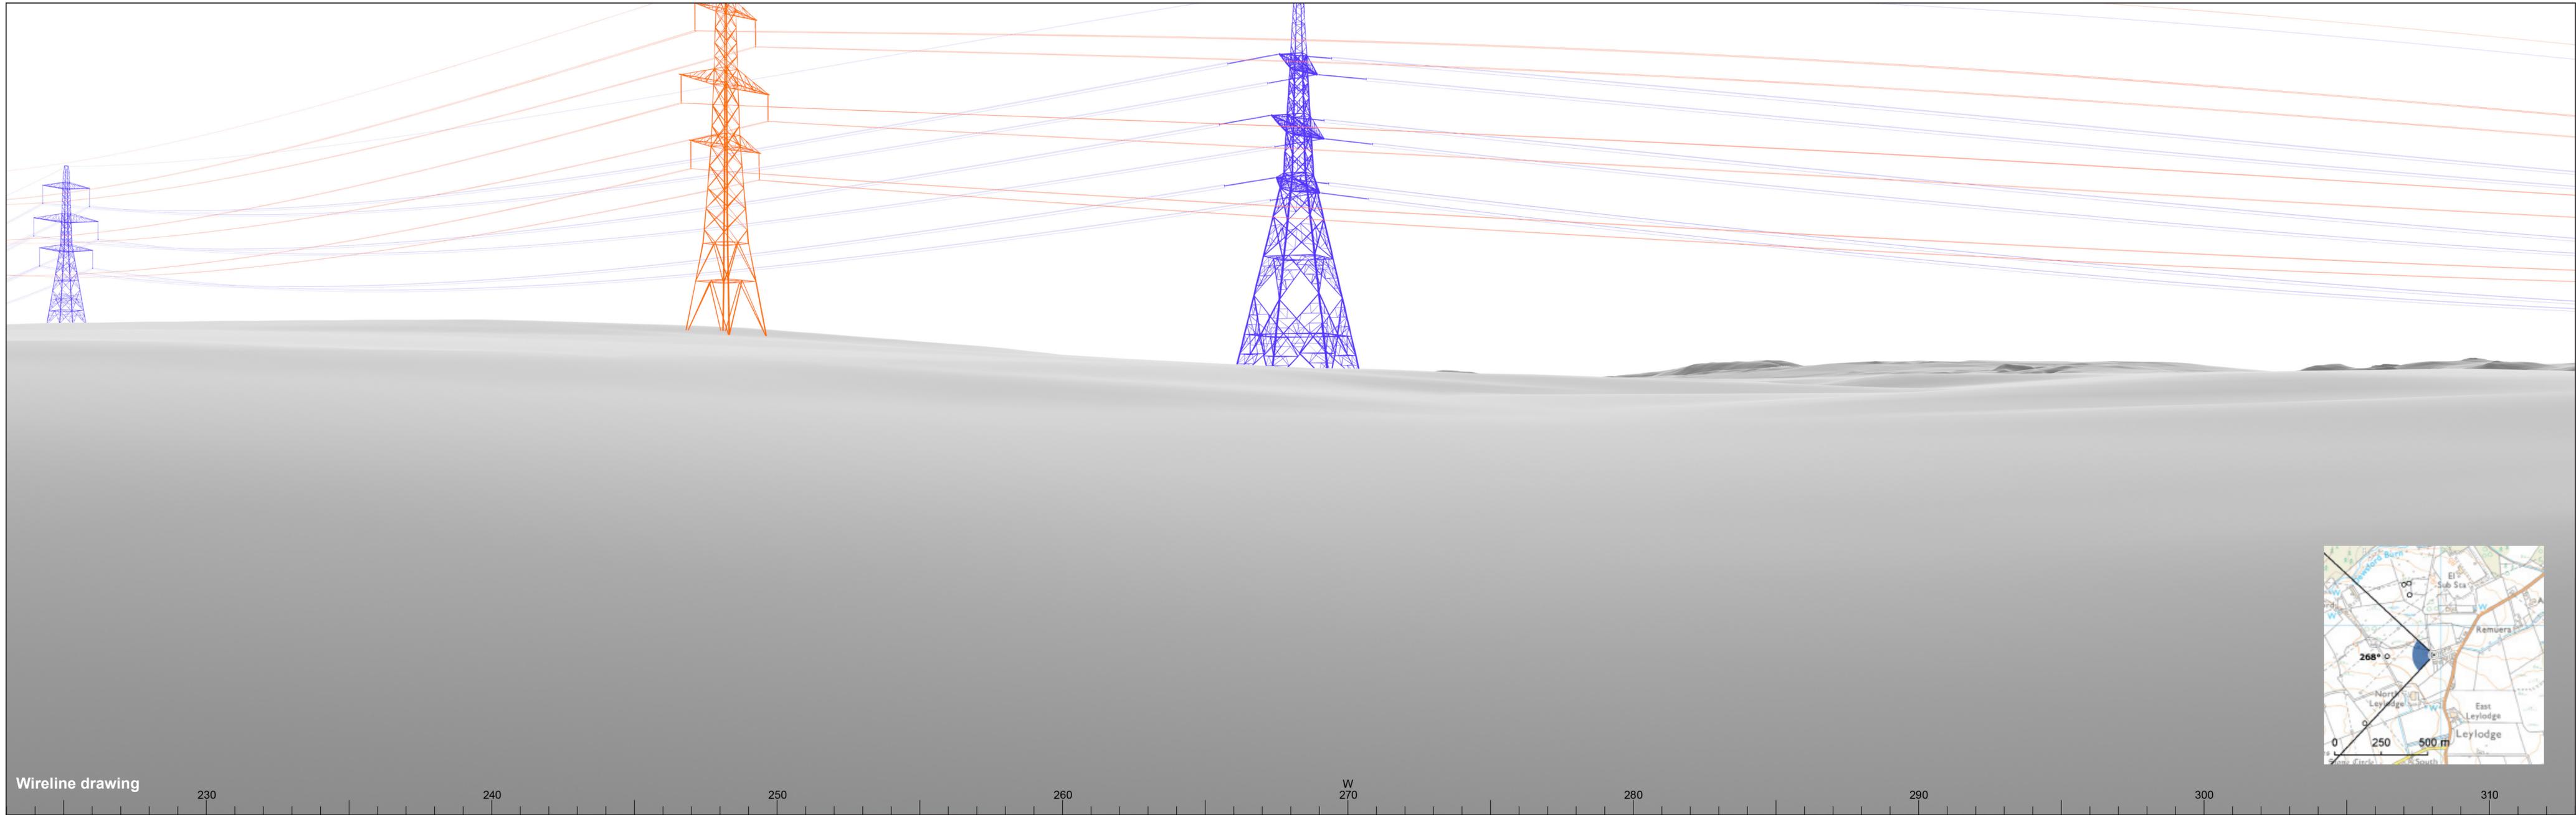

Wireline drawing

230 240 250 260 W 270 280 290 300 310

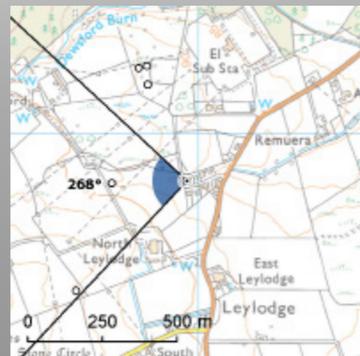

OS reference: 376963E 813841N
 AOD: 90.31 m
 Direction of view: 268°
 Nearest tower: 250 m

Horizontal field of view: 90° (cylindrical projection)
 Principal distance: 522 mm
 Paper size: 841 x 297 mm (half A1)
 Correct printed image size: 820 x 260 mm

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 Crown copyright and database right 2025 all rights reserved.
 Ordnance Survey Licence number 0100022432.
 SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey.

■ Permanent realignment of part of the existing Kintore to Tealing 275 kV OHL
■ The Proposed Development – Kintore to Tealing 400 kV OHL

Figure: A9.3.73
Beches, Leylodge

© Crown copyright and database rights 2025 Ordnance Survey data Licence number: 0100031673