


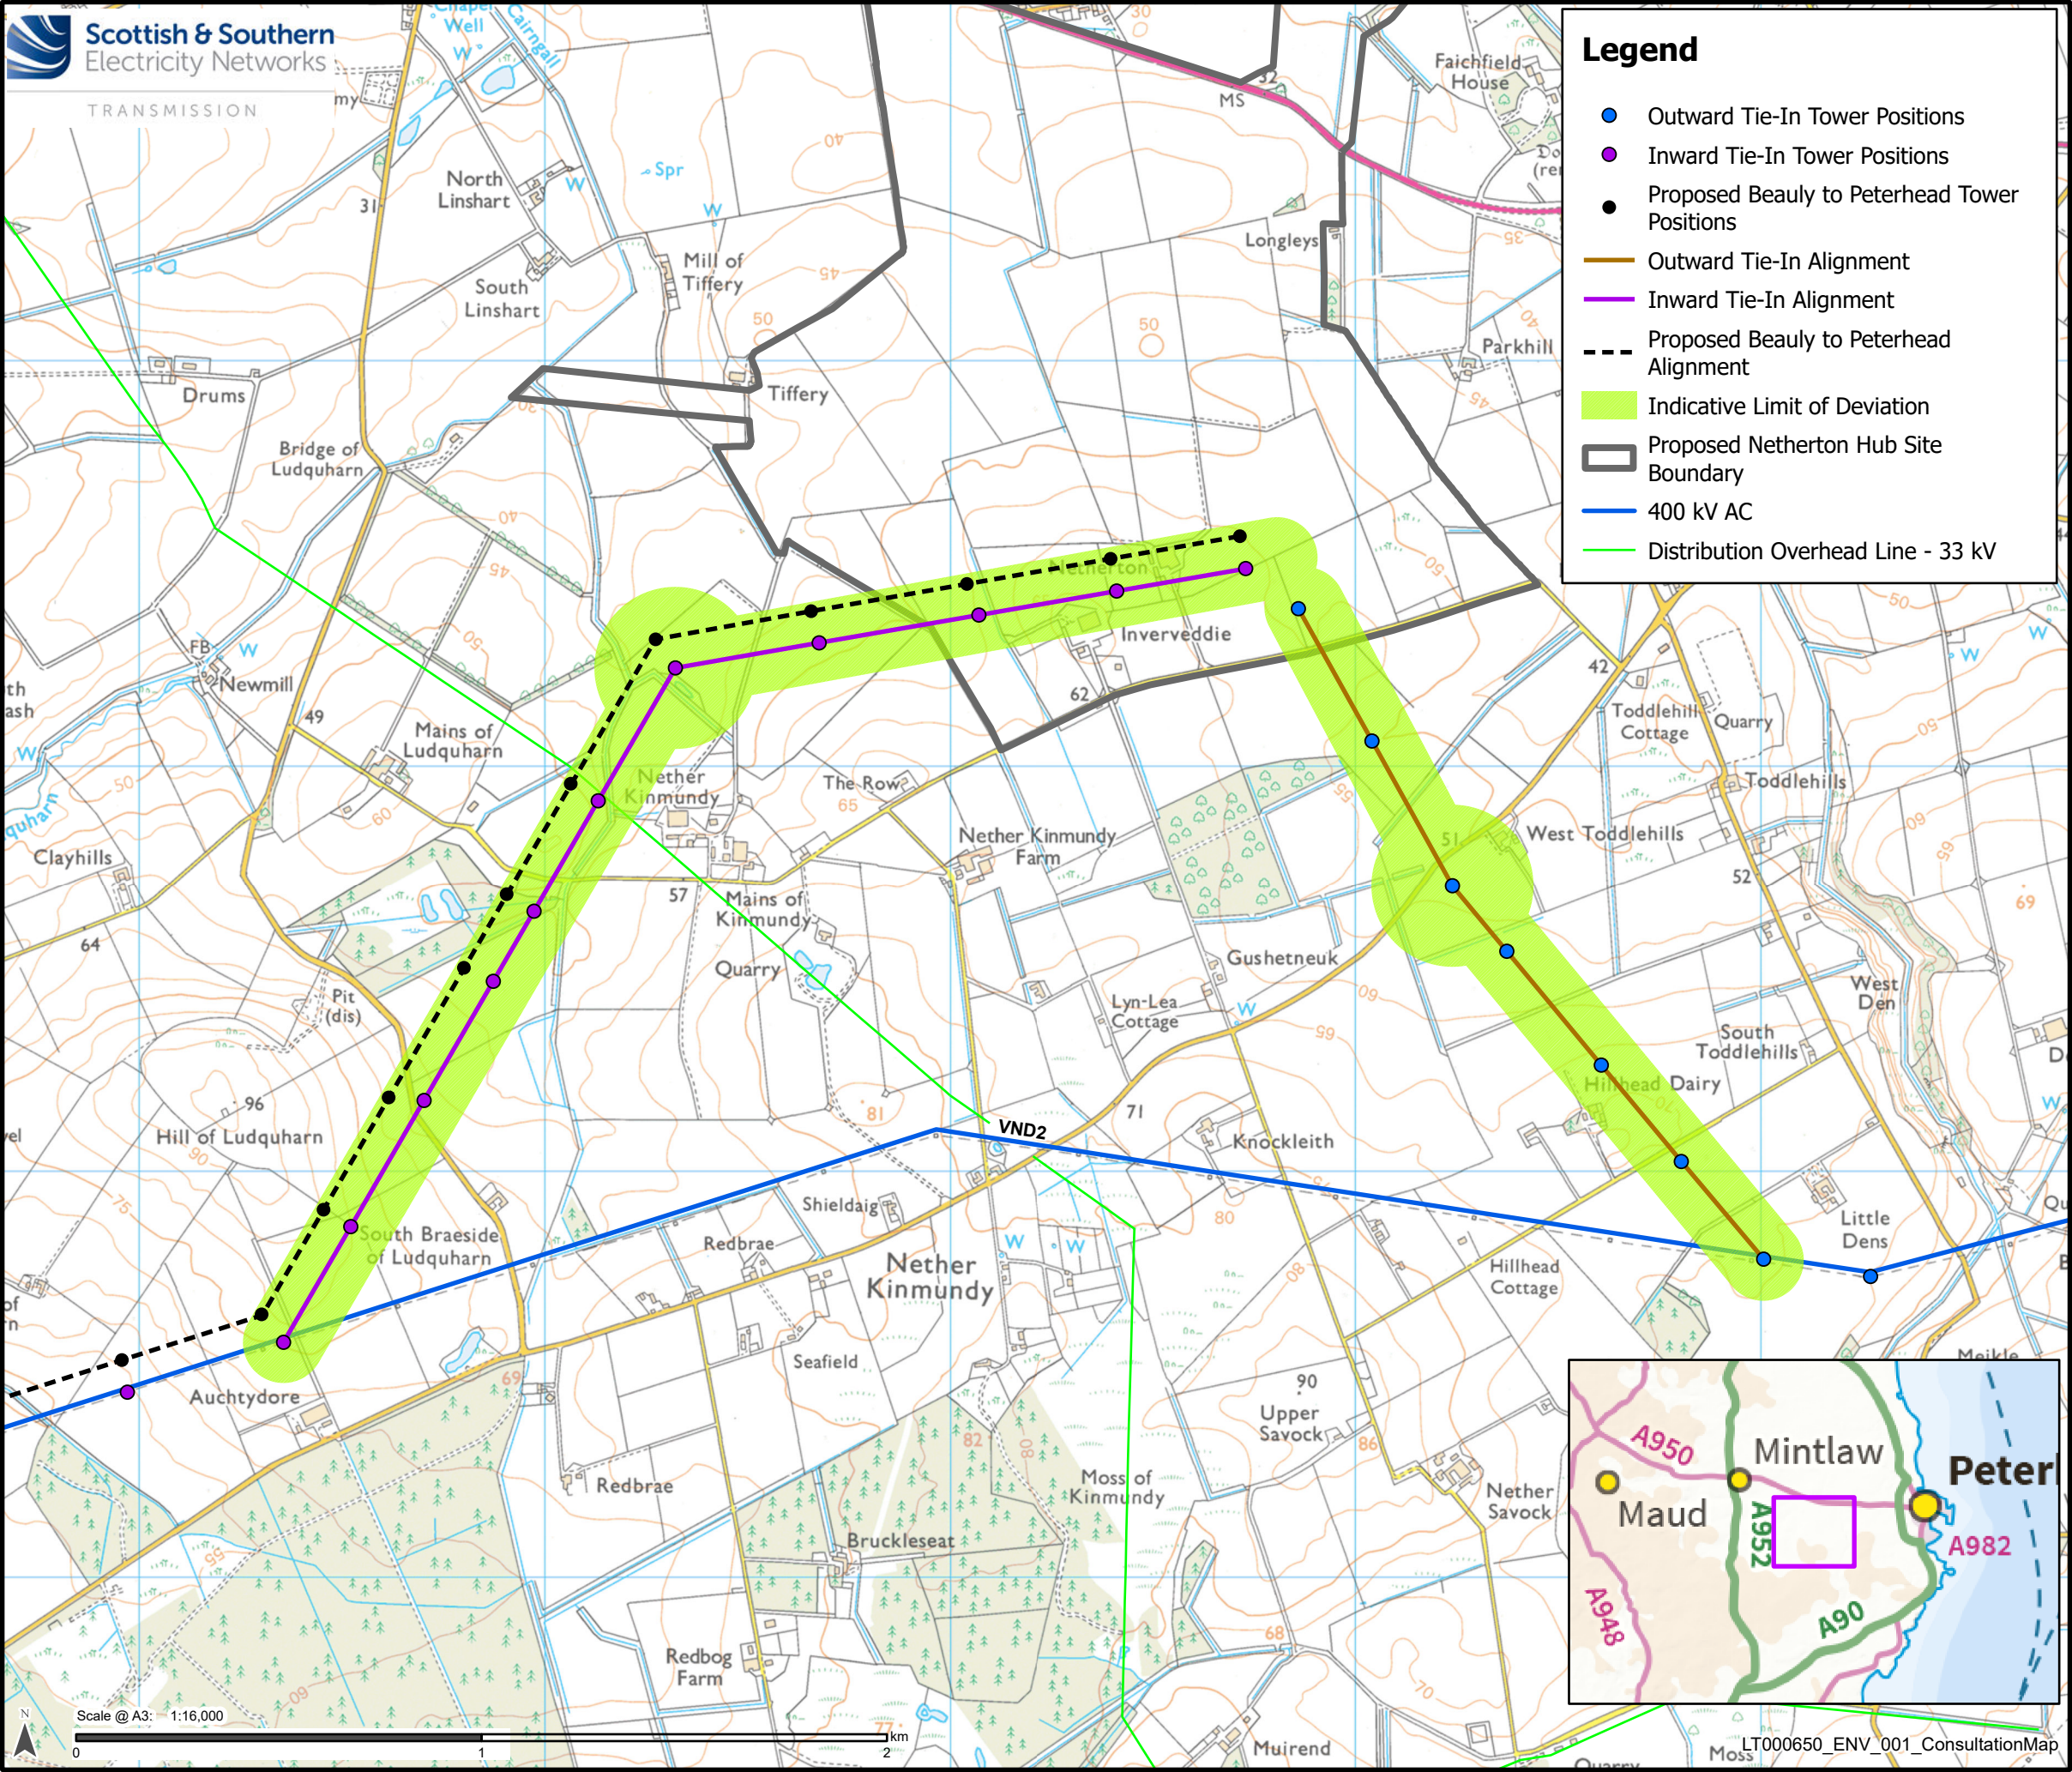

Legend

- Outward Tie-In Tower Positions
- Inward Tie-In Tower Positions
- Proposed Beauly to Peterhead Tower Positions
- Outward Tie-In Alignment
- Inward Tie-In Alignment
- - - Proposed Beauly to Peterhead Alignment
- Indicative Limit of Deviation
- Proposed Netherton Hub Site Boundary
- 400 kV AC
- Distribution Overhead Line - 33 kV