


Netherton Hub 400 kV OHL Connection to New Deer and Peterhead: Tie-In

Environmental Appraisal Report Volume 2 Figures: Part 4

July 2026



Scottish Hydro Electric Transmission plc
Inveralmond House
200 Dunkeld Road
Perth PH1 3AQ
Tel: +44 (0)1738 456 000
www.ssen-transmission.co.uk

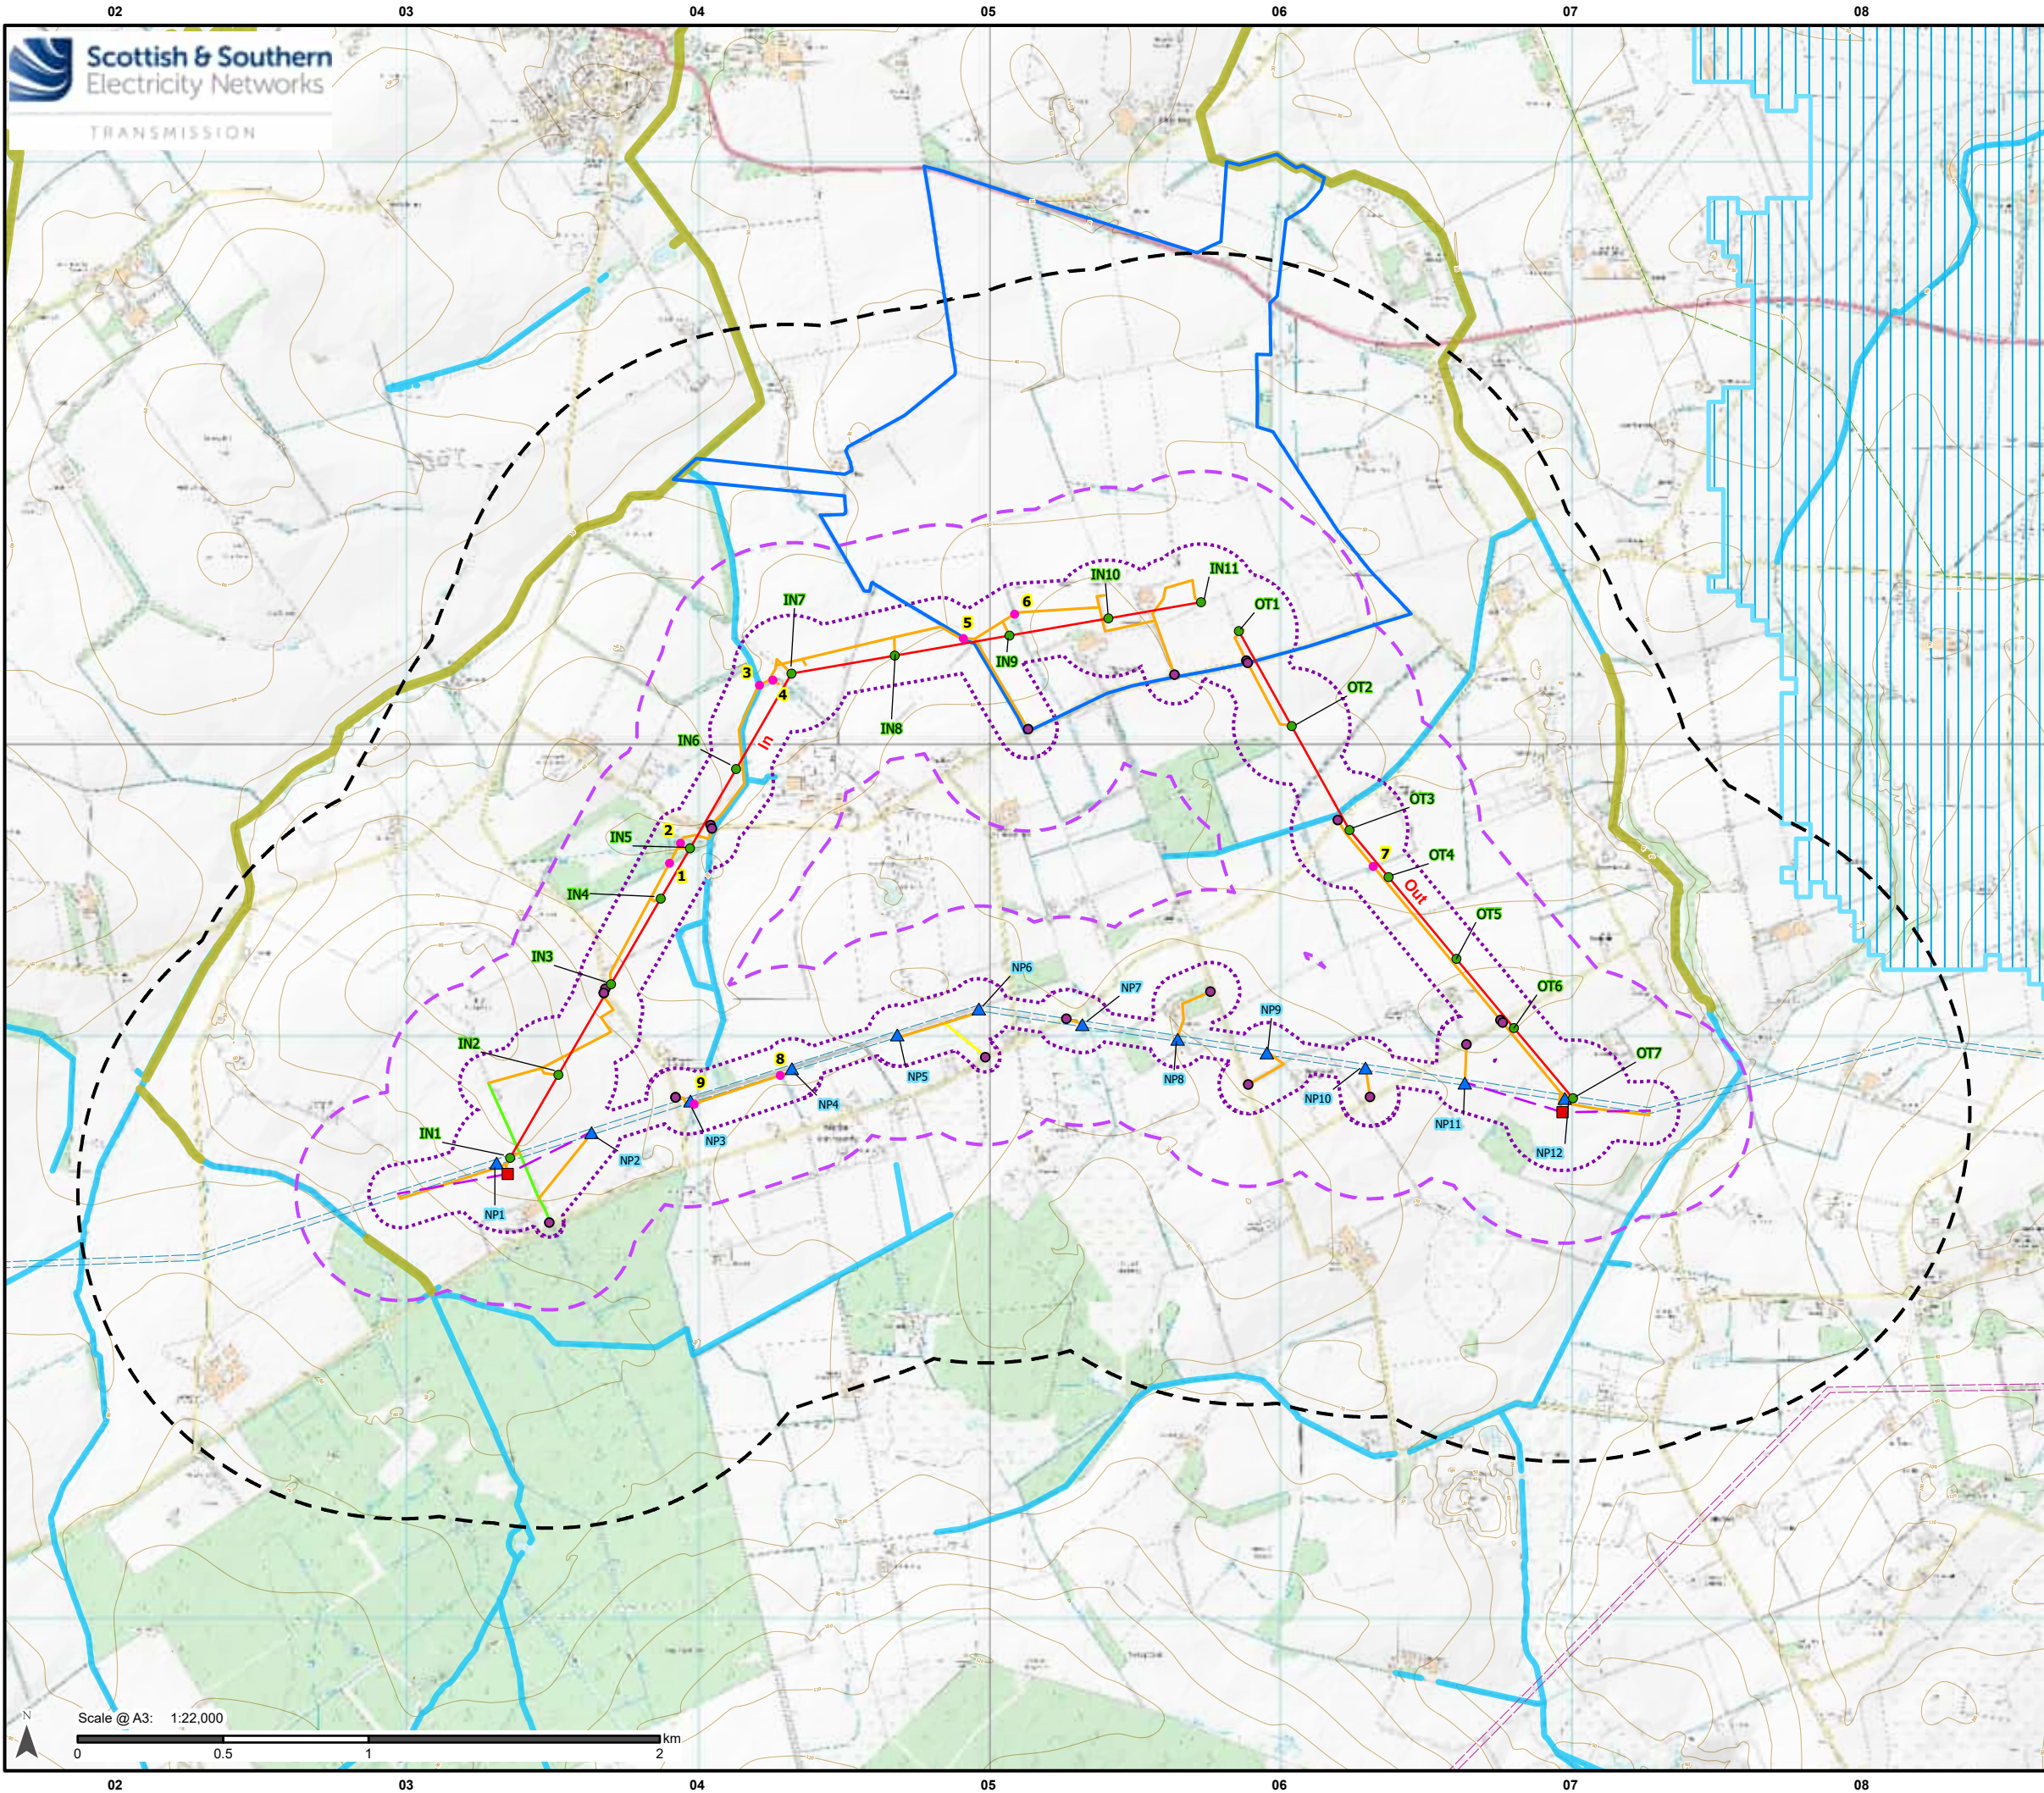

Legend

- Tower Locations
- Temporary Diversion Towers
- Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- Limit of Deviation
- 250 m Buffer From Limit of Deviation
- 1 km Study Area
- Netherton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
 - Upgrade - Good/Fair Condition
 - Upgrade - Very Poor Condition
- Watercourse crossings
- Watercourses
- Contours (10 m)
- Existing Overhead Line
 - 132 kV
 - 275 kV
 - 400 kV
- Hydrological Features
 - SEPA Drinking Water Protected Area (Catchments)
 - SEPA Recommended Riparian Corridor
 - 10m Buffer
 - 15m Buffer

Scale: 1:1,000,000

Crown copyright and database right 2020 all rights reserved.
Contains OS data © Crown Copyright and database right 2024, © Scottish Environment Protection Agency. Some features of this information are based on digital spatial data licensed from the Centre for Ecology and Hydrology Copyright NERC (CEH). Contains OS data Copyright Crown copyright (and database right).
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT650

Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title: Figure 9.1 - Hydrological Features


Drawn by: AC Date: 19/05/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-012

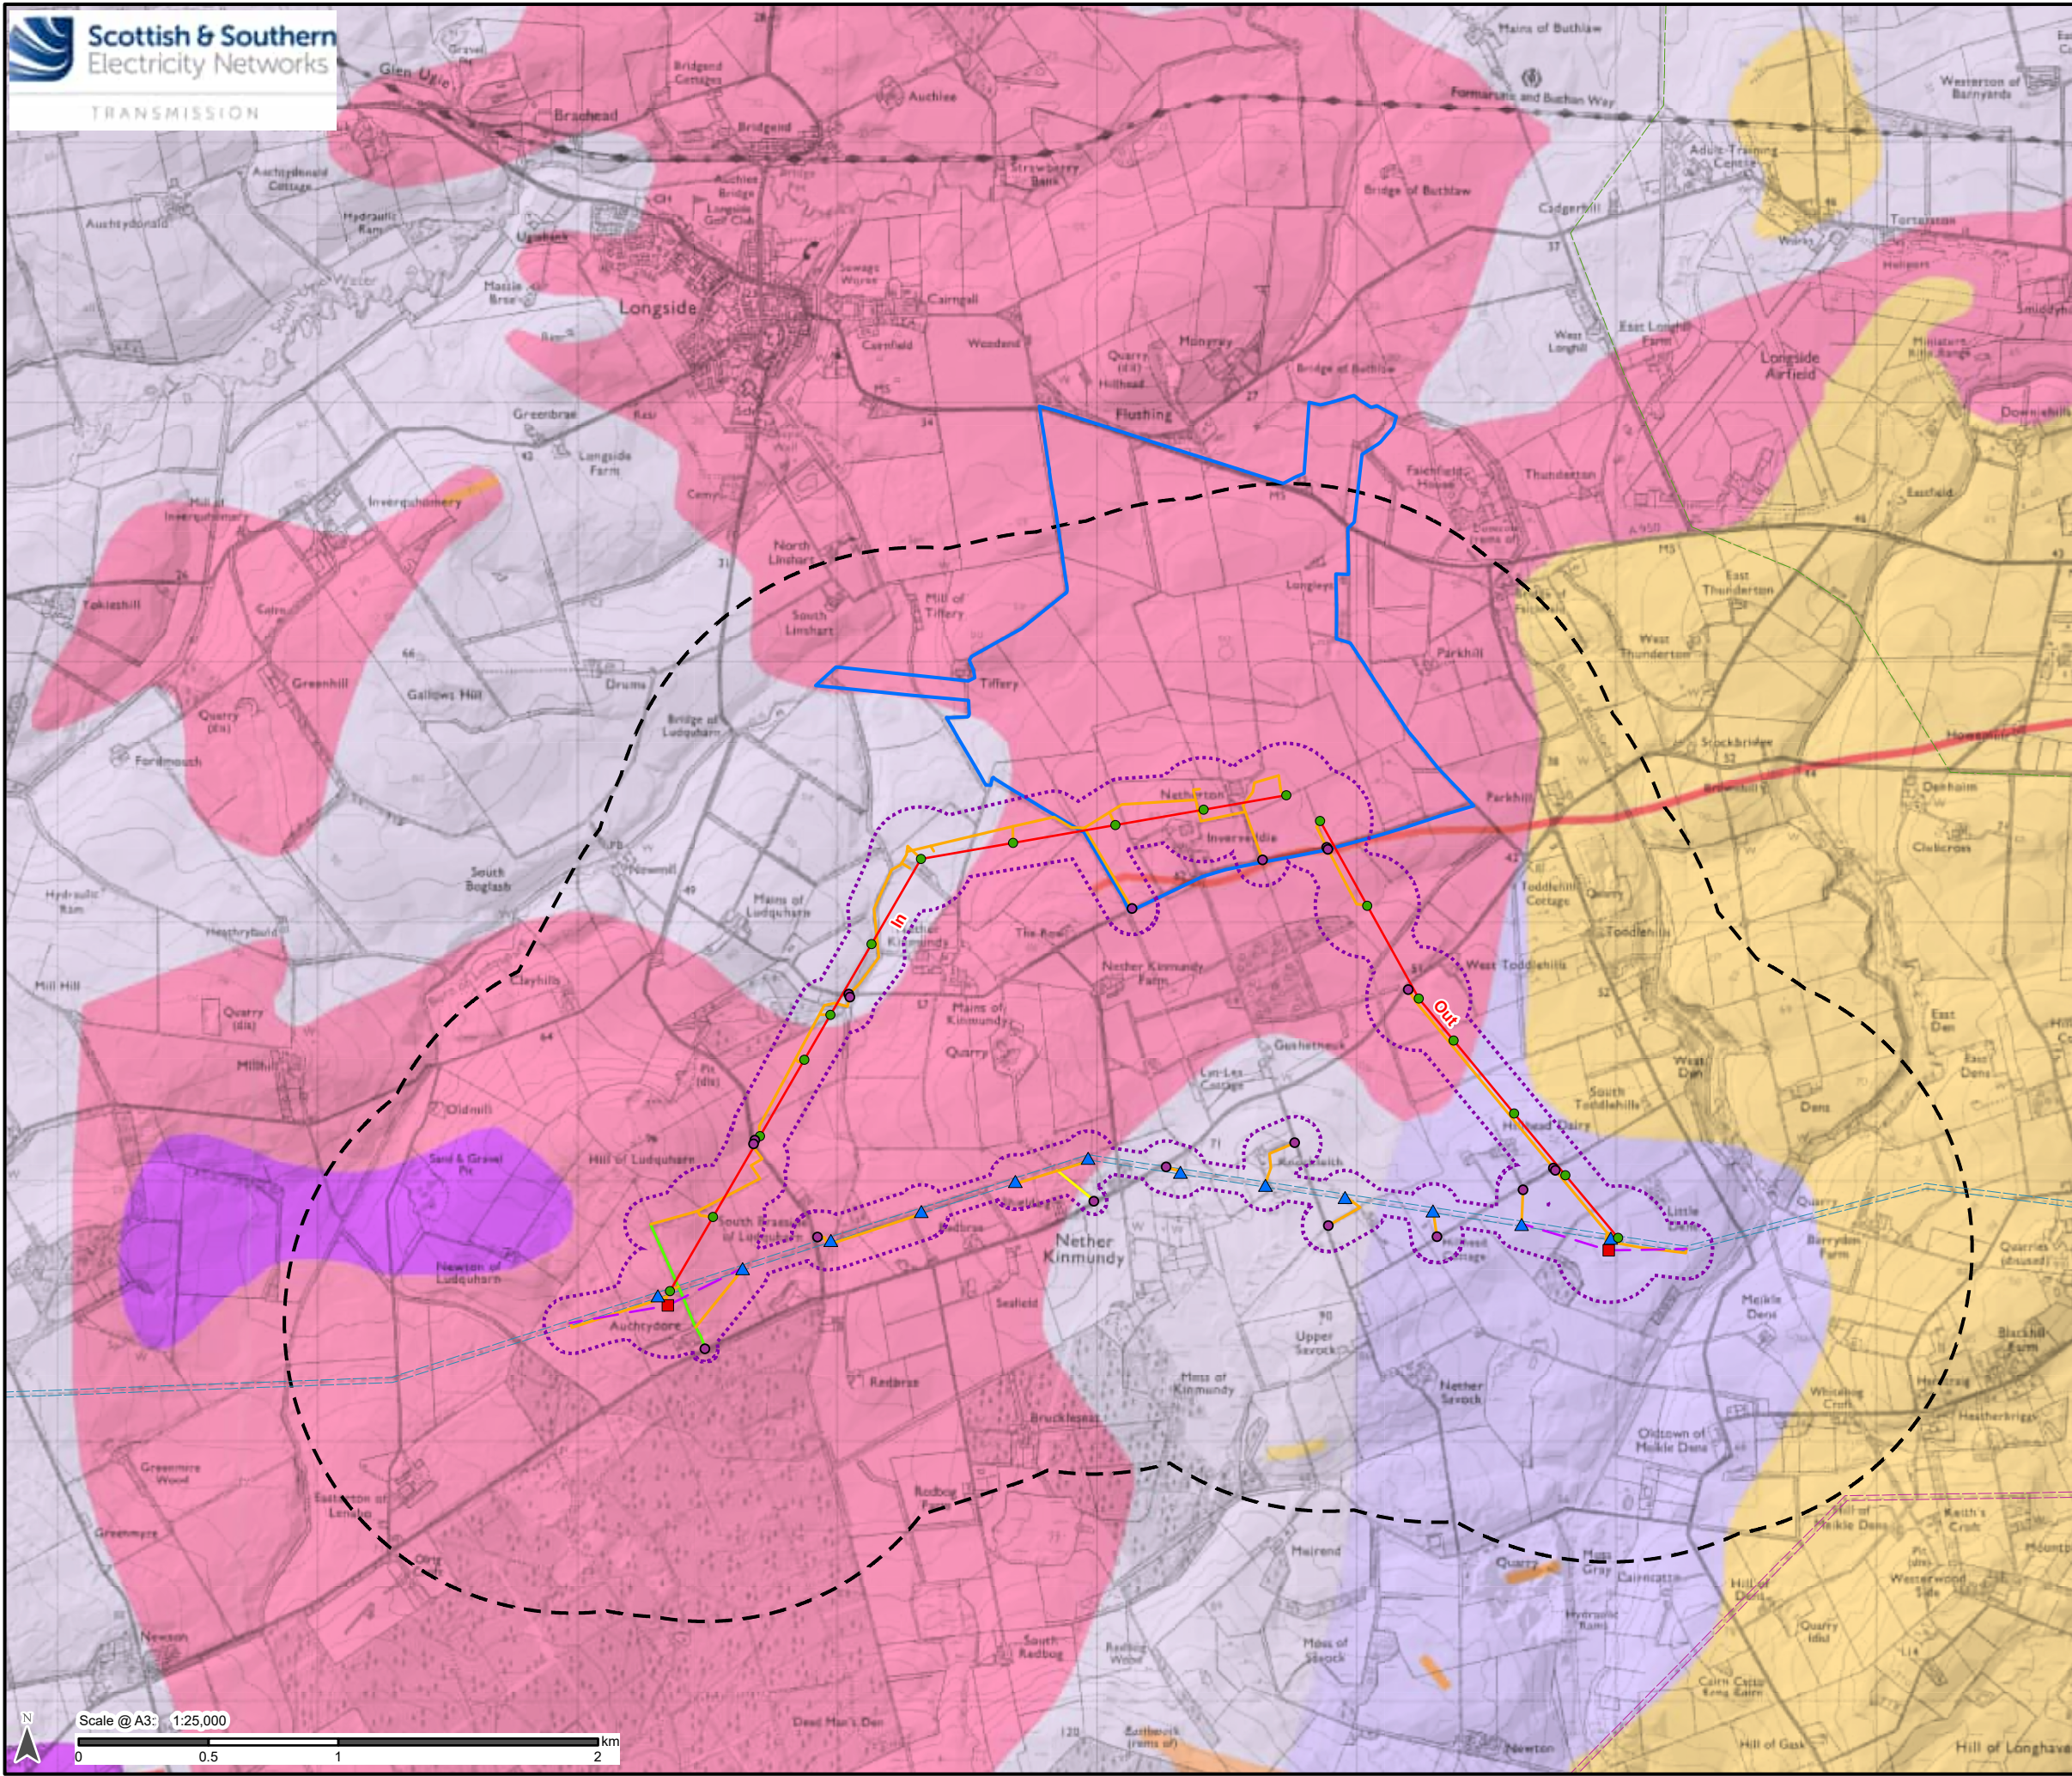

Legend

- Tower Locations
- Temporary Diversion Towers
- ▲ Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- - - Limit of Deviation
- 1 km Study Area
- Netherton Hub Site Boundary
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition
- Temporary Diversion Alignment
- Existing Overhead Line
- 132 kV
- 275 kV
- 400 kV
- Bedrock Geology
- Peterhead Pluton - Granite
- Forest of Deer Pluton - Melagranite, Biotite
- Collieston Formation - Pelite, Semipelite and Psammite
- Crinan Subgroup and Tayvallich Subgroup - Semipelite, Pelite and Psammite
- Deeside Subsuite - Granite
- North Britain Siluro-devonian Calc-alkaline Dyke Suite - Felsite
- Buchan Ridge Gravel Member - Clay and Gravel
- North-east Grampian Granitic Suite (Ordovician) - Granodiorite
- Forest of Deer Pluton - Diorite
- North-east Grampian Granitic Suite (Ordovician) - Diorite
- North Britain Late Carboniferous Tholeiitic Suite - Quartz-Microgabbro

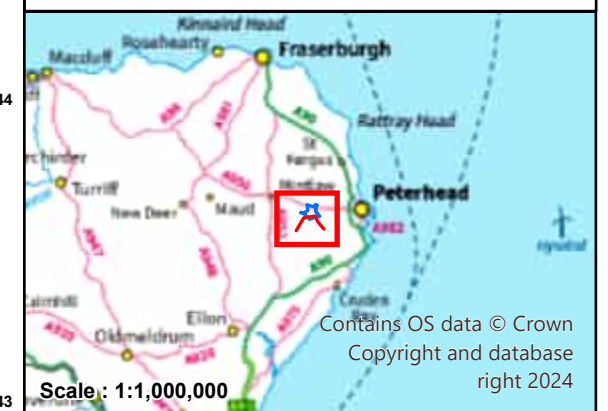

Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC0006813445.
Contains British Geological Survey materials © UKRI (2026)


SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT650
Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title:
Figure 9.2 - Bedrock Geology


Drawn by: AC Date: 20/04/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-008

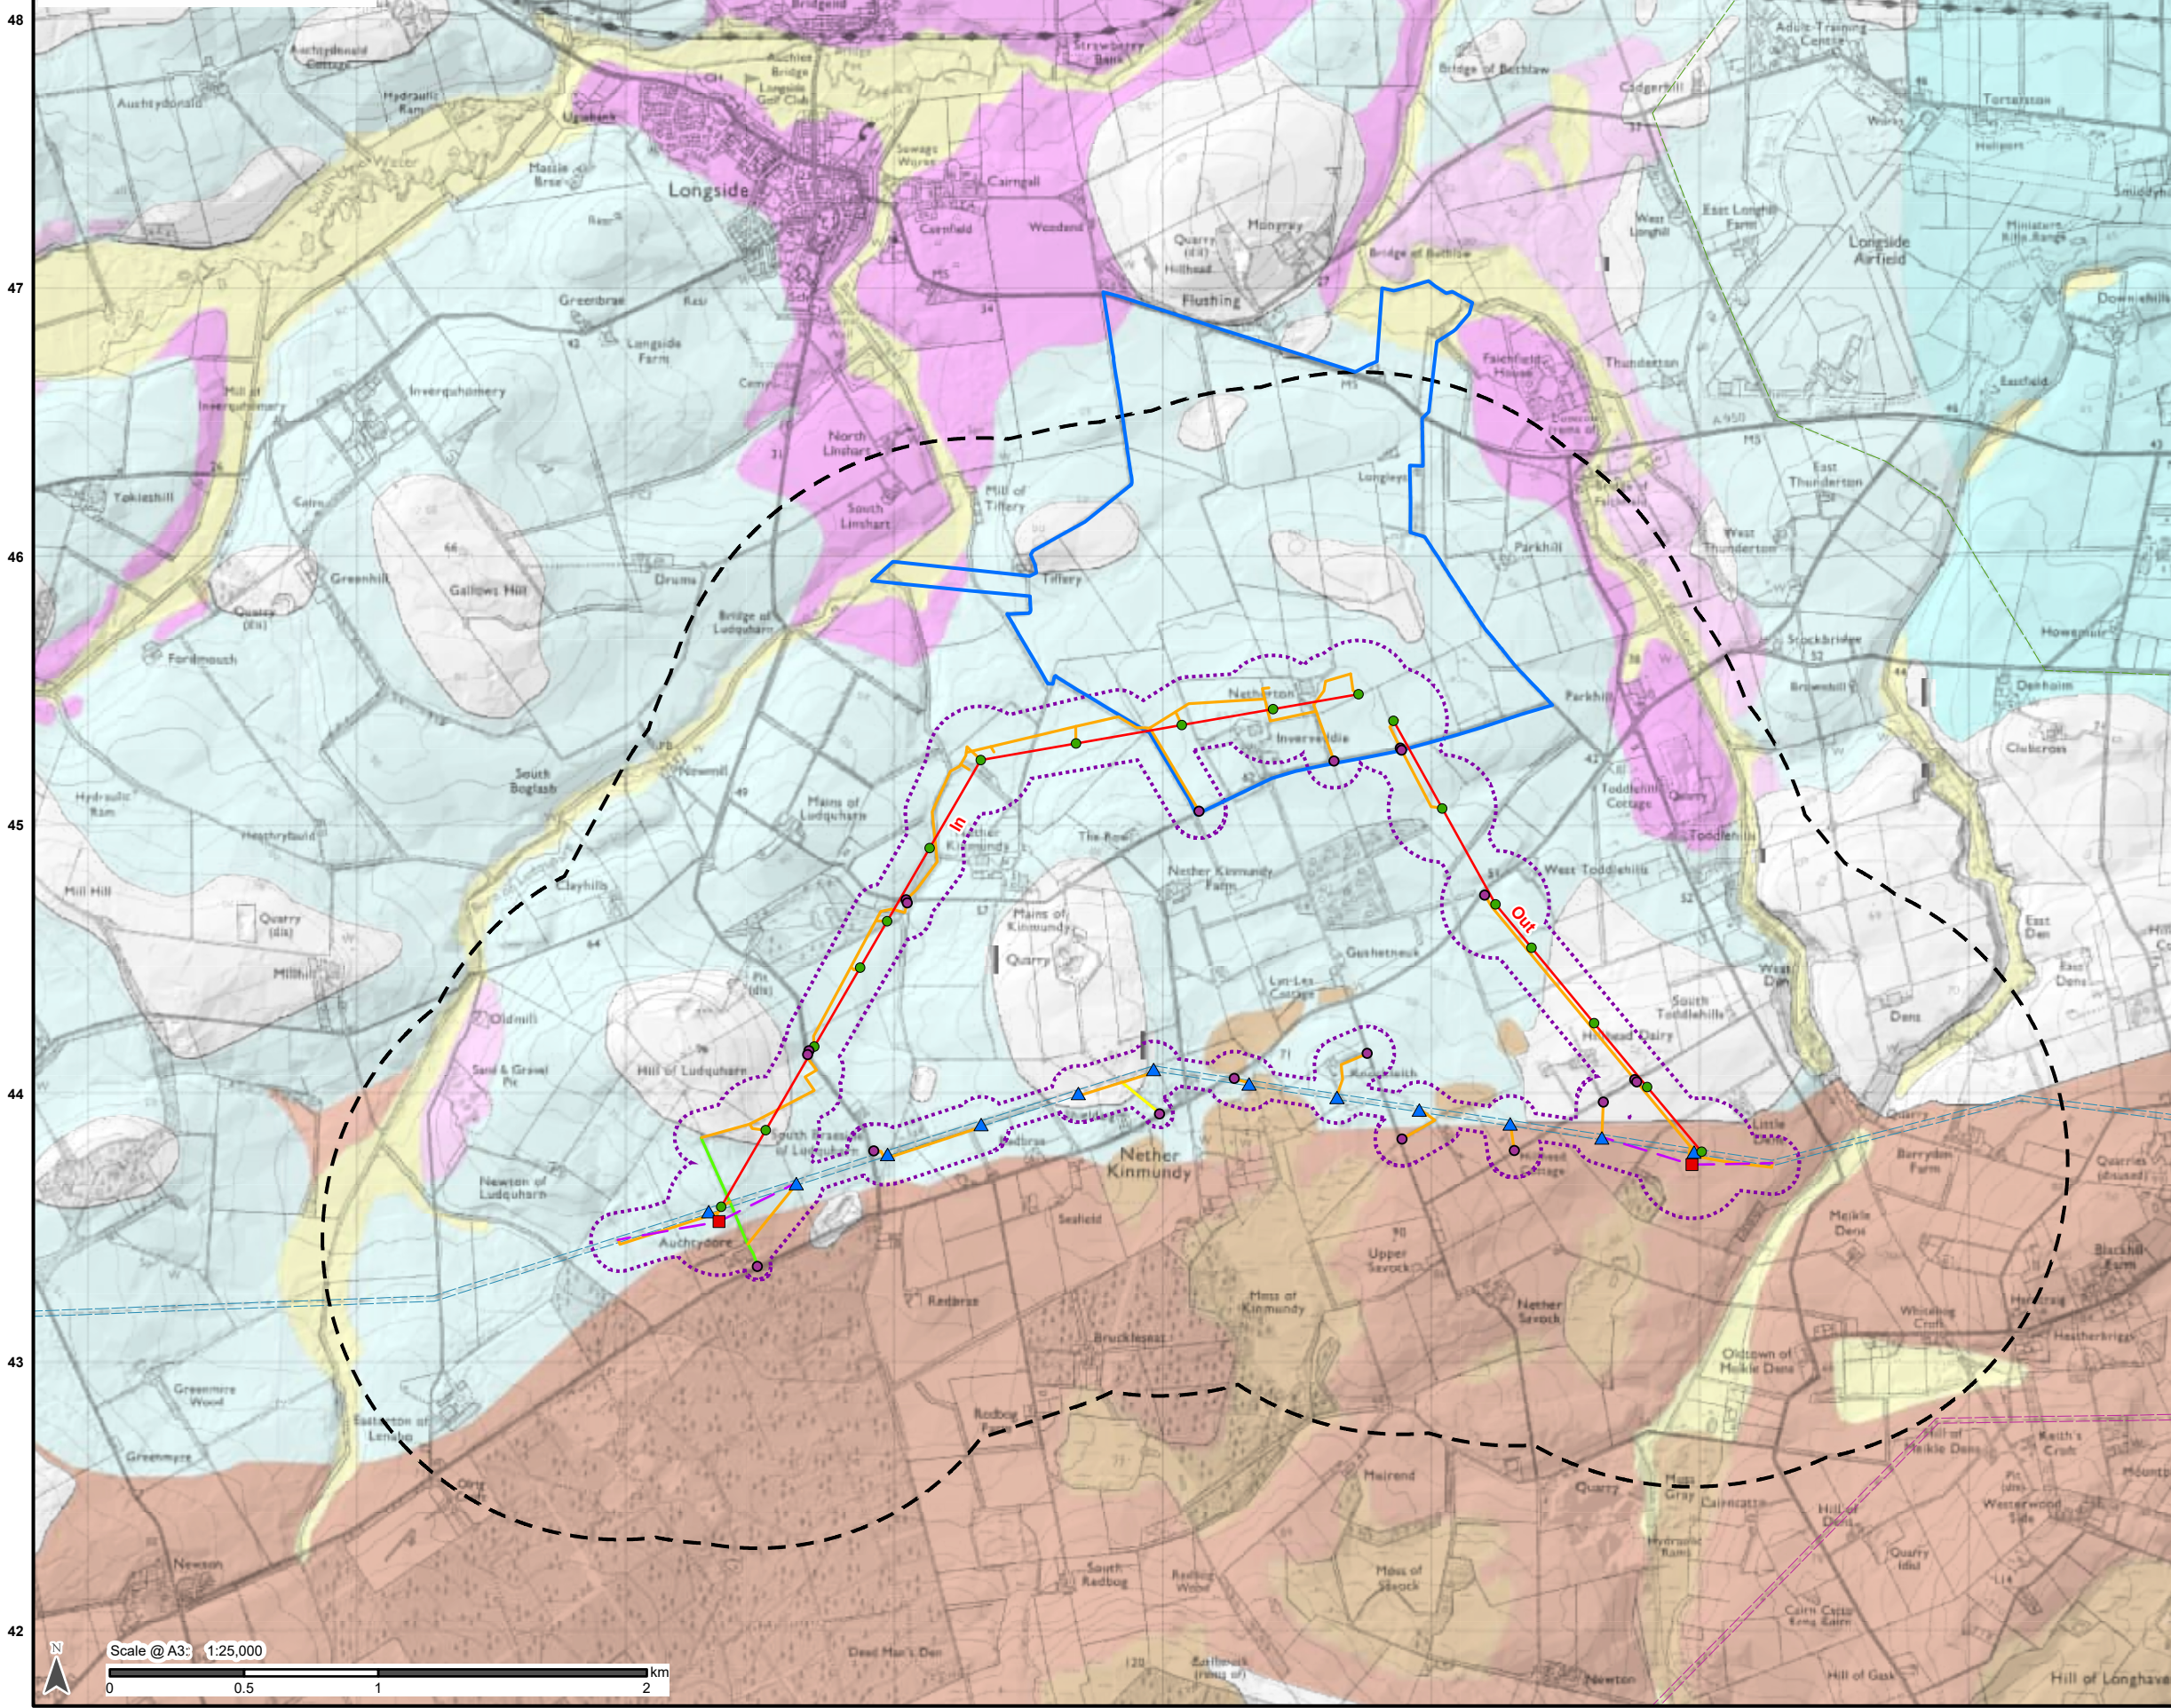

Legend

- Tower Locations
- Temporary Diversion Towers
- ▲ Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- - - Limit of Deviation
- - - 1 km Study Area
- Netherton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition
- Existing Overhead Line
- 132 kV
- 275 kV
- 400 kV
- Superficial Geology
- Hatton Till Formation - Diamicton, Clay, Sand and Gravel
- Banchory Till Formation - Diamicton
- Glaciofluvial Ice Contact Deposits - Gravel, Sand and Silt
- Alluvium - Clay, Silt, Sand and Gravel
- Glaciofluvial Sheet Deposits - Gravel, Sand and Silt
- Peat
- Head, 1 - Gravel, Flinty
- Alluvial Fan Deposits - Gravel, Sand, Silt and Clay

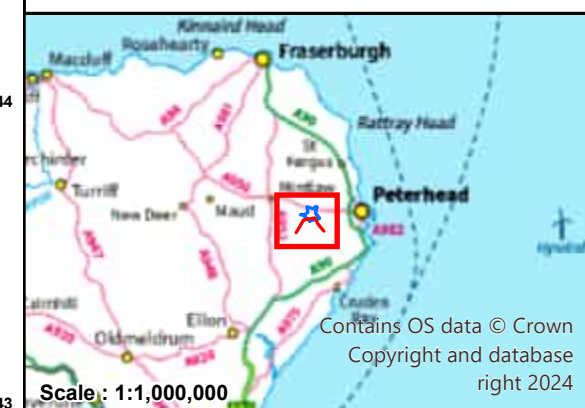

Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC0006813445.
Contains British Geological Survey materials © UKRI (2026)


SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT650
Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title:
Figure 9.3 - Superficial Geology

Drawn by: AC Date: 14/04/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-009

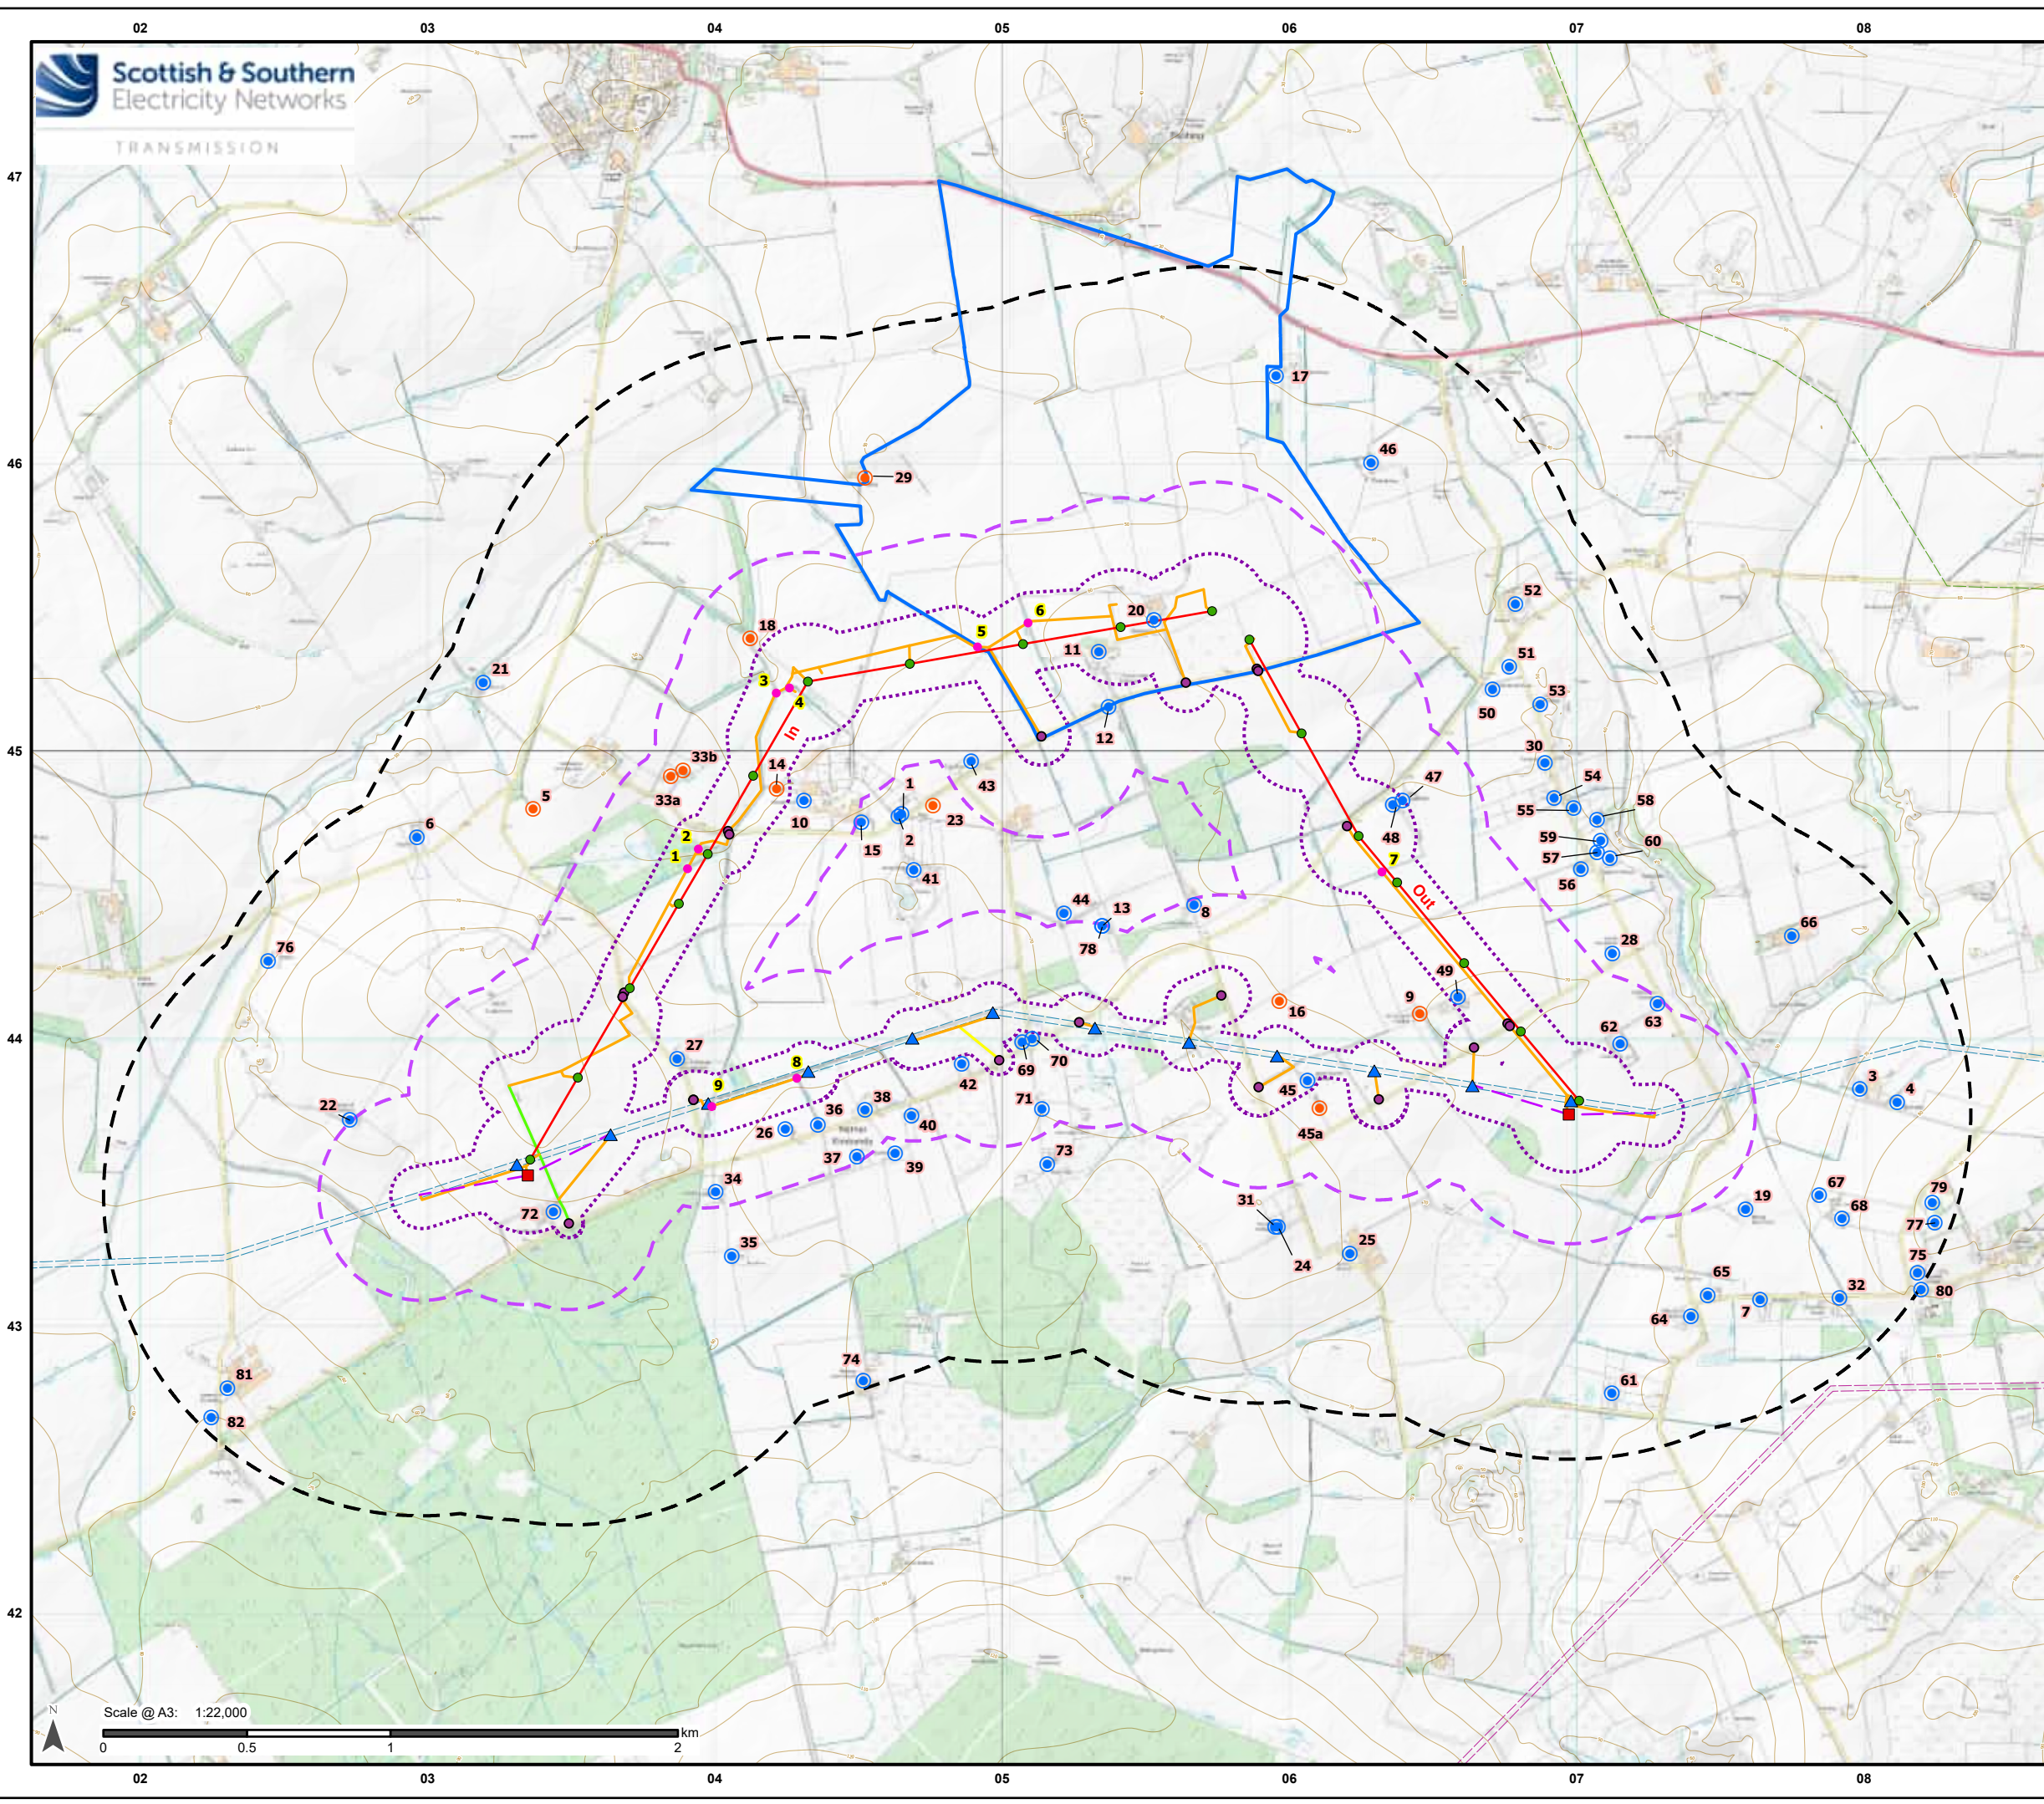

Legend

- Tower Locations
- Temporary Diversion Towers
- Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- Limit of Deviation
- 250 m Buffer From Limit of Deviation
- 1 km Study Area
- Netherton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
 - Upgrade - Good/Fair Condition
 - Upgrade - Very Poor Condition
- Watercourse crossings
- Watercourses
- Contours (10 m)
- Existing Overhead Line
 - 132 kV
 - 275 kV
 - 400 kV
- Private Water Supplies (PWS)
 - Property
 - Source

Contains OS data © Crown
Copyright and database
right 2024

Scale: 1:1,000,000

Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC0000813445.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from
Ordnance Survey

Project No: LT650
Project: Netherton Hub 400kV OHL Connection to
New Deer and Peterhead: Tie-In

Title:
Figure 9.4 - Private Water Supplies

Drawn by: AC
Date: 20/04/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-010