



Netherton Hub 400 kV OHL Connection to New Deer and Peterhead: Tie-In

Environmental Appraisal Report Volume 2 Figures: Part 5

July 2026



Scottish Hydro Electric Transmission plc
Inveralmond House
200 Dunkeld Road
Perth PH1 3AQ
Tel: +44 (0)1738 456 000
www.ssen-transmission.co.uk

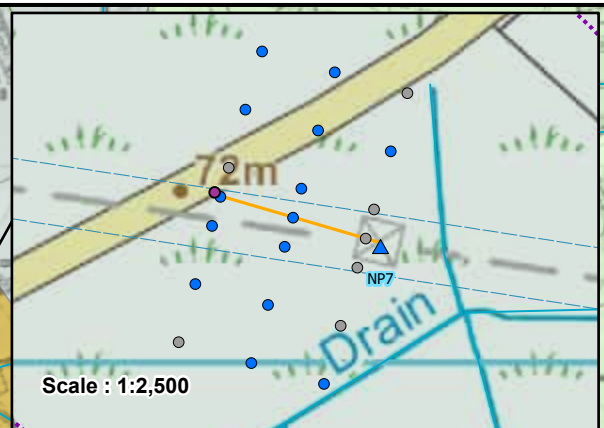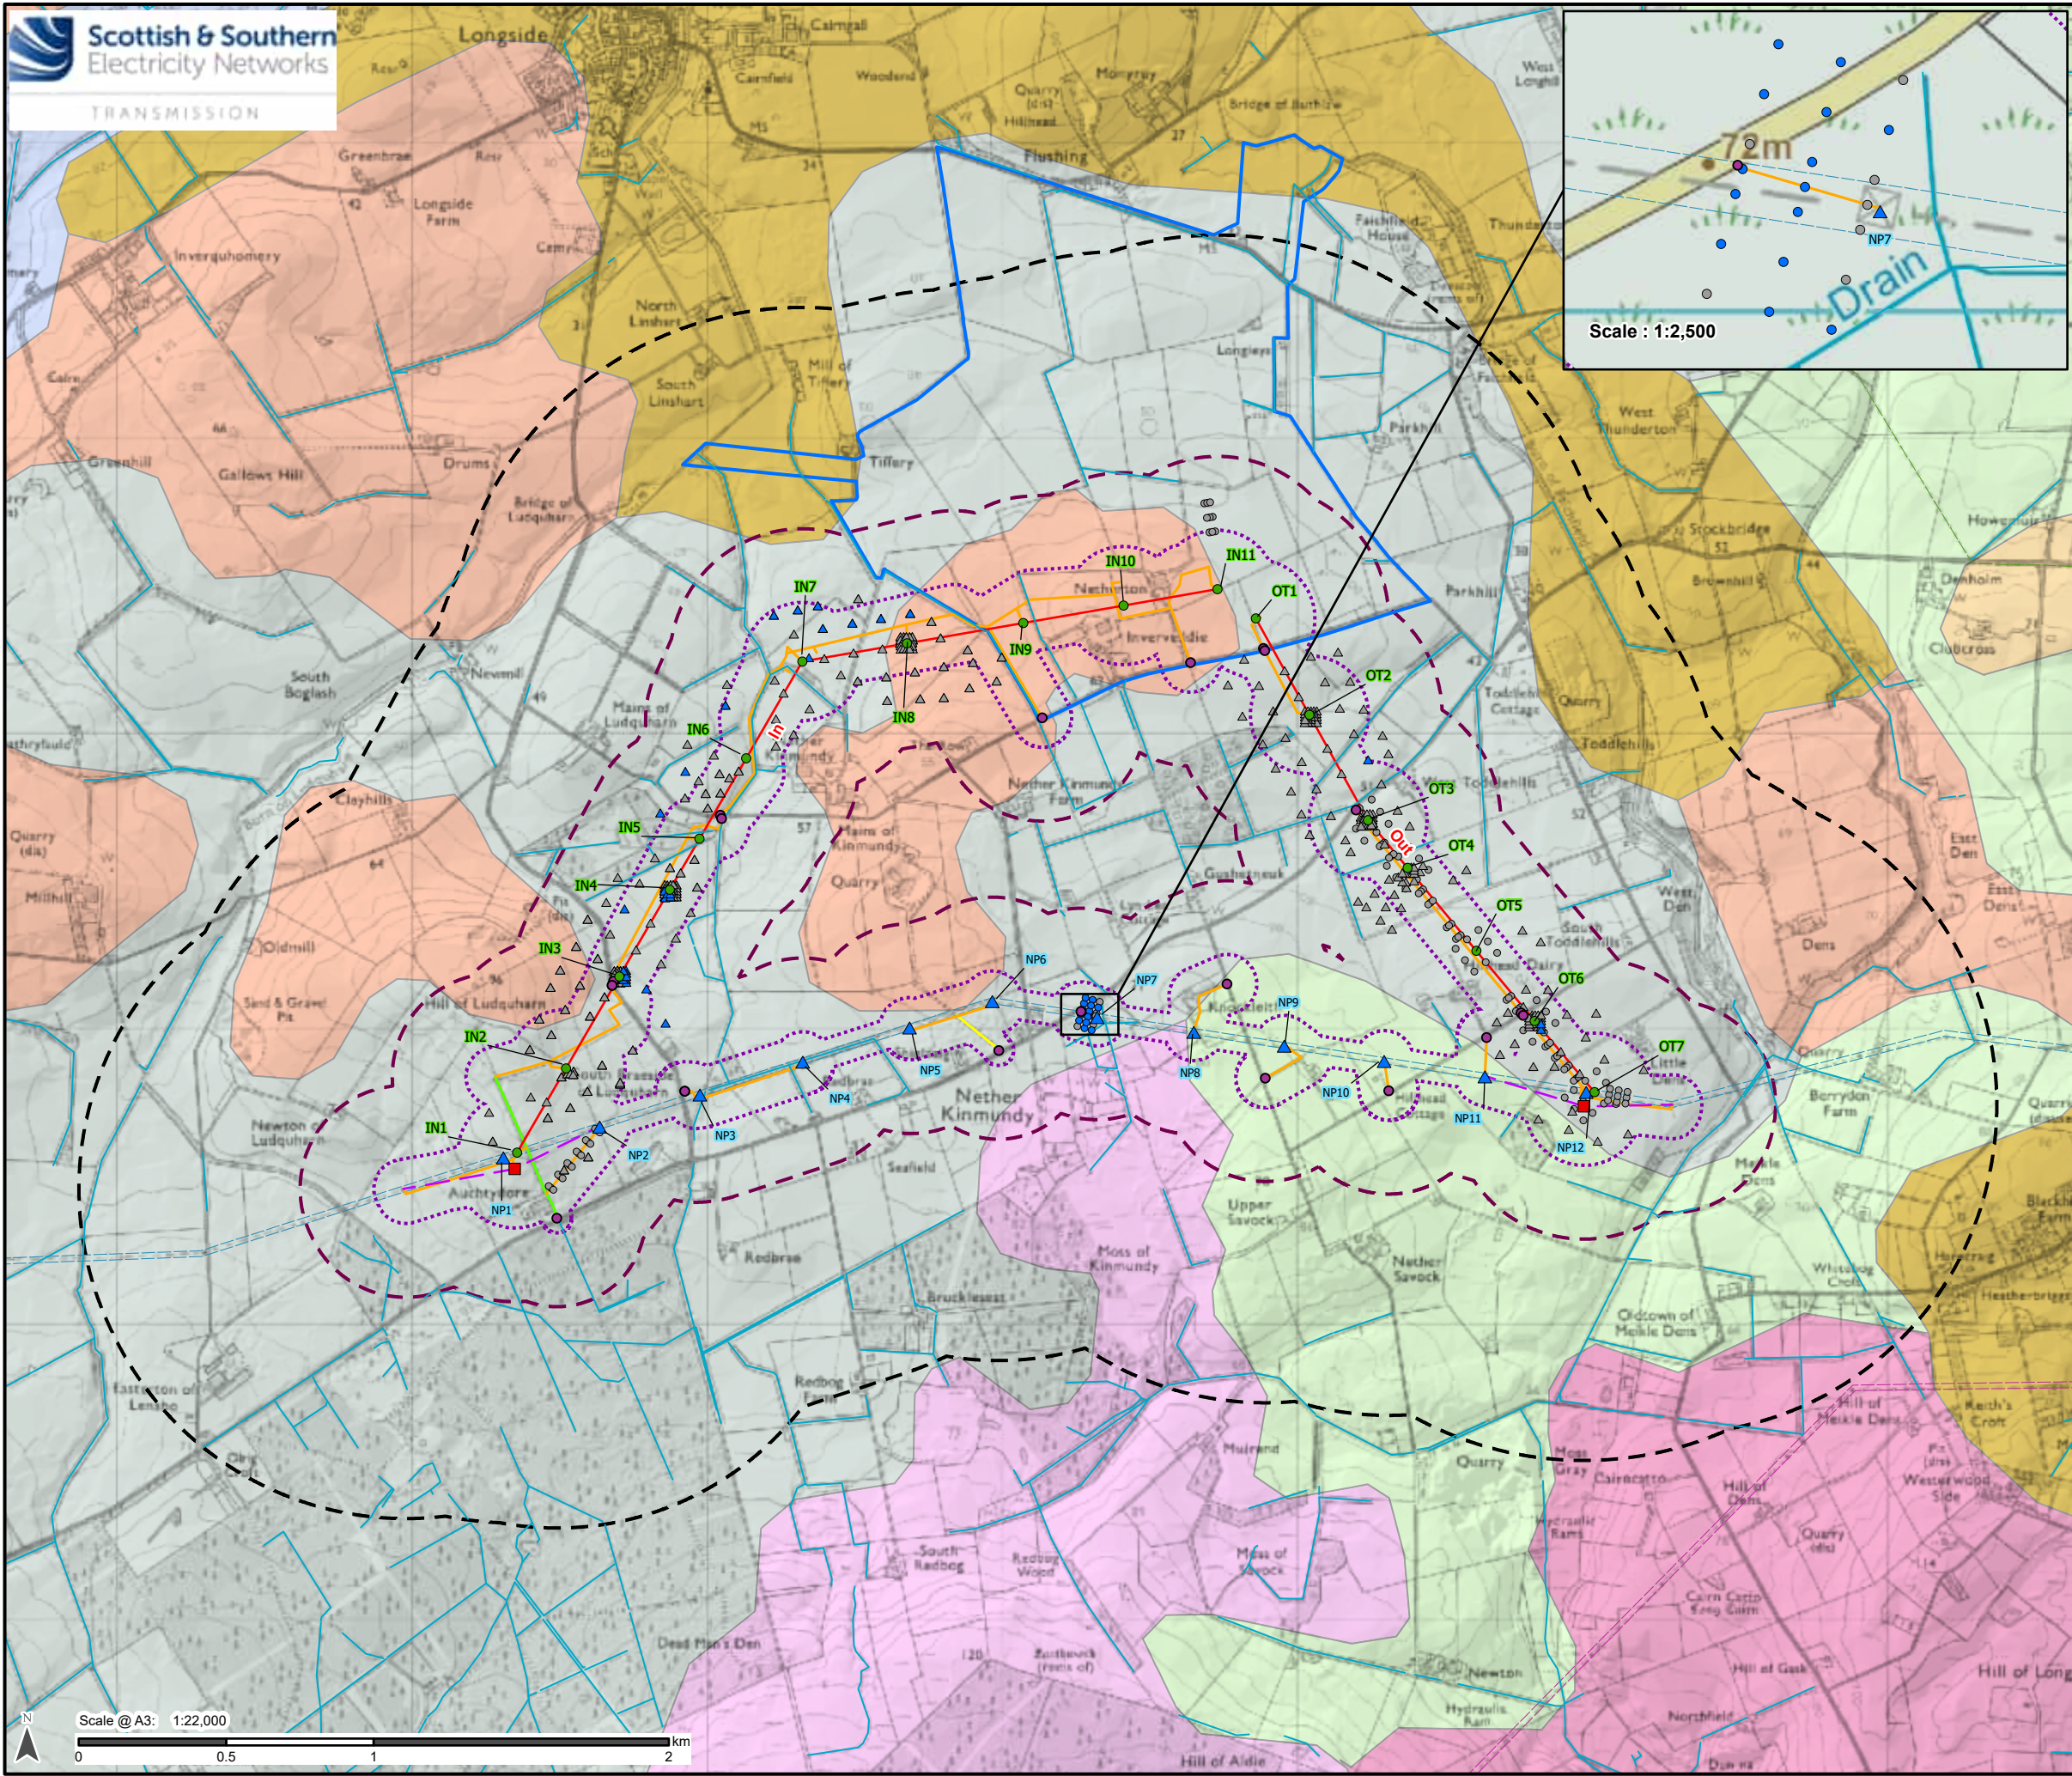

Legend

- Tower Locations
- Temporary Diversion Towers
- Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- Limit of Deviation
- 250 m Buffer From Limit of Deviation
- 1 km Study Area
- Netherton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition
- Watercourses
- Existing Overhead Line**
 - 132 kV
 - 275 kV
 - 400 kV
- Fluid EC - Phase 1 - Soil Depth (m)**
 - <0.5
 - 0.5 - 1.0
- WSP Phase 1 and 2 - Soil Depth (m)**
 - <0.5
 - 0.5 - 1.0
- Scottish Soils Map (2025)**
 - Blanket peat
 - Brown earths with brown earths with gleying
 - Brown earths with gleying
 - Humus-iron podzols
 - Mineral alluvial soils with peaty alluvial soils
 - Noncalcareous gleys
 - Noncalcareous gleys with peaty gleys
 - Peaty podzols

Contains OS data © Crown Copyright and database right 2024

Scale: 1:1,000,000

Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC006813445.
Contains public sector information licensed under the Open Government Licence v3.0.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey



Project No: LT650

Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title: Figure 9.5 - Scottish Soils Map (2025)

Drawn by: AC Date: 19/05/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-011

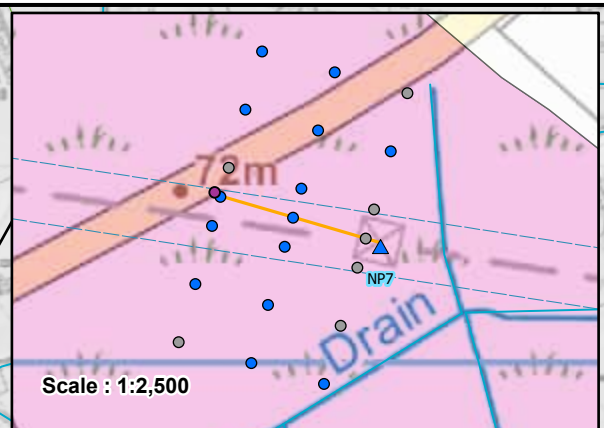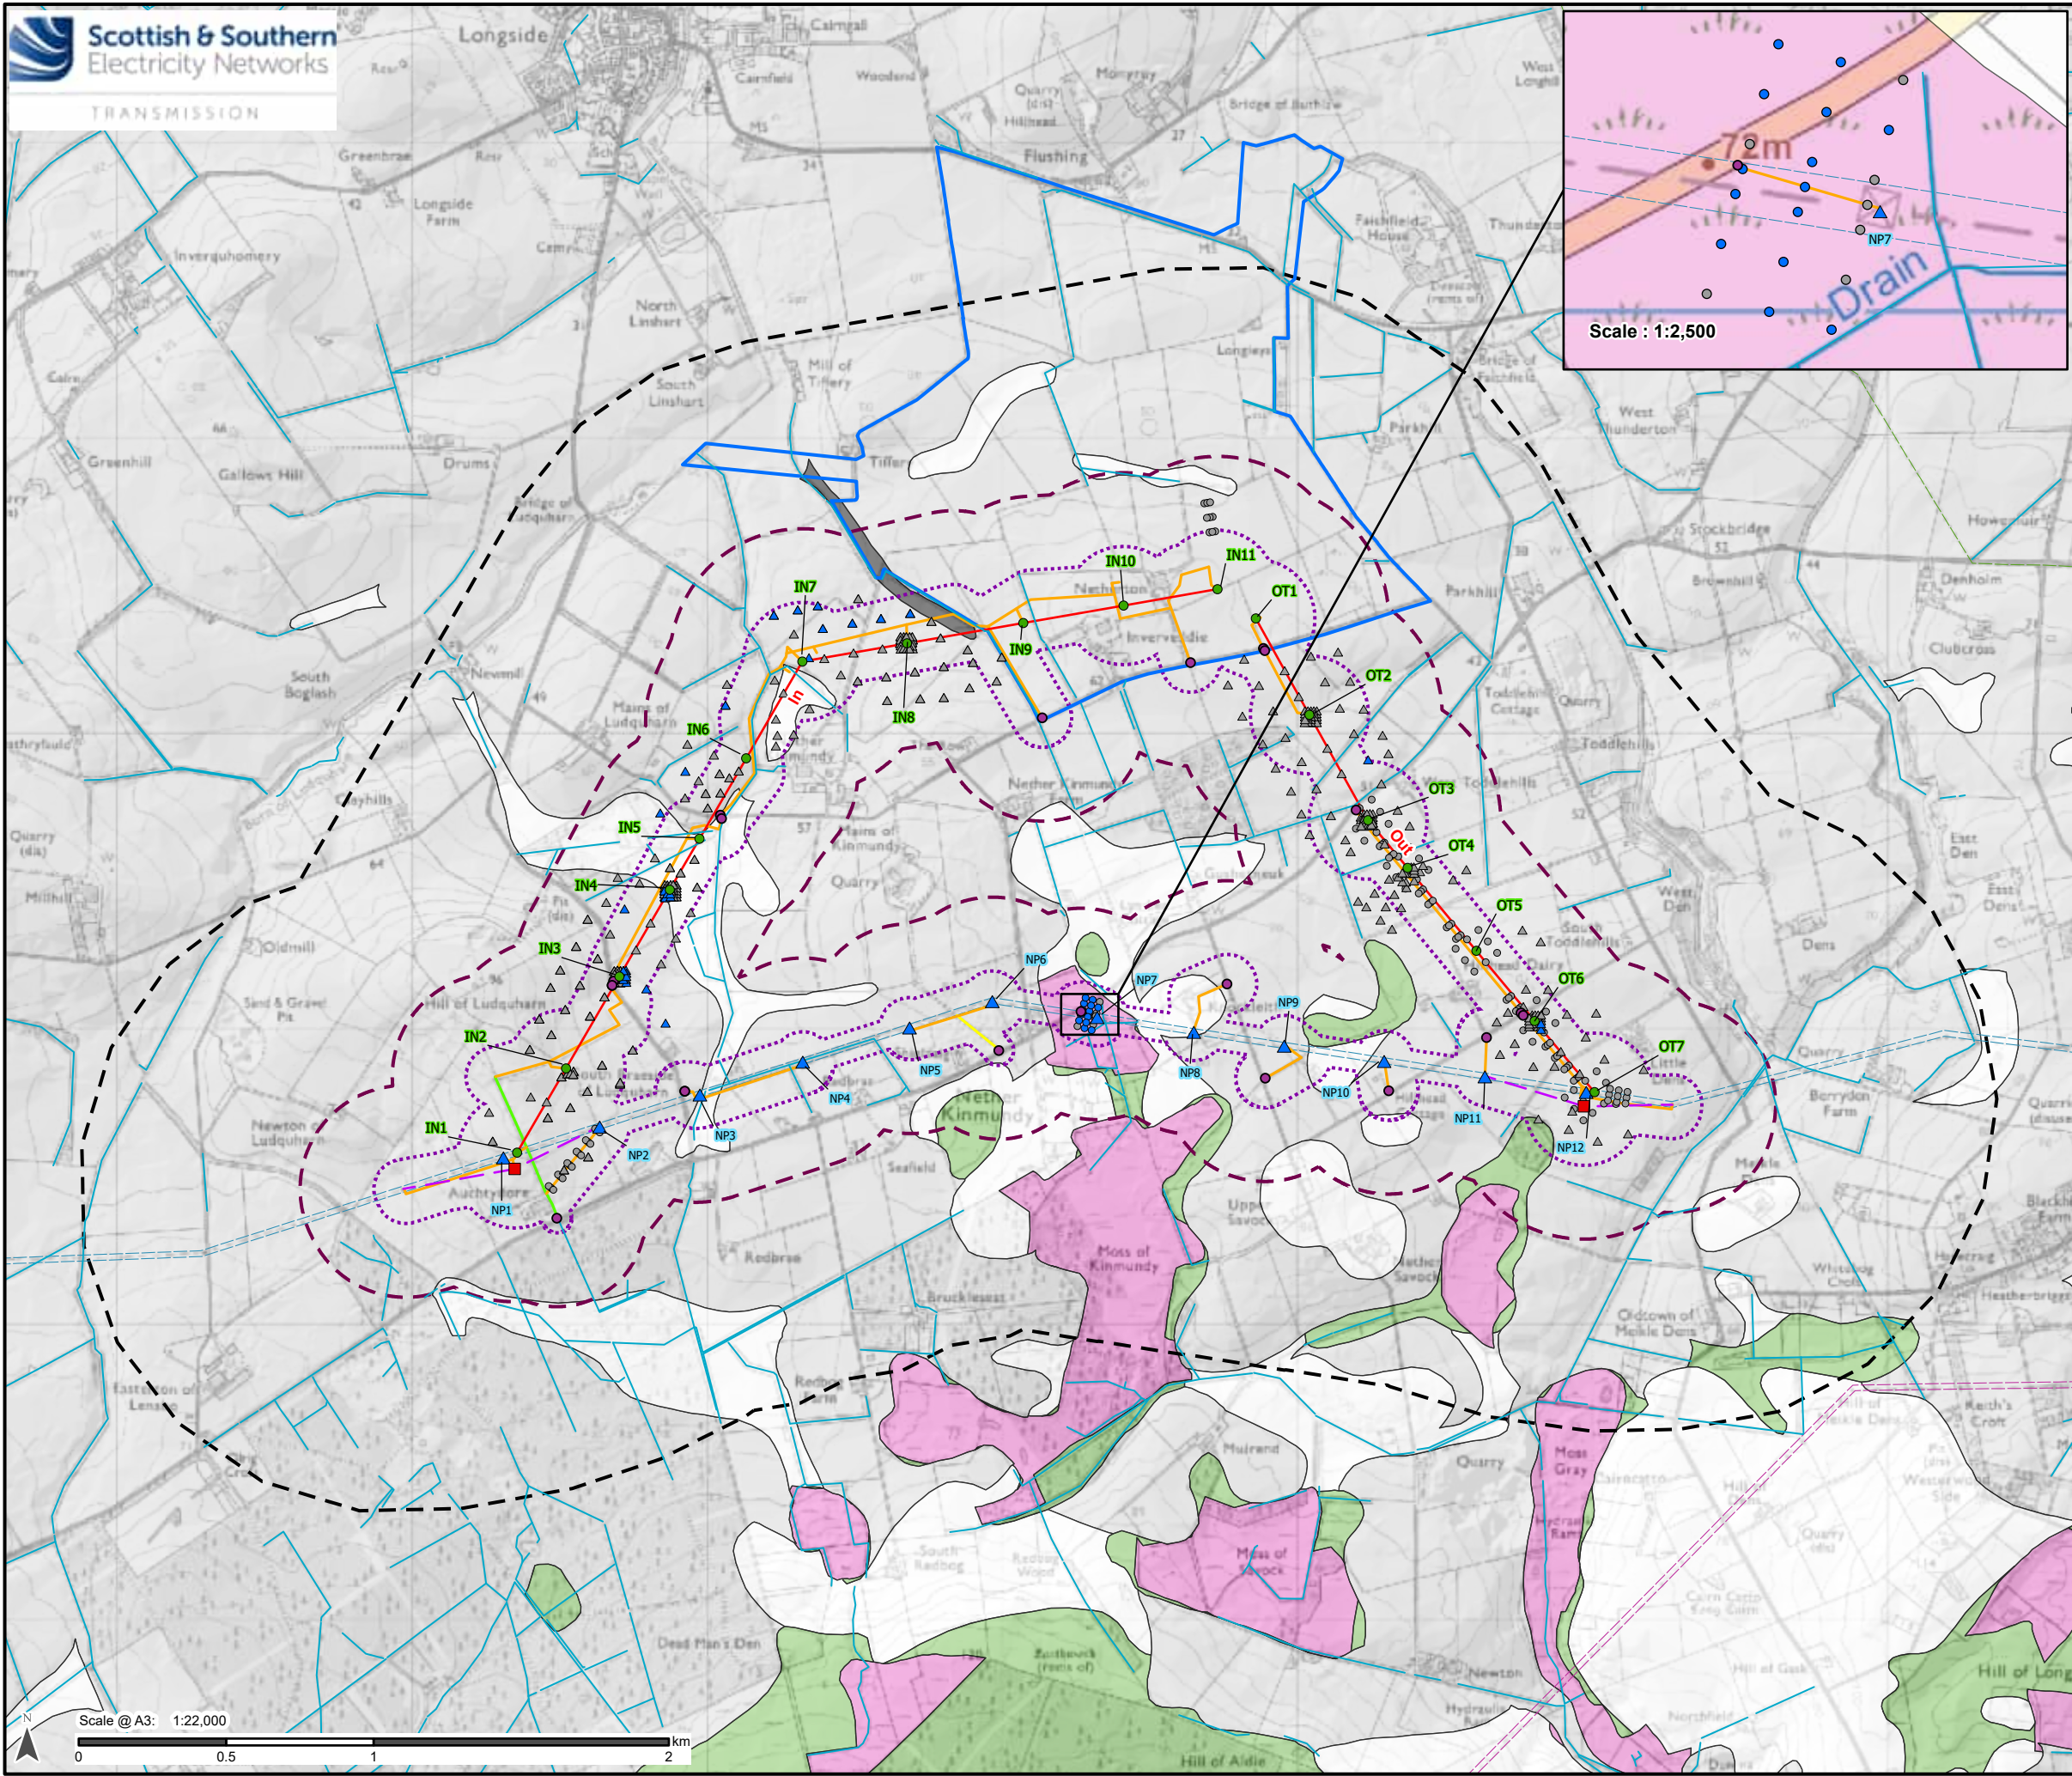

Legend

- Tower Locations
- Temporary Diversion Towers
- Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- Limit of Deviation
- 250 m Buffer From Limit of Deviation
- 1 km Study Area
- Netherton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition
- Watercourses
- Existing Overhead Line**
 - 132 kV
 - 275 kV
 - 400 kV
- Fluid EC - Phase 1 - Soil Depth (m)**
 - <0.5
 - 0.5 - 1.0
- WSP Phase 1 and 2 - Soil Depth (m)**
 - <0.5
 - 0.5 - 1.0
- Carbon and Peatland Map Classes (2016)**
 - 2
 - 0
 - 1
 - 4
 - 5

Contains OS data © Crown Copyright and database right 2024

Scale: 1:1,000,000

Crown copyright and database right 2024 all rights reserved.
Ordnance Survey Licence number AC006813445.
Contains public sector information licensed under the Open Government Licence v3.0.

SSN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey


Project No: LT650

Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title: Figure 9.5 - Carbon and Peatland Map Classes (2016)

Drawn by: AC Date: 19/05/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-011

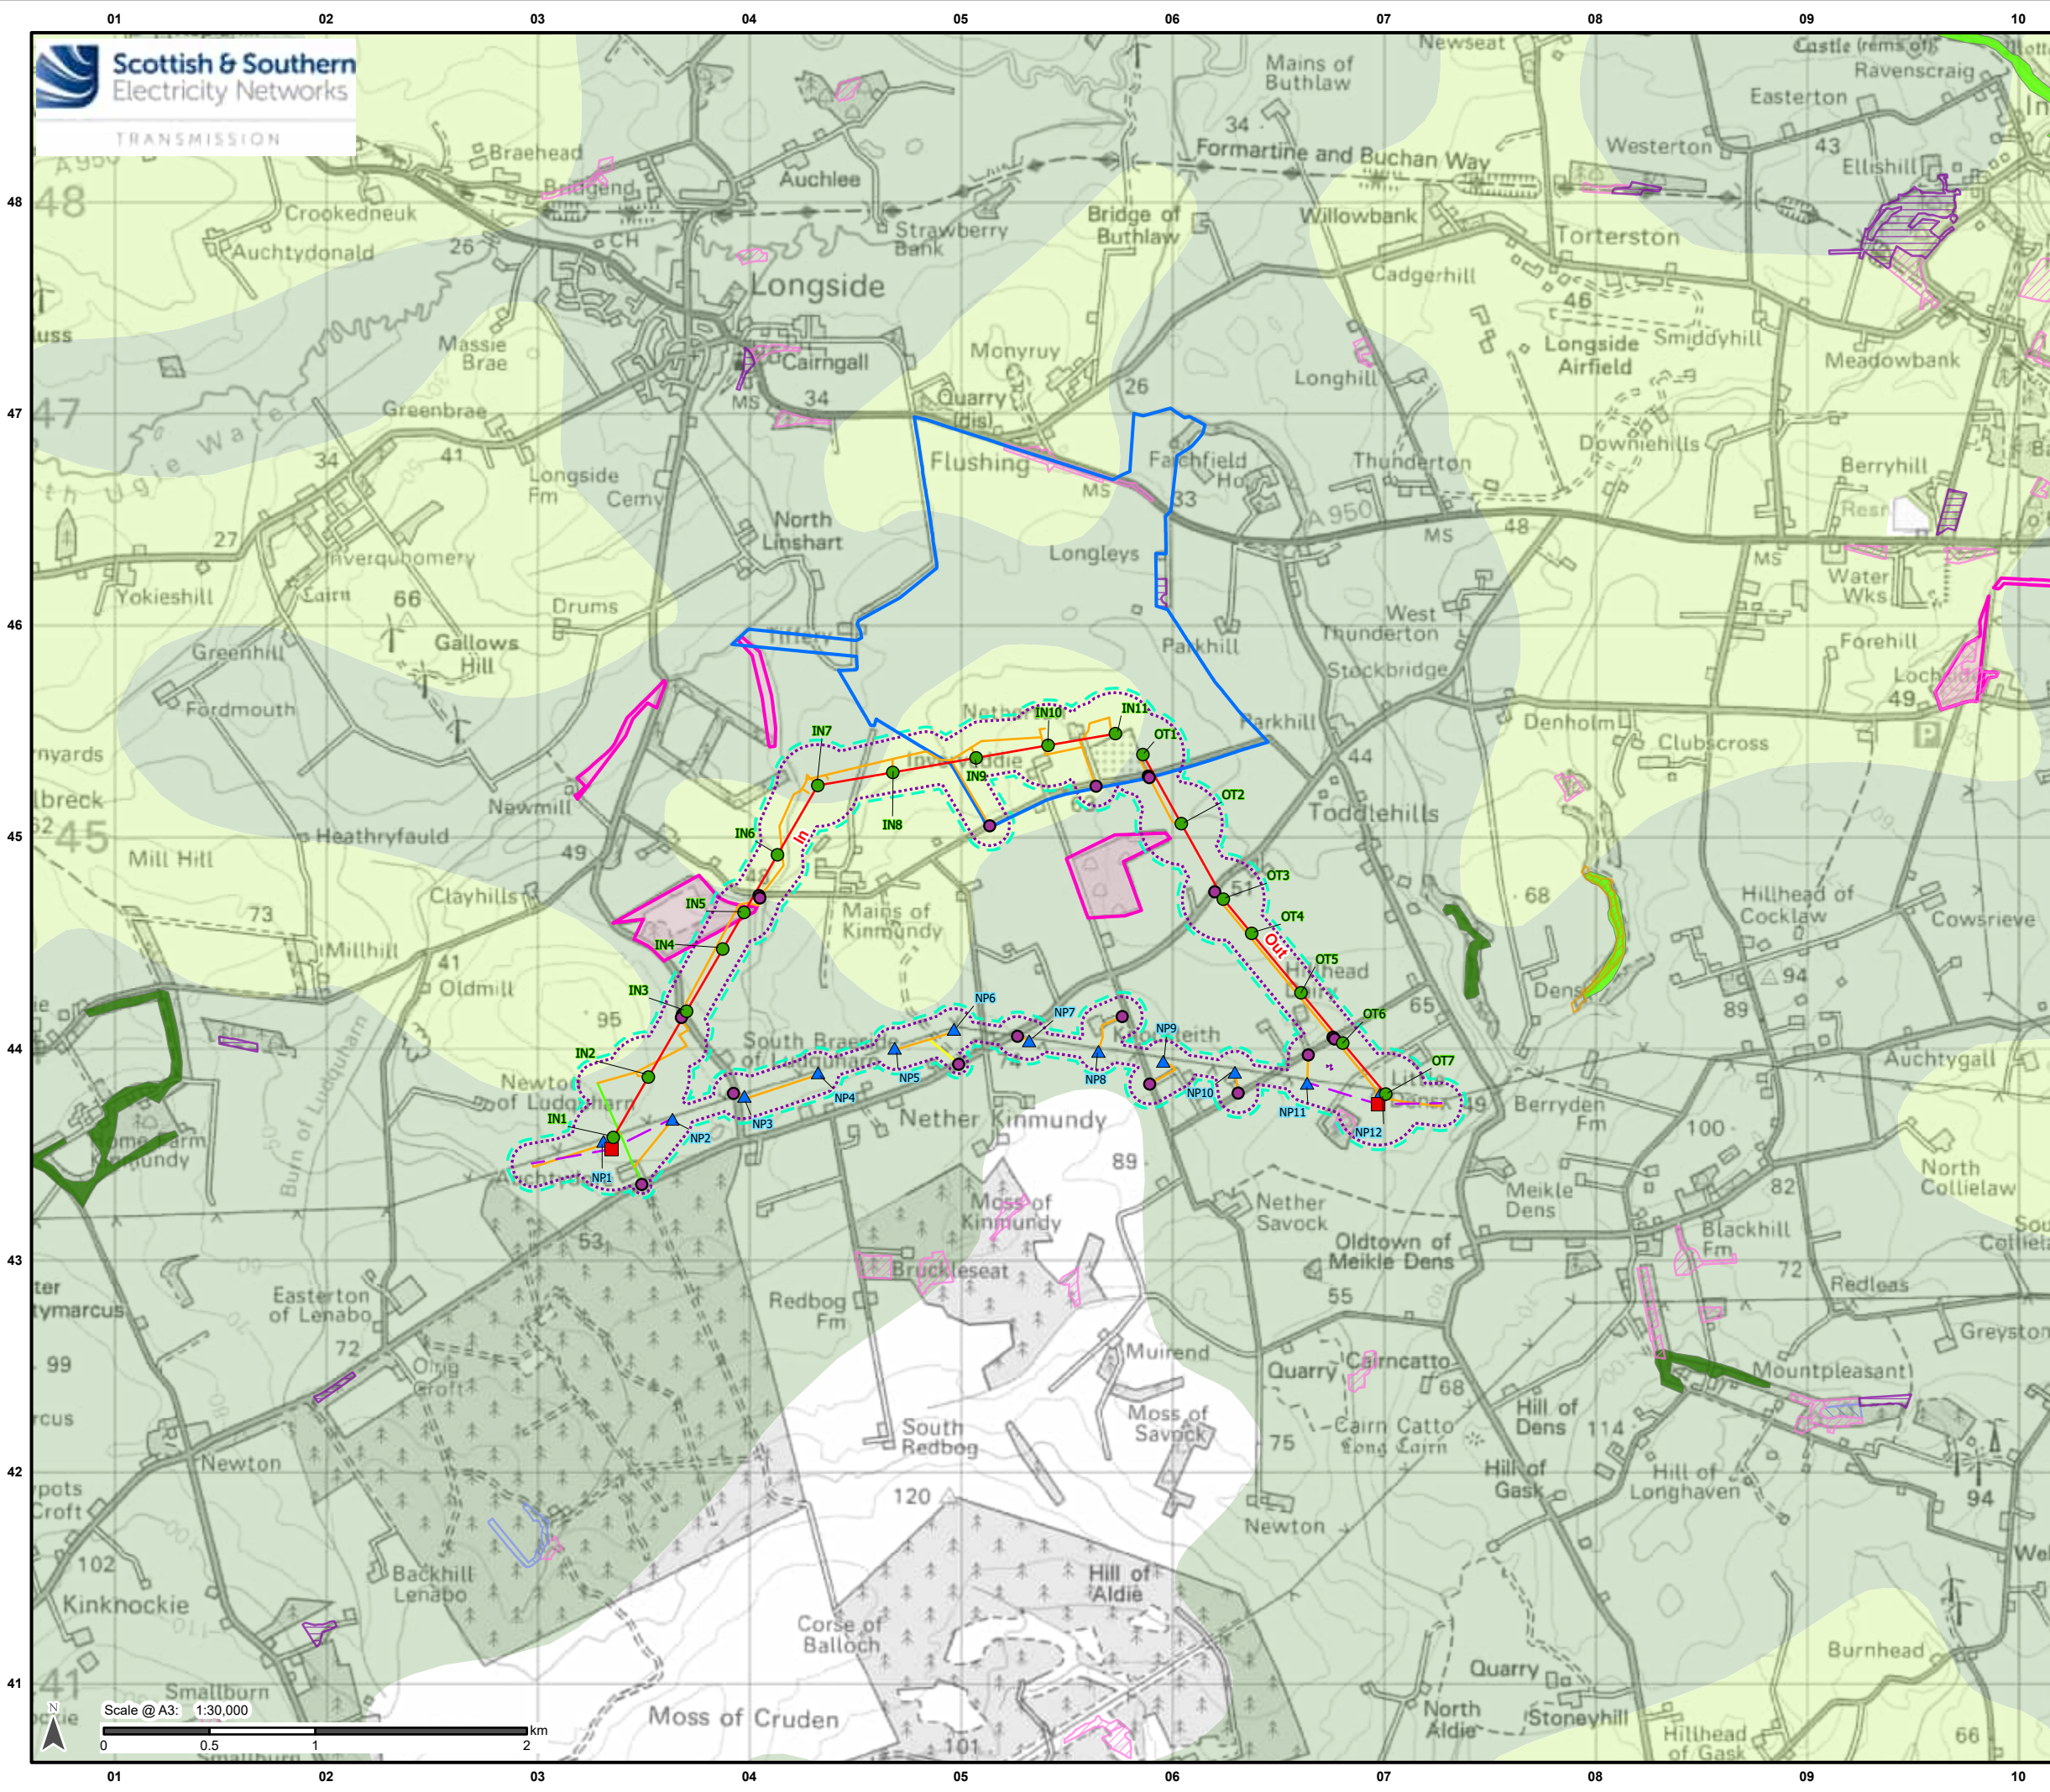

Legend

- Tower Locations
- Temporary Diversion Towers
- Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- Limit of Deviation
- Forestry Study Area
- Nethererton Hub Site Boundary
- Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition

Agriculture

Agricultural land Classification (BMV Grades)

- 3.1
- 3.2

Forestry

- Scottish Forestry Grant Scheme Boundary
- Native Woodland Survey
 - Native Woodland
 - Nearly-Native Woodland
 - Open Land Habitat
 - Plantations on Ancient Woodland Sites (PAWS)

Ancient Woodland Inventory

- Ancient (of semi-natural origin)
- Long-Established (of plantation origin)

Contains OS data © Crown
Copyright and database
right 2024

Scale: 1:1,000,000


Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC006813445.
Contains public sector information licensed under the Open Government Licence v3.0.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT650
Project: Nethererton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title:
Figure 10.1 Forestry and Land Use


Drawn by: AC
Date: 15/06/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-013

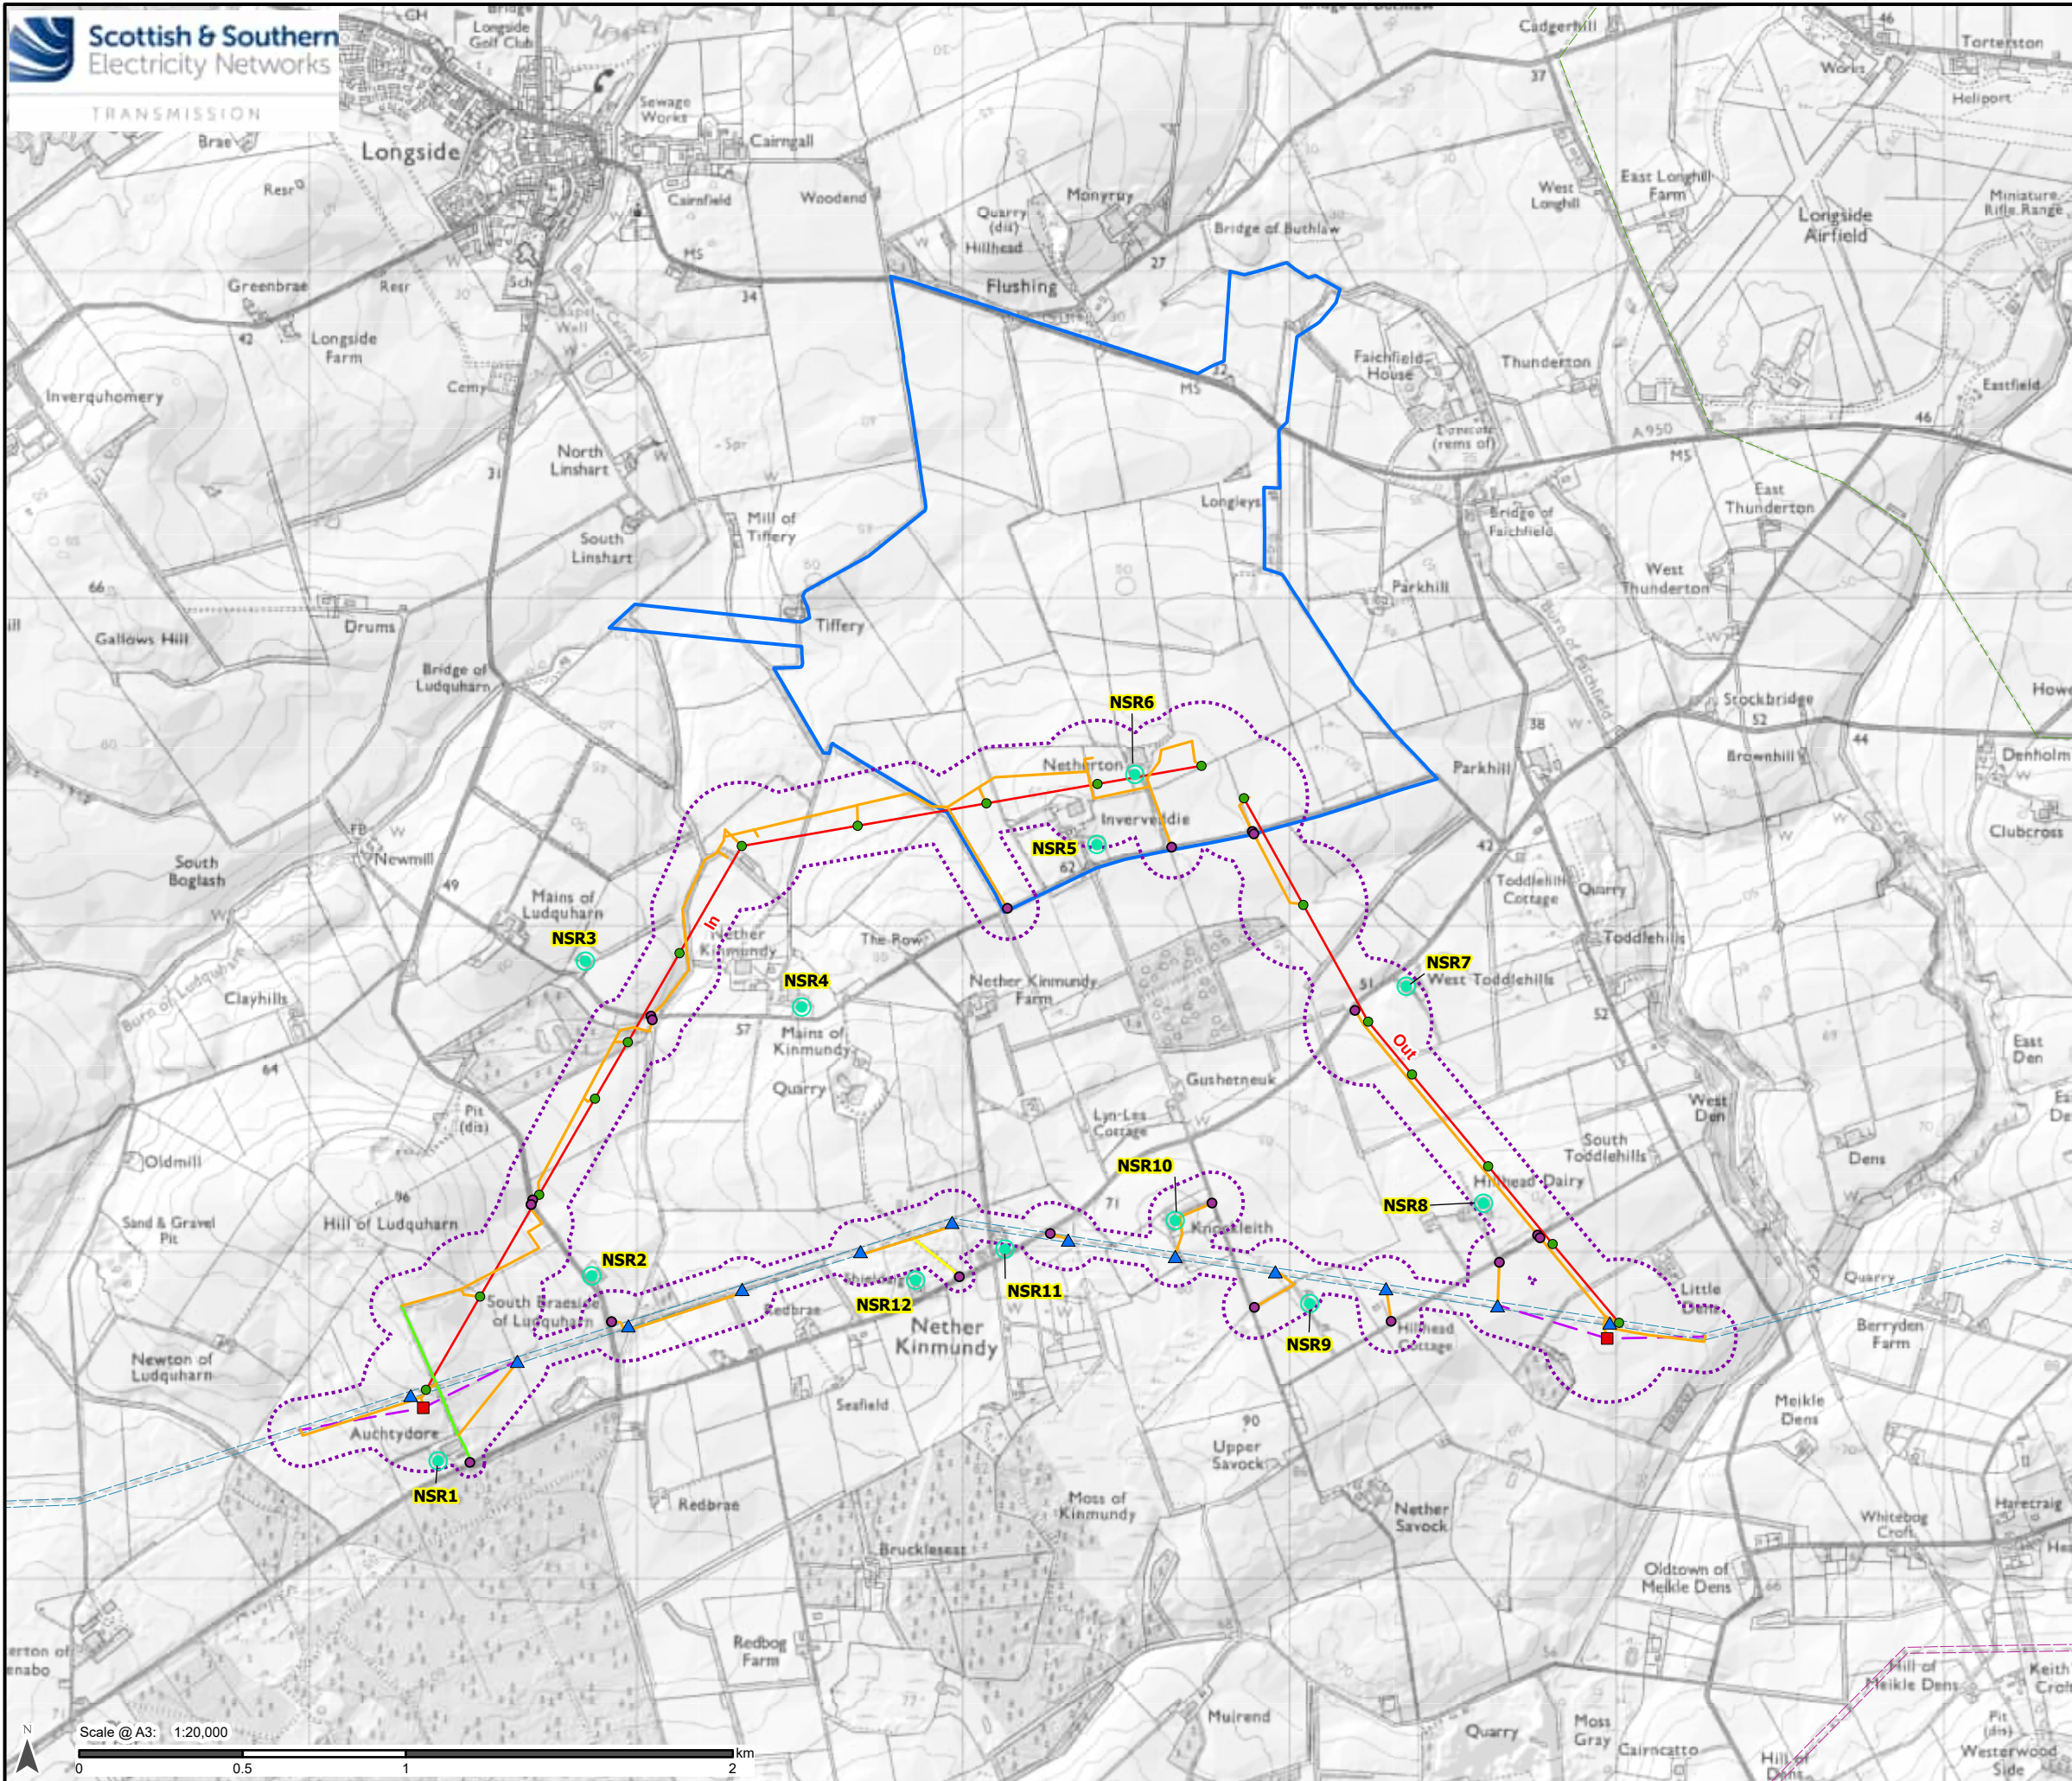

Legend

- Tower Locations
- Temporary Diversion Towers
- ▲ Dismantled Towers
- Bellmouths
- Proposed Overhead Line
- - - Limit of Deviation
- Netherton Hub Site Boundary
- - - Temporary Diversion Alignment
- Access Tracks
- Existing Access Tracks
- Upgrade - Good/Fair Condition
- Upgrade - Very Poor Condition
- Existing Overhead Line
- - - 132 kV
- - - 275 kV
- - - 400 kV
- Noise Sensitive Receptors (NSRs)

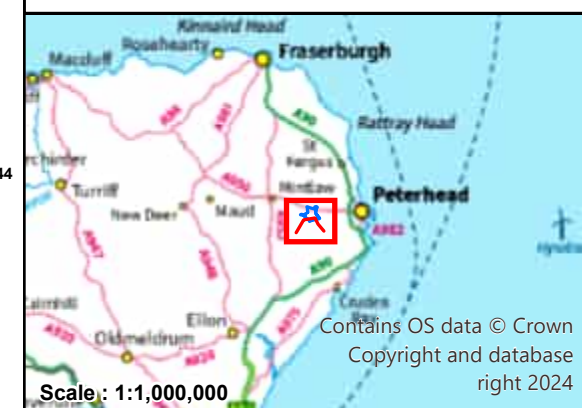


Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC0000813445.
SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT650
Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title:
Figure 11.1 - Construction Phase Sensitive Receptors

Drawn by: AC Date: 15/04/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-015

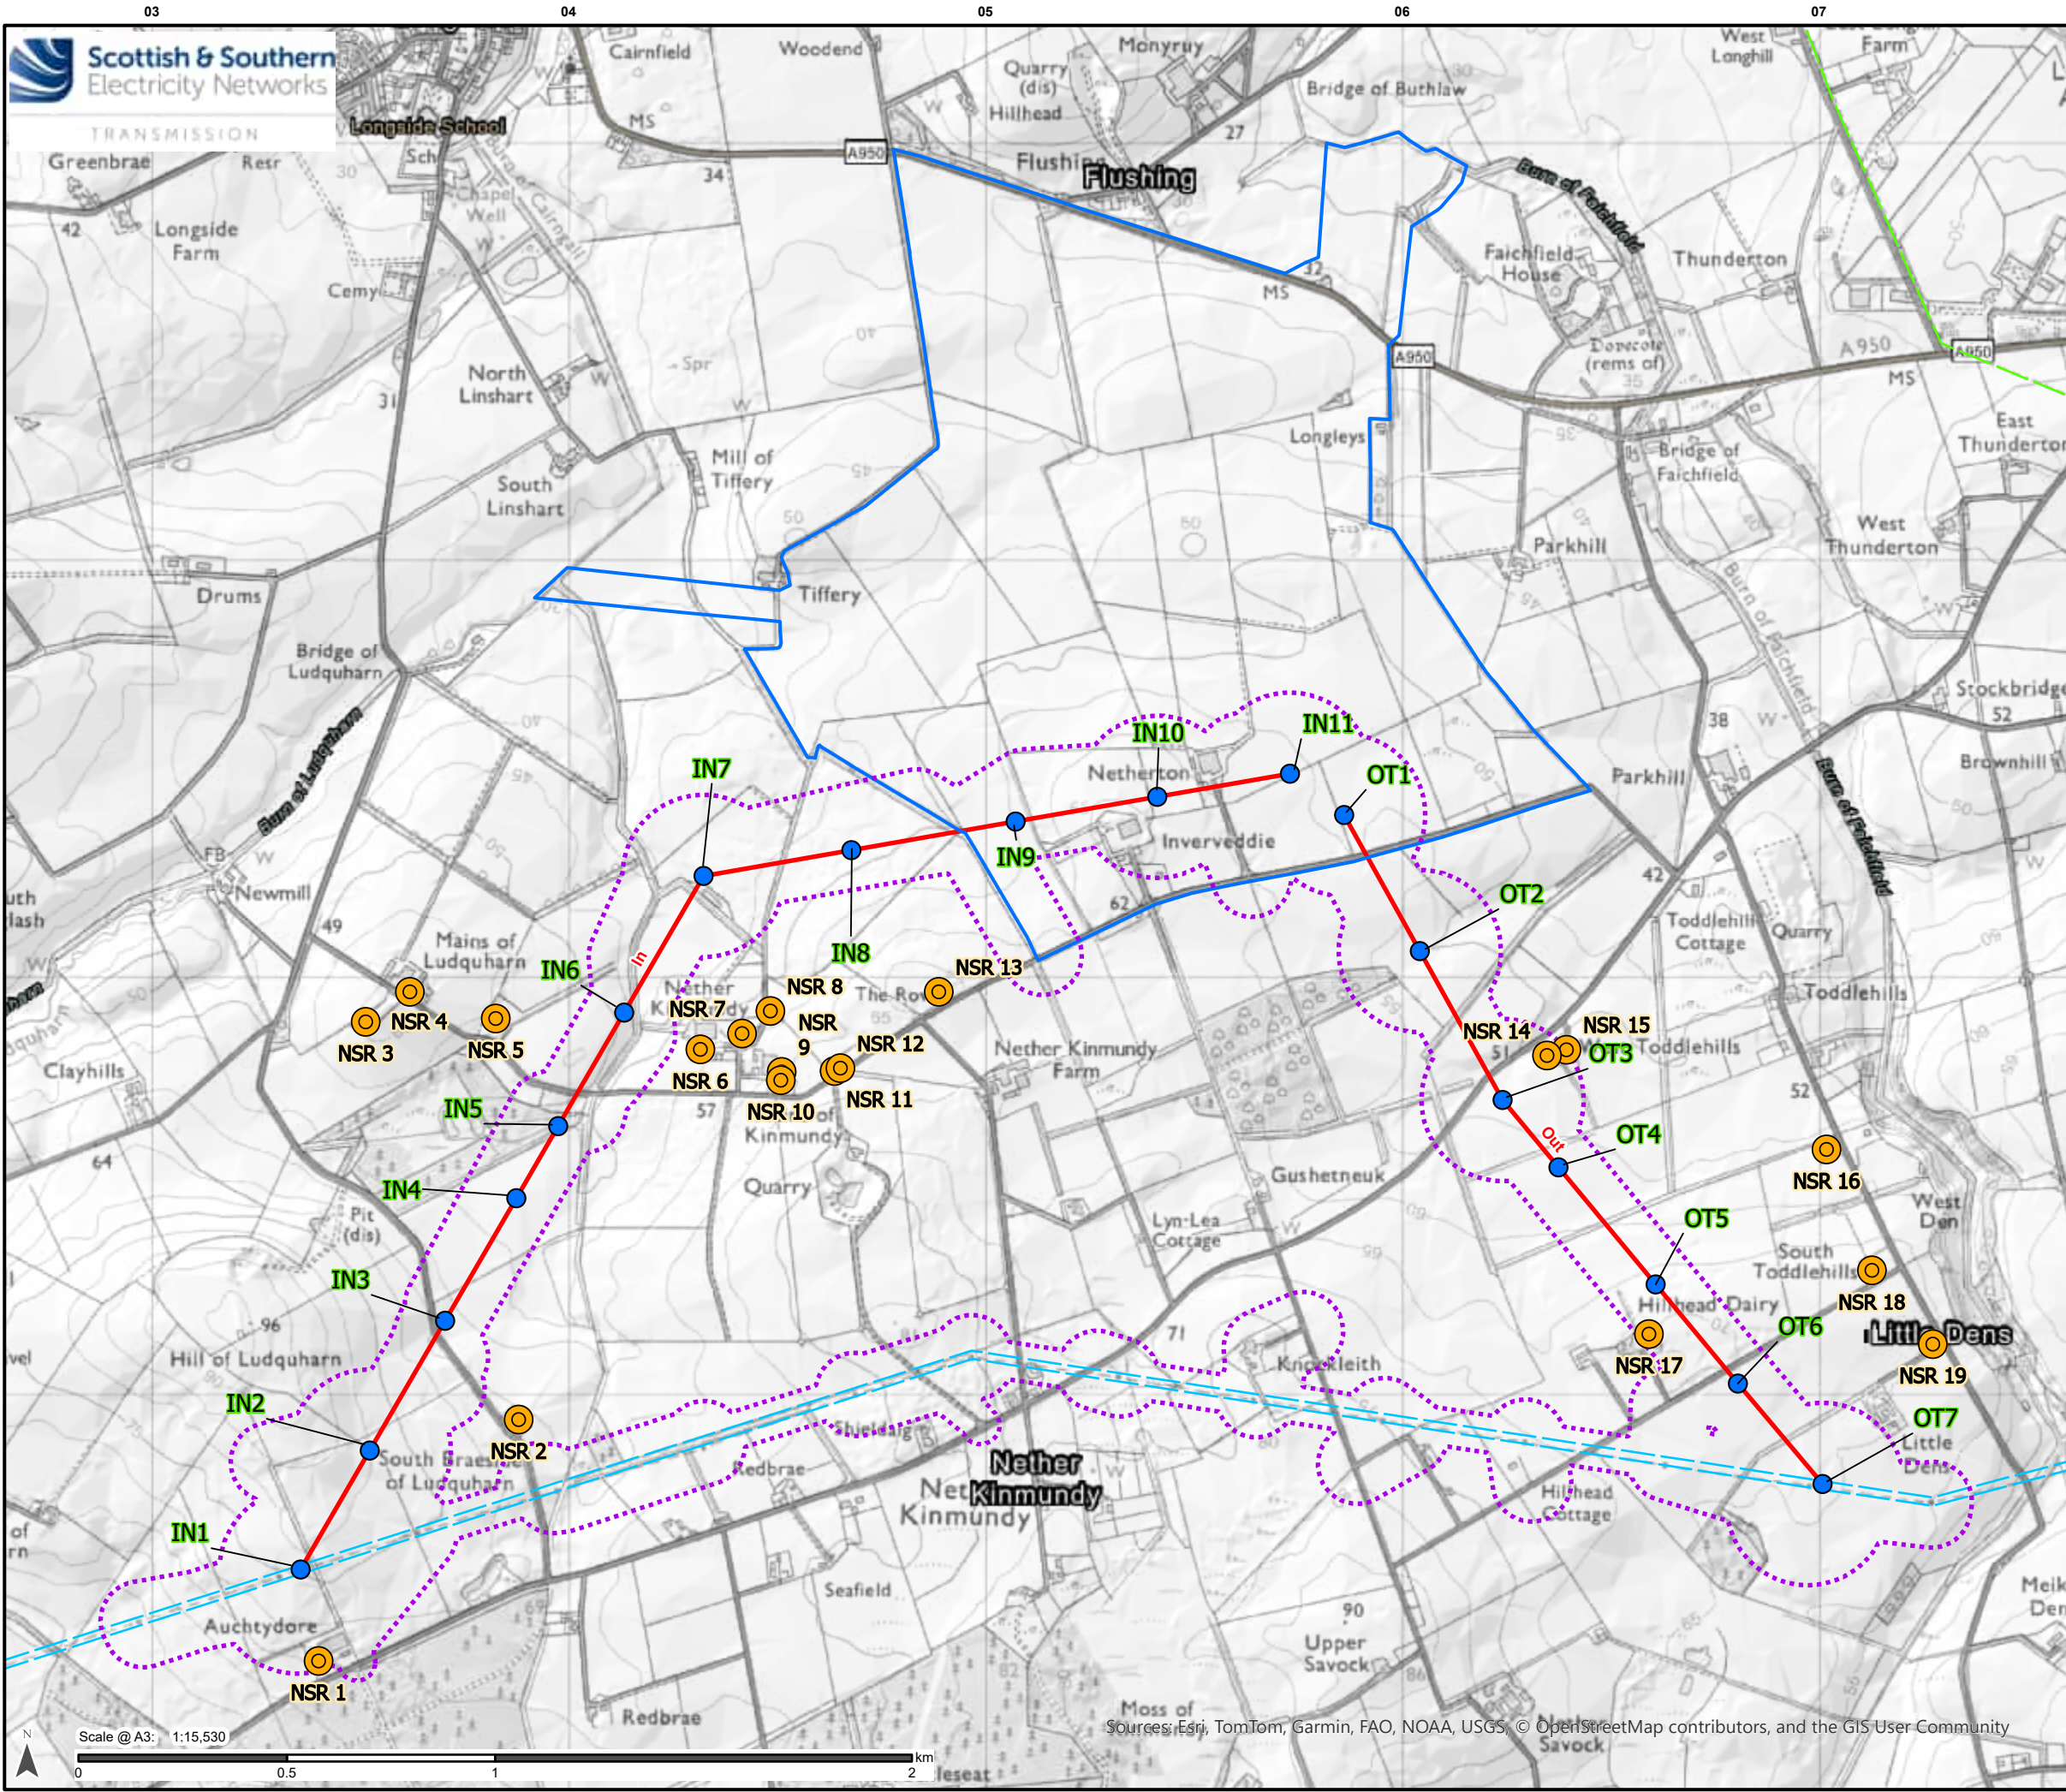

Legend

- Tower Locations
- Proposed Overhead Line
- Limit of Deviation
- Netherton Hub Site Boundary
- Existing Overhead Line**
 - 132 kV
 - 400 kV
- Noise Sensitive Receptors

Contains OS data © Crown Copyright and database right 2024

Scale: 1:1,000,000

Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number AC0000813445.

SSEN Transmission take no responsibility for the release or accuracy of latest version Basemaps from Ordnance Survey

Project No: LT650
Project: Netherton Hub 400kV OHL Connection to New Deer and Peterhead: Tie-In

Title:
Figure 11.2 - Operational Noise Sensitive Receptors

Drawn by: DZ
Date: 24/06/2026

Drawing: UK0029295.1009-NEWDEER-EAR-TIE-WSP-016

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community