


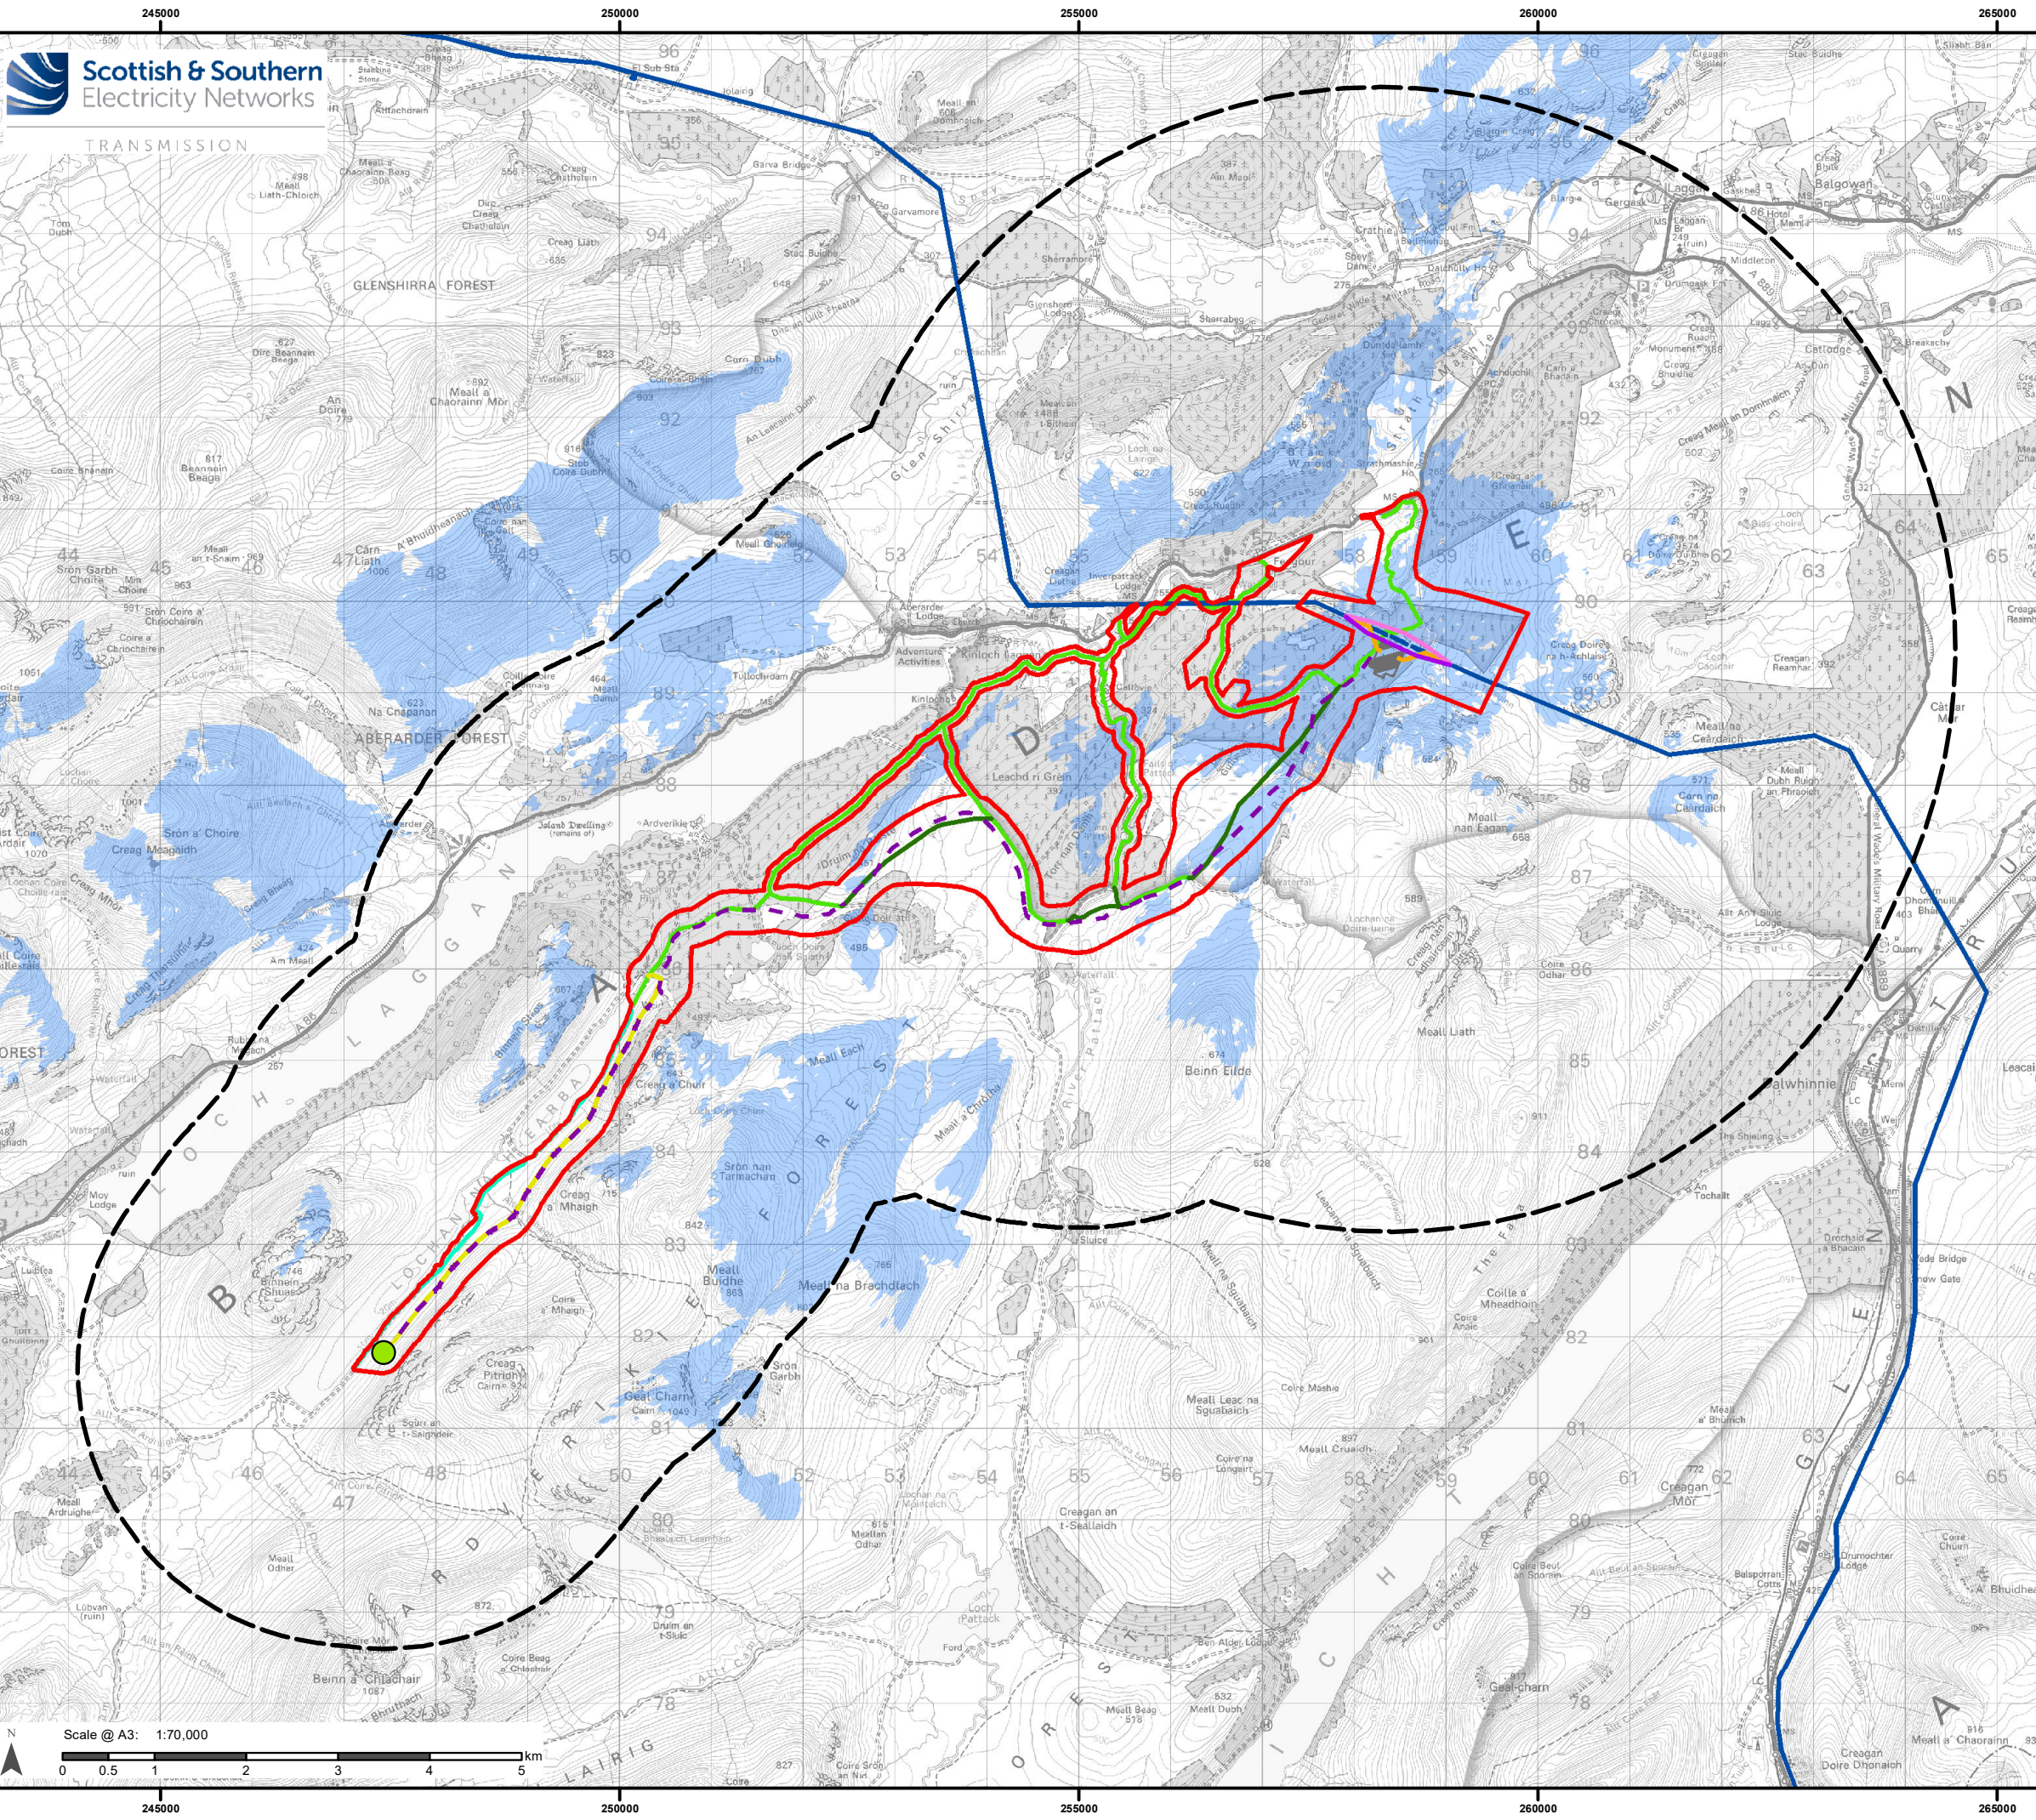

Legend

- Indicative Site Boundary
- Proposed LVIA Study Area
- Existing Infrastructure**
 - Beauly - Denny 400 kV (OHL)
 - Beauly - Denny 400 kV (OHL) (to be dismantled)
- Proposed Development (Indicative)**
 - Coire Mashie Substation
 - Underground Cable (UGC) Alignment
 - New Beauly - Denny 400 kV OHL
- Proposed Temporary Infrastructure (Indicative)**
 - OHL (Northern Option)
 - OHL (Southern Option)
- Access Tracks (Existing and Proposed)**
 - New Proposed Permanent Tracks (Indicative)
 - Existing Track (will likely require upgrading if utilised)
 - Existing Track Along Loch Earba (likely within PSH consented loch inundation area)
- Earba Pumped Storage Hydro (PSH) Scheme (Consented)**
 - Indicative Earba Pumped Storage Hydro Substation
 - Indicative Earba PSH Access Track (to be constructed by PSH Developer)
- Zone of Theoretical Visibility (ZTV)**
 - Preliminary ZTV (Coire Mashie Substation)

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number 0100022432.

Project: Coire Mashie Substation and
Earba Pumped Storage Hydro
Scheme Grid Connection Project

Title: Figure 5.1: Preliminary ZTV

Drawn by: M.T., J.W. Date: 27/08/2026

Drawing: 123021-D5.1-SCO-1.0.0