


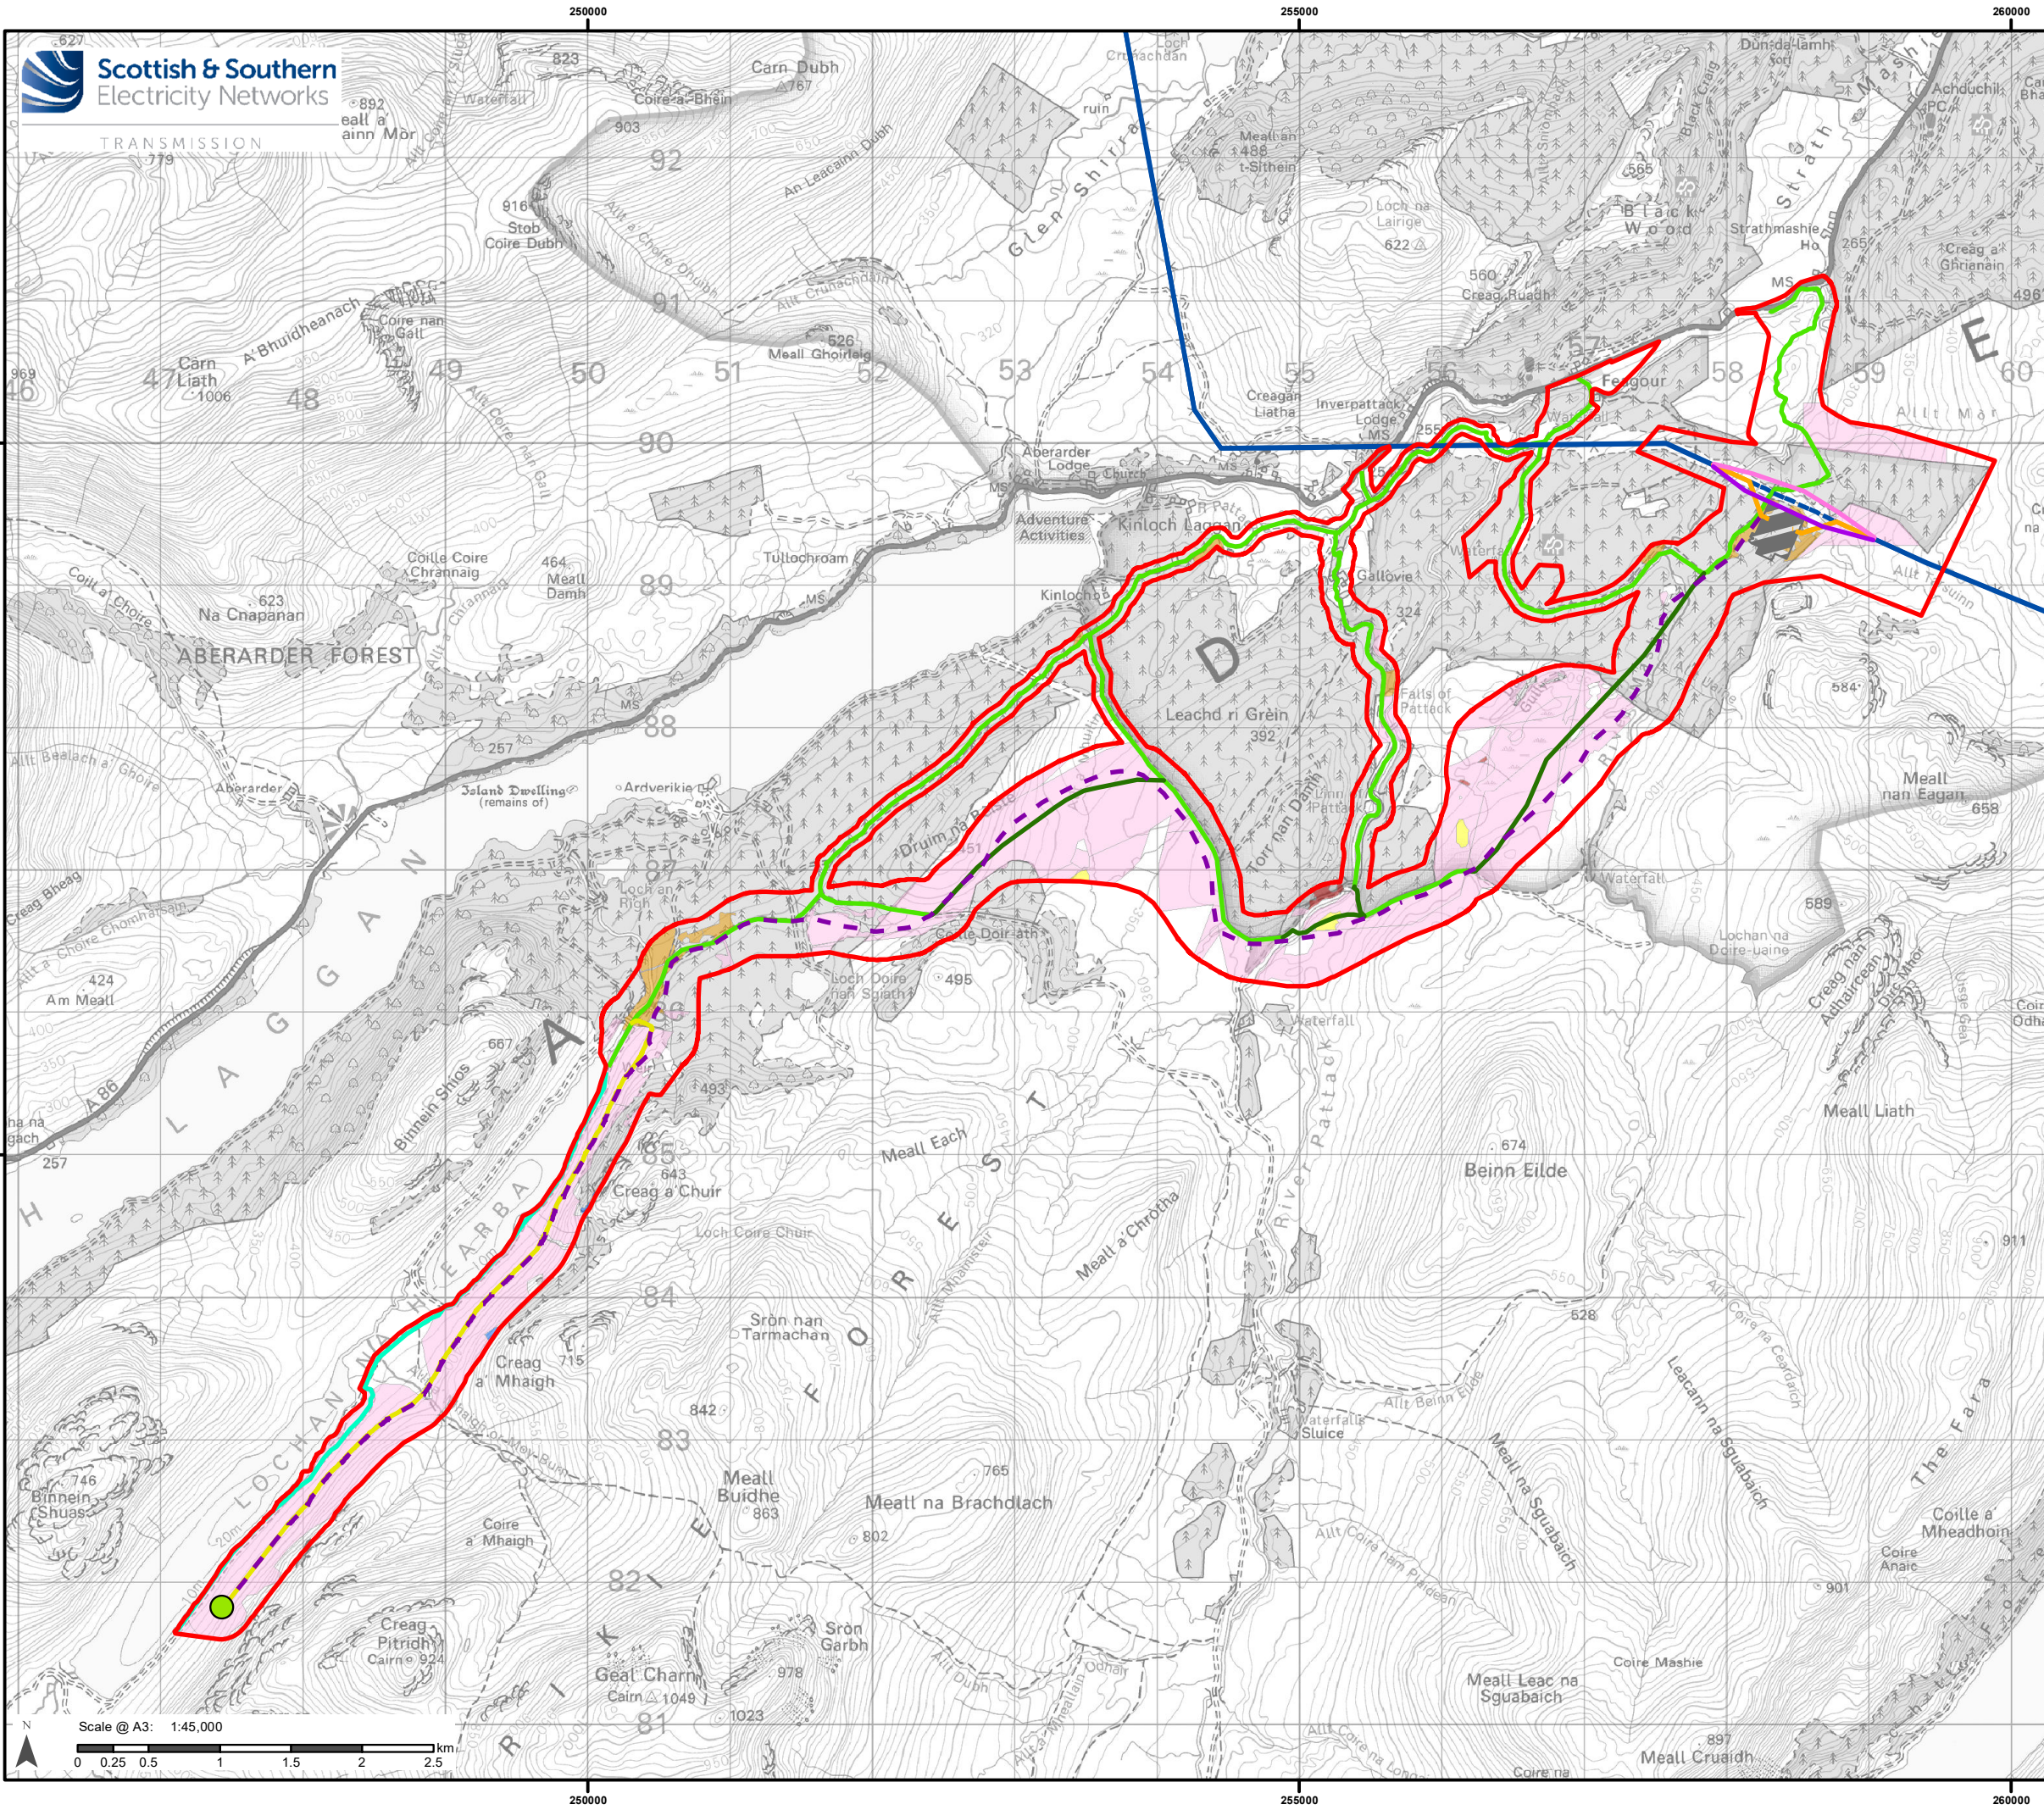

Legend

Indicative Site Boundary

Existing Infrastructure

Beaully - Denny 400 kV (OHL)

Beaully - Denny 400 kV (OHL) (to be dismantled)

Proposed Development (Indicative)

Coire Mashie Substation

Underground Cable (UGC) Alignment

New Beaully - Denny 400 kV OHL

Proposed Temporary Infrastructure (Indicative)

OHL (Northern Option)

OHL (Southern Option)

Access Tracks (Existing and Proposed)

New Proposed Permanent Tracks (Indicative)

Existing Track (will likely require upgrading if utilised)

Existing Track Along Loch Earba (likely within PSH consented loch inundation area)

Earba Pumped Storage Hydro (PSH) Scheme (Consented)

Indicative Earba Pumped Storage Hydro Substation

Indicative Earba PSH Access Track (to be constructed by PSH Developer)

Annex 1 & GWDTE Habitats

4010 - Northern Atlantic Wet Heaths

4030 - European Dry Heaths

7130 - Blanket Bog

H8110 - Siliceous Scree

H91C0 - Caledonian Forest

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number 0100022432.

Project: Coire Mashie Substation and Earba Pumped Storage Hydro Scheme Grid Connection Project

Title: Figure 6.3: Sensitive Habitats: Annex 1 & GWDTE Habitats

Drawn by: M.T., J.W. Date: 25/08/2026

Drawing: 123021-D6.3-SCO-0.1.0