



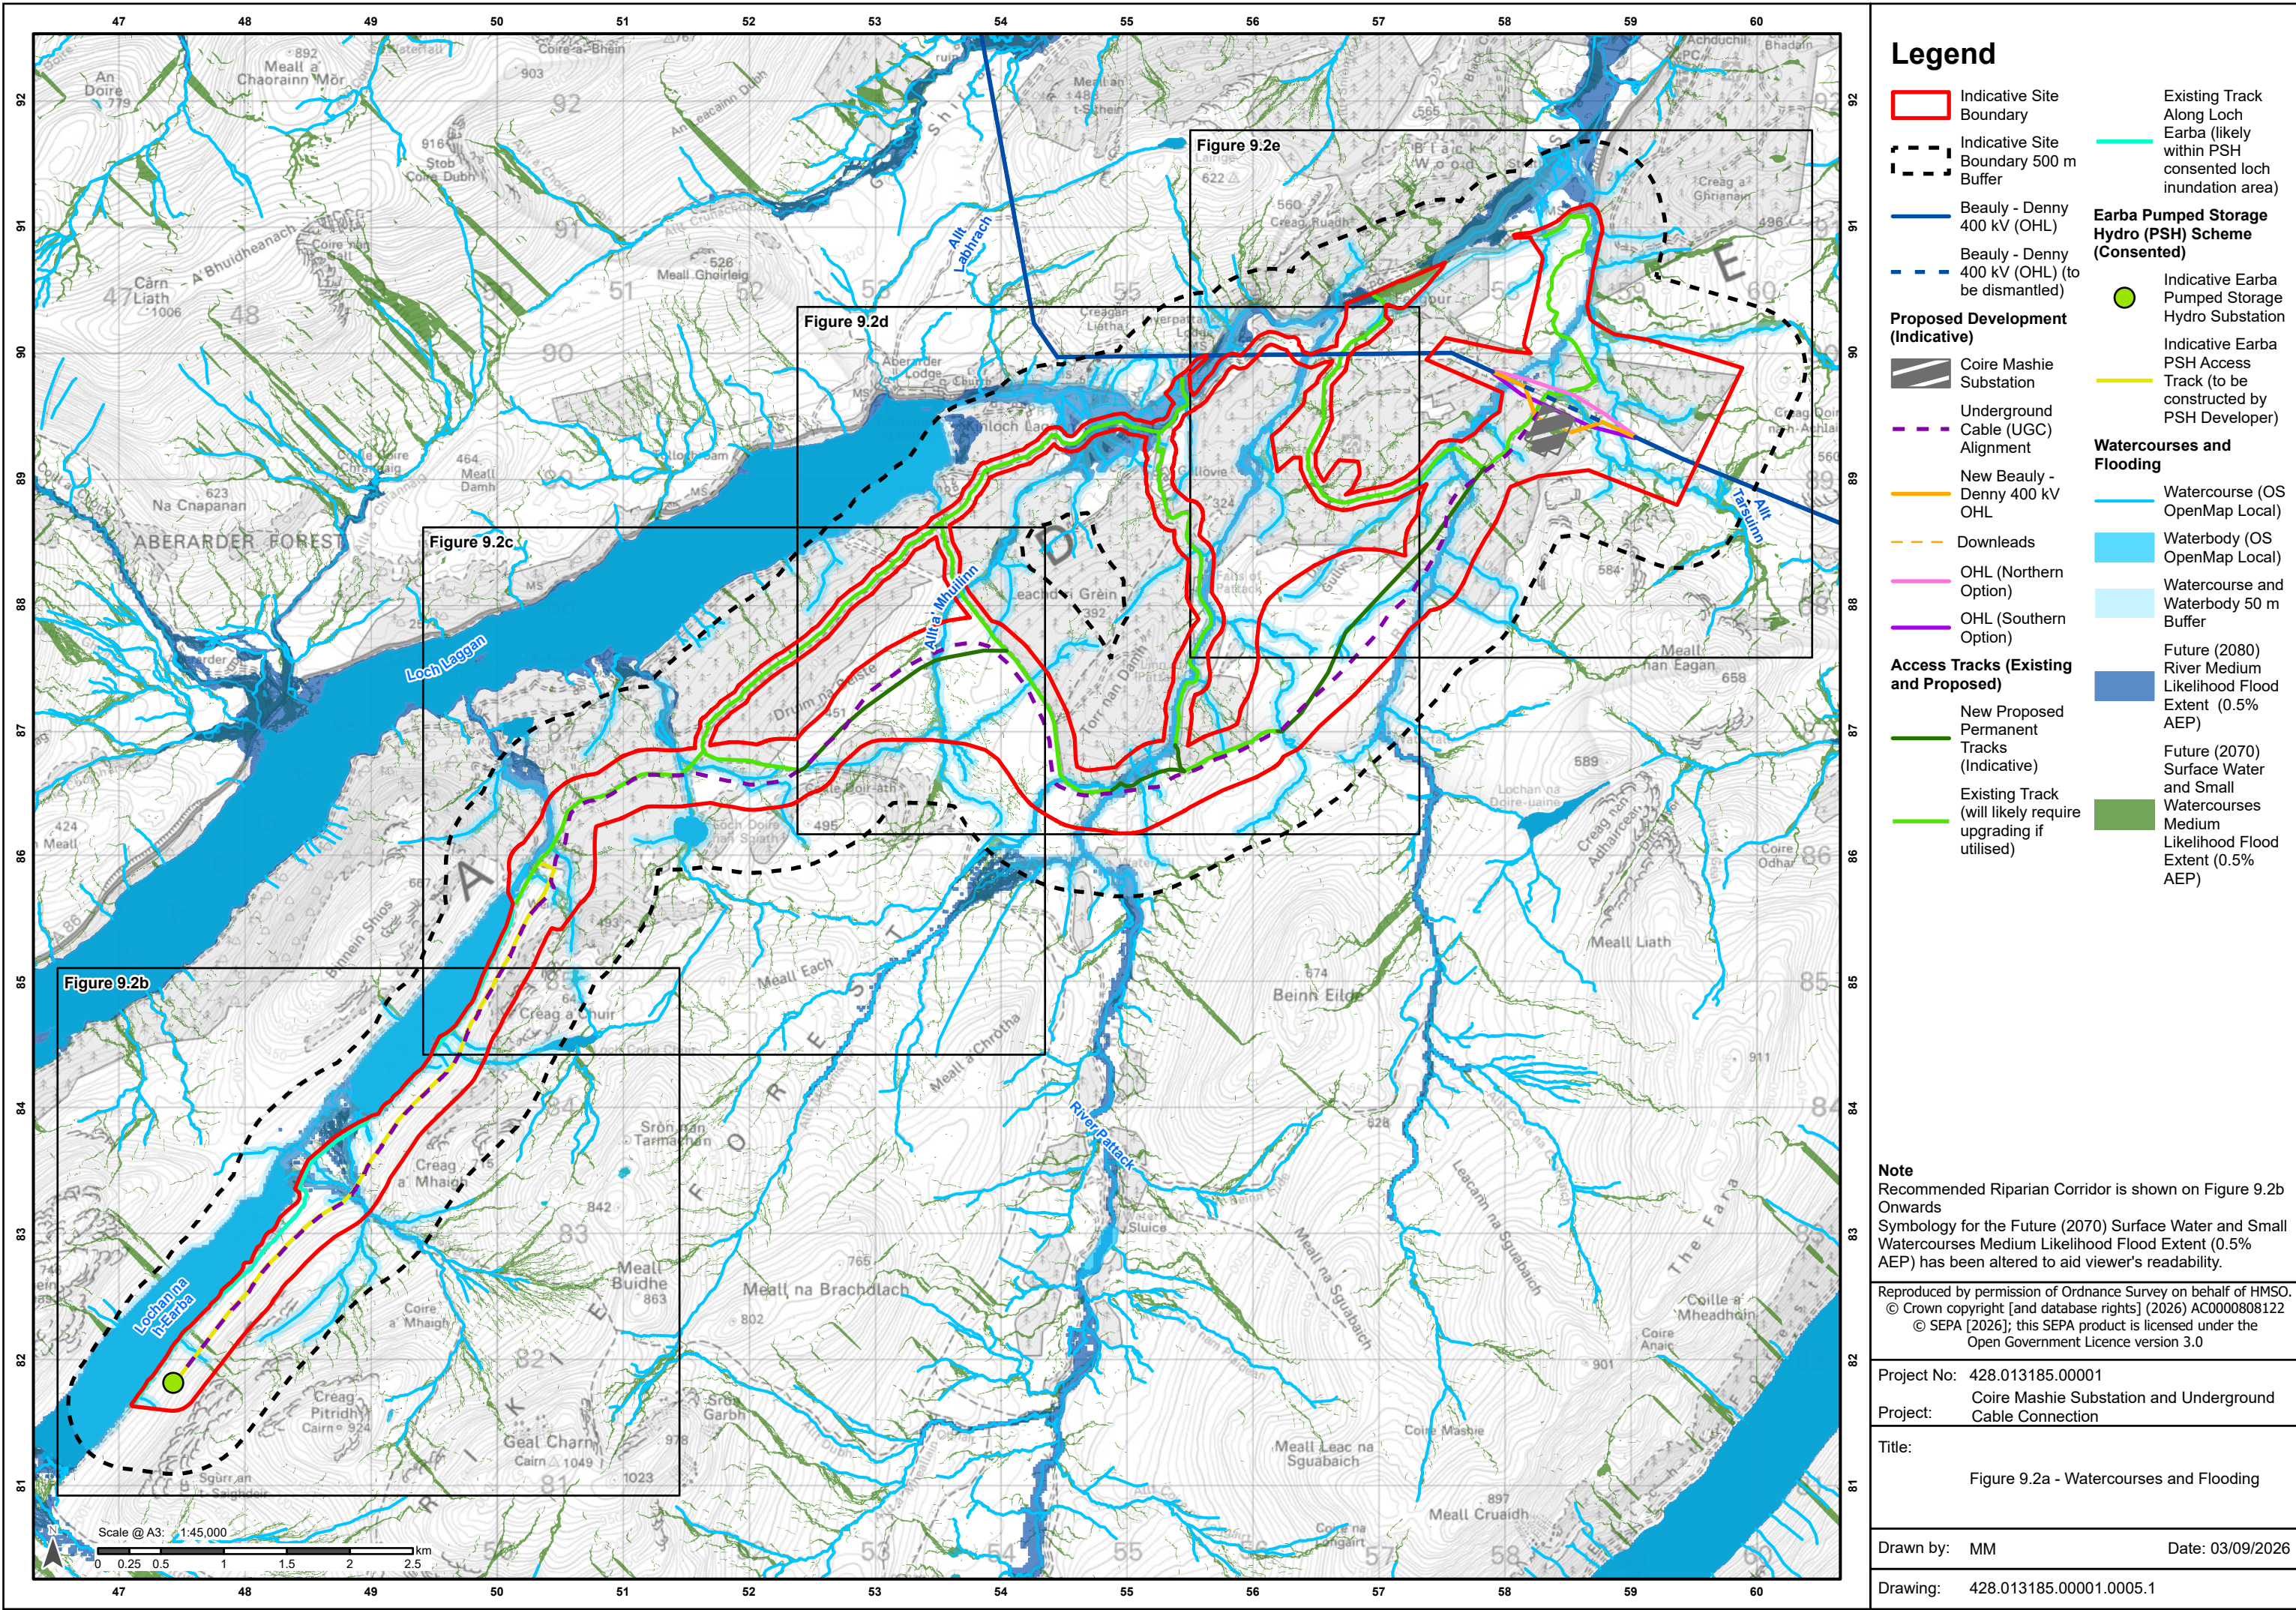

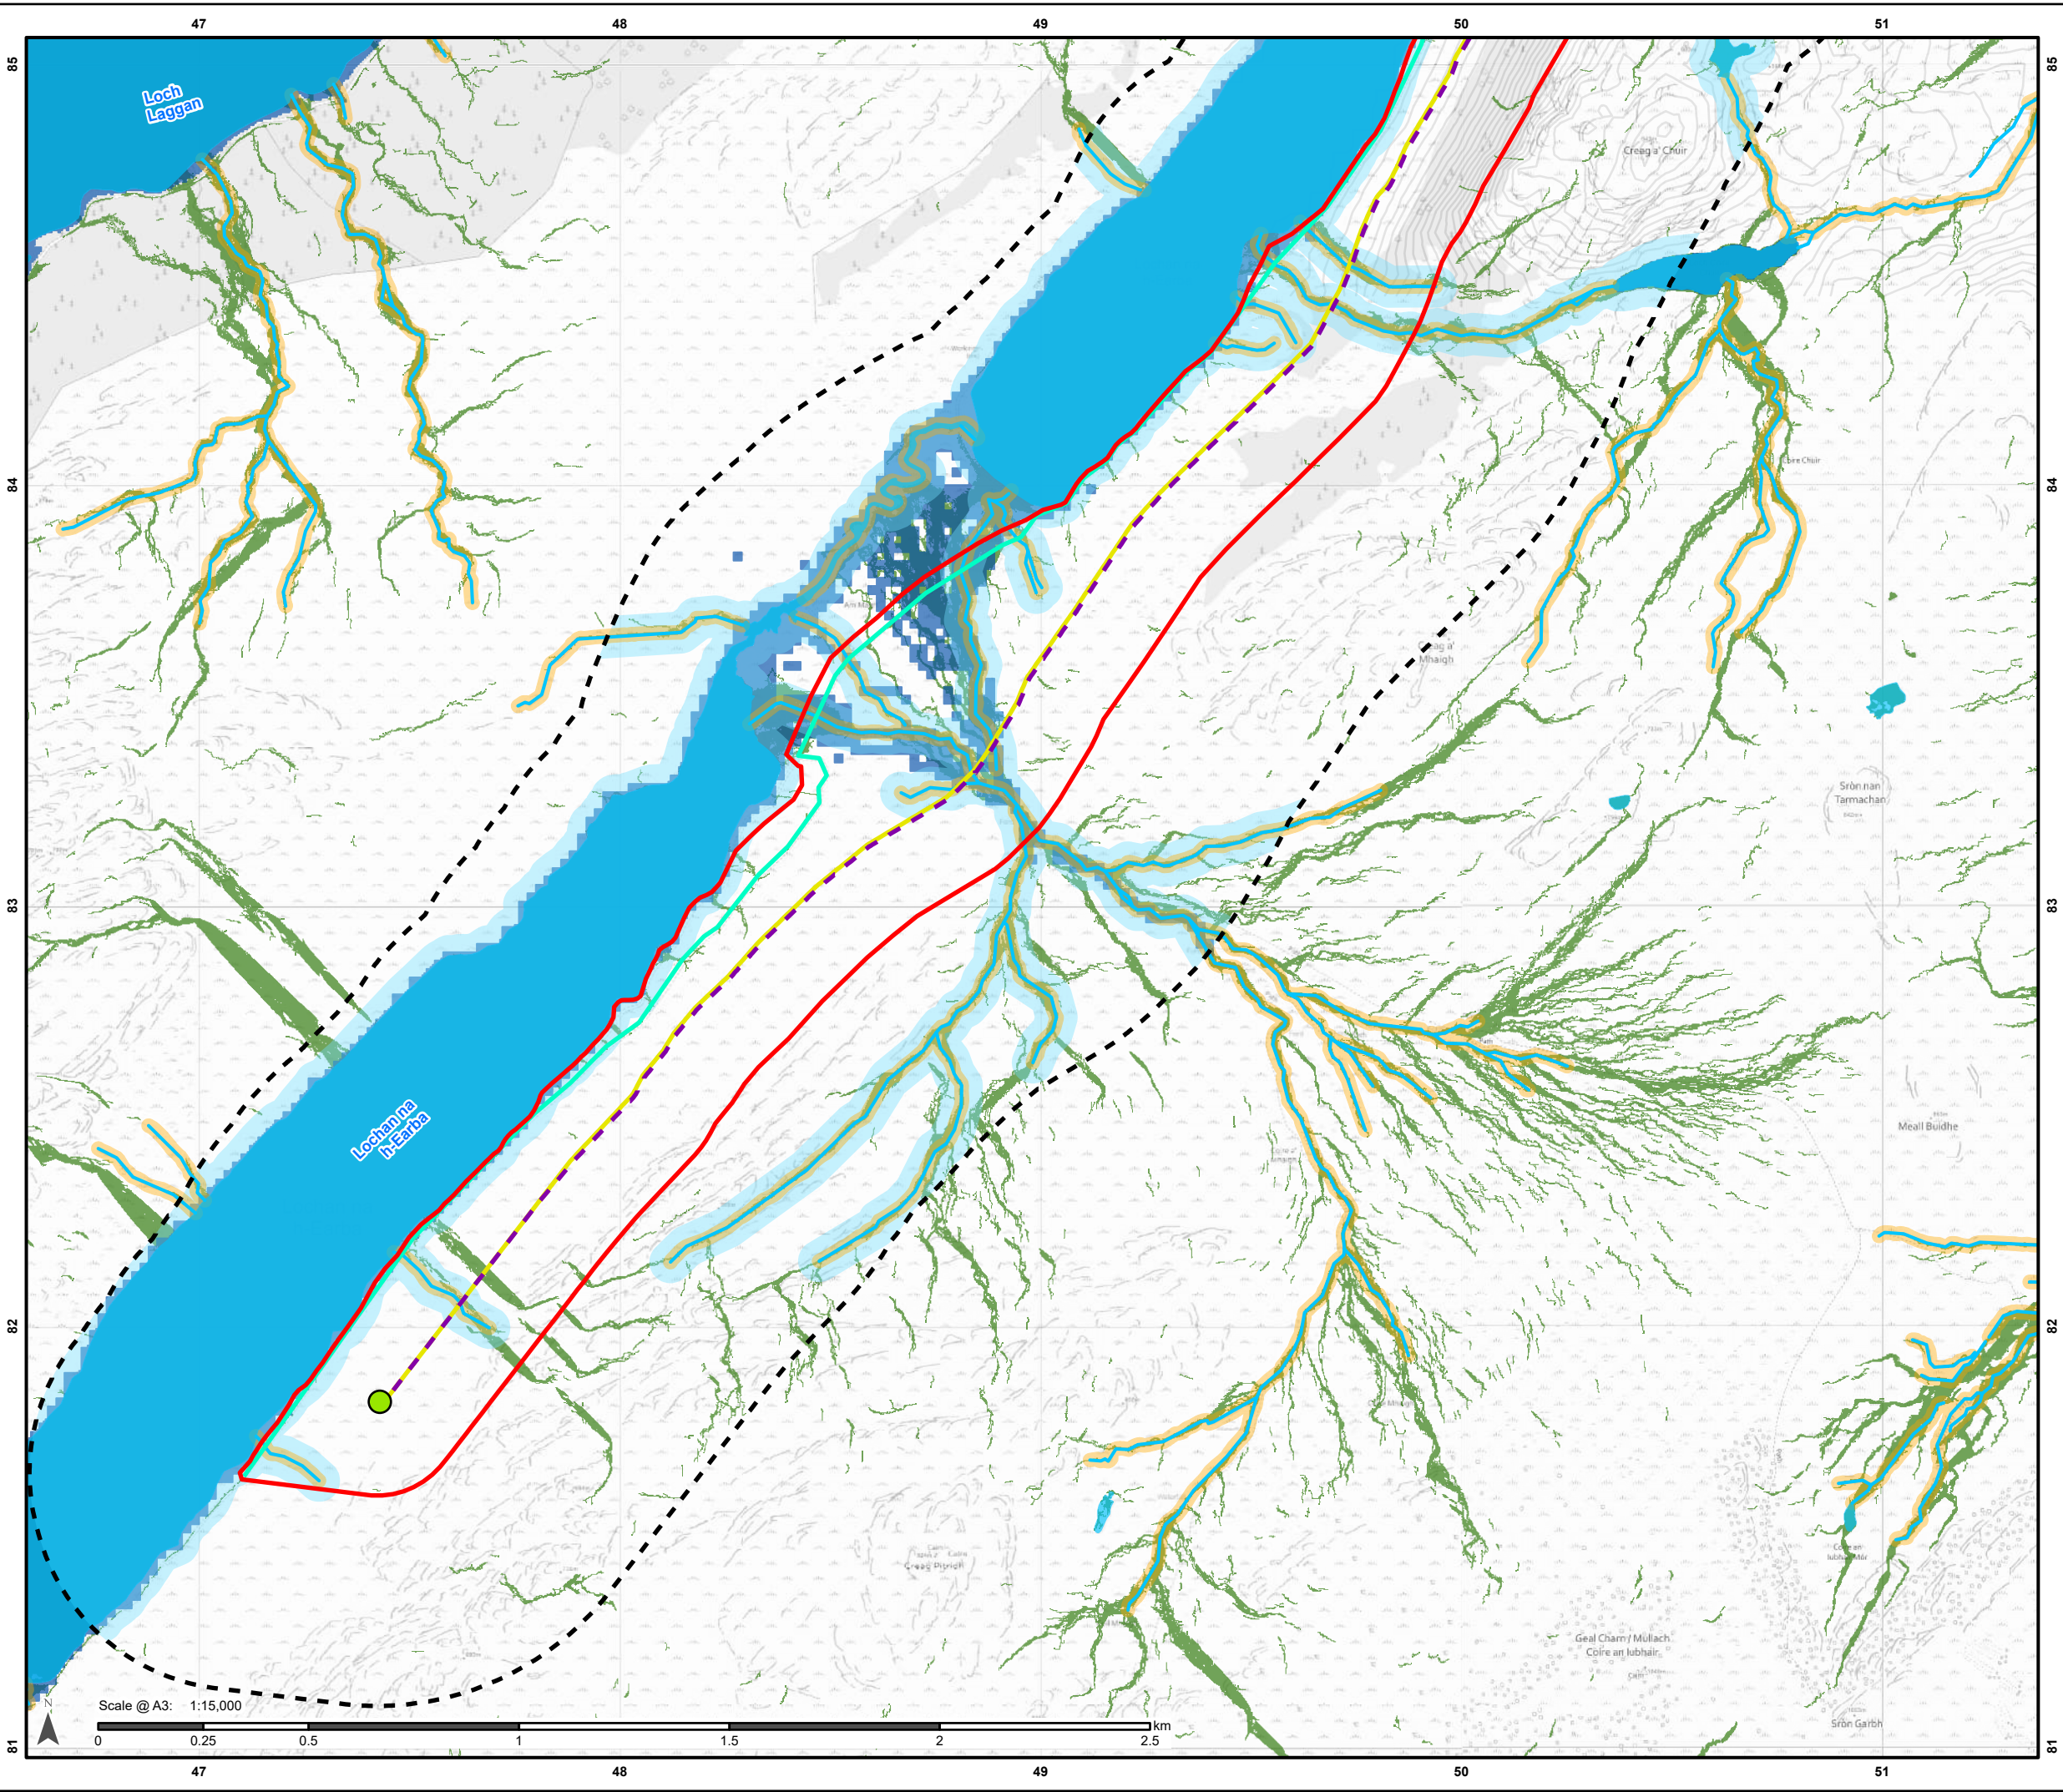

Legend

Indicative Site Boundary

Indicative Site Boundary 500 m Buffer

Existing Infrastructure

Beaully - Denny Towers

Beaully - Denny Towers (to be removed)

Beaully - Denny 400 kV (OHL)

Beaully - Denny 400 kV (OHL) (to be dismantled)

Proposed Development (Indicative)

Coire Mashie Substation

Underground Cable (UGC) Alignment

New Beaully - Denny Towers

New Beaully - Denny 400 kV OHL

Downleads

Proposed Temporary Infrastructure (Indicative)

Towers (Northern Option)

Towers (Southern Option)

OHL (Northern Option)

OHL (Southern Option)

Access Tracks (Existing and Proposed)

New Proposed Permanent Tracks (Indicative)

Existing Track (will likely require upgrading if utilised)

Existing Track Along Loch Earba (likely within PSH consented loch inundation area)

Earba Pumped Storage Hydro (PSH) Scheme (Consented)

Indicative Earba Pumped Storage Hydro Substation

Indicative Earba PSH Access Track (to be constructed by PSH Developer)

Watercourses and Flooding

Watercourse (OS OpenMap Local)

Waterbody (OS OpenMap Local)

Recommended Riparian Corridor

Watercourse and Waterbody 50 m Buffer

Future (2080) River Medium Likelihood Flood Extent (0.5% AEP)

Future (2070) Surface Water and Small Watercourses Medium Likelihood Flood Extent (0.5% AEP)

Note

Recommended Riparian Corridor is shown on Figure 9.2b Onwards

Symbology for the Future (2070) Surface Water and Small Watercourses Medium Likelihood Flood Extent (0.5% AEP) has been altered to aid viewer's readability.

Reproduced by permission of Ordnance Survey on behalf of HMSO.
© Crown copyright [and database rights] (2026) AC0000808122
© SEPA [2026]; this SEPA product is licensed under the Open Government Licence version 3.0

Project No: 428.013185.00001

Coire Mashie Substation and Underground Cable Connection

Title:

Figure 9.2b - Watercourses and Flooding

Drawn by: MM

Date: 03/09/2026

Drawing: 428.013185.00001.0005.1

