


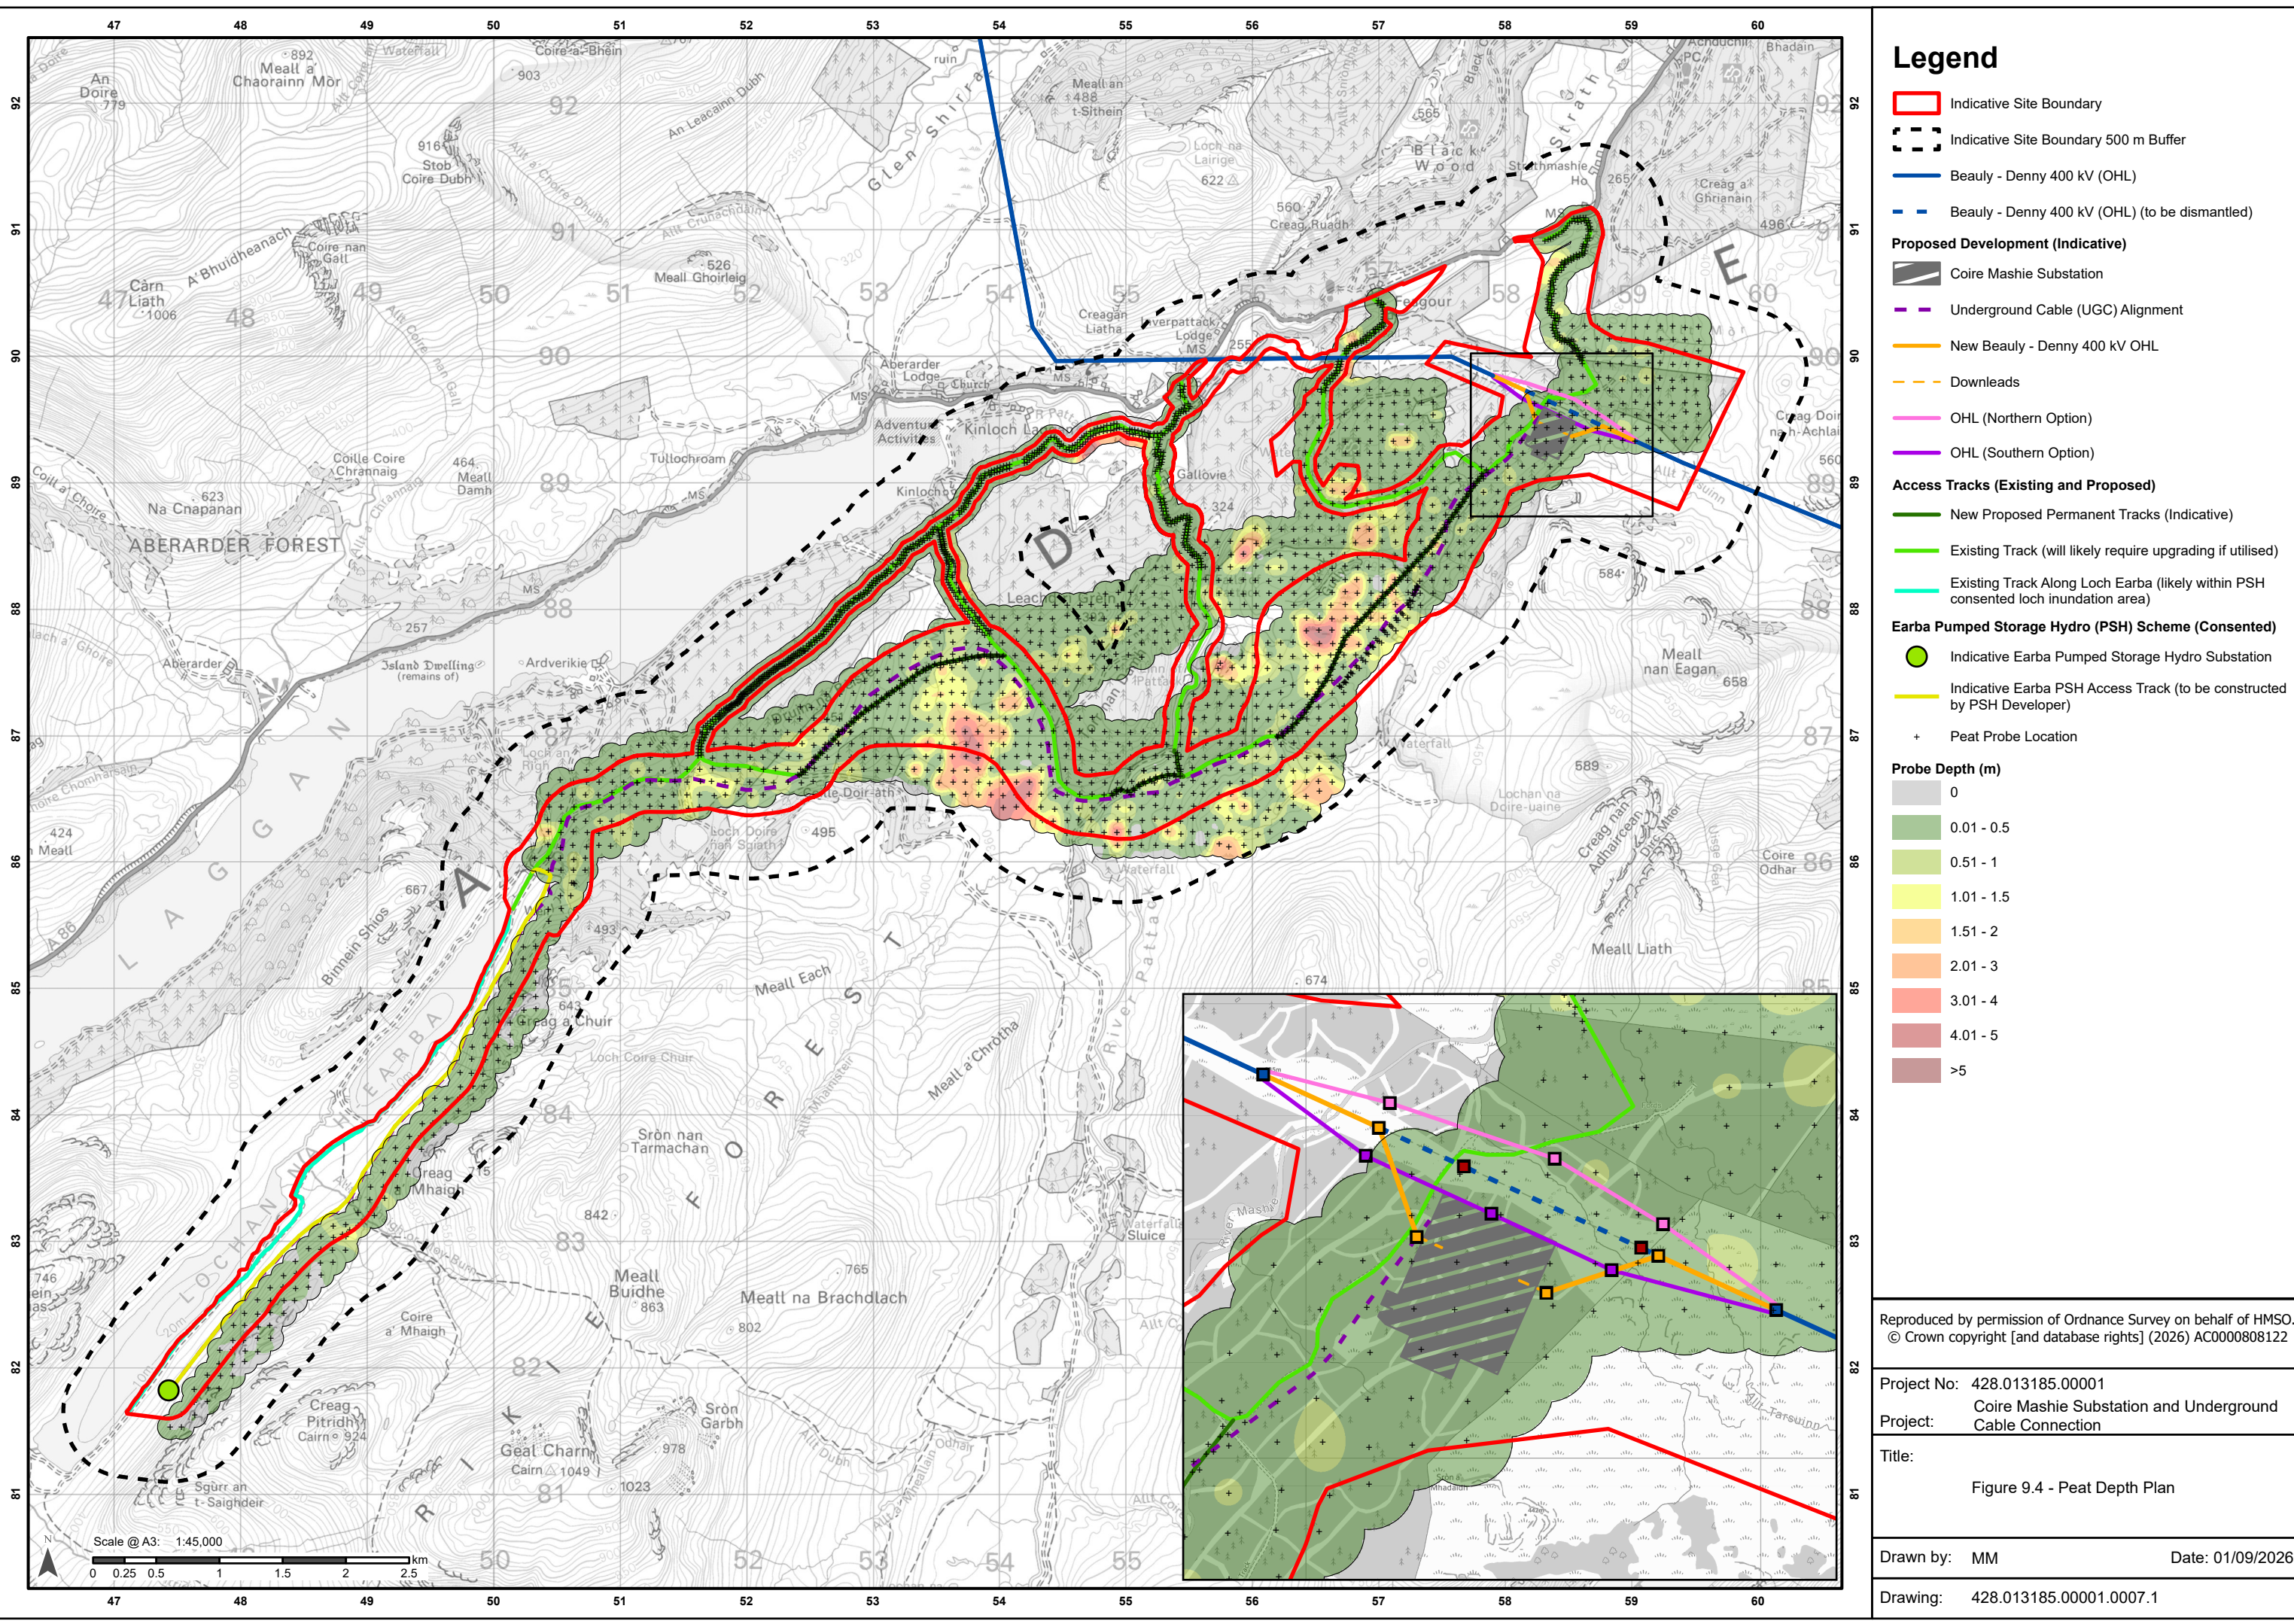

Legend

- Indicative Site Boundary
- Indicative Site Boundary 500 m Buffer
- Beaulieu - Denny 400 kV (OHL)
- Beaulieu - Denny 400 kV (OHL) (to be dismantled)
- Proposed Development (Indicative)**
- Coire Mashie Substation
- Underground Cable (UGC) Alignment
- New Beaulieu - Denny 400 kV OHL
- Downloads
- OHL (Northern Option)
- OHL (Southern Option)
- Access Tracks (Existing and Proposed)**
- New Proposed Permanent Tracks (Indicative)
- Existing Track (will likely require upgrading if utilised)
- Existing Track Along Loch Earba (likely within PSH consented loch inundation area)
- Earba Pumped Storage Hydro (PSH) Scheme (Consented)**
- Indicative Earba Pumped Storage Hydro Substation
- Indicative Earba PSH Access Track (to be constructed by PSH Developer)
- Peat Probe Location

Probe Depth (m)

- 0
- 0.01 - 0.5
- 0.51 - 1
- 1.01 - 1.5
- 1.51 - 2
- 2.01 - 3
- 3.01 - 4
- 4.01 - 5
- >5

Reproduced by permission of Ordnance Survey on behalf of HMSO.
© Crown copyright [and database rights] (2026) AC0000808122

Project No: 428.013185.00001
Coire Mashie Substation and Underground Cable Connection

Title:
Figure 9.4 - Peat Depth Plan

Drawn by: MM Date: 01/09/2026

Drawing: 428.013185.00001.0007.1