


Mapped Location

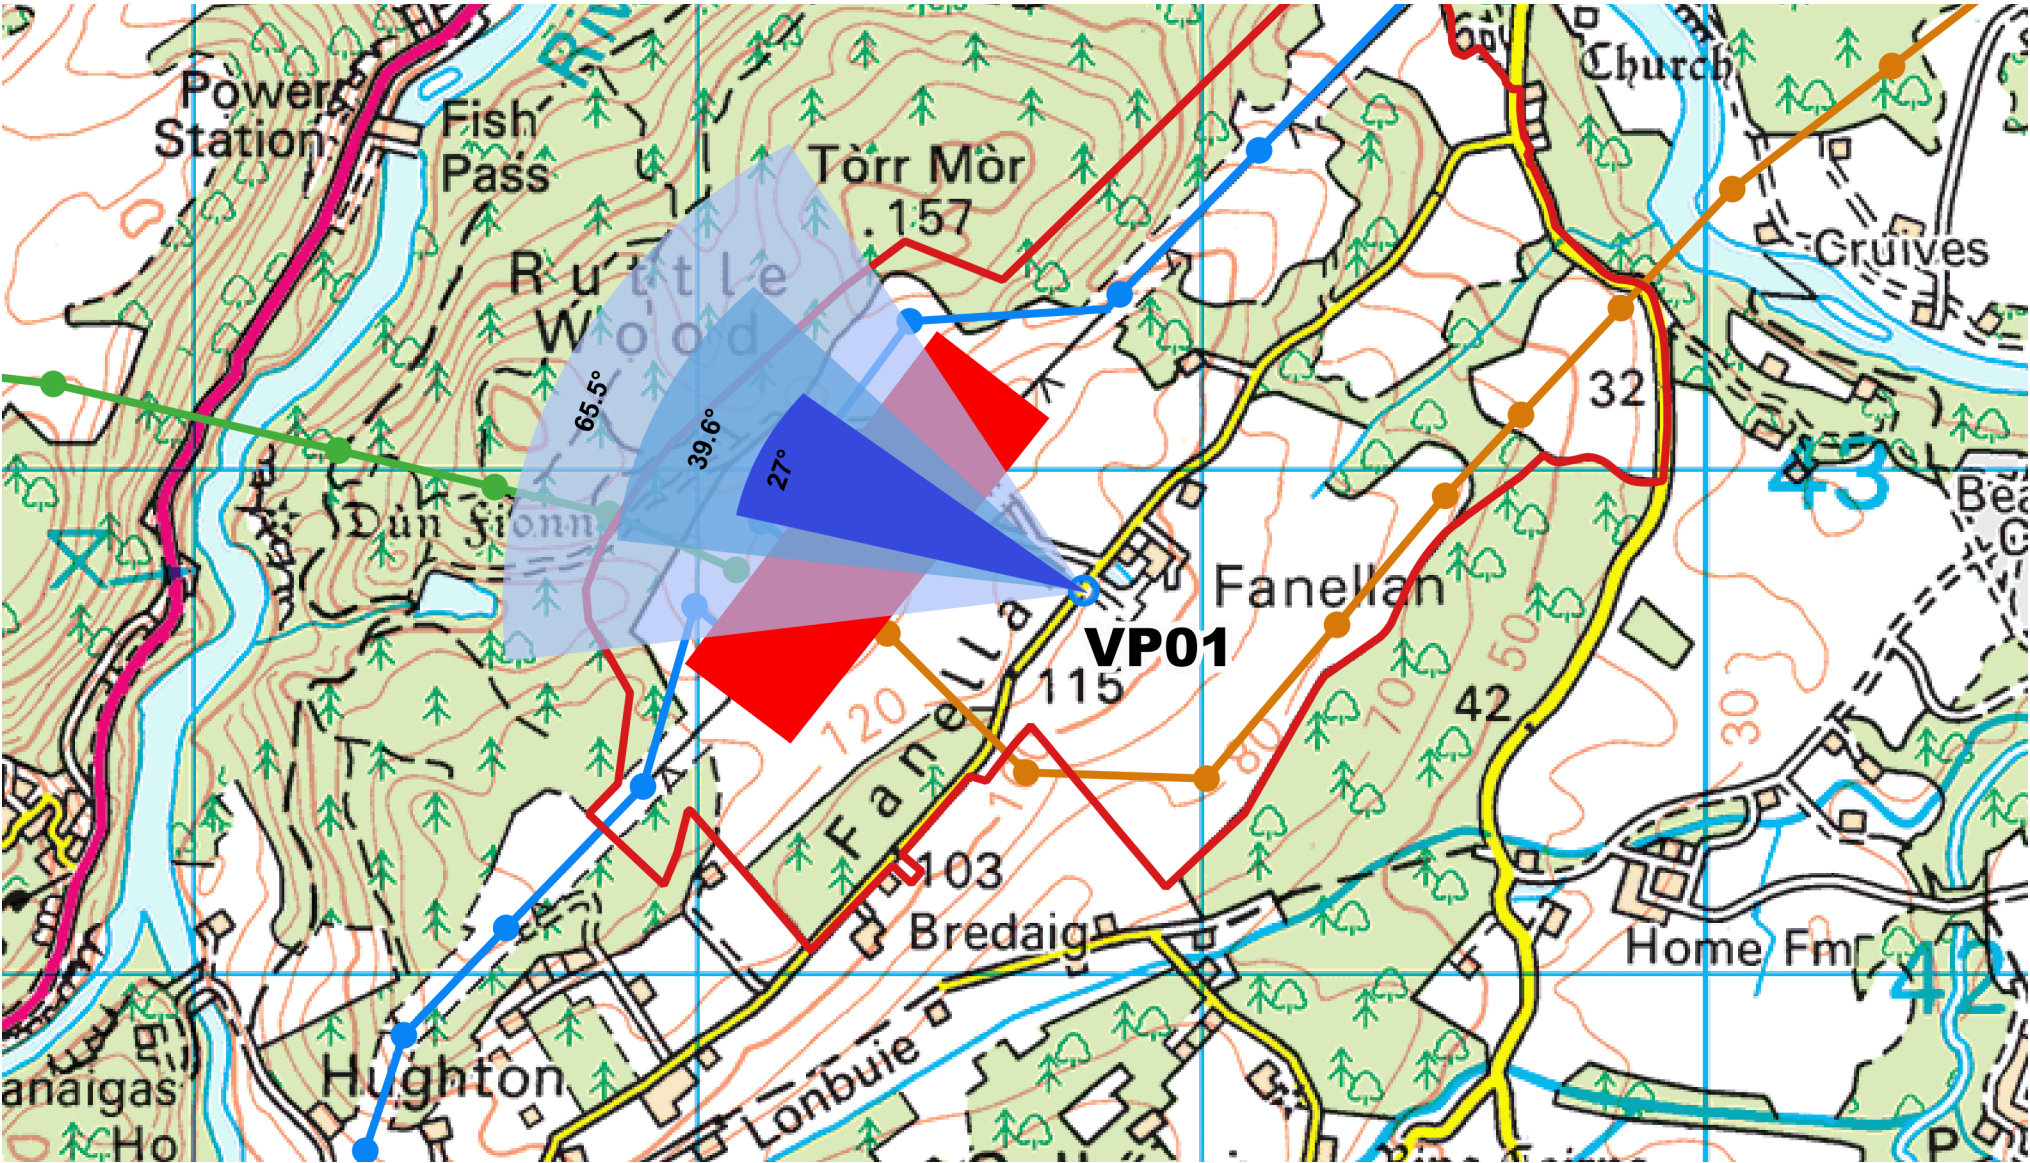

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12a**  
**Viewpoint Visualisations The Highland Council**  
**Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**


**Location Description:**  
The viewpoint is on Fanellan Road, just north of the area Lonbuie. Parking is situated directly adjacent to the viewpoint. The viewpoint can be accessed via foot from parking area

Camera Location



OSGB36 Location:	248767 842759
AOD:	108m
Camera Height:	1.5m
Distance to Development:	259m



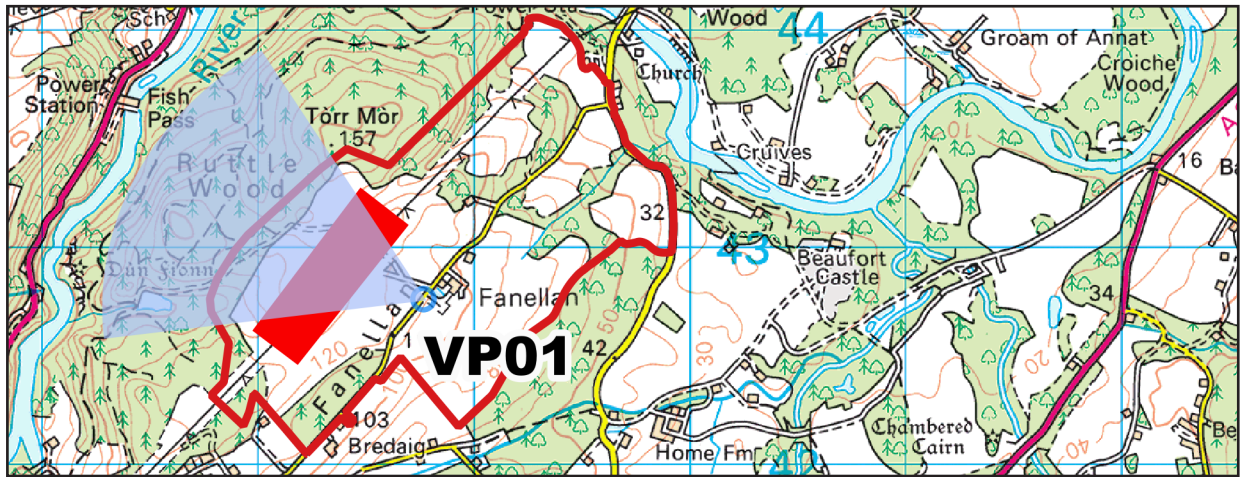

Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Alignment information correct as of 22.12.2024


**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12b**  
**Viewpoint 1: View looking west from Fanellan Road at**  
**Fanellan Cottages**  
**Operational View (Baseline) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





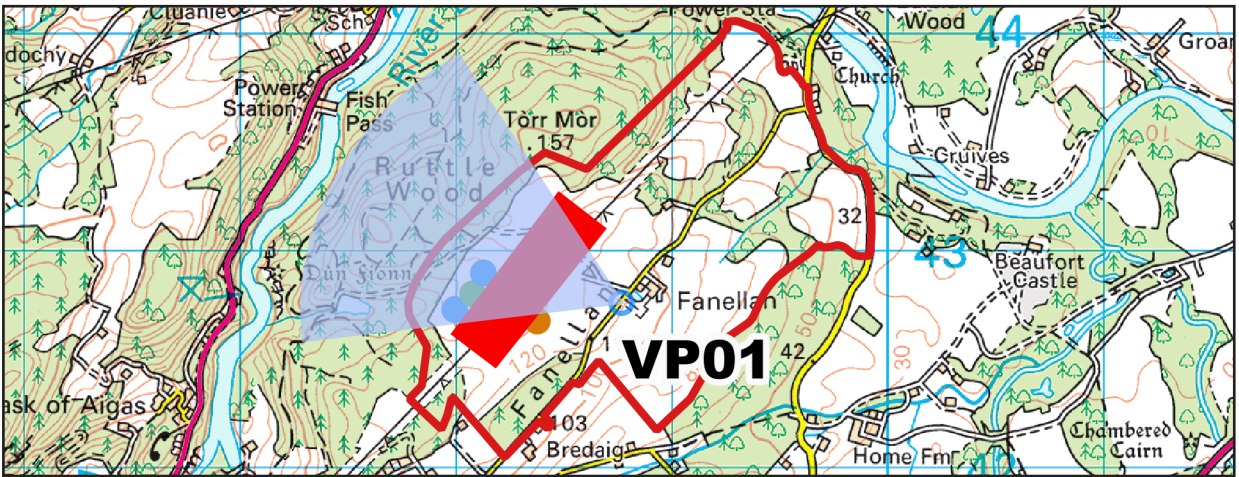

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12c**  
**Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
**Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024


Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



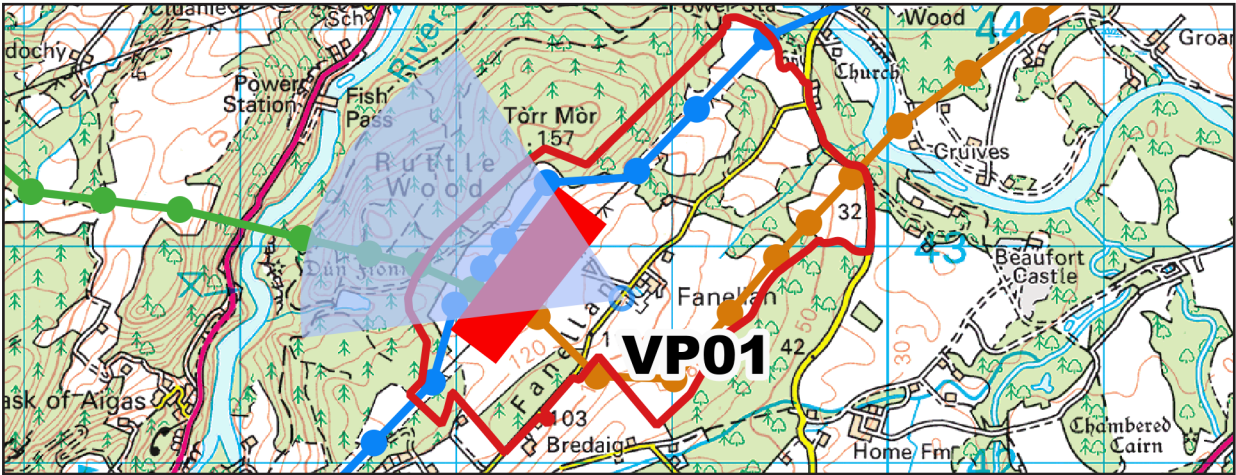

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12d**  
**Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
**Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024

Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

**Key:**

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



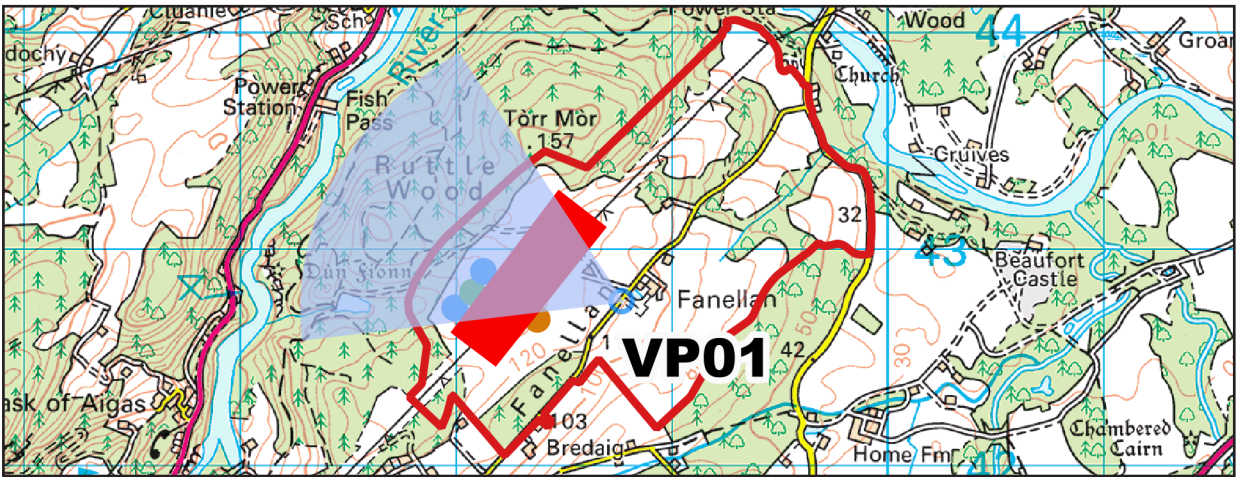

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12e**  
**Viewpoint 1: View looking west from Fanellan Road at**  
**Fanellan Cottages**  
**Operational View (Photomontage: Fanellan 400kV**  
**Substation & Converter Station & SSEN Cumulative**  
**Terminal Towers - Year 0) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024


Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



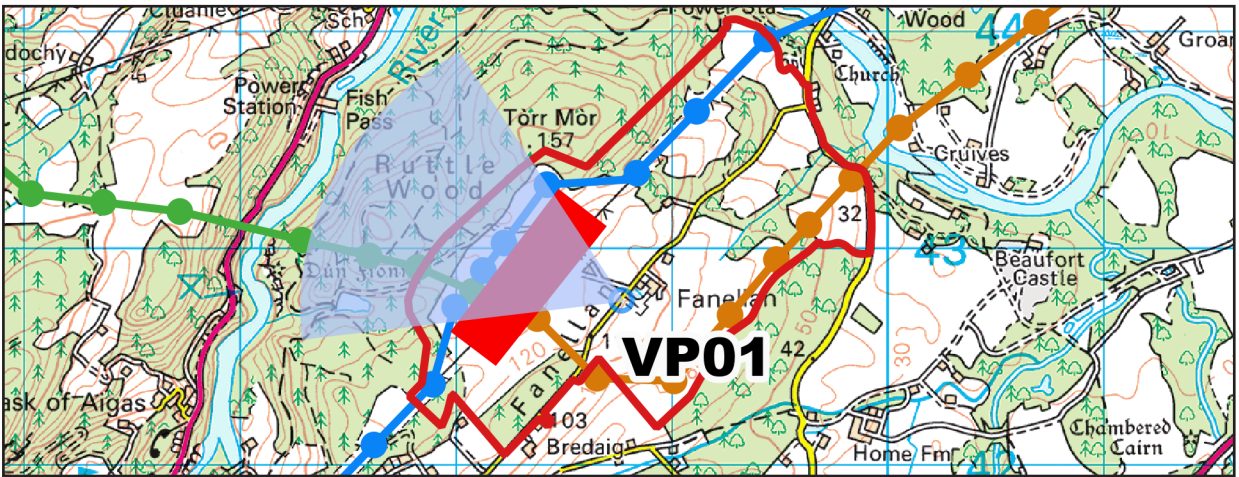

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12f**  
**Viewpoint 1: View looking west from Fanellan Road at**  
**Fanellan Cottages**  
**Operational View (Photomontage: SSEN Cumulative**  
**Overhead Line Schemes Only - Year 0) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024

Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)





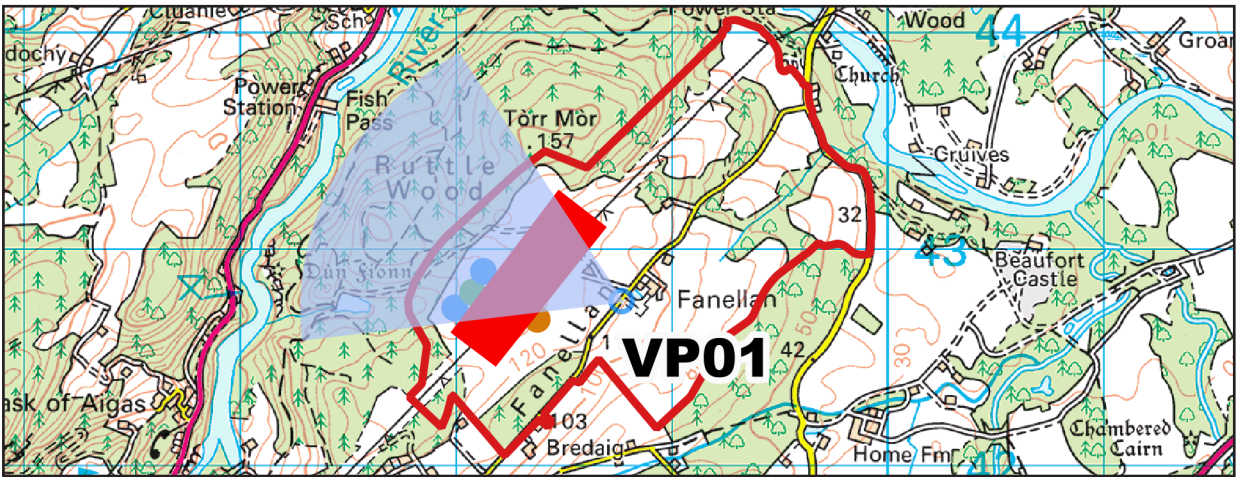

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12g**  
**Viewpoint 1: View looking west from Fanellan Road at**  
**Fanellan Cottages**  
**Operational View (Photomontage: Fanellan 400kV**  
**Substation & Converter Station & SSEN Cumulative**  
**Terminal Towers - Year 7) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024


Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



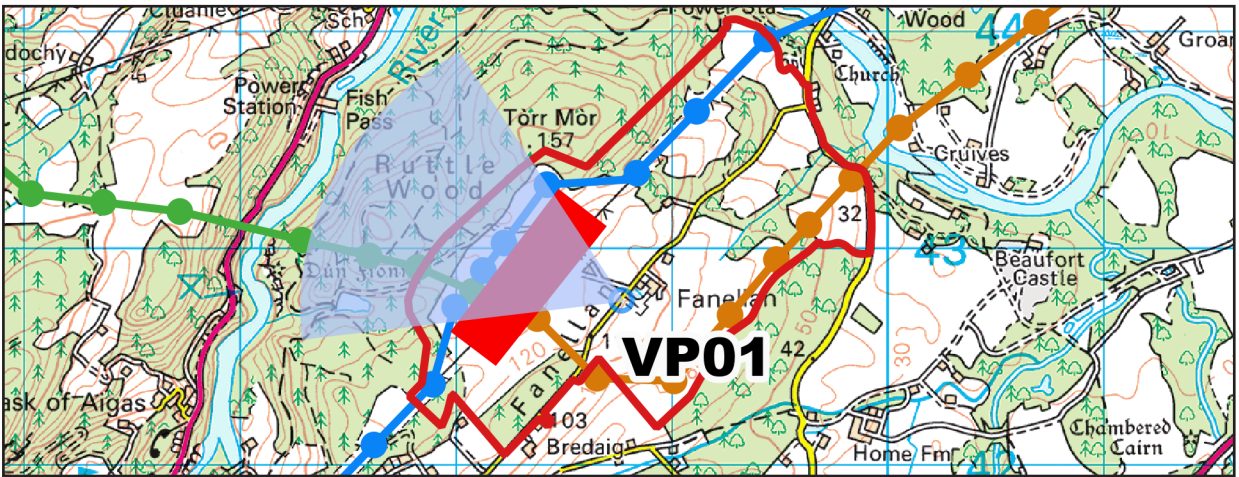

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12h**  
**Viewpoint 1: View looking west from Fanellan Road at**  
**Fanellan Cottages**  
**Operational View (Photomontage: SSEN Cumulative**  
**Overhead Line Schemes Only - Year 7) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024


Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



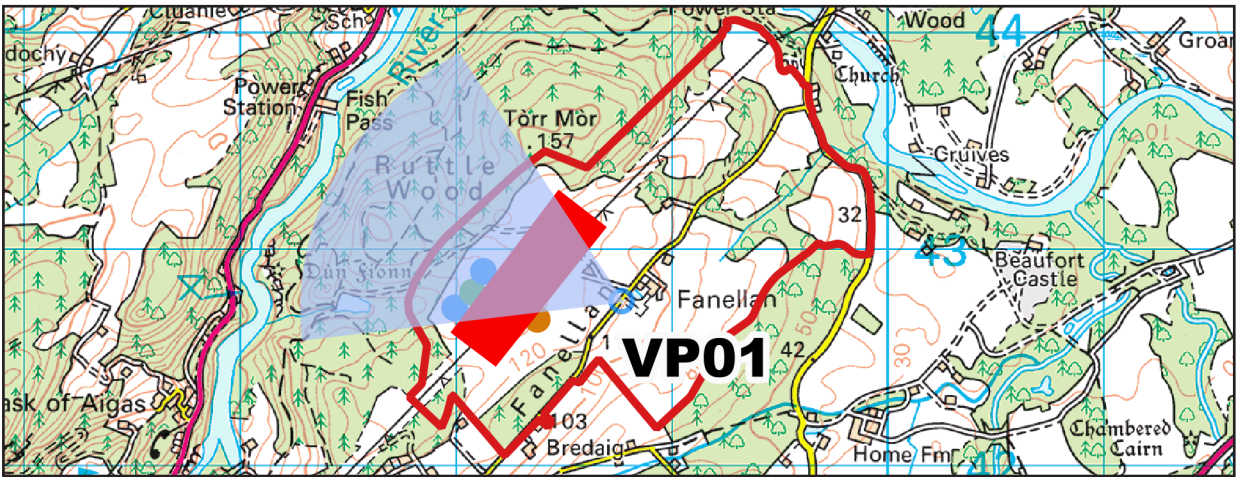

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.12i**  
**Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
**Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°**

Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024

Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)





Viewpoint Location: X 248767, Y 842759  
AOD: 108m  
Distance to Development and Direction of view: 259m, 296° (South)

*Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.*

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

**Key:**

- Fanellan 400kV Substation & Converter Station
- Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-k Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-I Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)  
 - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-m Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-n Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
Only - Year 0) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-o Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 7) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-p Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only -  
 Year 7) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-q Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-r Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only -  
 Year 15) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-s Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-1 Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photowire: SSN Cumulative Overhead Line Schemes Only)  
- 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-u Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-v Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
Only - Year 0) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-w Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 7) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-x Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
 Only - Year 7) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-y Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
Distance to Development and Direction of view: 259m, 296°  
Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.12-z Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages**  
 Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
 Only - Year 15) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m  
 Distance to Development and Direction of view: 259m, 296°  
 Date: 05/03/2024  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

