


Mapped Location

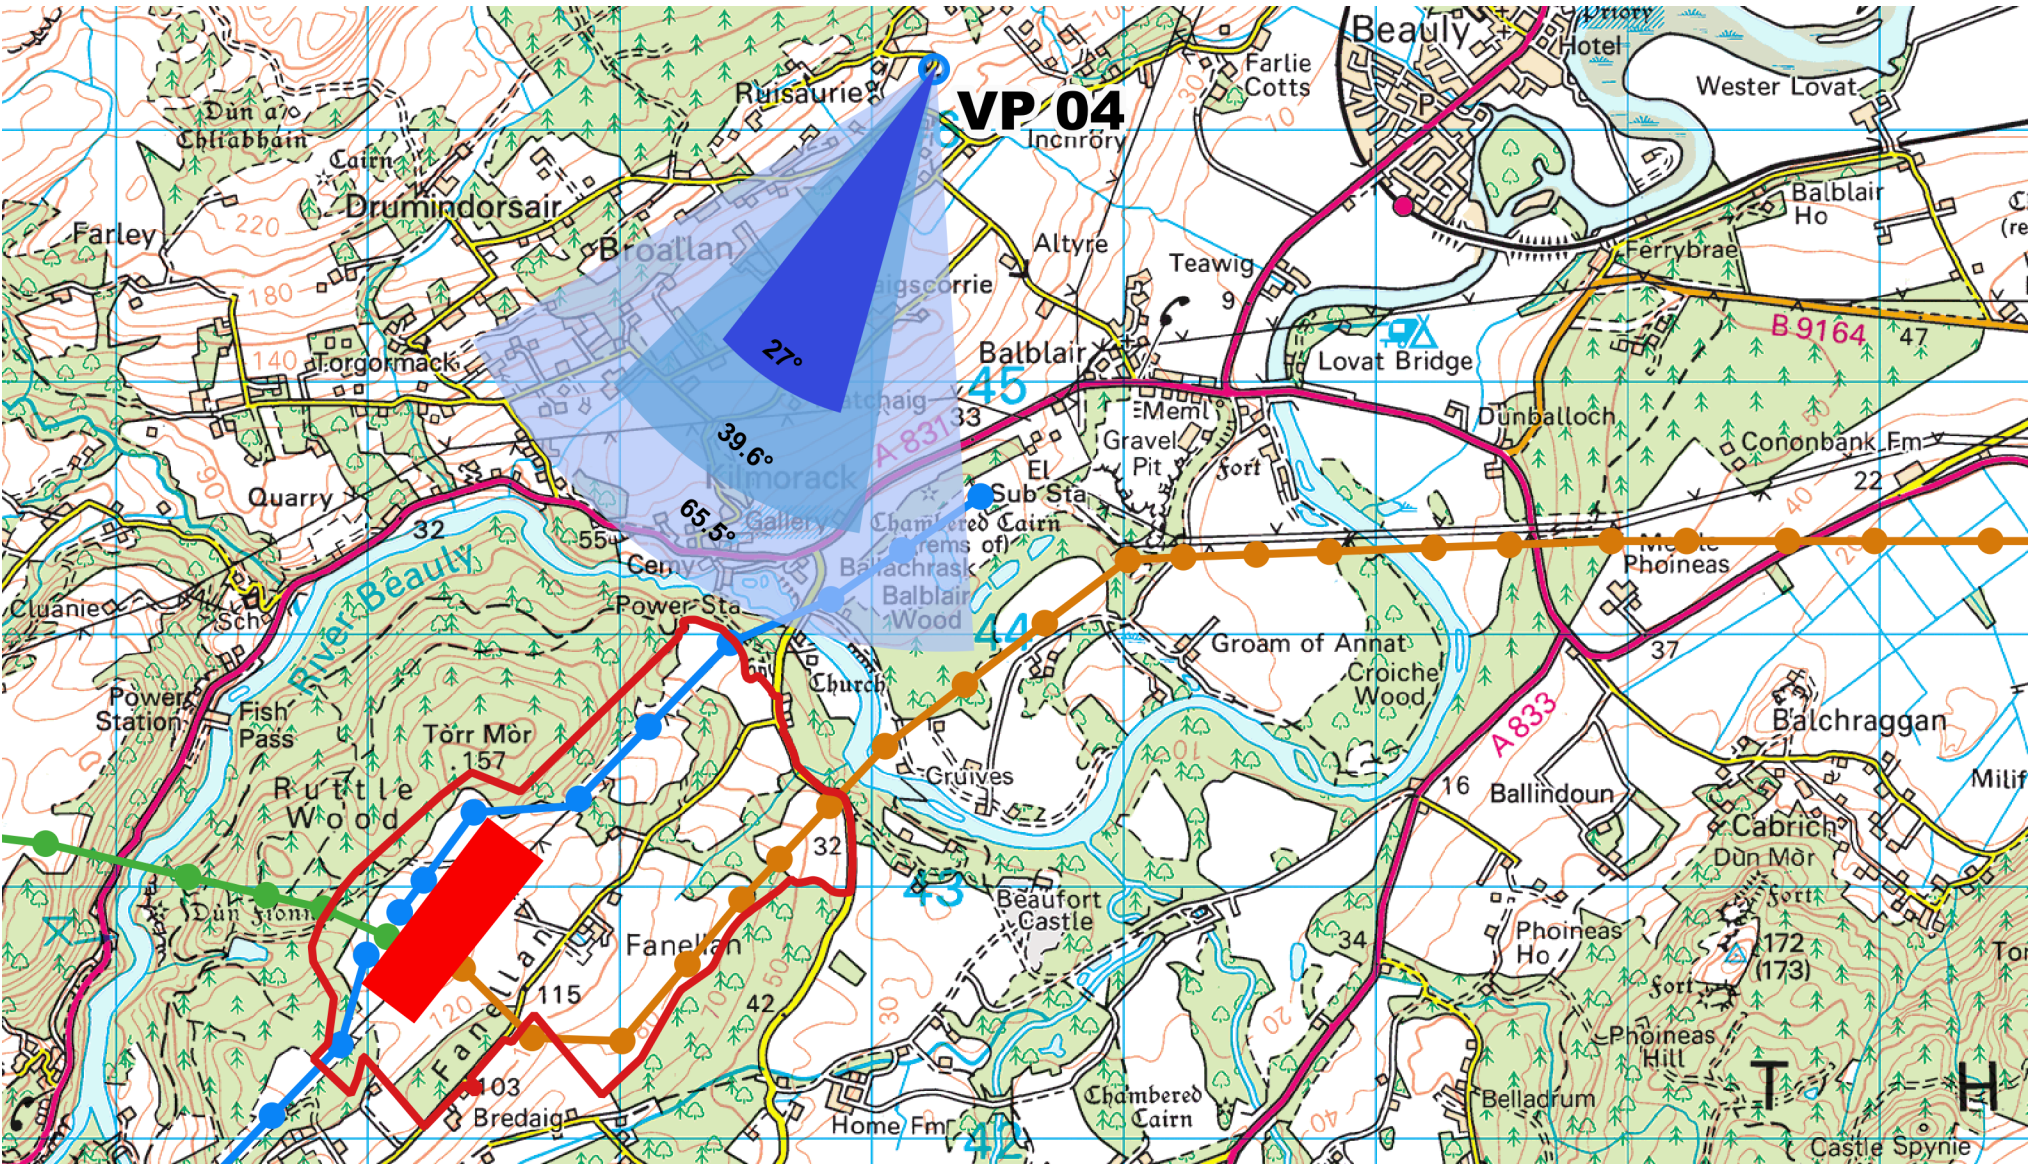

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15a**  
**Viewpoint 4: View looking south-west from Ruisaurie**

**Location Description:**  
The viewpoint is on an unnamed road in Ruisaurie, 150 m northeast of Drumindorsair Road, on the southern side of the road opposite a steel gate within the embankment. There is a layby for parking approximately 50 m southwest and the viewpoint can be accessed on foot on the quiet road.

Camera Location




Location Data

OSGB36 Location:	250248 846239
AOD:	126m
Camera Height:	1.5m
Distance to Development:	3482m





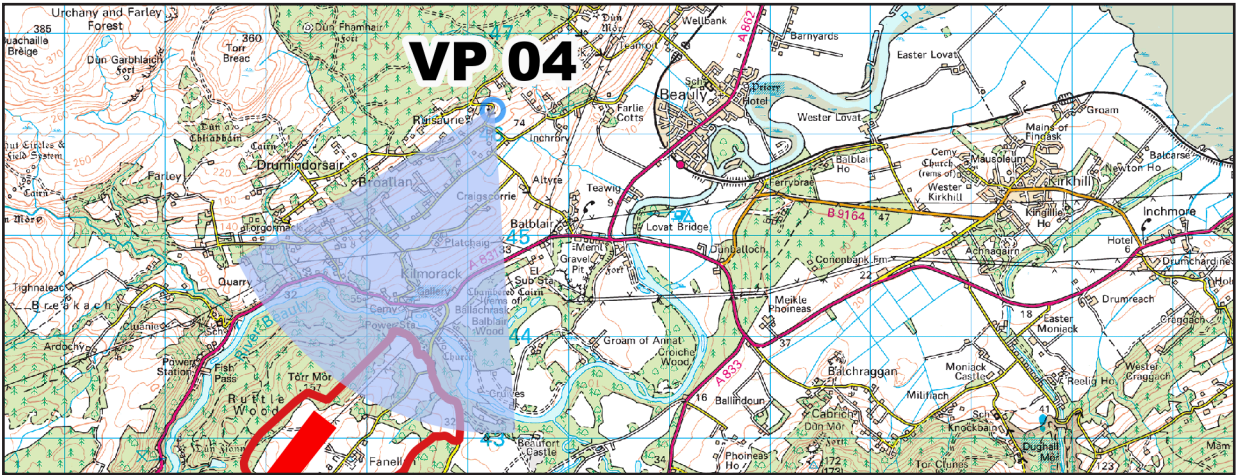

Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruilick, Ruisaurie and Drumindorsair to the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty. The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Alignment information correct as of 22.12.2024


**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15b**  
**Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024

Operational View (Baseline) - 65.5°



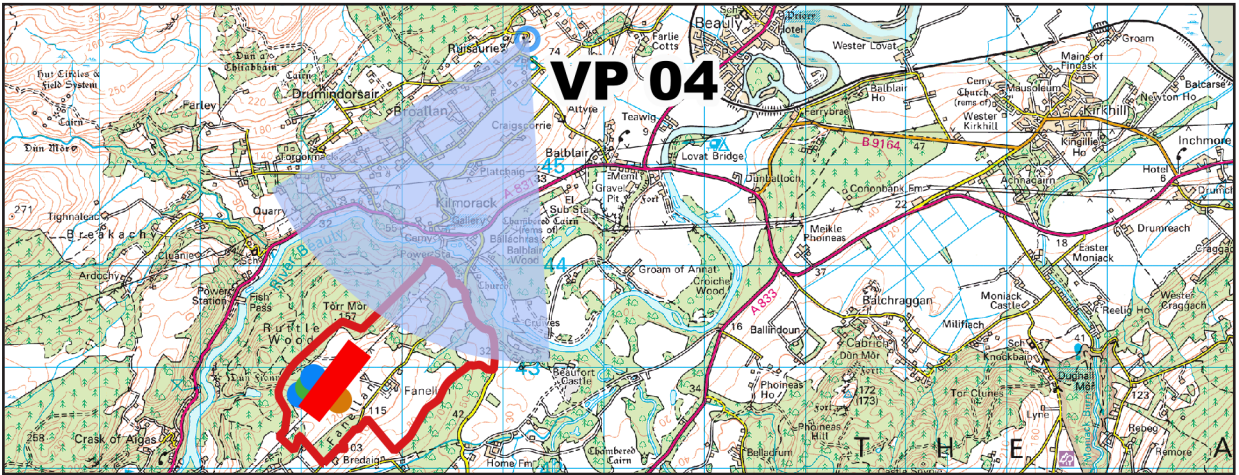

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15c**  
**Viewpoint 4: View looking south-west from Ruisaurie**

**Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers) - 65.5°**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





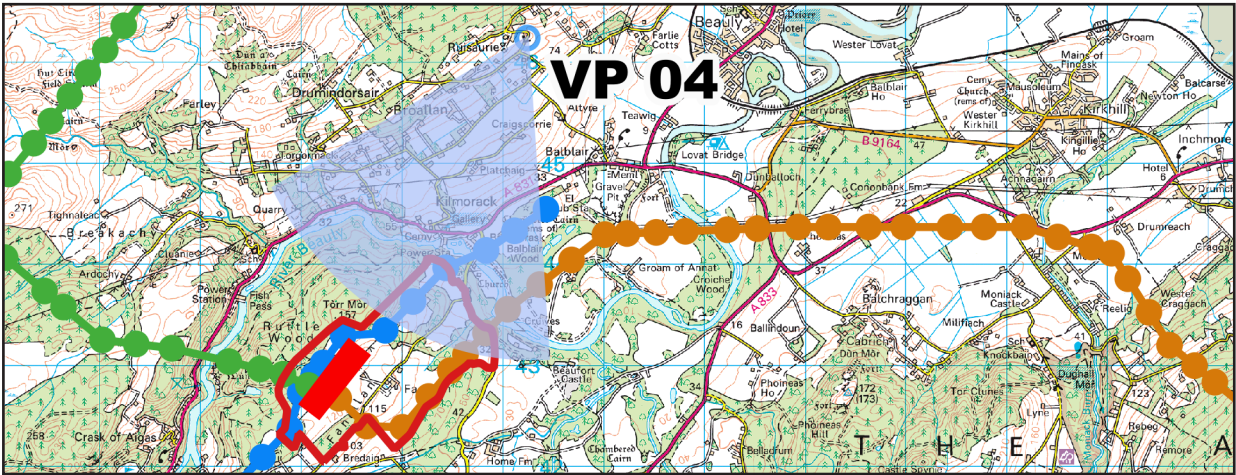

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15d**  
**Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

**Operational View (Photowire: SSEN Cumulative Overhead**  
**Line Schemes Only) - 65.5°**

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





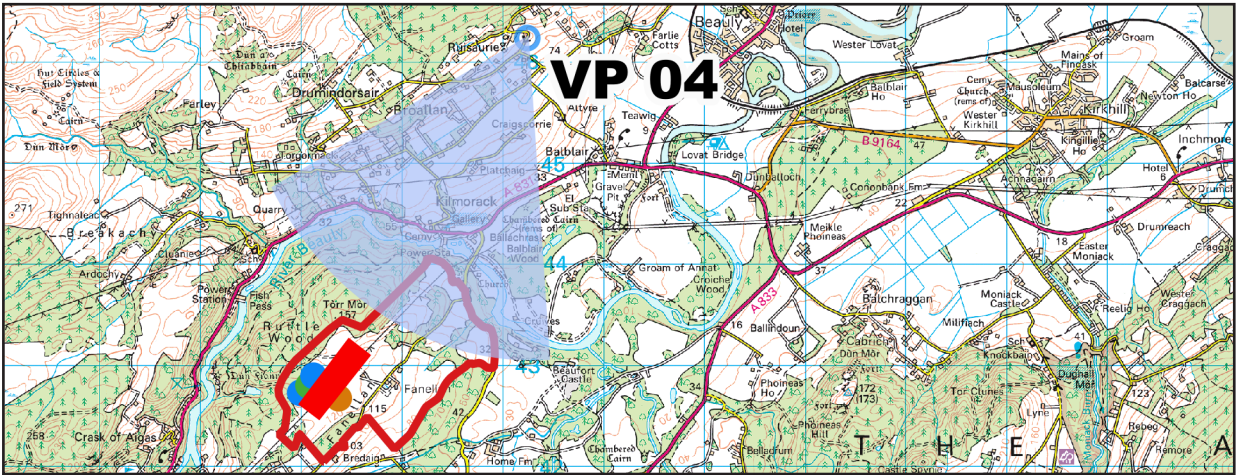

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15e**  
**Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

**Operational View (Photomontage: Fanellan 400kV  
Substation & Converter Station & SSSEN Cumulative  
Terminal Towers - Year 0) - 65.5°**

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





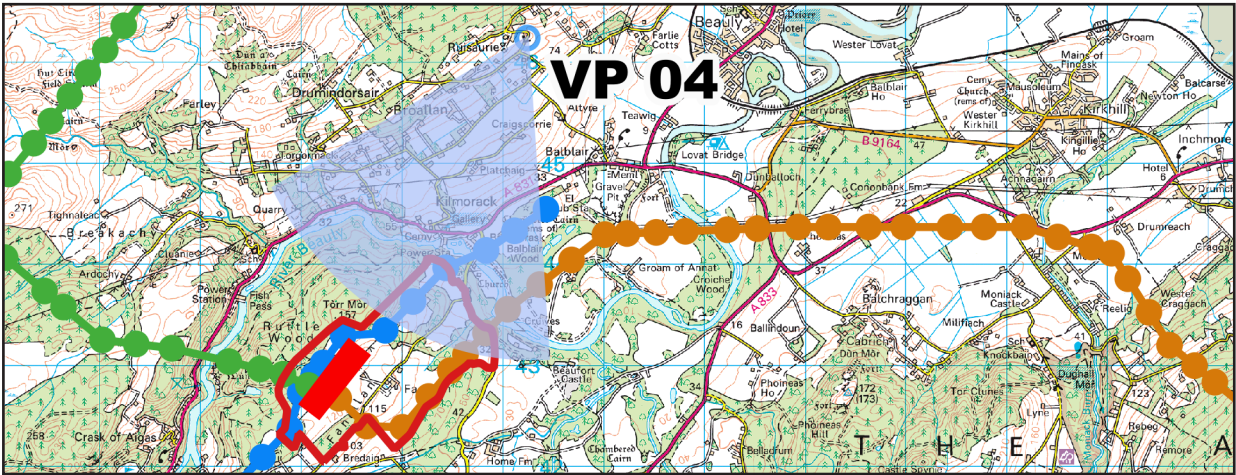

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15f**  
**Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

**Operational View (Photomontage: SSEN Cumulative  
Overhead Line Schemes Only - Year 0) - 65.5°**

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





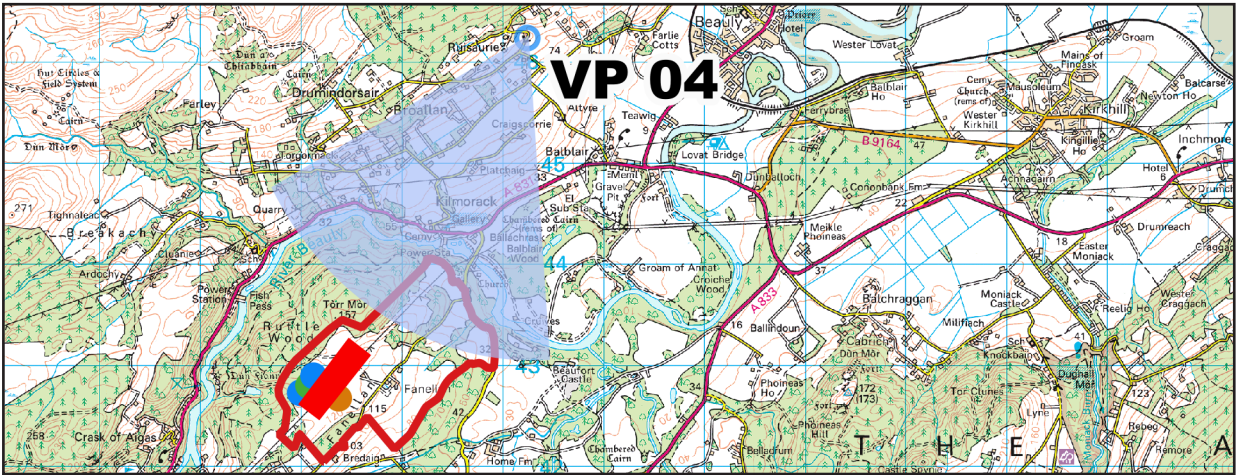

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15g**  
**Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

**Operational View (Photomontage: Fanellan 400kV  
Substation & Converter Station & SSN Cumulative  
Terminal Towers - Year 15) - 65.5°**

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024





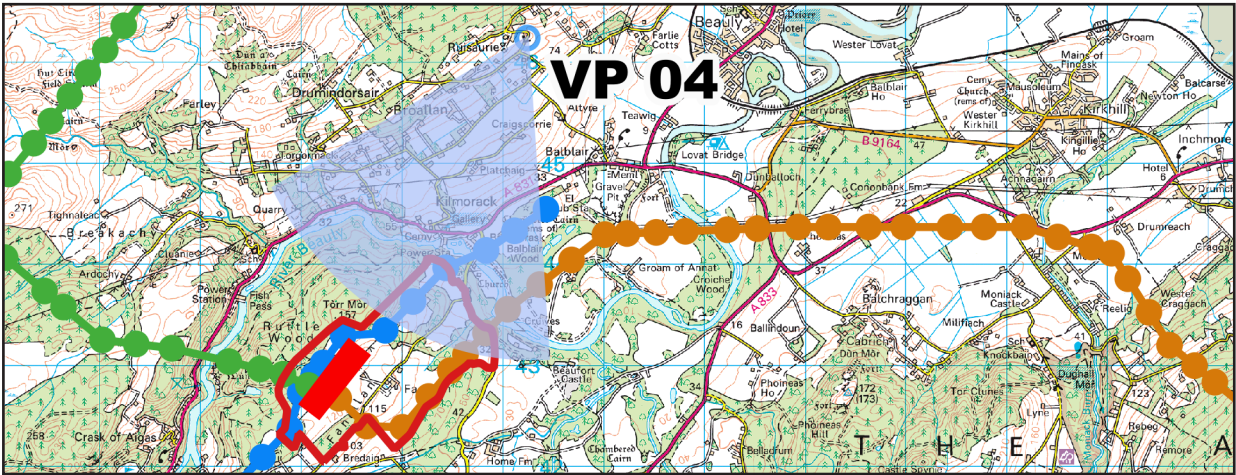

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.15h**  
**Viewpoint 4: View looking south-west from Ruisaurie**

**Operational View (Photomontage: SSEN Cumulative**  
**Overhead Line Schemes Only - Year 15) - 65.5°**

Viewpoint Location: X 250248, Y 846239  
AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
(South-West)

*Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruillick, Ruisaurie and Drumindorsair to the A831.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.*

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 05/03/2024







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-i Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-j Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)  
 - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-k Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-I Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
 Only - Year 0) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-m Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-n Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-o Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
Distance to Development and Direction of view: 3482m, 209°  
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-p Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)  
 - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-q Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-r Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
 Only - Year 0) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-s Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.15-t Viewpoint 4: View looking south-west from Ruisaurie**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes  
 Only - Year 15) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m  
 Distance to Development and Direction of view: 3482m, 209°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

