


Mapped Location

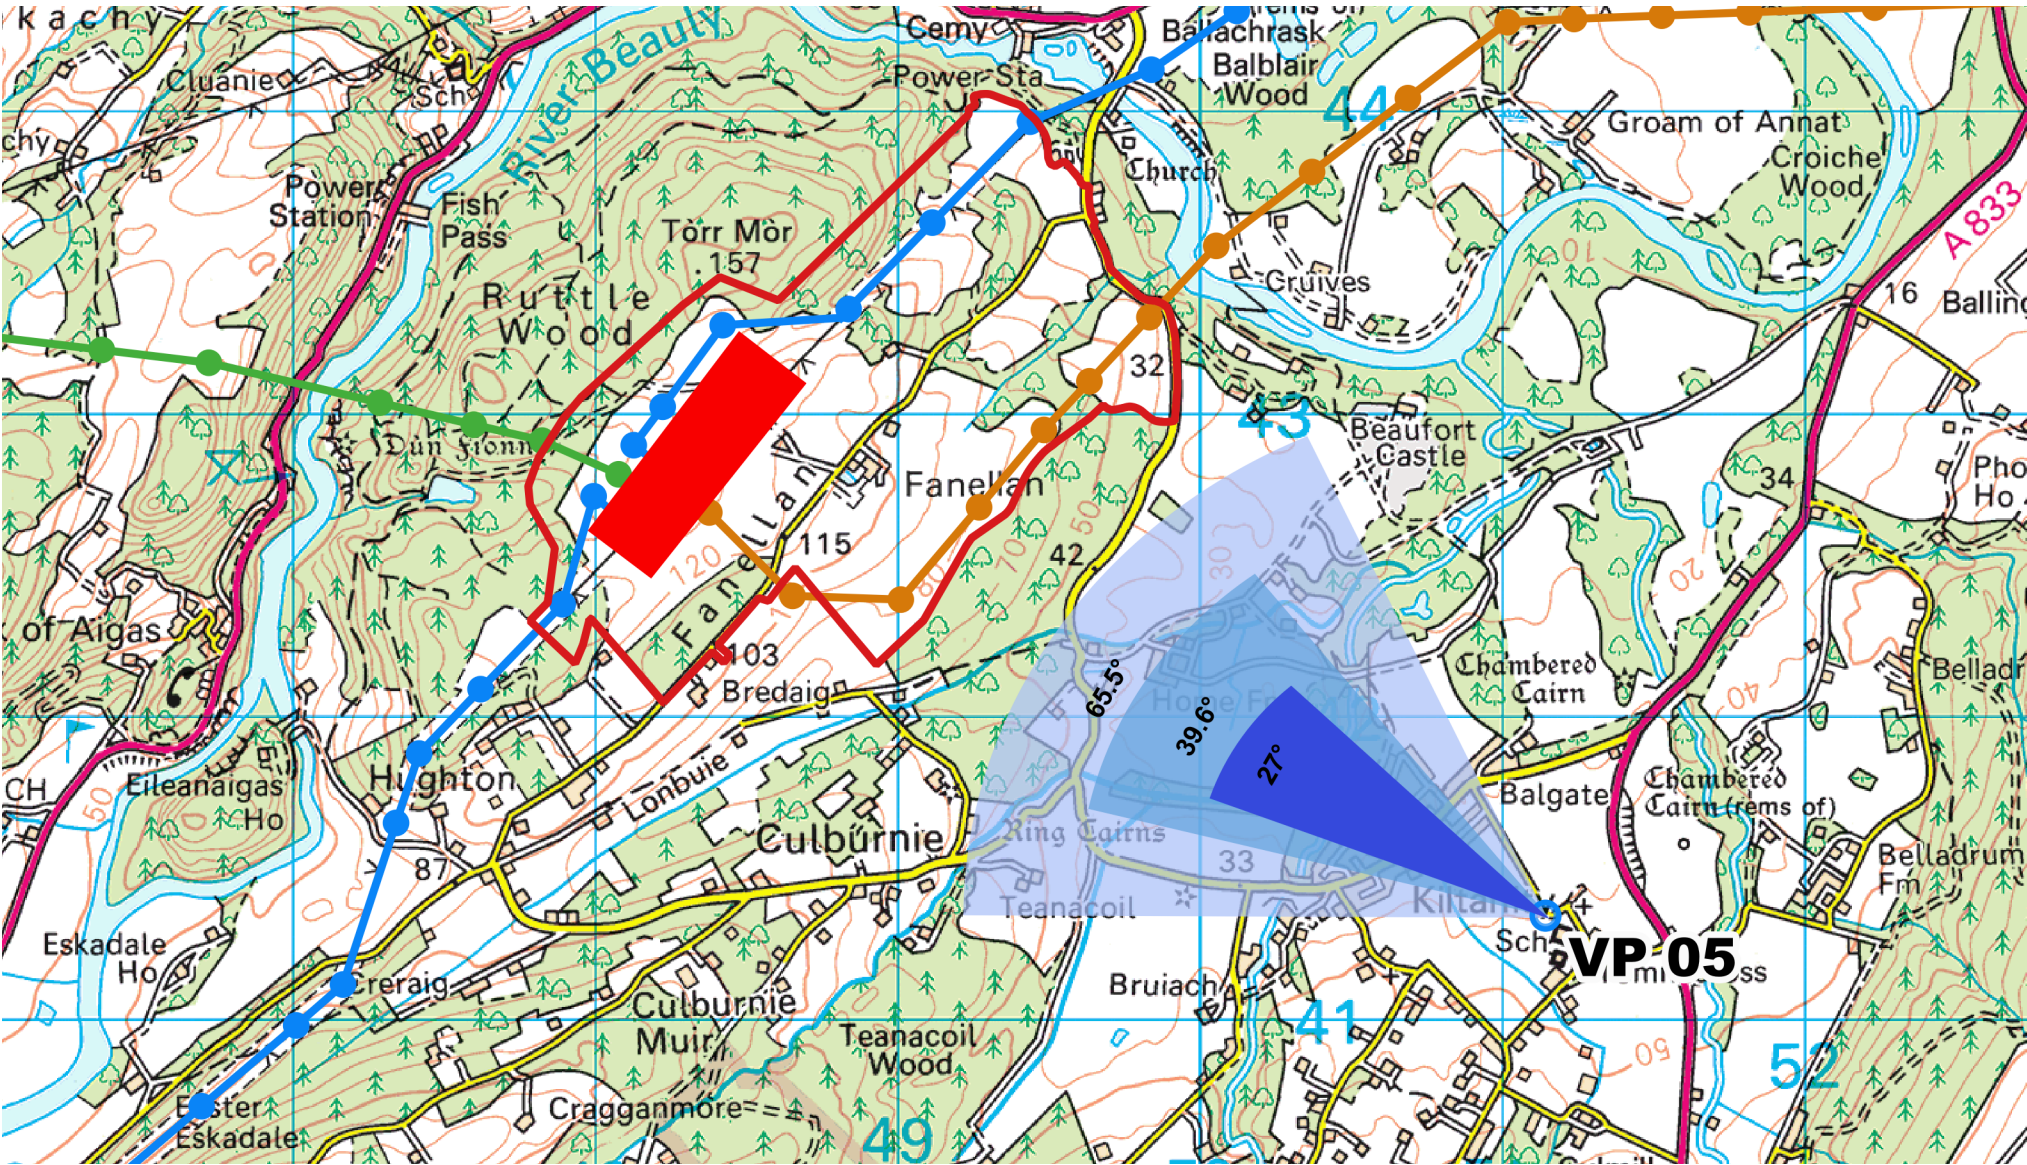

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16a
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarlity)

Location Description:
The viewpoint is on an unnamed road in Kiltarlity, Beauly. The viewpoint is next to Tomnacross Primary School and Kiltarlity Church of Scotland. Parking can be accessed here. The viewpoint is a short walk from the parking area and is on a quiet road.


Camera Location



Location Data

OSGB36 Location:	251143 841342
AOD:	43m
Camera Height:	1.5m
Distance to Development:	3036m



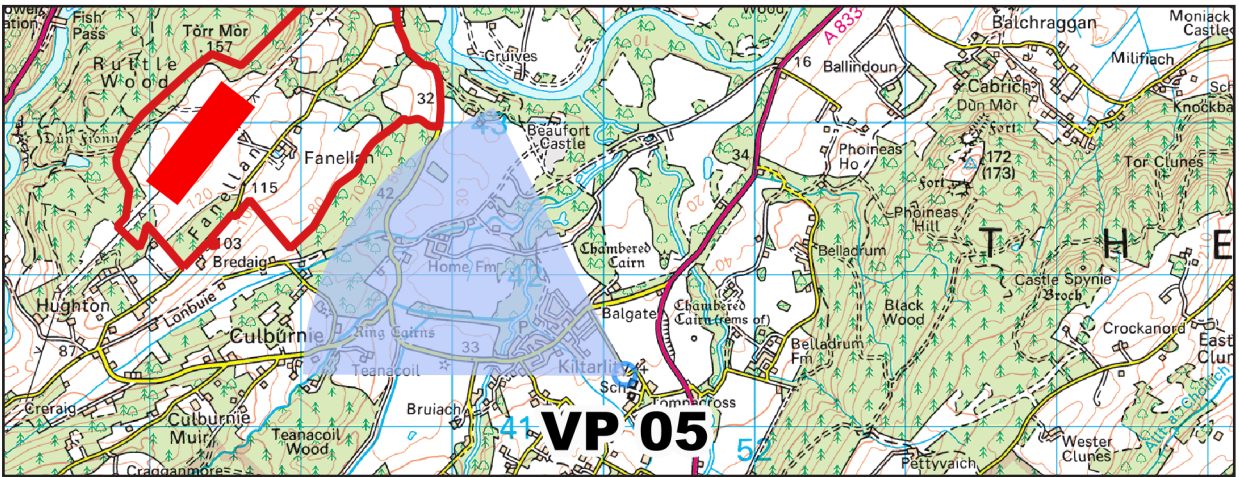

Receptor list: Residents at Tomnacross and Kiltarity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16b
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Baseline) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



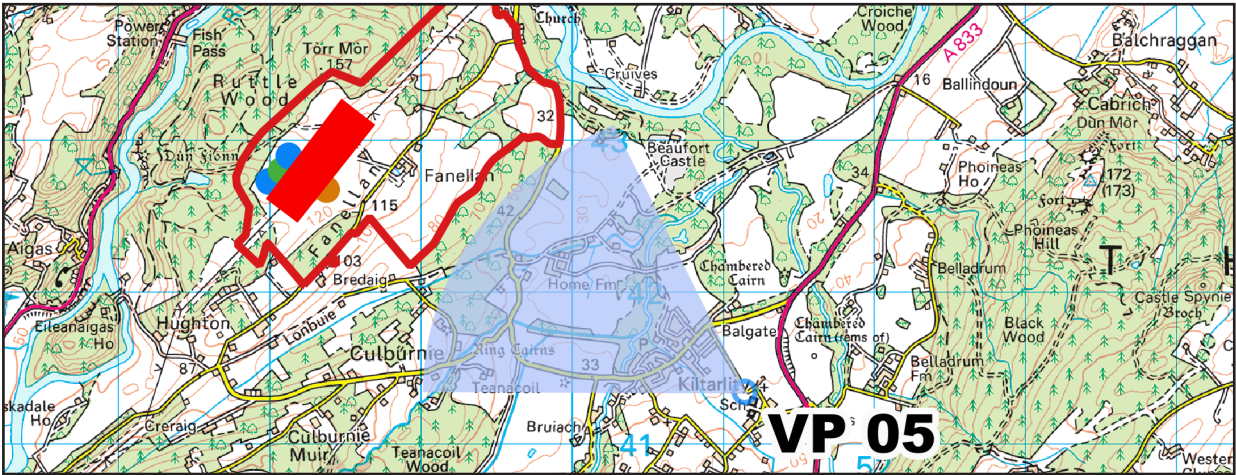

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16c
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarlity)
Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)



Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Tomnacross and Kiltarlity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.
This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



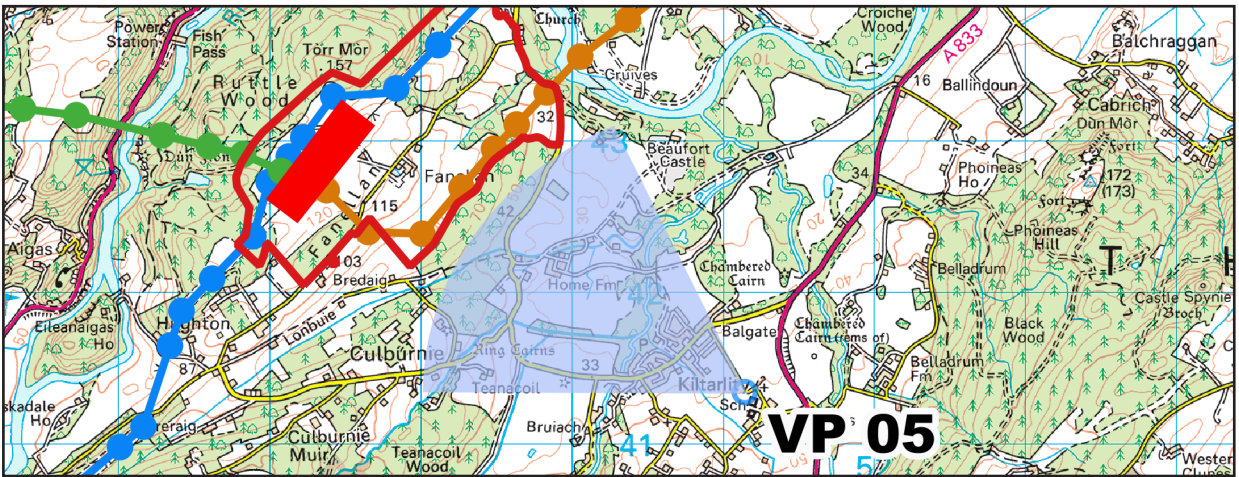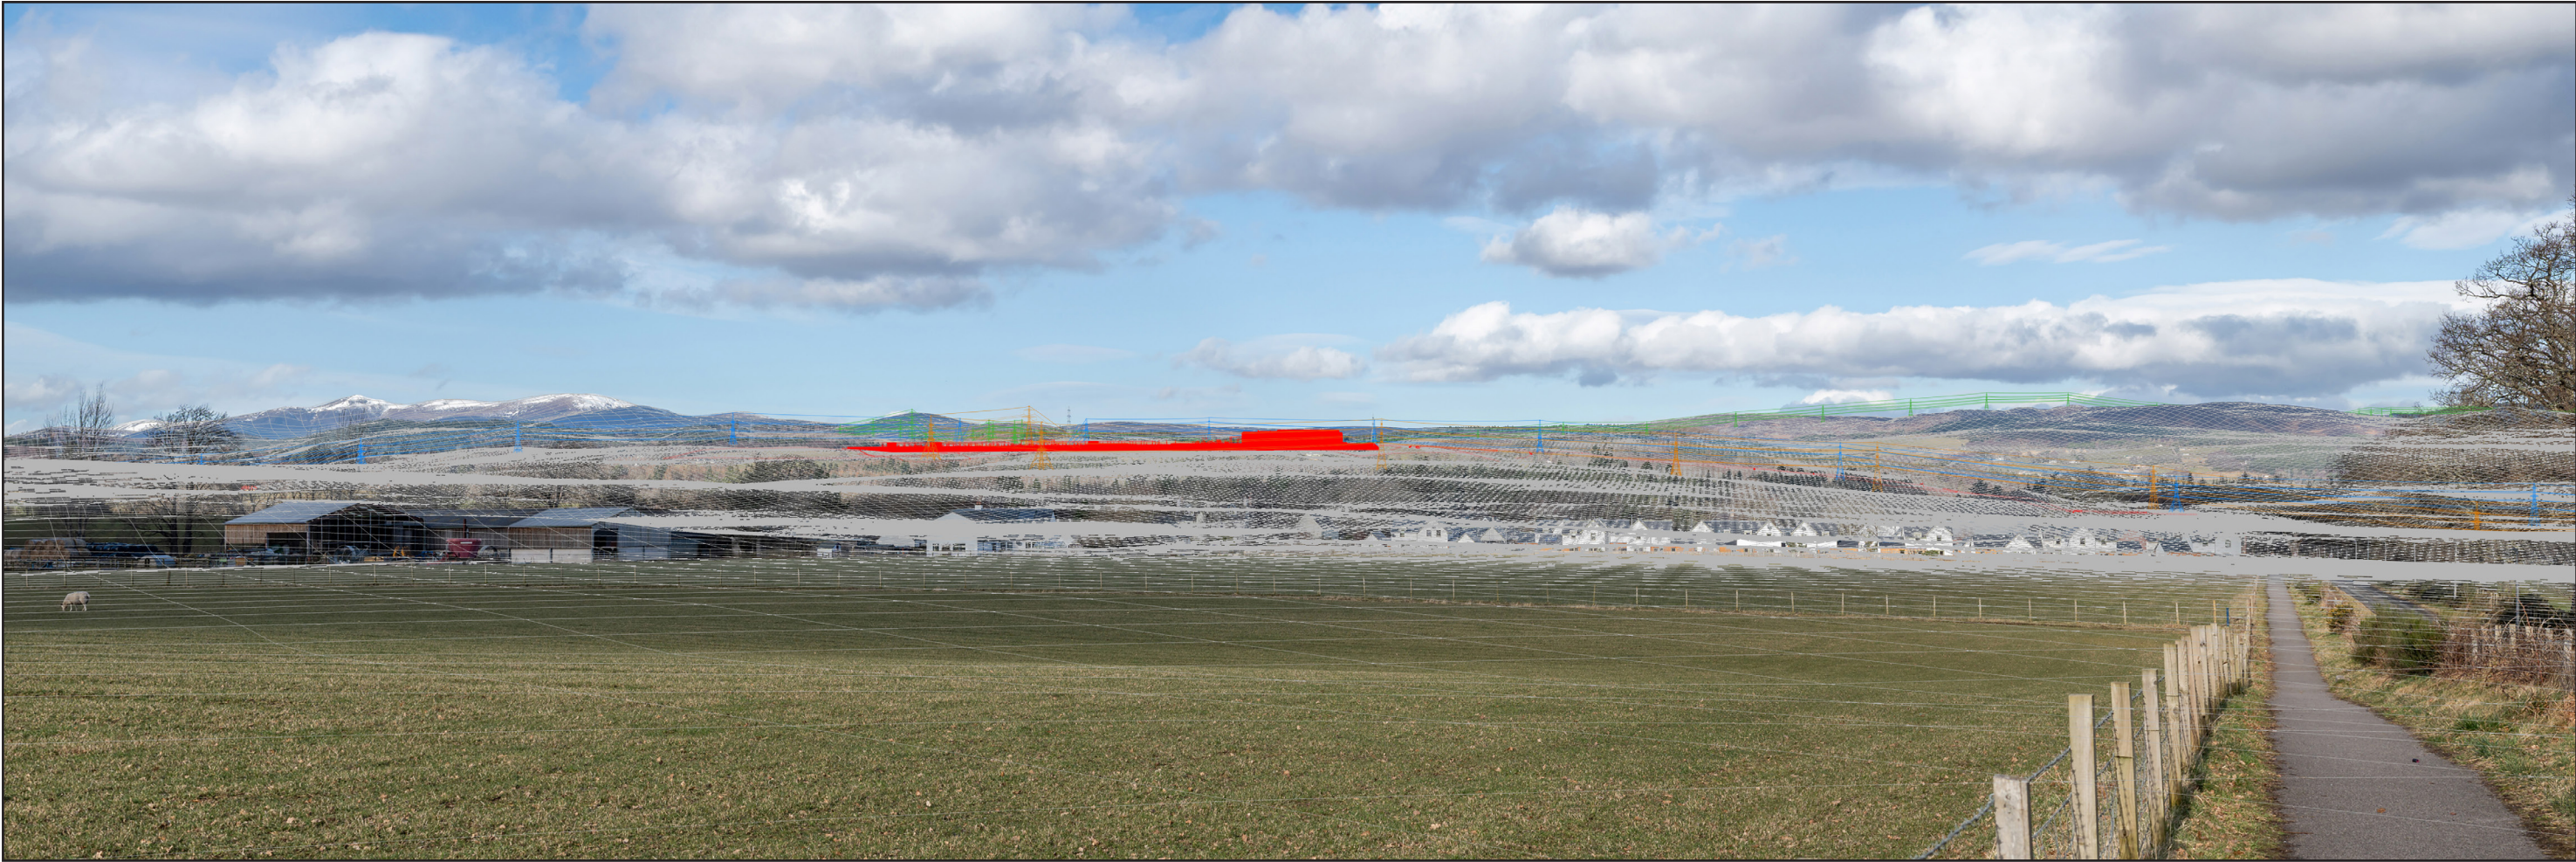

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16d
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarlity)
Operational View (Photowire: SSEN Cumulative Overhead
Line Schemes Only) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Receptor list: Residents at Tomnacross and Kiltarlity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



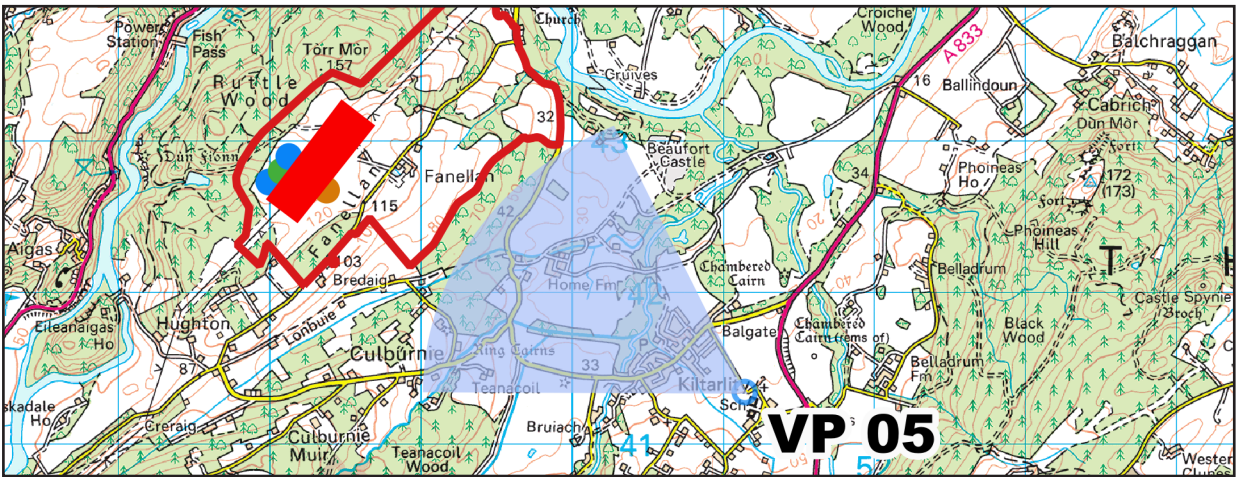

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16e
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarlity)
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Receptor list: Residents at Tomnacross and Kiltarlity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



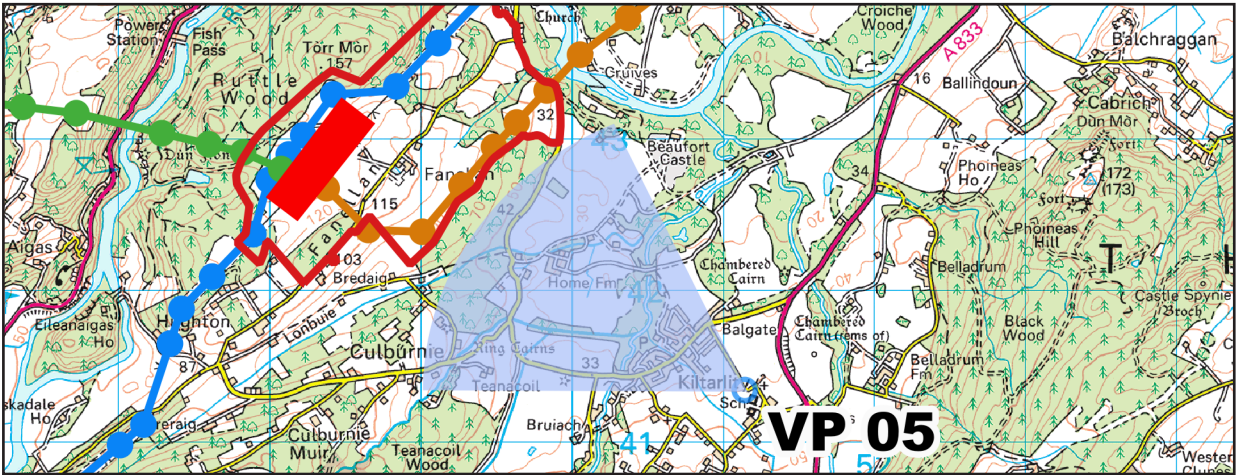

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16f
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°


Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Receptor list: Residents at Tomnacross and Kiltarity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.
This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

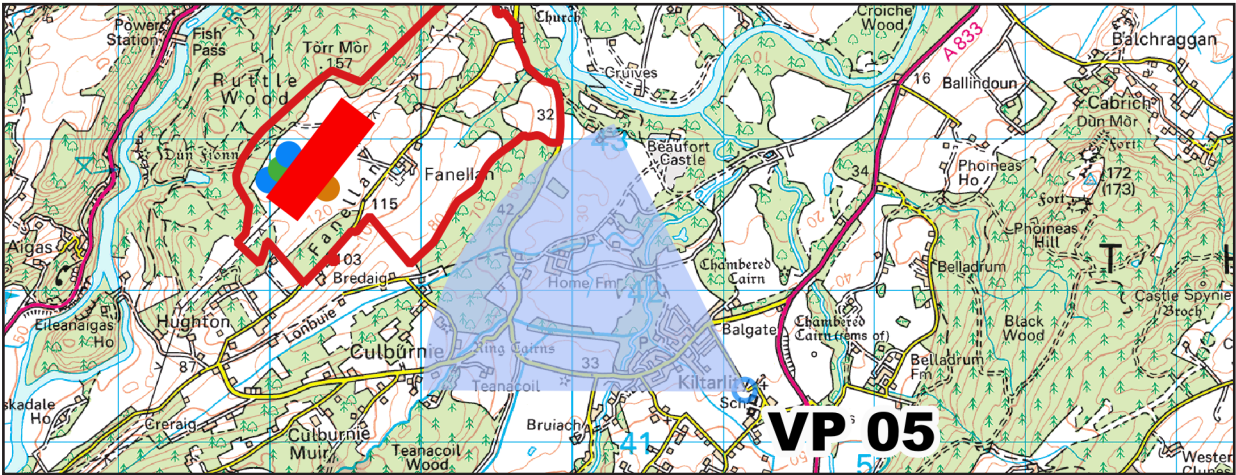

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16g
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarlity)
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Tomnacross and Kiltarlity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.
This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



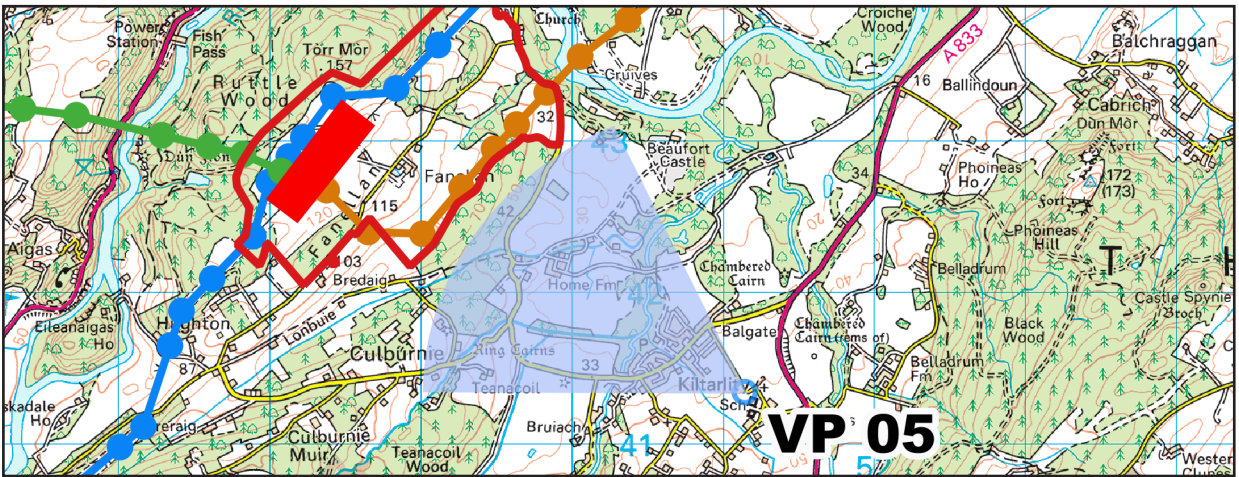

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.16h
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Tomnacross and Kiltarity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.
This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-i Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
 Operational View (Photowire: Fanellan 400kV Substation & Converter Station &
 SSEN Cumulative Terminal Towers) - 50mm


Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION

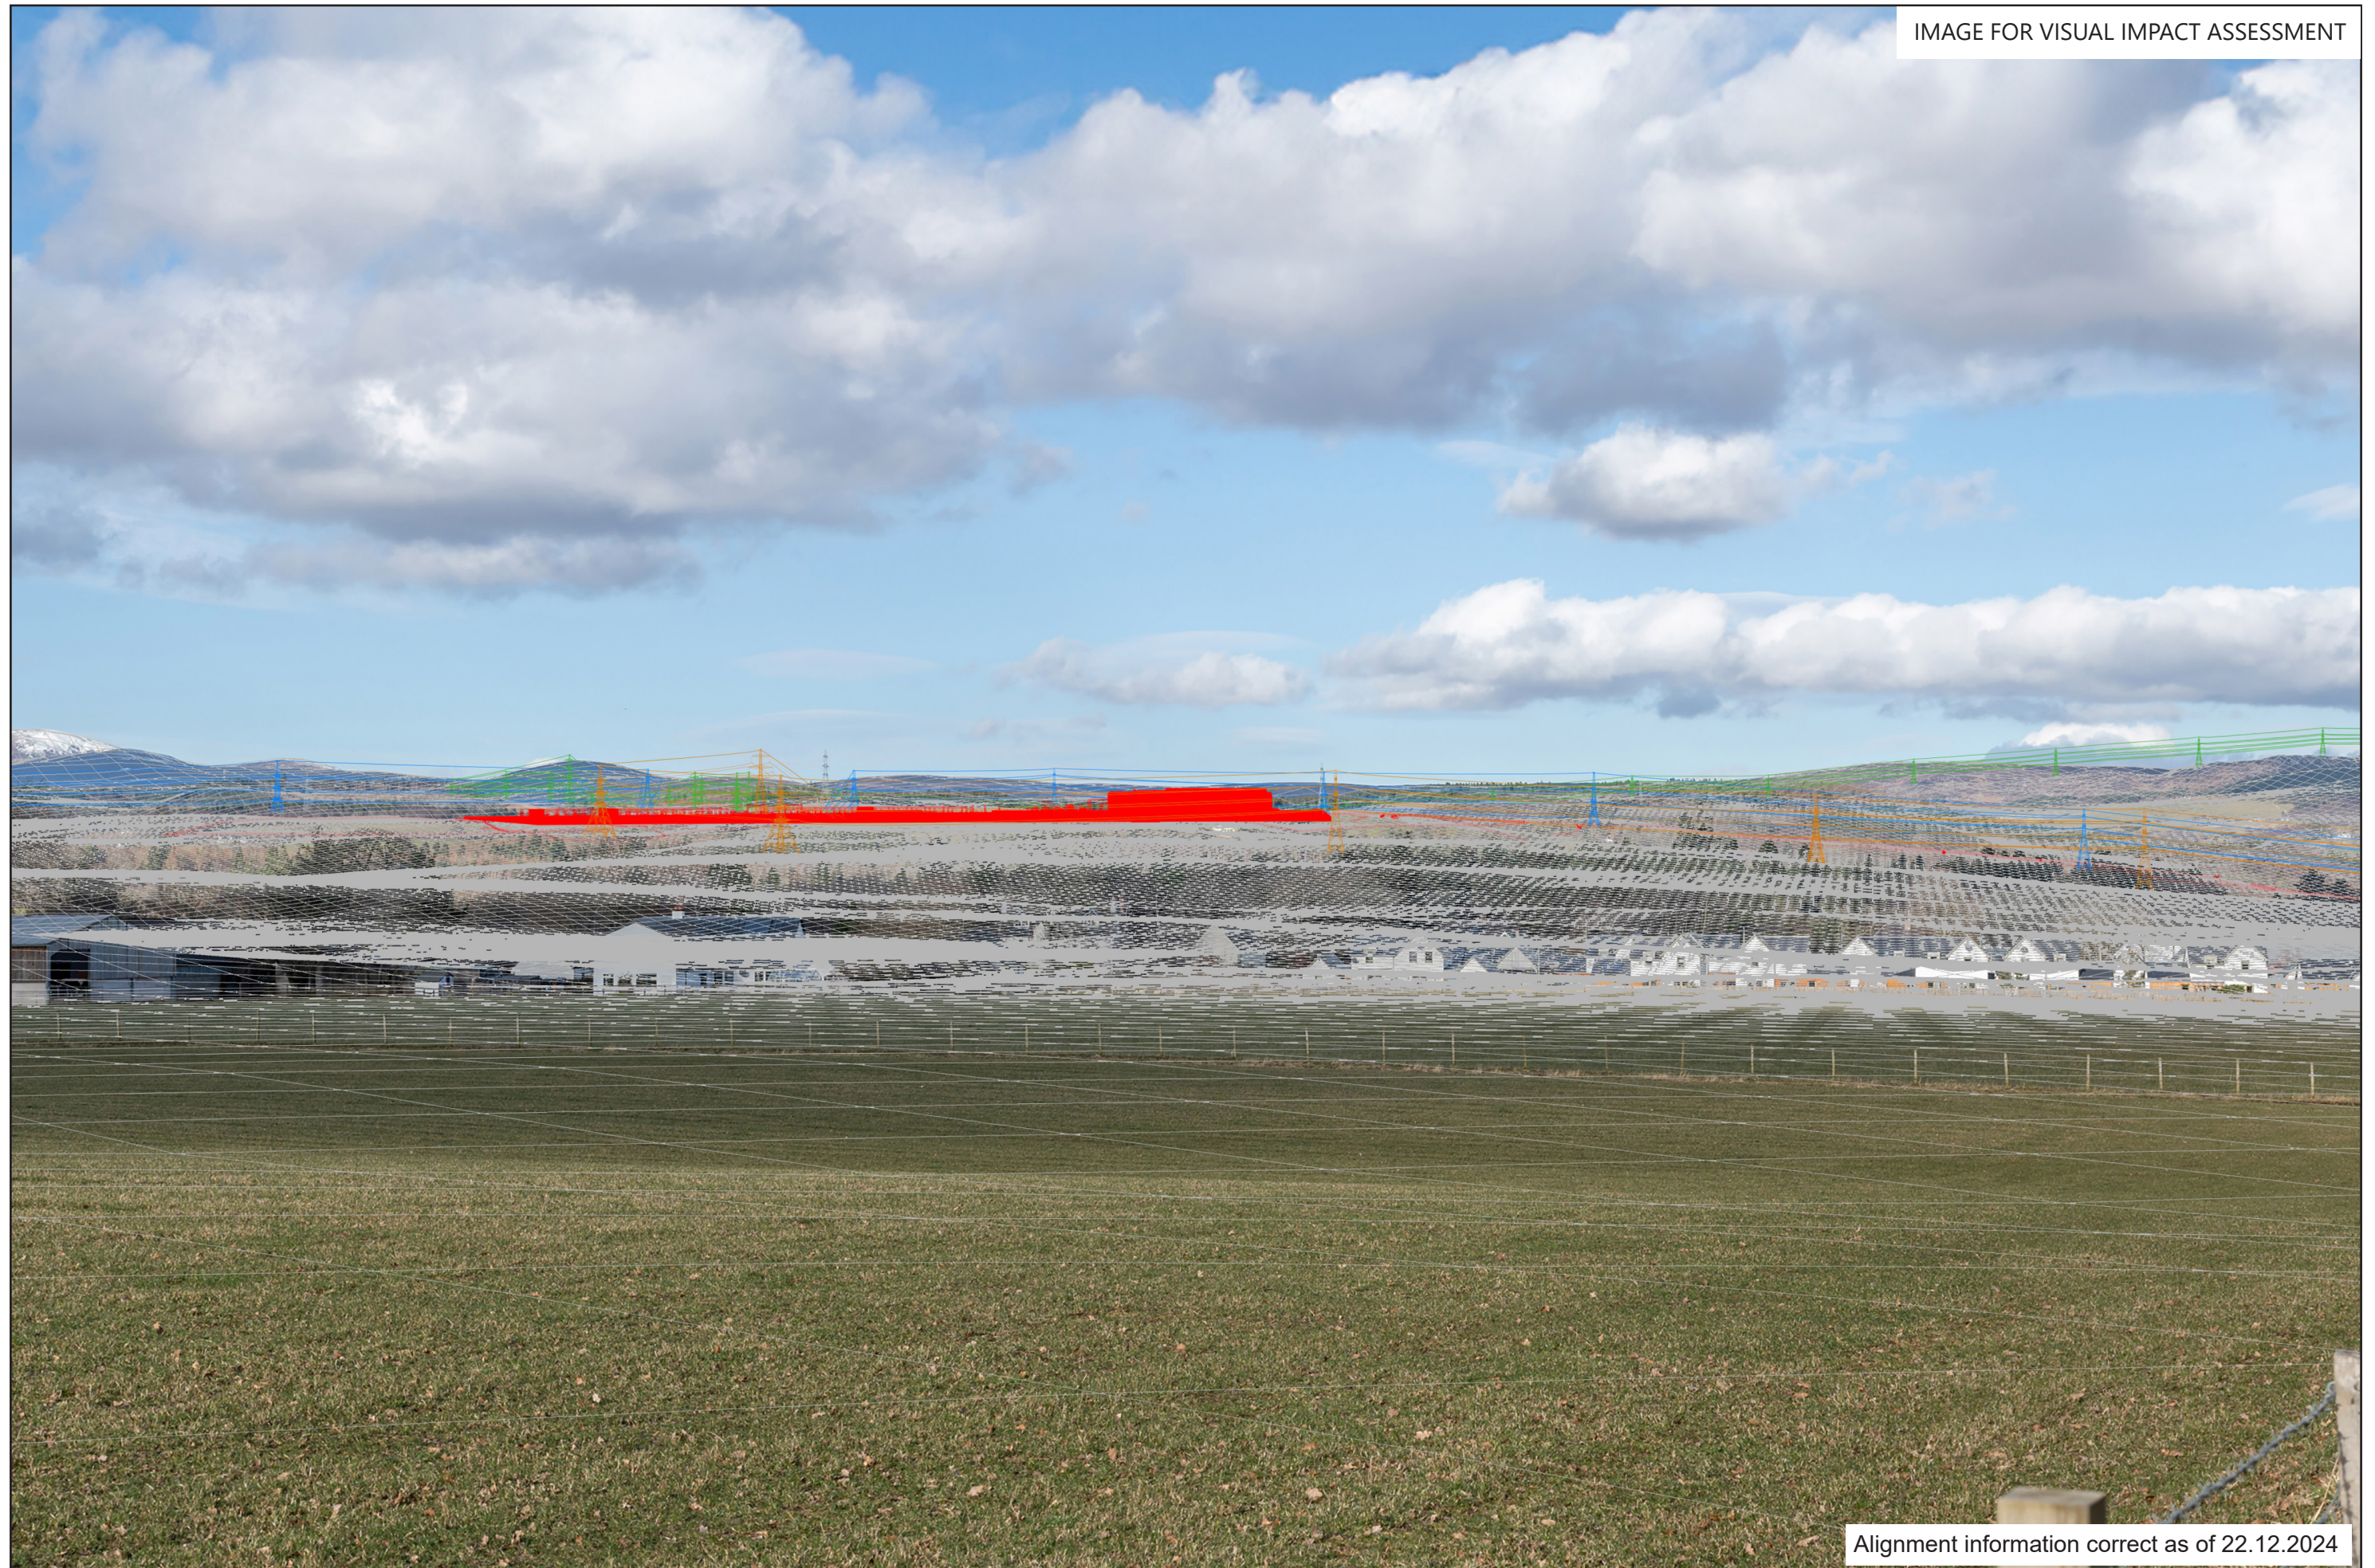

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-j Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024
The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-k Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter
Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-I Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-m Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-n Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only -
Year 15) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-o Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-p Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-q Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-r Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-s Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.16-t Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
 Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 15) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

