


Mapped Location

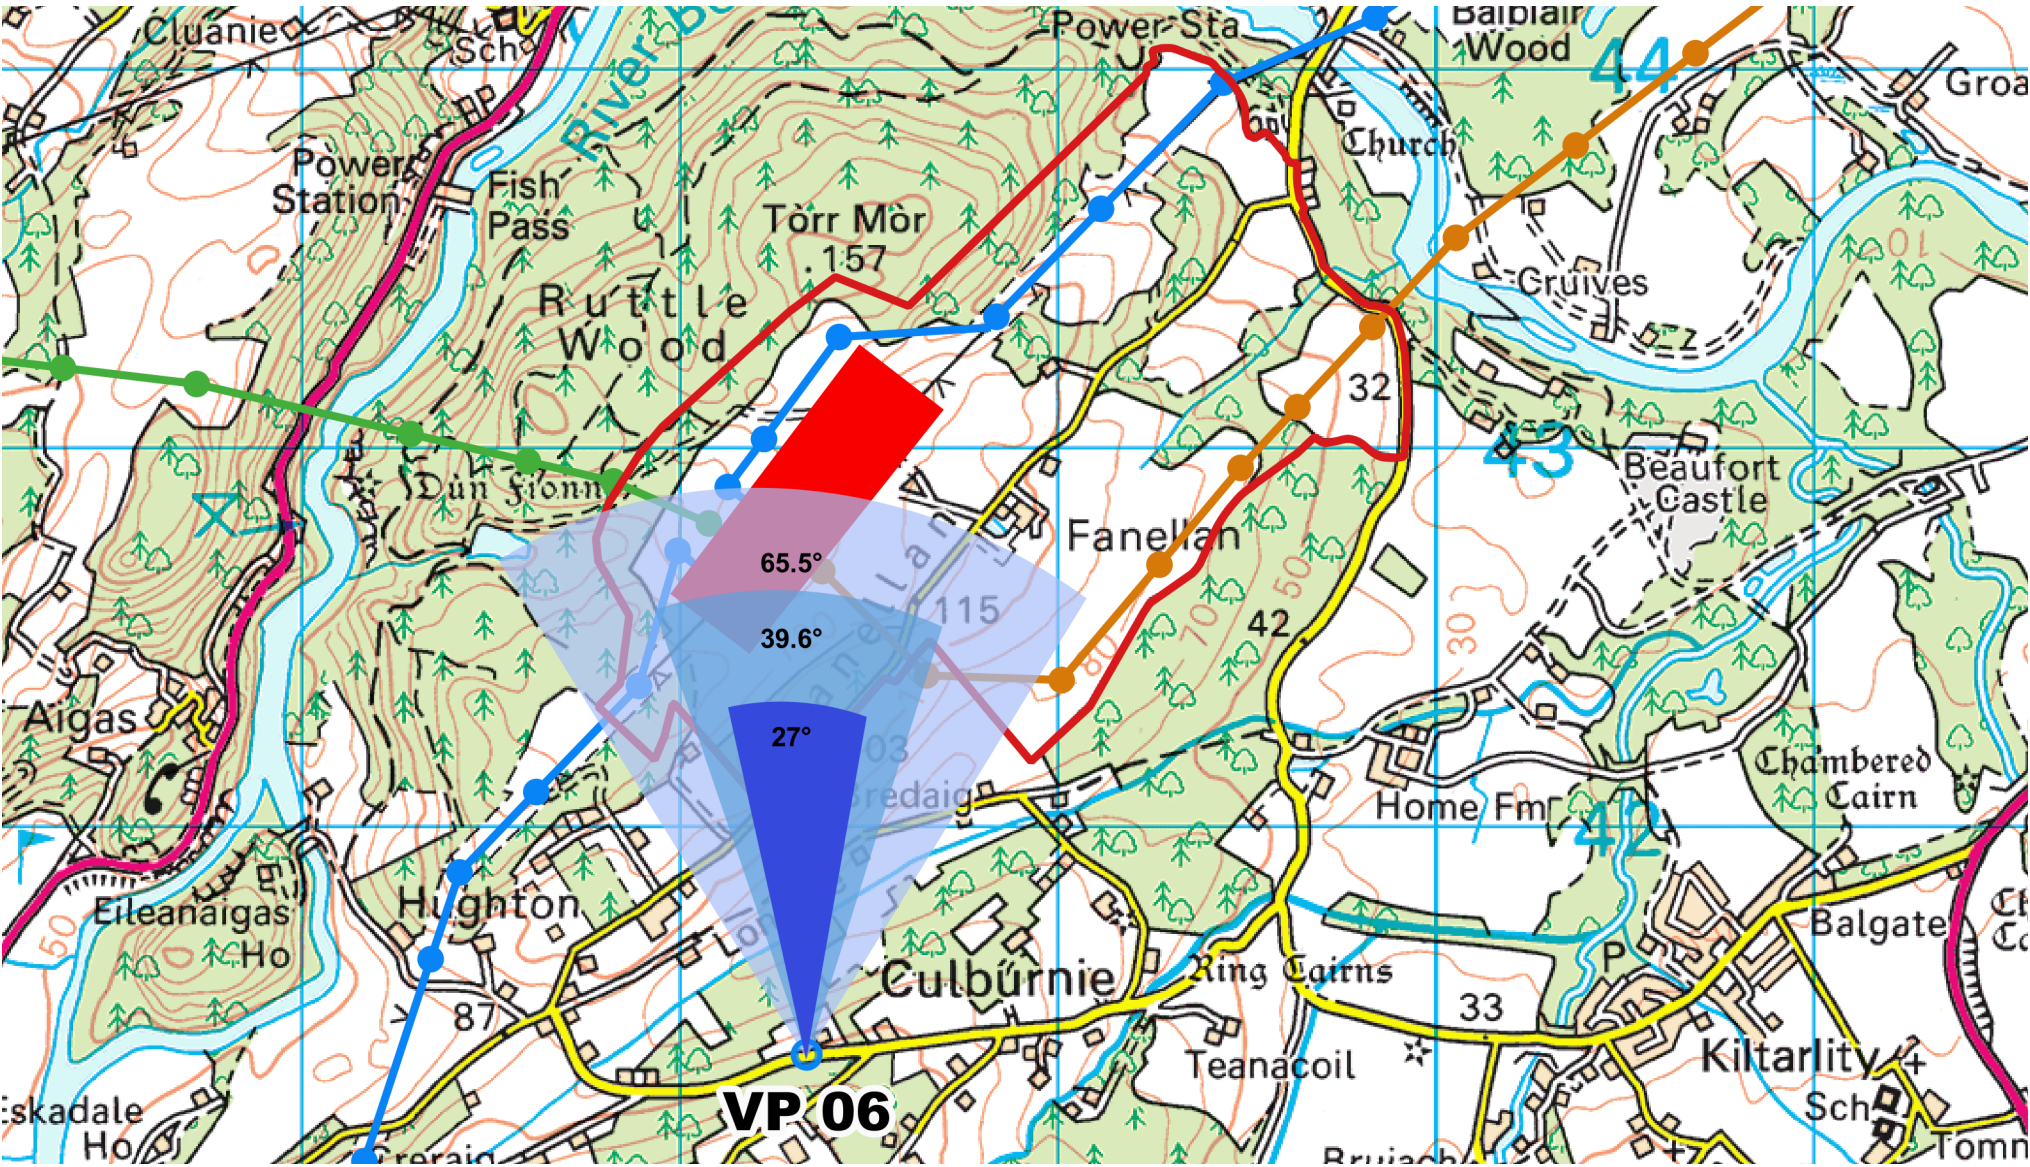

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17a
Viewpoint 6: View looking north from the western edge of Culburnie


Location Description:
The viewpoint is on an unnamed road linking the areas of Hughton and Culburnie. The viewpoint is from the northern side of the road. Parking in a layby is available nearby and the viewpoint can be accessed via foot on the quiet road.

Camera Location



Location Data

| | |
|--------------------------|---------------|
| OSGB36 Location: | 248336 841396 |
| AOD: | 106m |
| Camera Height: | 1.5m |
| Distance to Development: | 1073m |

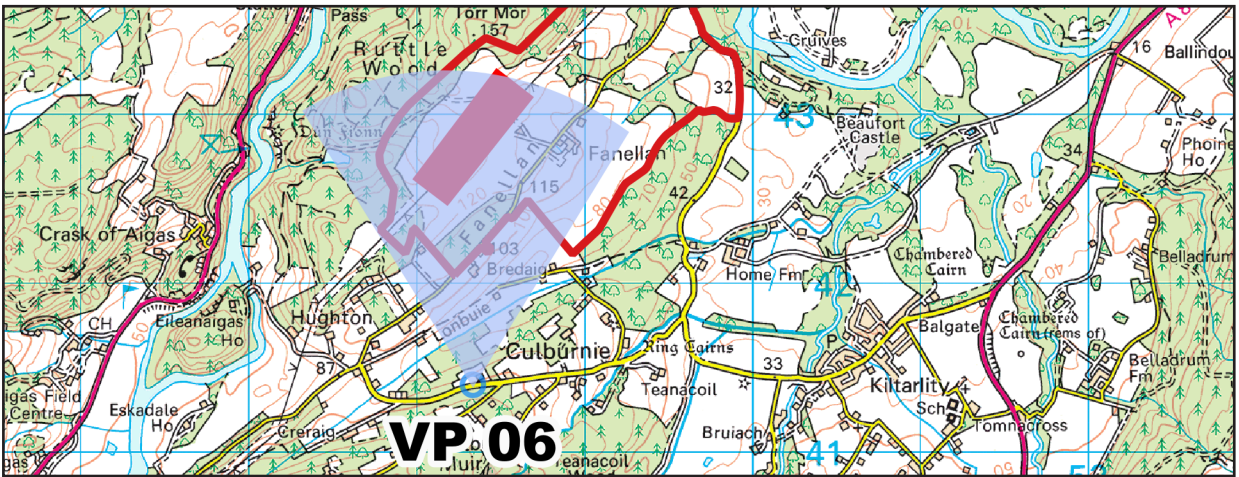

Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17b
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Baseline) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



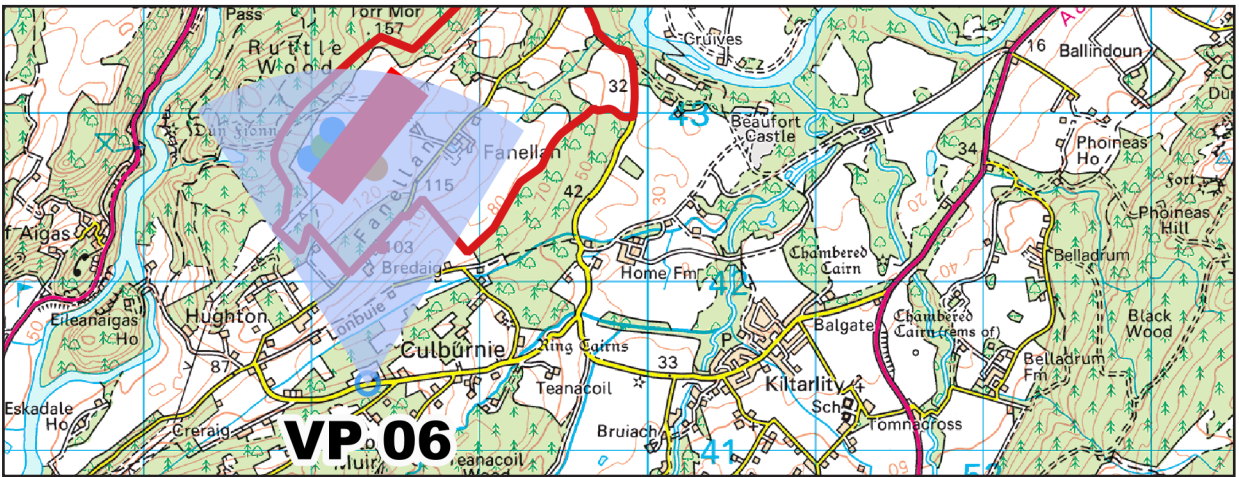

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17c
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024


Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



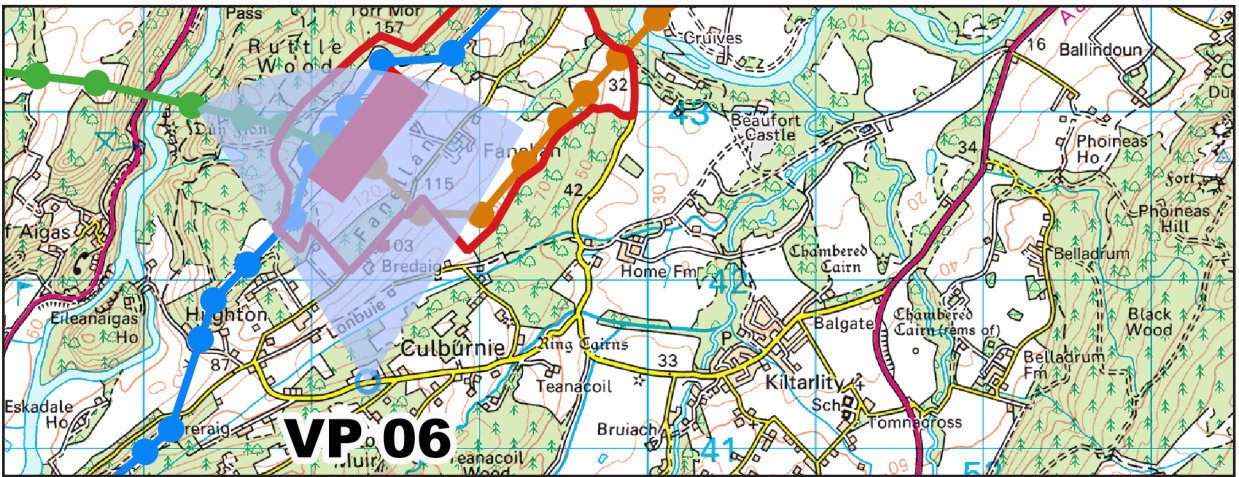

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17d
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photowire: SSEN Cumulative Overhead
Line Schemes Only) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

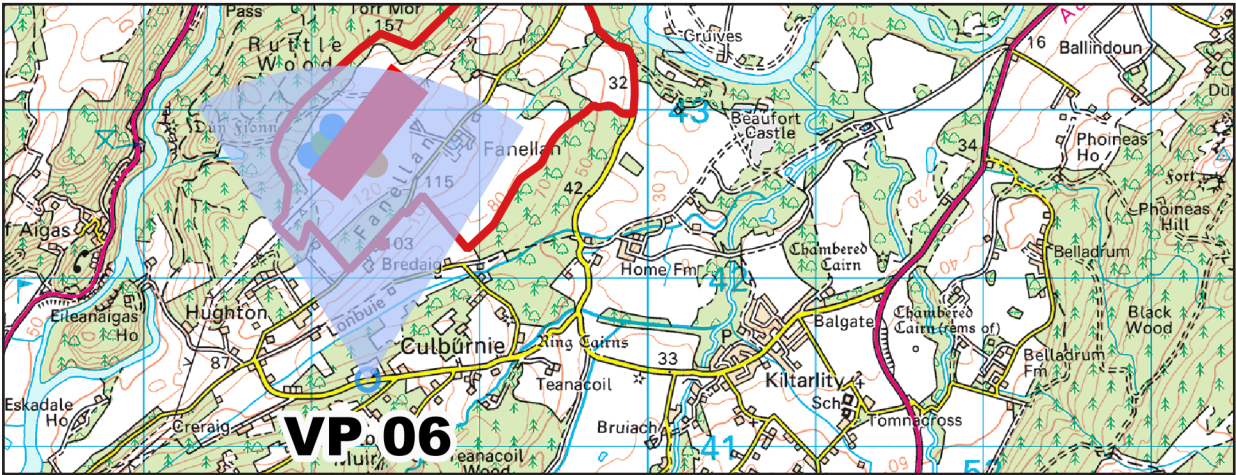

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17e
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

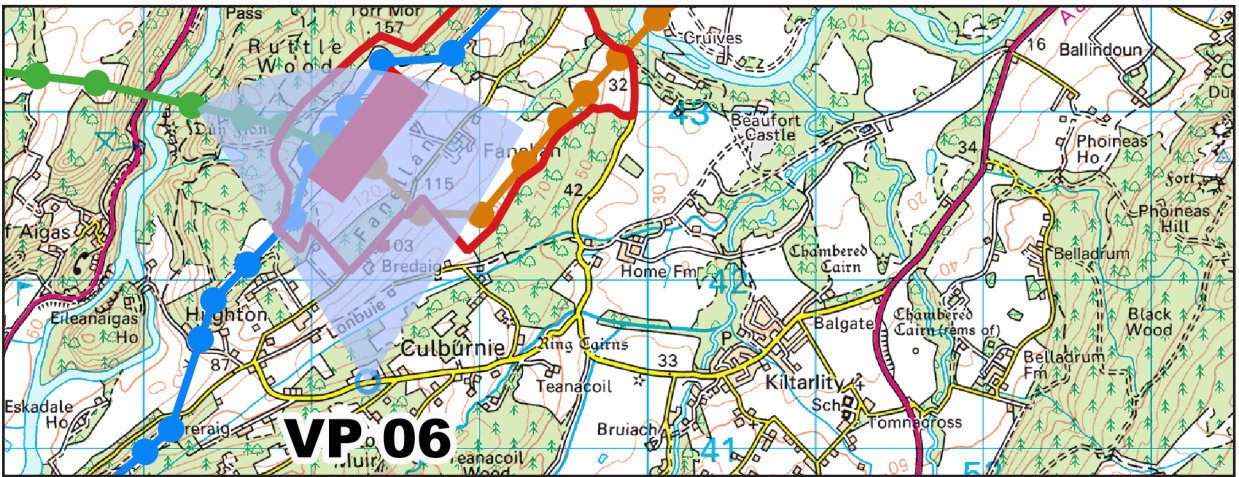

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17f
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024


Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



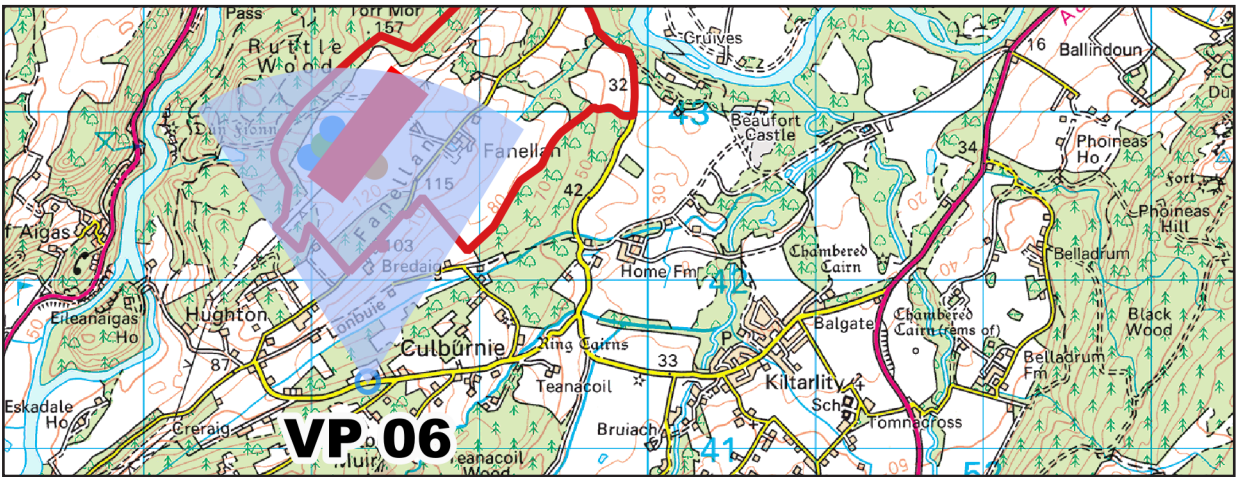

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17g
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

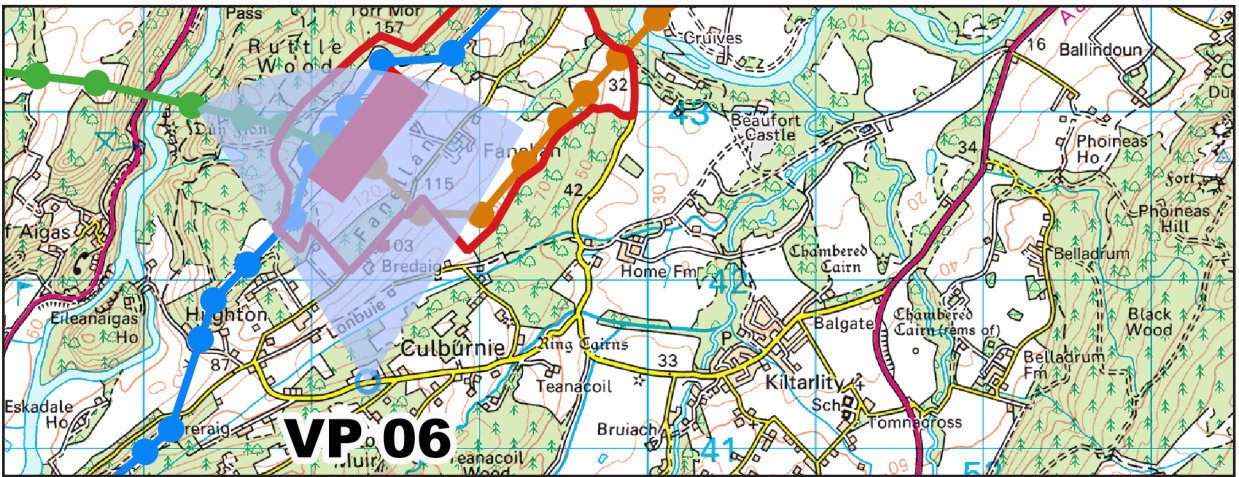

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.17h
Viewpoint 6: View looking north from the western edge of
Culburnie
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 248336, Y 841396
AOD: 106m
Distance to Development and Direction of view: 1073m, 1° (North)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Culburnie. Road users of the existing route between Culburnie and Fanellan.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-i Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
 Distance to Development and Direction of view: 1073m, 1°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-j Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm


Viewpoint Location: X 248336, Y 841396 AOD: 106m
 Distance to Development and Direction of view: 1073m, 1°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

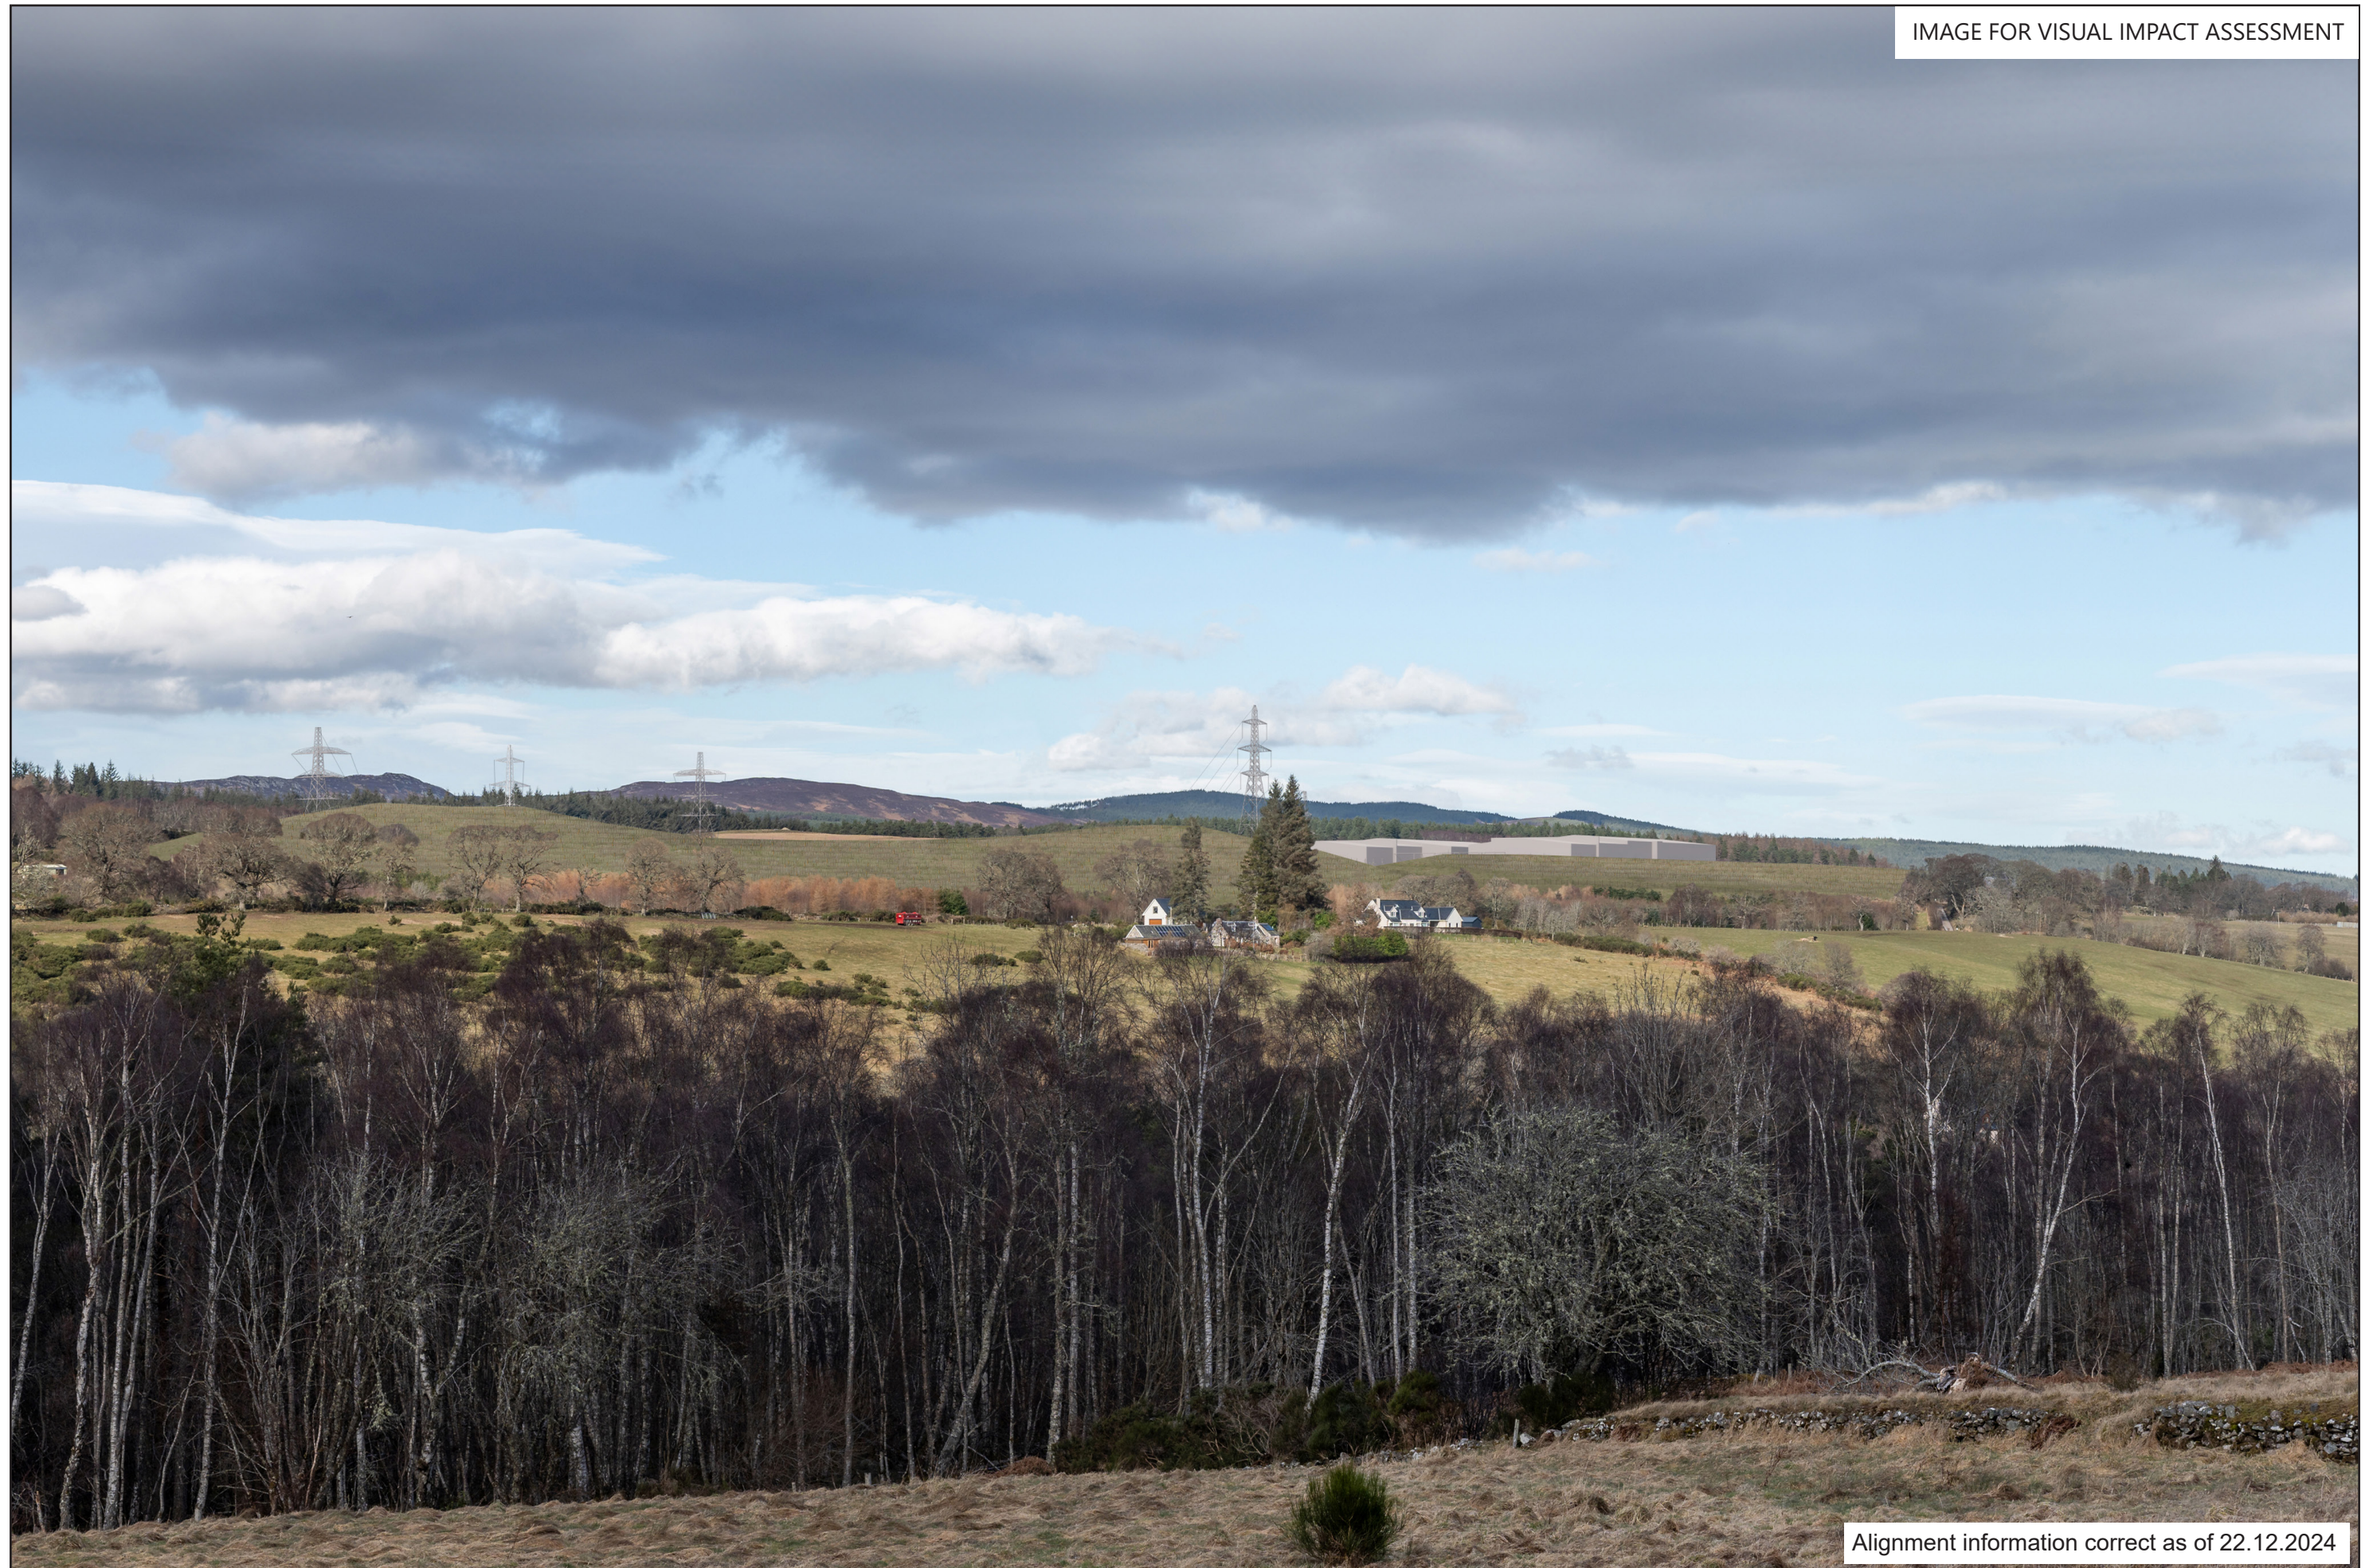

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-k Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm


Viewpoint Location: X 248336, Y 841396 AOD: 106m
 Distance to Development and Direction of view: 1073m, 1°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

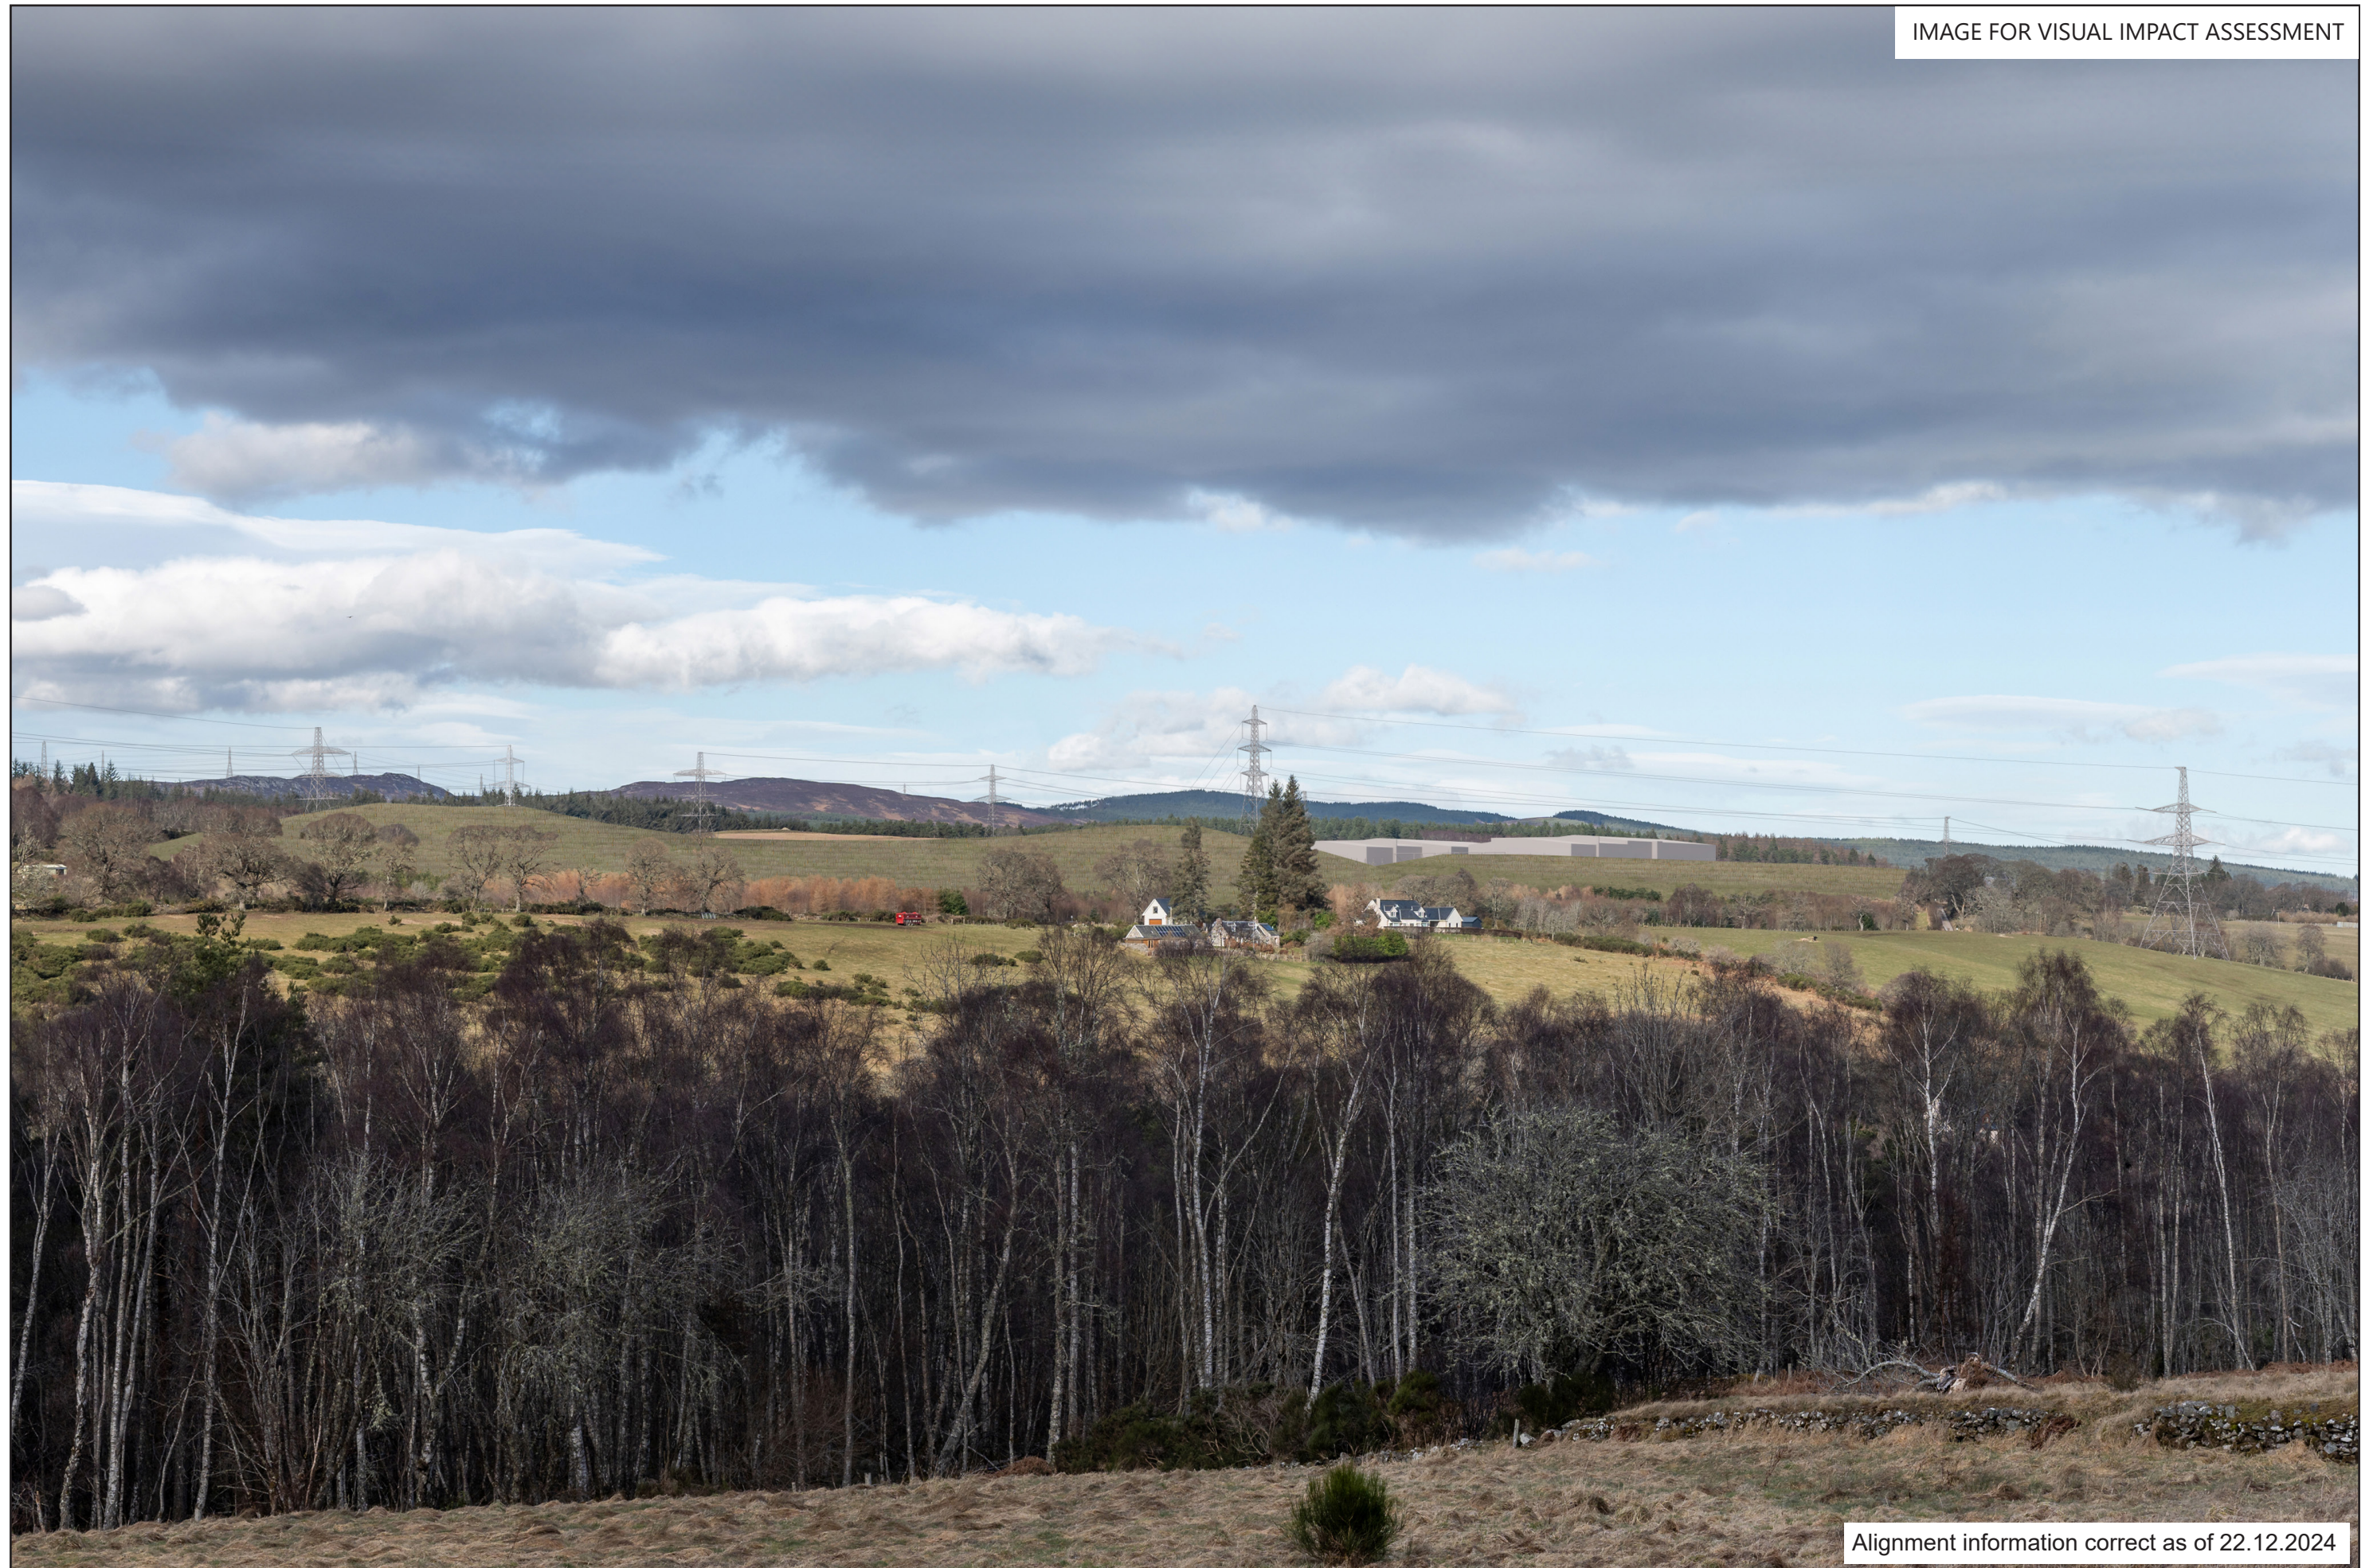

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-I Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 50mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
 Distance to Development and Direction of view: 1073m, 1°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-m Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
 Distance to Development and Direction of view: 1073m, 1°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-n Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-o Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-p Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 75mm


Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION

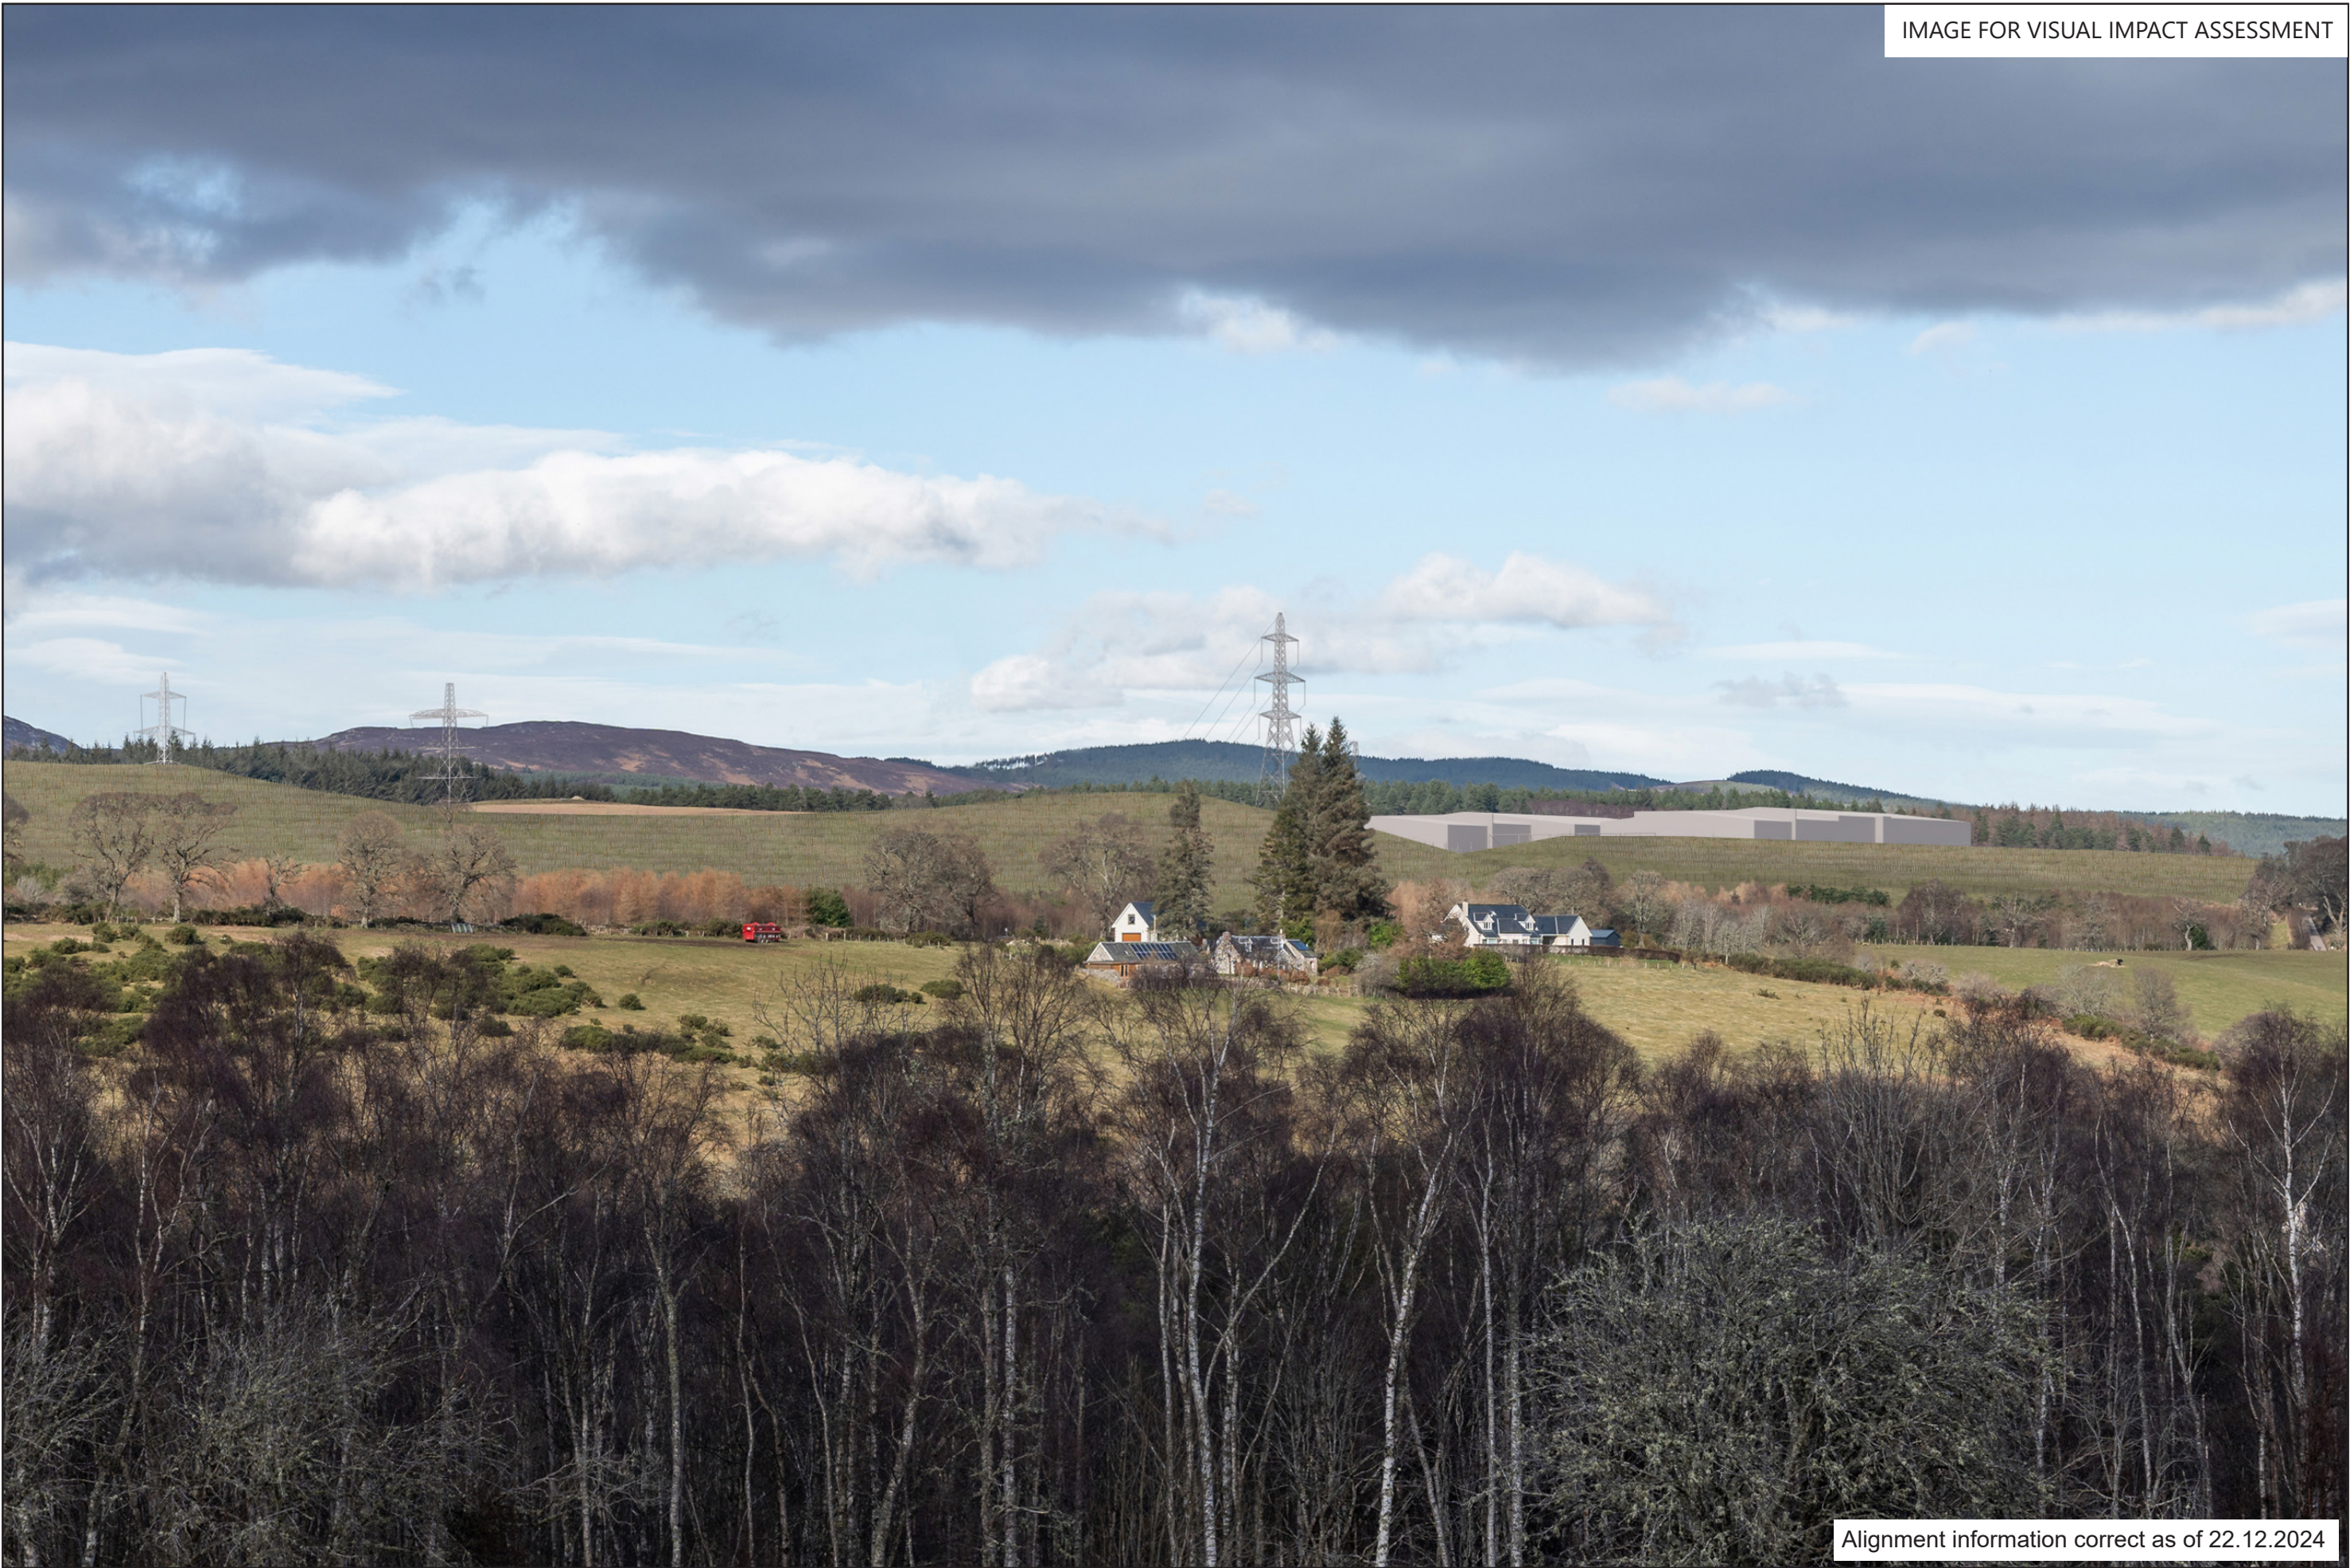

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-q Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-r Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 75mm


Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION

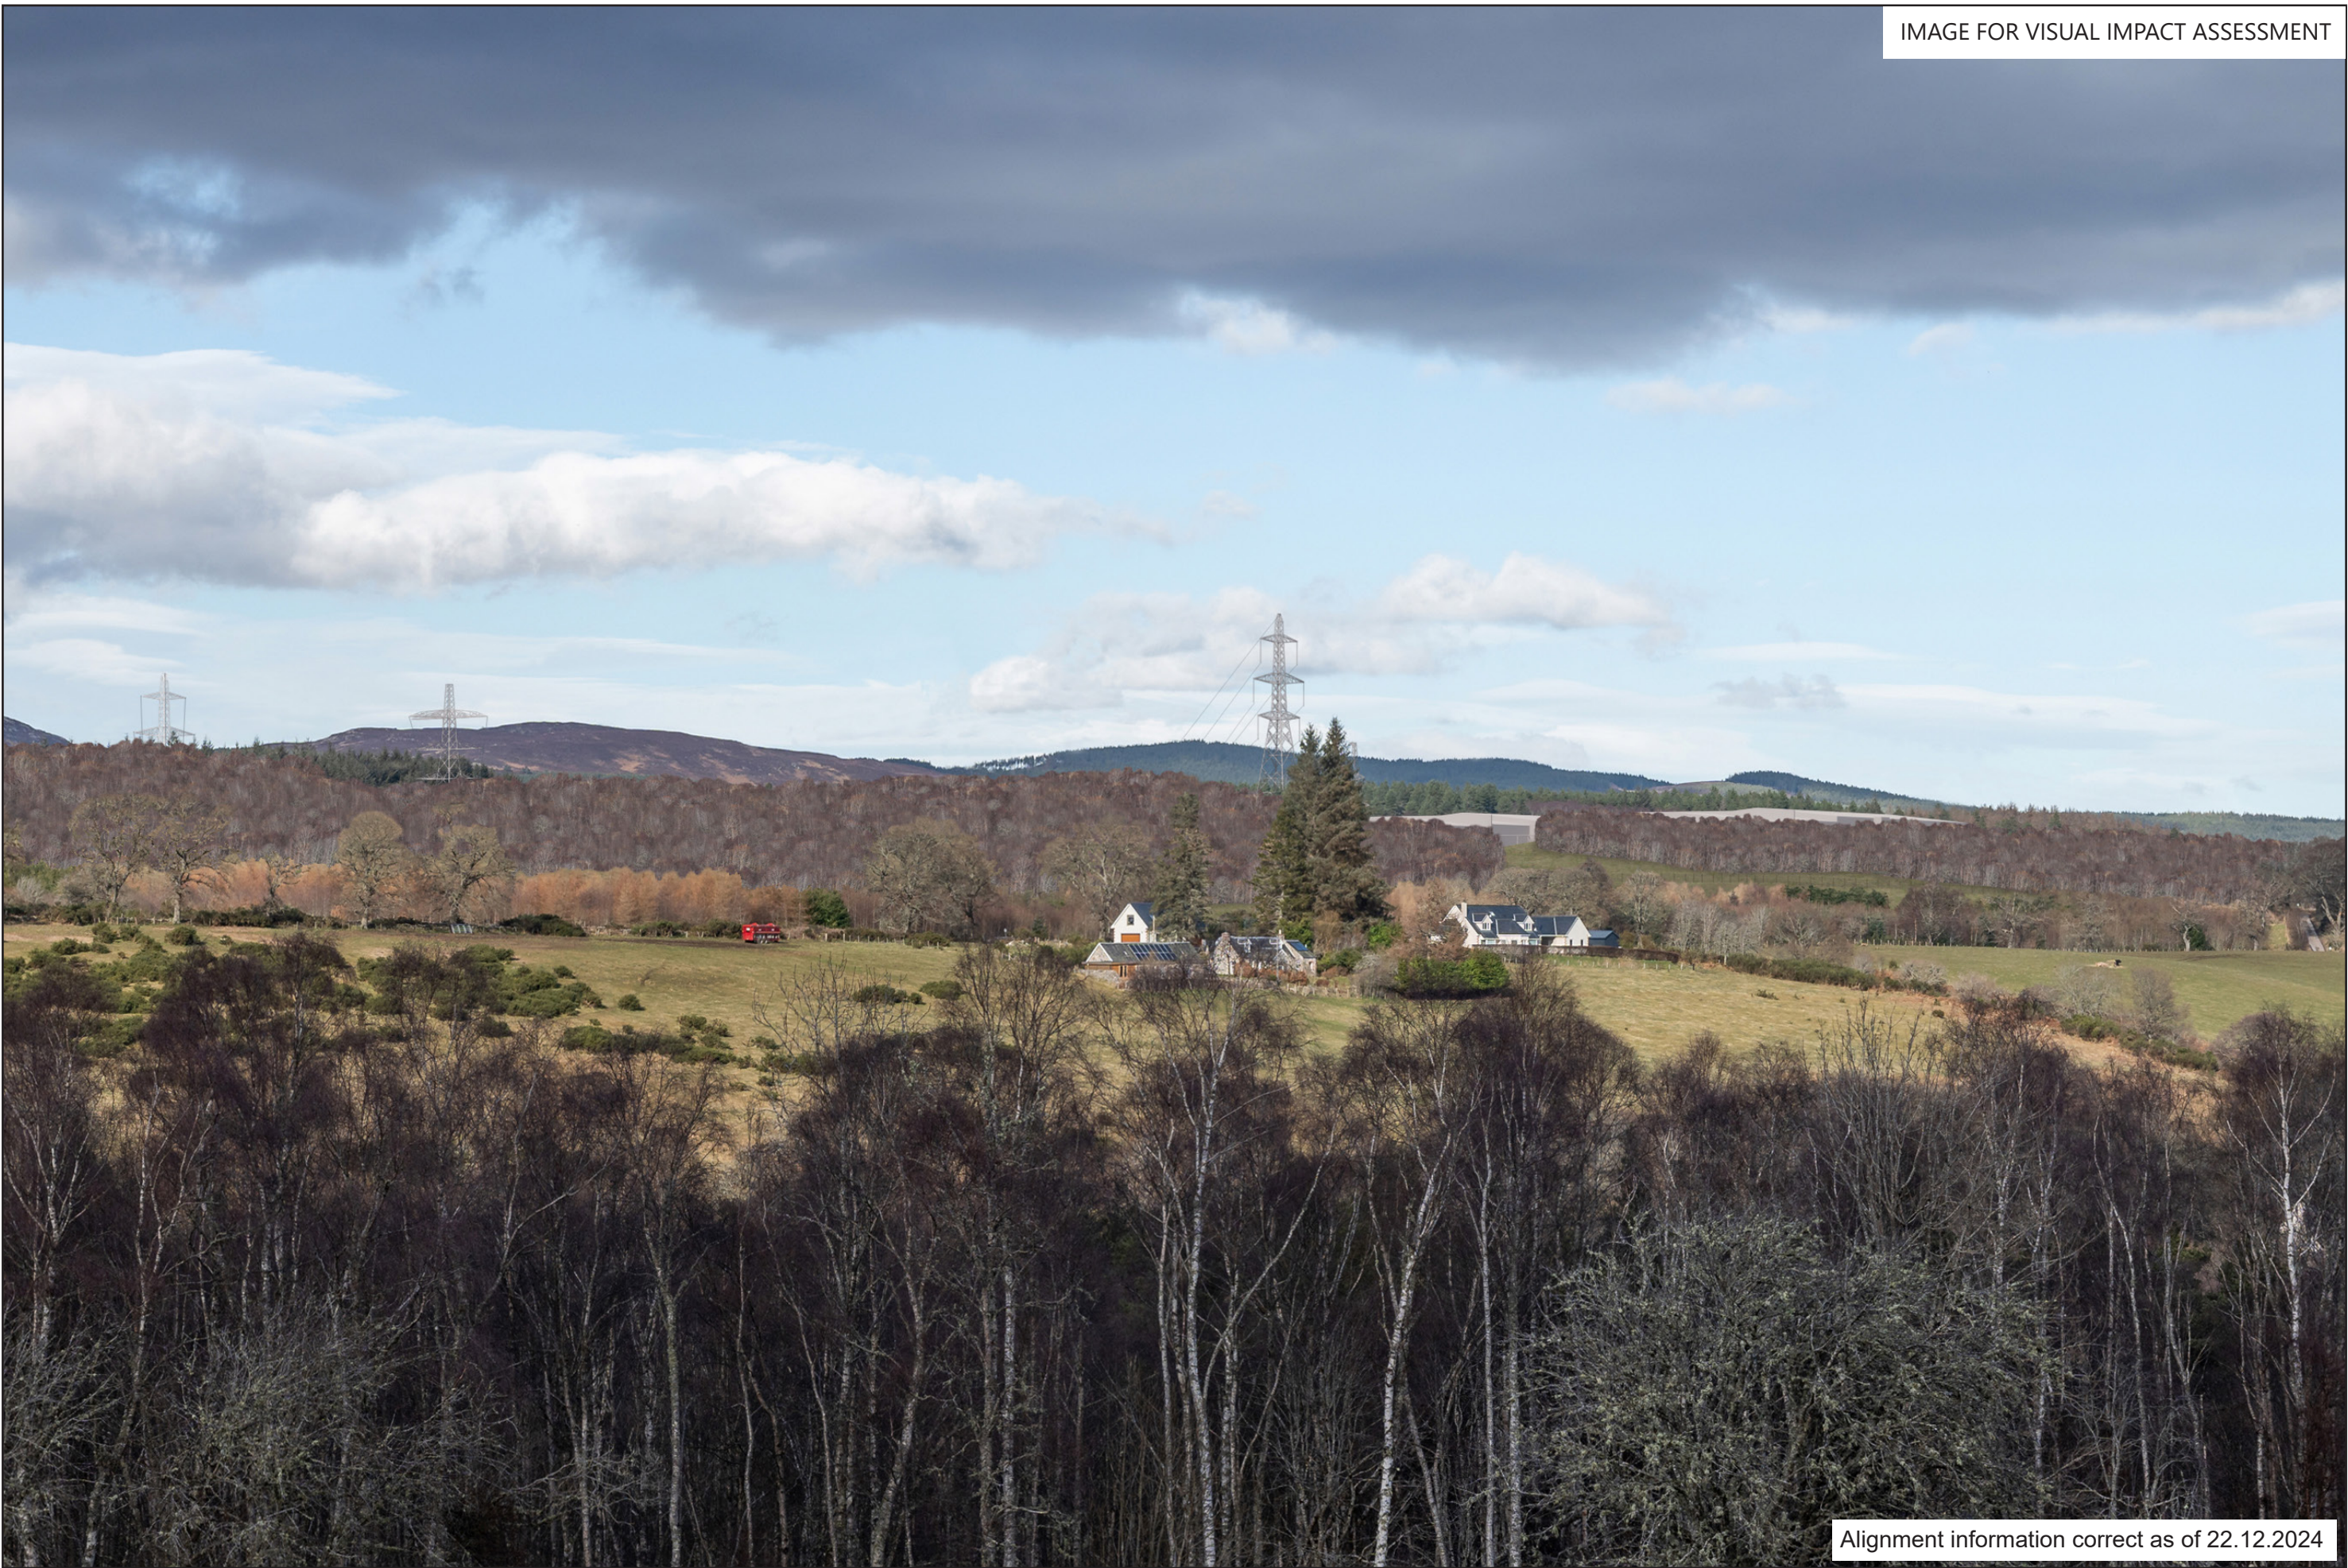

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-s Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.17-4 Viewpoint 6: View looking north from the western edge of Culburnie

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 75mm

Viewpoint Location: X 248336, Y 841396 AOD: 106m
Distance to Development and Direction of view: 1073m, 1°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION