


Mapped Location

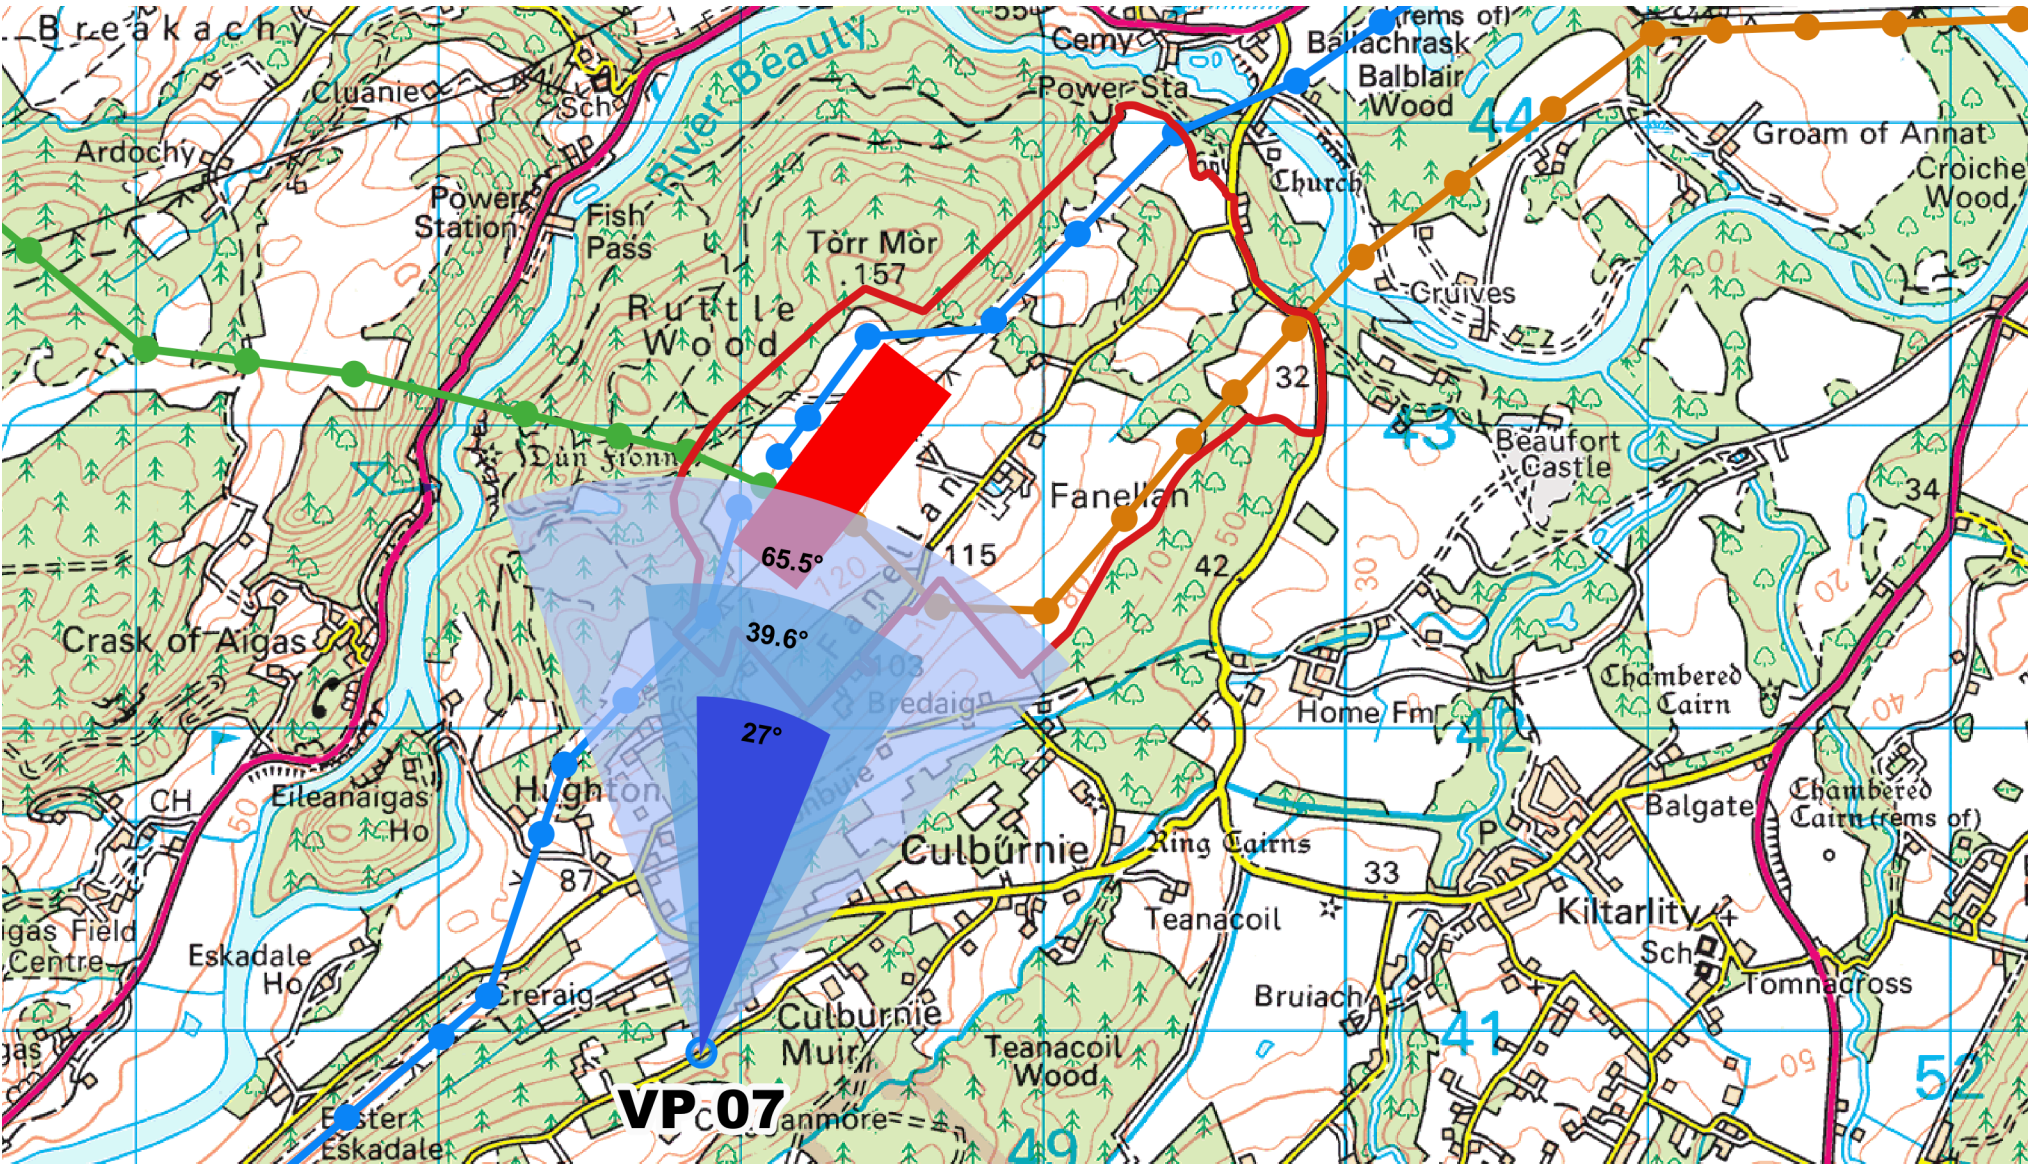

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18a
Viewpoint 7: View looking north-east from near Creraig

Location Description:
The viewpoint is on an unnamed single-track road linking the areas of Creraig and Culburnie. The viewpoint is from the western side of the road where the verge widens slightly. There is a large layby for parking, approximately 400 m west of the viewpoint. The viewpoint can be accessed on foot on the quiet road.


Camera Location



Location Data

OSGB36 Location:	247871 840927
AOD:	150m
Camera Height:	1.5m
Distance to Development:	1554m



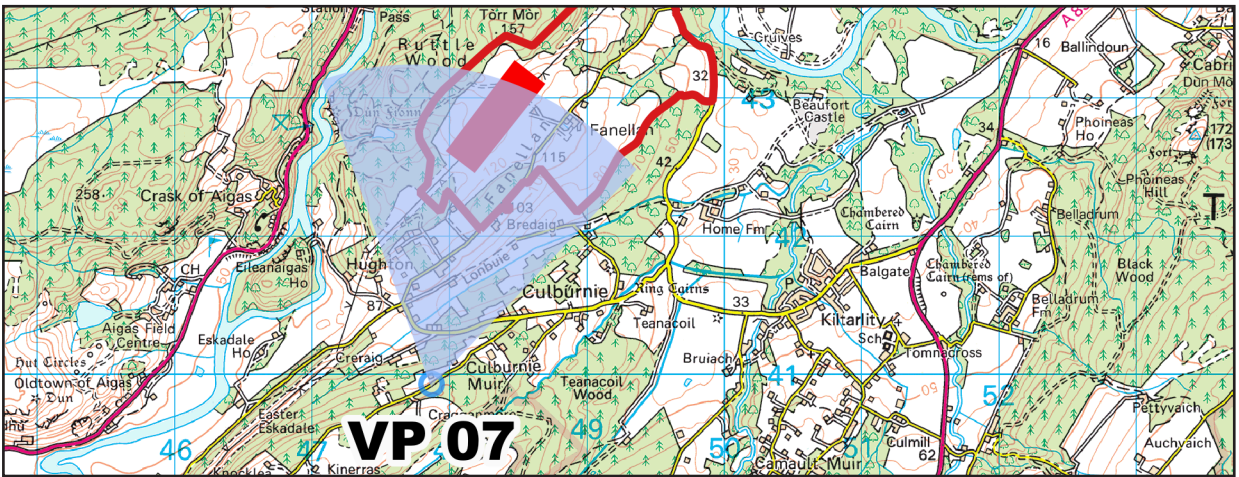

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18b
Viewpoint 7: View looking north-east from near Creraig

Operational View (Baseline) - 65.5°

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.



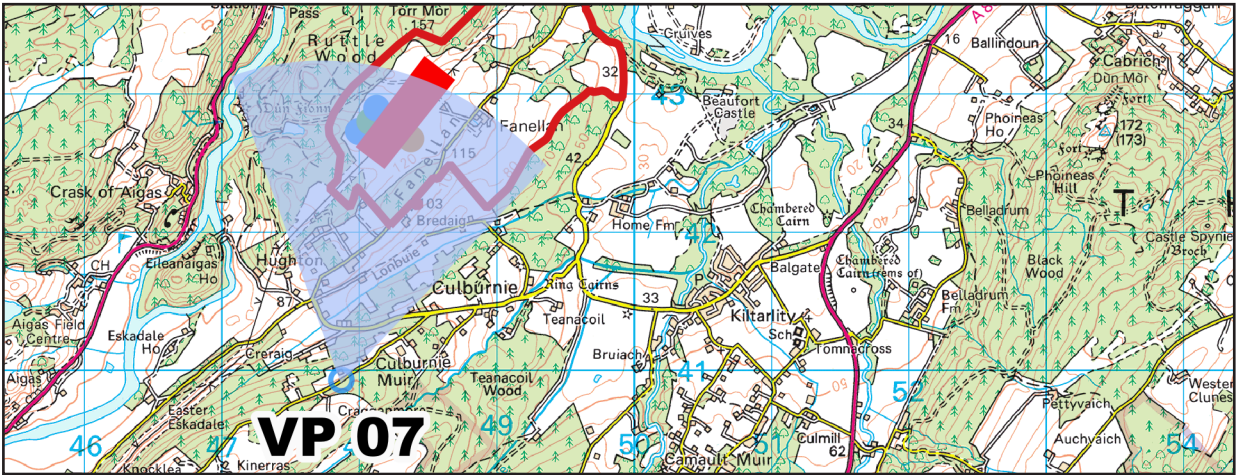

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18c
Viewpoint 7: View looking north-east from near Creraig

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

**Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°**

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



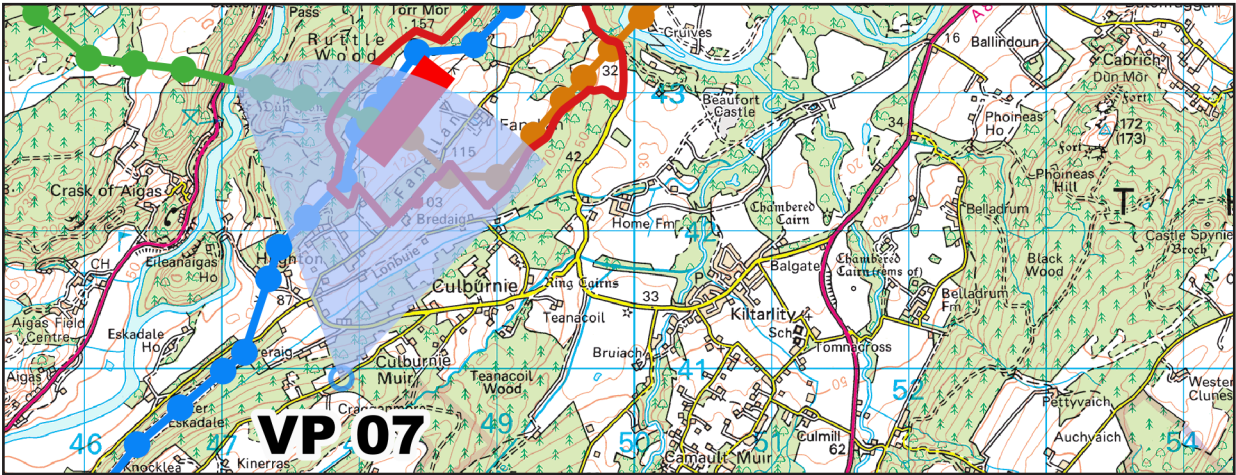

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18d
Viewpoint 7: View looking north-east from near Creraig

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



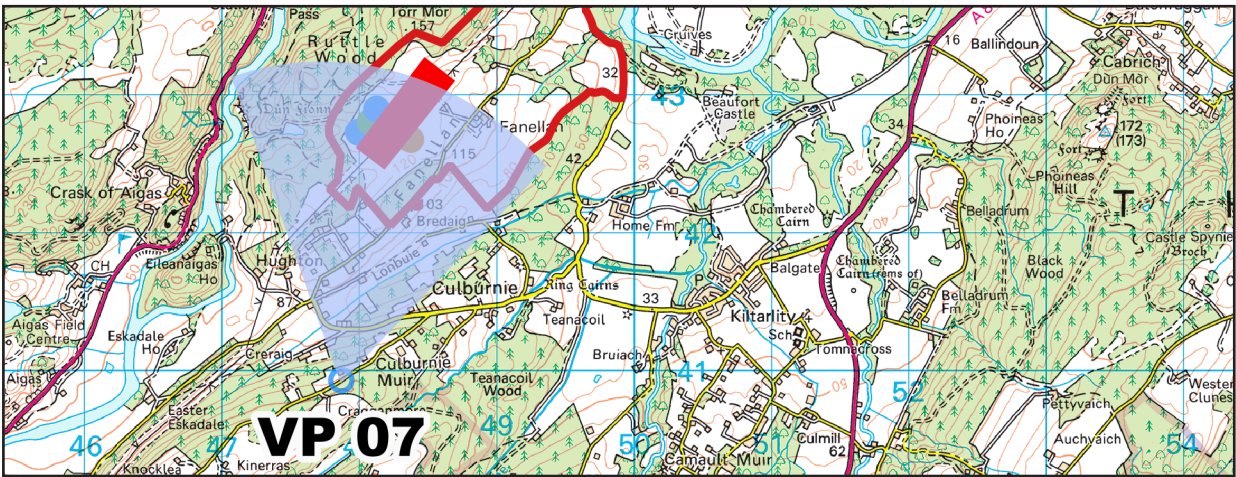

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18e
Viewpoint 7: View looking north-east from near Creraig

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers - Year 0) - 65.5°

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



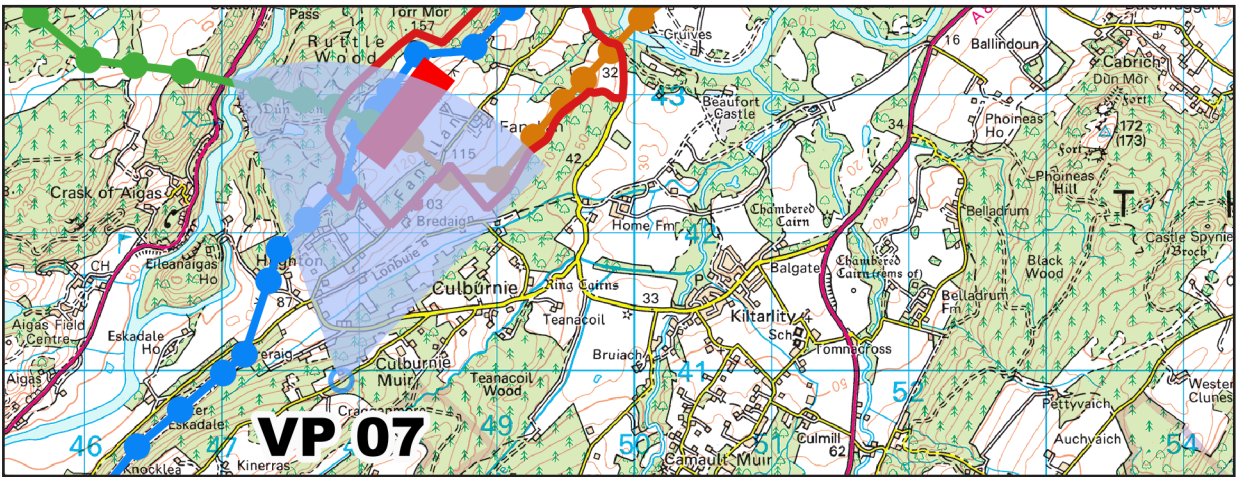

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18f
Viewpoint 7: View looking north-east from near Creraig

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.


The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



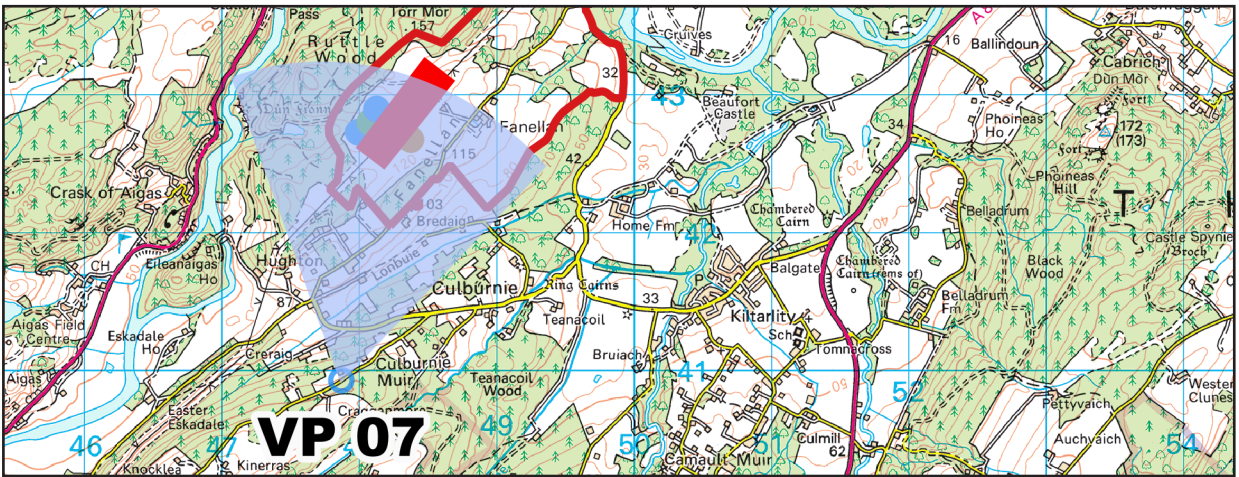

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18g
Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13° (North-East)

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



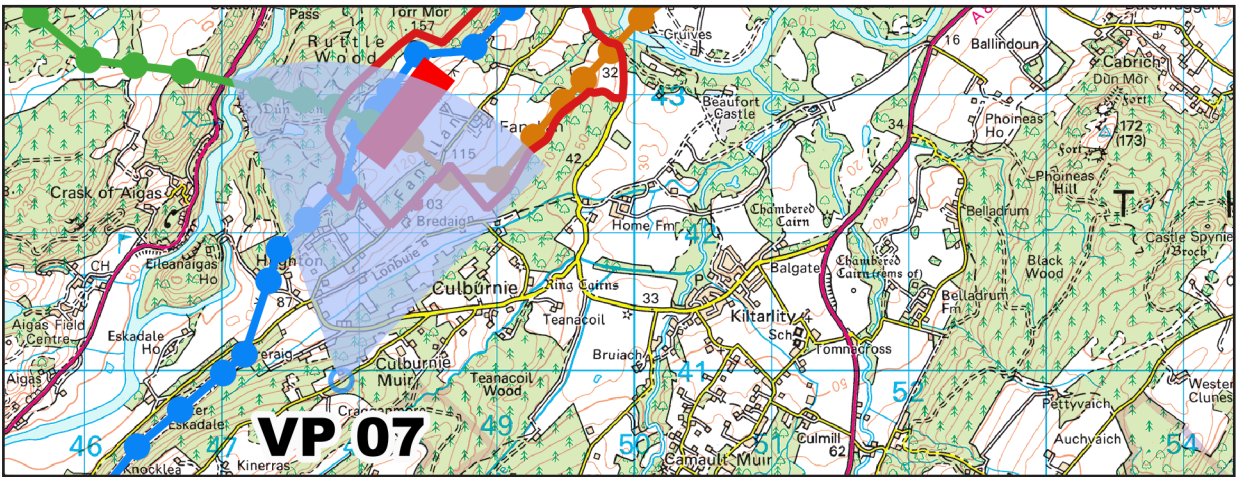

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.18h
Viewpoint 7: View looking north-east from near Ceraig

Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Receptor list: Residents of scattered dwellings associated with Ceraig. Rural road users of the route connecting Ceraig and Culburnie.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



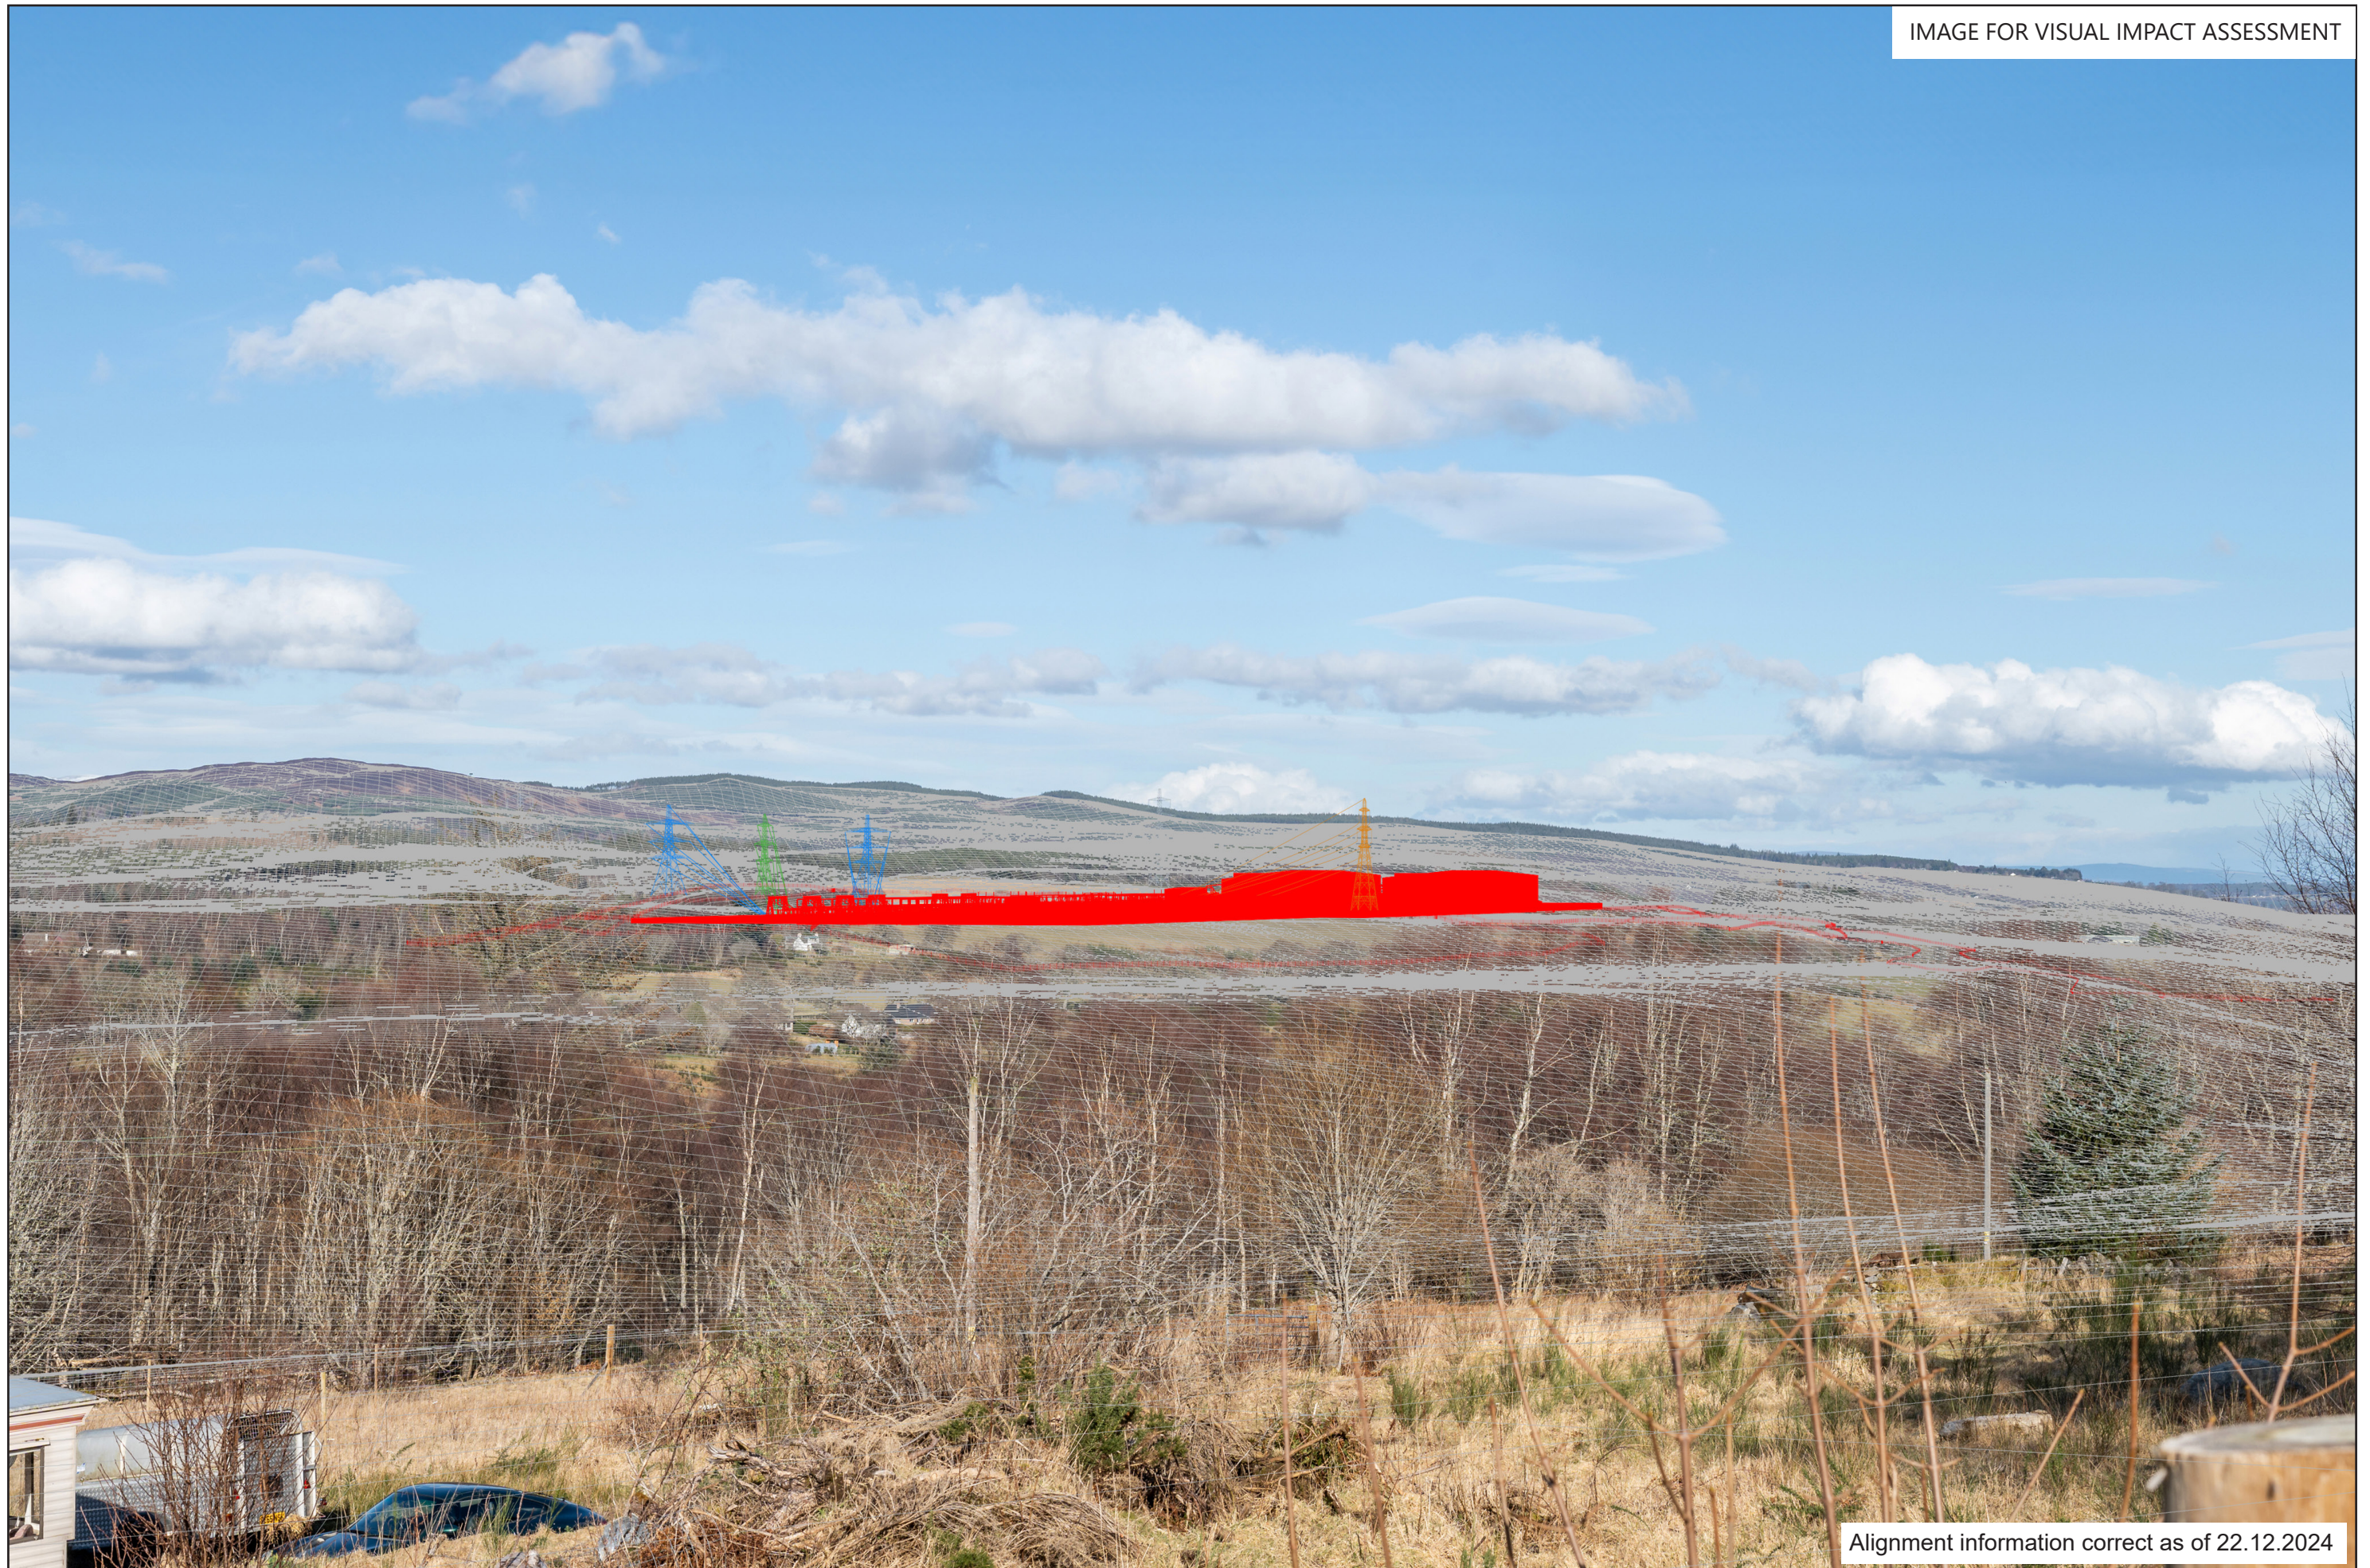

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-i Viewpoint 7: View looking north-east from near
Creraig

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-j Viewpoint 7: View looking north-east from near Creraig

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
- 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-k Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-I Viewpoint 7: View looking north-east from near Ceraig

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-m Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-n Viewpoint 7: View looking north-east from near Creraig

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm


Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

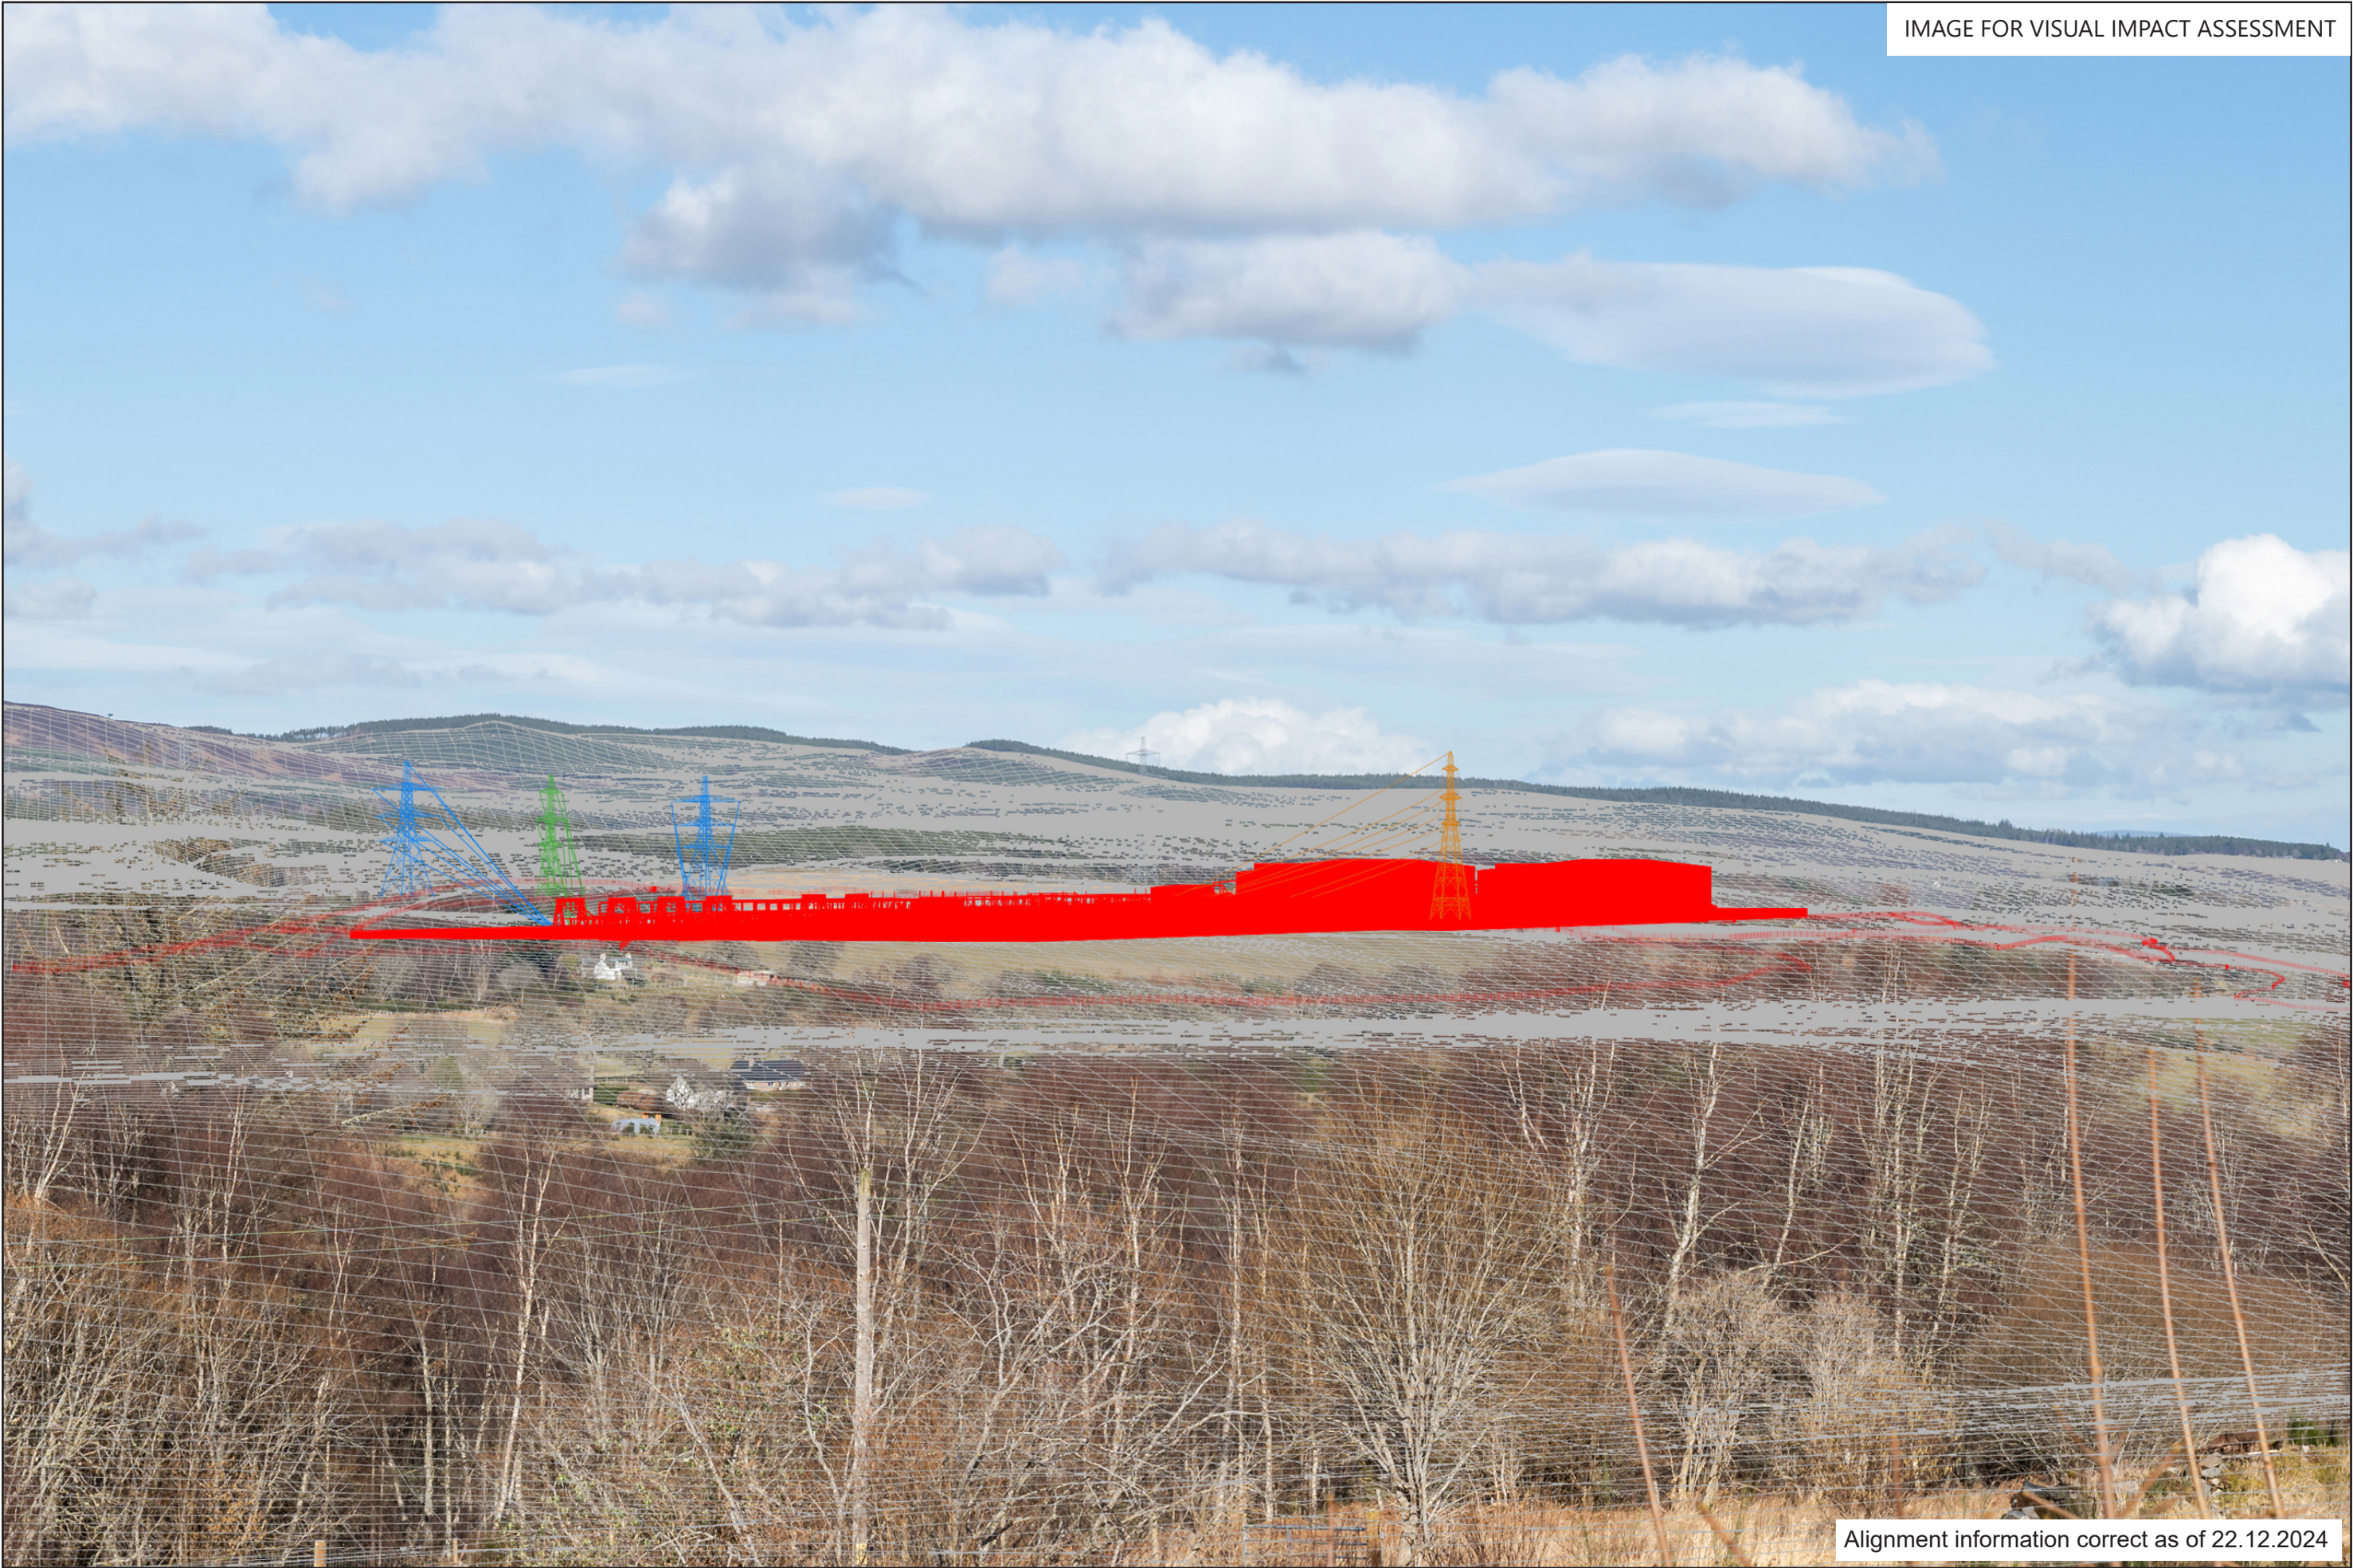

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-o Viewpoint 7: View looking north-east from near Creraig

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-p Viewpoint 7: View looking north-east from near Ceraig

Operational View (Photowire: SSN Cumulative Overhead Line Schemes Only)
 - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-q Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-r Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 75mm


Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

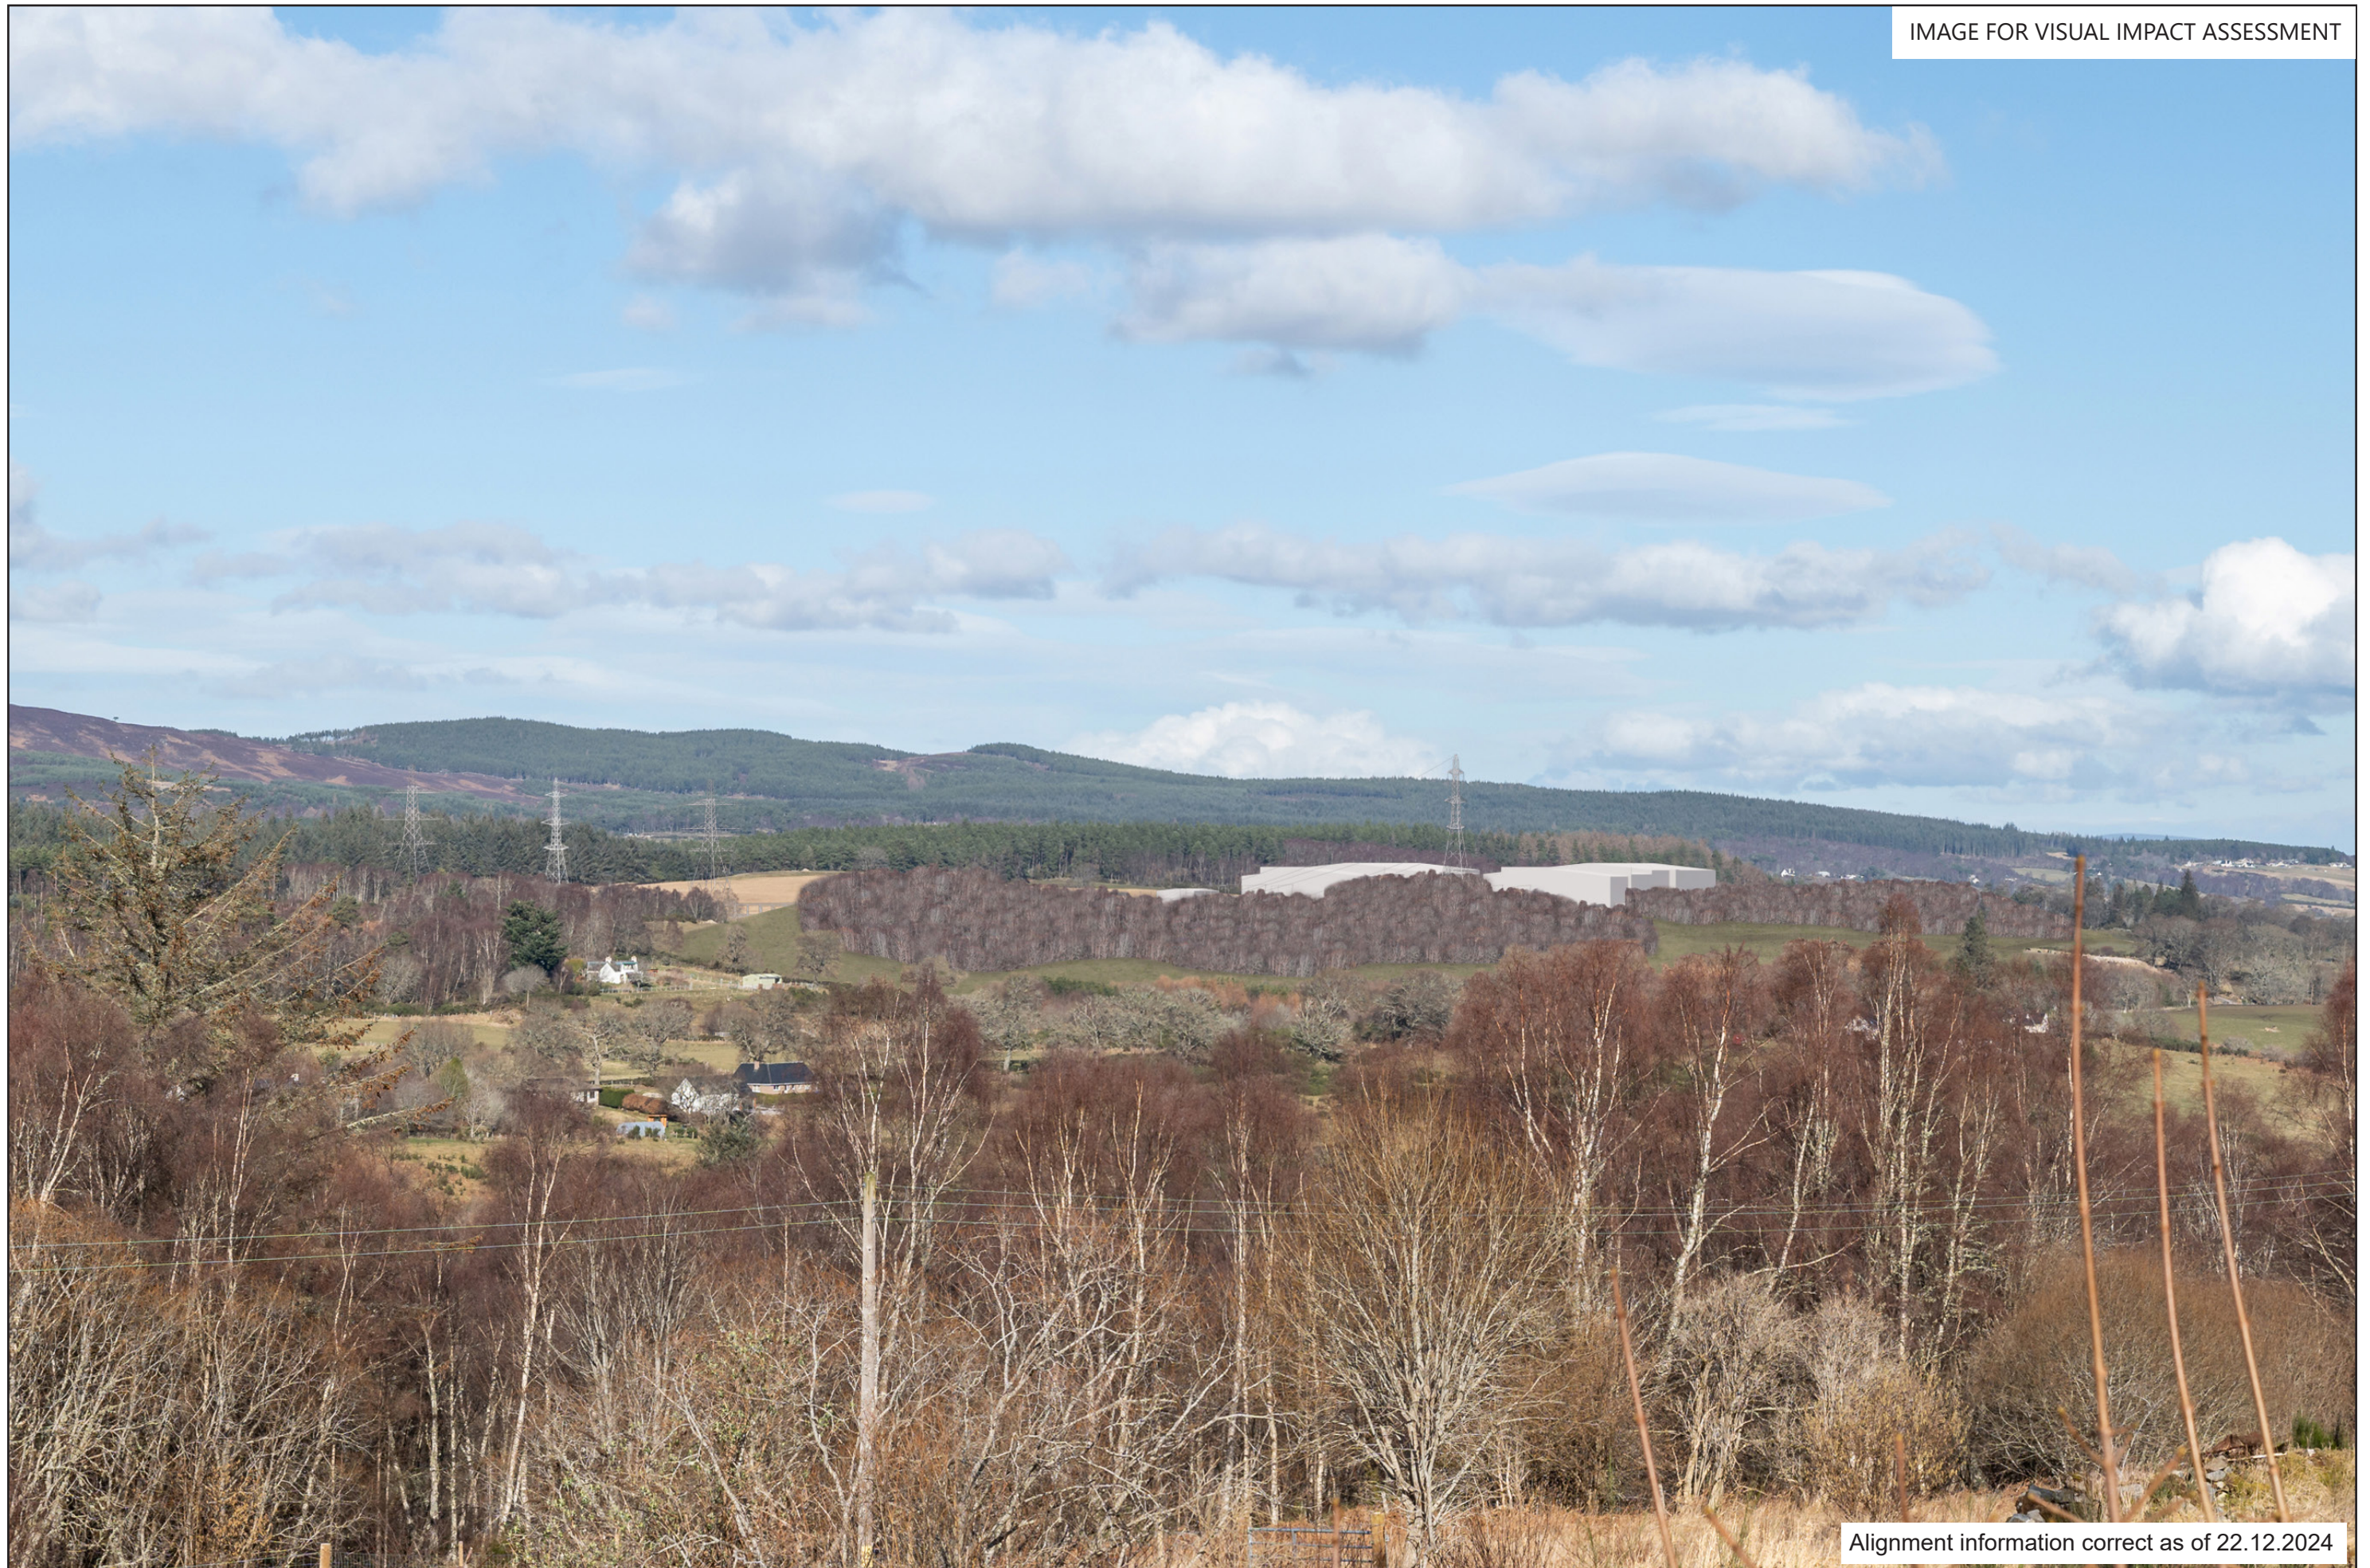

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-s Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.18-t Viewpoint 7: View looking north-east from near Creraig

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION