


Mapped Location

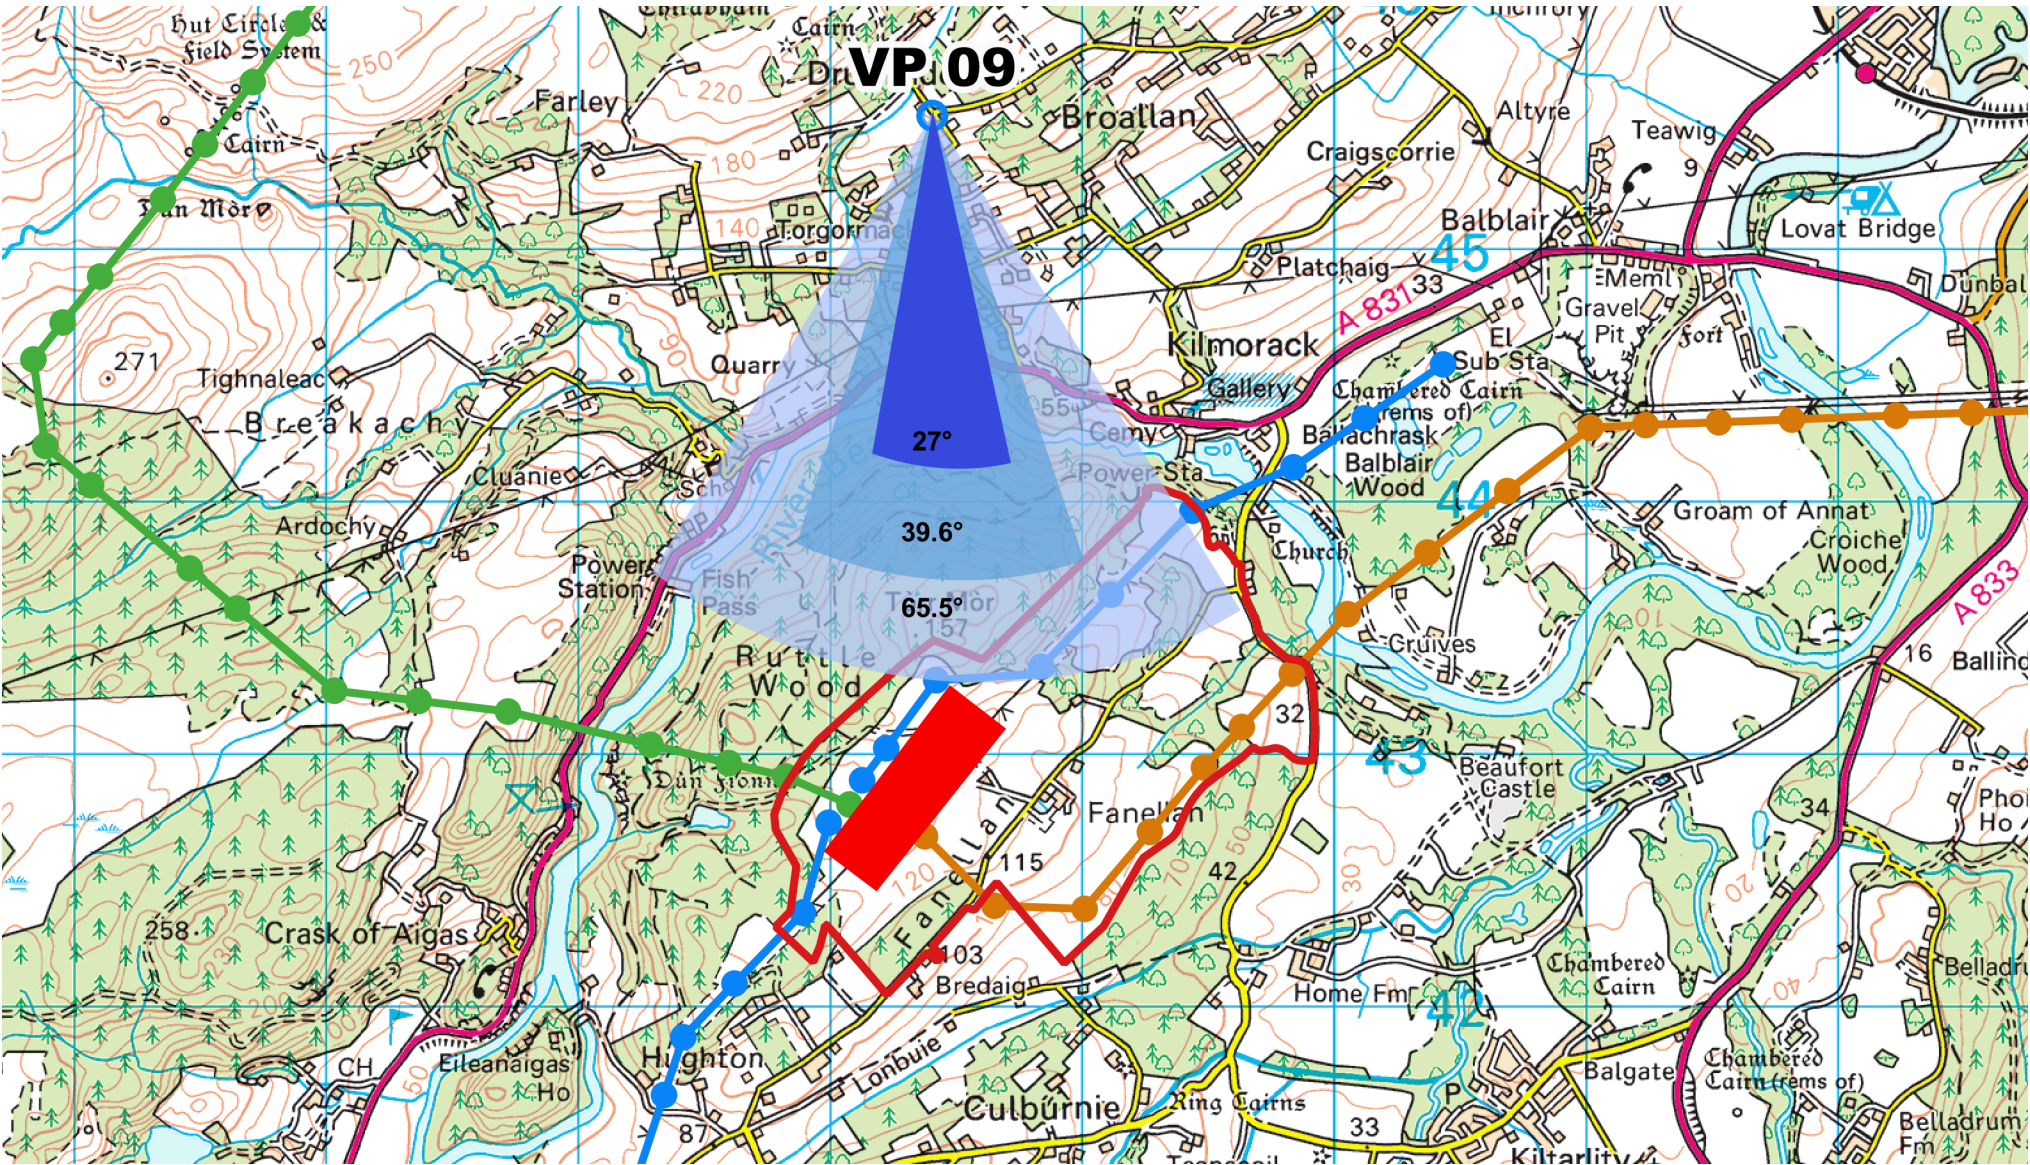

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20a
Viewpoint 9: View looking south from Torgormack near Broallan


Location Description:
The viewpoint is on an unnamed road, West of the area of Drumindorsair. Parking can be found in a layby adjacent to the viewpoint and the viewpoint can be accessed by foot on the quiet road.

Camera Location



Location Data

OSGB36 Location:	248406 845531
AOD:	179m
Camera Height:	1.5m
Distance to Development:	2273m

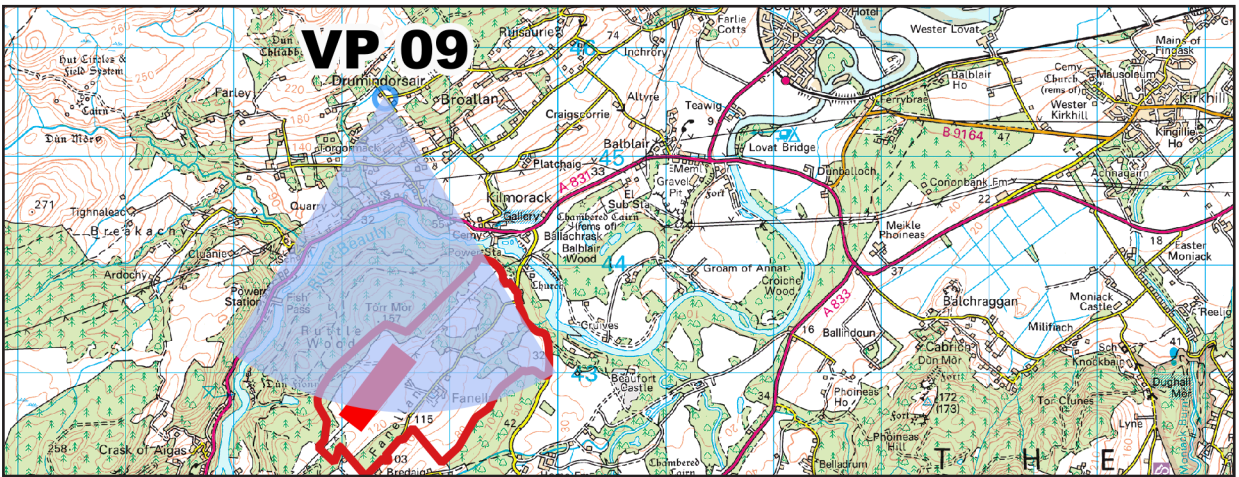

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20b
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Baseline) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)


Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



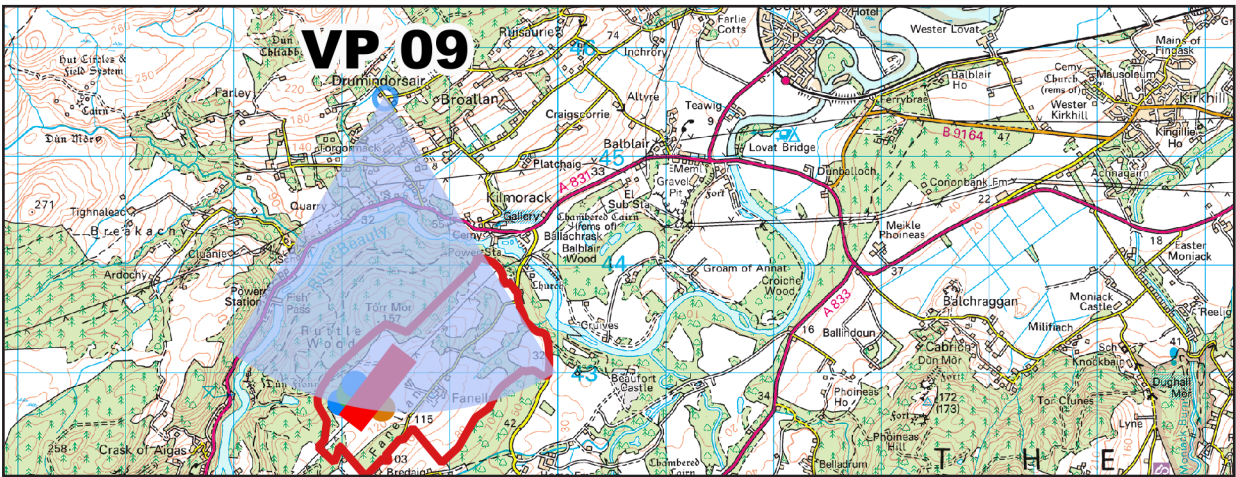

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20c
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)

Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



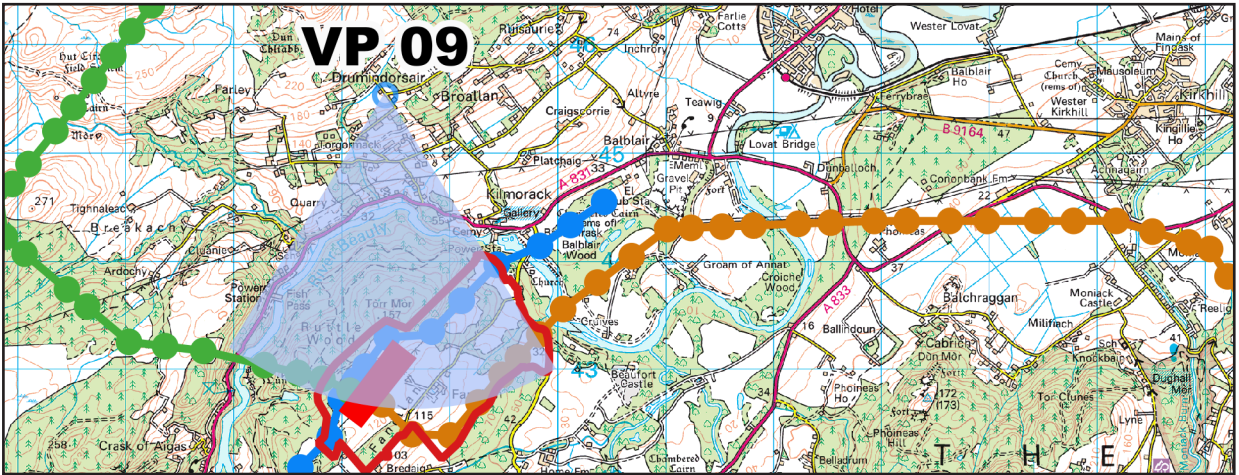

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20d
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Photowire: SSEN Cumulative Overhead
Line Schemes Only) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)


Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

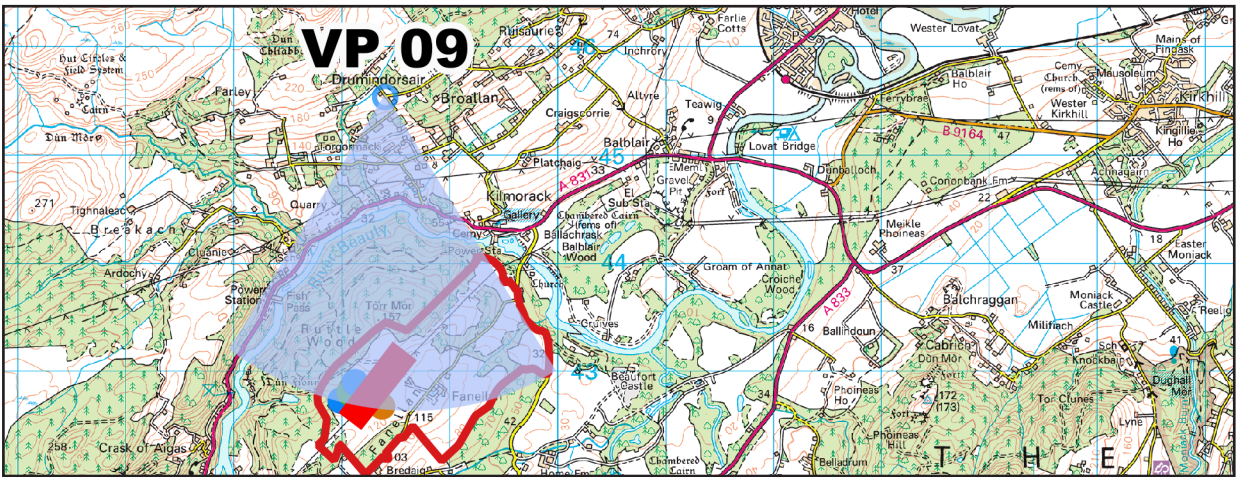

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20e
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)

Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



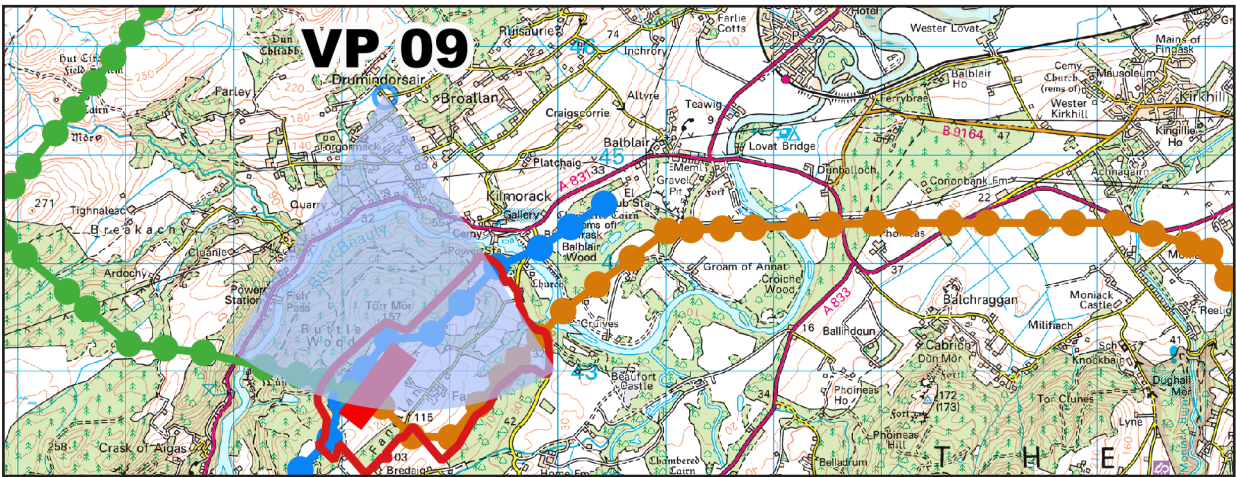

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20f
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)

Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



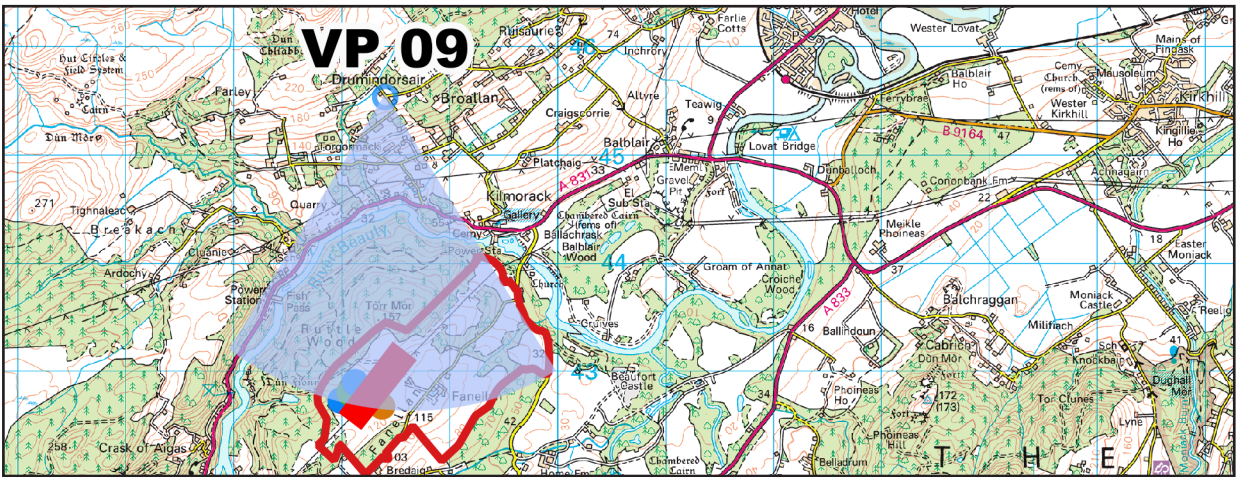

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20g
Viewpoint 9: View looking south from Torgormack near
Broallan
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
(South)

Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



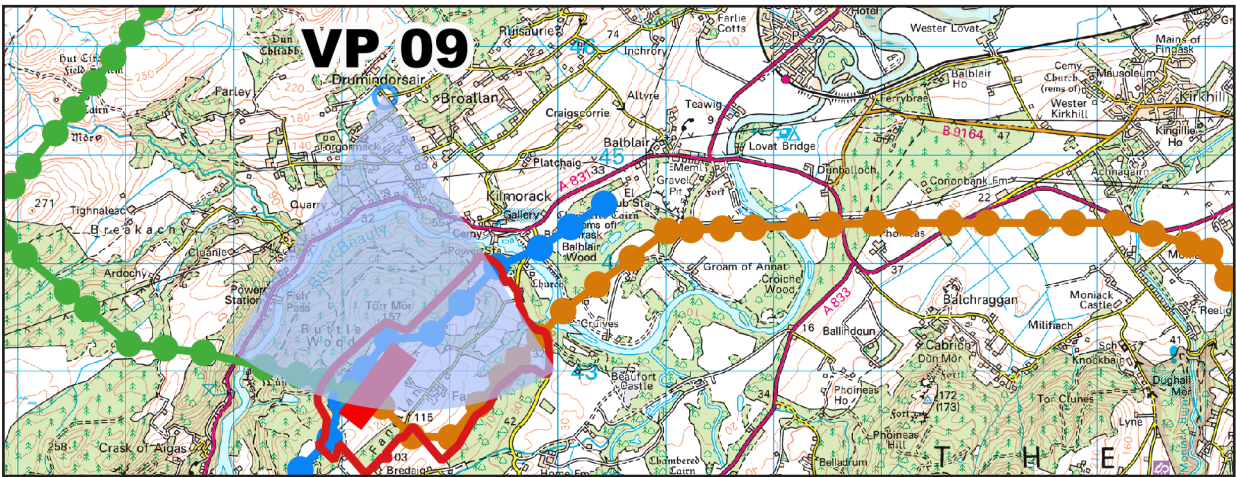

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.20h
Viewpoint 9: View looking south from Torgormack near Broallan
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 248406, Y 845531
AOD: 179m
Distance to Development and Direction of view: 2273m, 181° (South)

Receptor list: Residents at Torgormack, Drumindorsair and Broallan. Road users of the route between Torgormack and Drumindorsair.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 - Farmed and Forested Slopes - Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-i Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-j Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-k Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-I Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 50mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-m Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-n Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm


Viewpoint Location: X 248406, Y 845531 AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION

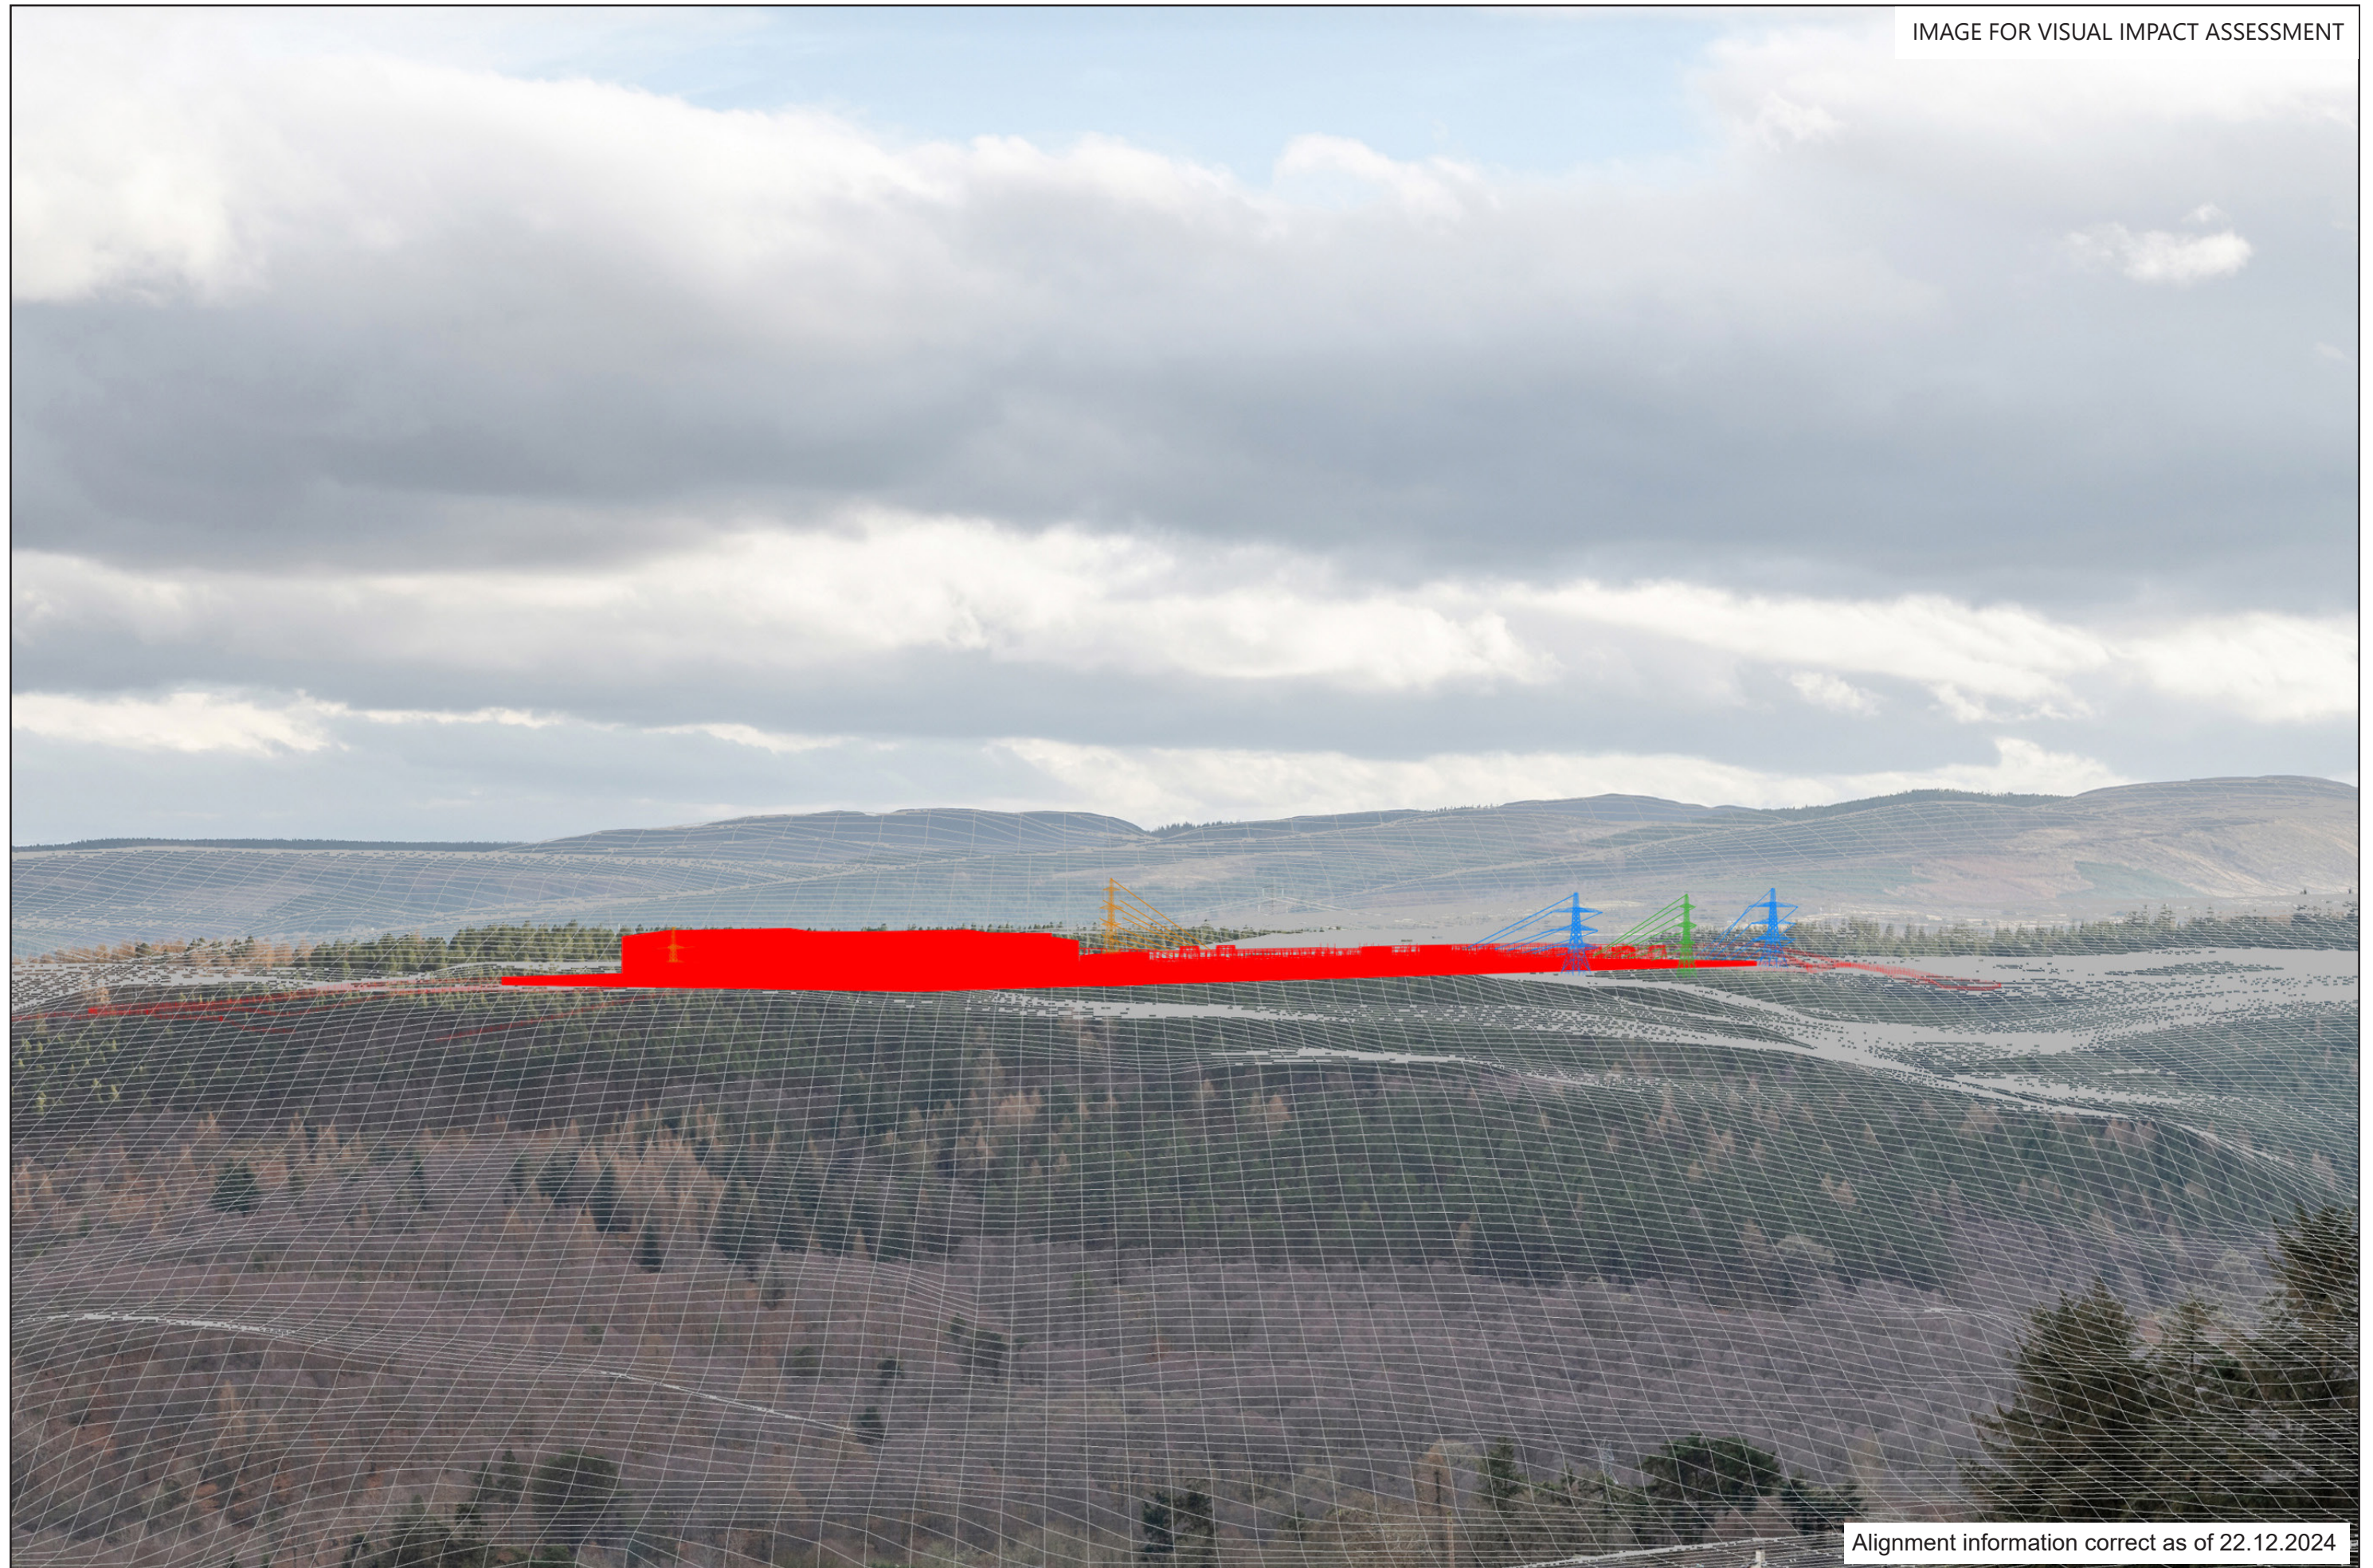

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-o Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm


Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

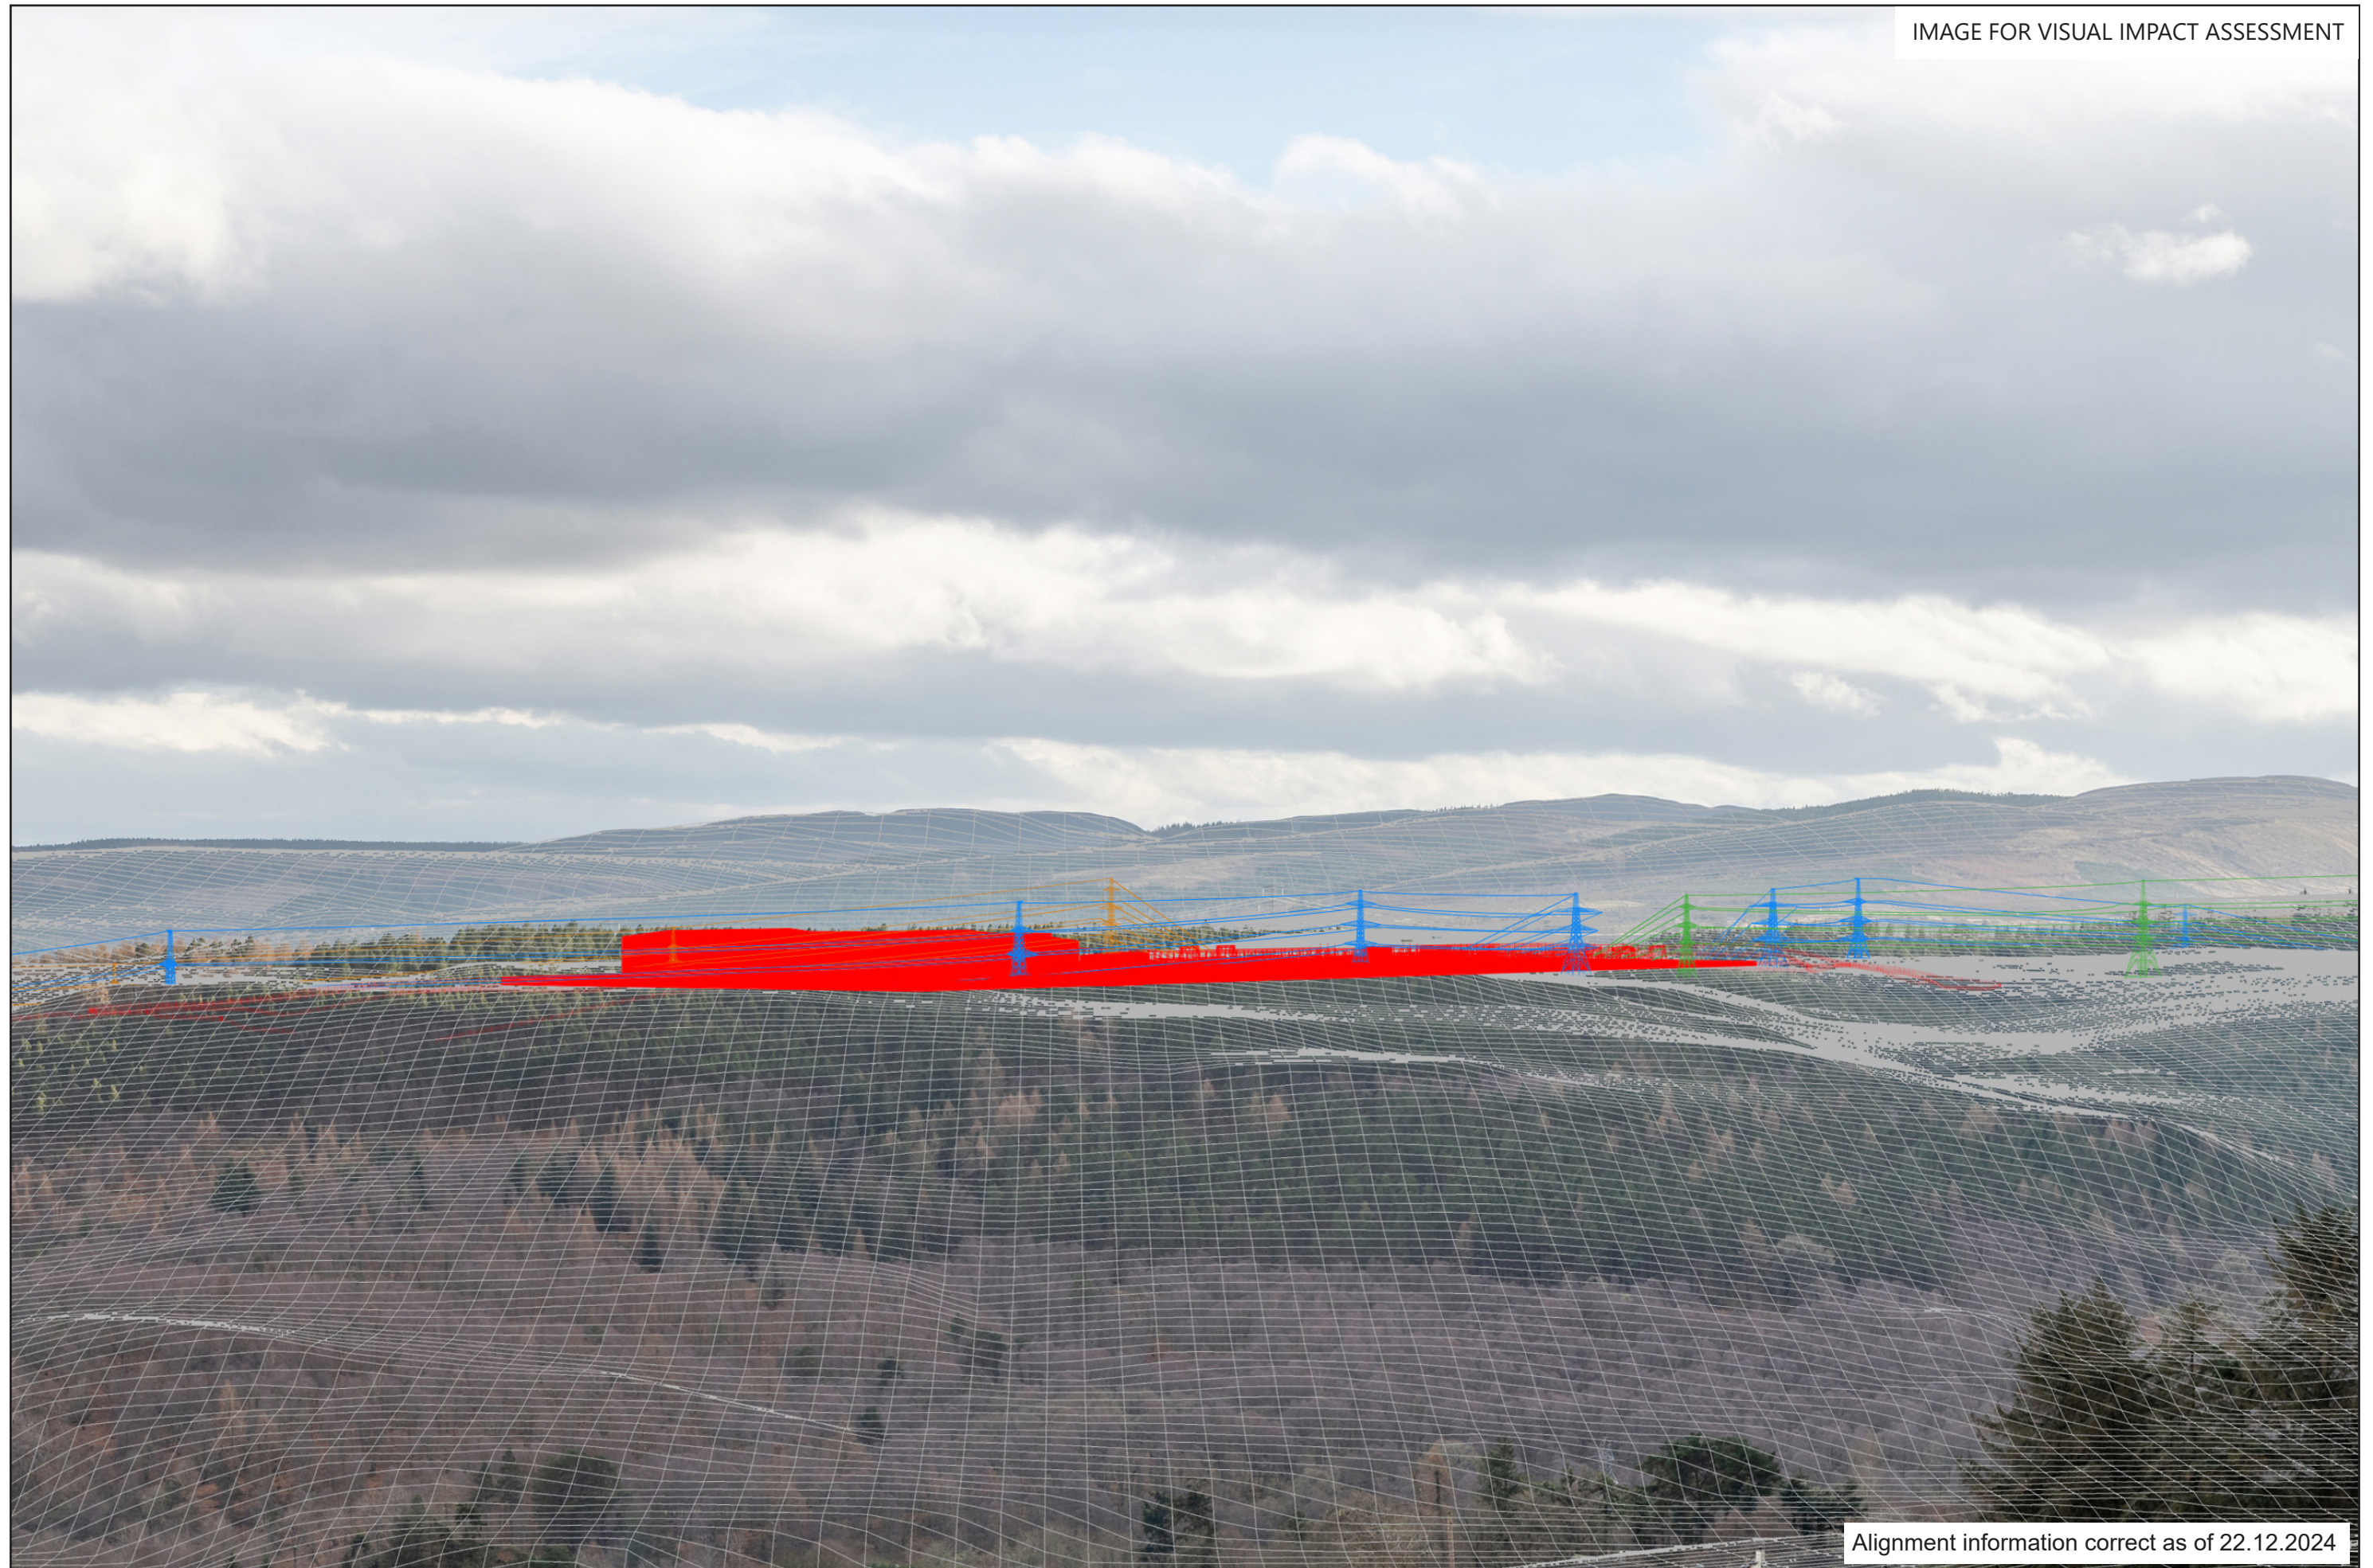

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-p Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 75mm


Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

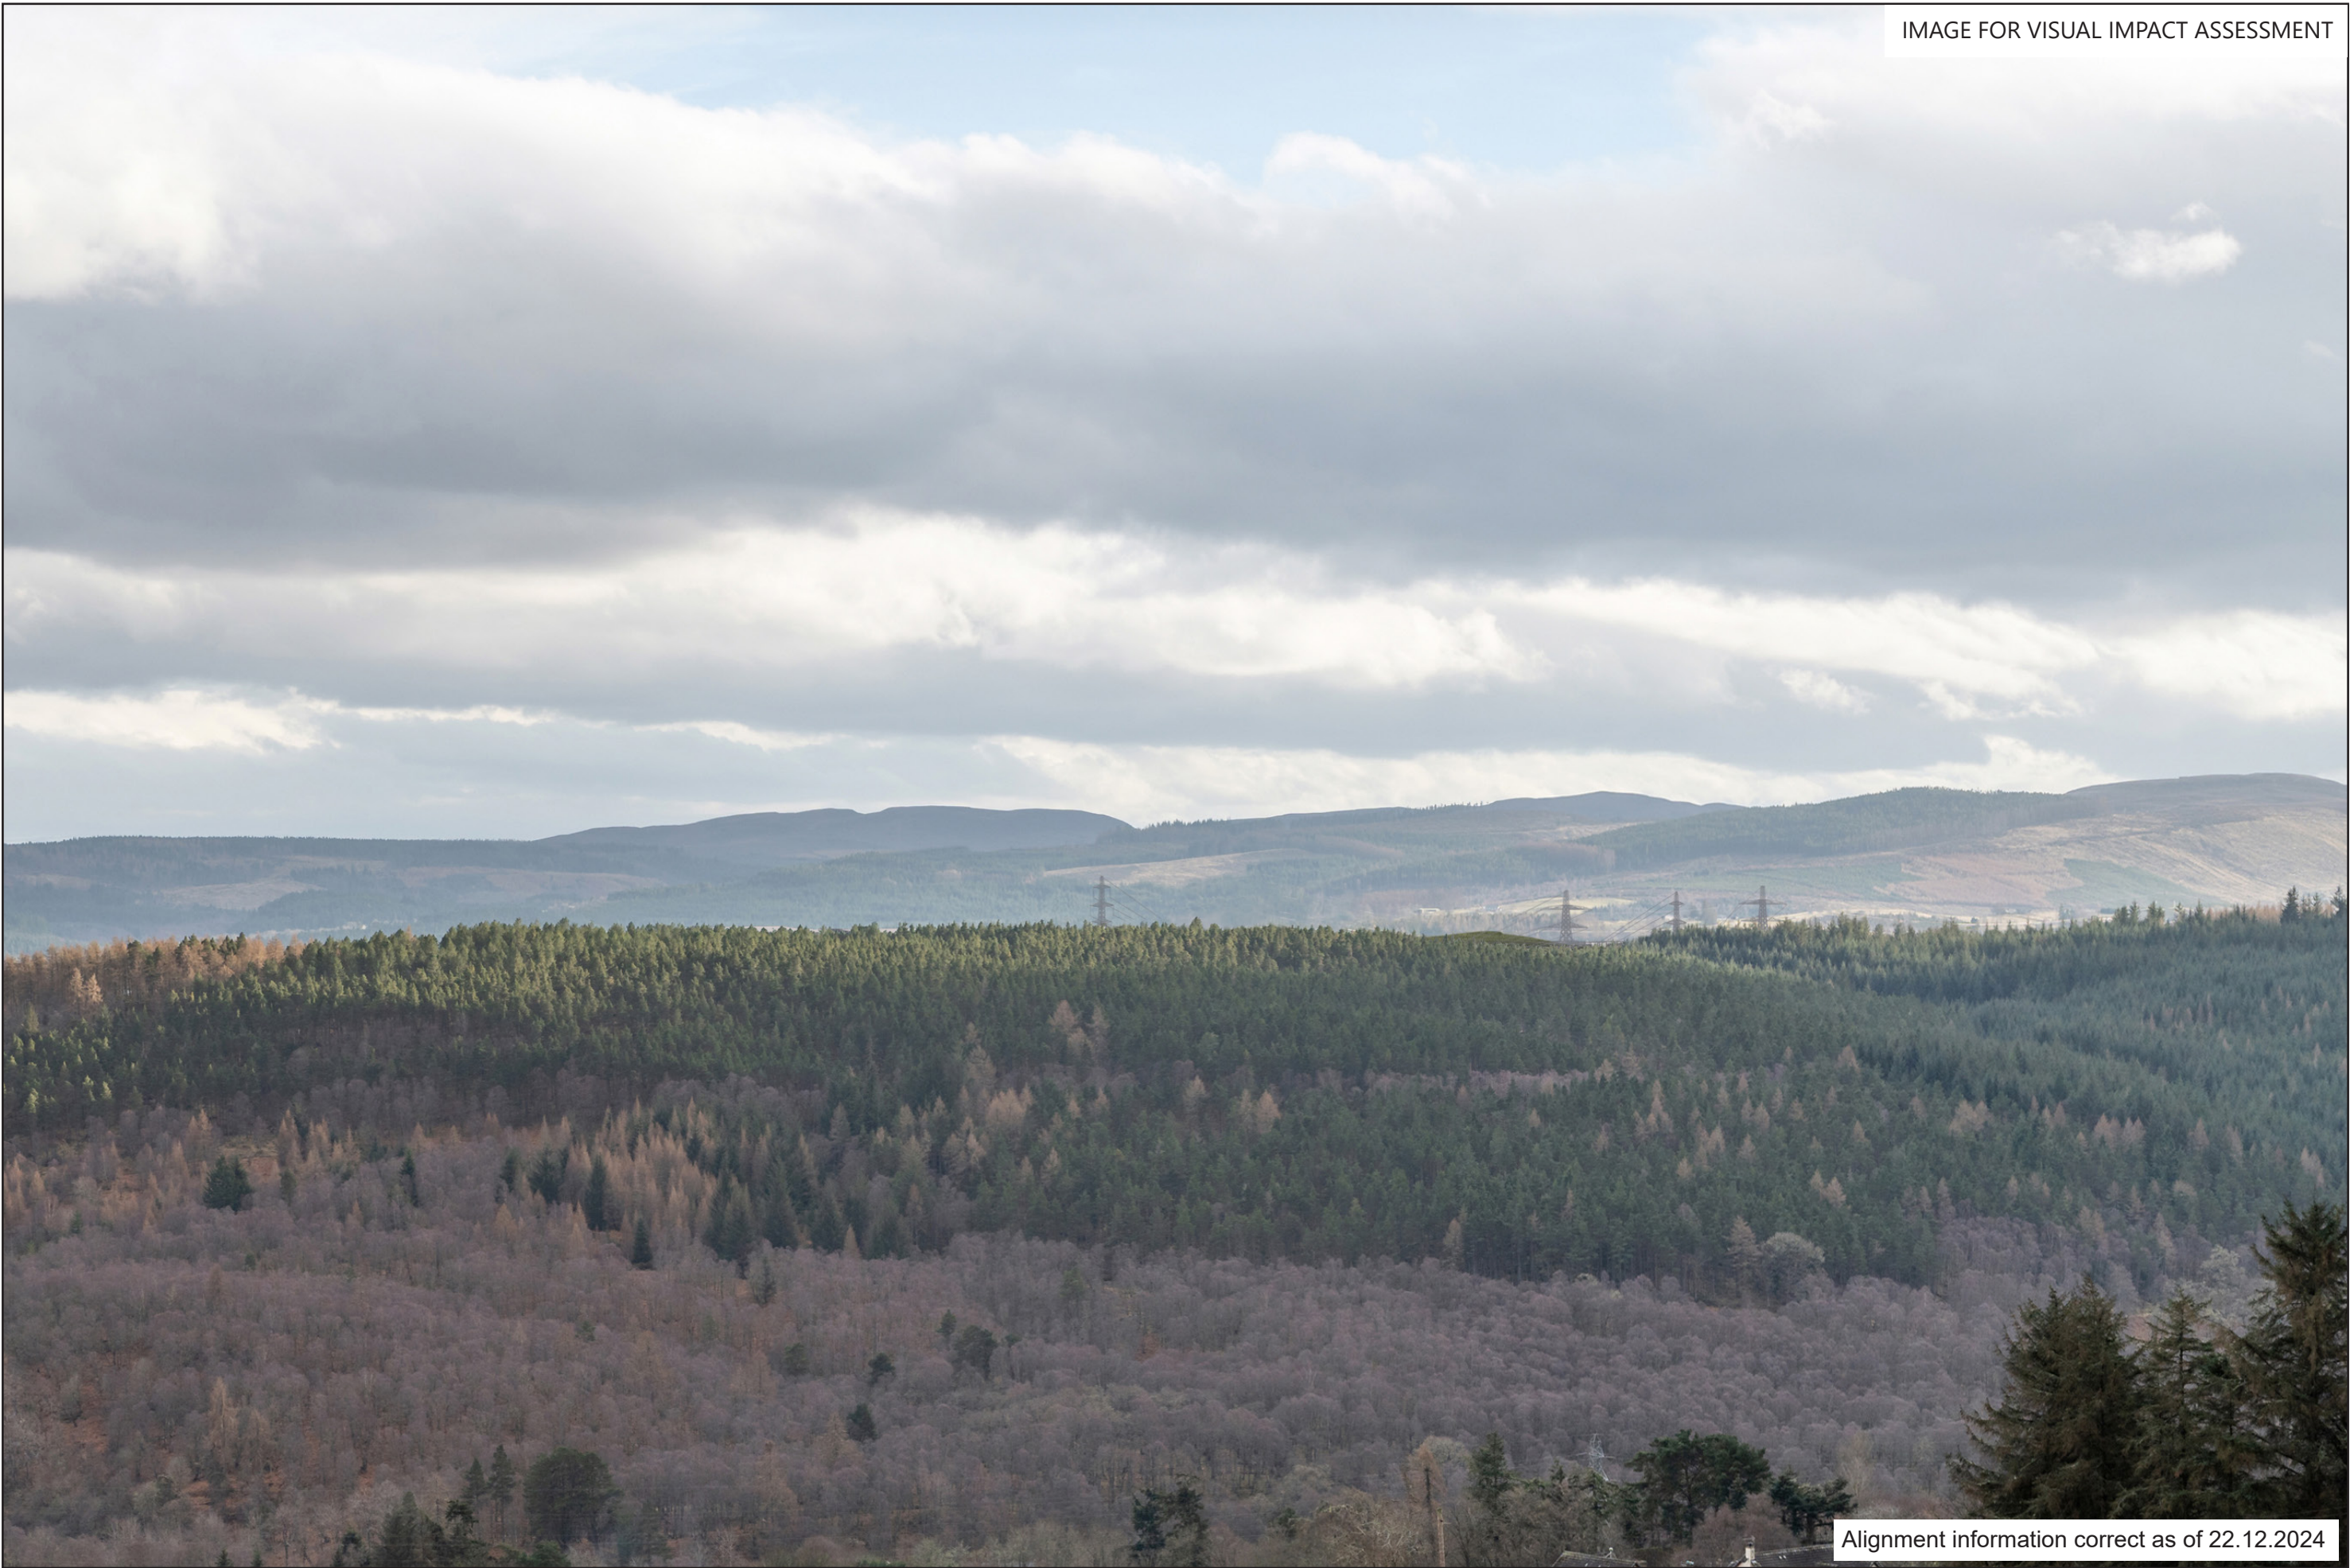

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-q Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm


Viewpoint Location: X 248406, Y 845531 AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION

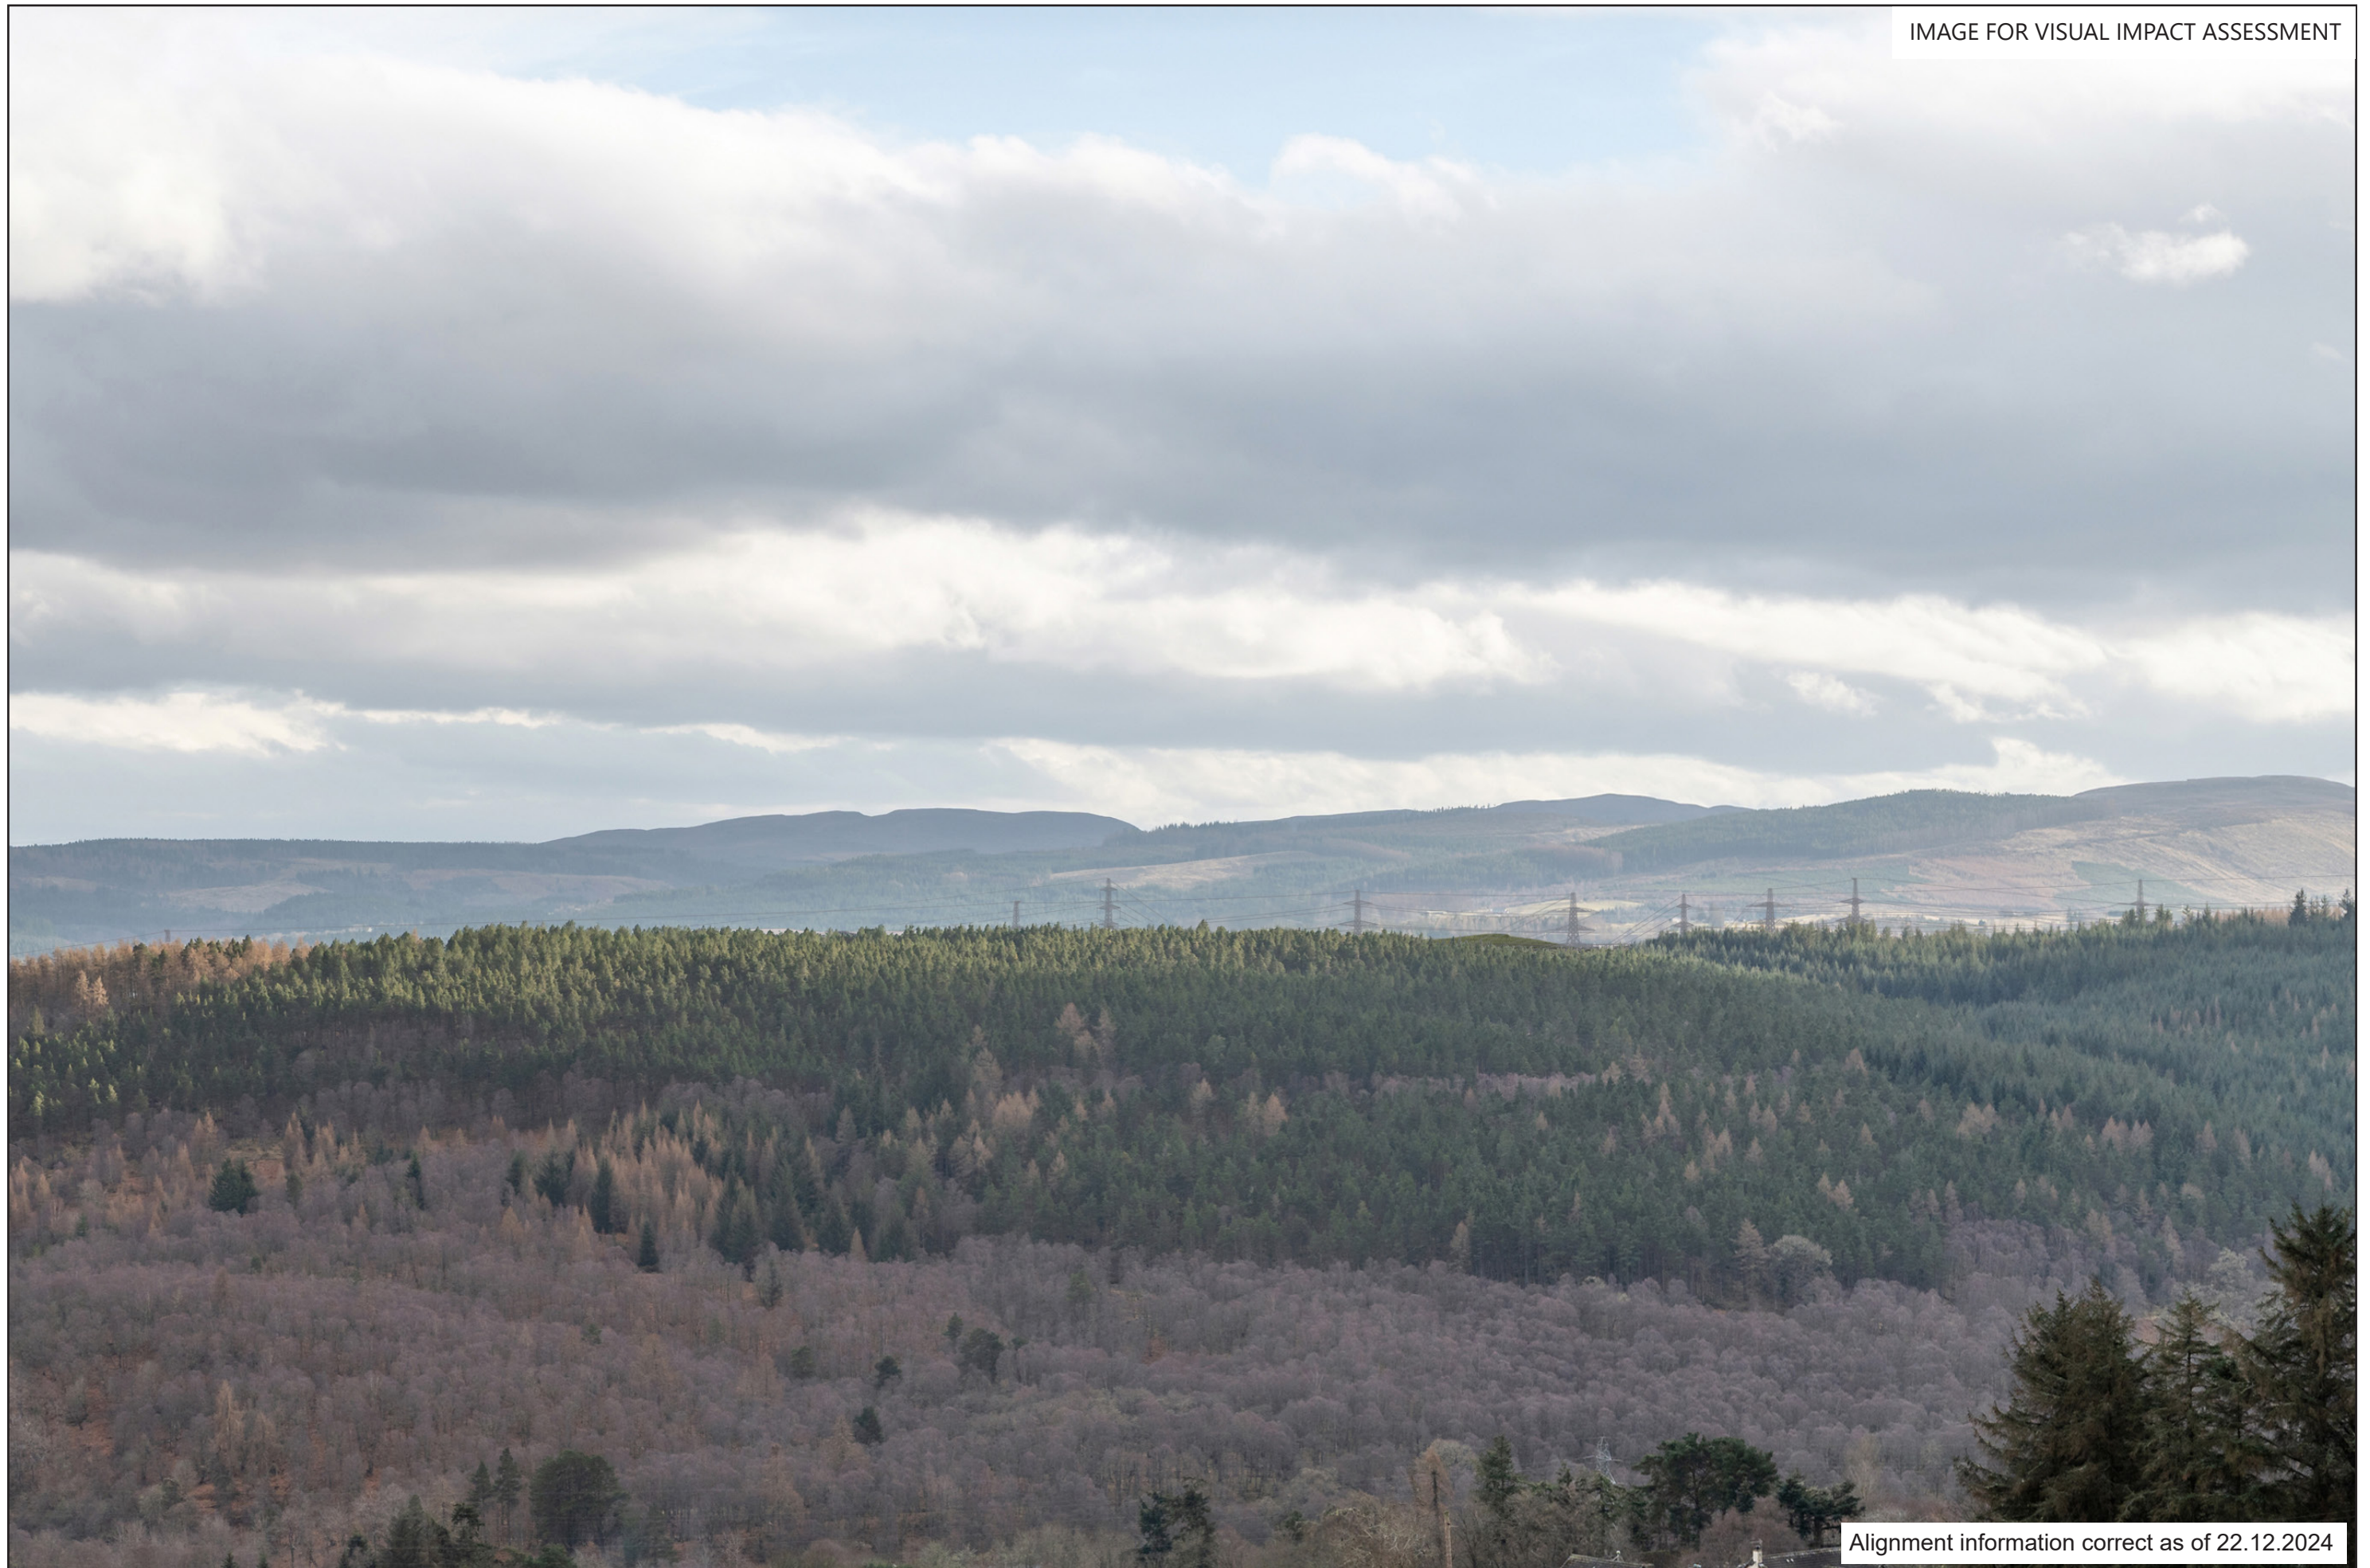

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-r Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 75mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
 Distance to Development and Direction of view: 2273m, 181°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-s Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.20-4 Viewpoint 9: View looking south from Torgormack near Broallan

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 75mm

Viewpoint Location: X 248406, Y 845531 AOD: 179m
Distance to Development and Direction of view: 2273m, 181°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION