


Mapped Location

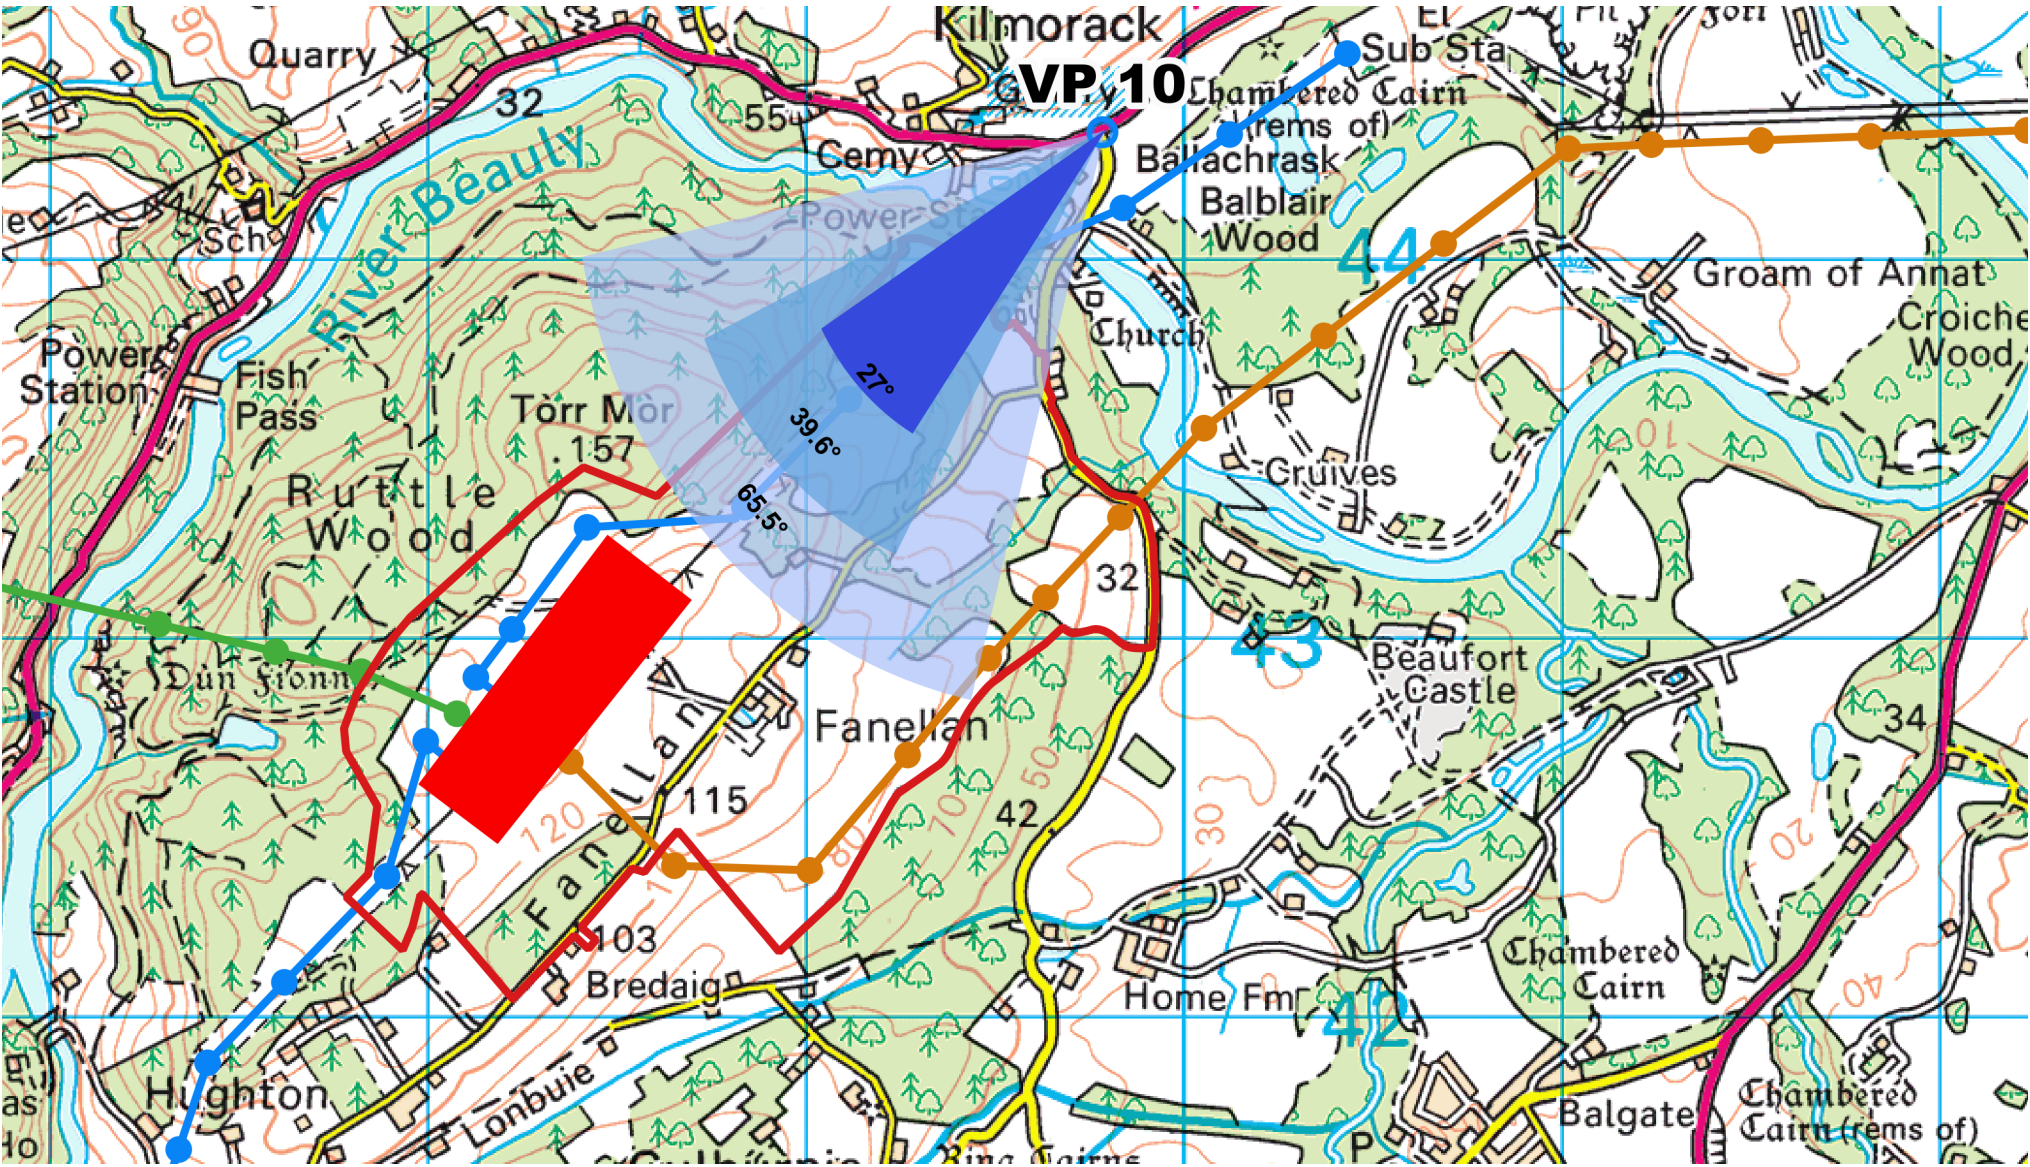

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulie to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulie 400 kV Overhead Line (SLBB)
 - Proposed Beaulie to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21a
Viewpoint 10: View south-west from Kilmorack

Location Description:
The viewpoint is on an unnamed road, just off the A831 in Kilmorack. There is a layby adjacent for parking or alternatively there is a layby just south of the viewpoint area.


Camera Location



Location Data

| | |
|--------------------------|---------------|
| OSGB36 Location: | 249785 844337 |
| AOD: | 33m |
| Camera Height: | 1.5m |
| Distance to Development: | 2669m |



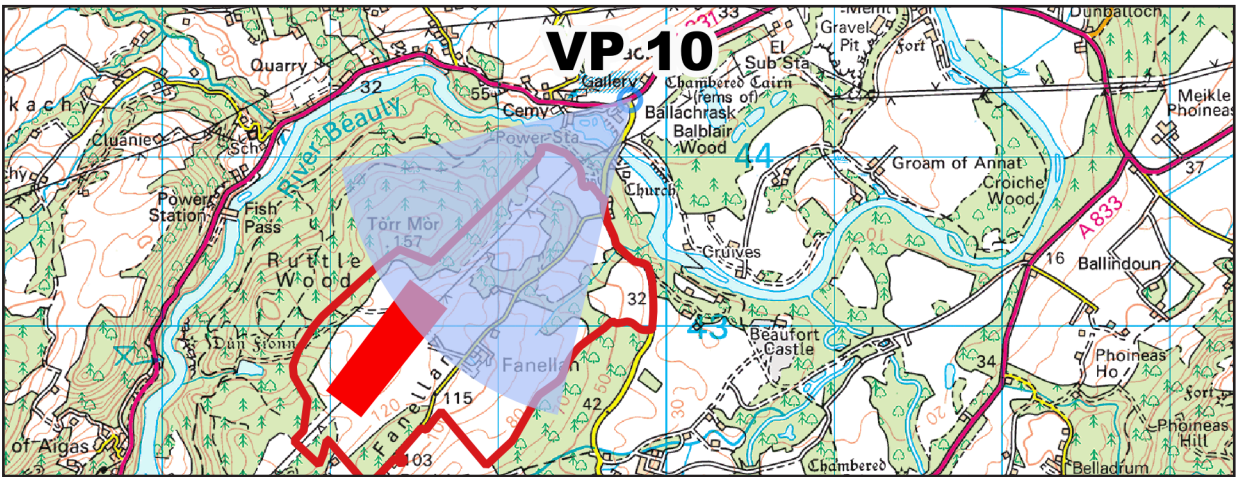

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21b
Viewpoint 10: View south-west from Kilmorack

Operational View (Baseline) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beaulieu to the south at Black Bridge.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.



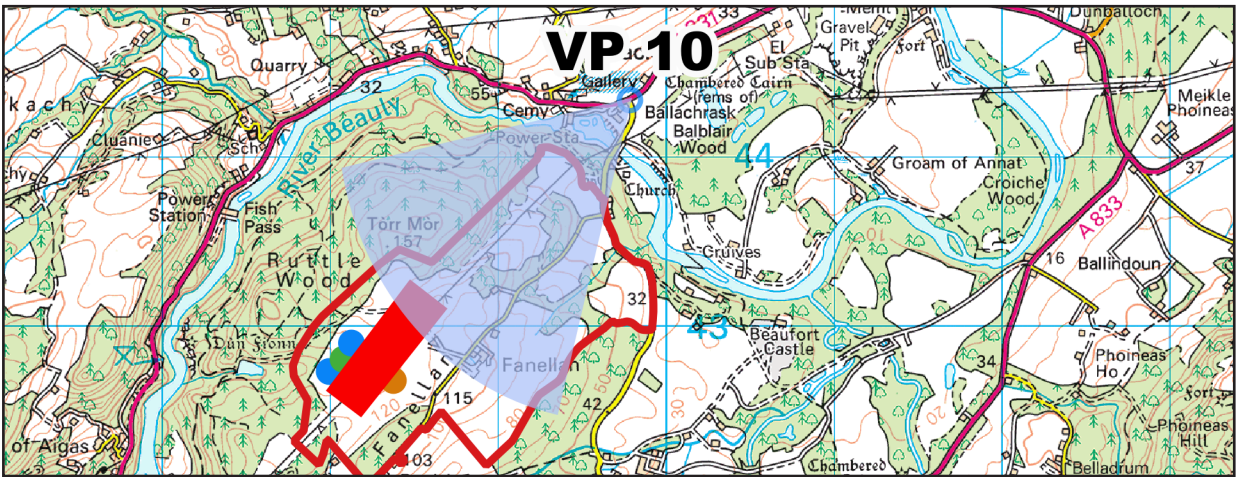

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21c
Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024


Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beaulieu to the south at Black Bridge.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)



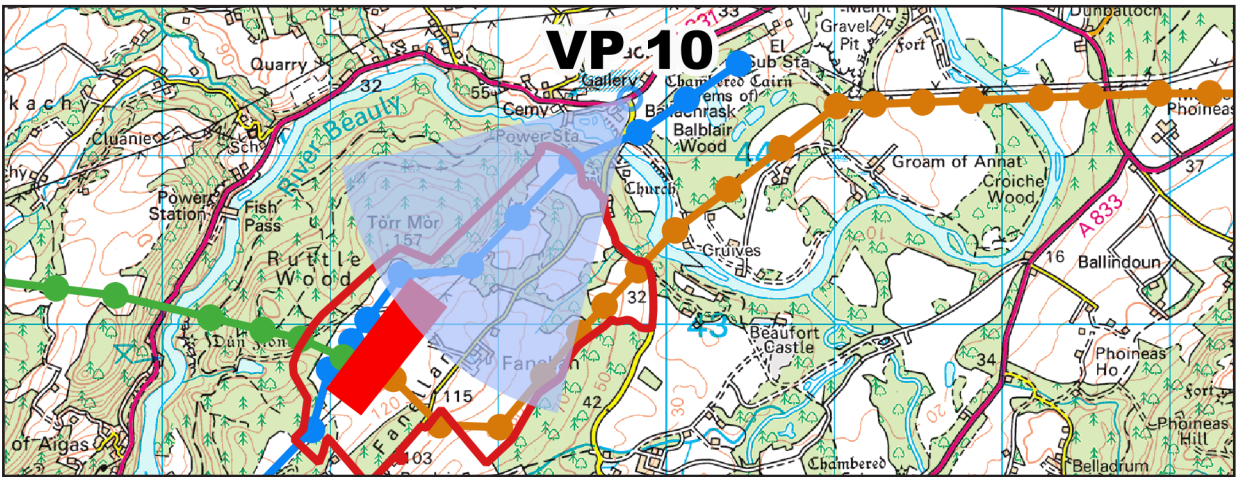

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21d
Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beaulie to the south at Black Bridge.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulie to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulie 400 kV Overhead Line (SLBB)
 - Proposed Beaulie to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



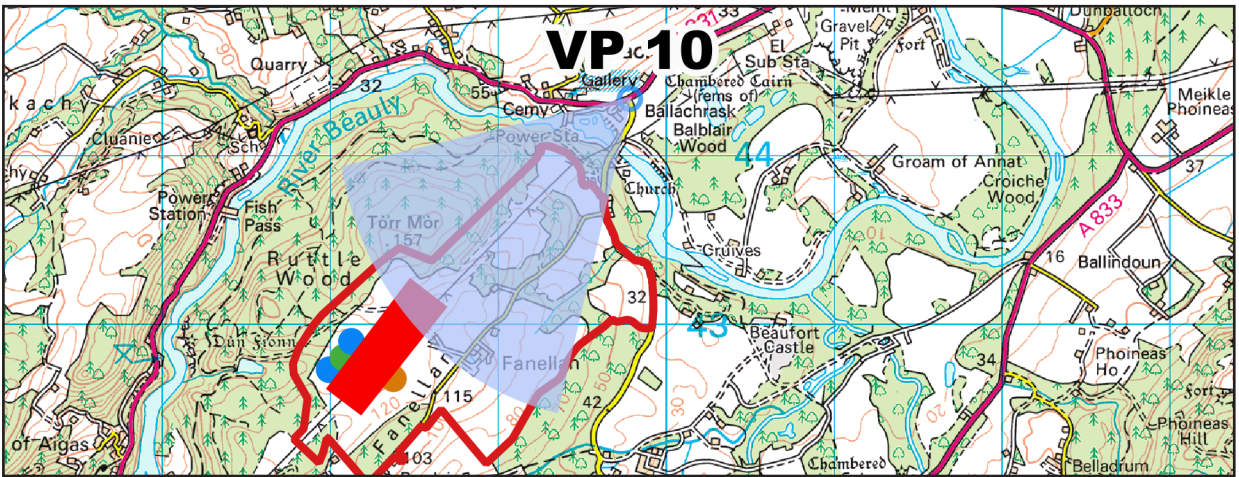

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21e
Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beaulieu to the south at Black Bridge.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



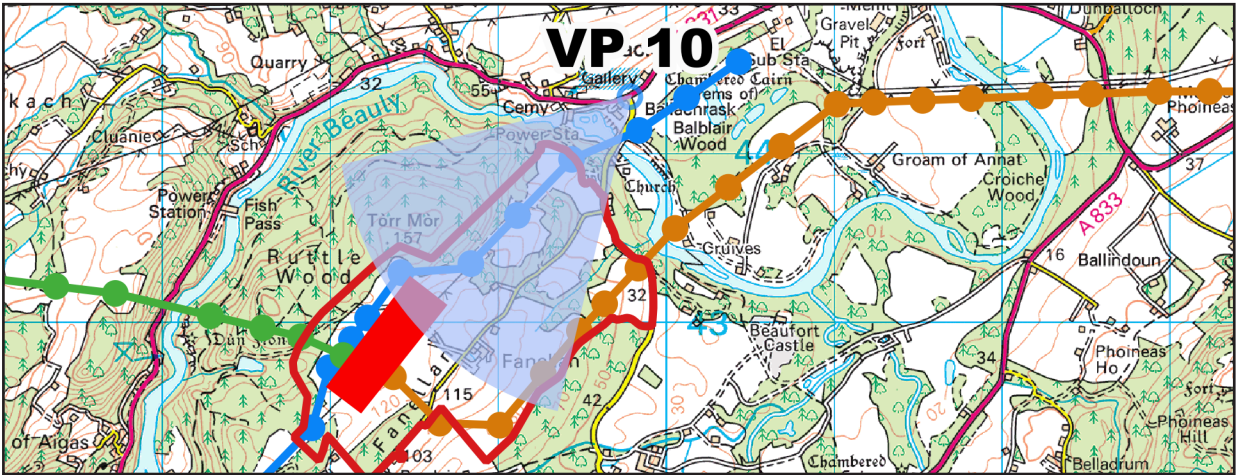

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21f
Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beauly to the south at Black Bridge.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

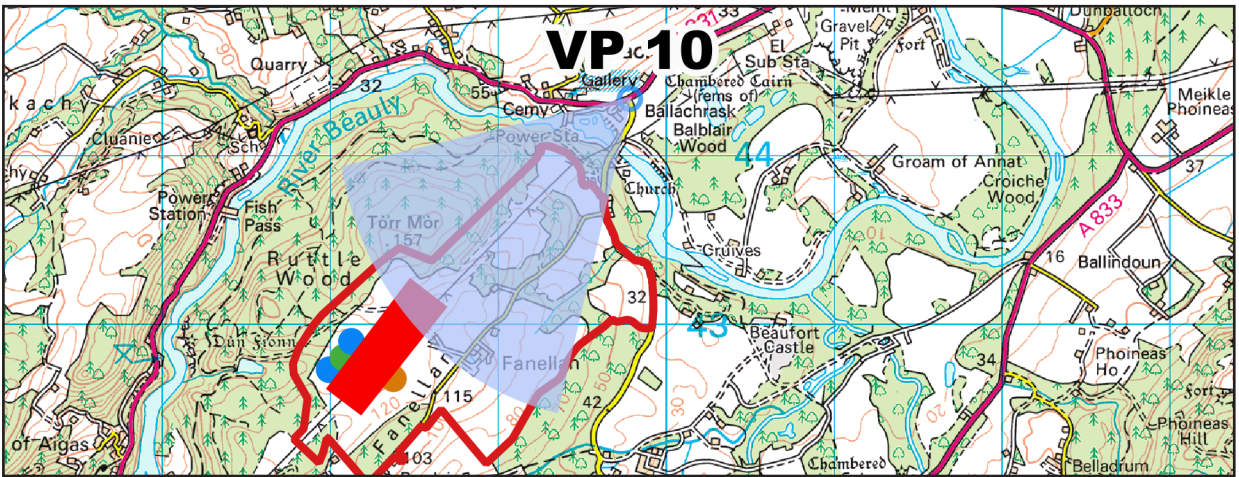

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21g
Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226° (South-West)

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beaulieu to the south at Black Bridge.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



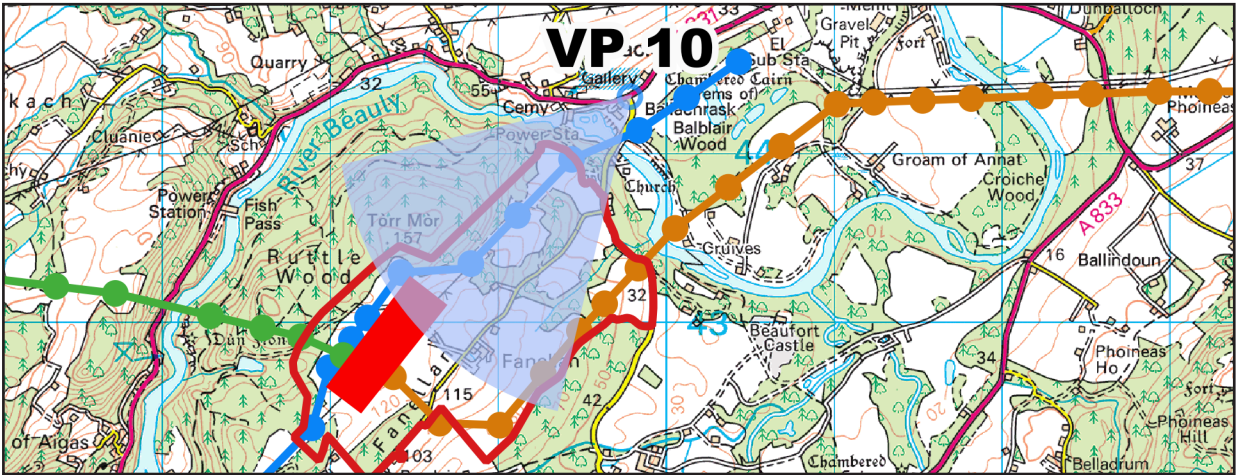

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.21h
Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 249785, Y 844337
AOD: 33m
Distance to Development and Direction of view: 2669m, 226°
(South-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptor list: Residents at Kilmorack. Users of the A831. Users of the rural road corridor that crosses the River Beauly to the south at Black Bridge.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-i Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-j Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-k Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-I Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-m Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-n Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-o Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm


Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

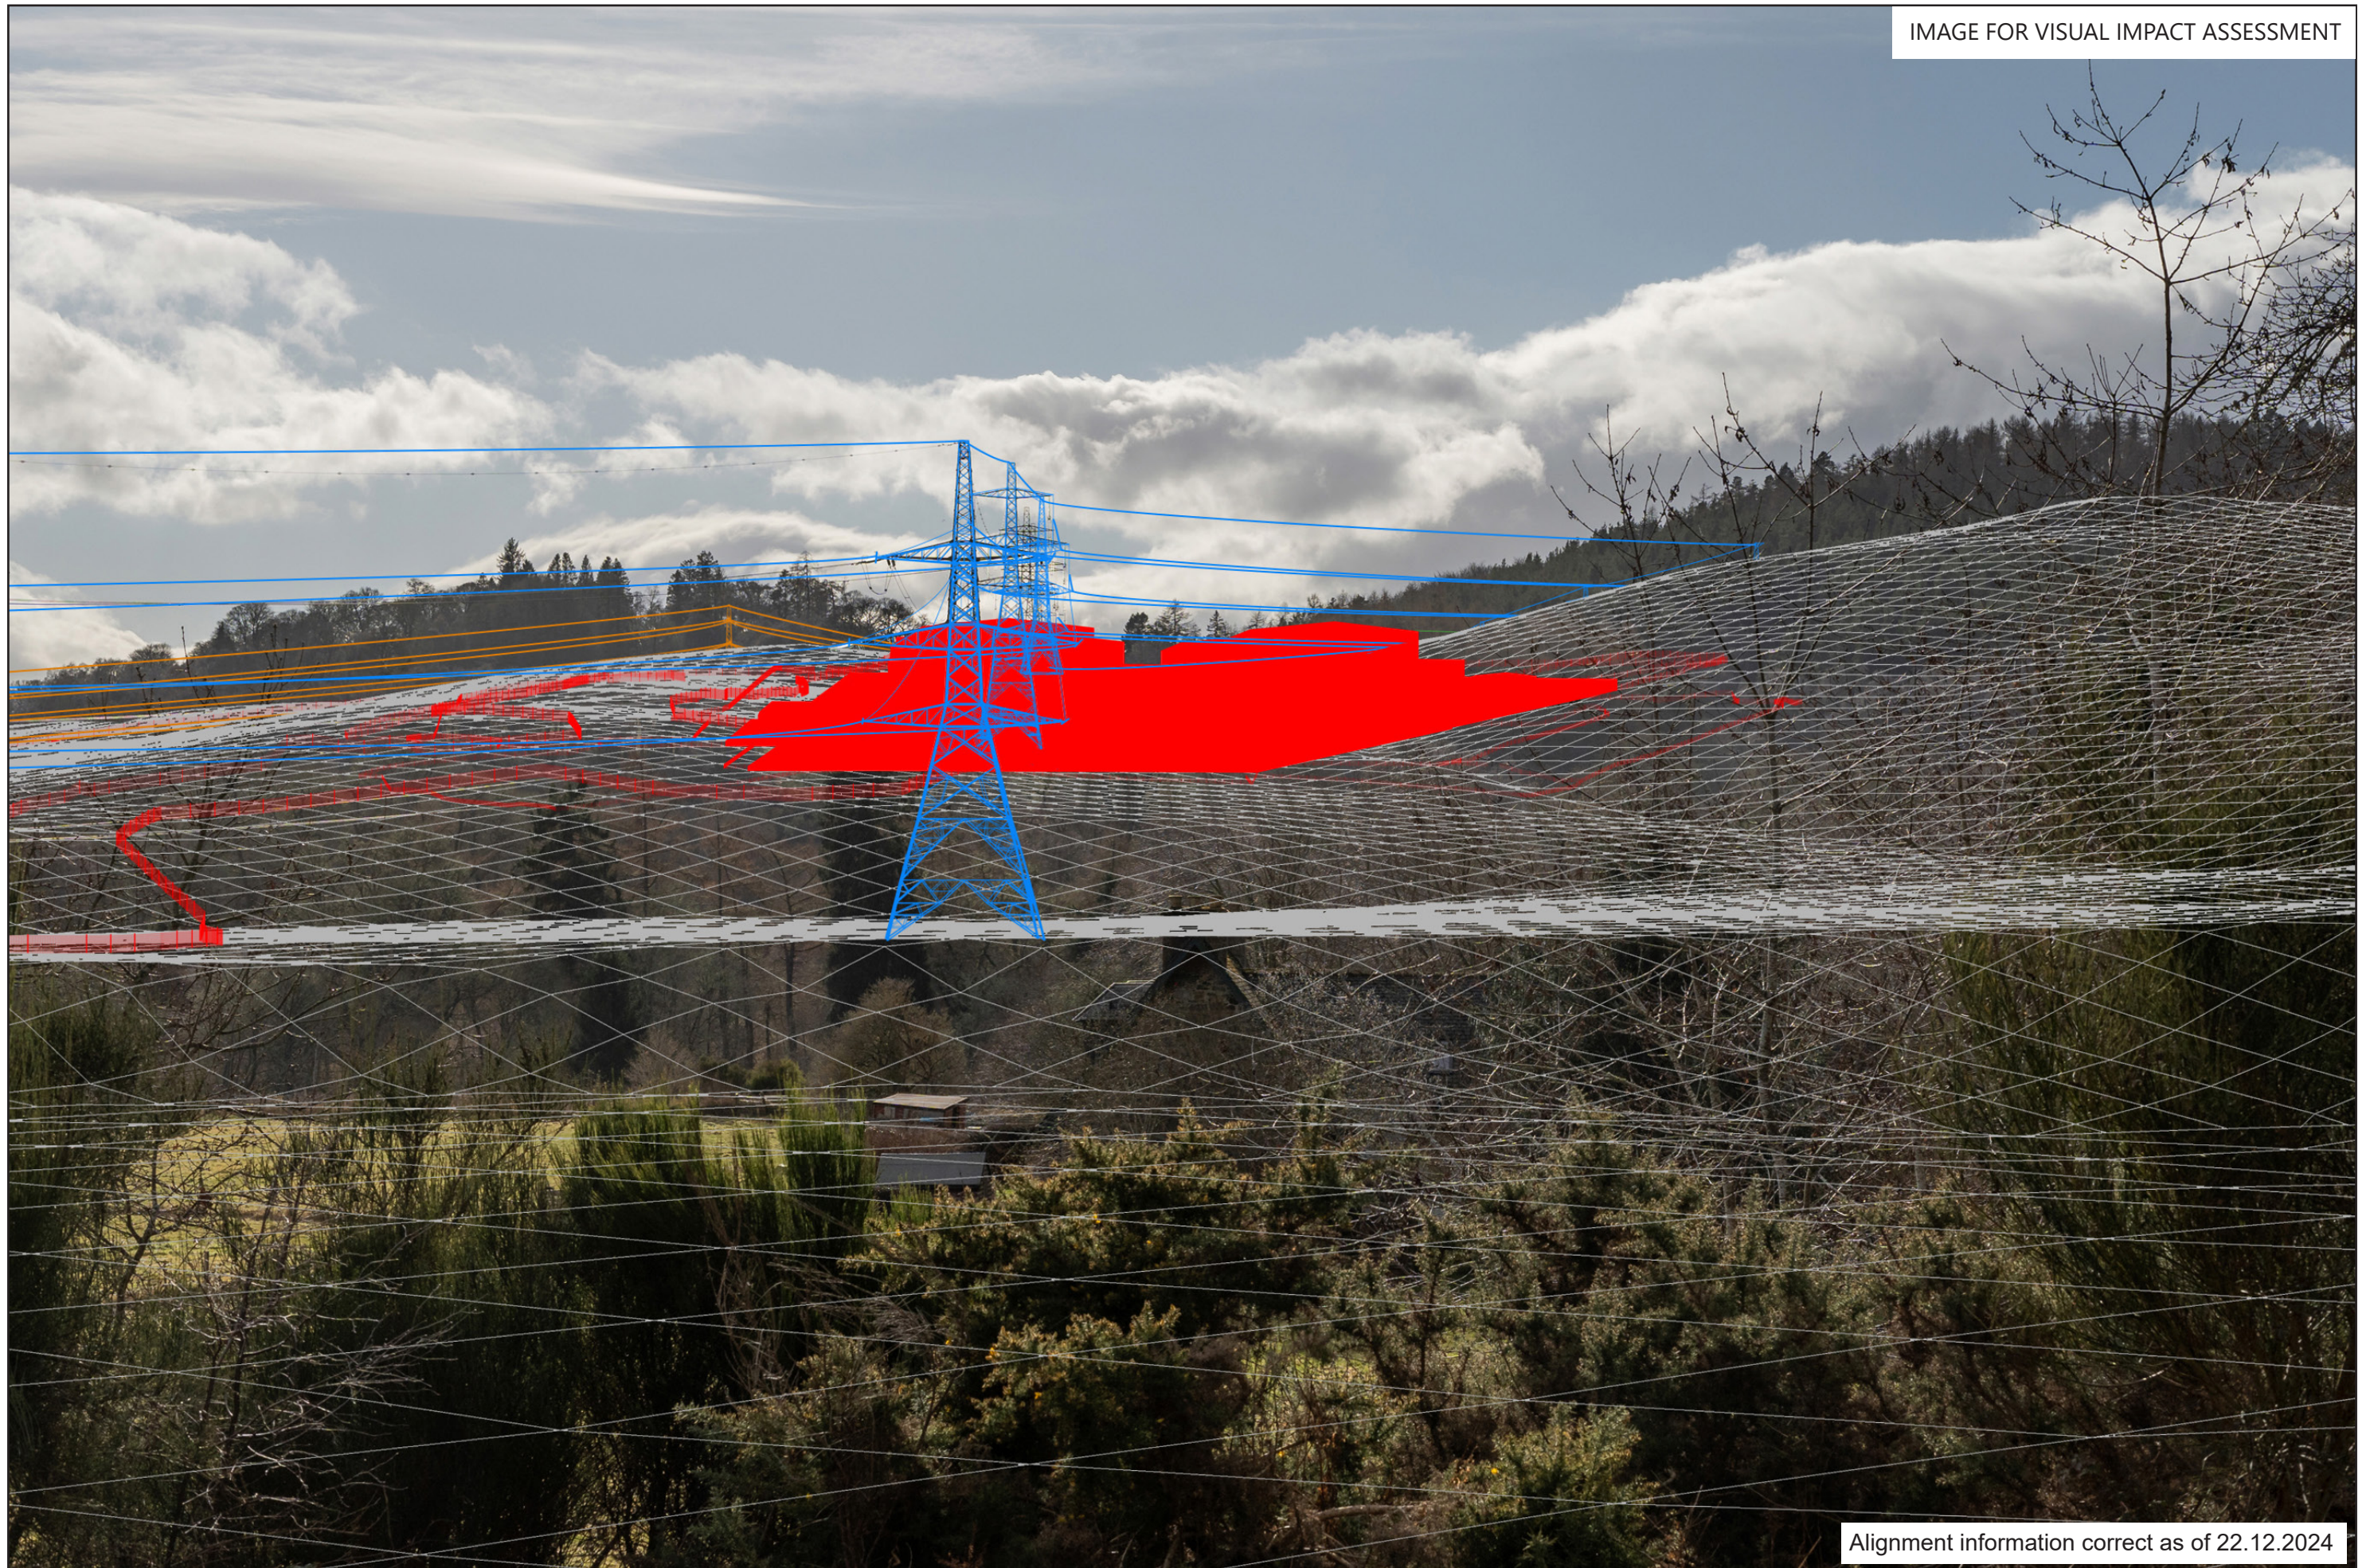

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-p Viewpoint 10: View south-west from Kilmorack

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 75mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-q Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-r Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 75mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-s Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.21-t Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 15) - 75mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION