


Mapped Location

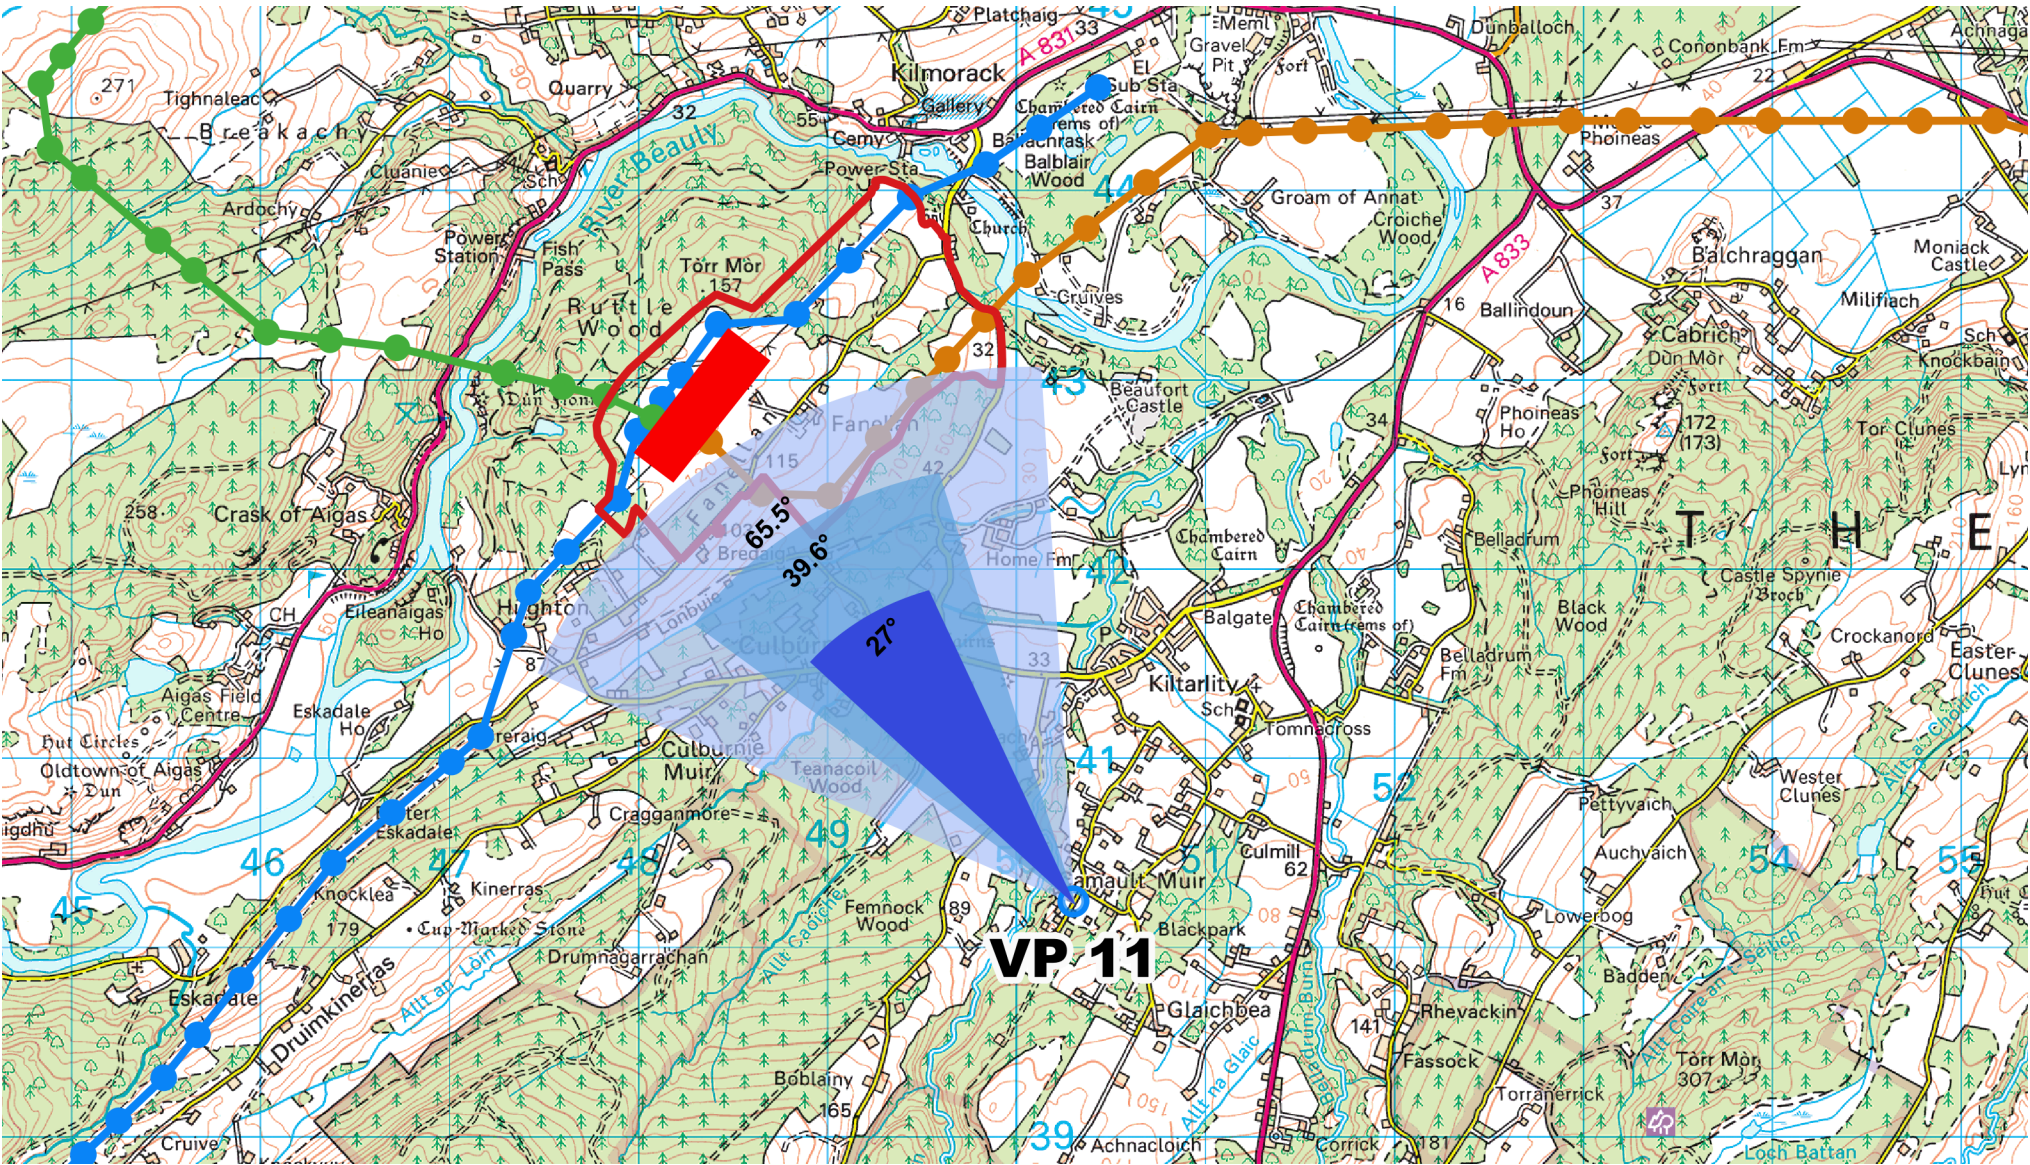

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22a
Viewpoint 11: View north-west from Camault Muir and Glaichbea


Location Description:
The viewpoint is on Loaneckhaim, Kiltarlity. Parking is available just south of the viewpoint in Highland Liliums Garden Centre.

Camera Location



Location Data

| | |
|--------------------------|---------------|
| OSGB36 Location: | 250302 840242 |
| AOD: | 88m |
| Camera Height: | 1.5m |
| Distance to Development: | 3101m |

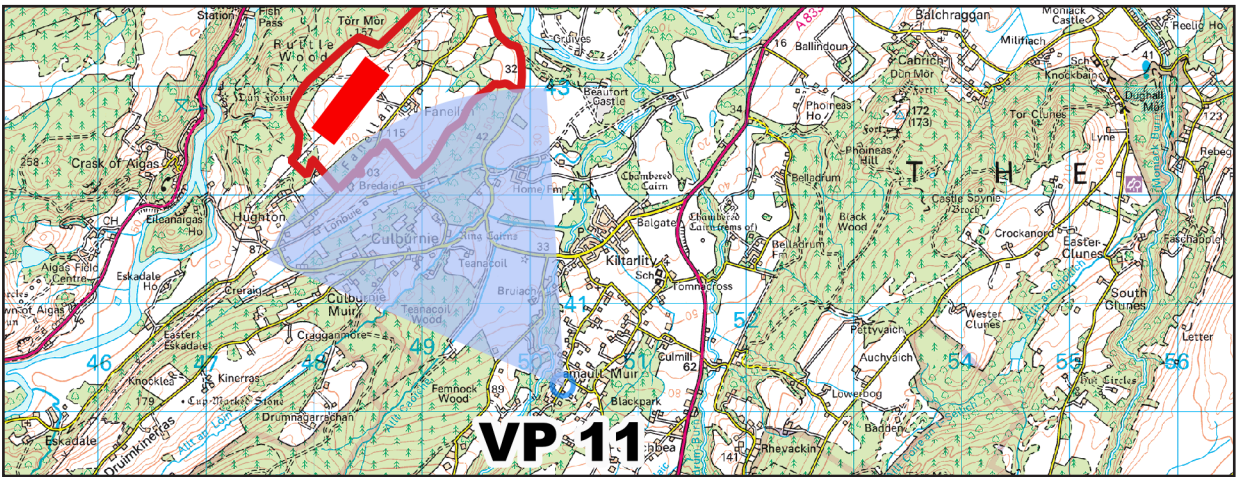

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22b
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Baseline) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



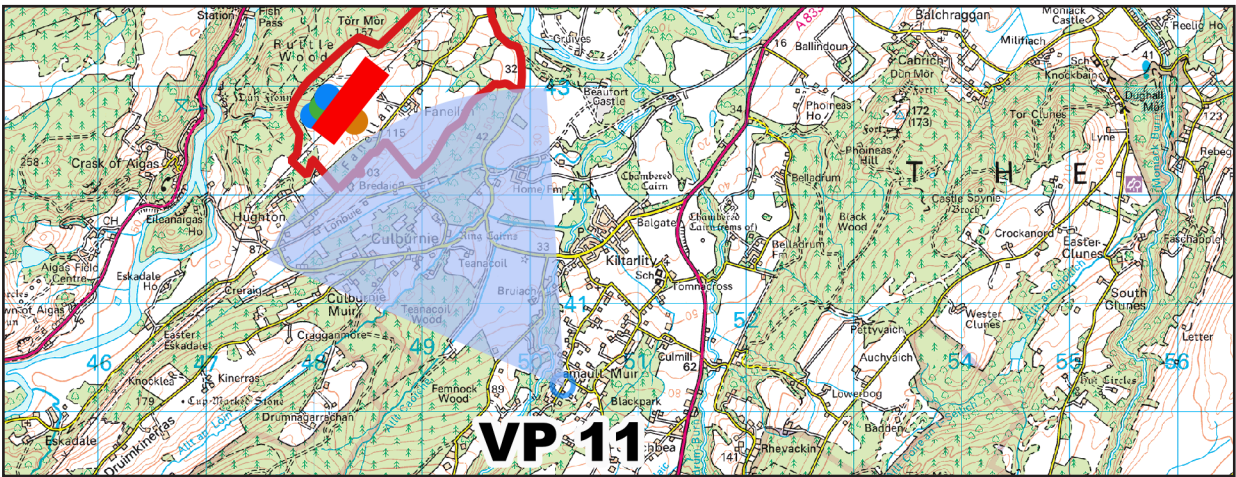

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22c
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



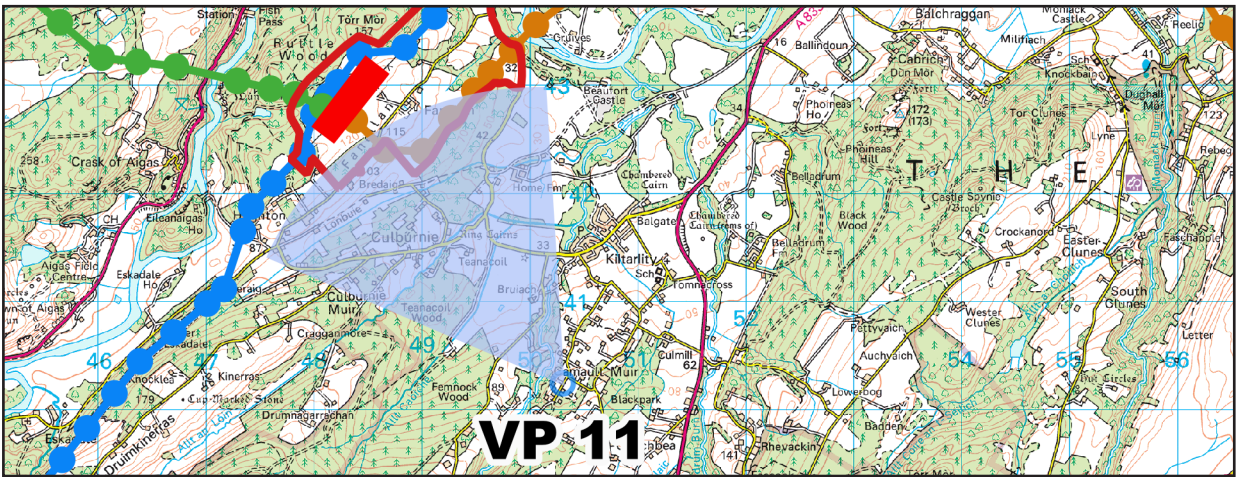

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22d
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photowire: SSEN Cumulative Overhead
Line Schemes Only) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



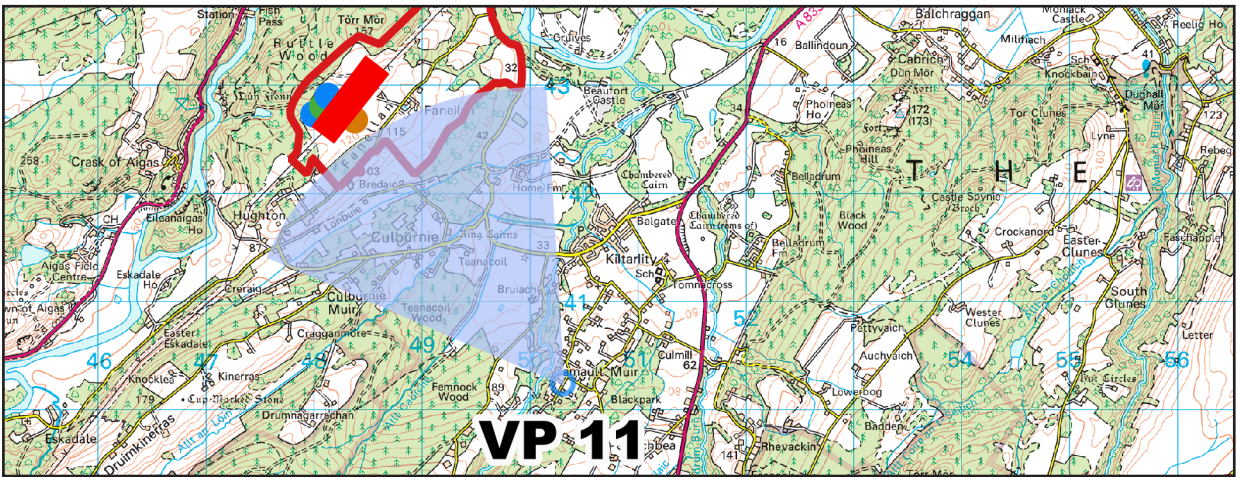

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22e
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)


Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

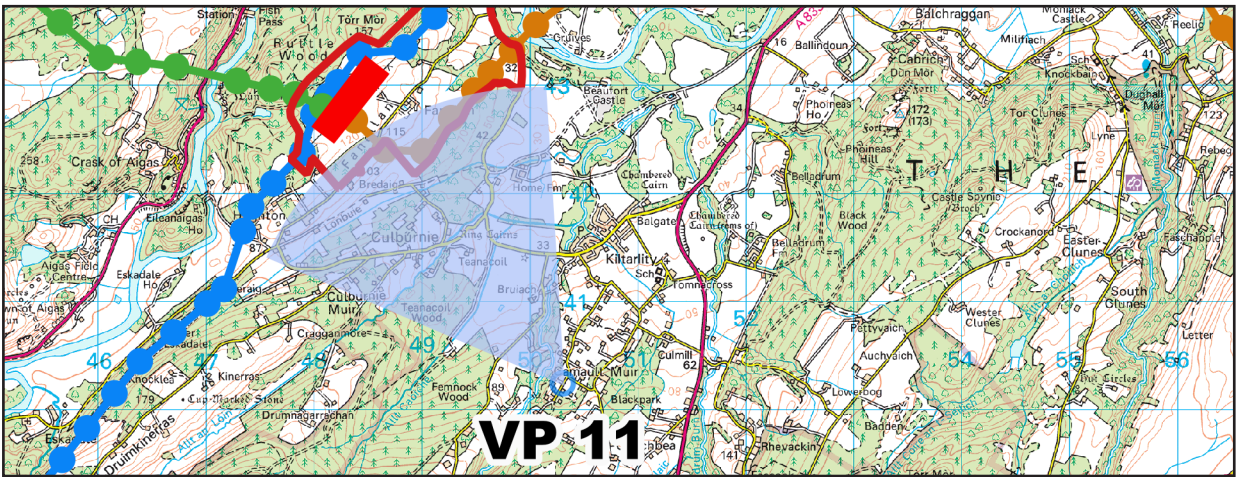

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22f
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)


Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

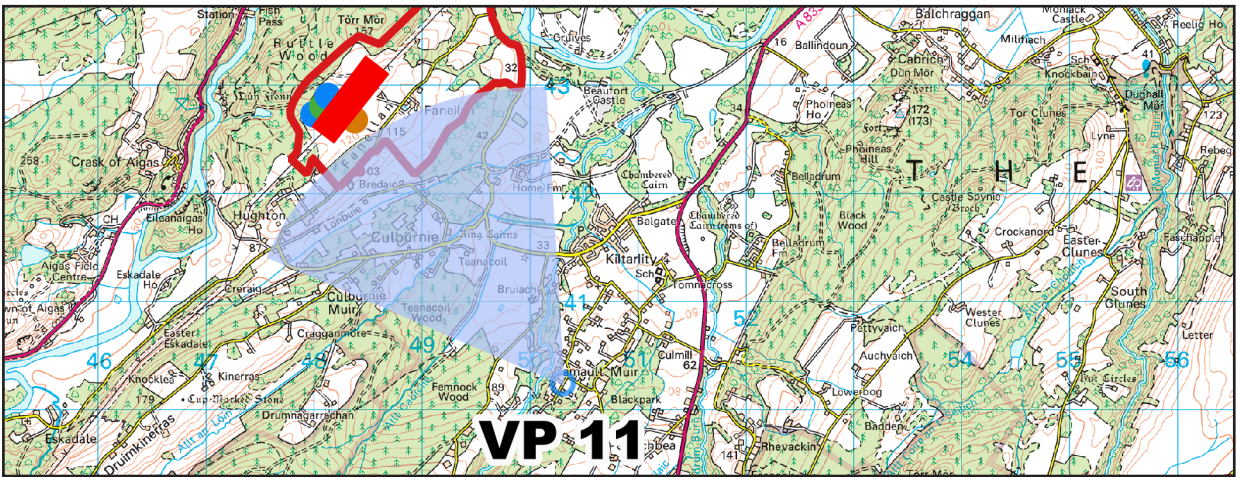

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22g
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photomontage: Fanellan 400kV
Substation & Converter Station & SSEN Cumulative
Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



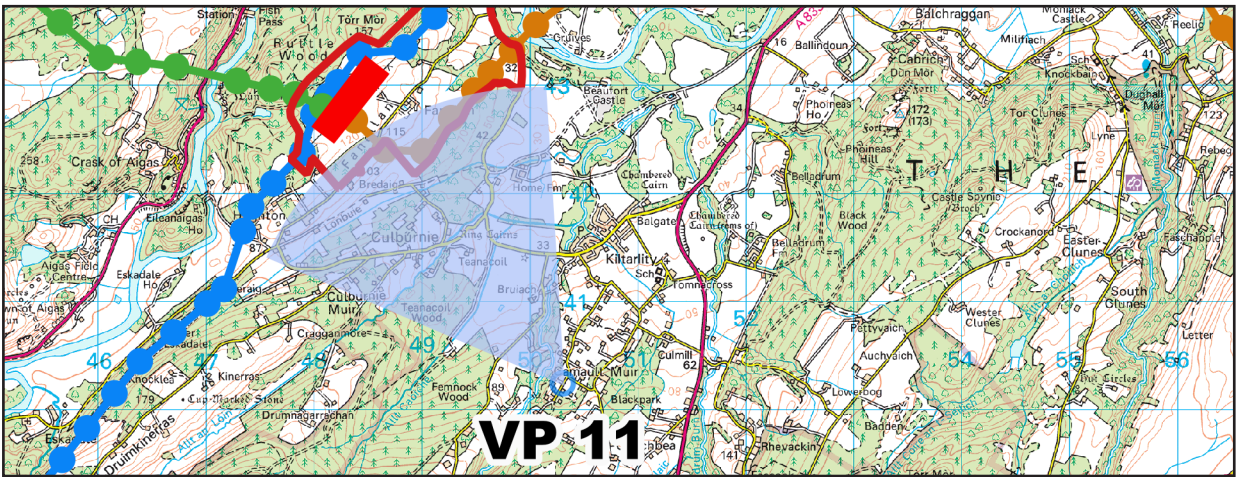

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.22h
Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Operational View (Photomontage: SSEN Cumulative
Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-i Viewpoint 11: View north-west from Camault Muir and Glaihbea

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-j Viewpoint 11: View north-west from Camault Muir and Glaiachea

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-k Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-I Viewpoint 11: View north-west from Camault Muir and Glaiachbea

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-m Viewpoint 11: View north-west from Camault Muir and Glachbea

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-n Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-o Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm


Viewpoint Location: X 250302, Y 840242 AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION

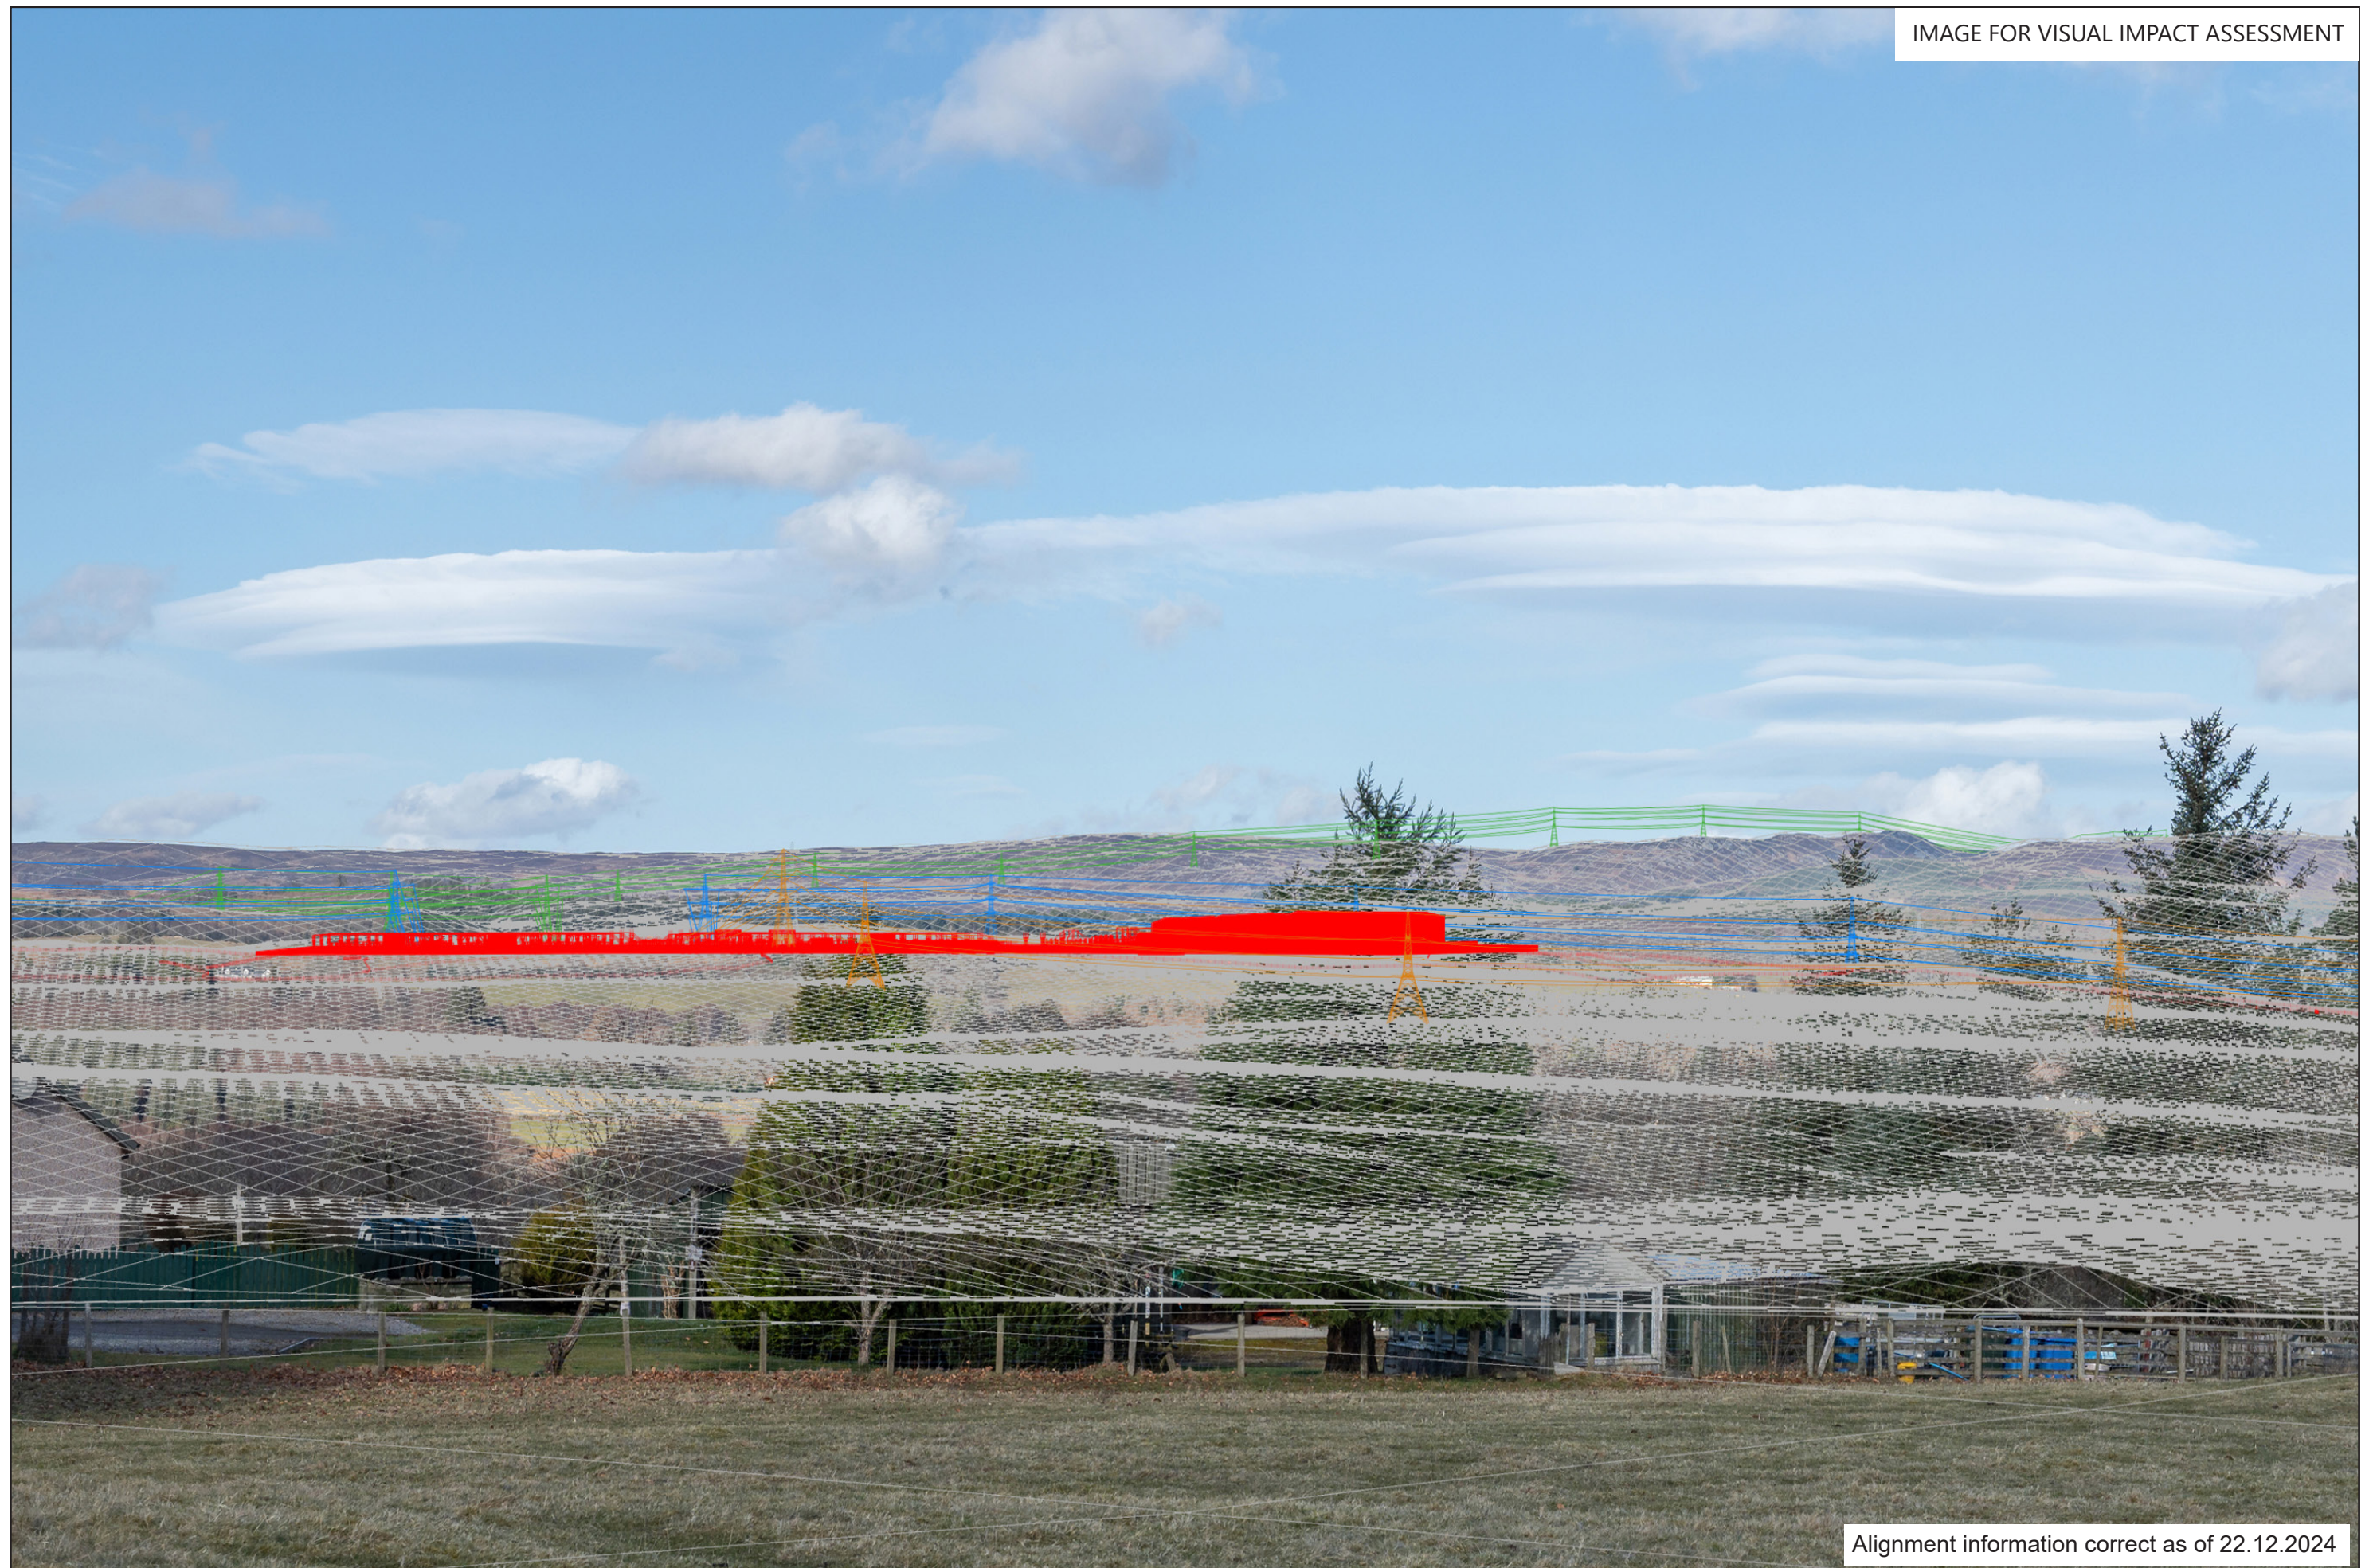

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-p Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photowire: SSN Cumulative Overhead Line Schemes Only)
 - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-q Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-r Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-s Viewpoint 11: View north-west from Camault Muir and Glaichbea

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.22-t Viewpoint 11: View north-west from Camault Muir and Glaiachea

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

