


Mapped Location

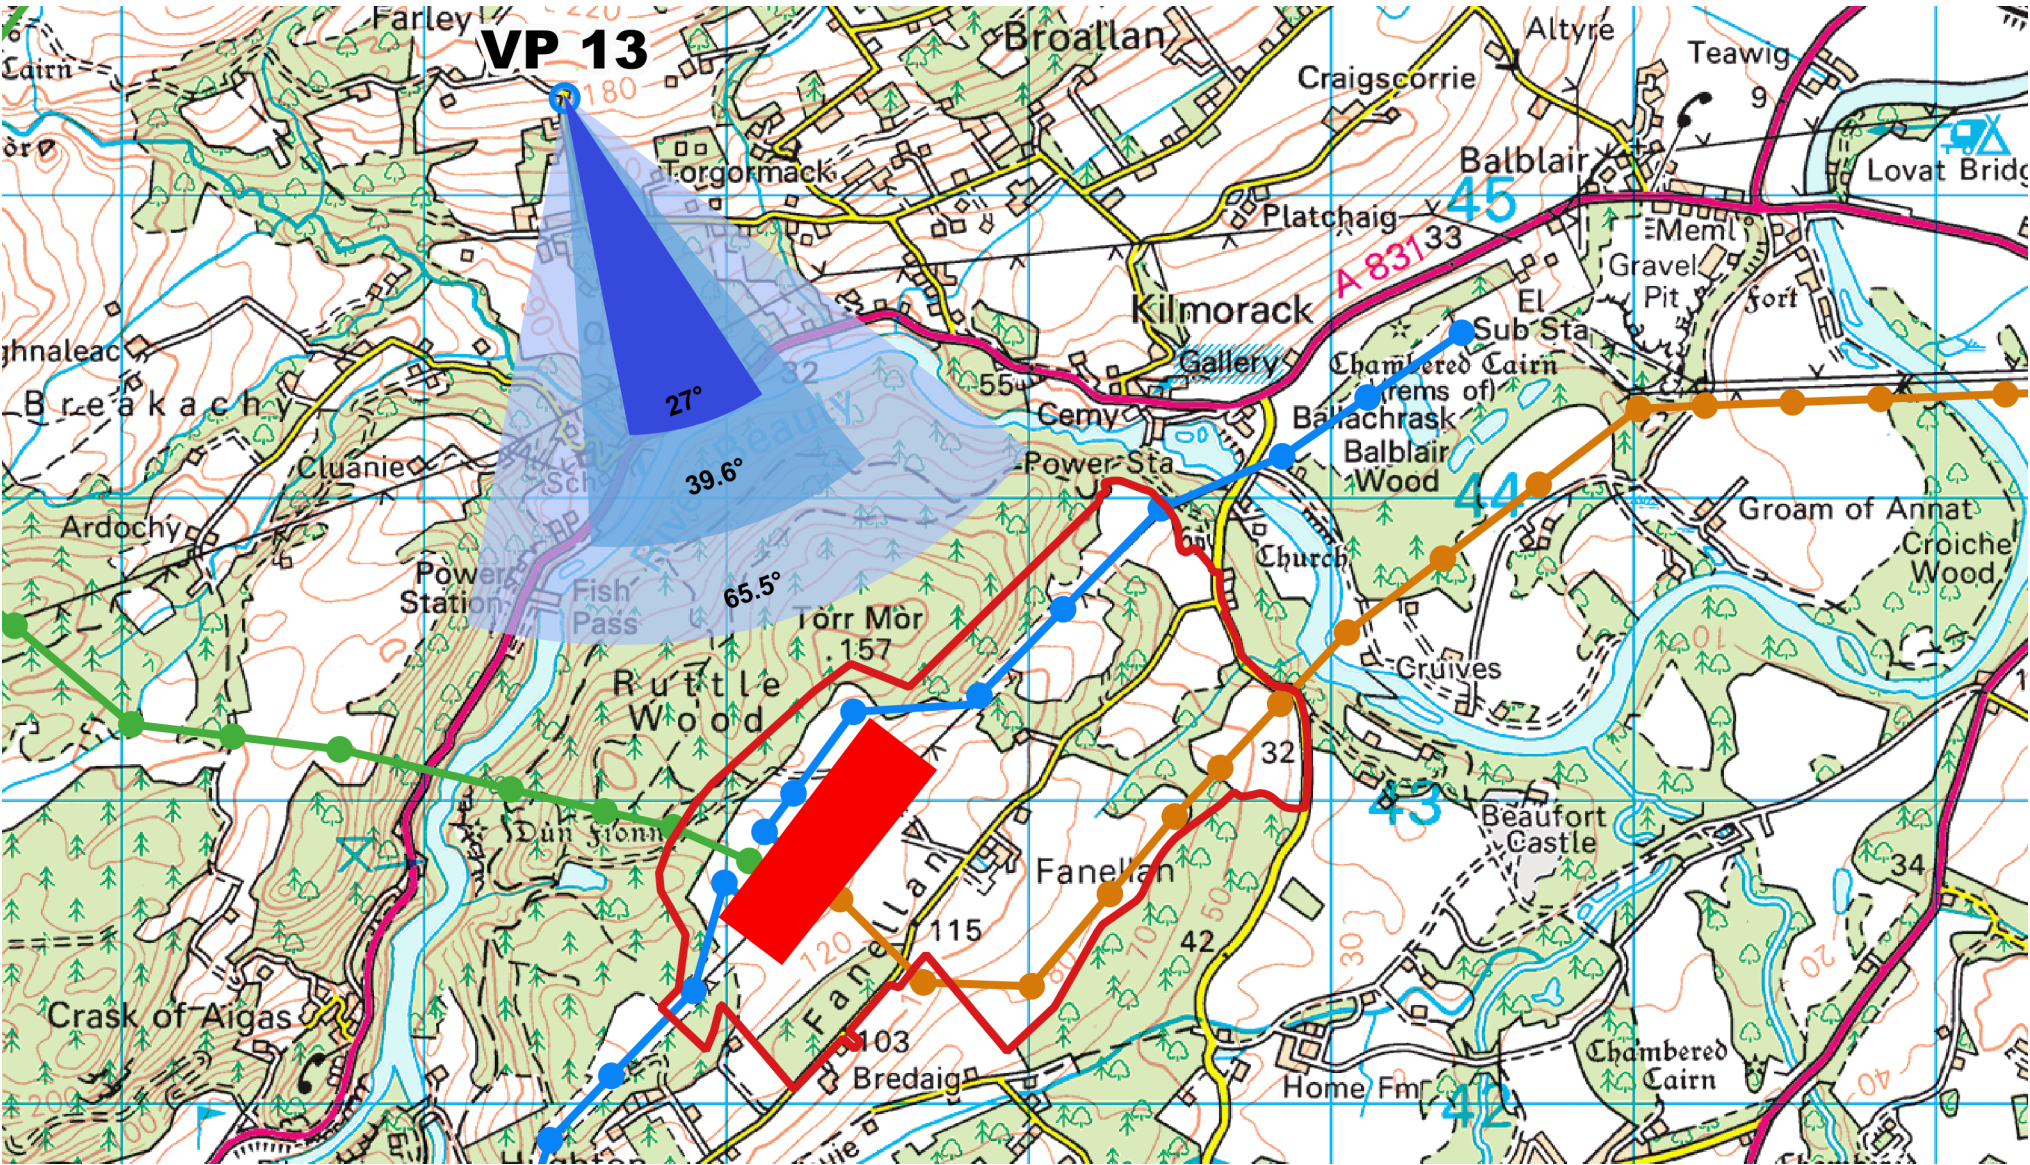

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulay to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulay 400 kV Overhead Line (SLBB)
 - Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24a
Viewpoint 13: View looking south-east from Farley


Location Description:
The viewpoint is on a bend of Farley Road and is adjacent to a large layby for parking.

Camera Location



Location Data

OSGB36 Location:	247466 845320
AOD:	172m
Camera Height:	1.5m
Distance to Development:	2293m

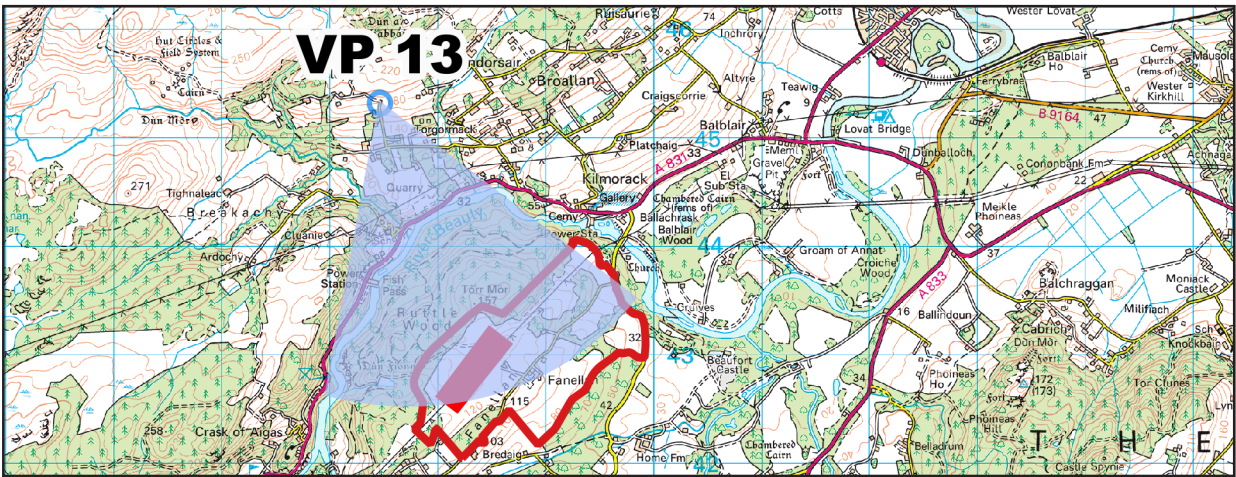

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24b
Viewpoint 13: View looking south-east from Farley

Operational View (Baseline) - 65.5°


Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

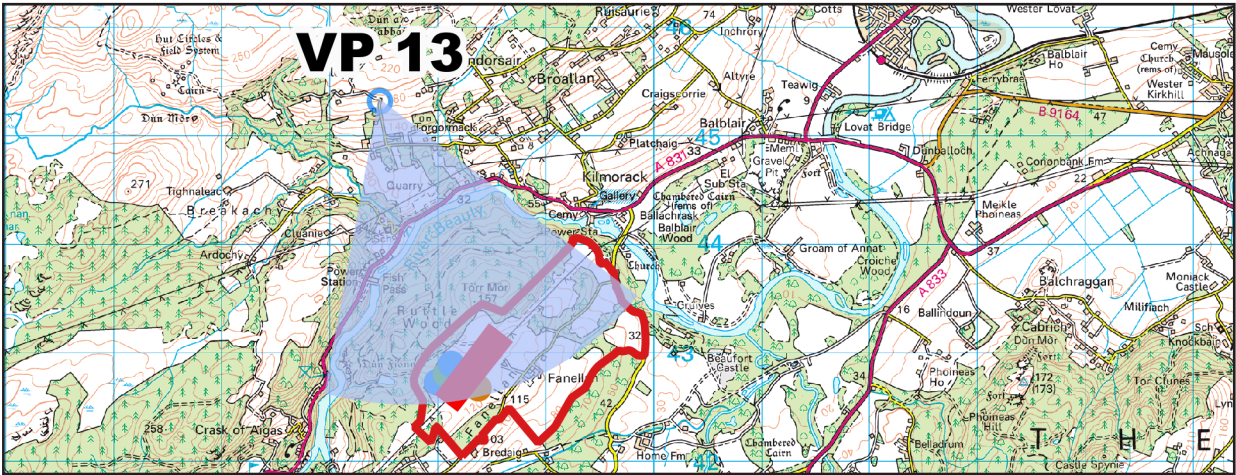

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24c
Viewpoint 13: View looking south-east from Farley

**Operational View (Photowire: Fanellan 400kV
Substation & Converter Station & SSSEN Cumulative
Terminal Towers) - 65.5°**

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*


*This visualisation has been identified and created for use with the visual impact
assessment, but can also be used to inform landscape impacts on LCT 220 Rugged
Massif-Inverness.*

*The image should be viewed at a comfortable arm's length (approximately 500mm)
and viewed normally with both eyes. The printed image is representative of the
Proposed Development, but is not representative of scale or distance.*

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



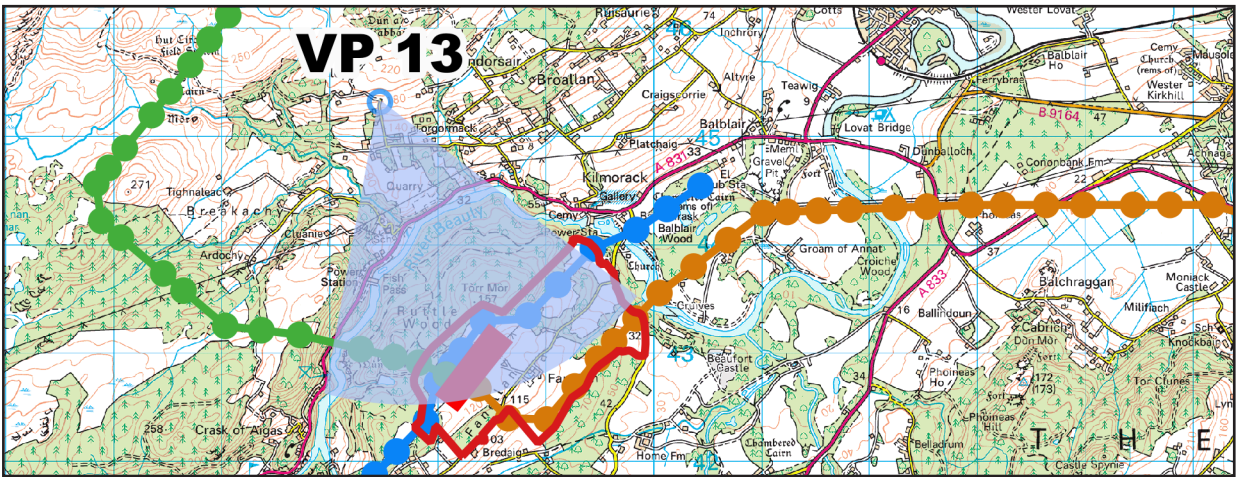

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24d
Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.


The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Fanellan 400kV Substation & Converter Station
- Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
- Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
- Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



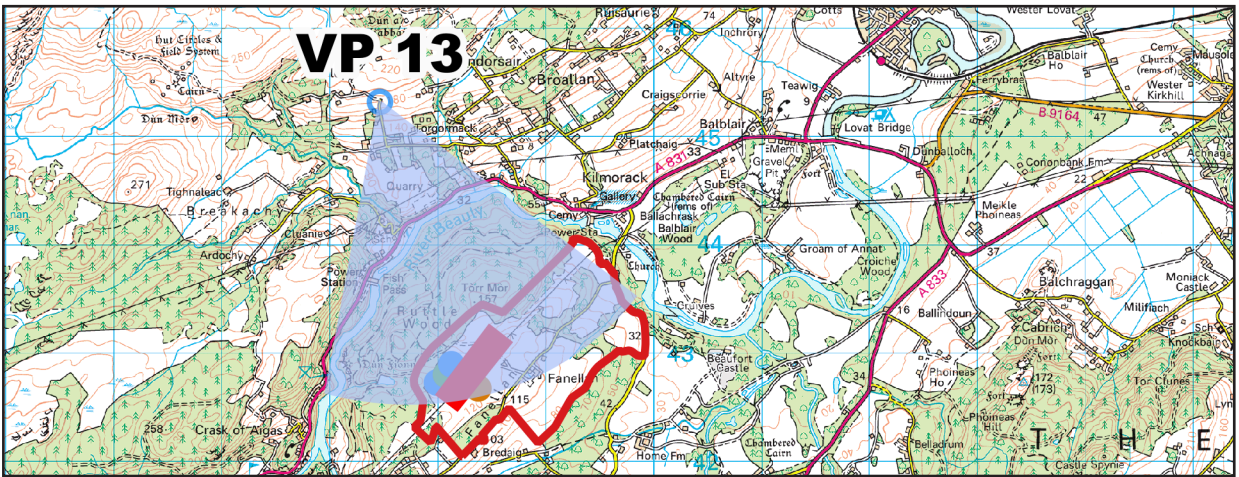

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24e
Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 65.5°

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



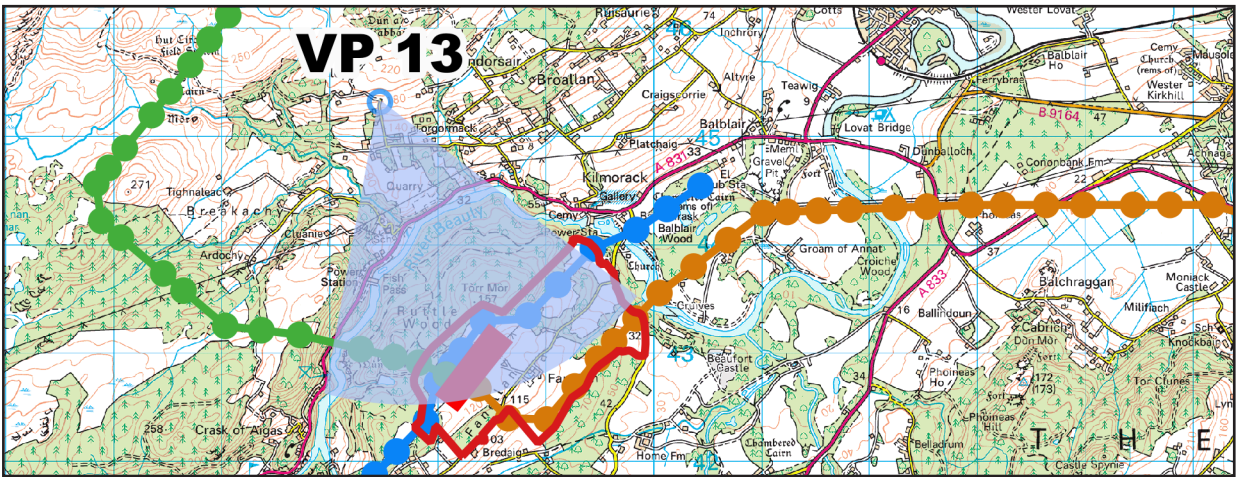

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24f
Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 65.5°

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



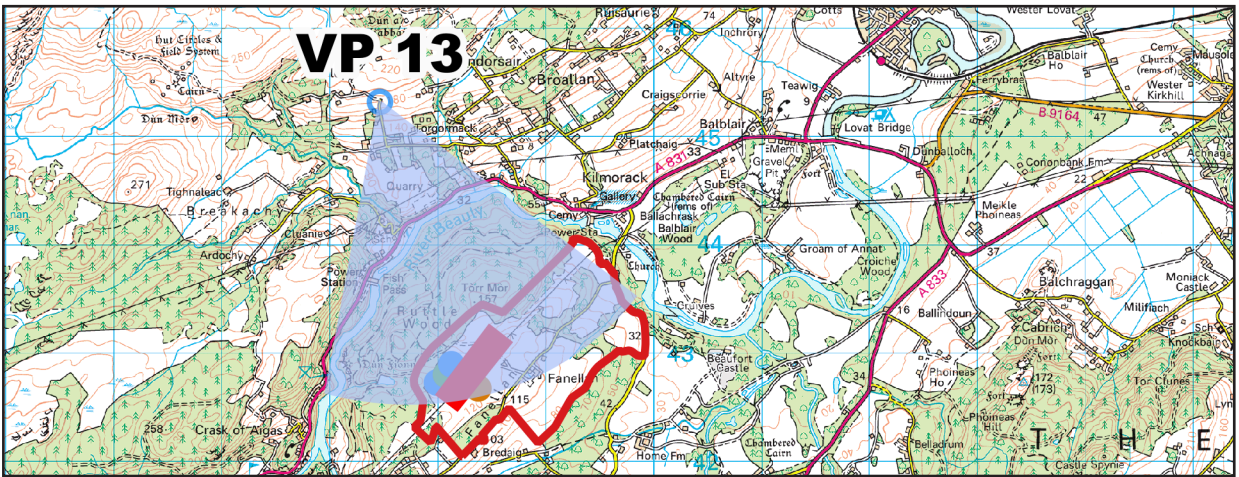

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24g
Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
(South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



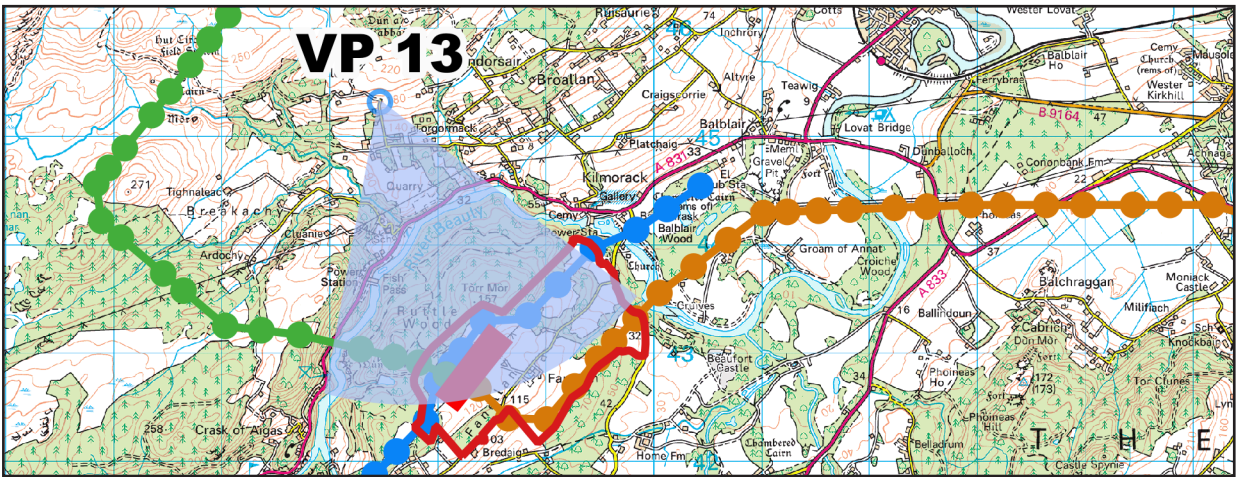

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Viewpoint Visualisations The Highland Council
Figure 8.24h
Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 65.5°

Viewpoint Location: X 247466, Y 845320
AOD: 172m
Distance to Development and Direction of view: 2293m, 160° (South-East)

*Receptors represented: Residential properties in and around Farley and Torgormack.
Users of the local road connecting Farley and Torgormack.*


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 220 Rugged Massif-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



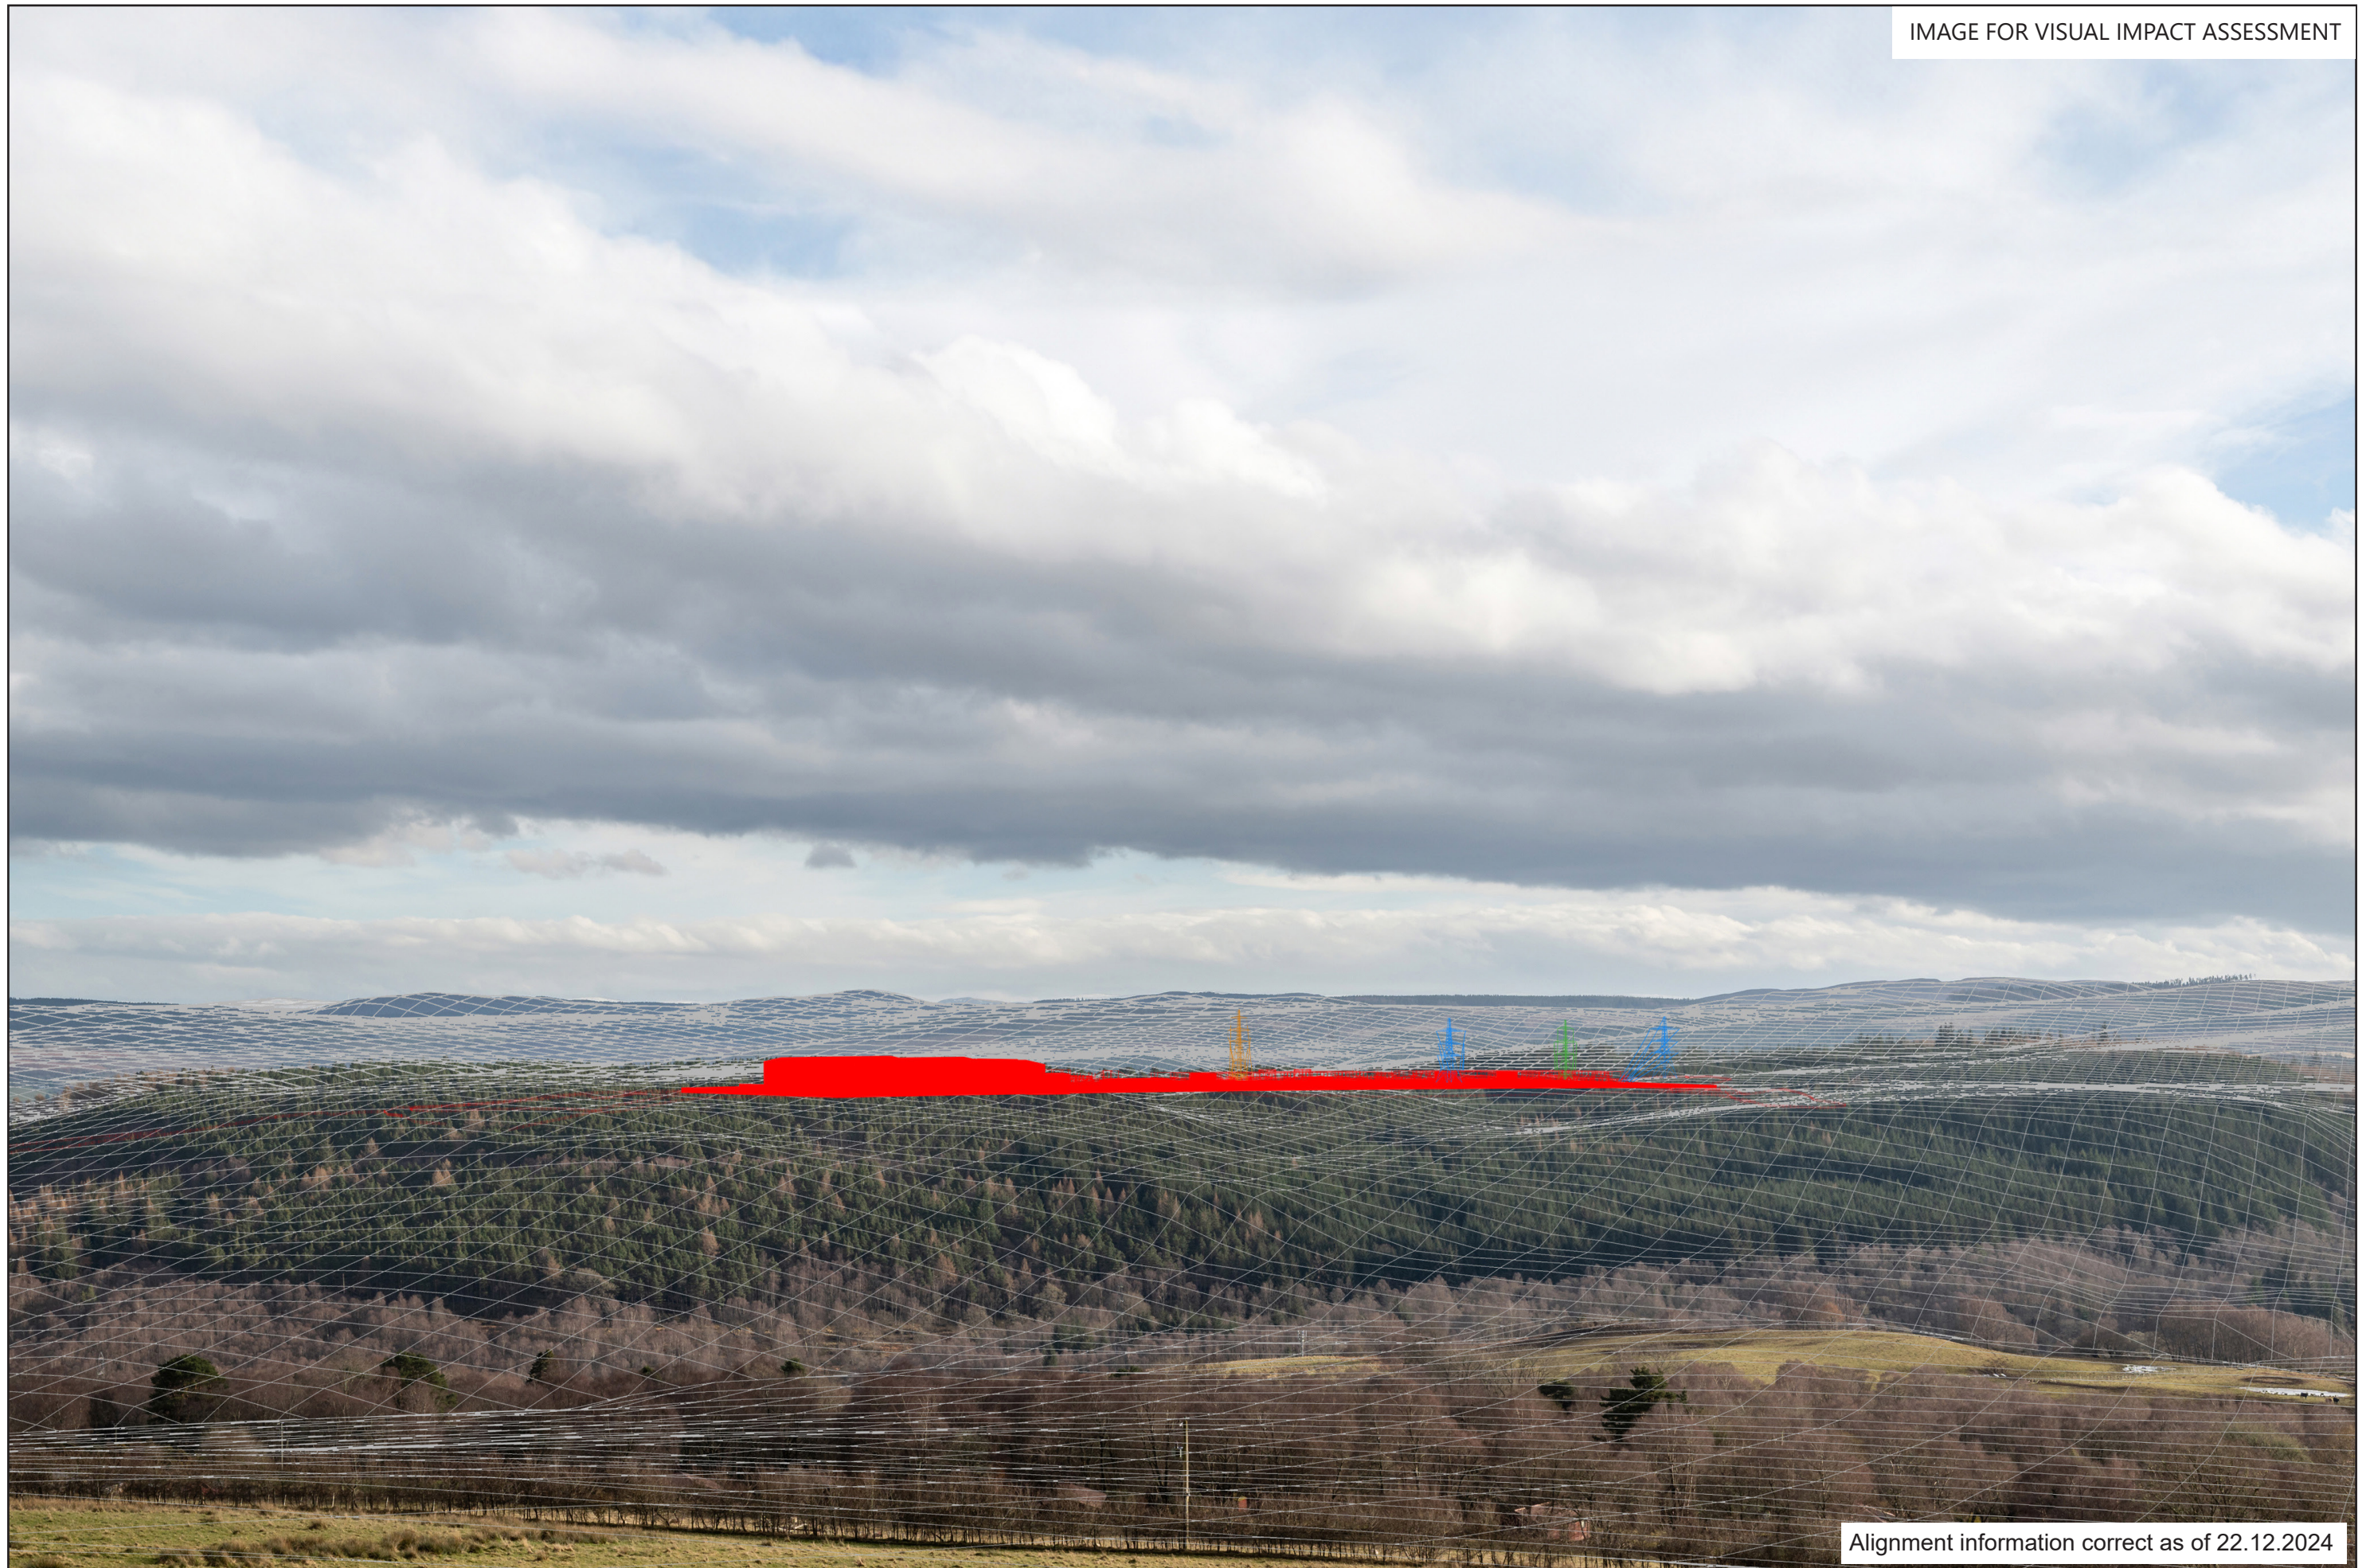

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-i Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm


Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

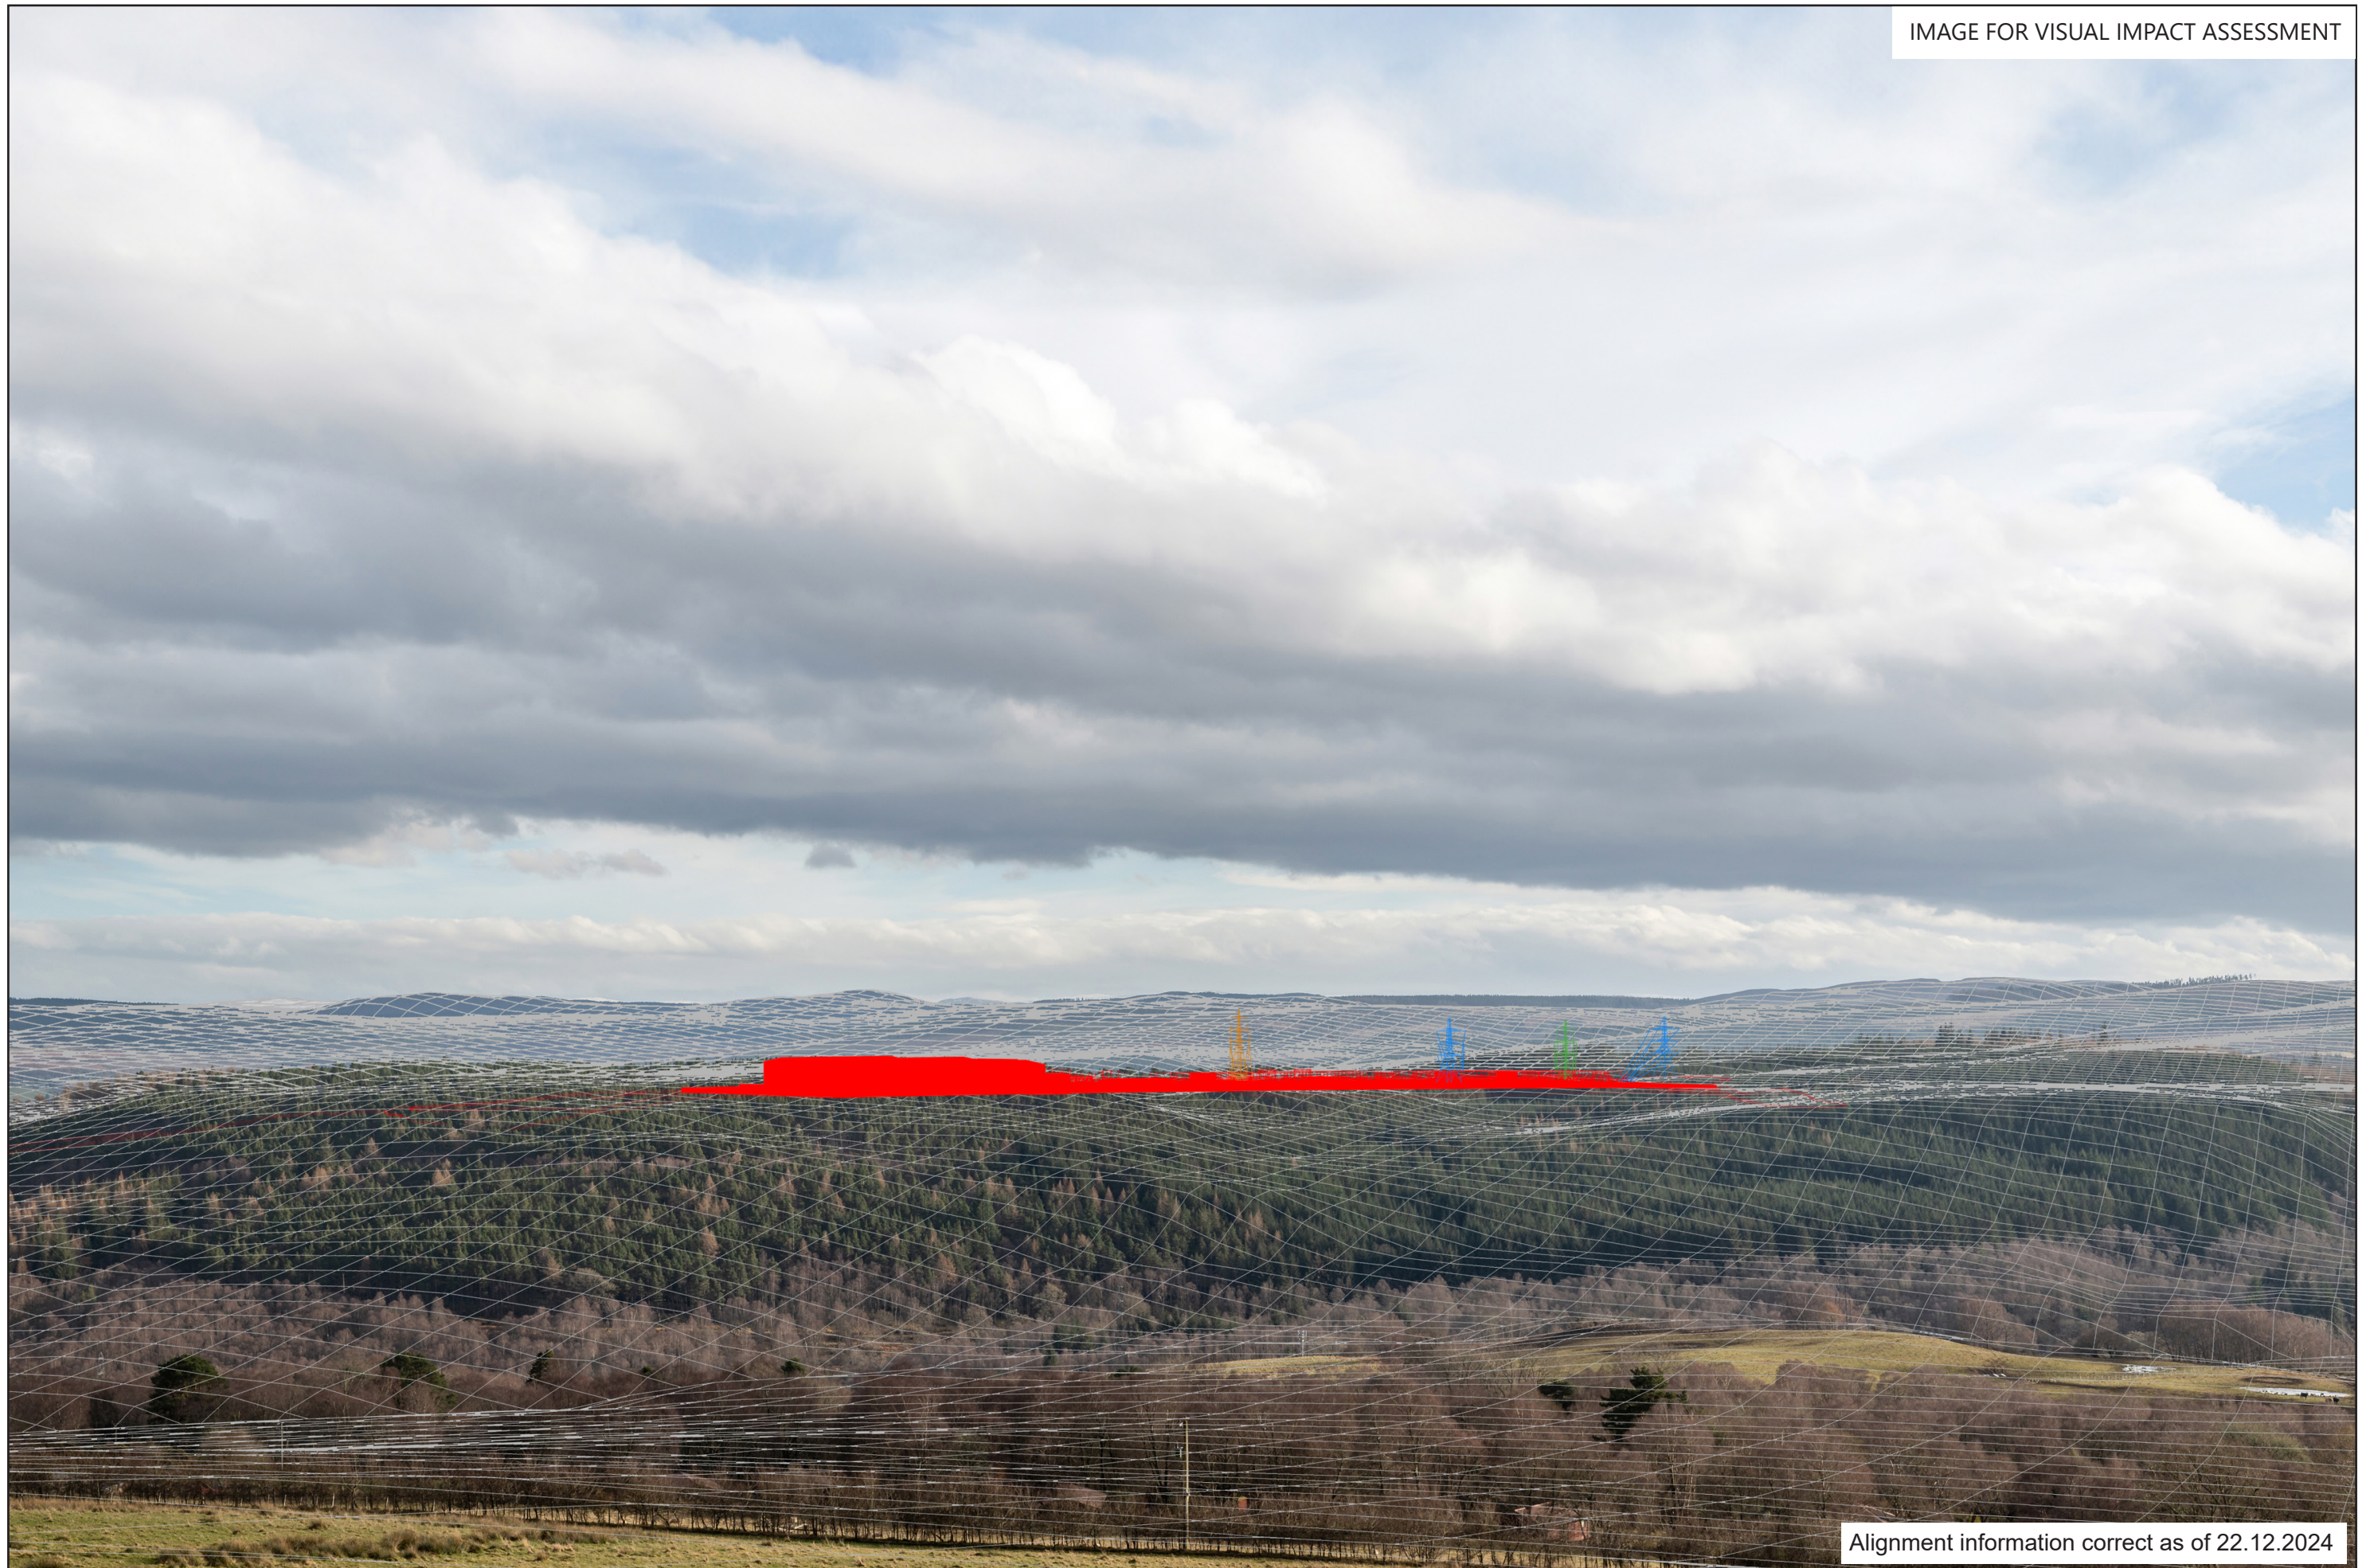

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-j Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 50mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-k Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-I Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
 Only - Year 0) - 50mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-m Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-n Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-o Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-p Viewpoint 13: View looking south-east from Farley

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)
 - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
 Distance to Development and Direction of view: 2293m, 160°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-q Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-r Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-s Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.24-t Viewpoint 13: View looking south-east from Farley

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 75mm

Viewpoint Location: X 247466, Y 845320 AOD: 172m
Distance to Development and Direction of view: 2293m, 160°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m

