


Mapped Location

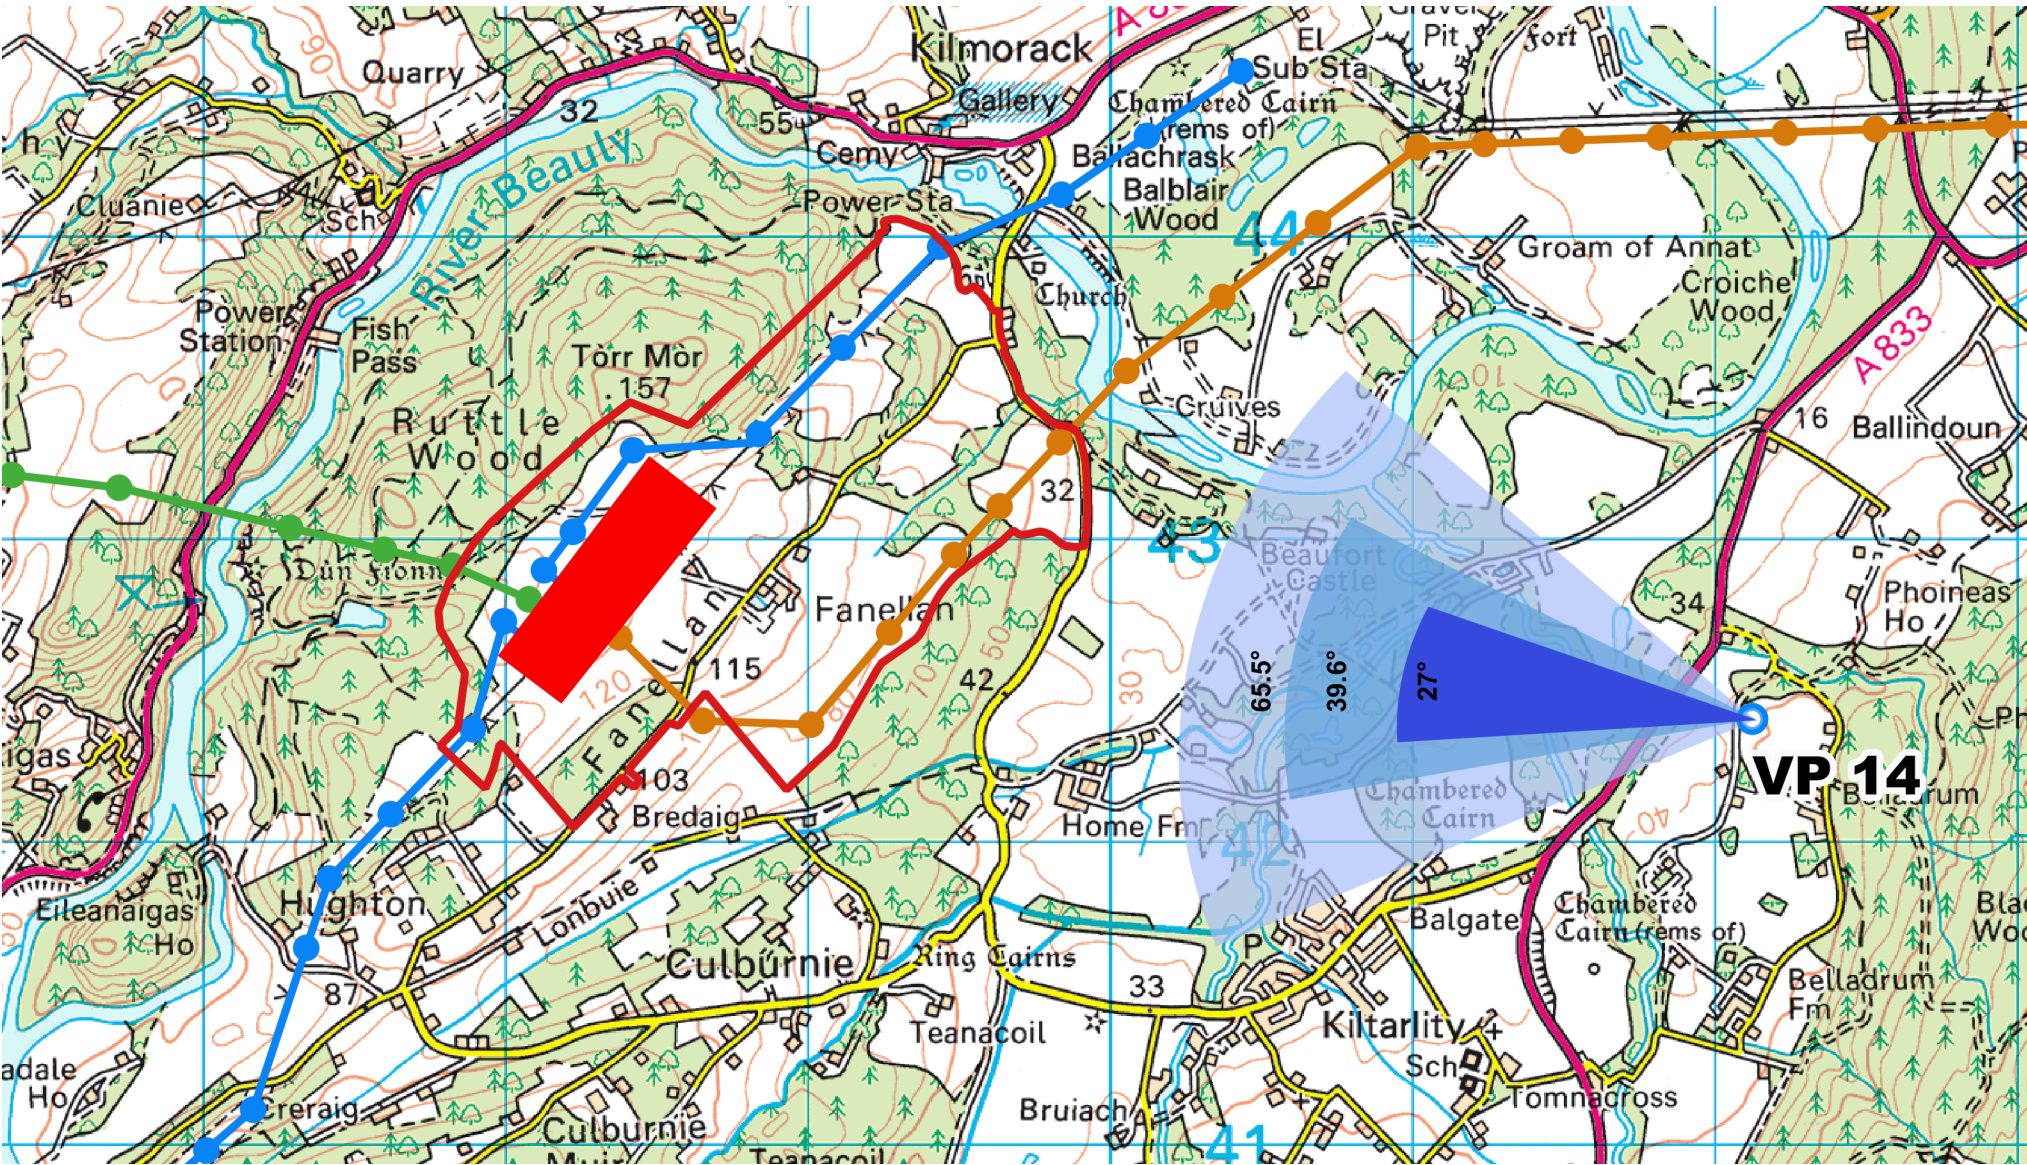

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25a**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

**Location Description:**  
The viewpoint is on Belladrum Road, Kiltarlity. There is parking available to the west of the viewpoint in a large area. The viewpoint can be accessed via foot over a field from the parking area.


Camera Location



Location Data

OSGB36 Location:	252124 842405
AOD:	163m
Camera Height:	1.5m
Distance to Development:	3499m



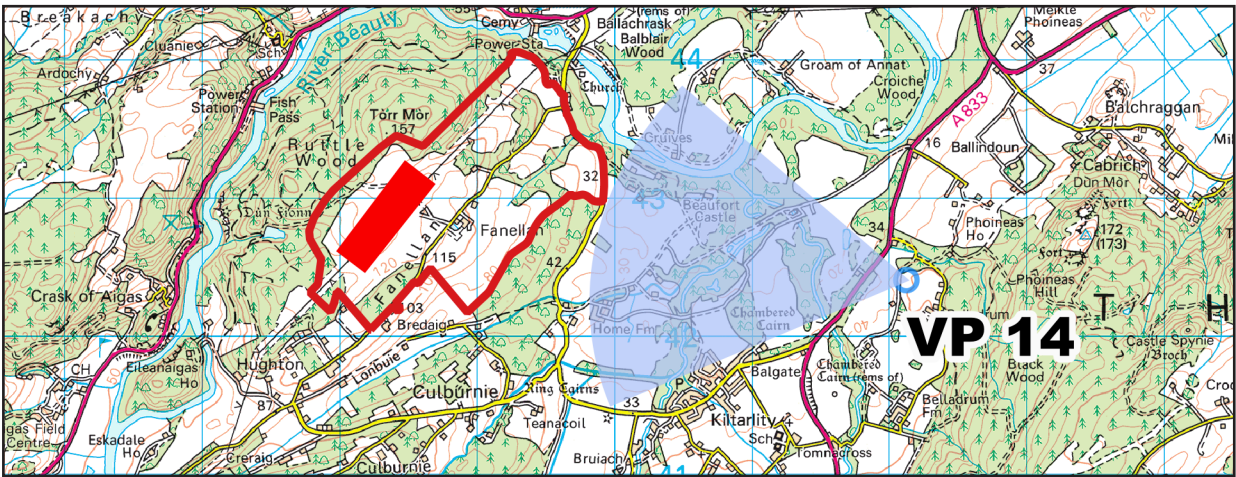

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25b**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Baseline) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
(North-West)


Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024

*Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.*

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



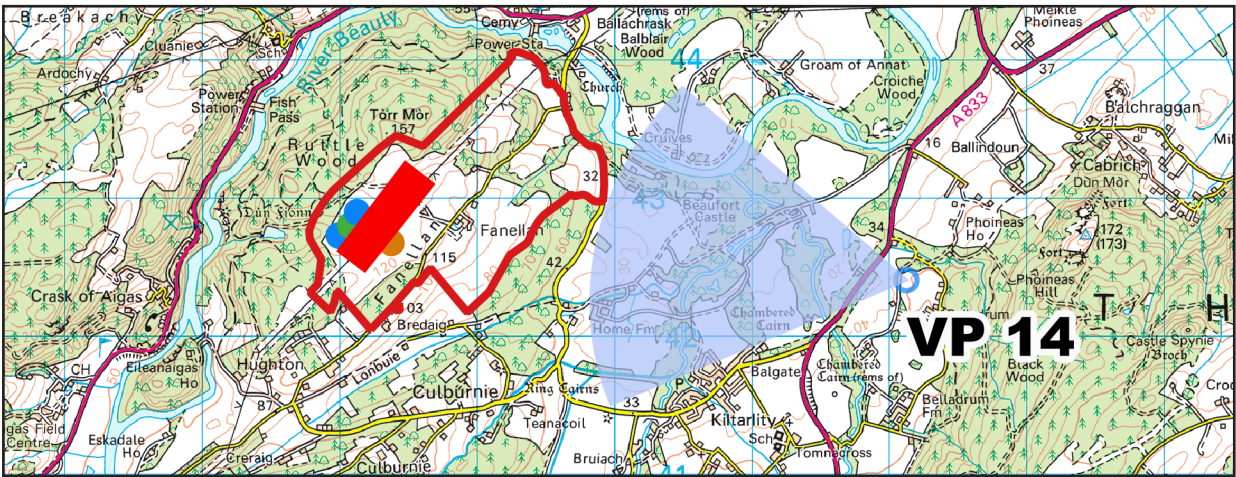

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25c**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSSEN Cumulative Terminal Towers) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270° (North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.


The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024





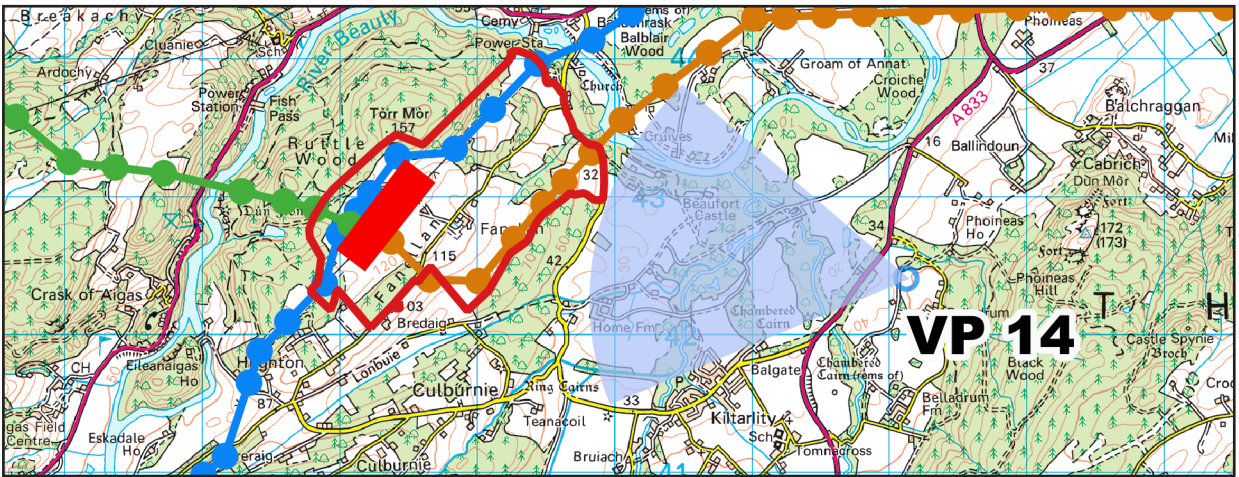

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25d**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
(North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024



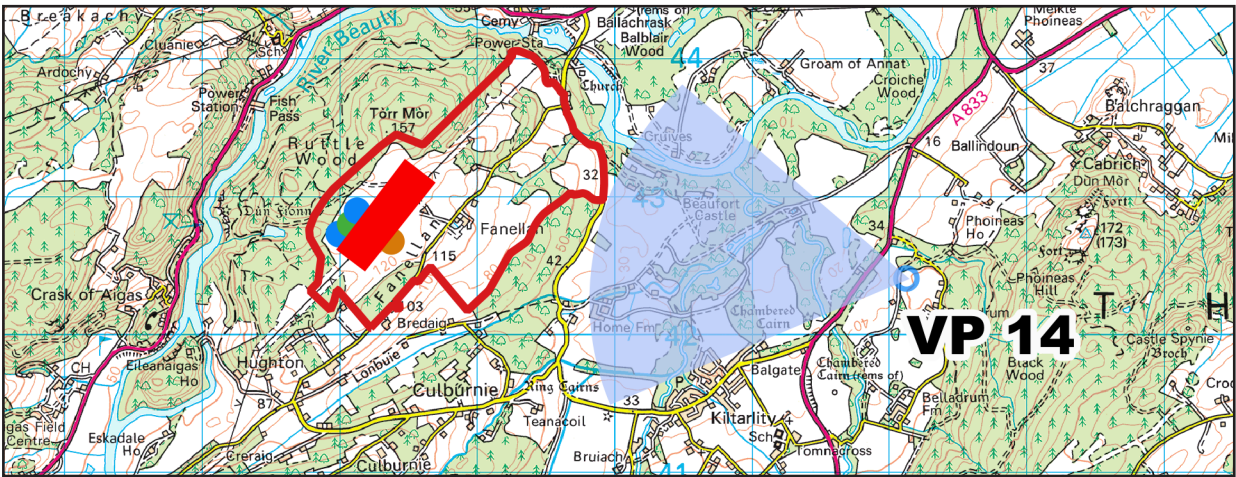

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25e**  
**Viewpoint 14: View looking west from Belladrum Tartan**  
**Heart Festival Grounds**  
**Operational View (Photomontage: Fanellan 400kV**  
**Substation & Converter Station & SSEN Cumulative**  
**Terminal Towers - Year 0) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
(North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024



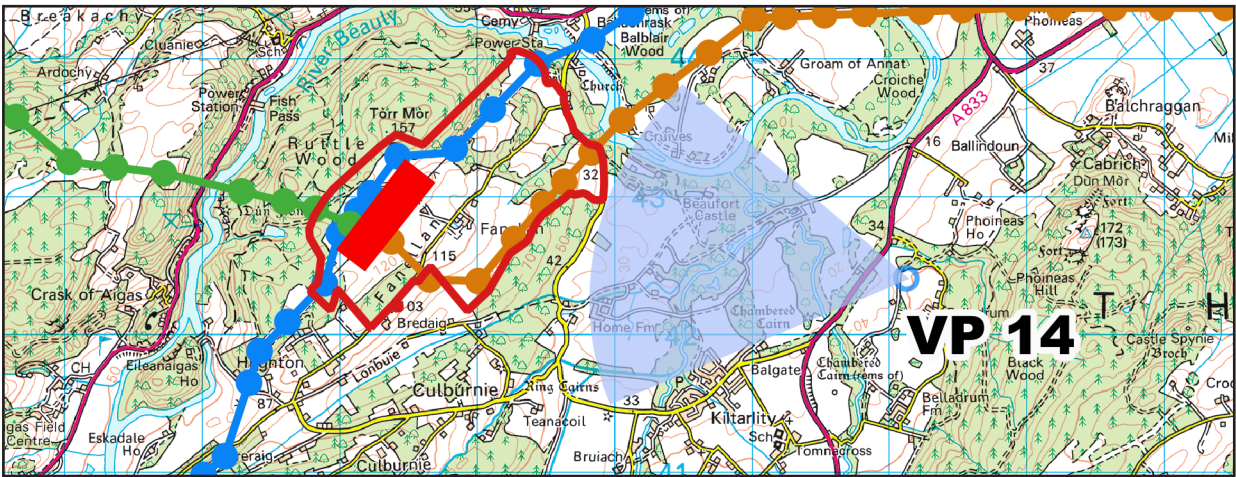

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25f**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
(North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024



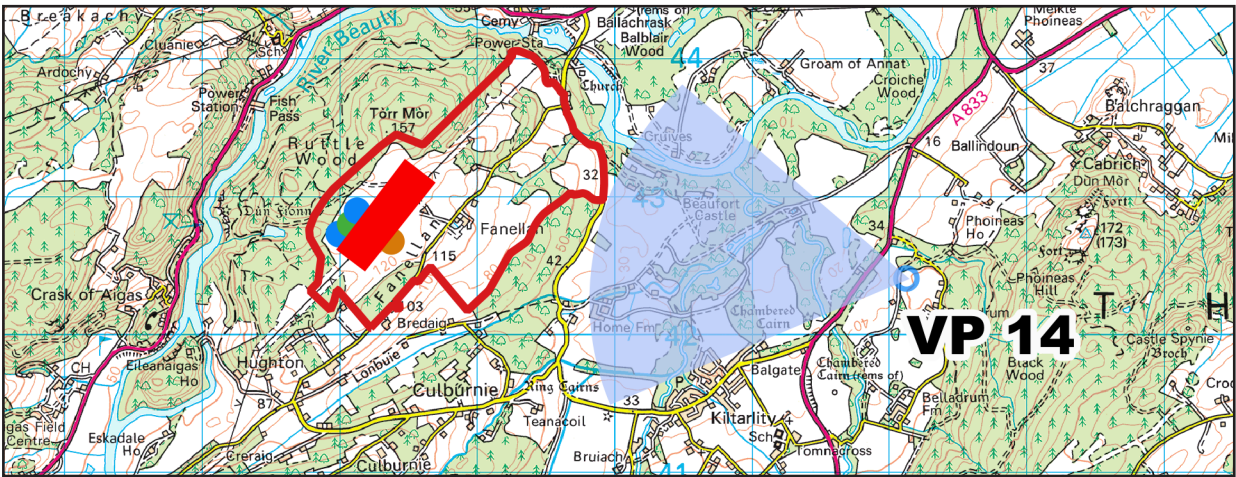

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25g**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270° (North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.


This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
  - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024



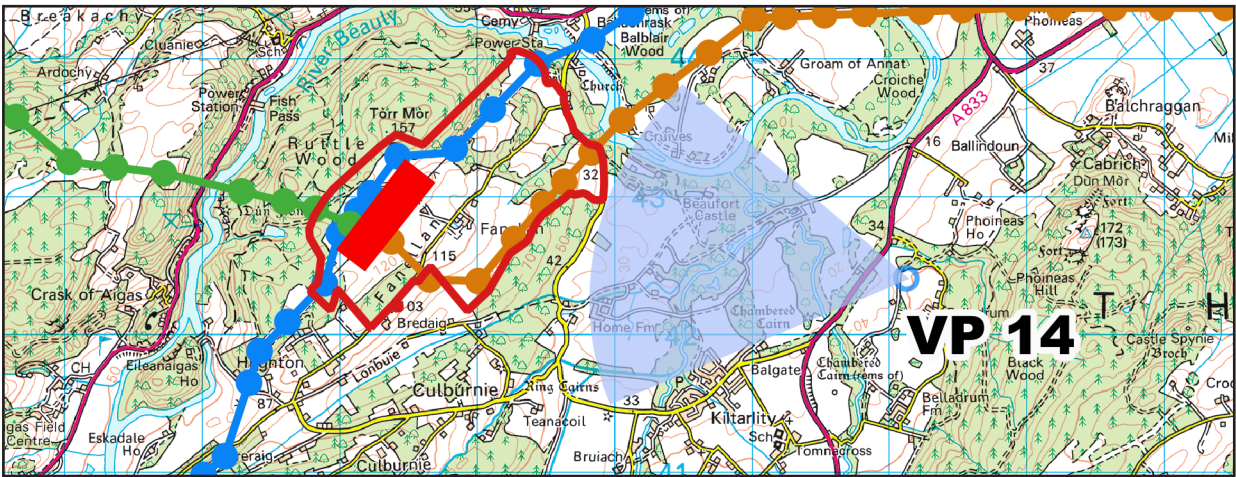

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Viewpoint Visualisations The Highland Council**  
**Figure 8.25h**  
**Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
**Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 65.5°**

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
(North-West)

Receptors represented: Recreational receptors visiting Belladrum Tartan Heart Festival Grounds.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
  - Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Permanent Tie-ins (to the Proposed Development)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 22/10/2024





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-i Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-j Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)  
 - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-k Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-I Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-m Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-n Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-o Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**  
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 75mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
Distance to Development and Direction of view: 3499m, 270°  
Date: 22/10/2024  
Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-p Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)  
 - 75mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024


*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION



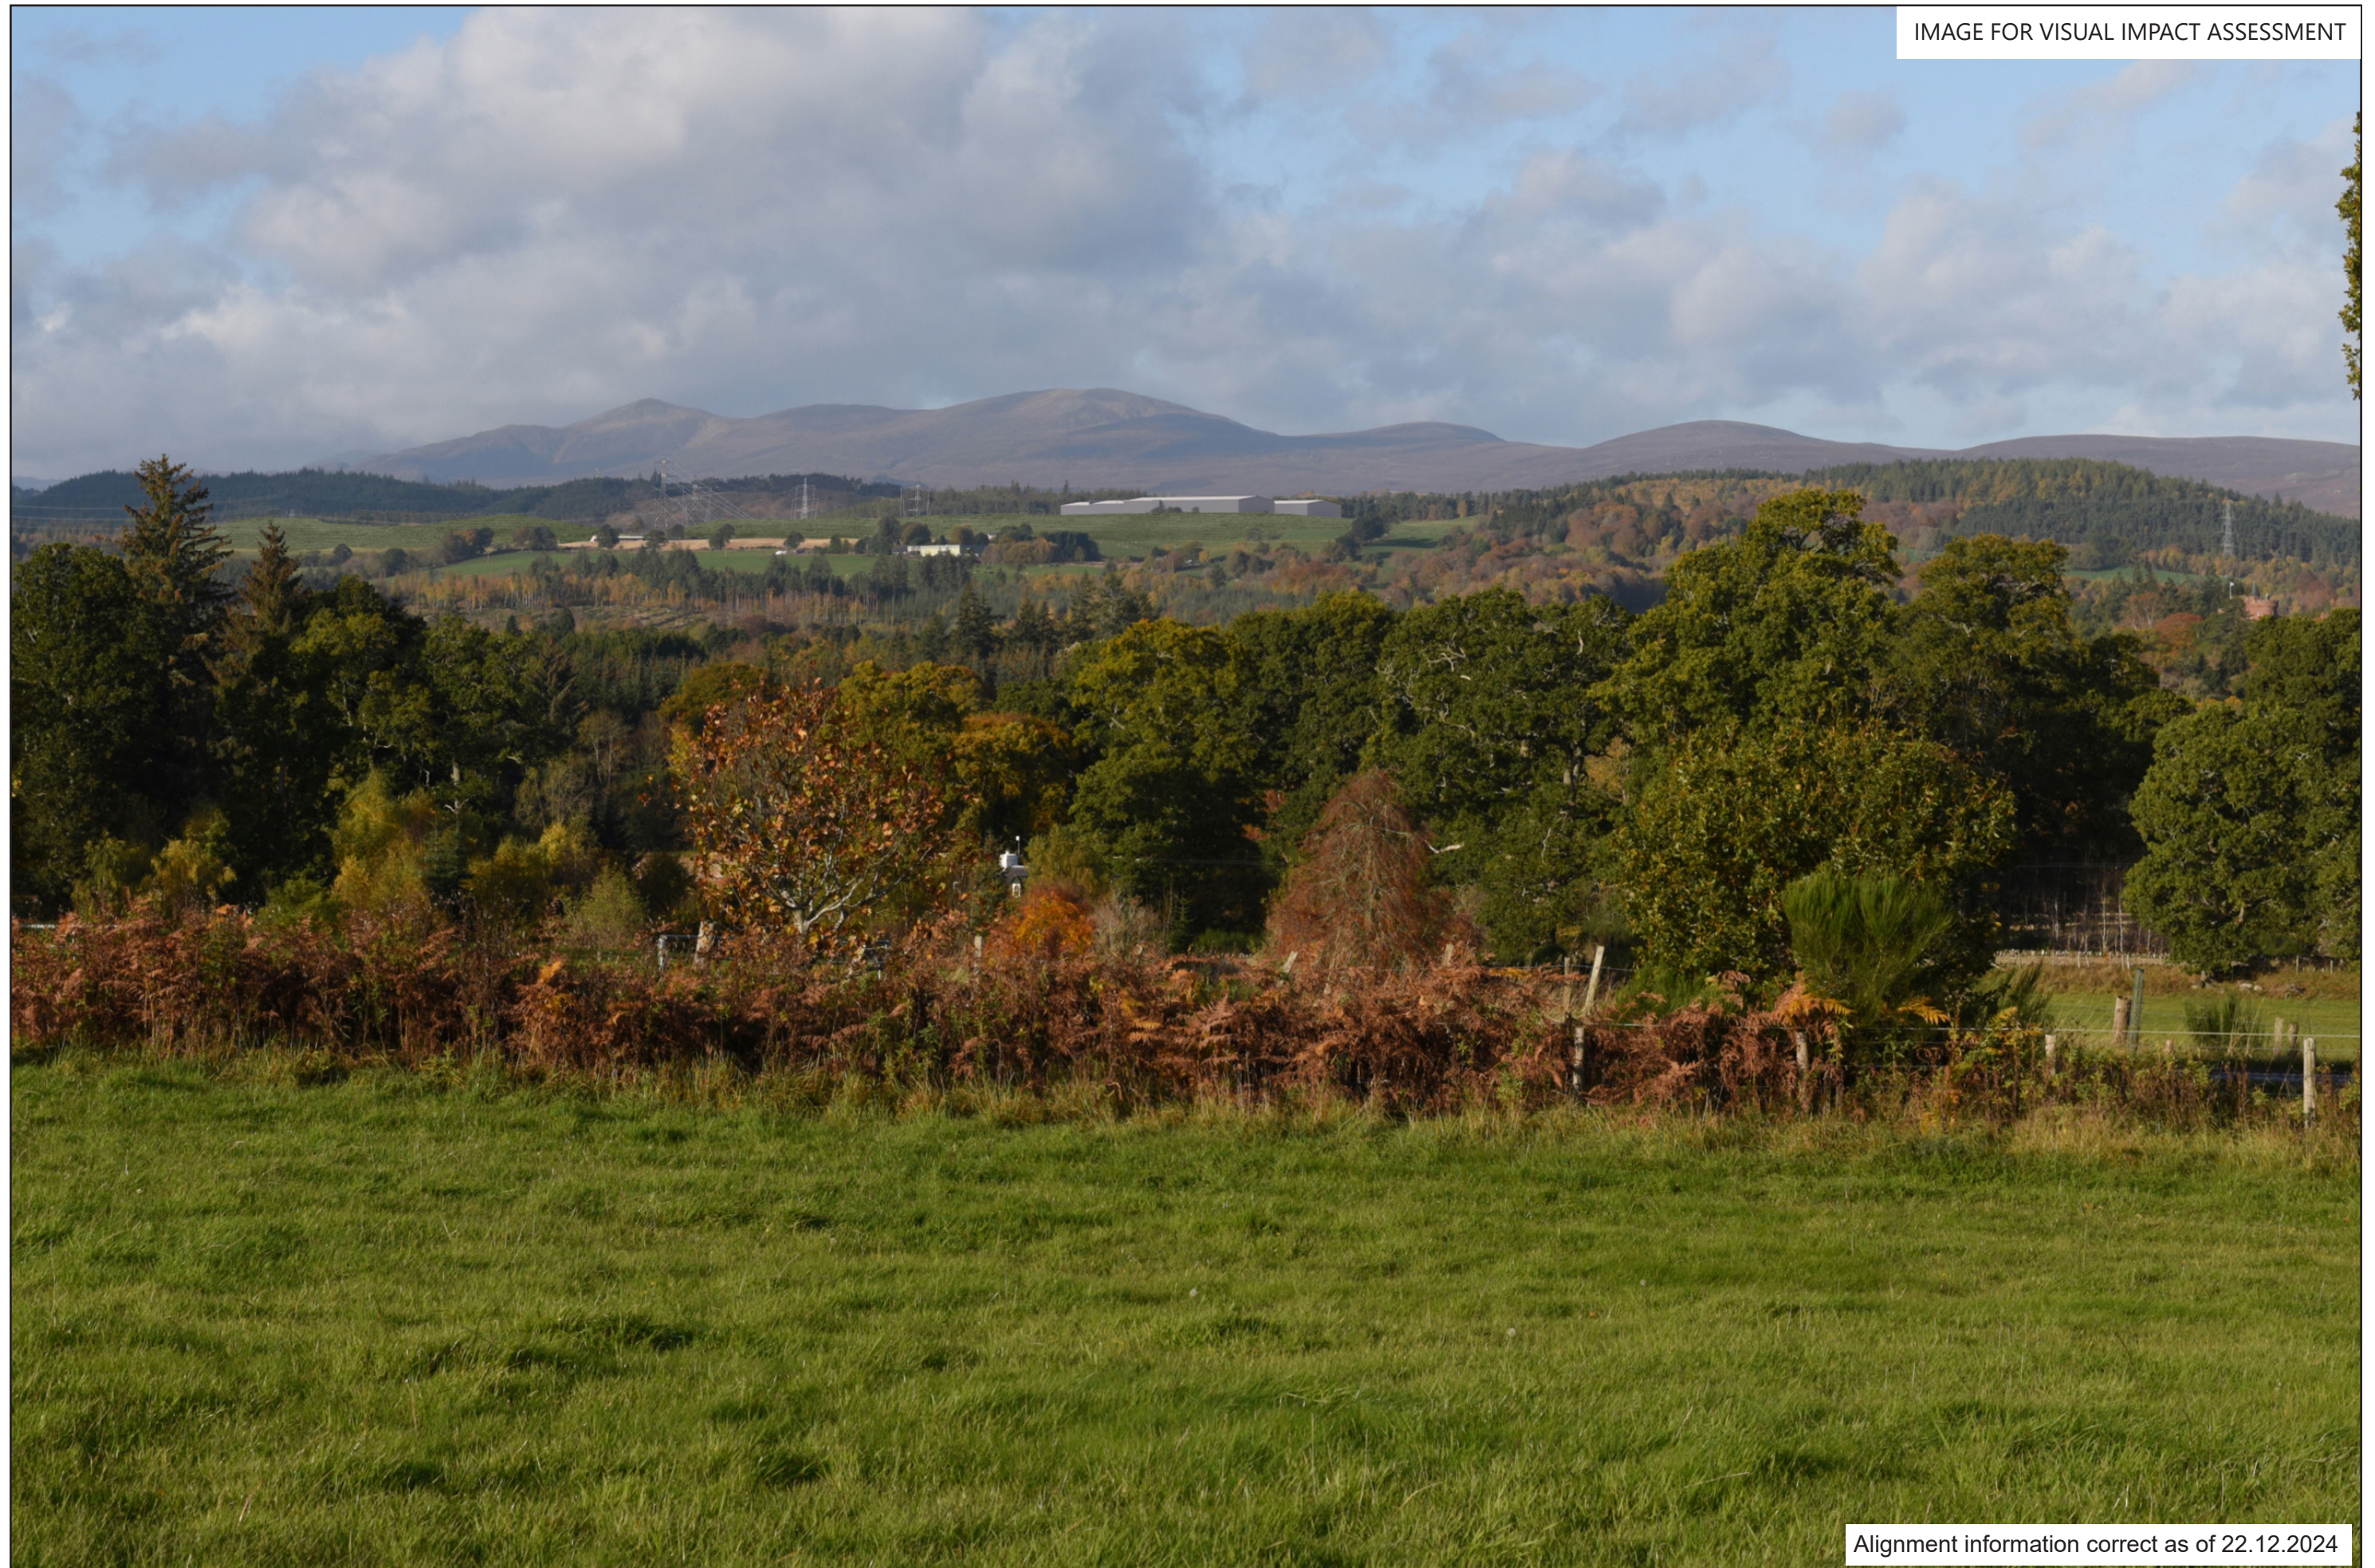

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-q Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 75mm


Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m





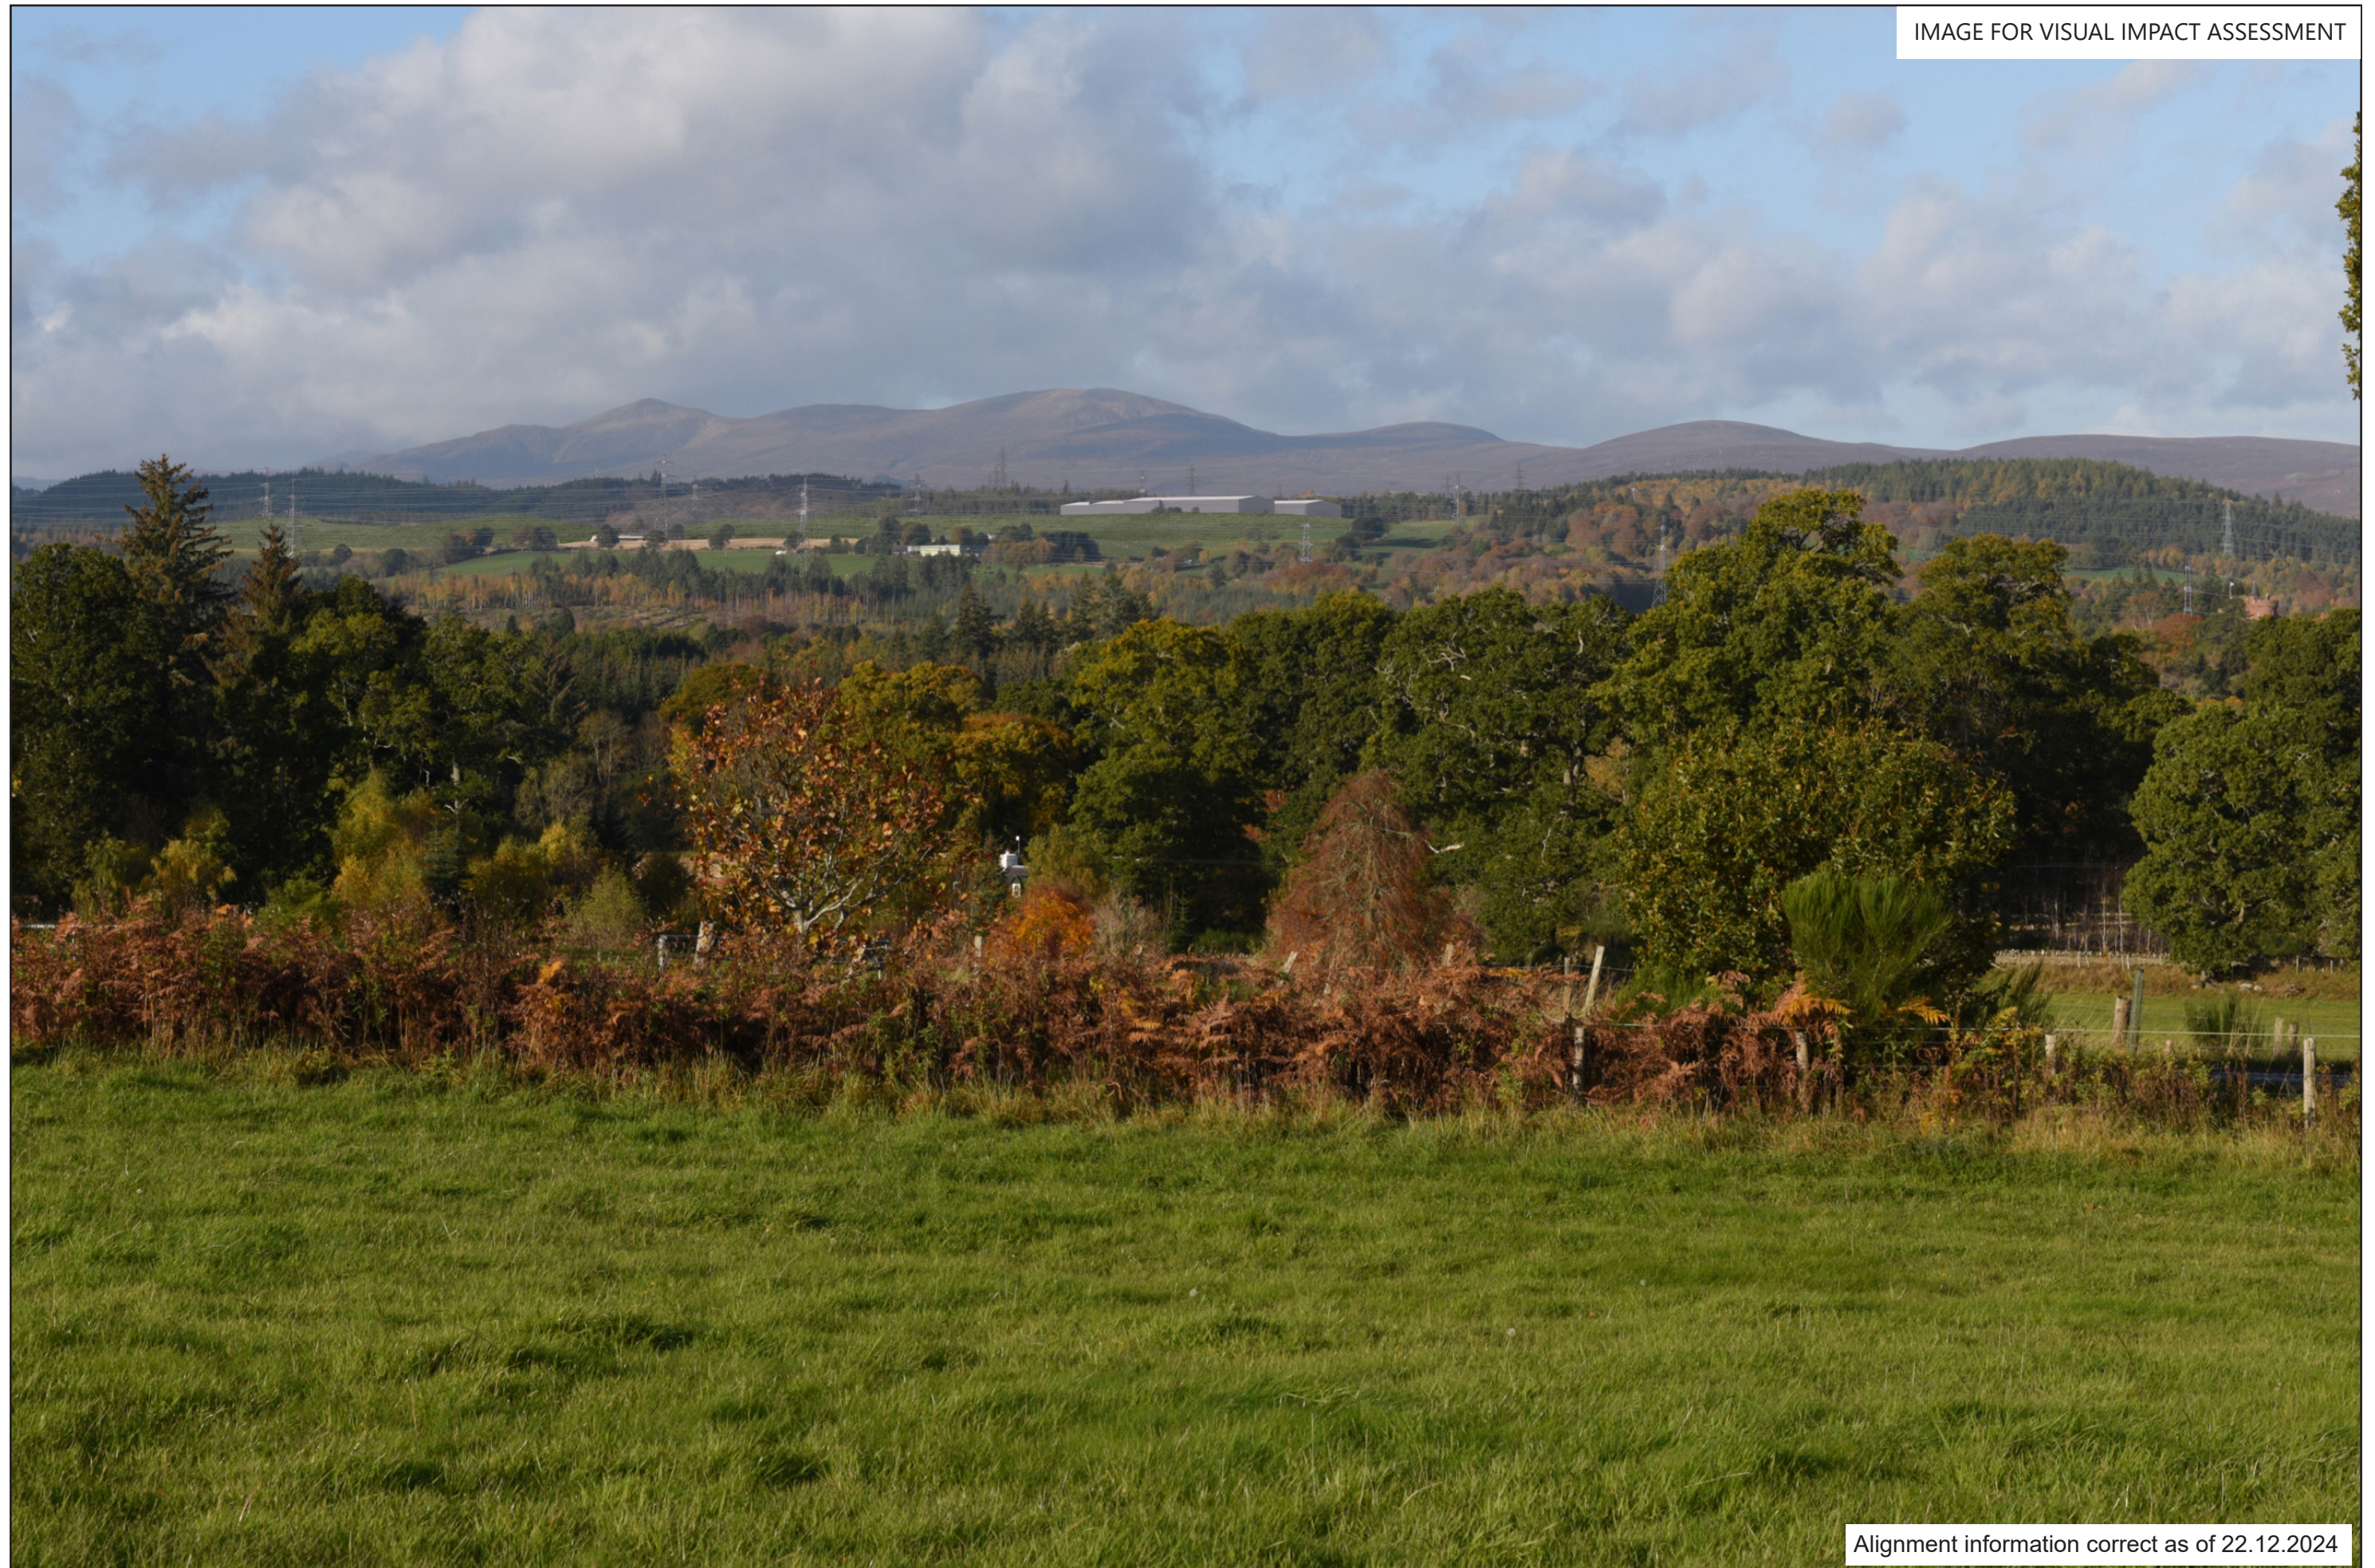

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-r Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 75mm


Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m





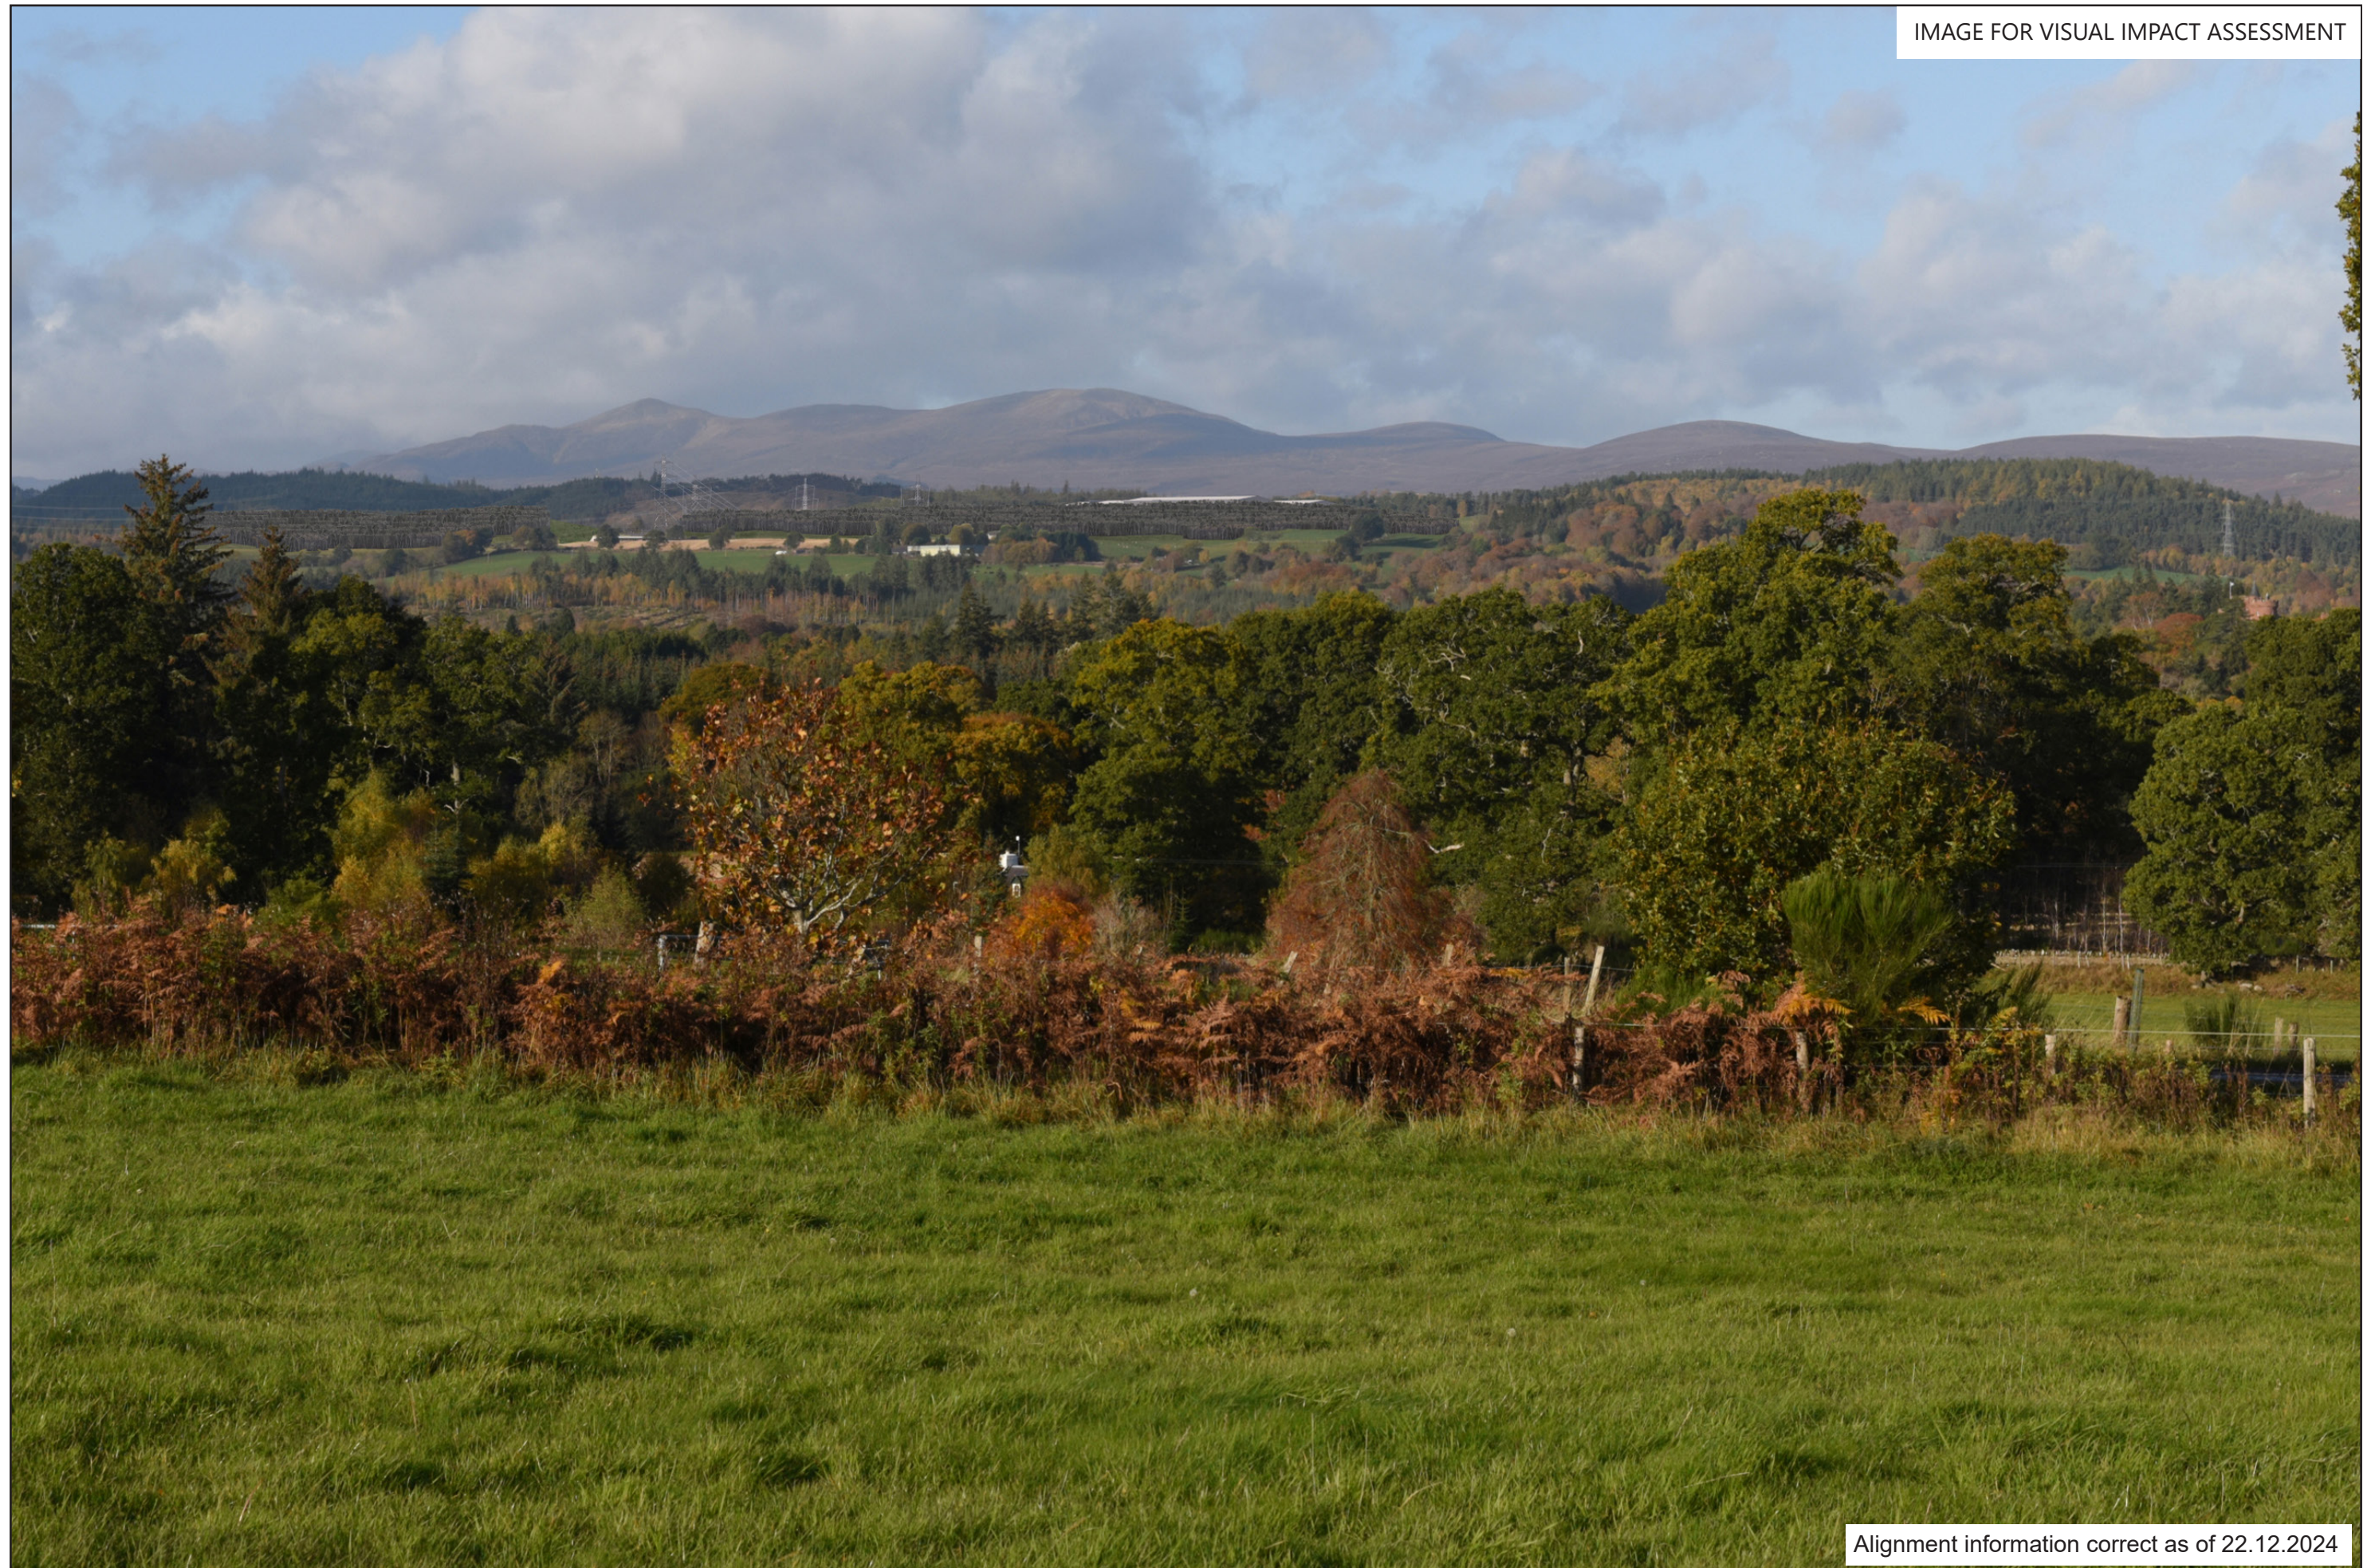

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-s Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 75mm


Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m





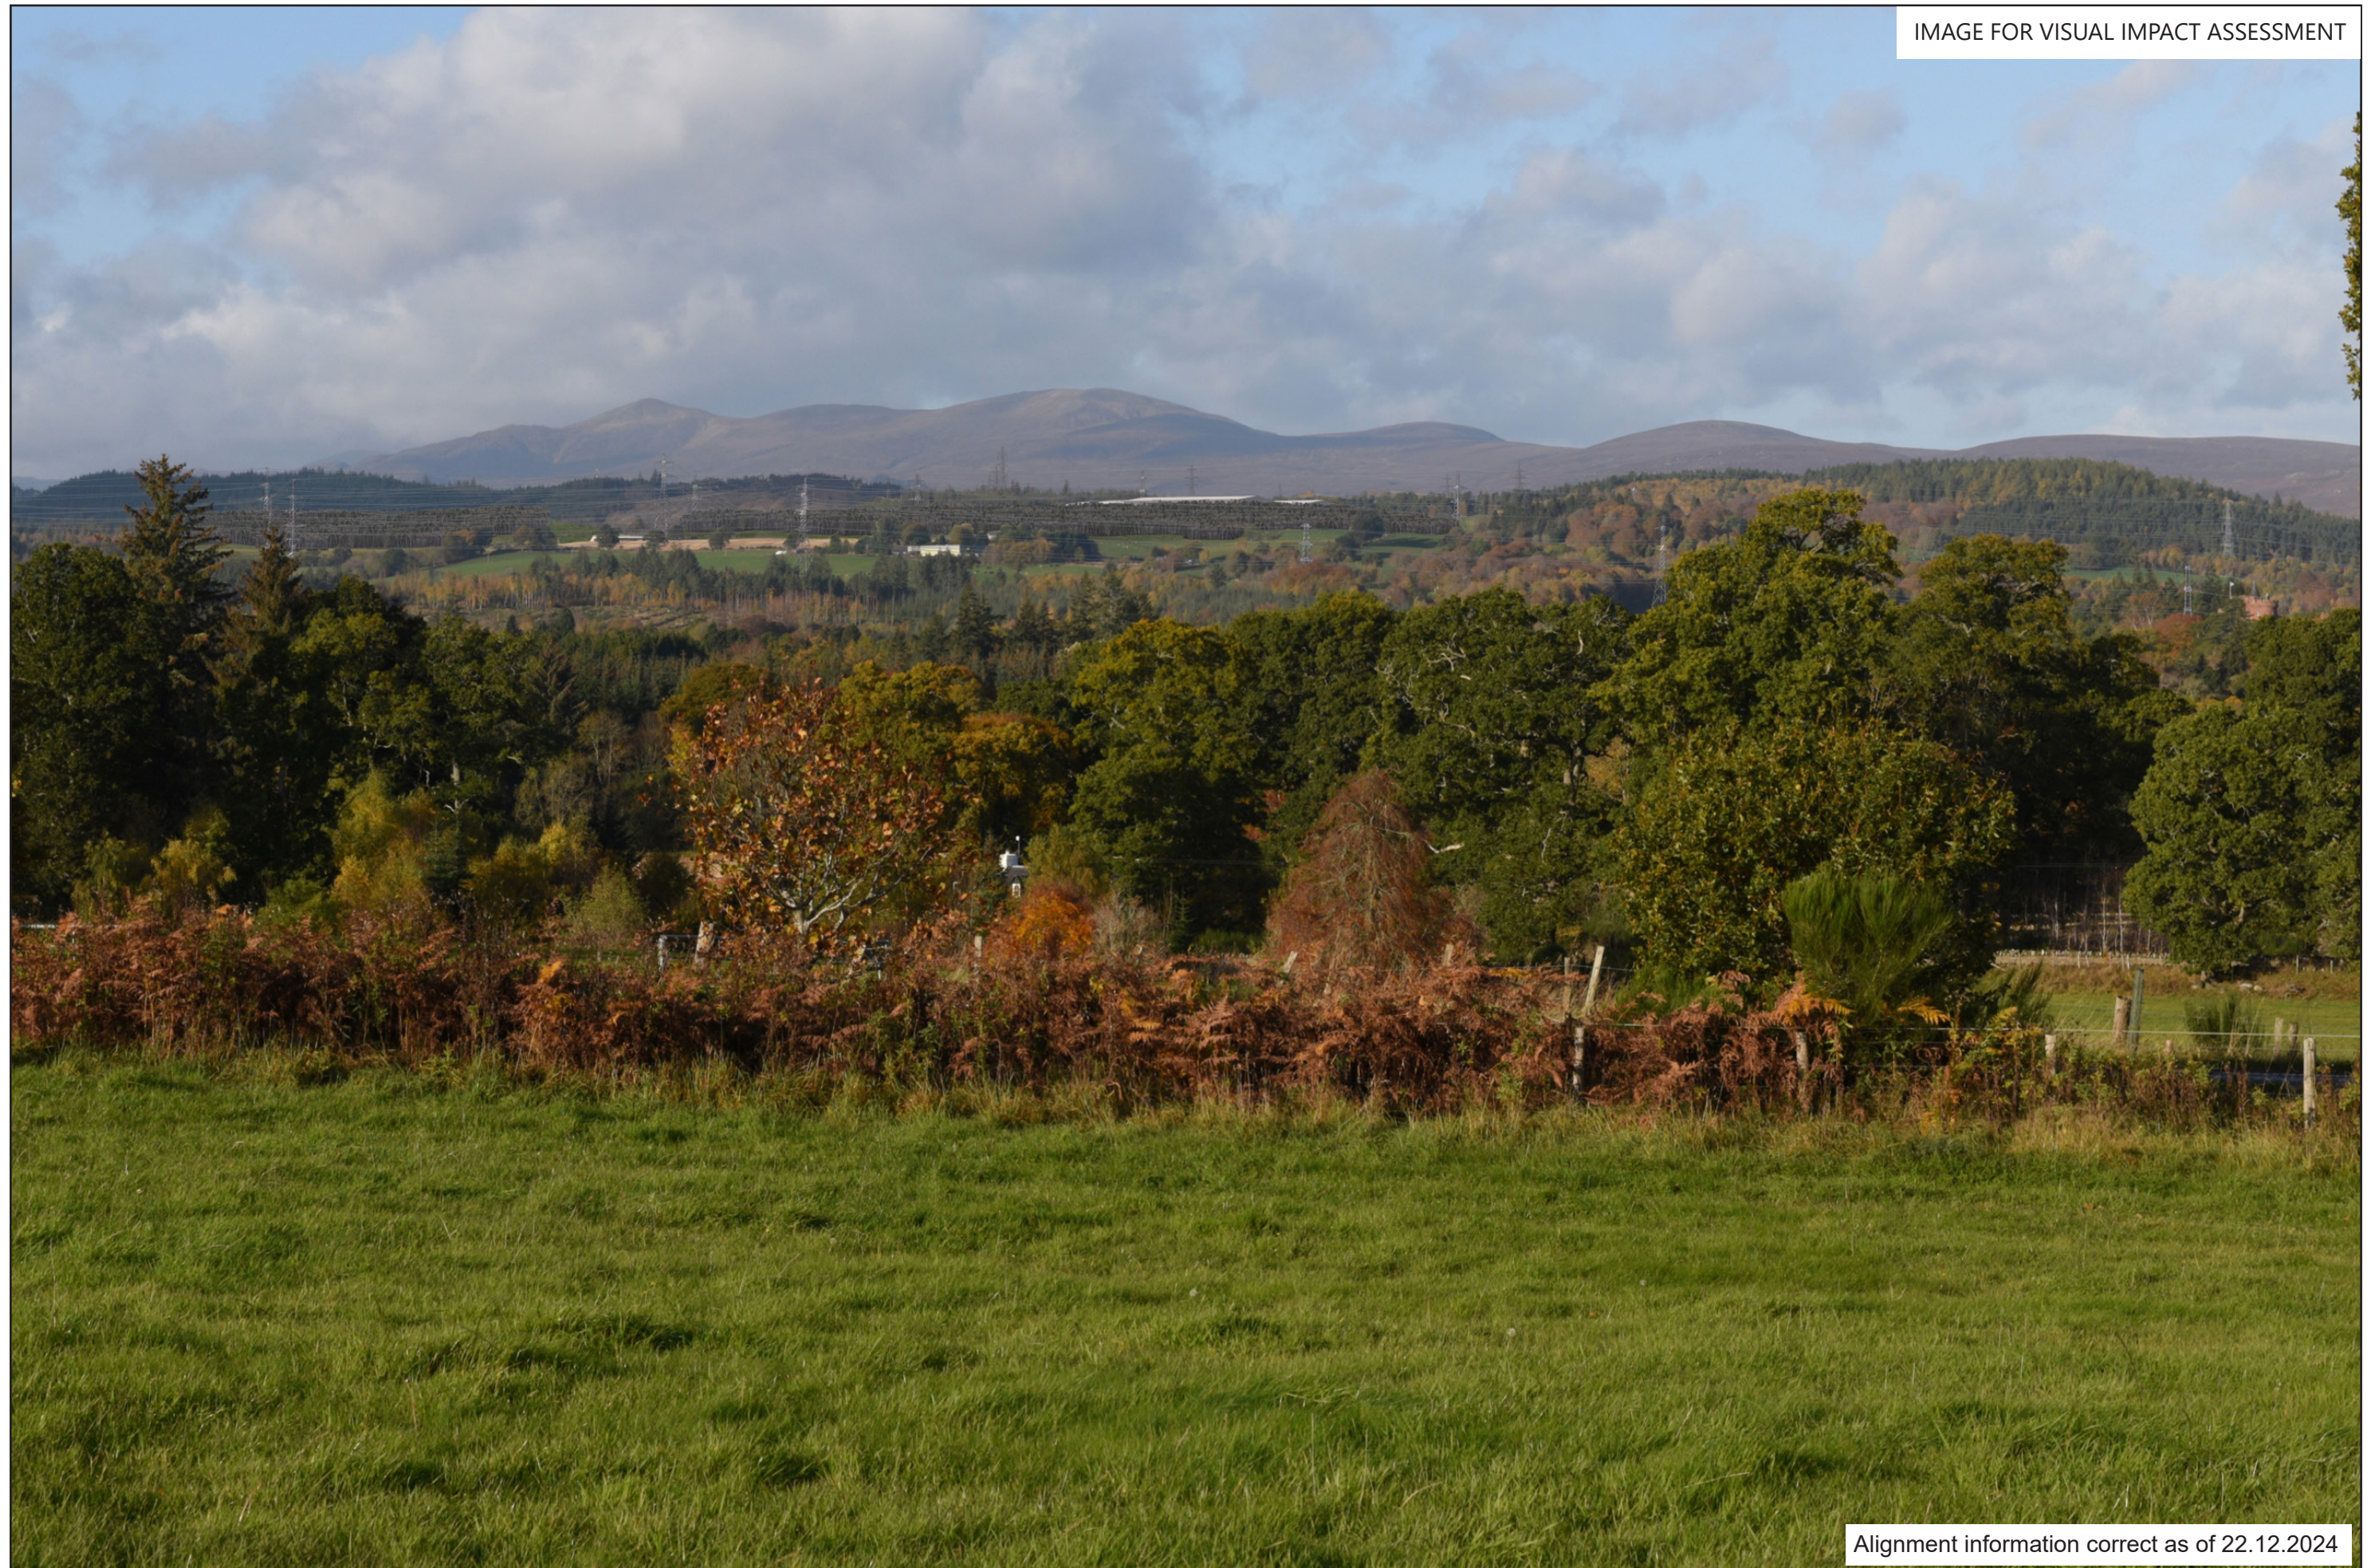

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.25-t Viewpoint 14: View looking west from Belladrum Tartan Heart Festival Grounds**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 75mm

Viewpoint Location: X 252124, Y 842405 AOD: 163m  
 Distance to Development and Direction of view: 3499m, 270°  
 Date: 22/10/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION