




Figure 8.30a Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Existing View

Alignment information correct as of 22.12.2024

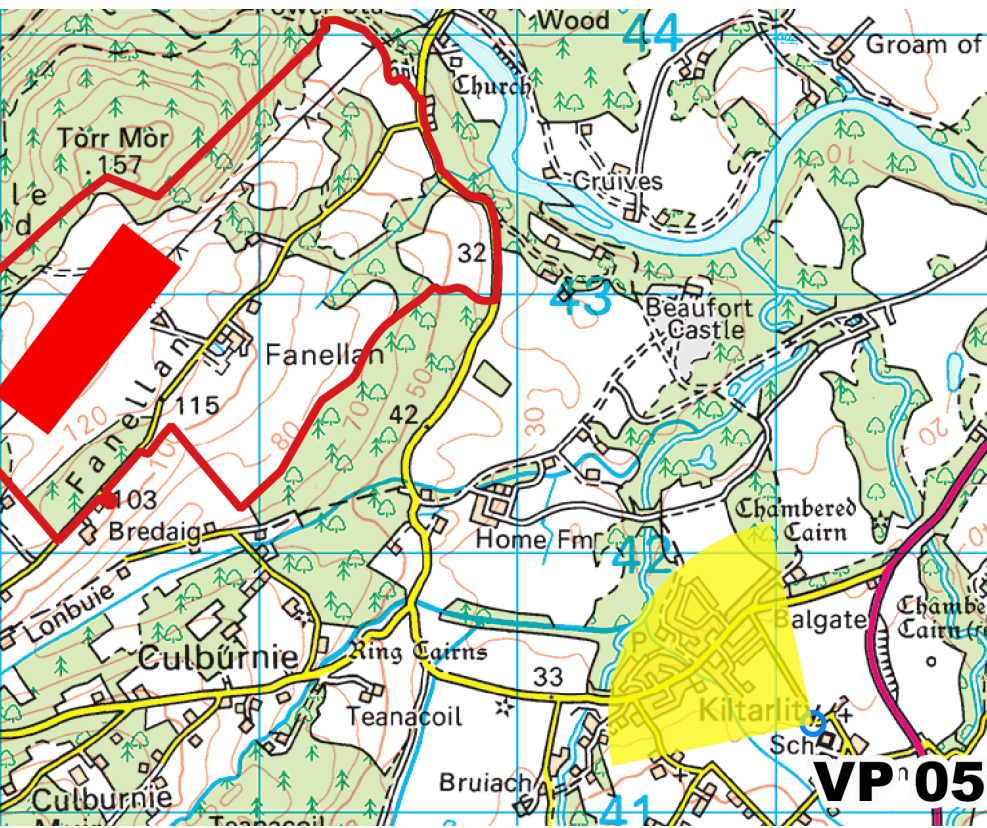

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 251143, Y 841342, AOD 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is an existing view to support a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)


Existing View





Figure 8.30b Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)

Alignment information correct as of 22.12.2024

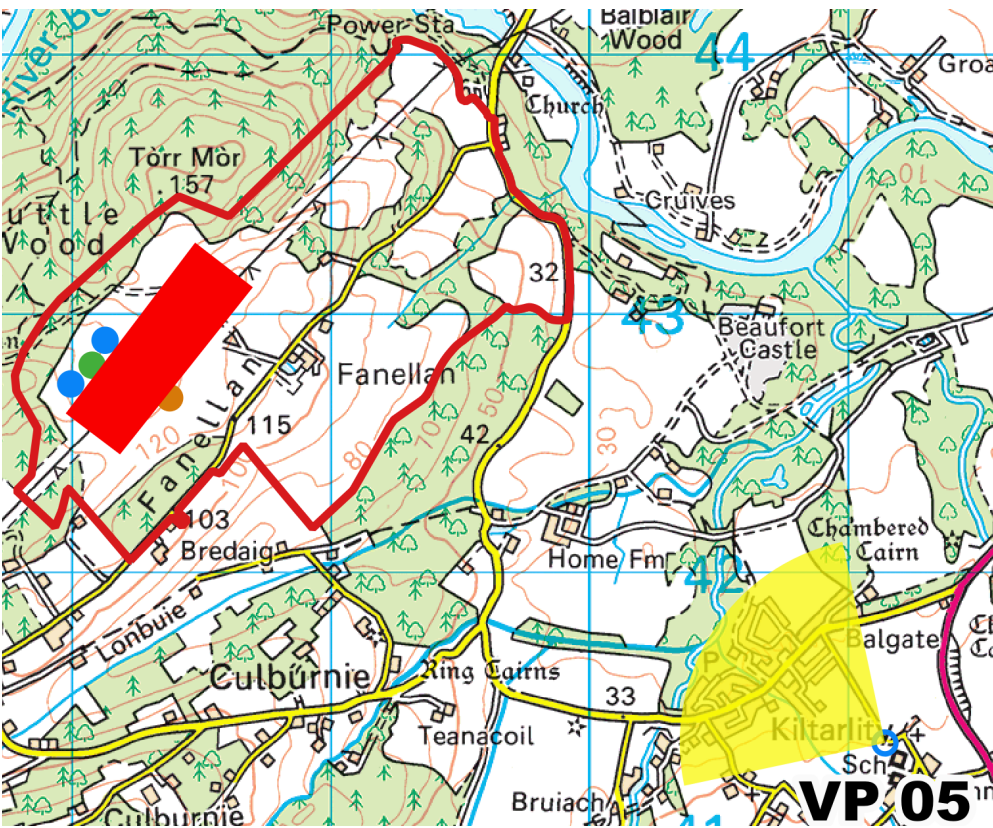

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024,10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 251143, Y 841342, AOD 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)





Figure 8.30c Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)

Alignment information correct as of 22.12.2024

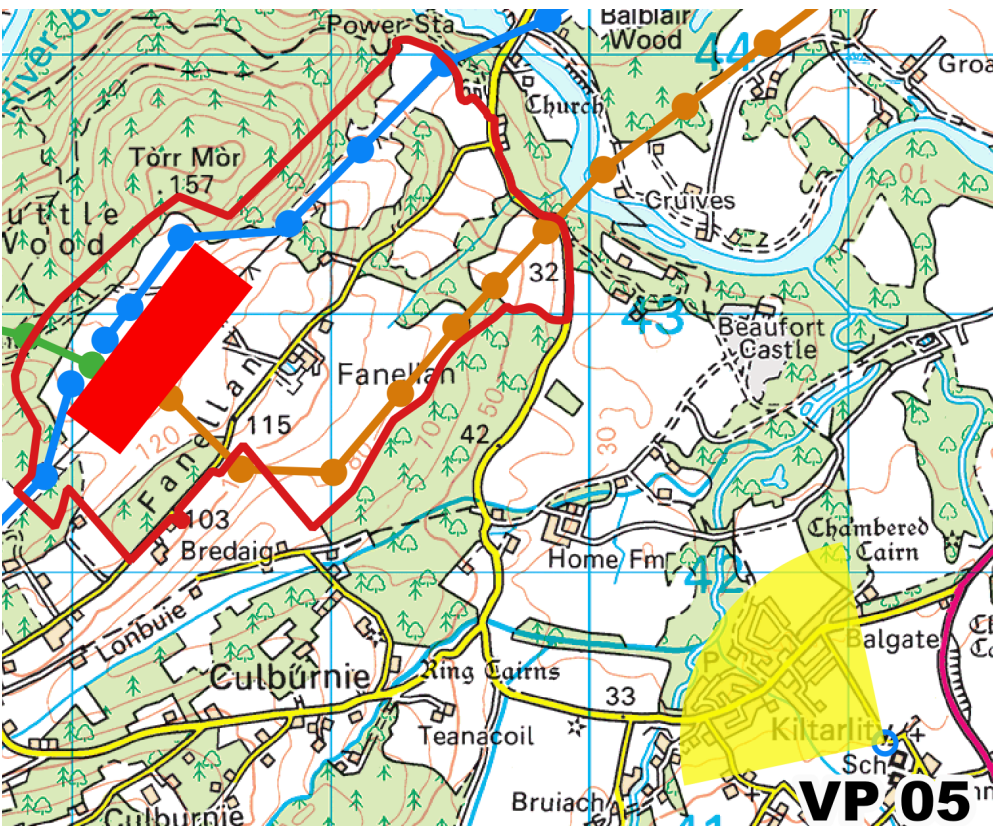

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 251143, Y 841342, AOD 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photowire: SSEN Cumulative Overhead Line Schemes Only)





Figure 8.30d Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)

Alignment information correct as of 22.12.2024

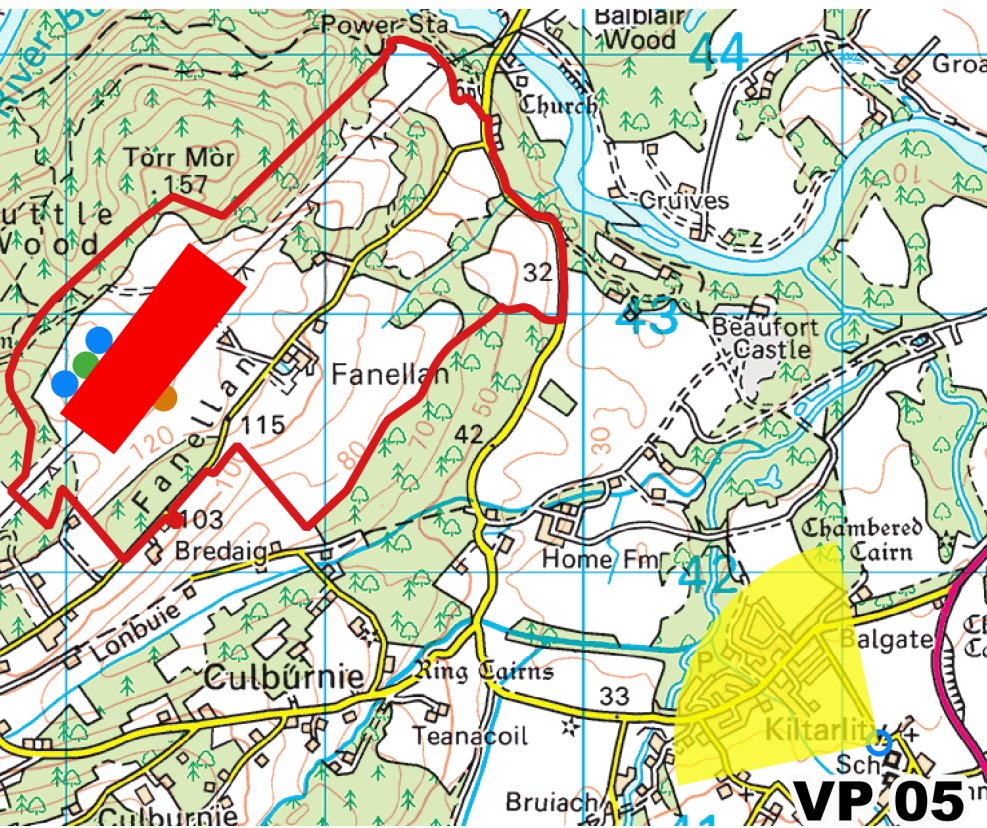

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° **Horizontal Field of View:** 90°
Viewpoint location: X 251143, Y 841342, **AOD** 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)





Figure 8.30e Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

Alignment information correct as of 22.12.2024

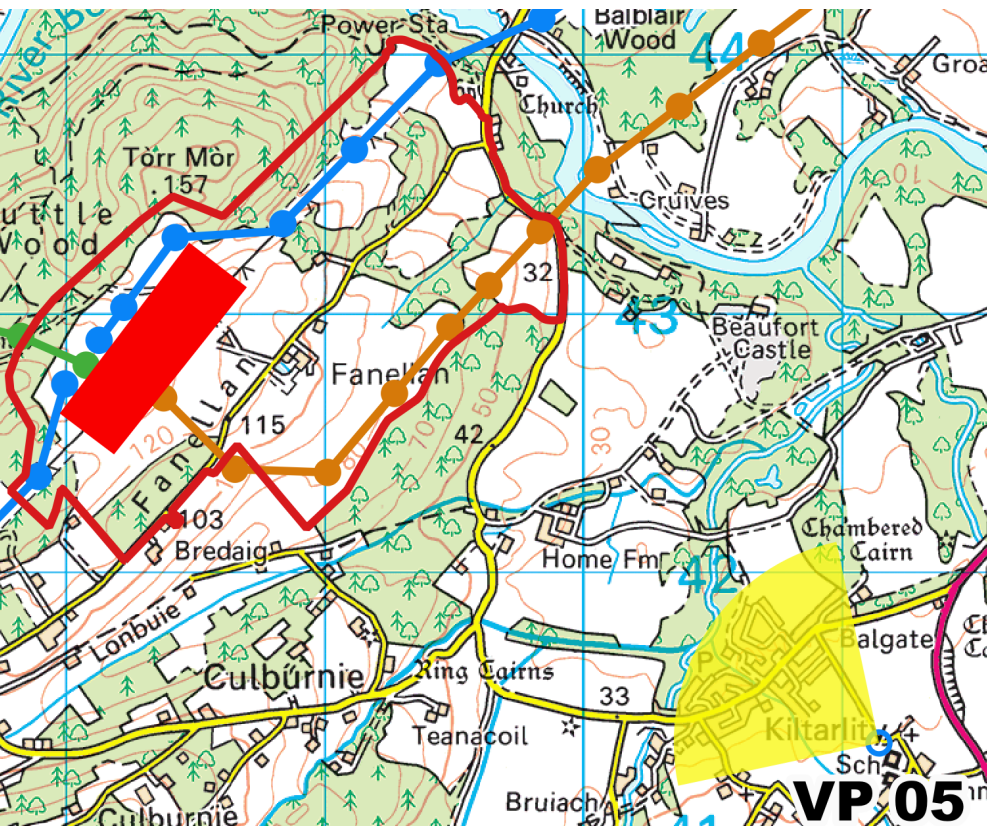

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024,10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 251143, Y 841342, AOD 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)





Figure 8.30f Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)

Alignment information correct as of 22.12.2024

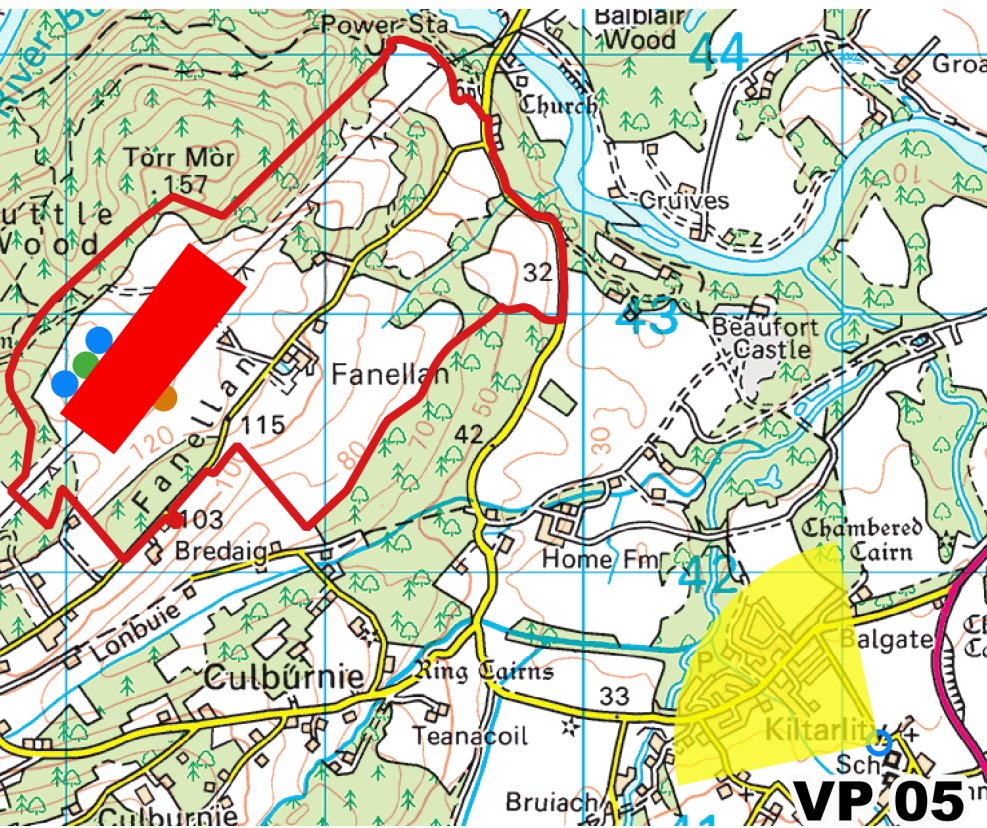

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° **Horizontal Field of View:** 90°
Viewpoint location: X 251143, Y 841342, **AOD** 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)





Figure 8.30g Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)

Alignment information correct as of 22.12.2024

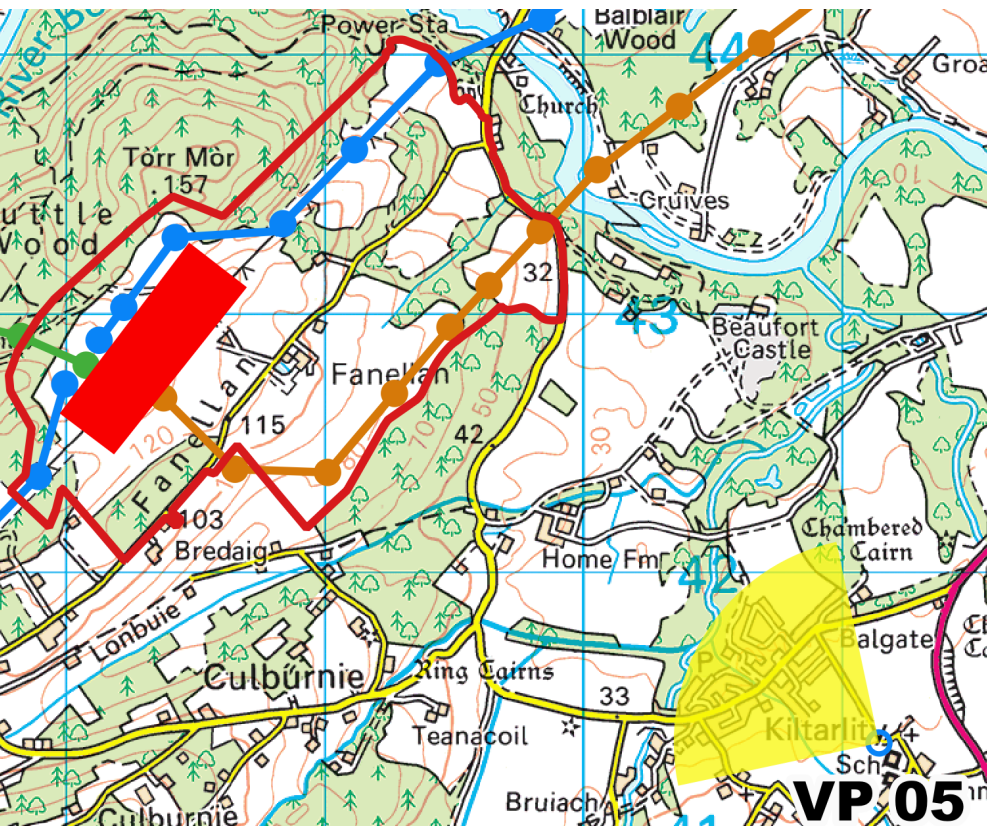

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Permanent
 - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024,10:38
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 251143, Y 841342, AOD 43m
Distance (in m) to proposed development and direction of view: 3036 m, 303°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
Operational View
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-h Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm


Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION

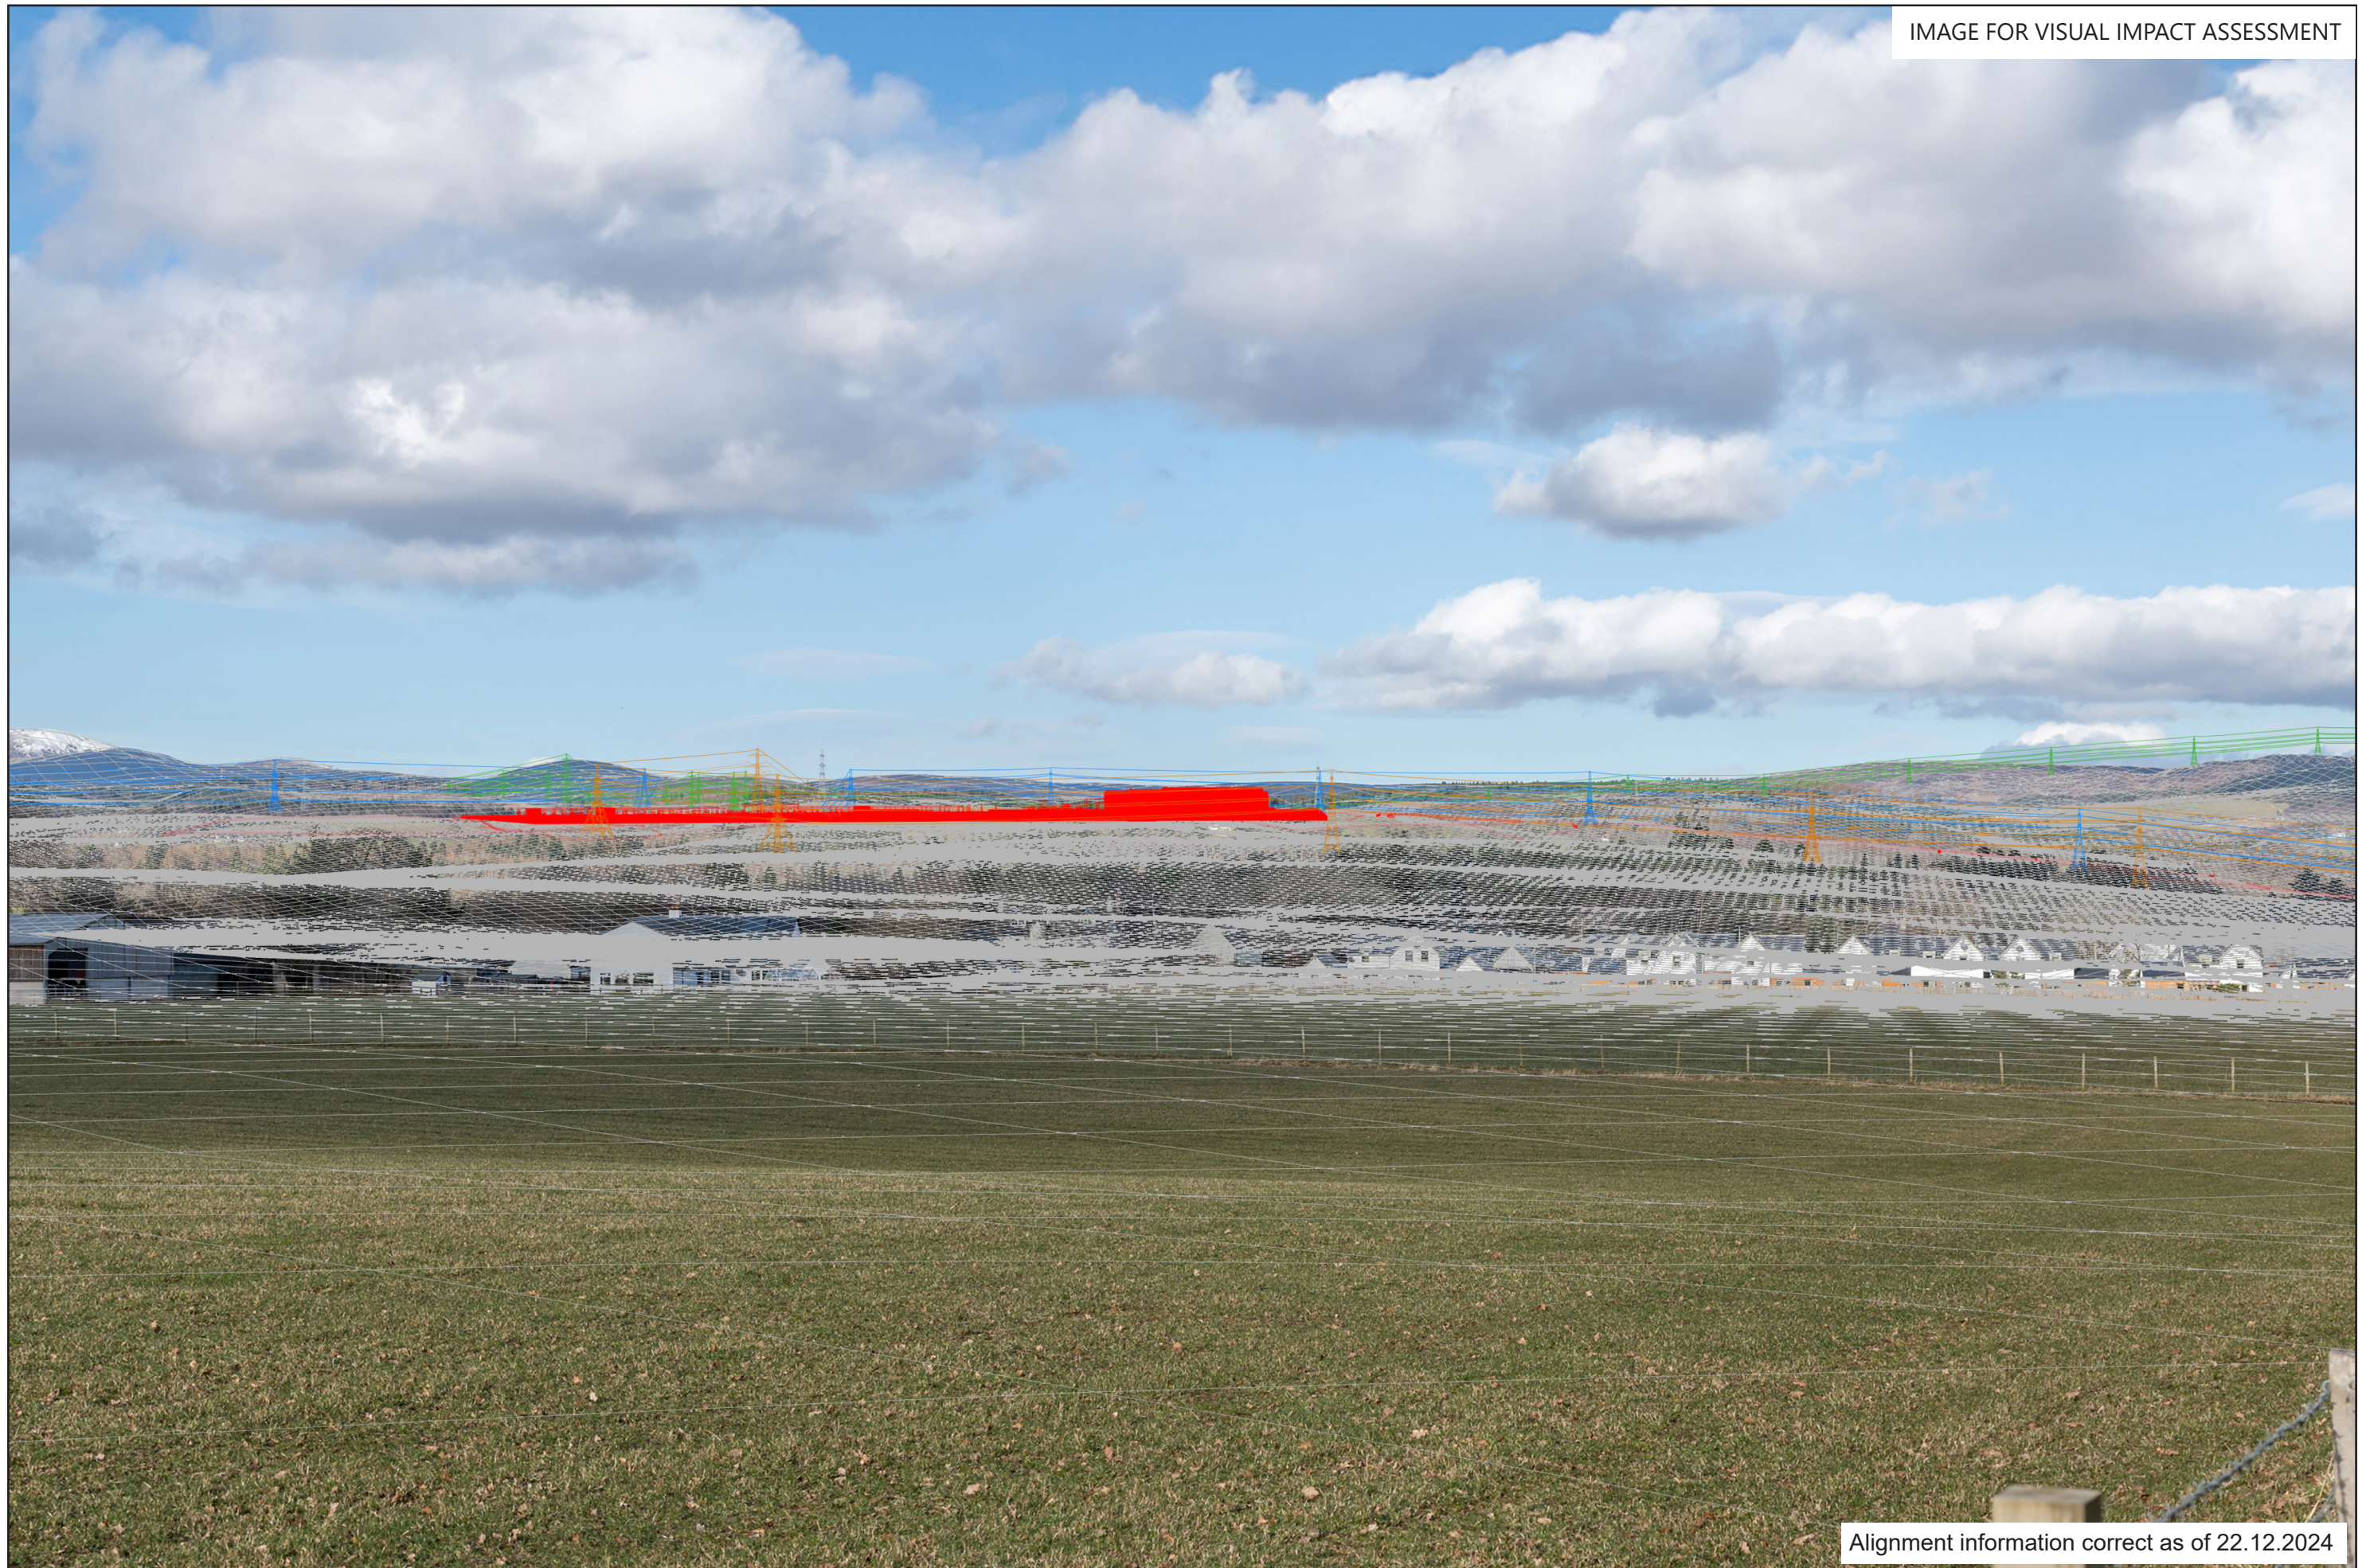

Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-i Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
 Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024
 Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-j Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station
& SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-k Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 0) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-I Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station
& SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.30-m Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes
Only - Year 15) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
Date: 05/03/2024
Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

