




Figure 8.32a Viewpoint 7: View looking north-east from near Creraig  
Existing View

Alignment information correct as of 22.12.2024

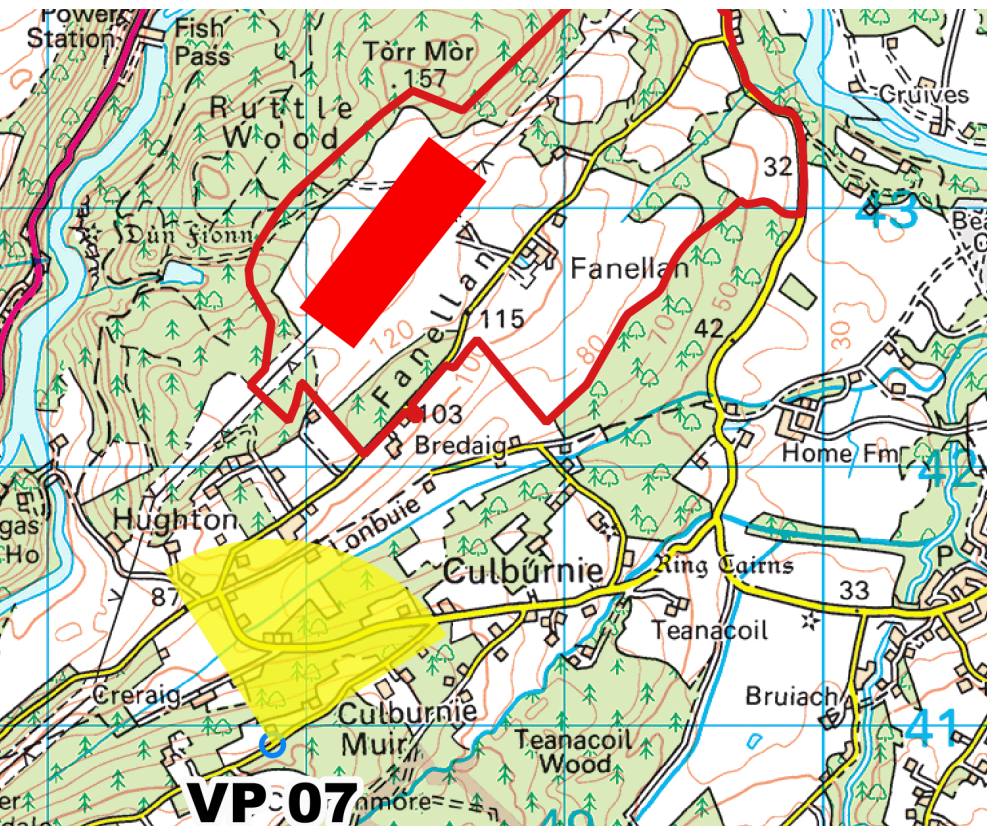

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

NOTES:  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is an existing view to support a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Creraig  
Existing View

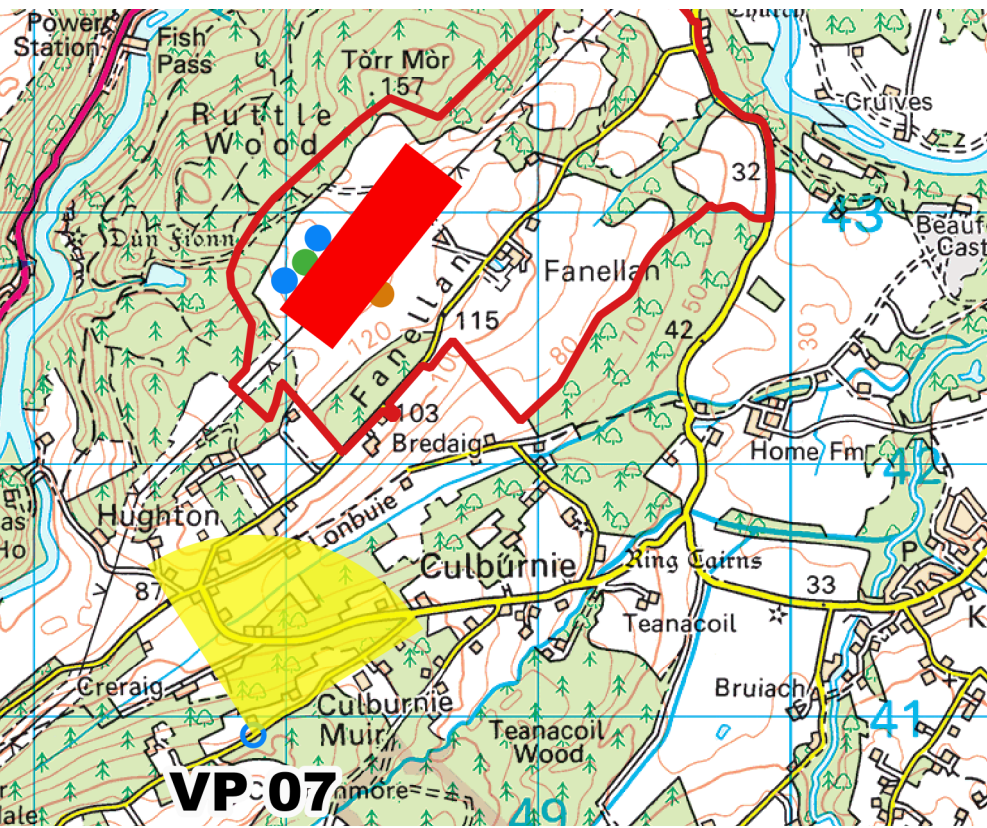






Figure 8.32b Viewpoint 7: View looking north-east from near Craiga  
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Craiga  
Operational View  
(Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)

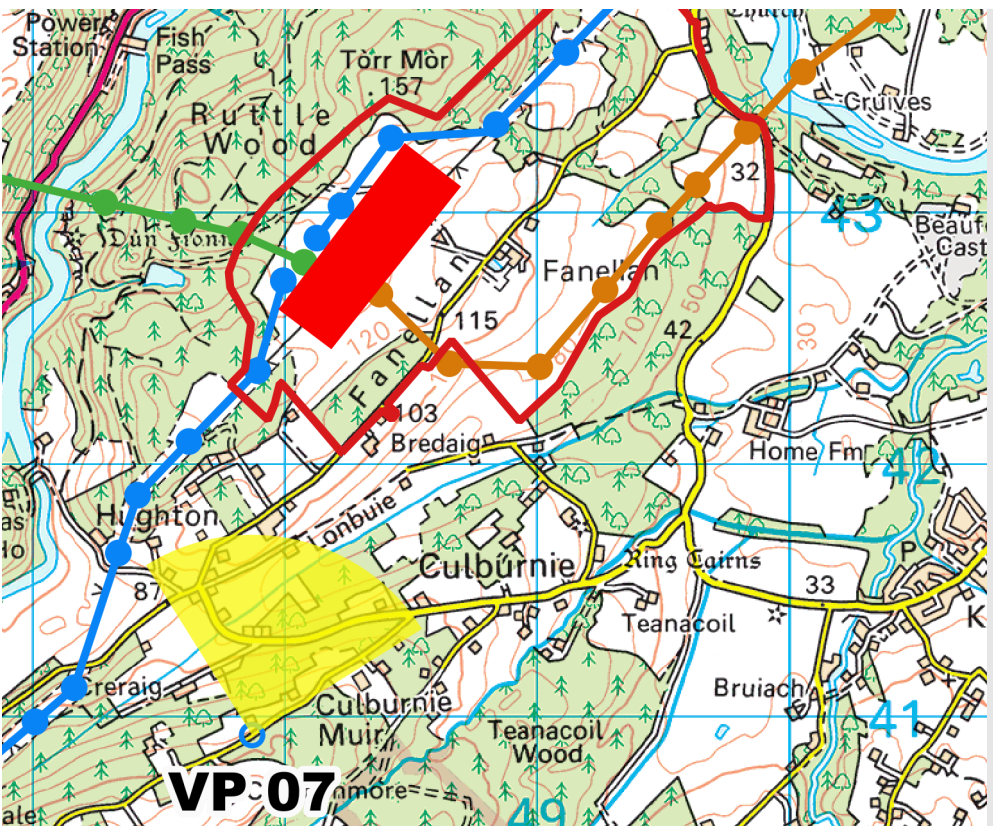






Figure 8.32c Viewpoint 7: View looking north-east from near Creraig  
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Creraig  
Operational View  
(Photowire: SSEN Cumulative Overhead Line Schemes Only)

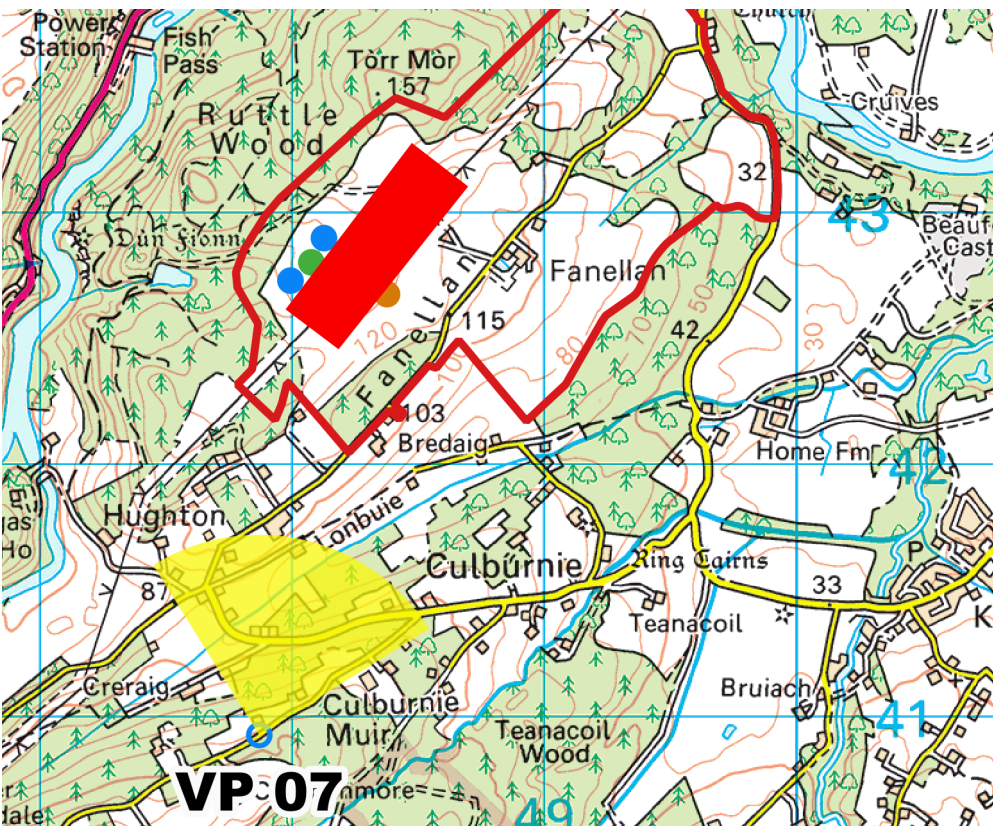






Figure 8.32d Viewpoint 7: View looking north-east from near Craiga  
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024,12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Craiga  
Operational View  
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)

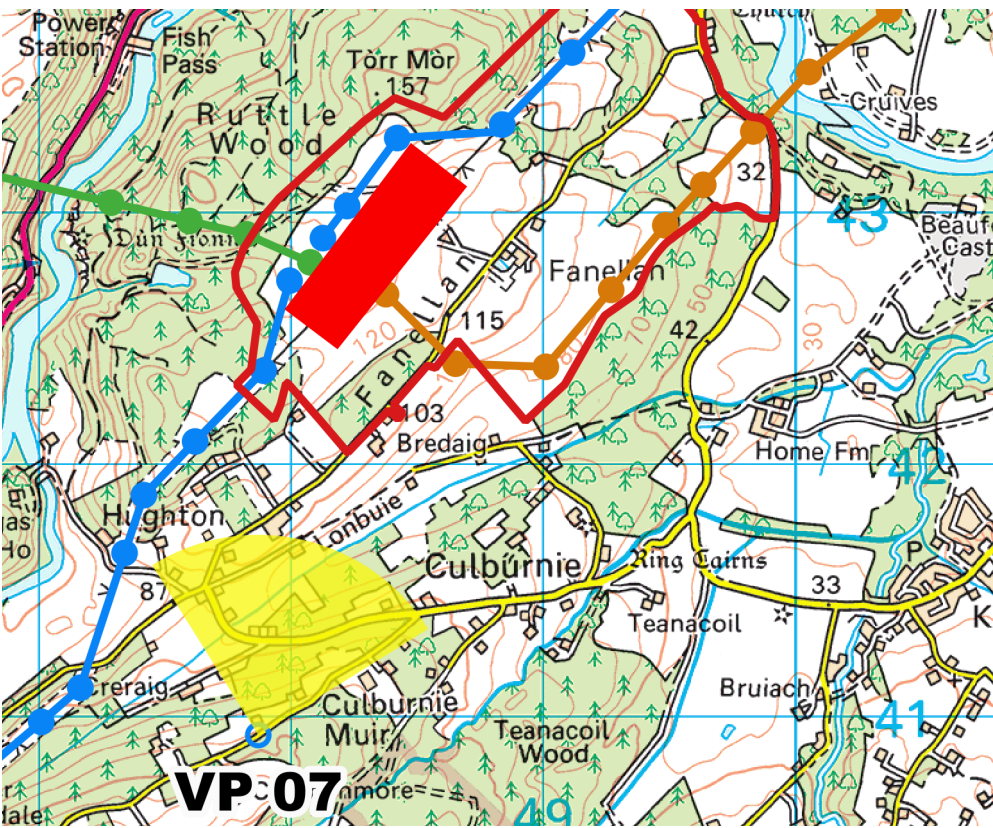






Figure 8.32e Viewpoint 7: View looking north-east from near Craiga  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

Alignment information correct as of 22.12.2024



- Key:**
- Fanelan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024,12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanelan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Craiga  
Operational View  
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

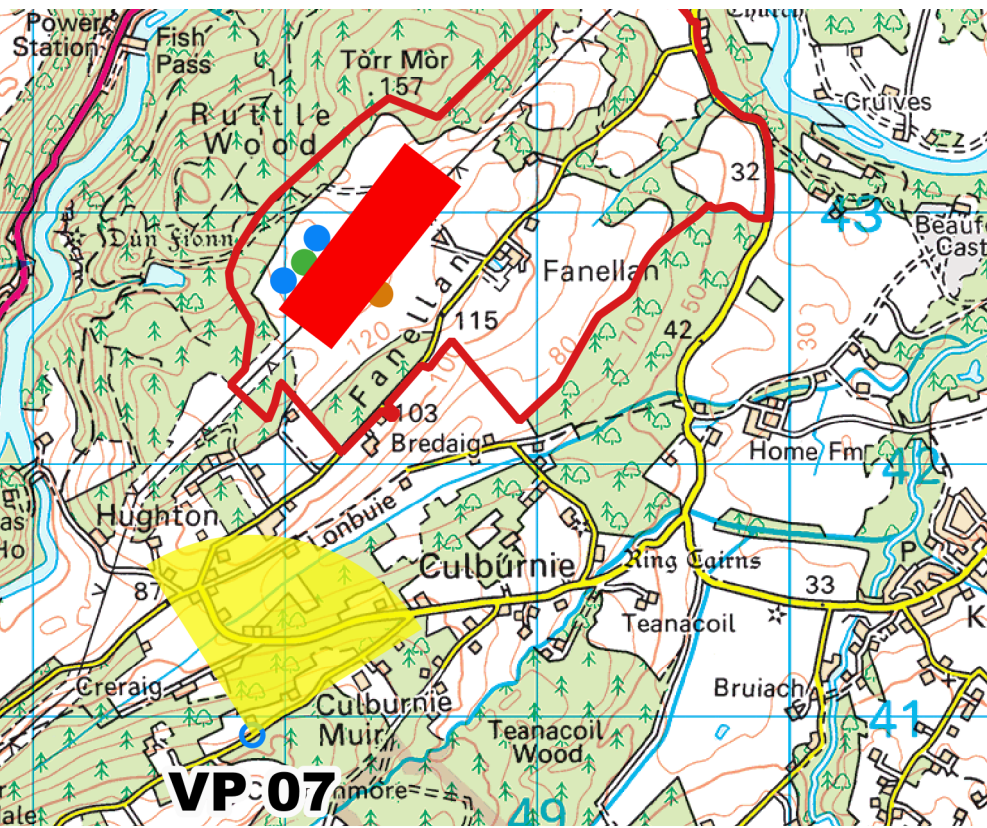






Figure 8.32f Viewpoint 7: View looking north-east from near Creraig  
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative  
Terminal Towers - Year 15)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024, 12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m

**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Creraig  
Operational View  
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)

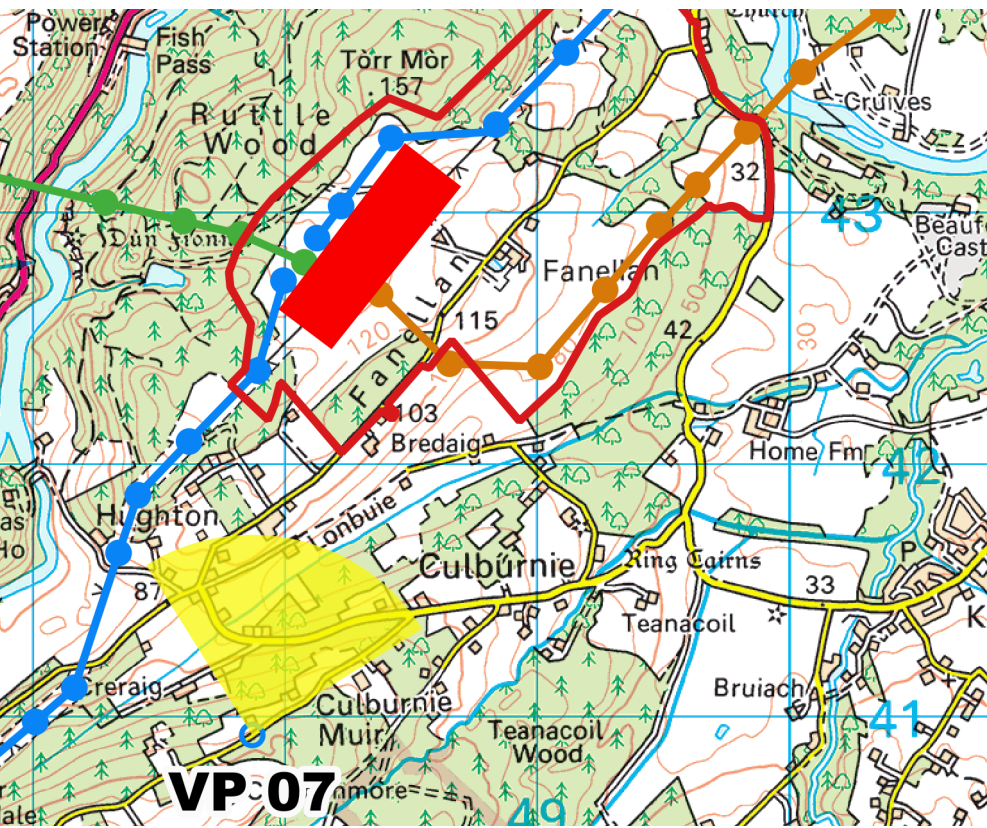






Figure 8.32g Viewpoint 7: View looking north-east from near Craiga  
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
  - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
  - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
  - Proposed Beaully to Denny 400 kV Overhead Line Permanent
  - Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3  
Projection: Cylindrical  
Enlargement Factor: 100% @ A1  
Date and time of photography: 5/3/2024,12:52  
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°  
Viewpoint location: X 247871, Y 840927, AOD 150m  
Distance (in m) to proposed development and direction of view: 1554 m, 13°  
Height of camera above ground: 1.5m


**NOTES:**  
This image provides landscape and visual context only  
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station  
Viewpoint 7: View looking north-east from near Craiga  
Operational View  
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)





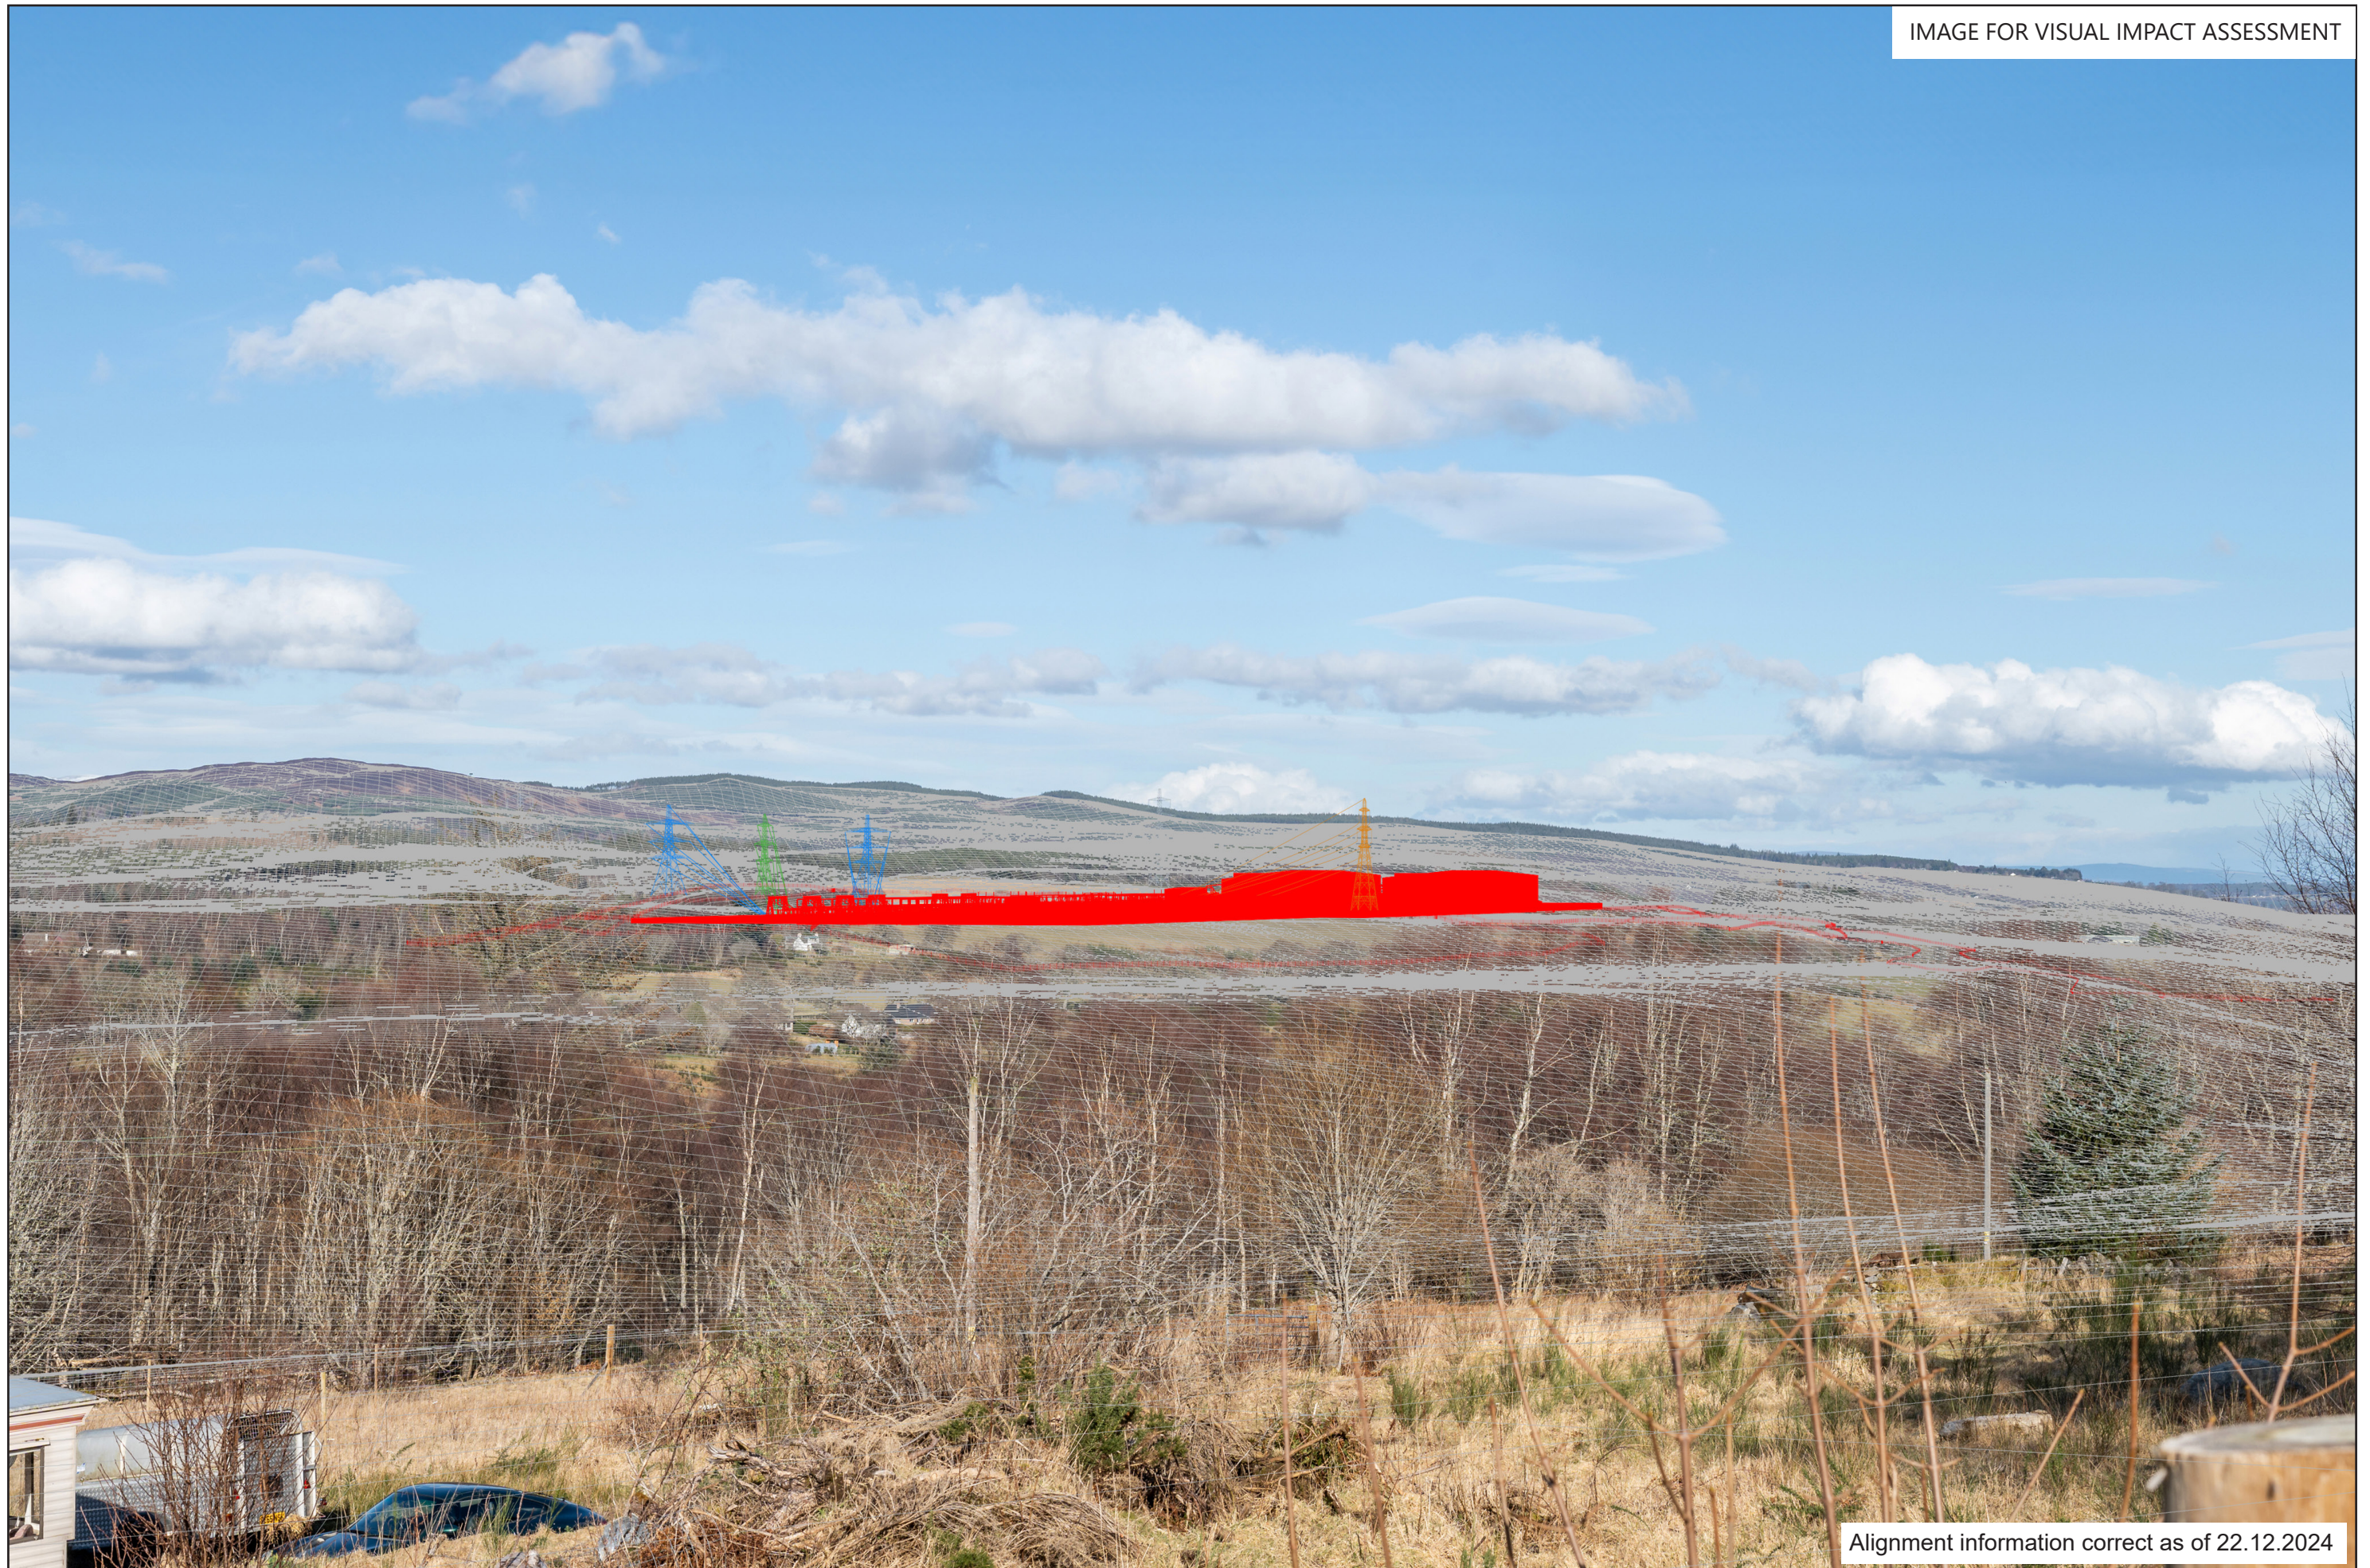

Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-h Viewpoint 7: View looking north-east from near**  
**Creraig**

Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
 Distance to Development and Direction of view: 1554m, 13°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-i Viewpoint 7: View looking north-east from near Creraig**

Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
 Distance to Development and Direction of view: 1554m, 13°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-j Viewpoint 7: View looking north-east from near Creraig**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
 Distance to Development and Direction of view: 1554m, 13°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-k Viewpoint 7: View looking north-east from near Ceraig**

Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
 Distance to Development and Direction of view: 1554m, 13°  
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-I Viewpoint 7: View looking north-east from near Ceraig**

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
Distance to Development and Direction of view: 1554m, 13°  
Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m



TRANSMISSION





Alignment information correct as of 22.12.2024

**Fanellan 400kV Substation & Converter Station**  
**Figure 8.32-m Viewpoint 7: View looking north-east from near Ceraig**  
 Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m  
 Distance to Development and Direction of view: 1554m, 13°  
 Date: 05/03/2024

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION