



A topographic map of the area around Bredaigh. The River Beauty flows from the top left towards the center. To the left of the river is a quarry and a fish pass. The map shows several woods: Rattle Wood, Torr Mor, Fanella, and Balblair Wood. A yellow highlighted area is labeled 'VP 10' and is situated near the river and Balblair Wood. A red highlighted area is labeled '103' and is located near Bredaigh. The map also shows a church, graves, and a castle. The area is bounded by a red line, and there are various contour lines and place names like Houghton, Home Farm, and Bredaigh.

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and
direction of view: 2669 m, 226°
Height of camera above ground: 1.5m


This image is an existing view to support a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Existing View





Figure 8.35b Viewpoint 10: View south-west from Kilmorack
Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)
Alignment information correct as of 22.12.2024

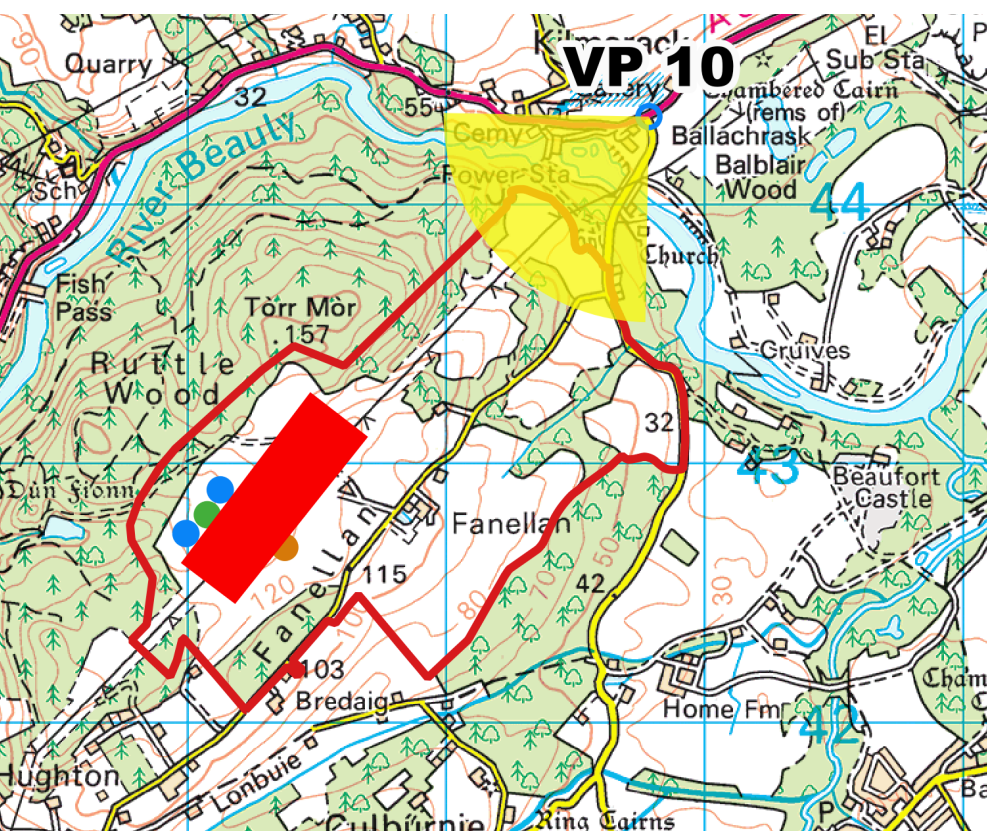

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° **Horizontal Field of View:** 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.


Fanellan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack
Operational View
(Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers)





Figure 8.35c Viewpoint 10: View south-west from Kilmorack
Operational View (Photowire: SSEN Cumulative Overhead Line Schemes Only)

Alignment information correct as of 22.12.2024

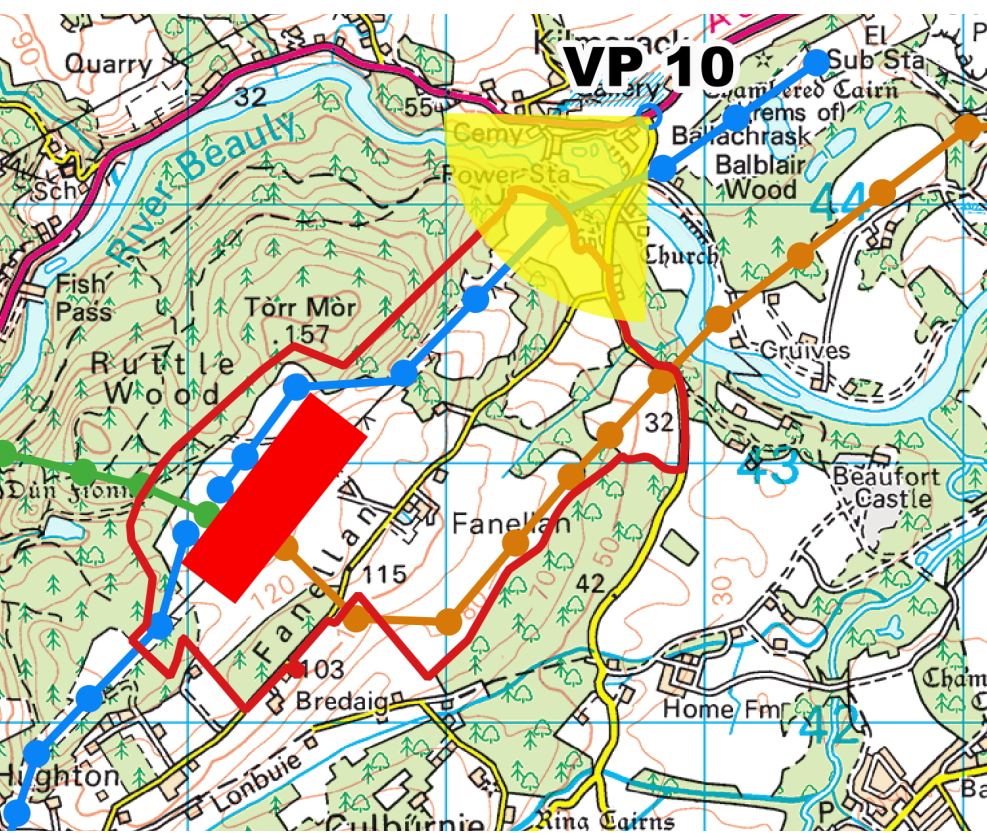

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaulieu to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaulieu 400 kV Overhead Line (SLBB)
 - Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photowire and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack

Operational View
(Photowire: SSEN Cumulative Overhead Line Schemes Only)

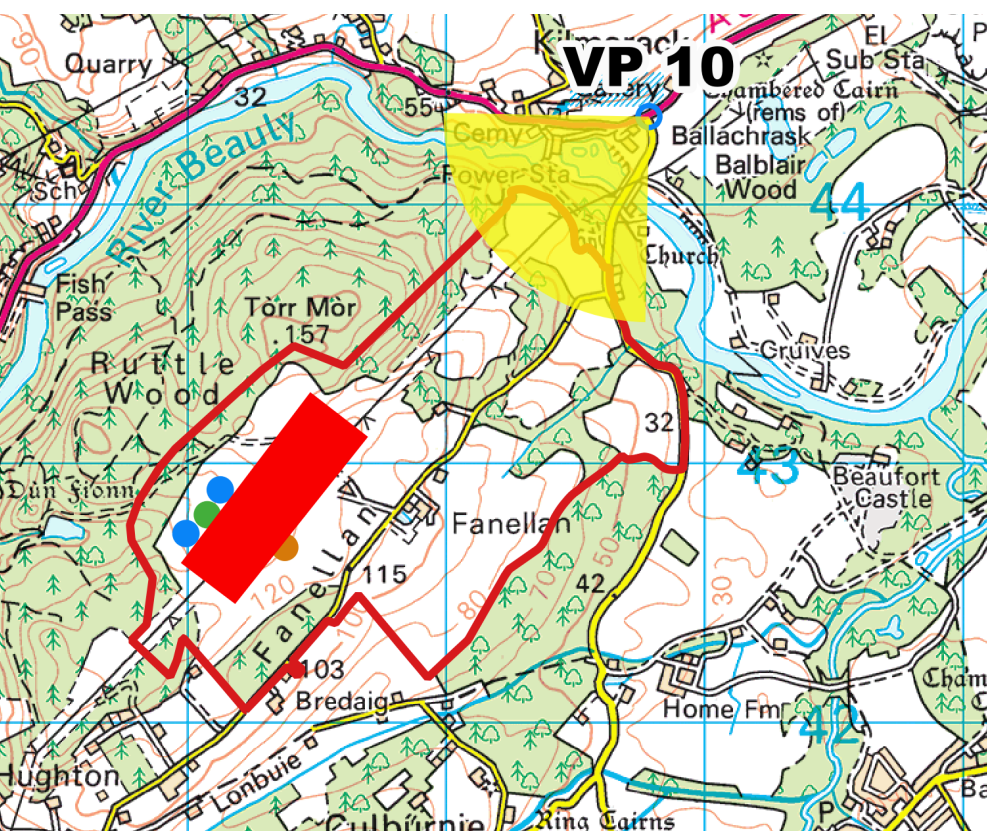




Figure 8.35d Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)

Alignment information correct as of 22.12.2024



- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack


Operational View
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0)





Figure 8.35e Viewpoint 10: View south-west from Kilmorack
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)

Alignment information correct as of 22.12.2024

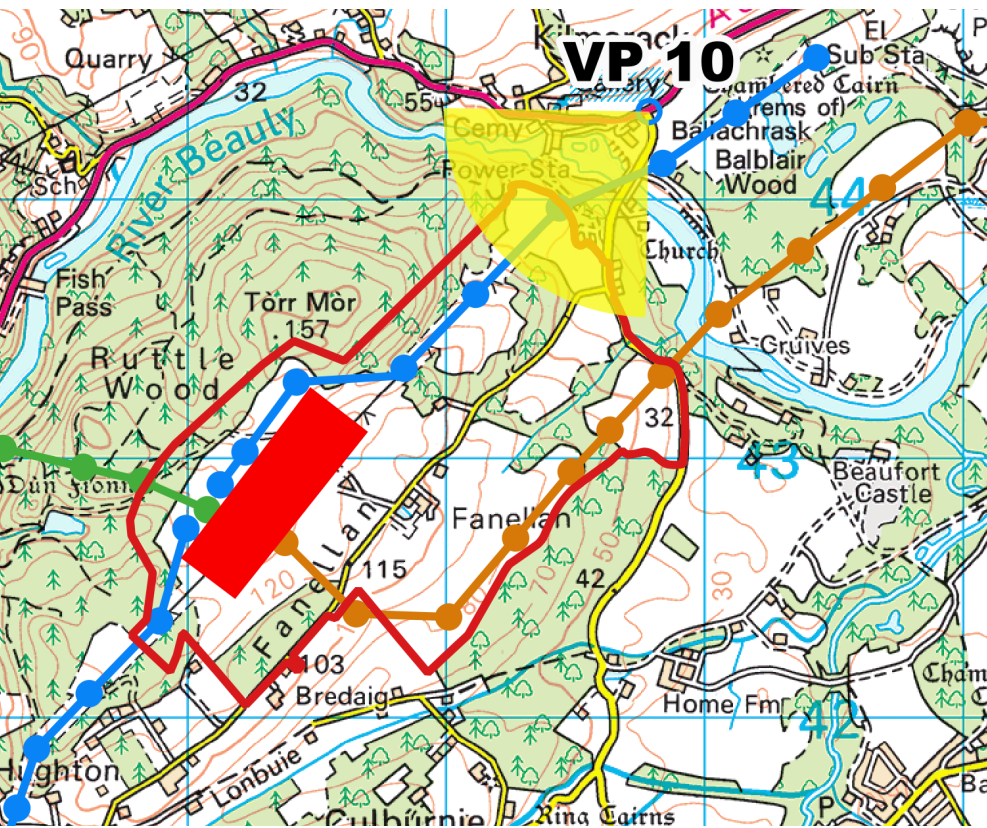

- Key:**
- Fanelan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024,14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanelan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack


Operational View
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 0)





Figure 8.35f Viewpoint 10: View south-west from Kilmorack
Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)

Alignment information correct as of 22.12.2024

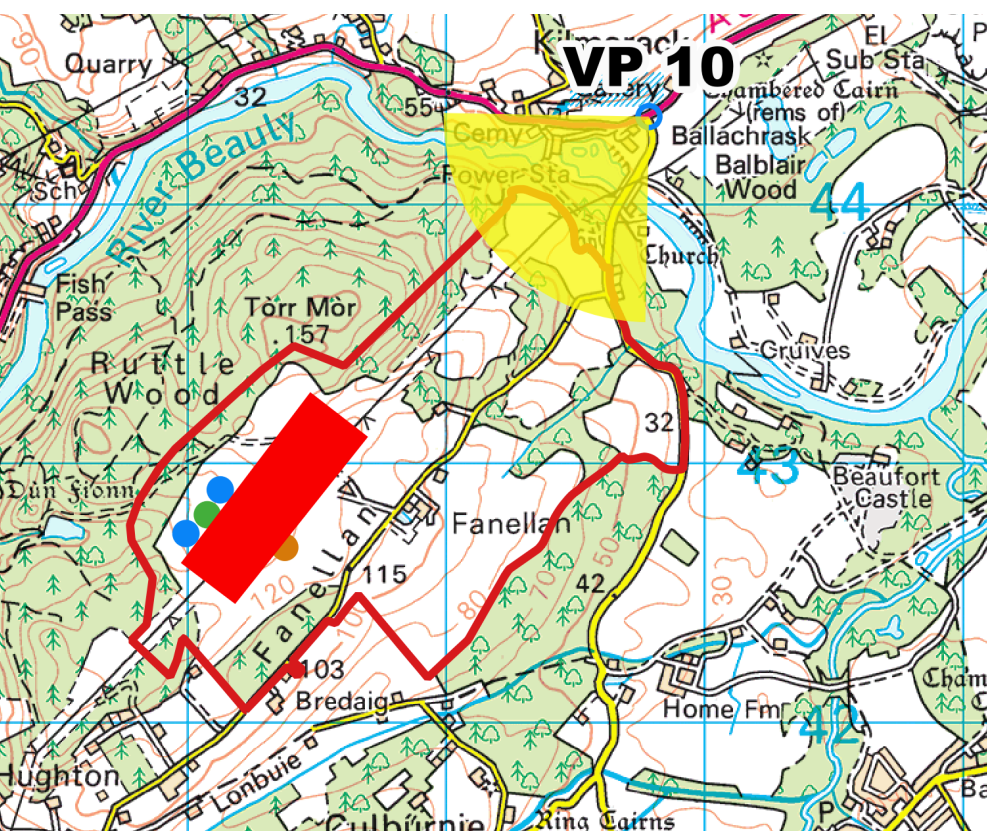

- Key:**
- Fanellan 400kV Substation & Converter Station
 - Proposed Beaully to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beaully 400 kV Overhead Line (SLBB)
 - Proposed Beaully to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024, 14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanellan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack


Operational View
(Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 15)





Figure 8.35g Viewpoint 10: View south-west from Kilmorack
Operational View (Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)

Alignment information correct as of 22.12.2024

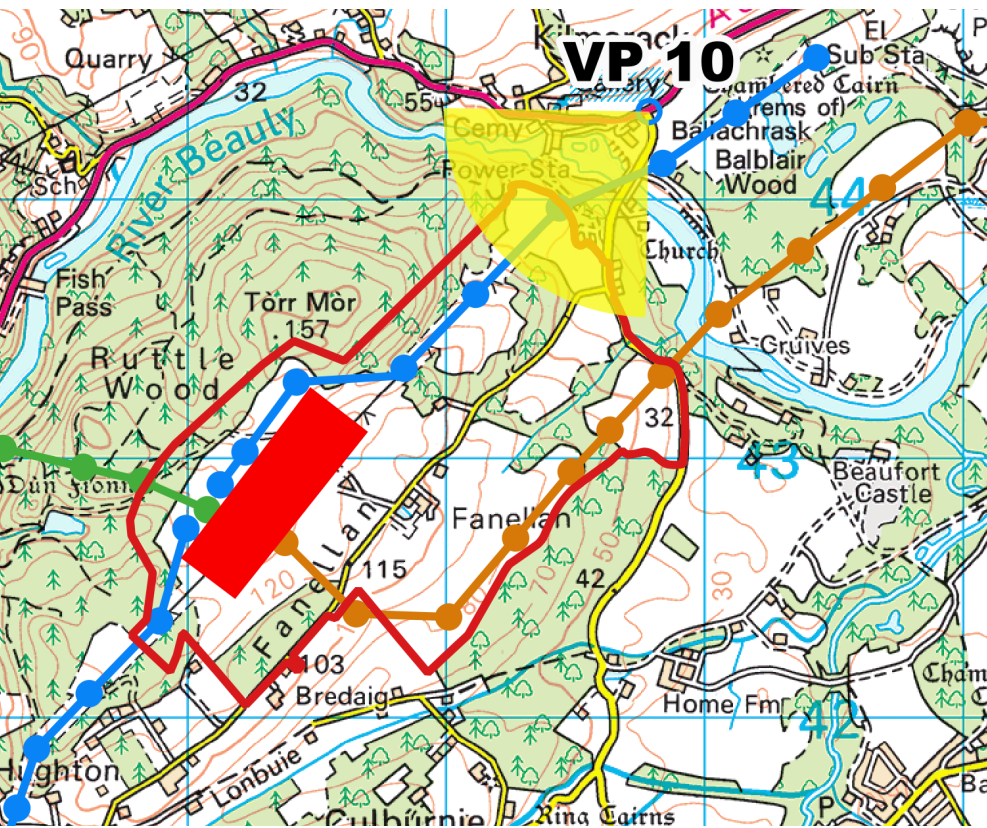

- Key:**
- Fanelan 400kV Substation & Converter Station
 - Proposed Beauly to Peterhead 400 kV Overhead Line (BBNP)
 - Proposed Spittal to Beauly 400 kV Overhead Line (SLBB)
 - Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins (to the Proposed Development)

Visualisation Type: Type 3
Projection: Cylindrical
Enlargement Factor: 100% @ A1
Date and time of photography: 5/3/2024,14:42
Camera & lens: Sony ILCE-7M4, 50mm

Vertical Field of View: 39.6° Horizontal Field of View: 90°
Viewpoint location: X 249785, Y 844337, AOD 33m
Distance (in m) to proposed development and direction of view: 2669 m, 226°
Height of camera above ground: 1.5m

NOTES:
This image provides landscape and visual context only
View flat at a comfortable arm's length. If viewing on screen enlarge to full screen to gain an overview, enlarge to 100% to have a reasonable impression of the size of the development in the view.

This image is a Type 3 photomontage and has been produced in accordance with Landscape Institute Technical Guidance Note 06/19.

Fanelan 400kV Substation & Converter Station
Viewpoint 10: View south-west from Kilmorack

Operational View
(Photomontage: SSEN Cumulative Overhead Line Schemes Only - Year 15)





Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-h Viewpoint 10: View south-west from Kilmorack
 Operational View (Photowire: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-i Viewpoint 10: View south-west from Kilmorack
 Operational View (Photowire: SSSEN Cumulative Overhead Line Schemes Only) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-j Viewpoint 10: View south-west from Kilmorack
 Operational View (Photomontage: Fanellan 400kV Substation & Converter Station & SSEN Cumulative Terminal Towers - Year 0) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-k Viewpoint 10: View south-west from Kilmorack
 Operational View (Photomontage: SSEN Cumulative Overhead Line
 Schemes Only - Year 0) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-I Viewpoint 10: View south-west from Kilmorack

Operational View (Photomontage: Fanellan 400kV Substation & Converter Station
 & SSEN Cumulative Terminal Towers - Year 15) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Alignment information correct as of 22.12.2024

Fanellan 400kV Substation & Converter Station
Figure 8.35-m Viewpoint 10: View south-west from Kilmorack
 Operational View (Photomontage: SSEN Cumulative Overhead Line
 Schemes Only - Year 15) - 50mm

Viewpoint Location: X 249785, Y 844337 AOD: 33m
 Distance to Development and Direction of view: 2669m, 226°
 Date: 05/03/2024

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*



TRANSMISSION