


Mapped Location

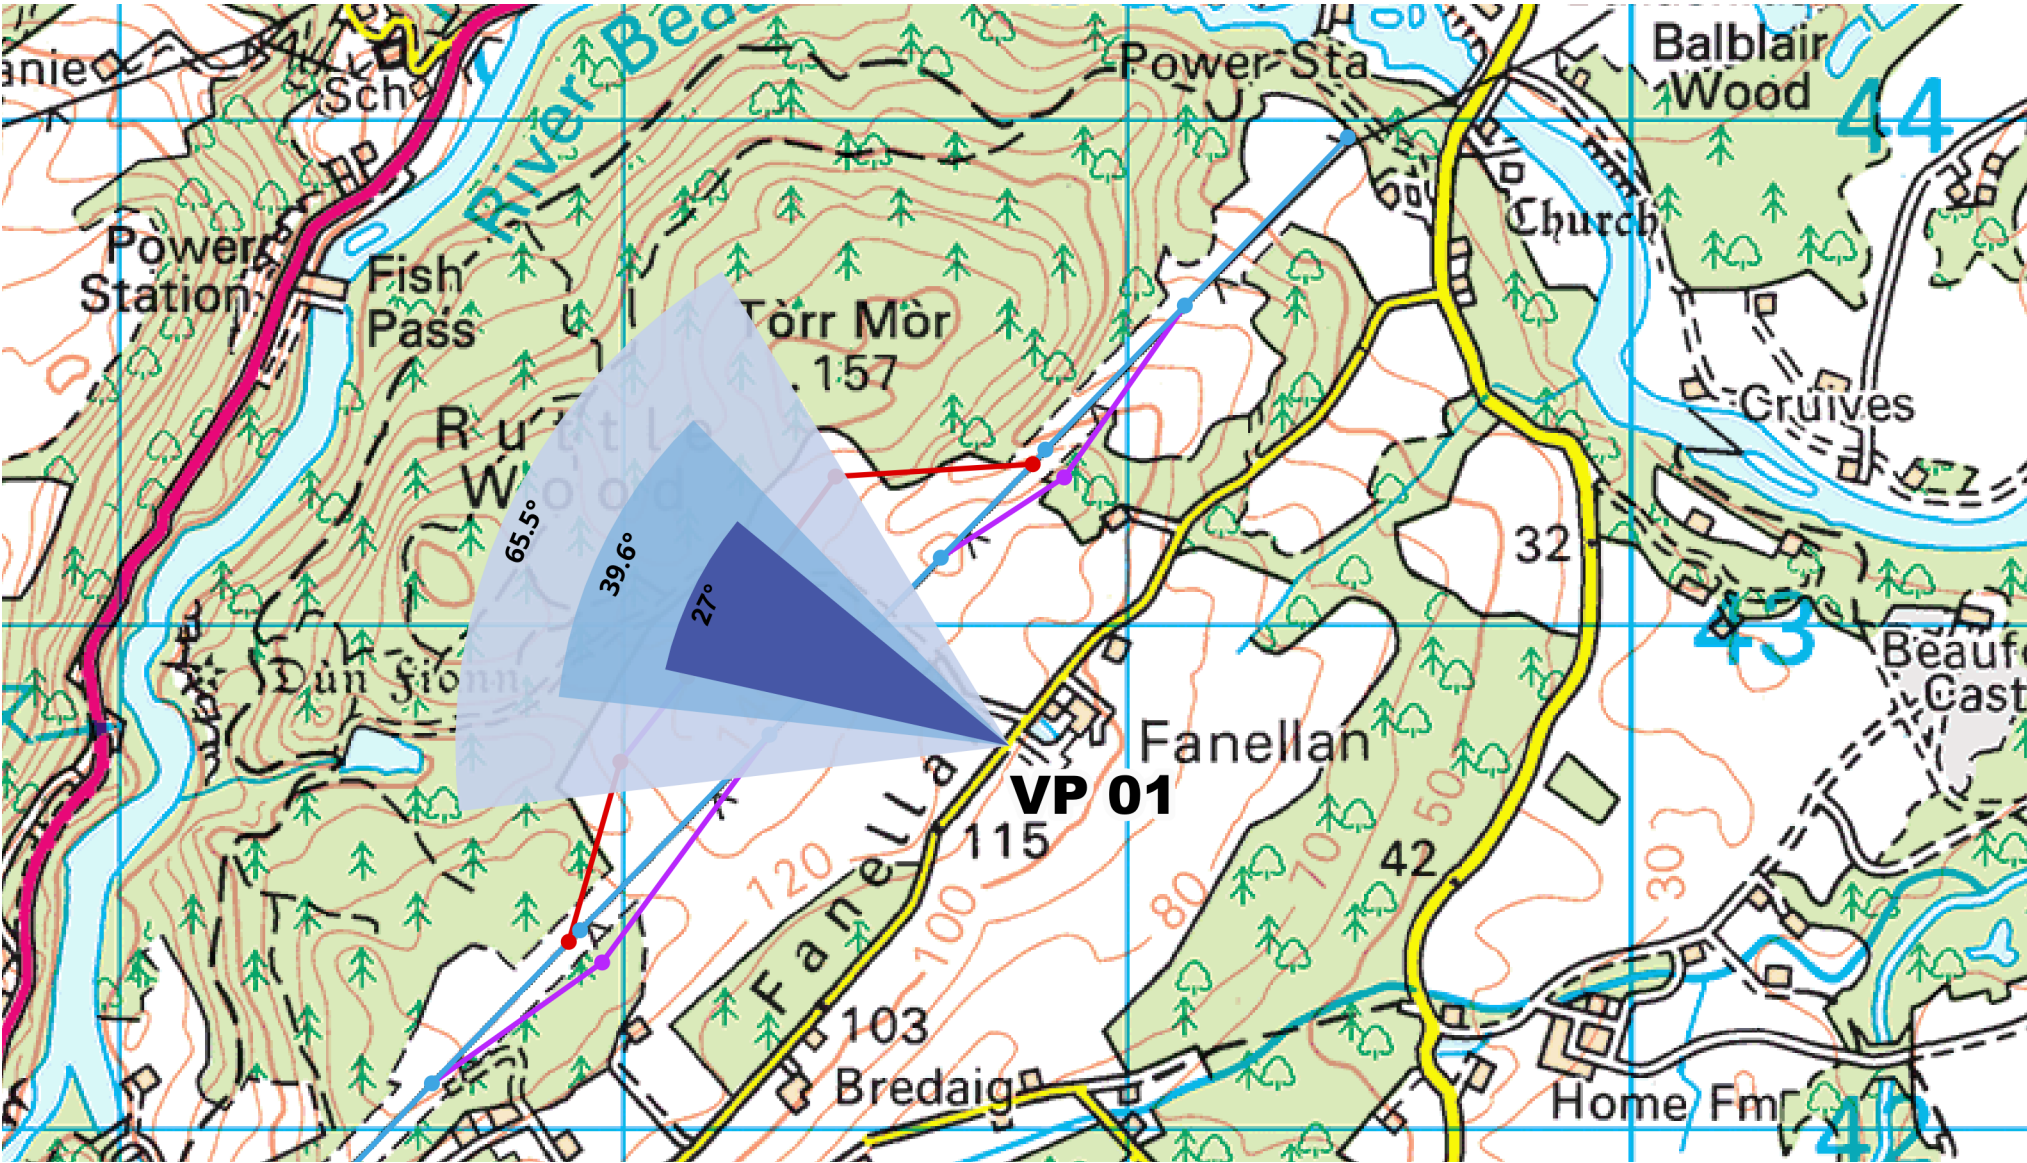

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.5a
Viewpoint Visualisations
Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages

Location Description:
The viewpoint is on Fanellan Road, just north of the area Lonbuie. Parking is situated directly adjacent to the viewpoint. The viewpoint can be accessed via foot from parking area

Camera Location




Location Data

OSGB36 Location:	248767 842759
AOD:	108m
Camera Height:	1.5m
Distance to Development:	259m



Alignment information correct as of 22.12.2024

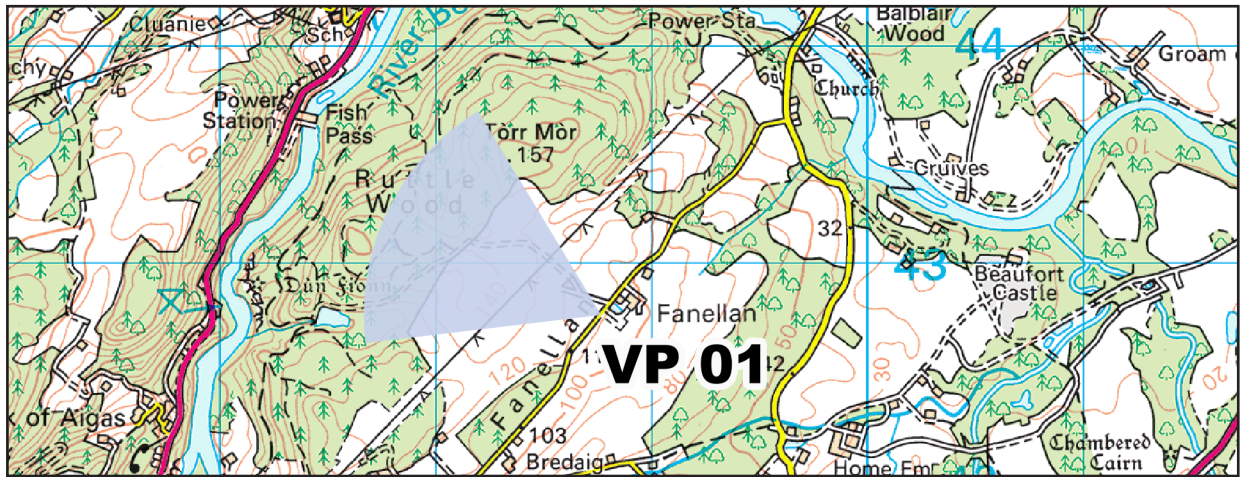

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.5b
Viewpoint 1: View looking west from Fanellan Road at
Fanellan Cottages**

Viewpoint Location: X 248767, Y 842759
AOD: 108m
Distance to Development and Direction of view: 259m, 296° (South)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptors represented: Residents off Fanellan Road including Fanellan Croft and Fanellan Cottages. Road users travelling along Fanellan Road.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



TRANSMISSION



Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.5-d Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages

Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m
 Distance to Development and Direction of view: 259m, 296°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.5-e Viewpoint 1: View looking west from Fanellan Road at Fanellan Cottages
 Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 248767, Y 842759 AOD: 108m
 Distance to Development and Direction of view: 259m, 296°
 Date: 05/03/2024
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m

