


Mapped Location

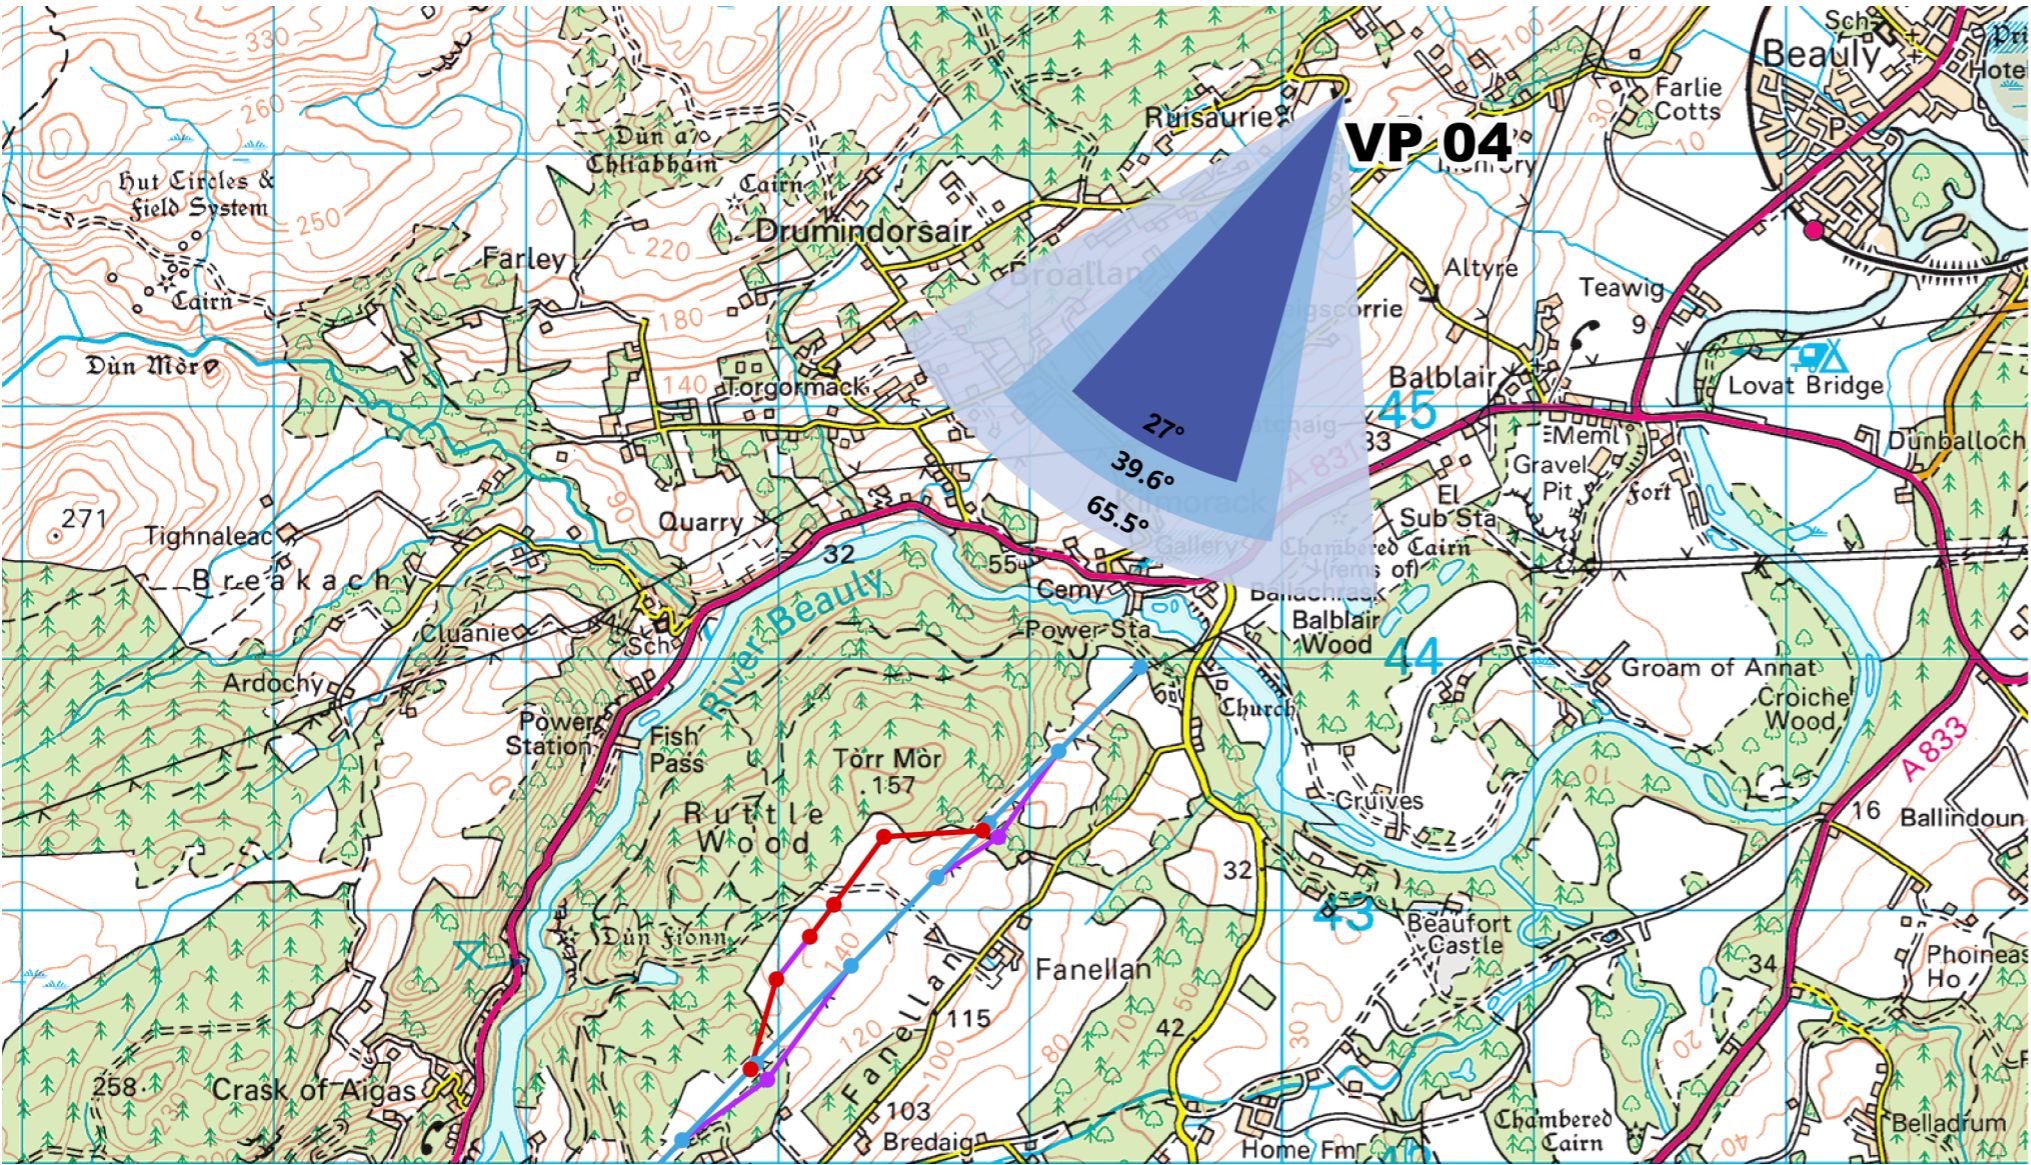

Key:

- Existing Beaulay to Denny 400 kV Overhead Line
- Proposed Beaulay to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulay to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulay to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.8a
Viewpoint 4: View looking south-west from Ruisaurie**

Location Description:
The viewpoint is on an unnamed road in Ruisaurie, 150 m northeast of Drumindorsair Road, on the southern side of the road opposite a steel gate within the embankment. There is a layby for parking approximately 50 m southwest and the viewpoint can be accessed on foot on the quiet road.

Camera Location




Location Data

OSGB36 Location:	250248 846239
AOD:	126m
Camera Height:	1.5m
Distance to Development:	3482m





Alignment information correct as of 22.12.2024

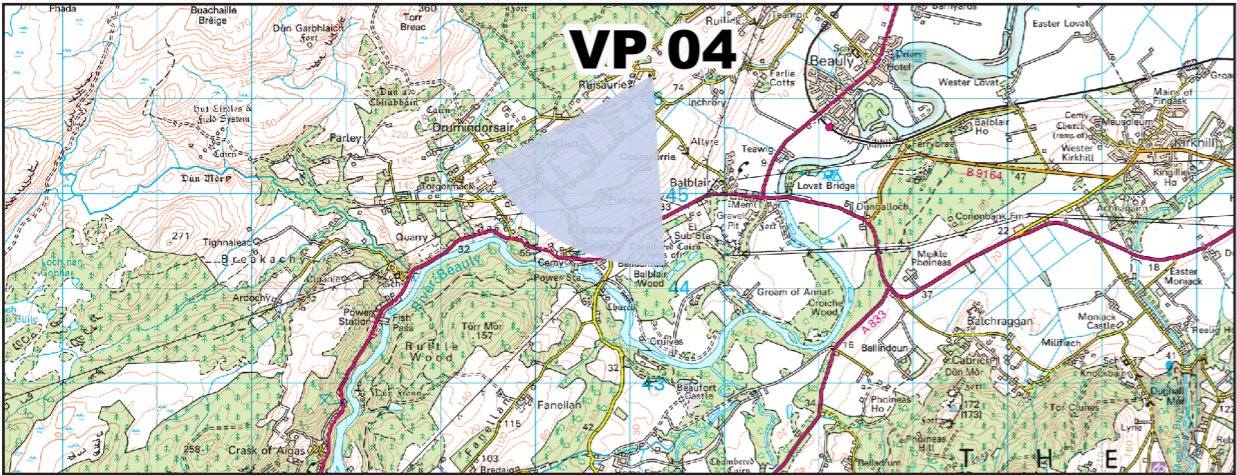

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.8b
Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239
AOD: 126m
Distance to Development and Direction of view: 3482m, 209°
(South-West)

Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruislick, Ruisaurie and Drumindorsair to the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.
The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Operational View (Baseline) - 65.5°

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024





Alignment information correct as of 22.12.2024

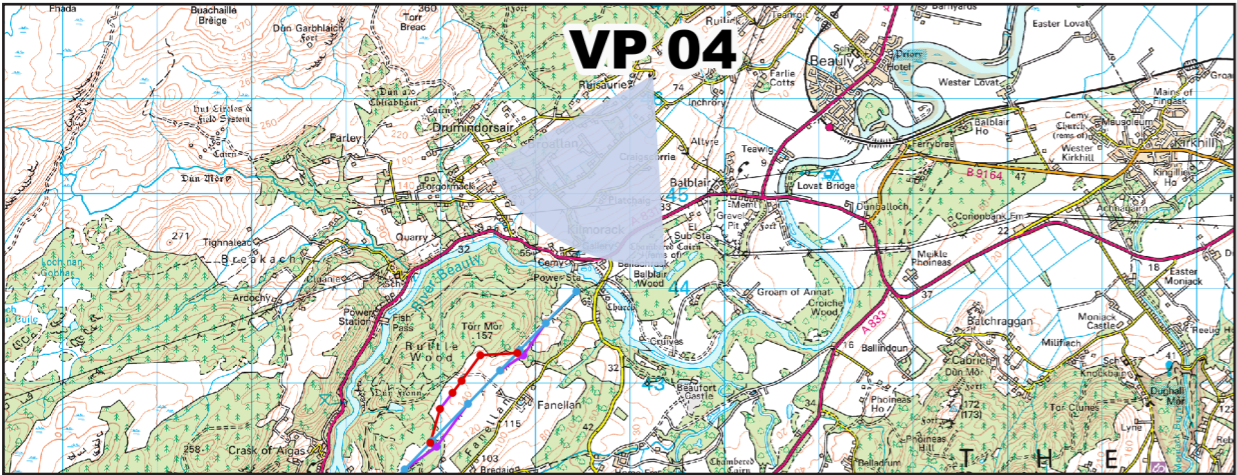

Receptor list: Residents at Ruisaurie. Road users of the route connecting Ruilick, Ruisaurie and Drumindorsair to the A831.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT345 Farmed and Forested Slopes – Ross & Cromarty.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Existing Beauly to Denny 400 kV Overhead Line
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beauly to Denny 400 kV Overhead Line Diversion

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.8c
Viewpoint 4: View looking south-west from Ruisaurie**

Viewpoint Location: X 250248, Y 846239
AOD: 126m
Distance to Development and Direction of view: 3482m, 209°
(South-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



**Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV
Substation & Converter Station SSEN Proposed Site) - 65.5°**



Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.8-d Viewpoint 4: View looking south-west from Ruisaurie

Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m
 Distance to Development and Direction of view: 3482m, 209°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.8-e Viewpoint 4: View looking south-west from Ruisaurie

Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 250248, Y 846239 AOD: 126m
 Distance to Development and Direction of view: 3482m, 209°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION