


Mapped Location

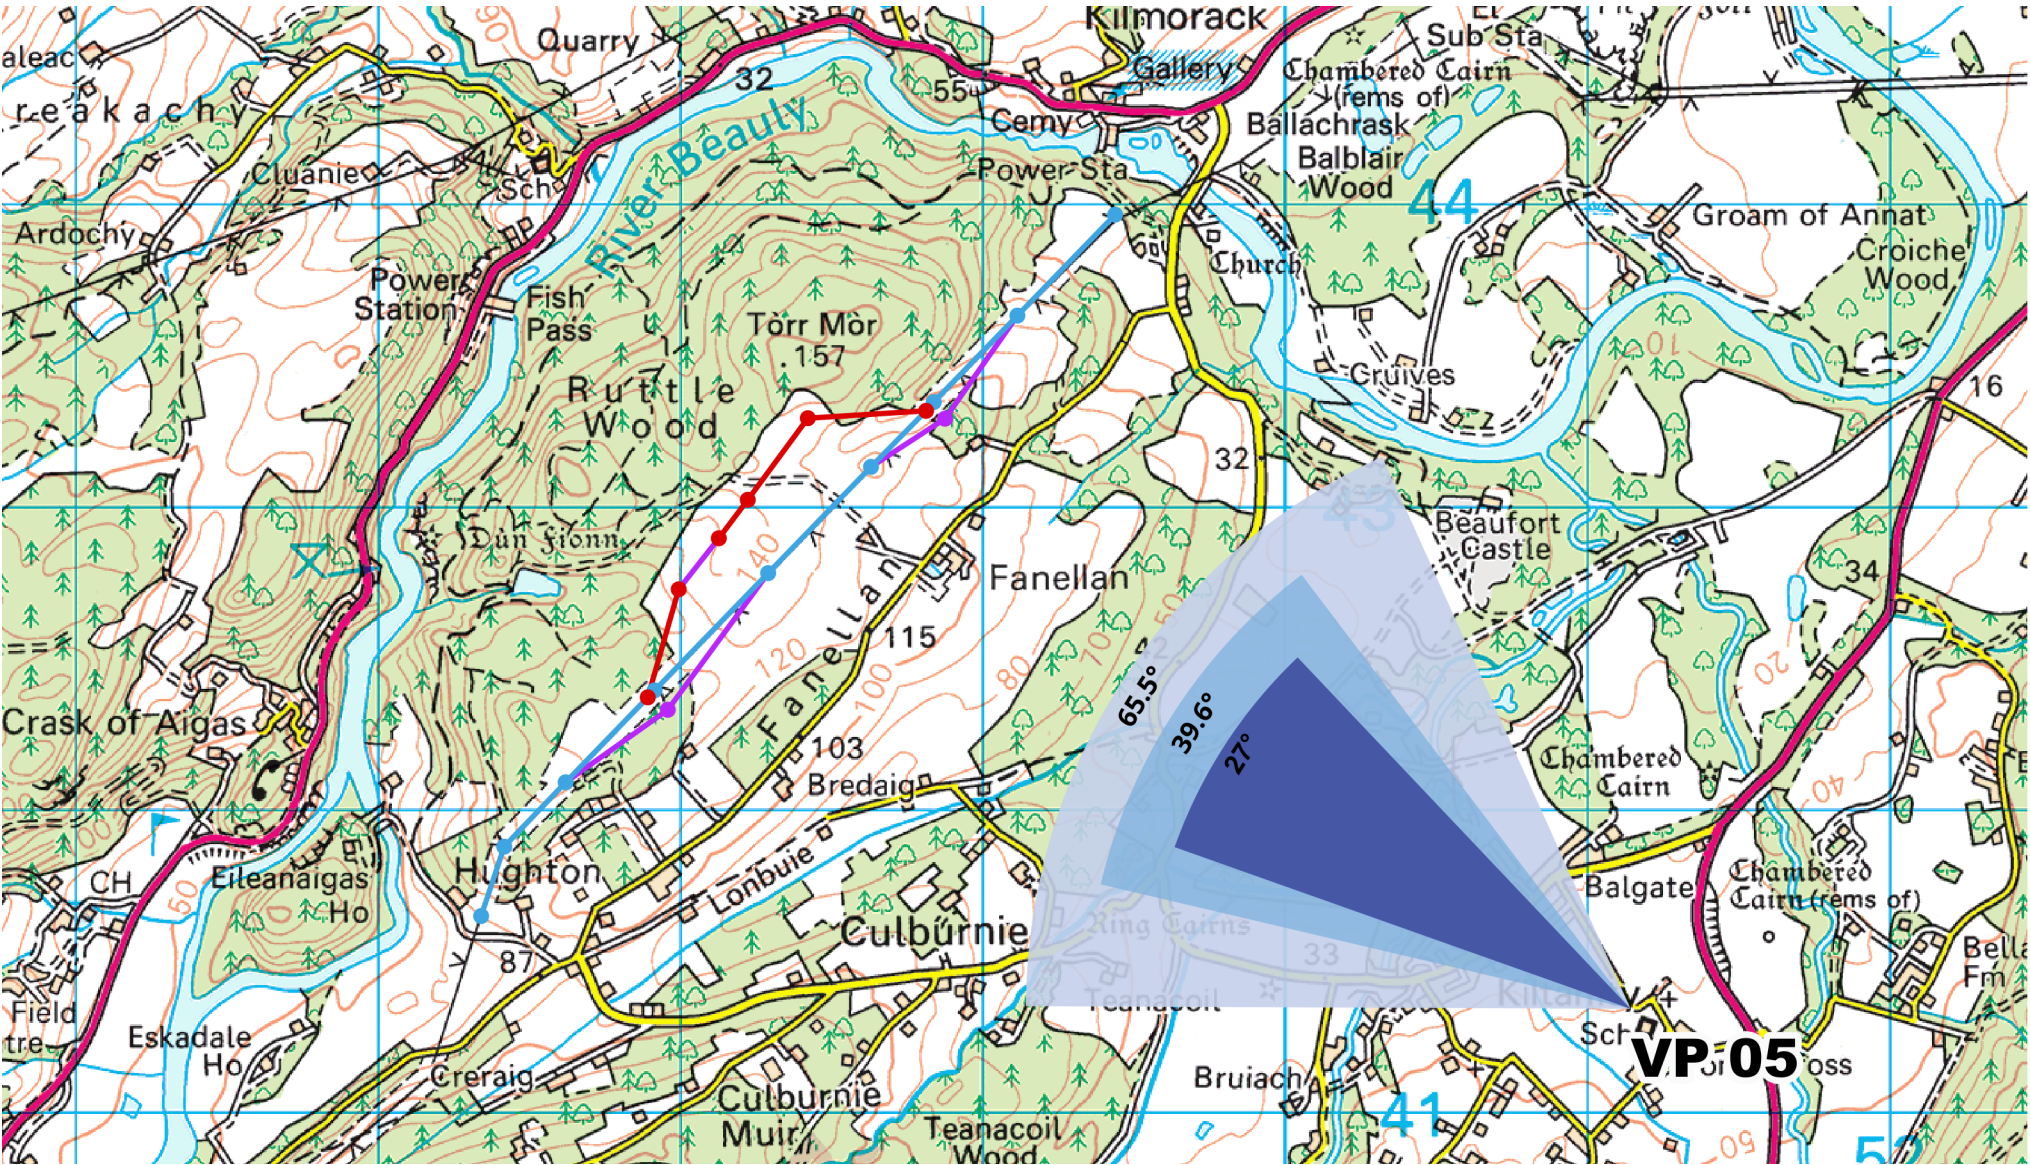

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations**

Figure 5.9a

**Viewpoint 5: View looking north-west from Tomnacross Primary
School entrance (south of Kiltarity)**

Location Description:

The viewpoint is on an unnamed road in Kiltarity, Beaulieu. The viewpoint is next to Tomnacross Primary School and Kiltarity Church of Scotland. Parking can be accessed here. The viewpoint is a short walk from the parking area and is on a quiet road.

Camera Location




Location Data

OSGB36 Location:	251143 841342
AOD:	43m
Camera Height:	1.5m
Distance to Development:	3036m





Alignment information correct as of 22.12.2024

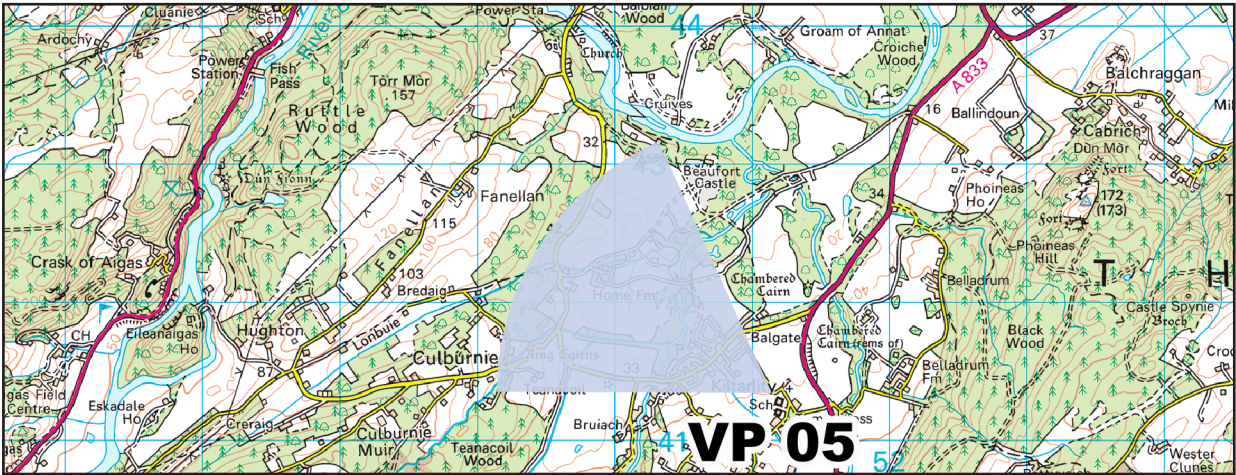

Receptor list: Residents at Tomnacross and Kiltarity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.
This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.9b
Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarity)**

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



Operational View (Baseline) - 65.5°



Alignment information correct as of 22.12.2024

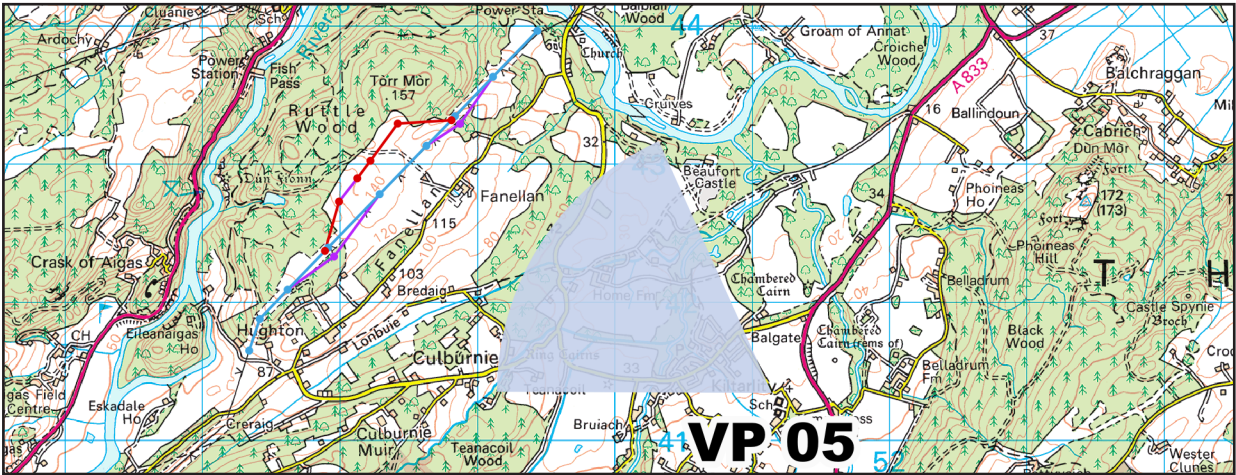

Receptor list: Residents at Tomnacross and Kiltarlity. Tourists visiting the area; Users of Core path IN20.07. Road users of the connecting route between the A833 and Allarburn Drive.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT 229 - Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.9c**

**Viewpoint 5: View looking north-west from Tomnacross
Primary School entrance (south of Kiltarlity)
Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV
Substation & Converter Station SSEN Proposed Site) - 65.5°**

Viewpoint Location: X 251143, Y 841342
AOD: 43m
Distance to Development and Direction of view: 3036m, 303°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024





Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.9-d Viewpoint 5: View looking north-west from Tomnacross Primary School entrance (south of Kiltarity)
 Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024
*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.9-e Viewpoint 5: View looking north-west from Tomnacross Primary School
entrance (south of Kiltarity)

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 251143, Y 841342 AOD: 43m
 Distance to Development and Direction of view: 3036m, 303°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION