


Mapped Location

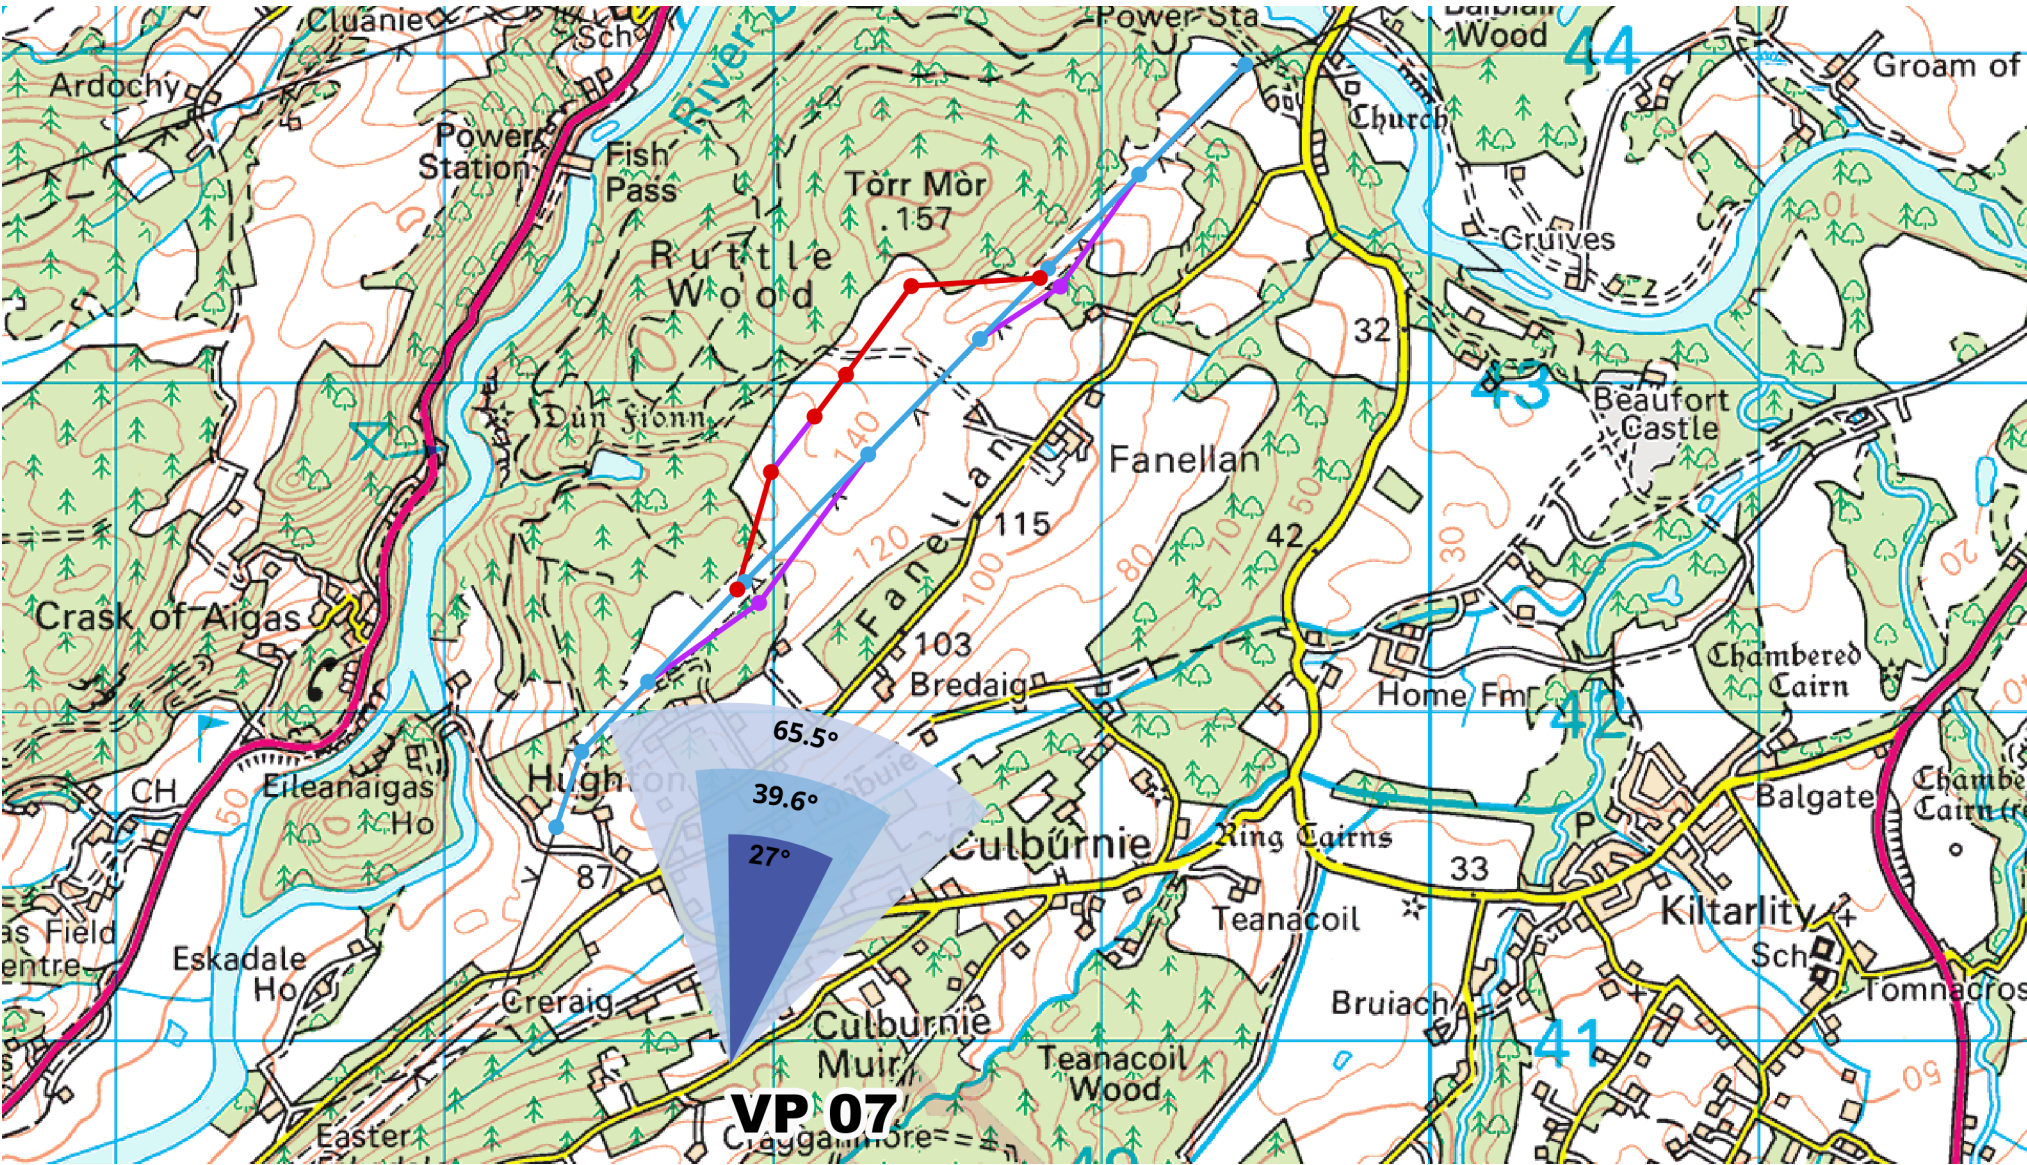

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.11a
Viewpoint 7: View looking north-east from near Creraig**

Location Description:
The viewpoint is on an unnamed single-track road linking the areas of Creraig and Culburnie. The viewpoint is from the western side of the road where the verge widens slightly. There is a large layby for parking, approximately 400 m west of the viewpoint. The viewpoint can be accessed on foot on the quiet road.

Camera Location




Location Data

OSGB36 Location:	247871 840927
AOD:	150m
Camera Height:	1.5m
Distance to Development:	1554m





Alignment information correct as of 22.12.2024

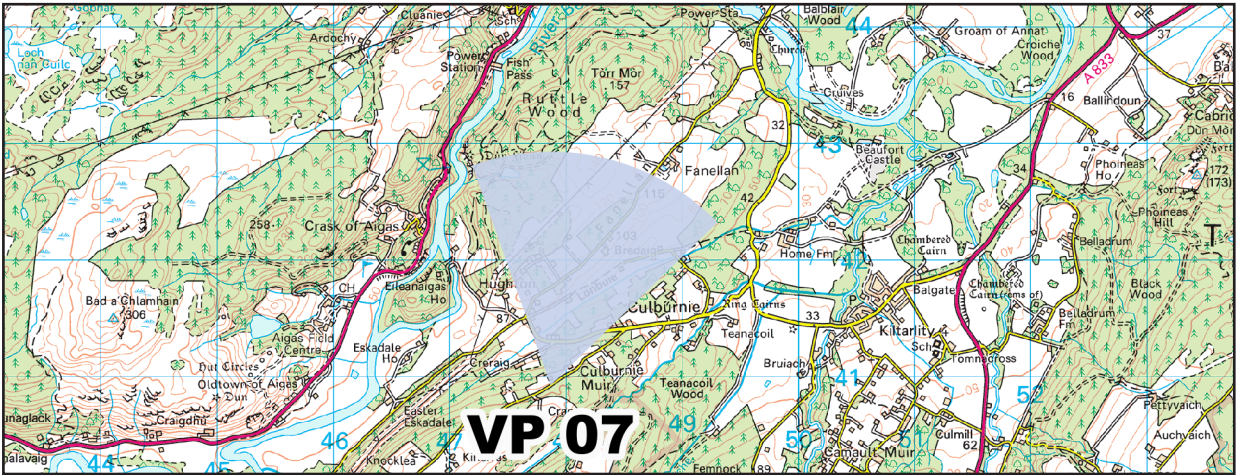

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.11b
Viewpoint 7: View looking north-east from near Creraig**

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



Operational View (Baseline) - 65.5°



Alignment information correct as of 22.12.2024

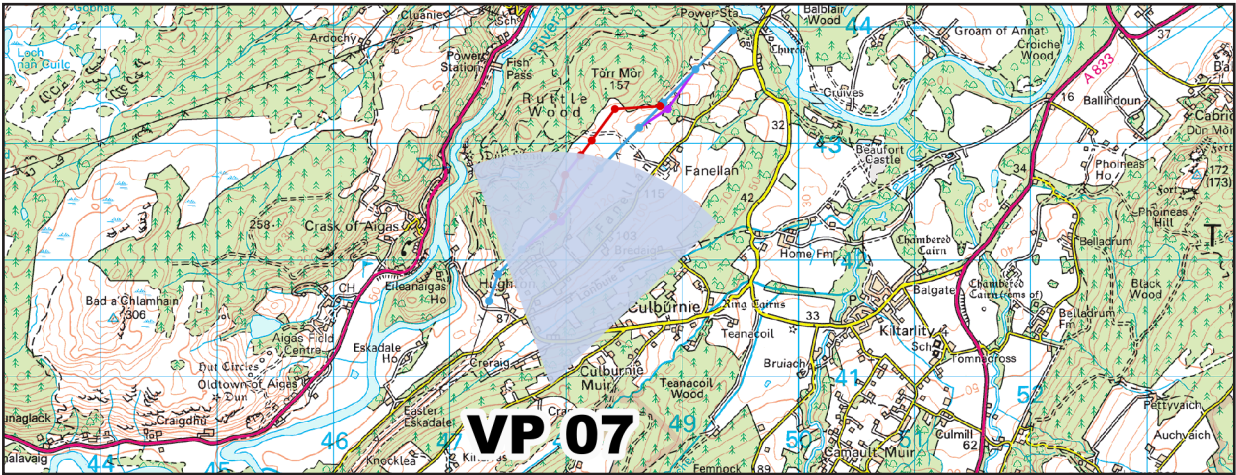

Receptor list: Residents of scattered dwellings associated with Creraig. Rural road users of the route connecting Creraig and Culburnie.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Existing Beauly to Denny 400 kV Overhead Line
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beauly to Denny 400 kV Overhead Line Diversion

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.11c
Viewpoint 7: View looking north-east from near Creraig**

Viewpoint Location: X 247871, Y 840927
AOD: 150m
Distance to Development and Direction of view: 1554m, 13°
(North-East)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



**Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV
Substation & Converter Station SSEN Proposed Site) - 65.5°**



Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.11-d Viewpoint 7: View looking north-east from near Creraig

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.11-a Viewpoint 7: View looking north-east from near Creraig

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 247871, Y 840927 AOD: 150m
 Distance to Development and Direction of view: 1554m, 13°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION