


Mapped Location

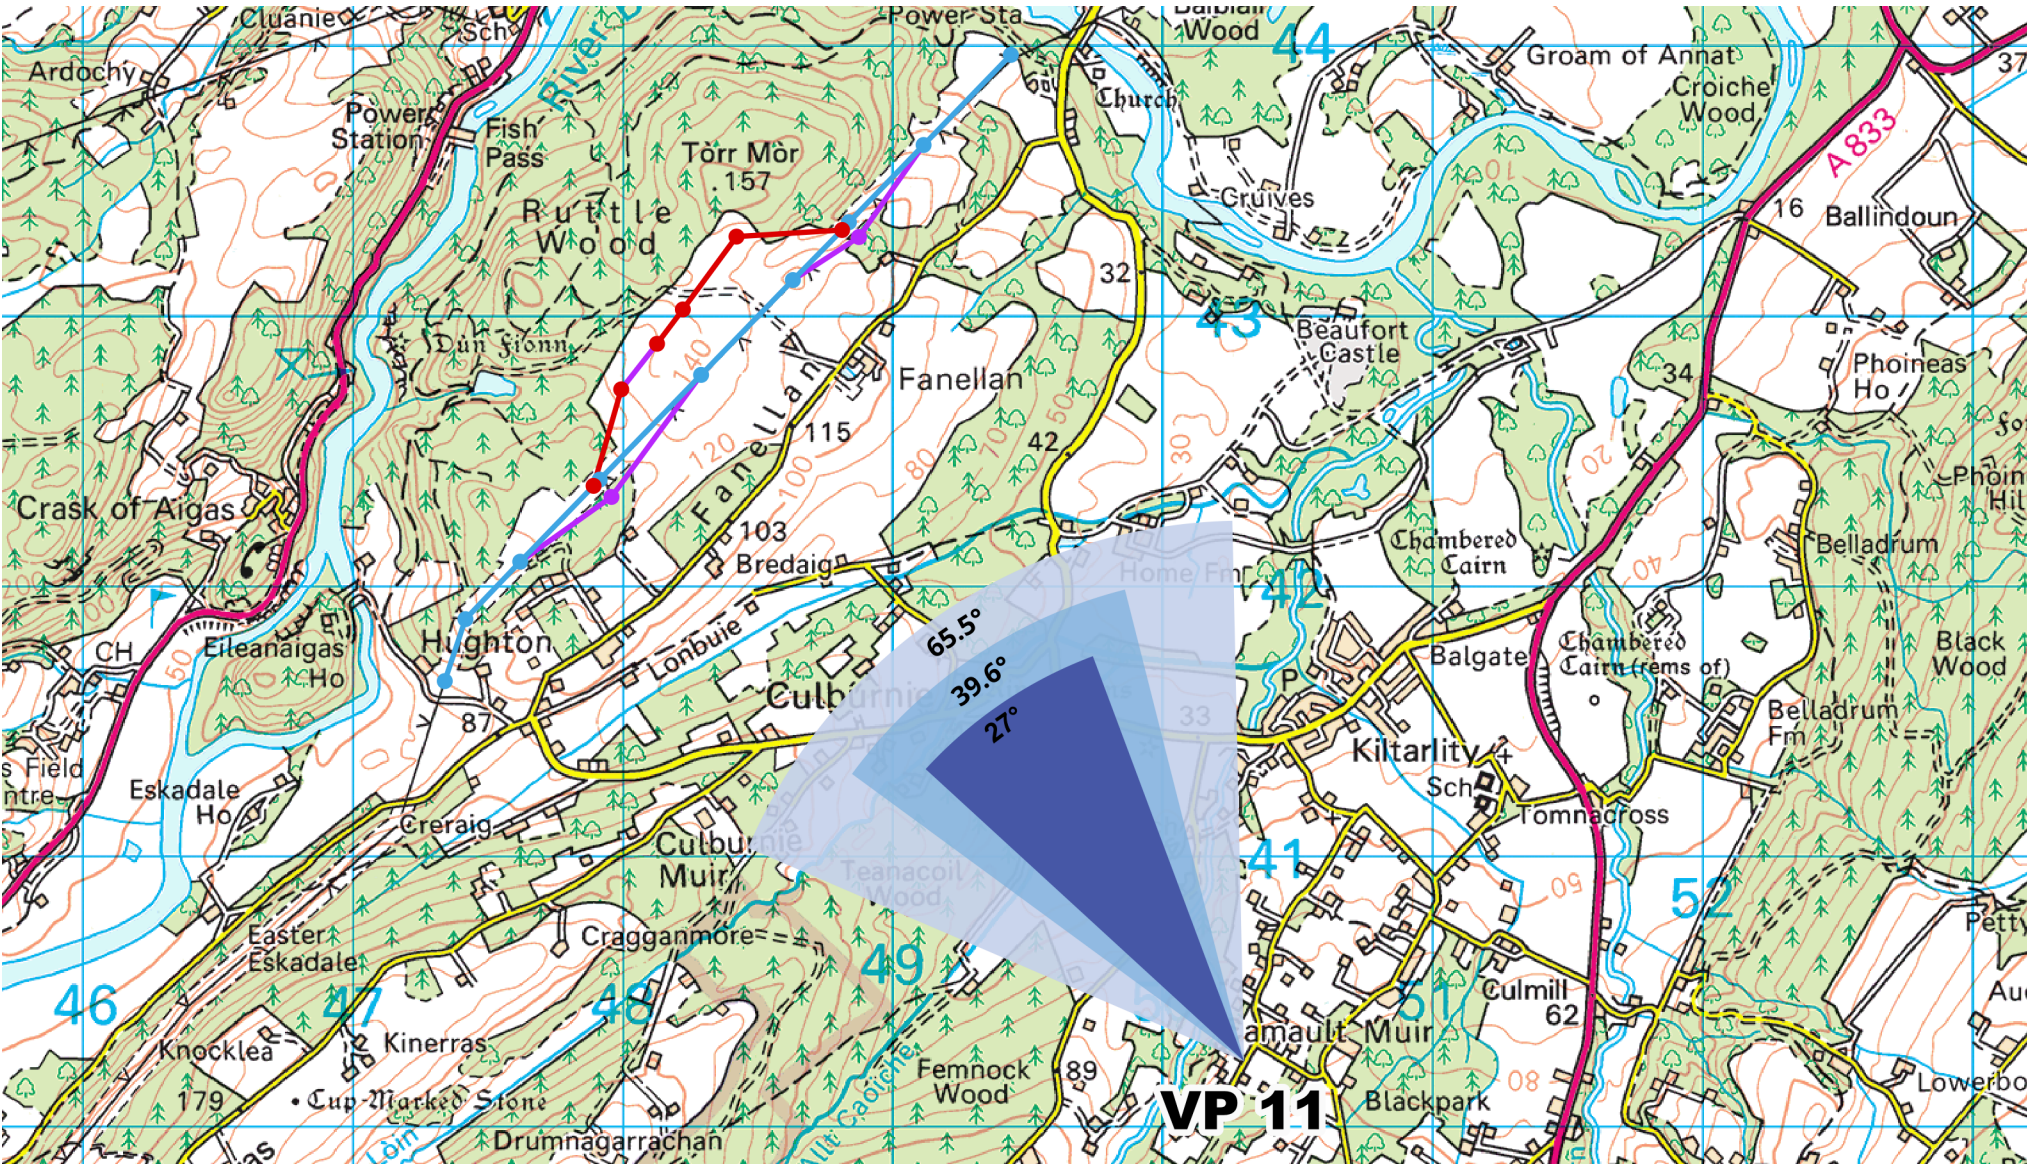

Key:

- Existing Beaully to Denny 400 kV Overhead Line
- Proposed Beaully to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaully to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaully to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.15a
Viewpoint 11: View north-west from Camault Muir and Glaiachbea**

Location Description:
The viewpoint is on Loaneckhaim, Kiltarlity. Parking is available just south of the viewpoint in Highland Liliums Garden Centre.

Camera Location




Location Data

OSGB36 Location:	250302 840242
AOD:	88m
Camera Height:	1.5m
Distance to Development:	3101m





Alignment information correct as of 22.12.2024

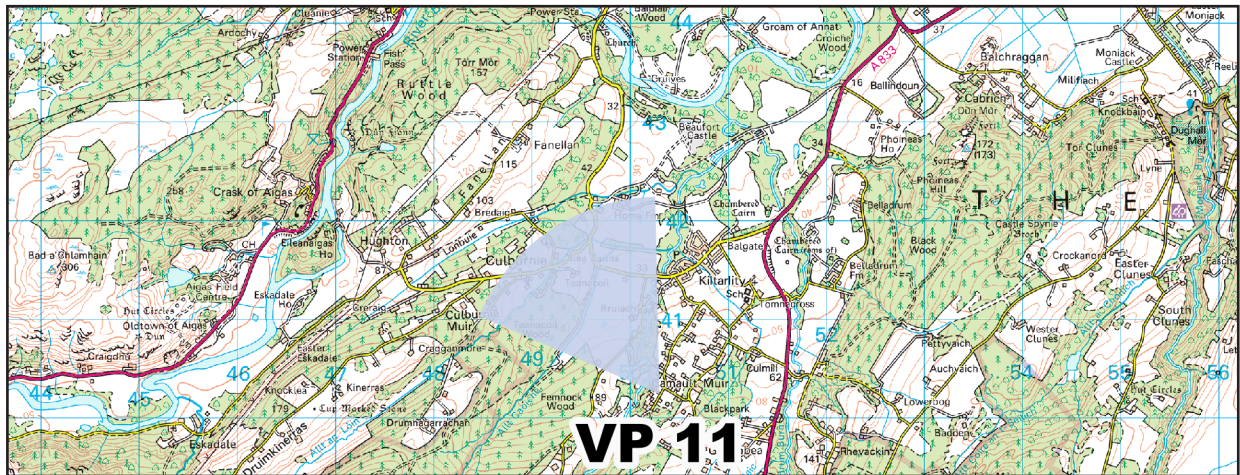

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.15b
Viewpoint 11: View north-west from Camault Muir and
Glaichbea**

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

*Receptors represented: Residential properties in and around Camault Muir and
Glaichbea. Users of the local road of Post Office Brae.*

*This visualisation has been identified and created for use with the visual impact
assessment, but can also be used to inform landscape impacts on LCT229 Enclosed
Farmland.*

*The image should be viewed at a comfortable arm's length (approximately 500mm)
and viewed normally with both eyes. The printed image is representative of the
Proposed Development, but is not representative of scale or distance.*


Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



Operational View (Baseline) - 65.5°



Alignment information correct as of 22.12.2024

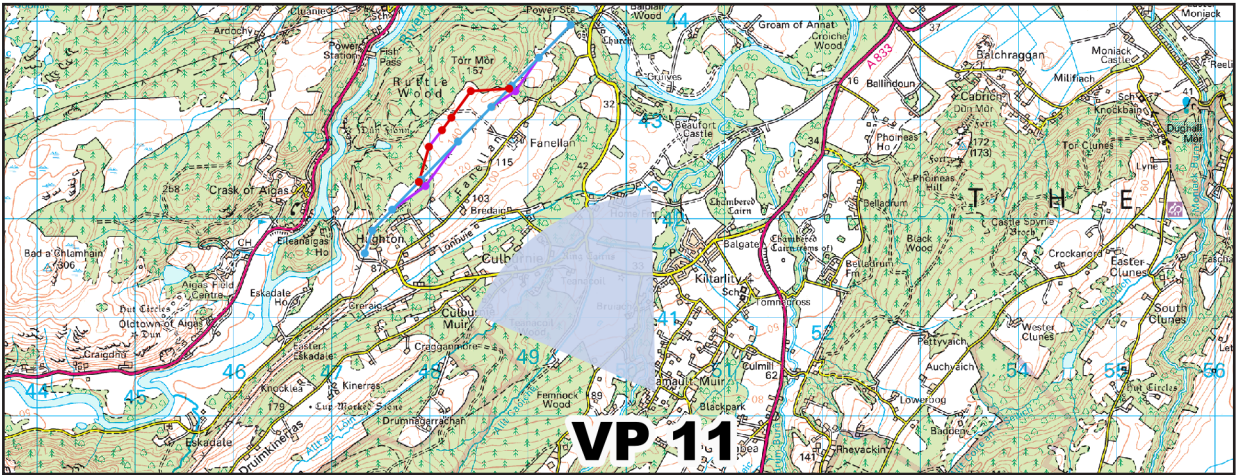

Receptors represented: Residential properties in and around Camault Muir and Glaichbea. Users of the local road of Post Office Brae.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229 Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Existing Beauly to Denny 400 kV Overhead Line
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beauly to Denny 400 kV Overhead Line Diversion

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.15c**

**Viewpoint 11: View north-west from Camault Muir and
Glaichbea
Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV
Substation & Converter Station SSEN Proposed Site) - 65.5°**

Viewpoint Location: X 250302, Y 840242
AOD: 88m
Distance to Development and Direction of view: 3101m, 326°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024





Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.15-d Viewpoint 11: View north-west from Camault Muir and Glaichbea

Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beauty to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.15-a Viewpoint 11: View north-west from Camault Muir and Glaihbha

Construction View (Photowire: Proposed Beauty to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 250302, Y 840242 AOD: 88m
 Distance to Development and Direction of view: 3101m, 326°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION