


Mapped Location

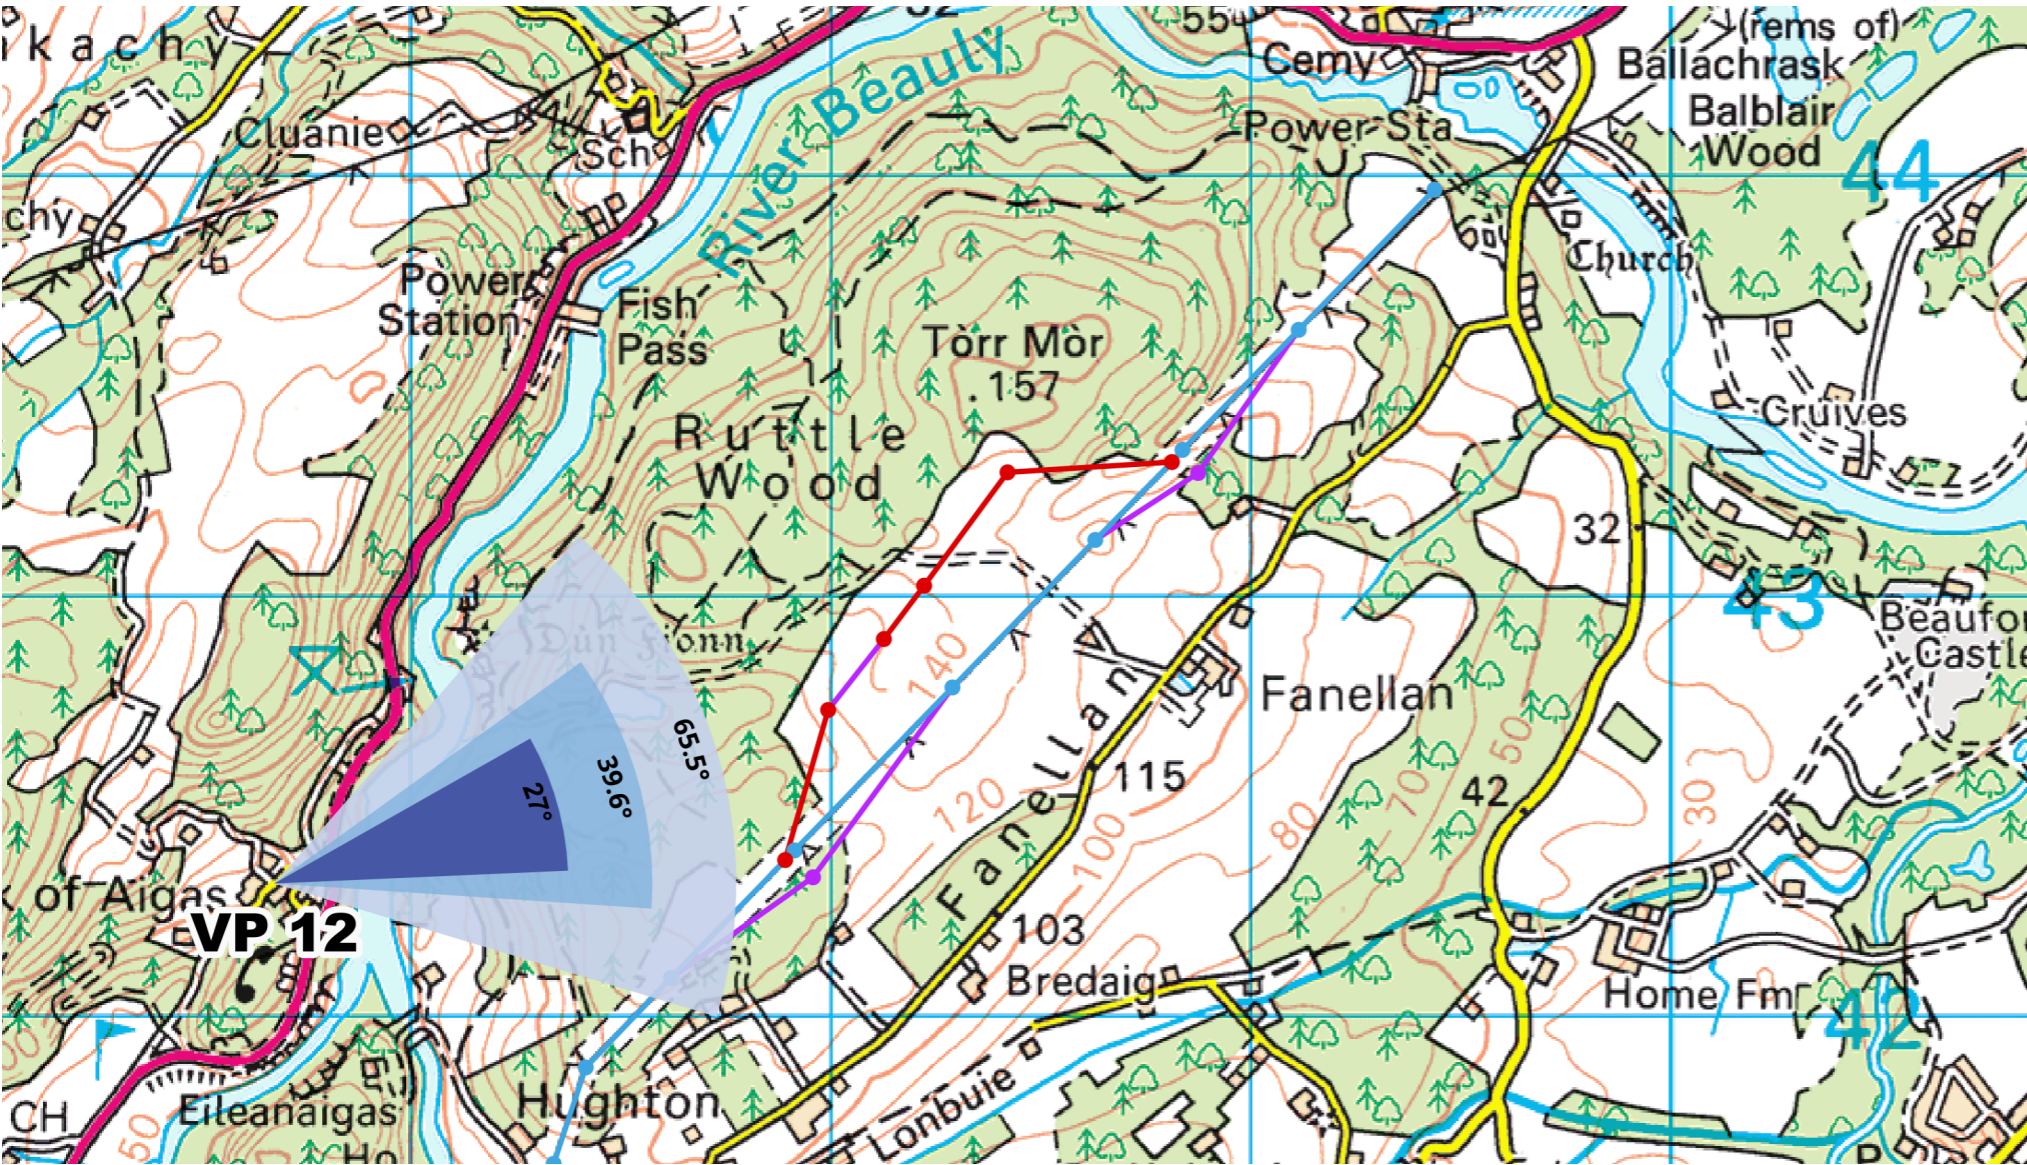

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.16a
Viewpoint 12: View looking north-east from Crask of Aigas**

Location Description:
The viewpoint is on Crask of Aigas Road, Crask of Aigas. Parking is available next to it.

Camera Location




Location Data

OSGB36 Location:	246676 842315
AOD:	101m
Camera Height:	1.5m
Distance to Development:	1336m





Alignment information correct as of 22.12.2024

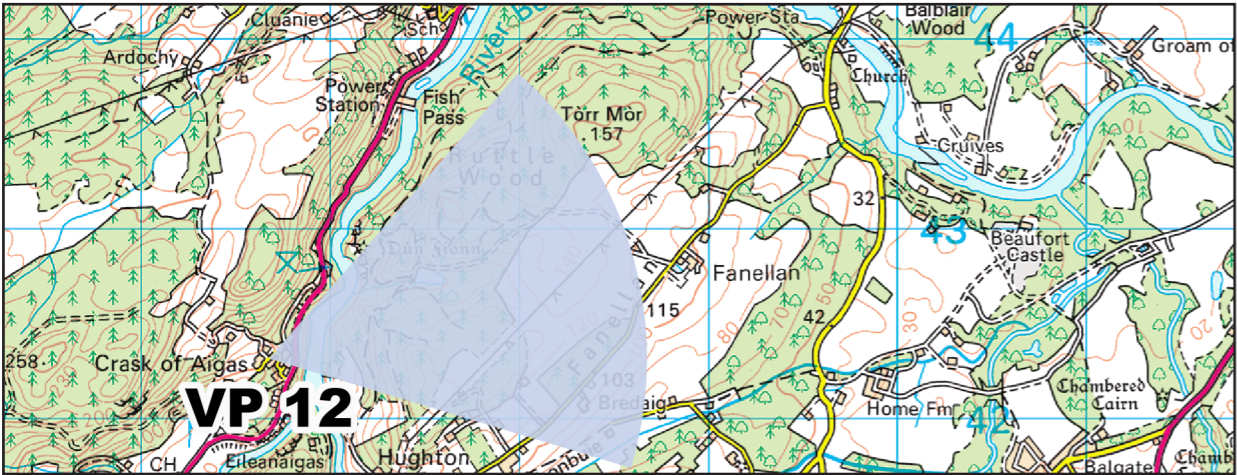

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.16b
Viewpoint 12: View looking north-east from Crask of Aigas**

Viewpoint Location: X 246676, Y 842315
AOD: 101m
Distance to Development and Direction of view: 1336m, 74°
(North-East)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024

Receptors represented: Residential properties in and around Crask of Aigas. Users of the local residential road corridor connecting Crask of Aigas to the A831 to the east.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT227 Farmed Strath - Inverness.


The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.



Operational View (Baseline) - 65.5°



Alignment information correct as of 22.12.2024

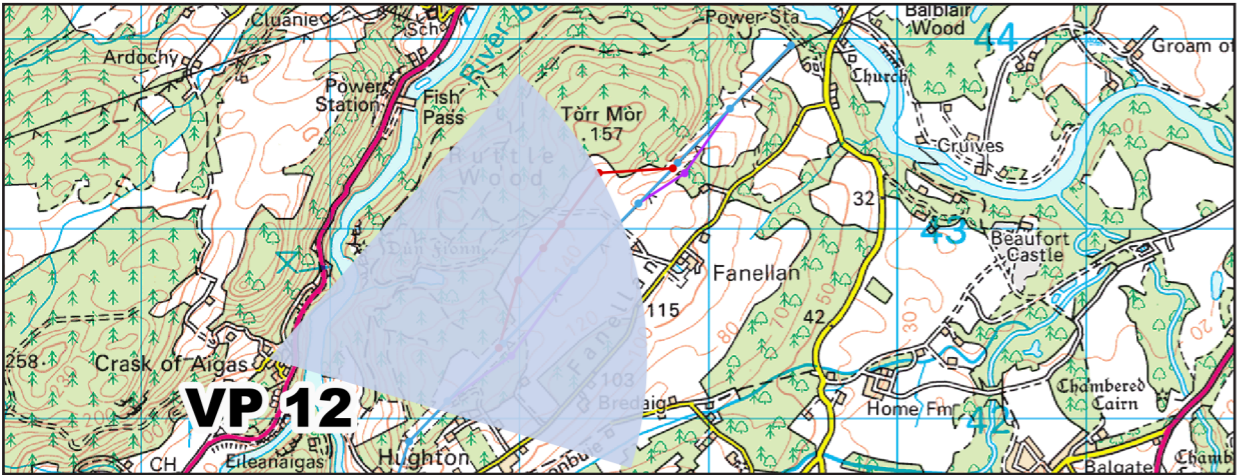

Receptors represented: Residential properties in and around Crask of Aigas. Users of the local residential road corridor connecting Crask of Aigas to the A831 to the east.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT227 Farmed Strath - Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:
- Existing Beauly to Denny 400 kV Overhead Line
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
 - Temporary Beauly to Denny 400 kV Overhead Line Diversion

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.16c
Viewpoint 12: View looking north-east from Crask of Aigas**

Viewpoint Location: X 246676, Y 842315
AOD: 101m
Distance to Development and Direction of view: 1336m, 74°
(North-East)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 05/03/2024



Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 65.5°



Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.16-d Viewpoint 12: View looking north-east from Crask of Aigas

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m
 Distance to Development and Direction of view: 1336m, 74°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beauty to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.16-a Viewpoint 12: View looking north-east from Crask of Aigas

Construction View (Photowire: Proposed Beauty to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 246676, Y 842315 AOD: 101m
 Distance to Development and Direction of view: 1336m, 74°
 Date: 05/03/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION