


Mapped Location

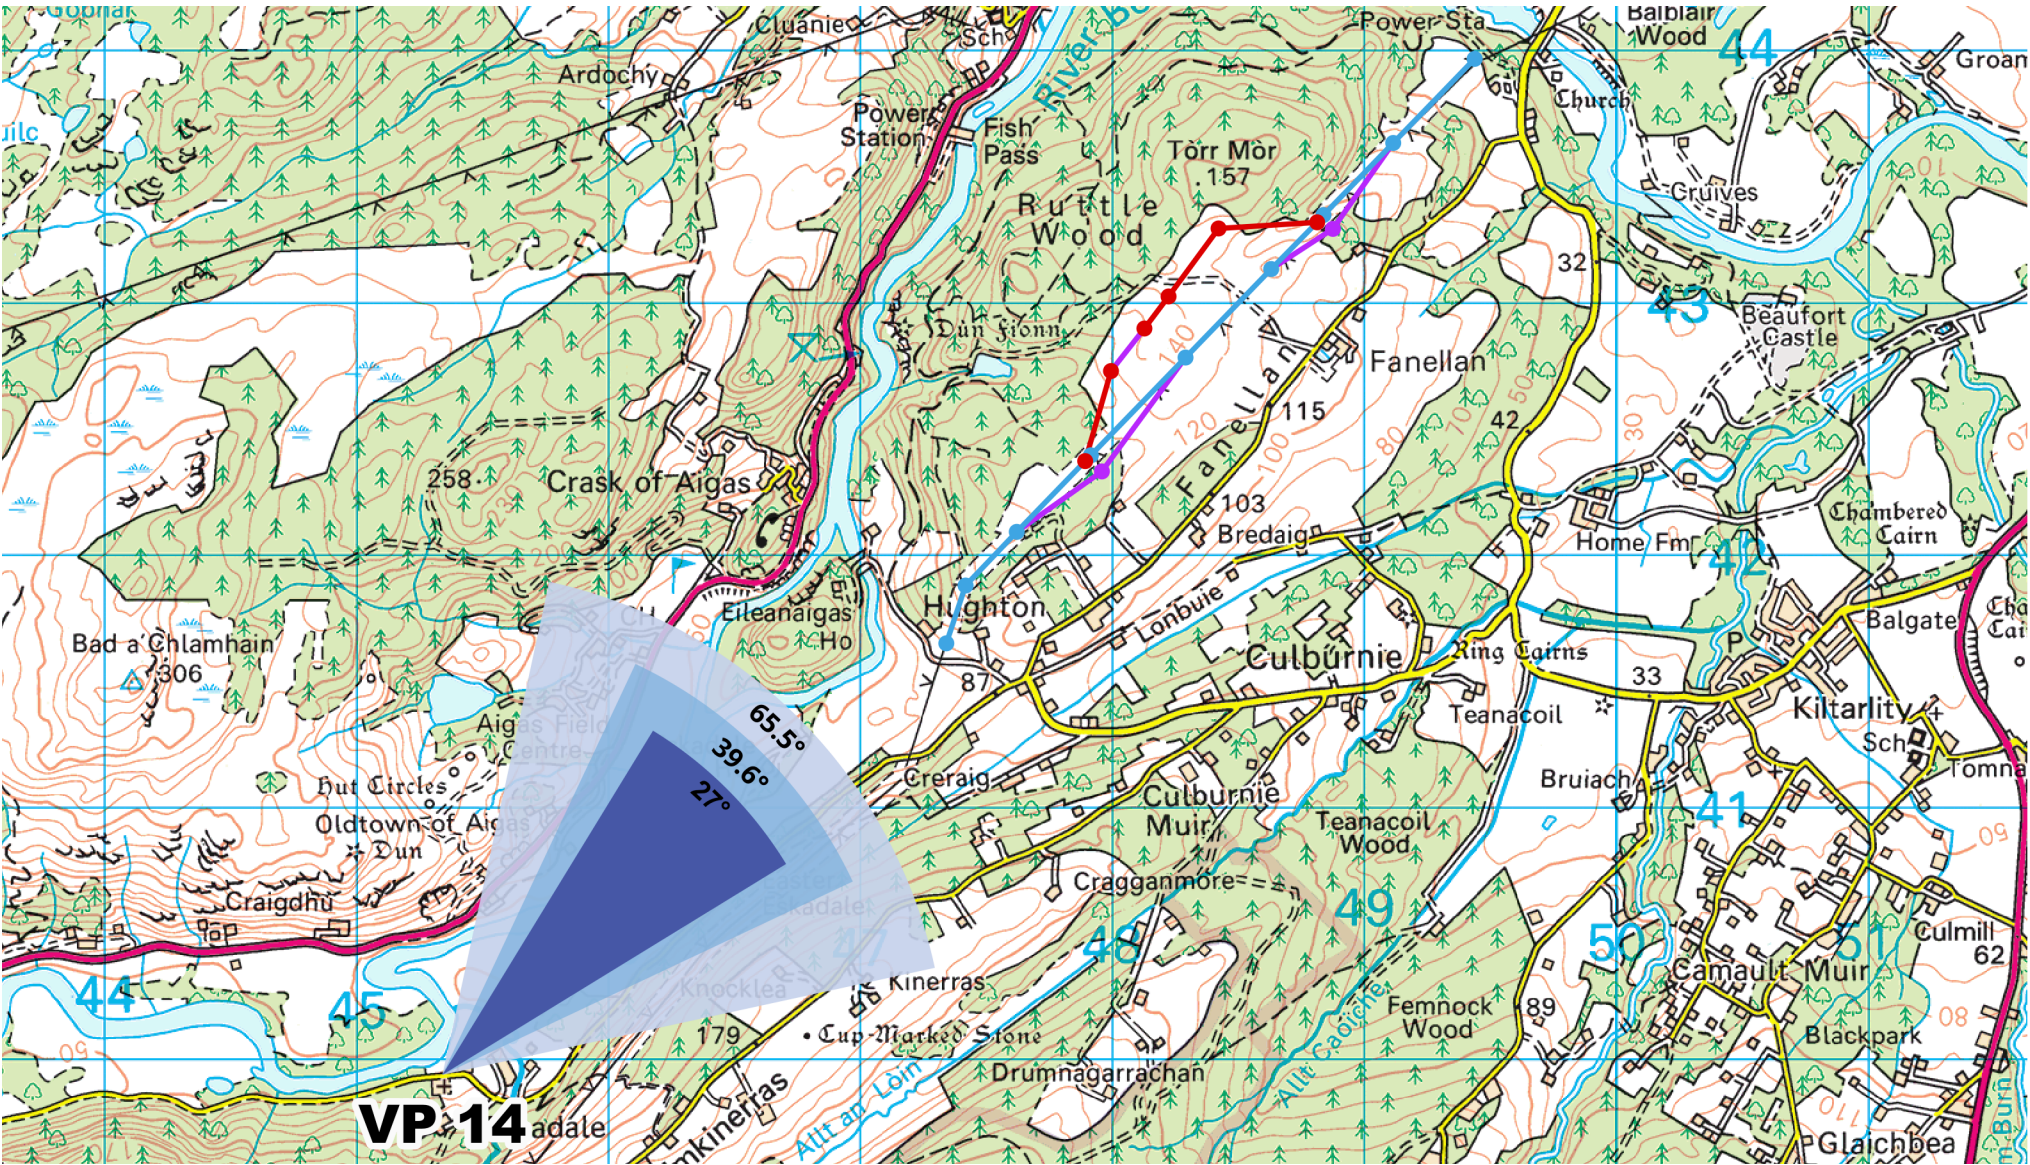

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulieu to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations  
Figure 5.18a  
Viewpoint 14: View looking northeast from Eskadale**

**Location Description:**  
The viewpoint is on an unnamed quiet road next to St Mary's Church in Eskadale and just South of the River Beaulieu. Parking can be accessed at the Church and the viewpoint is a short walk away.

Camera Location



Location Data


OSGB36 Location:	245341 839938
AOD:	57m
Camera Height:	1.5m
Distance to Development:	3744m







Alignment information correct as of 22.12.2024

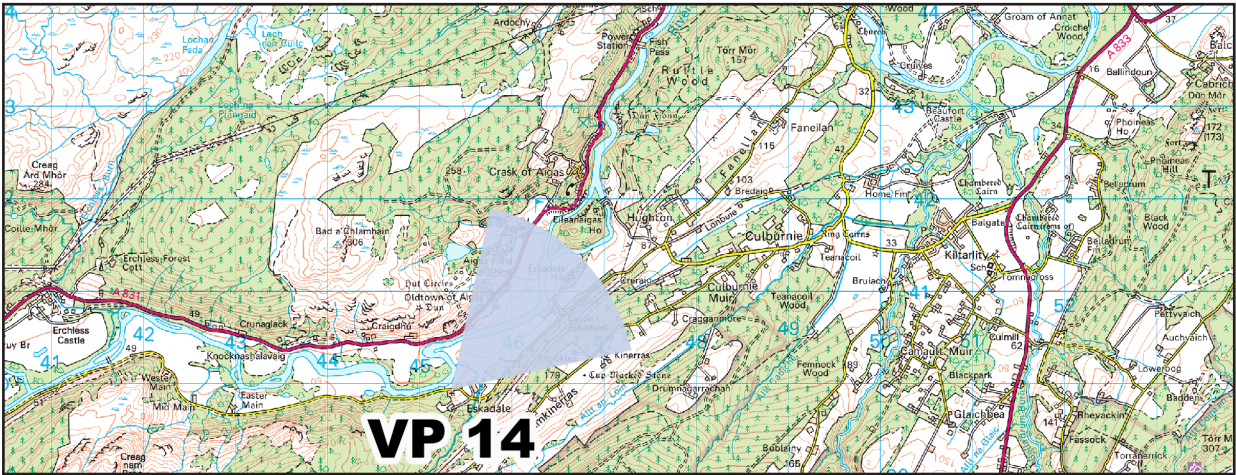

**Proposed Beaulieu to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations  
Figure 5.18b  
Viewpoint 14: View looking northeast from Eskadale**

Viewpoint Location: X 245341, Y 839938 AOD: 57m  
Distance to Development and Direction of view: 3744m, 45°  
(North-East)

*Receptors represented: Residential properties in and around Eskadale. Users of the local road connecting Eskadale.*

*This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT227 Farmed Strath-Inverness.*

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Operational View (Baseline) - 65.5°


Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 17/06/2024







Alignment information correct as of 22.12.2024

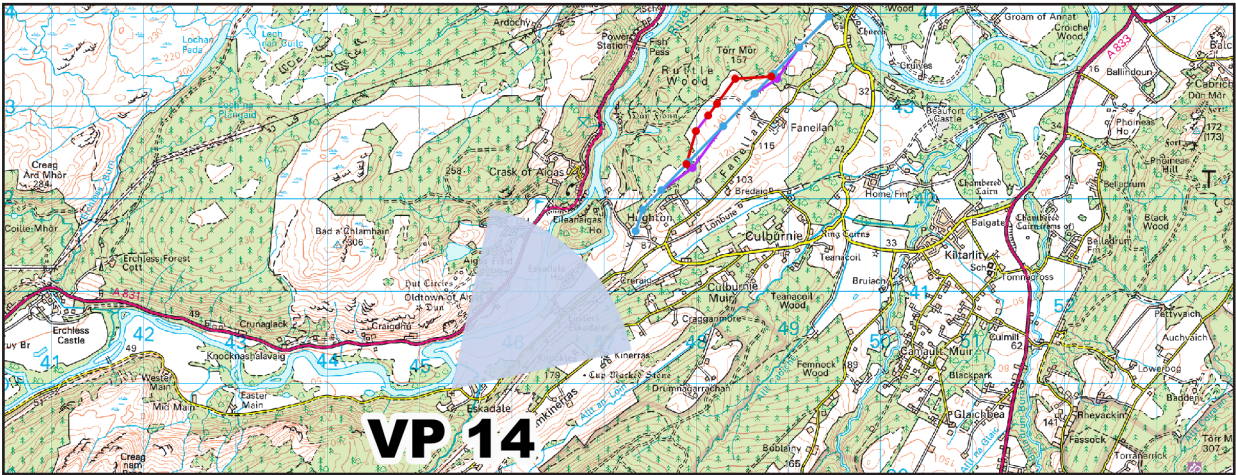

Receptors represented: Residential properties in and around Eskadale. Users of the local road connecting Eskadale.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT227 Farmed Strath-Inverness.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

Key:

- Existing Beauly to Denny 400 kV Overhead Line
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beauly to Denny 400 kV Overhead Line Diversion

**Proposed Beauly to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations  
Figure 5.18c  
Viewpoint 14: View looking northeast from Eskadale**

Viewpoint Location: X 245341, Y 839938 AOD: 57m  
Distance to Development and Direction of view: 3744m, 45°  
(North-East)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 17/06/2024



**Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead  
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV  
Substation & Converter Station SSEN Proposed Site) - 65.5°**





**Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins**  
**Figure 5.18-d Viewpoint 14: View looking northeast from Eskadale**

Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 245341, Y 839938 AOD: 57m  
 Distance to Development and Direction of view: 3744m, 45°  
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





**Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins**  
**Figure 5.18-a Viewpoint 14: View looking northeast from Eskadale**

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 245341, Y 839938 AOD: 57m  
 Distance to Development and Direction of view: 3744m, 45°  
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION