


Mapped Location

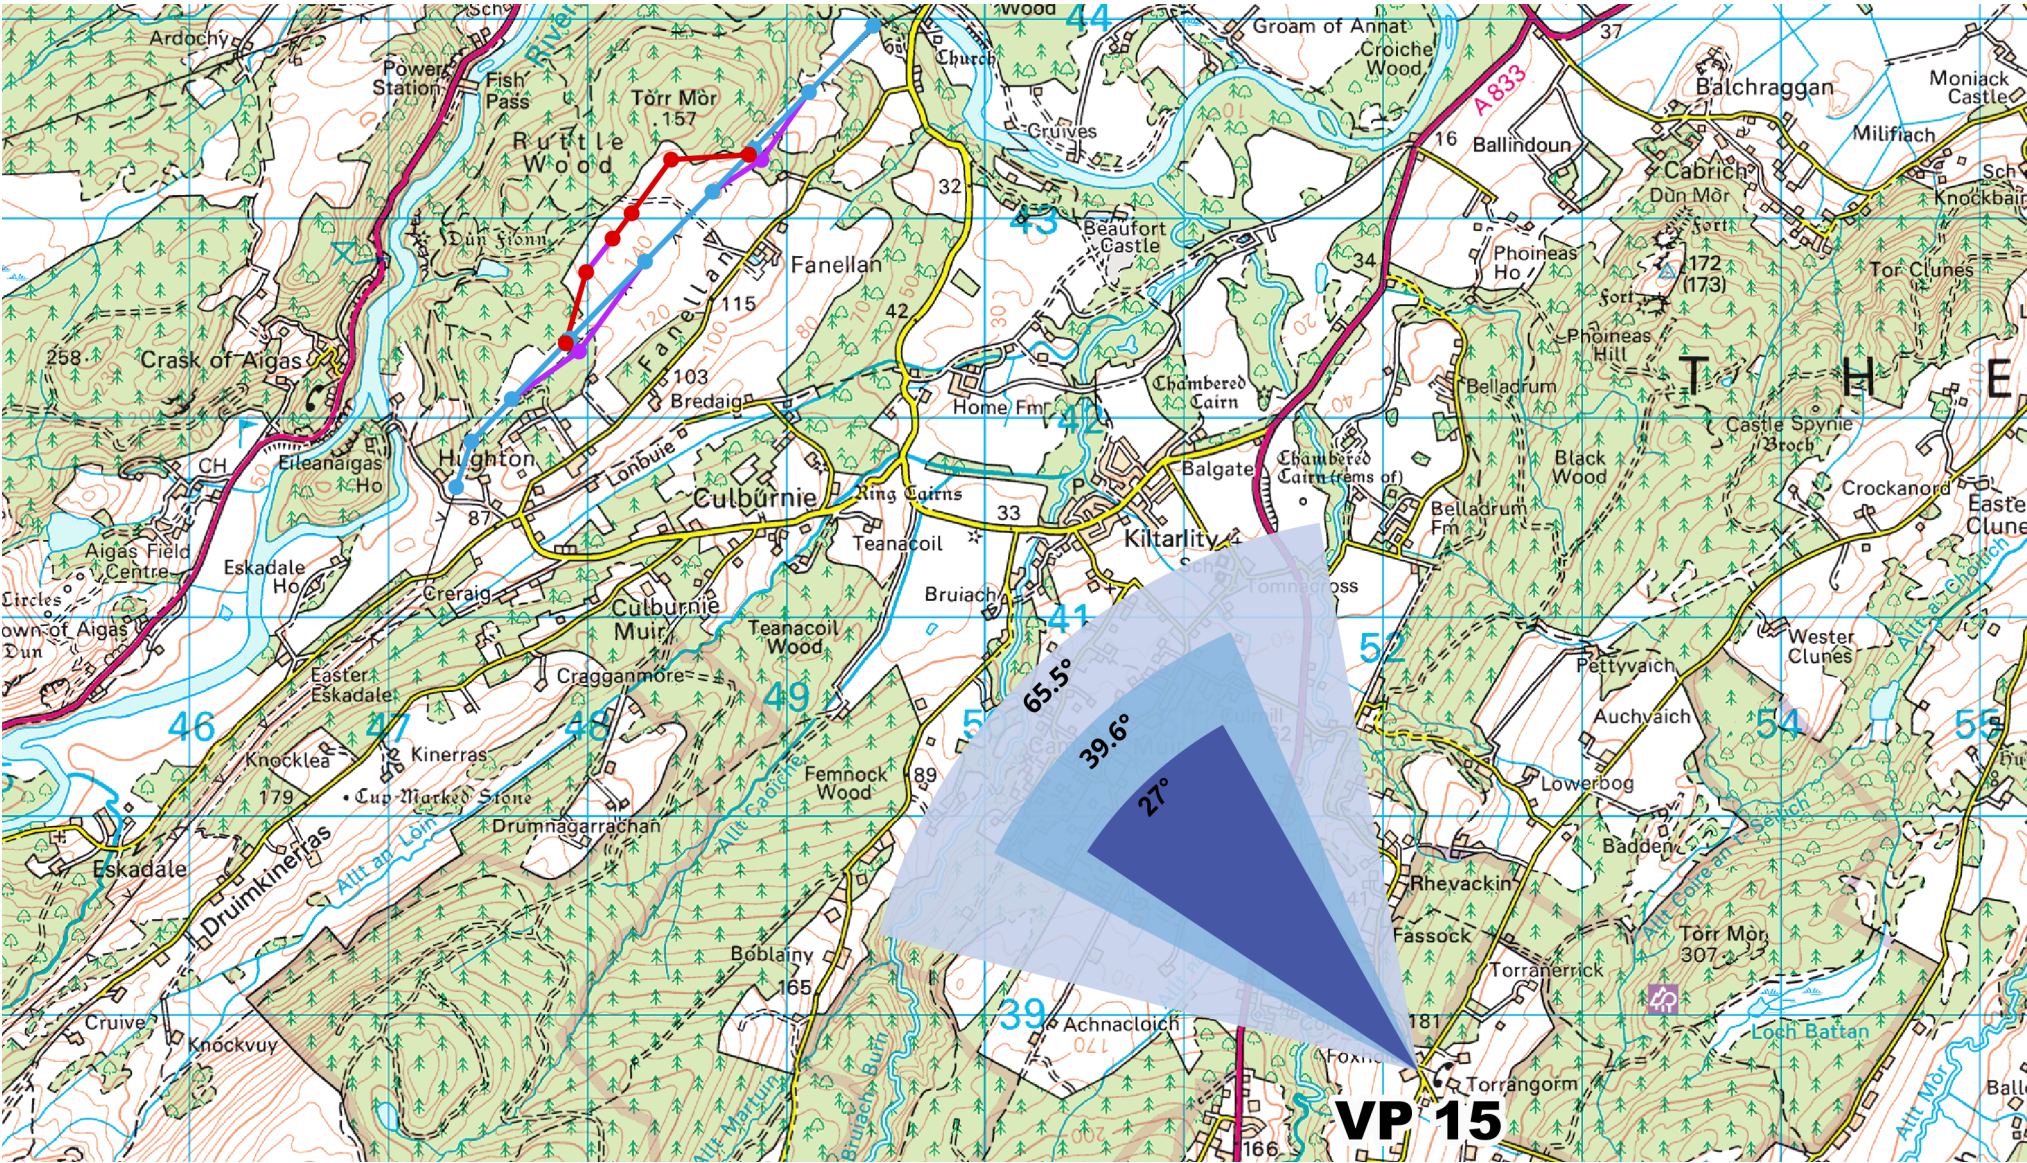

Key:

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beaulieu to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.19a
Viewpoint 15: View looking northwest from Foxhole**

Location Description:
The viewpoint is in an area called Foxhole, just west of the A833. The viewpoint is located on a quiet junction next to a telephone box and private property. Car parking is limited however, can be safely parked at the side of the junction or next to the private property.

Camera Location




Location Data

OSGB36 Location:	252180 838715
AOD:	192m
Camera Height:	1.5m
Distance to Development:	5483m



Alignment information correct as of 22.12.2024

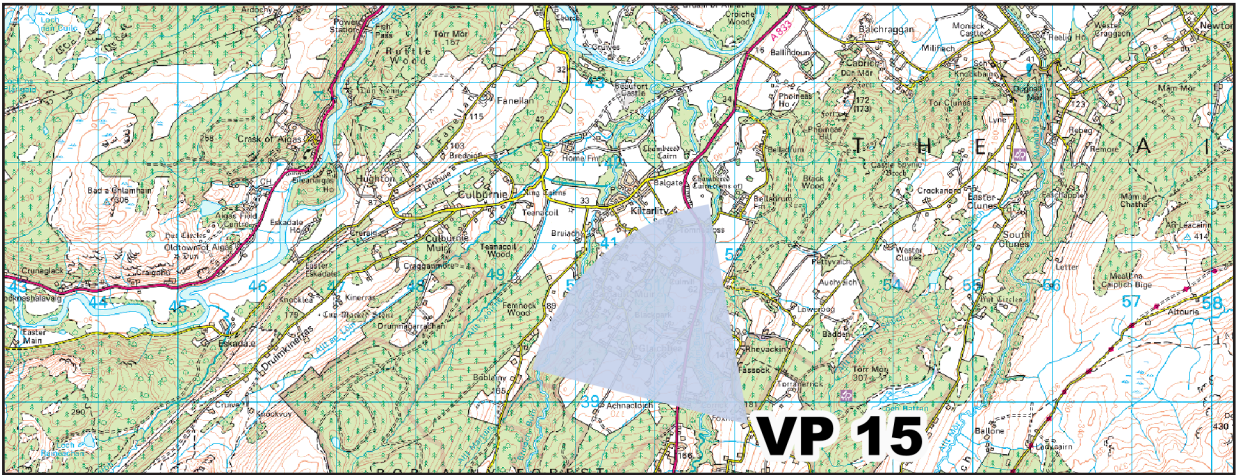

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.19b
Viewpoint 15: View looking northwest from Foxhole**

Viewpoint Location: X 252180, Y 838715 AOD: 192m
Distance to Development and Direction of view: 5483m, 317°
(North-West)

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 17/06/2024


Receptors represented: Residential properties in and around Foxhole and Torrangrom. Users of the local road connecting Foxhole and Torrangrom.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229- Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.



Alignment information correct as of 22.12.2024

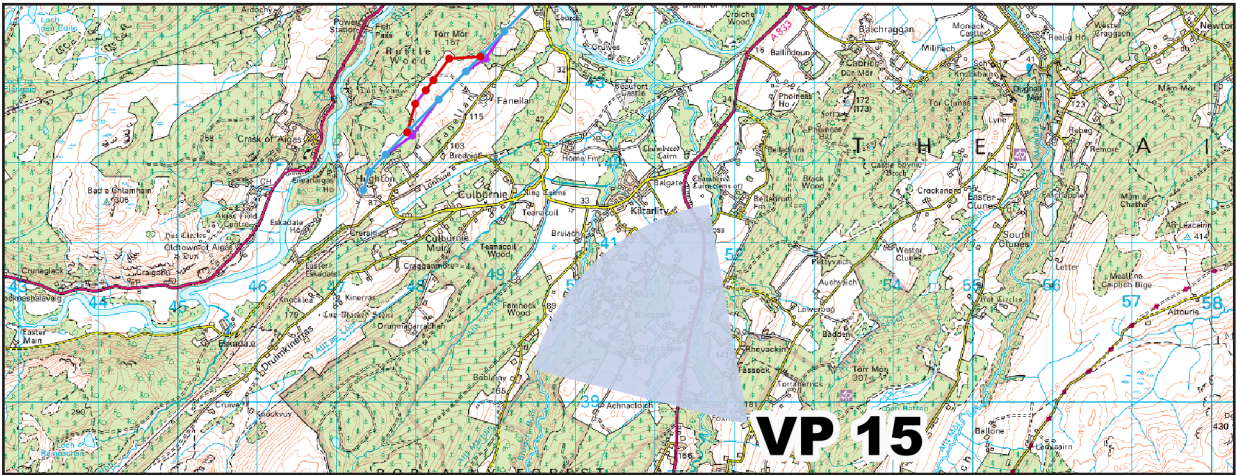

**Proposed Beauly to Denny 400 kV Overhead Line
Temporary Diversion and Permanent Tie-ins
Viewpoint Visualisations
Figure 5.19c
Viewpoint 15: View looking northwest from Foxhole**

Viewpoint Location: X 252180, Y 838715 AOD: 192m
Distance to Development and Direction of view: 5483m, 317°
(North-West)

**Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV
Substation & Converter Station SSEN Proposed Site) - 65.5°**

Receptors represented: Residential properties in and around Foxhole and Torrangrom. Users of the local road connecting Foxhole and Torrangrom.

This visualisation has been identified and created for use with the visual impact assessment, but can also be used to inform landscape impacts on LCT229- Enclosed Farmland.

The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes. The printed image is representative of the Proposed Development, but is not representative of scale or distance.

- Key:**
- Existing Beauly to Denny 400 kV Overhead Line
 - Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
 - Temporary Beauly to Denny 400 kV Overhead Line Diversion

Camera: Sony ILCE-7M4
Lens: 50mm
Height of camera above the ground: 1.5m
Date: 17/06/2024





Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.19-d Viewpoint 15: View looking northwest from Foxhole

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 252180, Y 838715 AOD: 192m
 Distance to Development and Direction of view: 5483m, 317°
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION



Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins
Figure 5.19-a Viewpoint 15: View looking northwest from Foxhole

Construction View (Photowire: Proposed Beauly to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 252180, Y 838715 AOD: 192m
 Distance to Development and Direction of view: 5483m, 317°
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4
 Lens: 50mm
 Height of camera above the ground: 1.5m



TRANSMISSION