


Mapped Location

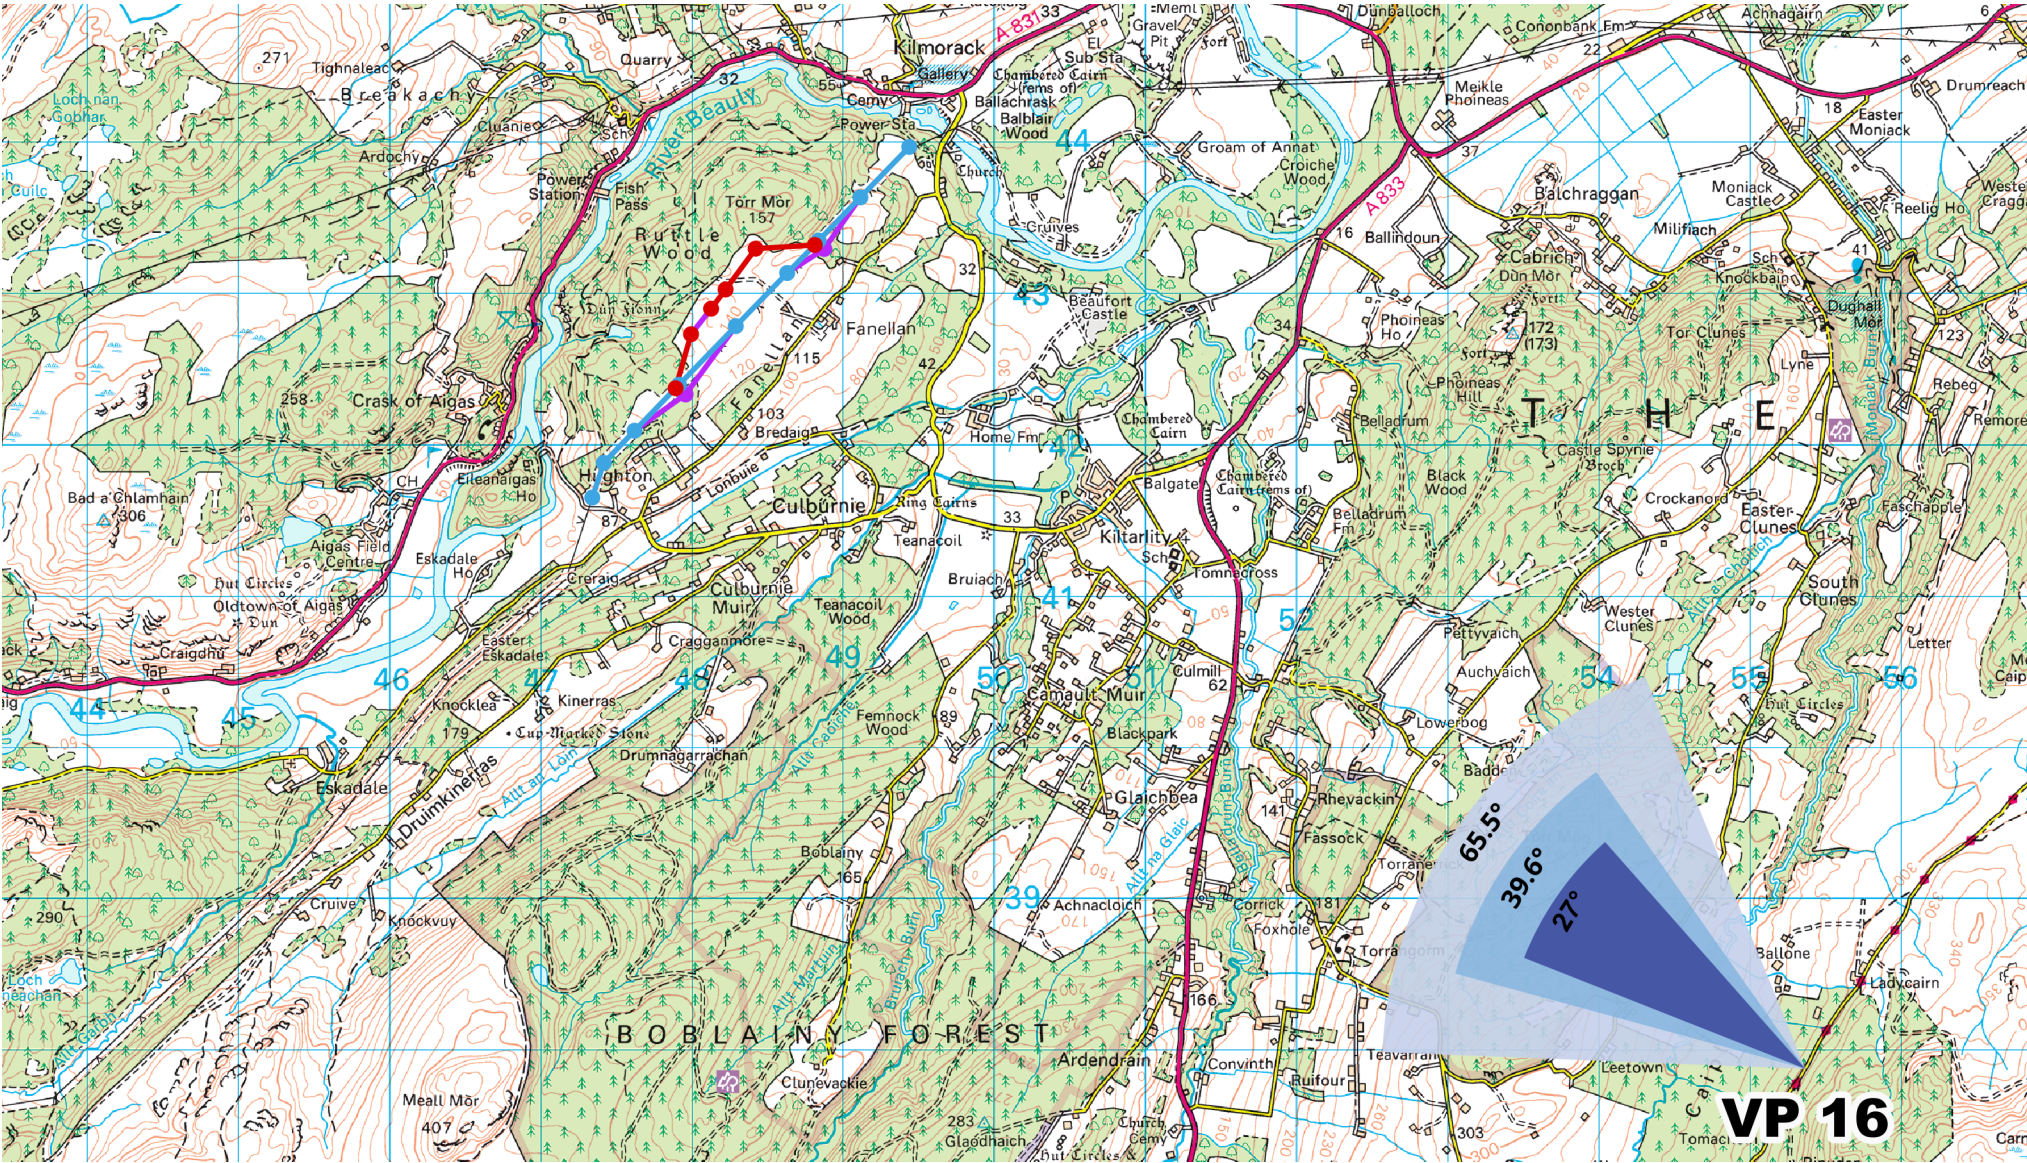

Key:

- Existing Beauly to Denny 400 kV Overhead Line
- Proposed Beauly to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beauly to Denny 400 kV Overhead Line Diversion

Alignment information correct as of 22.12.2024

**Proposed Beauly to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations  
Figure 5.20a  
Viewpoint 16: View looking northwest from the Great Glen Way**

**Location Description:**  
The viewpoint is on the Glen Way, West of the A822. Parking is limited however there are a few laybys on the road. The viewpoint can be accessed by foot from parking.

Camera Location



Location Data


OSGB36 Location:	255366 837875
AOD:	319m
Camera Height:	1.5m
Distance to Development:	8424m







Alignment information correct as of 22.12.2024

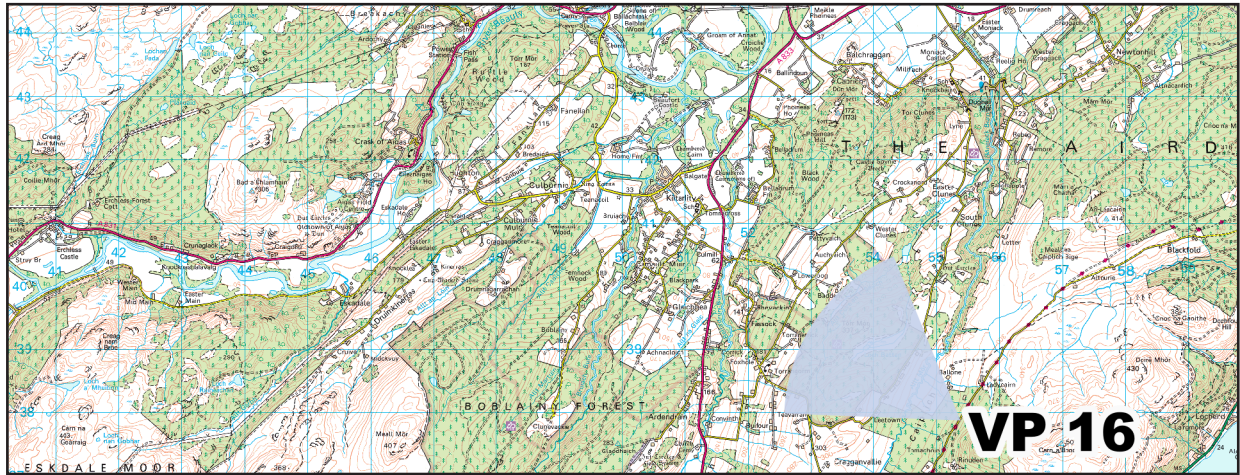

**Proposed Beauly to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations  
Figure 5.20b  
Viewpoint 16: View looking northwest from the Great Glen  
Way**

Viewpoint Location: X 255366, Y 837875 AOD: 319m  
Distance to Development and Direction of view: 8424m, 305°  
(North-West)

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 17/06/2024

*Receptors represented: Residential properties in and around Ballone.  
Recreational users of the Great Glen Way long distance walking route.*

*This visualisation has been identified and created for use with the visual  
impact assessment, but can also be used to inform landscape impacts on  
LCT222- Rocky Moorland Plateau – Inverness.*


*The image should be viewed at a comfortable arm's length (approximately  
500mm) and viewed normally with both eyes. The printed image is representative  
of the Proposed Development, but is not representative of scale or distance.*







Alignment information correct as of 22.12.2024

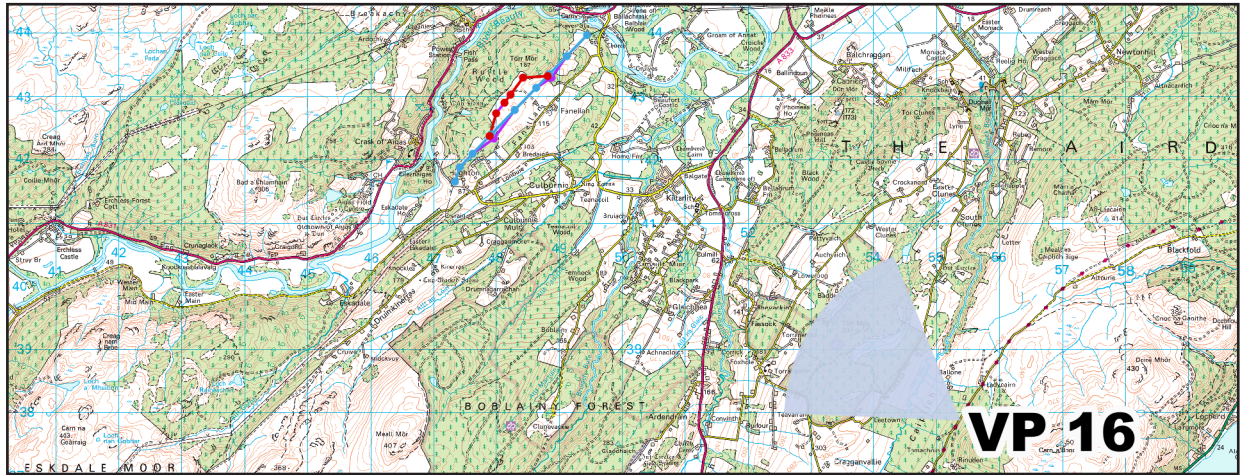

**Proposed Beaulieu to Denny 400 kV Overhead Line  
Temporary Diversion and Permanent Tie-ins  
Viewpoint Visualisations**

**Figure 5.20c**  
**Viewpoint 16: View looking northwest from the Great Glen  
Way**  
**Construction View (Photowire: Proposed Beaulieu to Denny 400 kV Overhead  
Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV  
Substation & Converter Station SSEN Proposed Site) - 65.5°**

Viewpoint Location: X 255366, Y 837875 AOD: 319m  
Distance to Development and Direction of view: 8424m, 305°  
(North-West)

**Key:**

- Existing Beaulieu to Denny 400 kV Overhead Line
- Proposed Beaulieu to Denny 400 kV Overhead Line Permanent Diversion and Tie ins
- Temporary Beaulieu to Denny 400 kV Overhead Line Diversion

*Receptors represented: Residential properties in and around Ballone.  
Recreational users of the Great Glen Way long distance walking route.*

*This visualisation has been identified and created for use with the visual  
impact assessment, but can also be used to inform landscape impacts on  
LCT222- Rocky Moorland Plateau – Inverness.*

*The image should be viewed at a comfortable arm's length (approximately  
500mm) and viewed normally with both eyes. The printed image is representative  
of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
Lens: 50mm  
Height of camera above the ground: 1.5m  
Date: 17/06/2024







**Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins**  
**Figure 5.20-d Viewpoint 16: View looking northwest from the Great Glen Way**

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSN Proposed Site) - 50mm

Viewpoint Location: X 255366, Y 837875 AOD: 319m  
 Distance to Development and Direction of view: 8424m, 305°  
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION





**Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins**  
**Figure 5.20-a Viewpoint 16: View looking northwest from the Great Glen Way**

Construction View (Photowire: Proposed Beaulay to Denny 400 kV Overhead Line Temporary Diversion and Permanent Tie-ins and Fanellan 400kV Substation & Converter Station SSEN Proposed Site) - 75mm

Viewpoint Location: X 255366, Y 837875 AOD: 319m  
 Distance to Development and Direction of view: 8424m, 305°  
 Date: 17/6/2024

*The image should be viewed at a comfortable arm's length (approximately 500mm) and viewed normally with both eyes.  
 The printed image is representative of the Proposed Development, but is not representative of scale or distance.*

Camera: Sony ILCE-7M4  
 Lens: 50mm  
 Height of camera above the ground: 1.5m



TRANSMISSION