


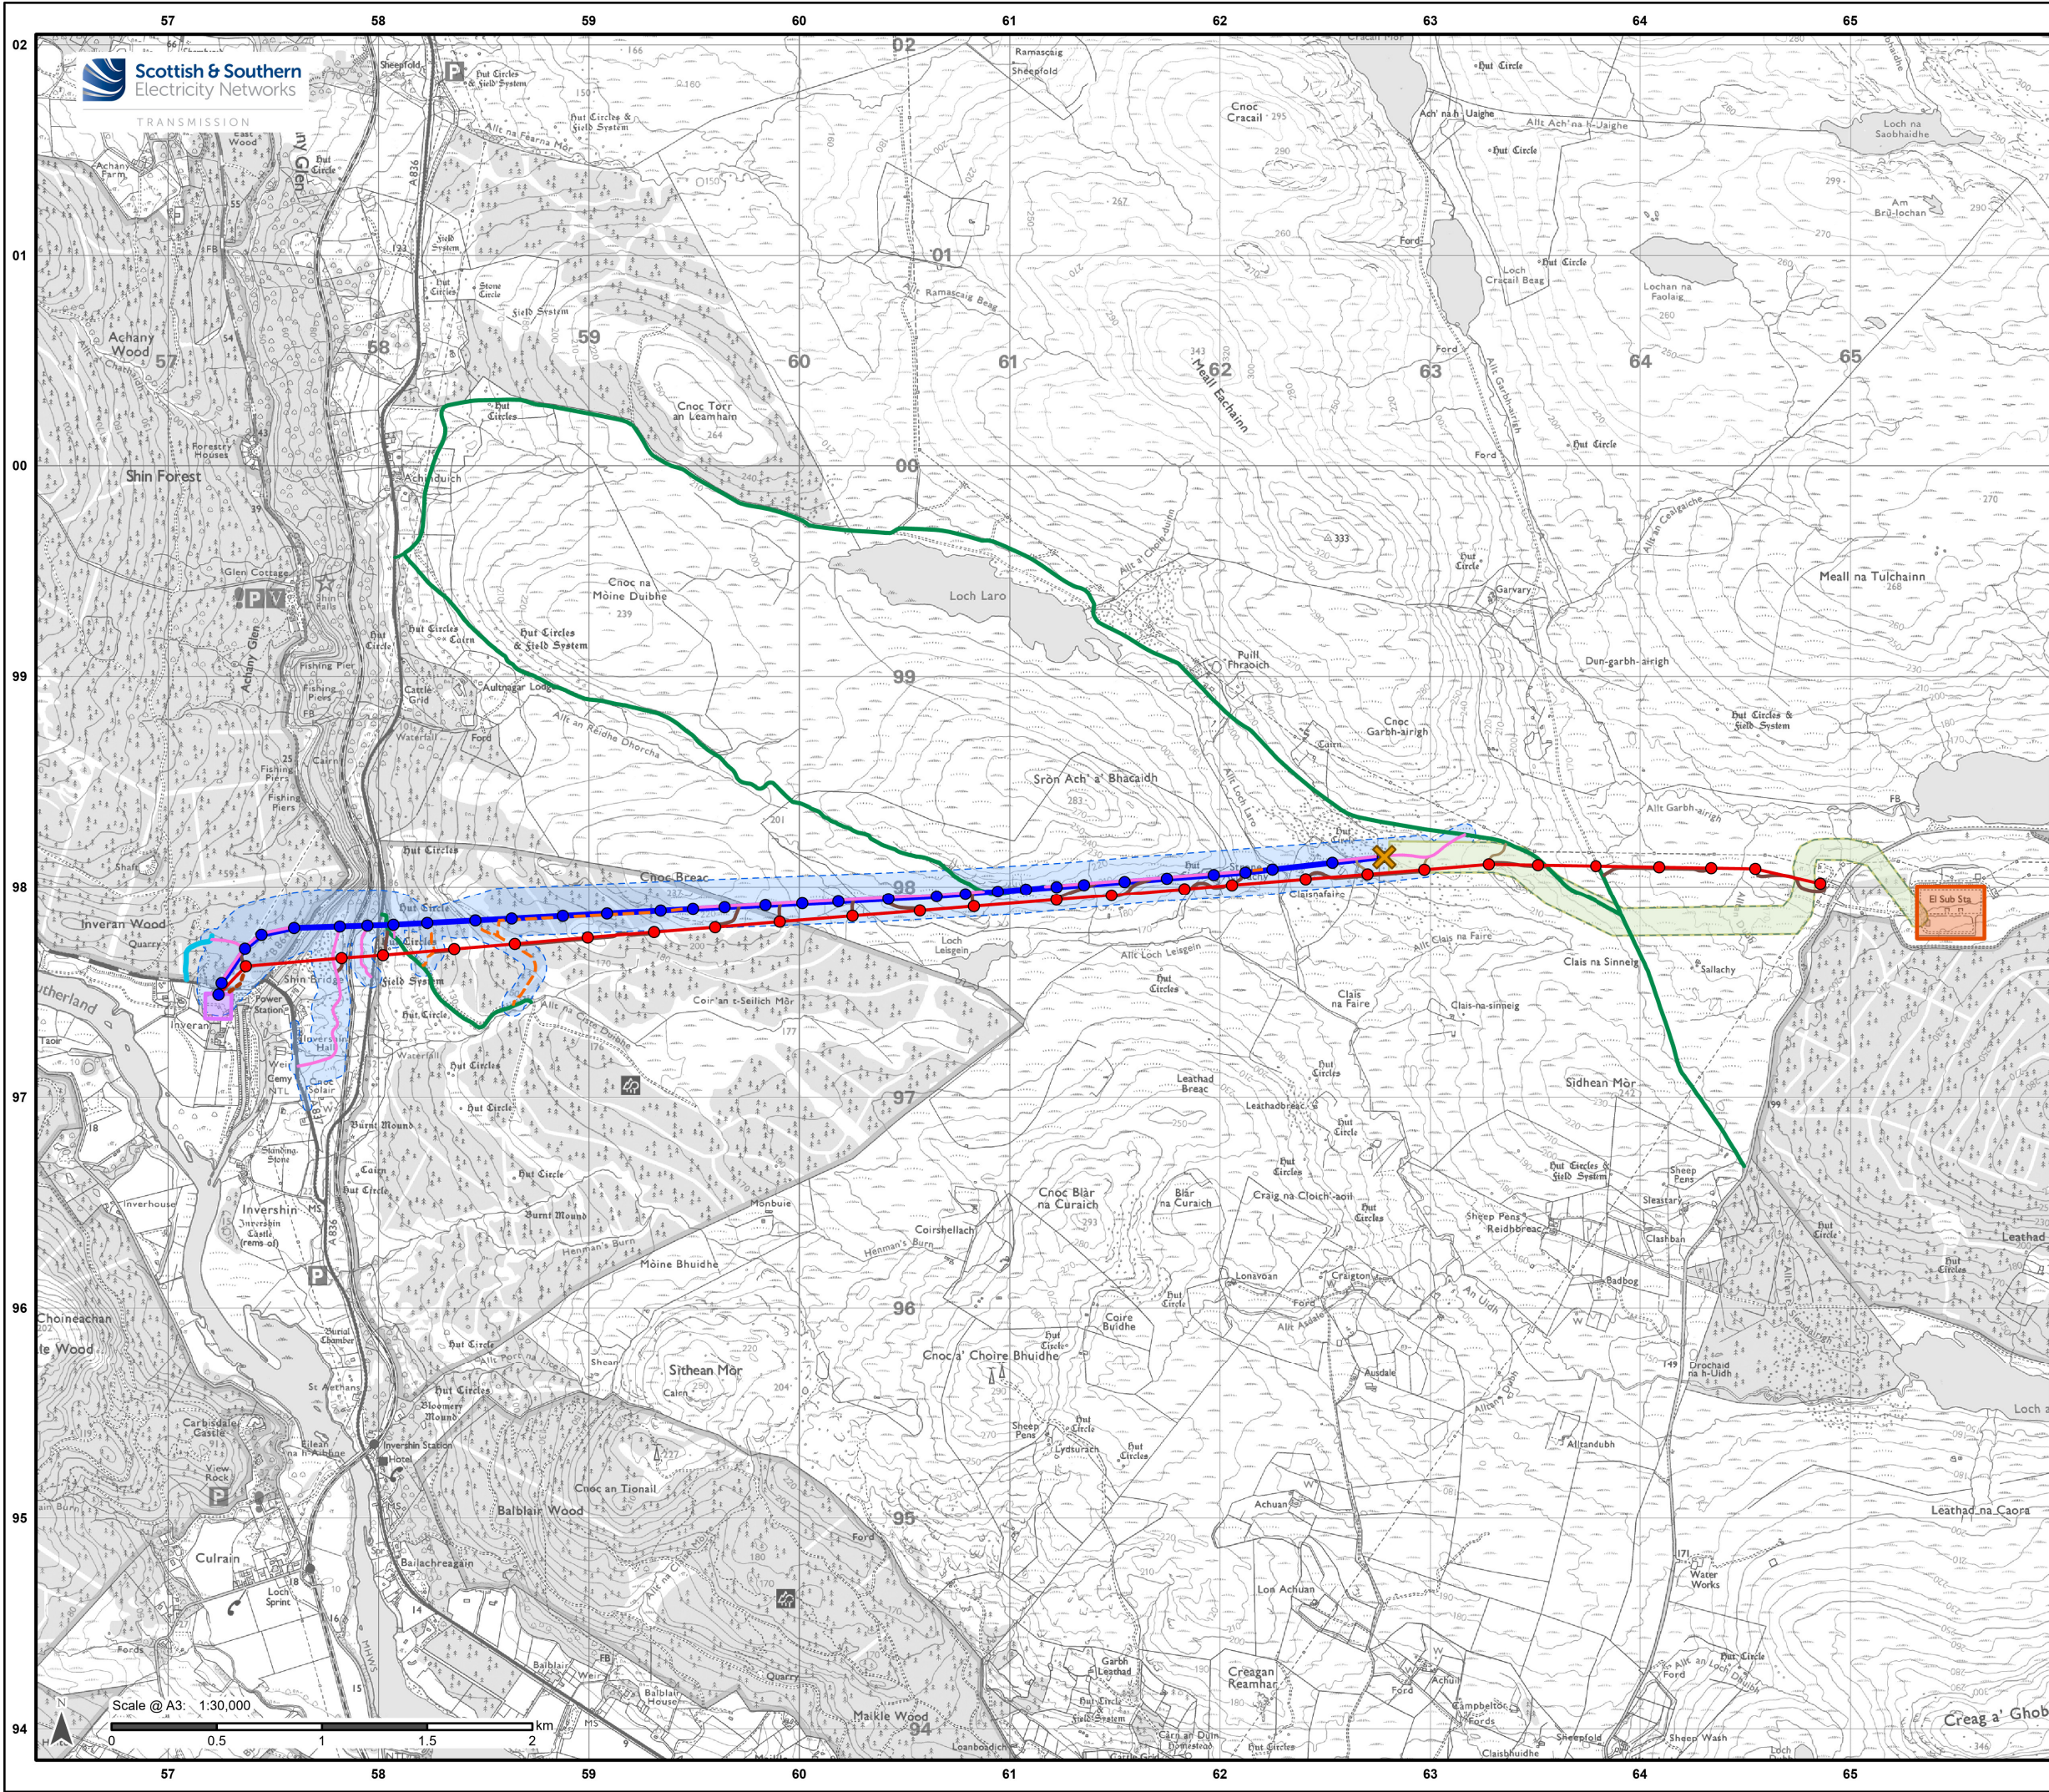

Legend

Existing Substations

- Shin
- Loch Buidhe

Proposed Development (Section 37 Application)

- OHL Tower
- OHL Alignment
- Indicative Limit of Deviation


Ancillary Works (Section 37 Application)

- Cable Sealing End Compound
- Existing Tower (to be dismantled)
- Existing OHL (to be dismantled)
- Temporary Wood Pole Diversion
- Permanent Tracks
- Temporary Tracks
- Temporary Open Ground Secondary Access Track
- Temporary Open Ground Secondary Access Track (Alternative)
- Existing Access Track To Be Upgraded
- Existing Access Track to be Upgraded (see Note 1)

Permitted Development

- Indicative Underground Cable Route

Note 1: Existing access track to be upgraded included in Spittal to Loch Buidhe to Beaully 400kV OHL (ECU00006008) application.

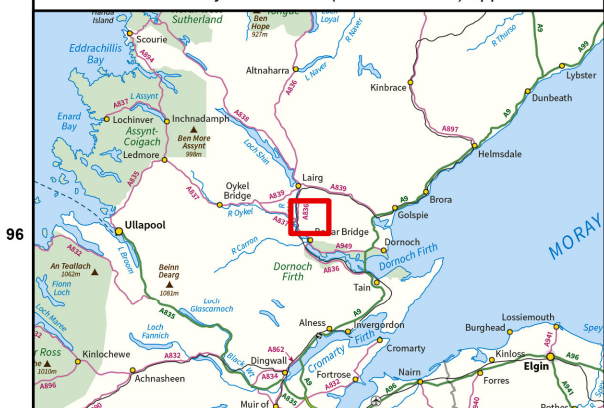

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2026 all rights reserved.
Ordnance Survey Licence number 0100022432.

Project No:	LT000499
Project:	Shin to Loch Buidhe 132 kV OHL Rebuild
Title:	Proposed Development - PAC2
Drawn by:	AMYM
Date:	08/01/2026
Drawing:	1620017309-RAM-MA-IA-00075_PAC2ProposedDev_05