


**Key**

- 2.5km Study
  - Proposed OHL Alignment
  - Temporary 132kV Diversion
  - Proposed Steel Lattice Tower
  - Existing NeSTS Tower to be Retained
  - Temporary 132kV Diversion Poles
  - Sealing End Compound
  - Existing 132 kV OHL to be Dismantled (Steel Lattice)
  - Existing 132 kV OHL to be Dismantled (Wood Pole)
  - Existing Access Track
  - Existing Access Track to be Upgraded
  - New Permanent Access Track (construction type to be determined)
  - New Temporary Access Track
  - New Temporary Spur to Towers
  - Zone of Theoretical Visibility (ZTV)
- Designated and Protected Landscapes
- Special Landscape Area (SLA)
  - Wild Land Area (WLA)

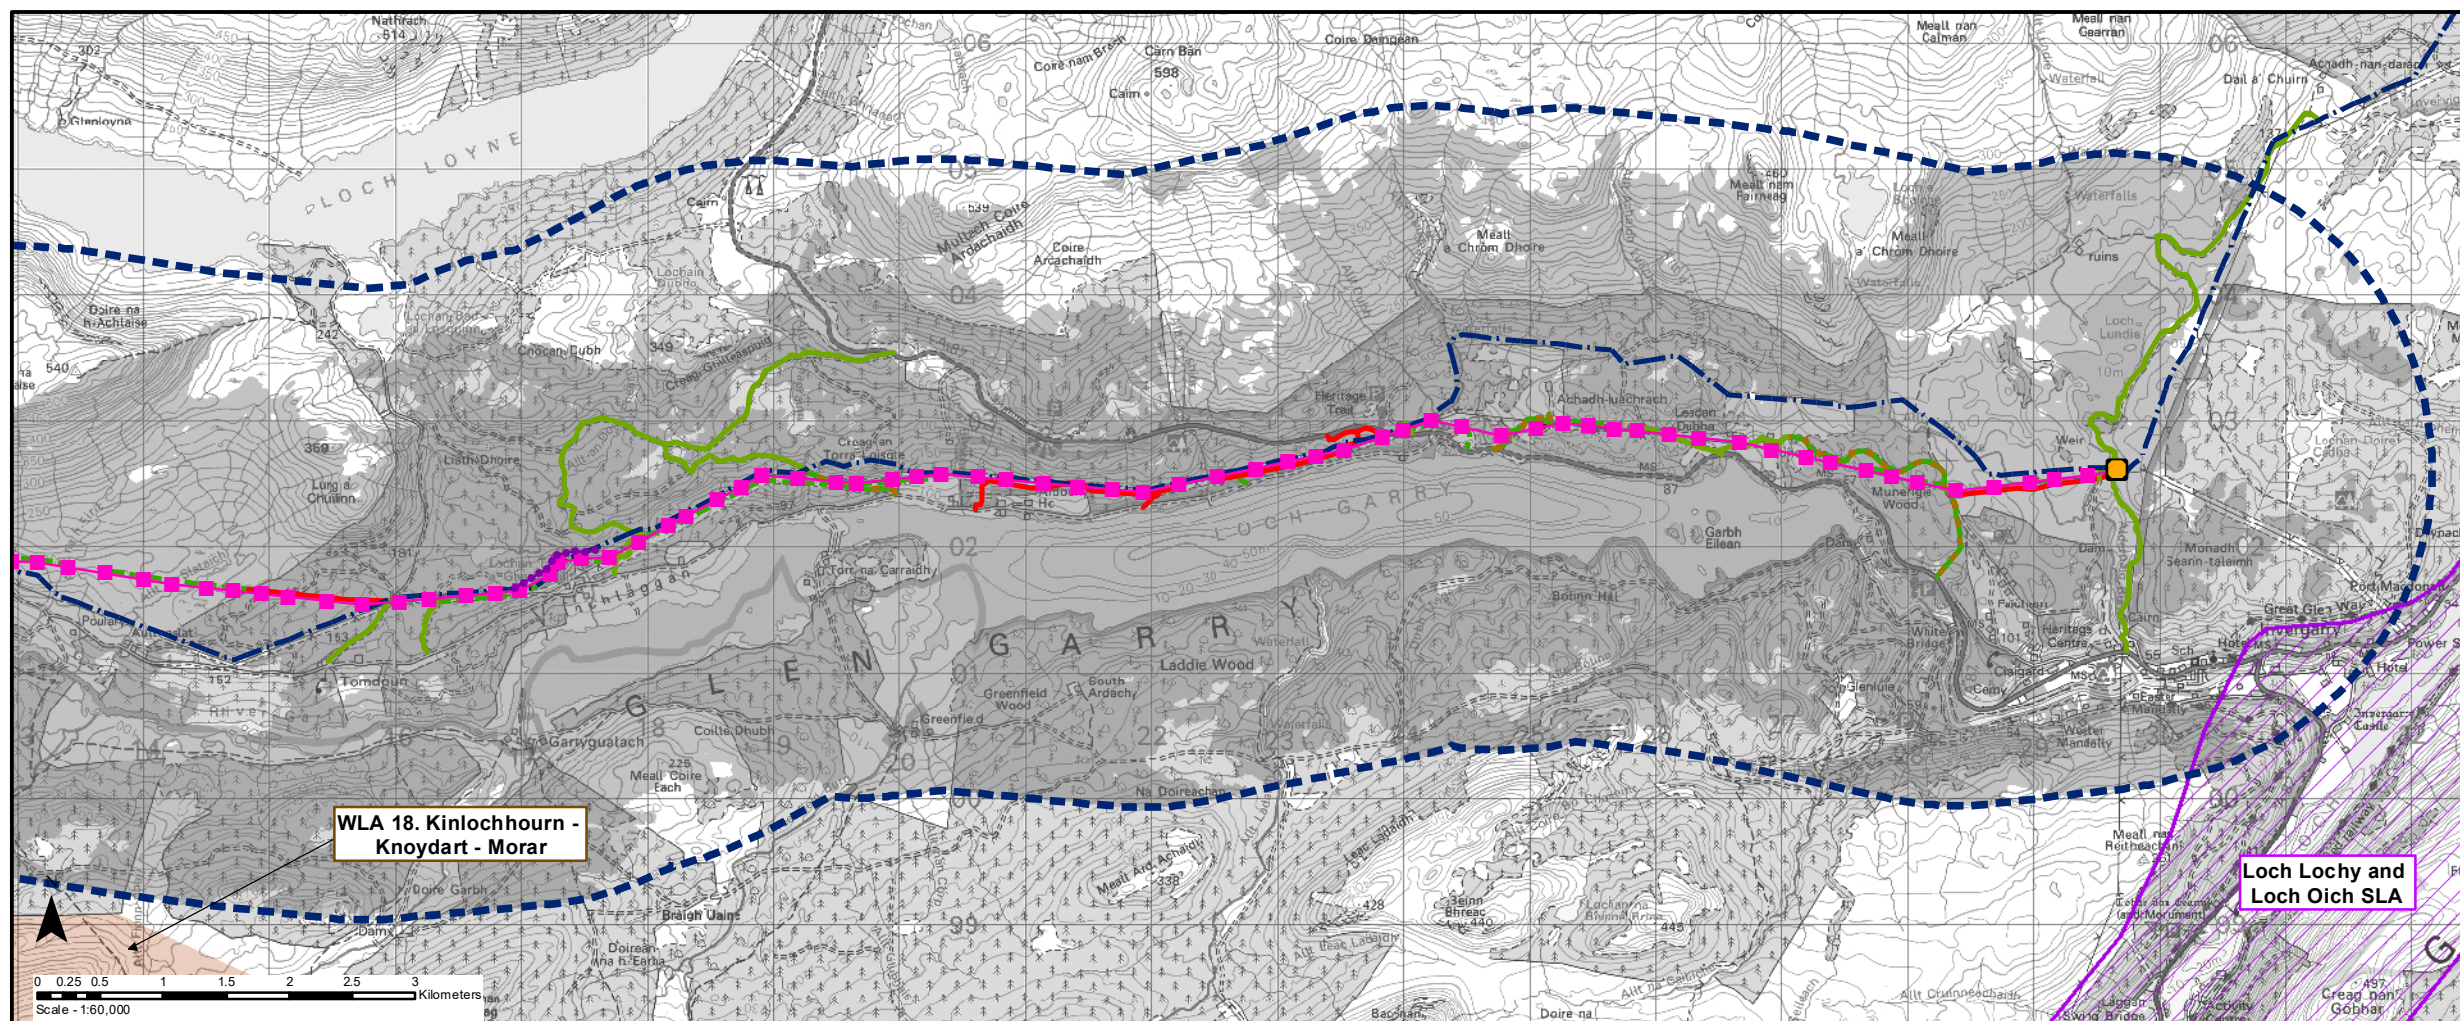

Reproduced by permission of Ordnance Survey on behalf of HMSO.  
Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.

Project No:	LT91
Project:	Skye Reinforcement Project
Title:	Figure V2-3.2-S5 Section 5 Designated and Protected Landscapes
Drawn by:	LV <span style="float: right;">26/08/2022</span>
Drawing:	119026-D-EIA-V2-3.2-S5-1.0.0