


LCZ 5-1 – Eastern Loch Cuaich to Pouлары

LCZ 5-2 – Pouлары to Munerigie Wood

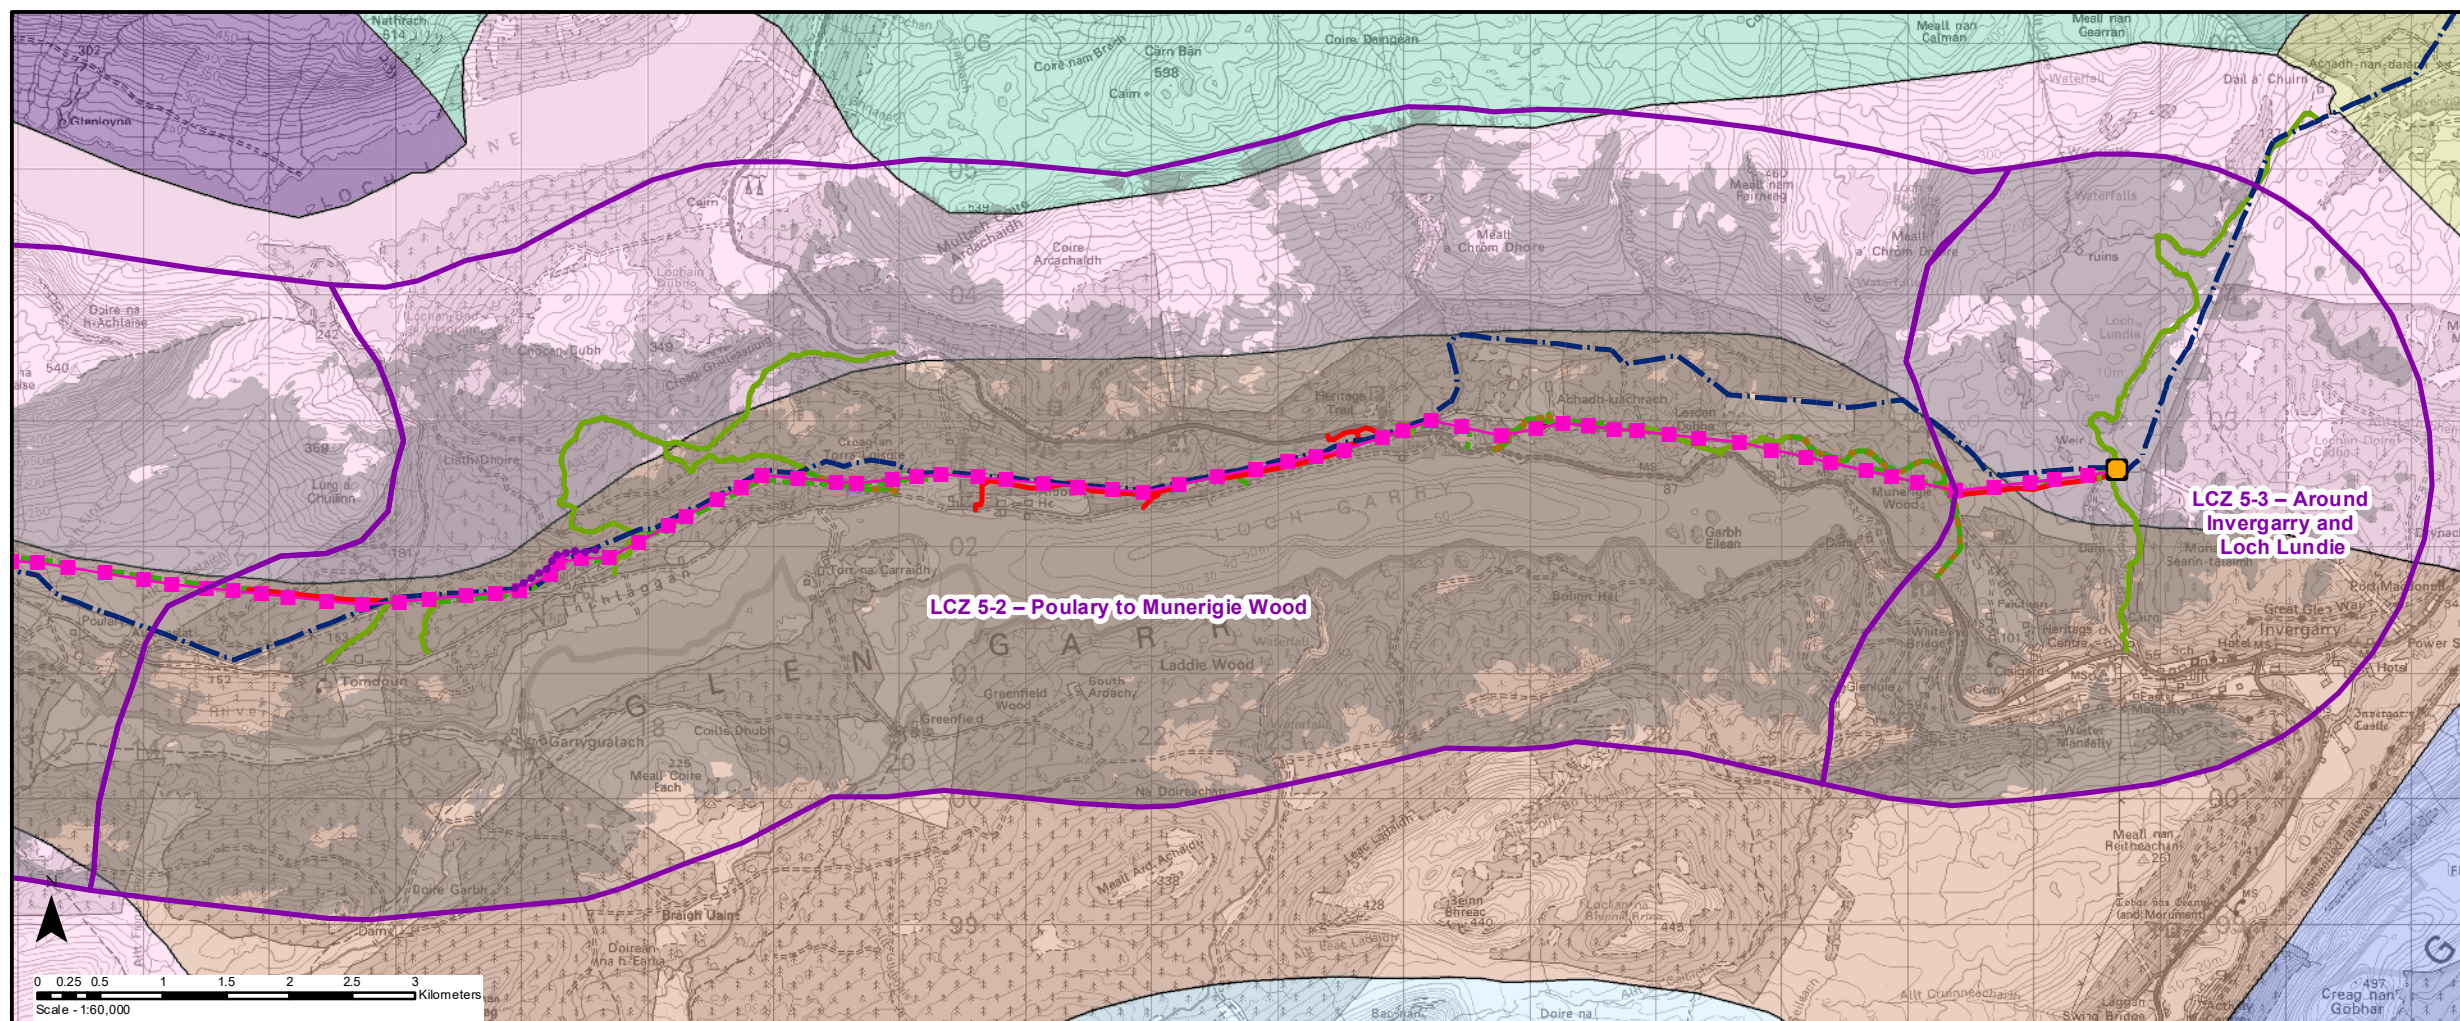

LCZ 5-2 – Pouлары to Munerigie Wood

LCZ 5-3 – Around Invergarry and Loch Lundie

- Key**
- 2.5km Study Area
 - Proposed OHL Alignment
 - Temporary 132kV Diversion
 - Proposed Steel Lattice Tower
 - Existing NeSTS Tower to be Retained
 - Temporary 132kV Diversion Poles
 - Sealing End Compound
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (construction type to be determined)
 - New Temporary Access Track
 - New Temporary Spur to Towers
 - Zone of Theoretical Visibility (ZTV)

- Landscape Assessment**
- Local Character Zones (LCZ)

- Landscape Character Types (LCT)**
- LCT 220: Rugged Massif - Inverness
 - LCT 225: Broad Steep-Sided Glen
 - LCT 235: Broad Forested Strath
 - LCT 236: Smooth Moorland Ridges
 - LCT 237: Rocky Moorland - Lochaber
 - LCT 239: Interlocking Sweeping Peaks - Lochaber
 - LCT 365: Rugged Massif - Skye & Lochalsh
 - LCT 369: Interlocking Sweeping Peaks - Skye & Lochalsh

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project

Title: Figure V2-3.3-S5
Section 5 Landscape Character

Drawn by: LV 26/08/2022
Drawing: 119026-D-EIA-V2-3.3-S5-1.0.0

